

|   |       |     |    |    |            |            |
|---|-------|-----|----|----|------------|------------|
| ■ | HUS26 | USP | 18 | NA | 16d/3-1/2" | 16d/3-1/2" |
|---|-------|-----|----|----|------------|------------|



| LVL    |        |                             |       |         |          |
|--------|--------|-----------------------------|-------|---------|----------|
| PlotID | Length | Product                     | Plies | Net Qty | Fab Type |
| GDH-3  | 13-0-0 | 1-3/4"x 11-7/8" LVL Kerto-S | 2     | 2       | FF       |

**All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.**

**-- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs**

**Truss Placement Plan**  
SCALE: 1/4"=1'

△ = Indicates Left End of Truss  
(Reference Engineered Truss Drawing)  
Do NOT Erect Truss Backwards

**LOAD CHART FOR JACK STUDS**

(BASED ON TABLES B502.5(1) & (2))  
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS

| END REACTION (UP TO) @ END OF HEADERS | END REACTION (UP TO) @ END OF HEADERS | END REACTION (UP TO) @ END OF HEADERS |
|---------------------------------------|---------------------------------------|---------------------------------------|
| 1700                                  | 2550                                  | 3400                                  |
| 3400                                  | 5100                                  | 6800                                  |
| 5100                                  | 7650                                  | 10200                                 |
| 6800                                  | 10200                                 | 13600                                 |
| 8500                                  | 12750                                 | 17000                                 |
| 10200                                 | 15300                                 |                                       |
| 11900                                 |                                       |                                       |
| 13600                                 |                                       |                                       |
| 15300                                 |                                       |                                       |

|                  |                               |                  |                  |
|------------------|-------------------------------|------------------|------------------|
| <b>BUILDER</b>   | Weaver Development Co. Inc.   | <b>COUNTY</b>    | Johnston         |
| <b>JOB NAME</b>  | Lot 5 West Pointe III         | <b>ADDRESS</b>   | 109 Hillwood Dr. |
| <b>PLAN</b>      | Gaston II (181035B) w/3rd Car | <b>MODEL</b>     | Roof             |
| <b>SEAL DATE</b> | N/A                           | <b>DATE REV.</b> | //               |
| <b>QUOTE #</b>   |                               | <b>DRAWN BY</b>  | Marshall Naylor  |
| <b>JOB #</b>     | J0923-5063                    | <b>SALESMAN</b>  | Lenny Norris     |



**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Marshall Naylor

**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444

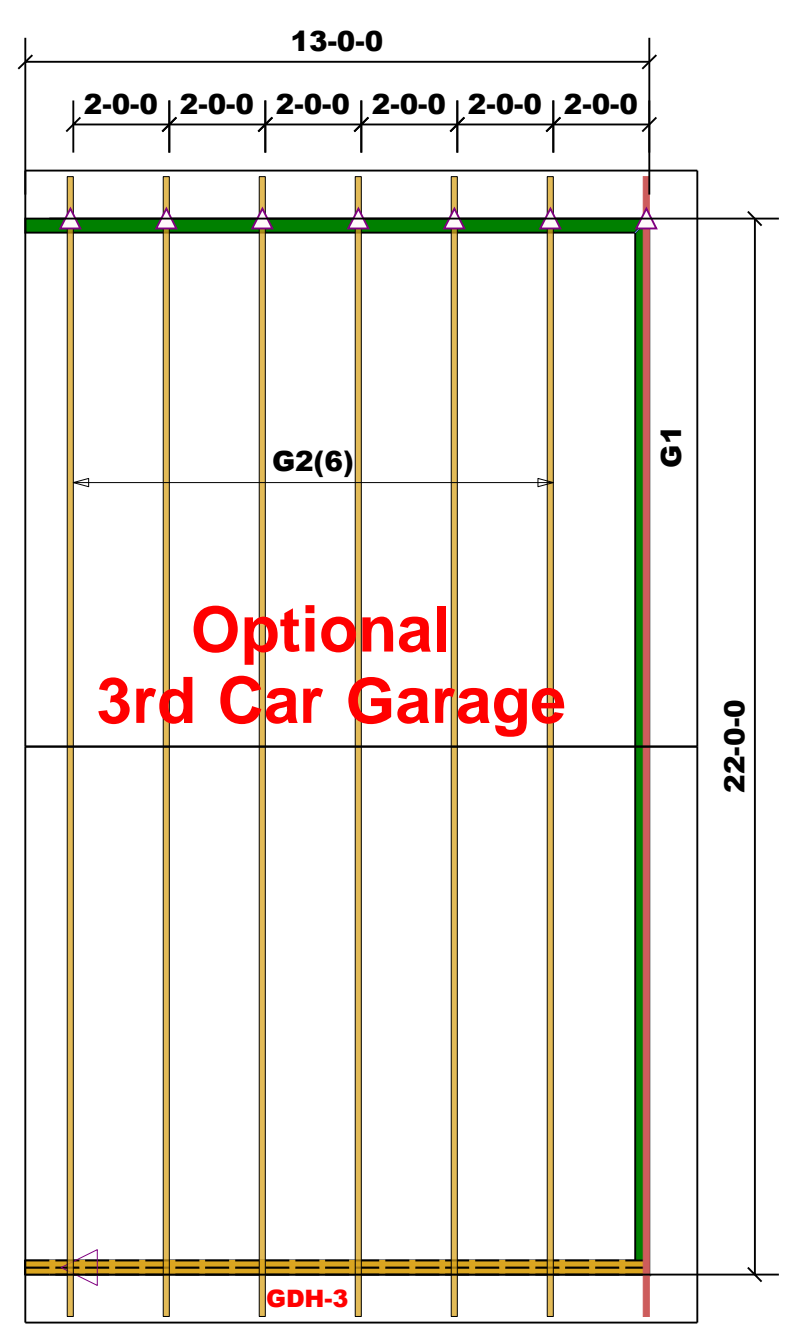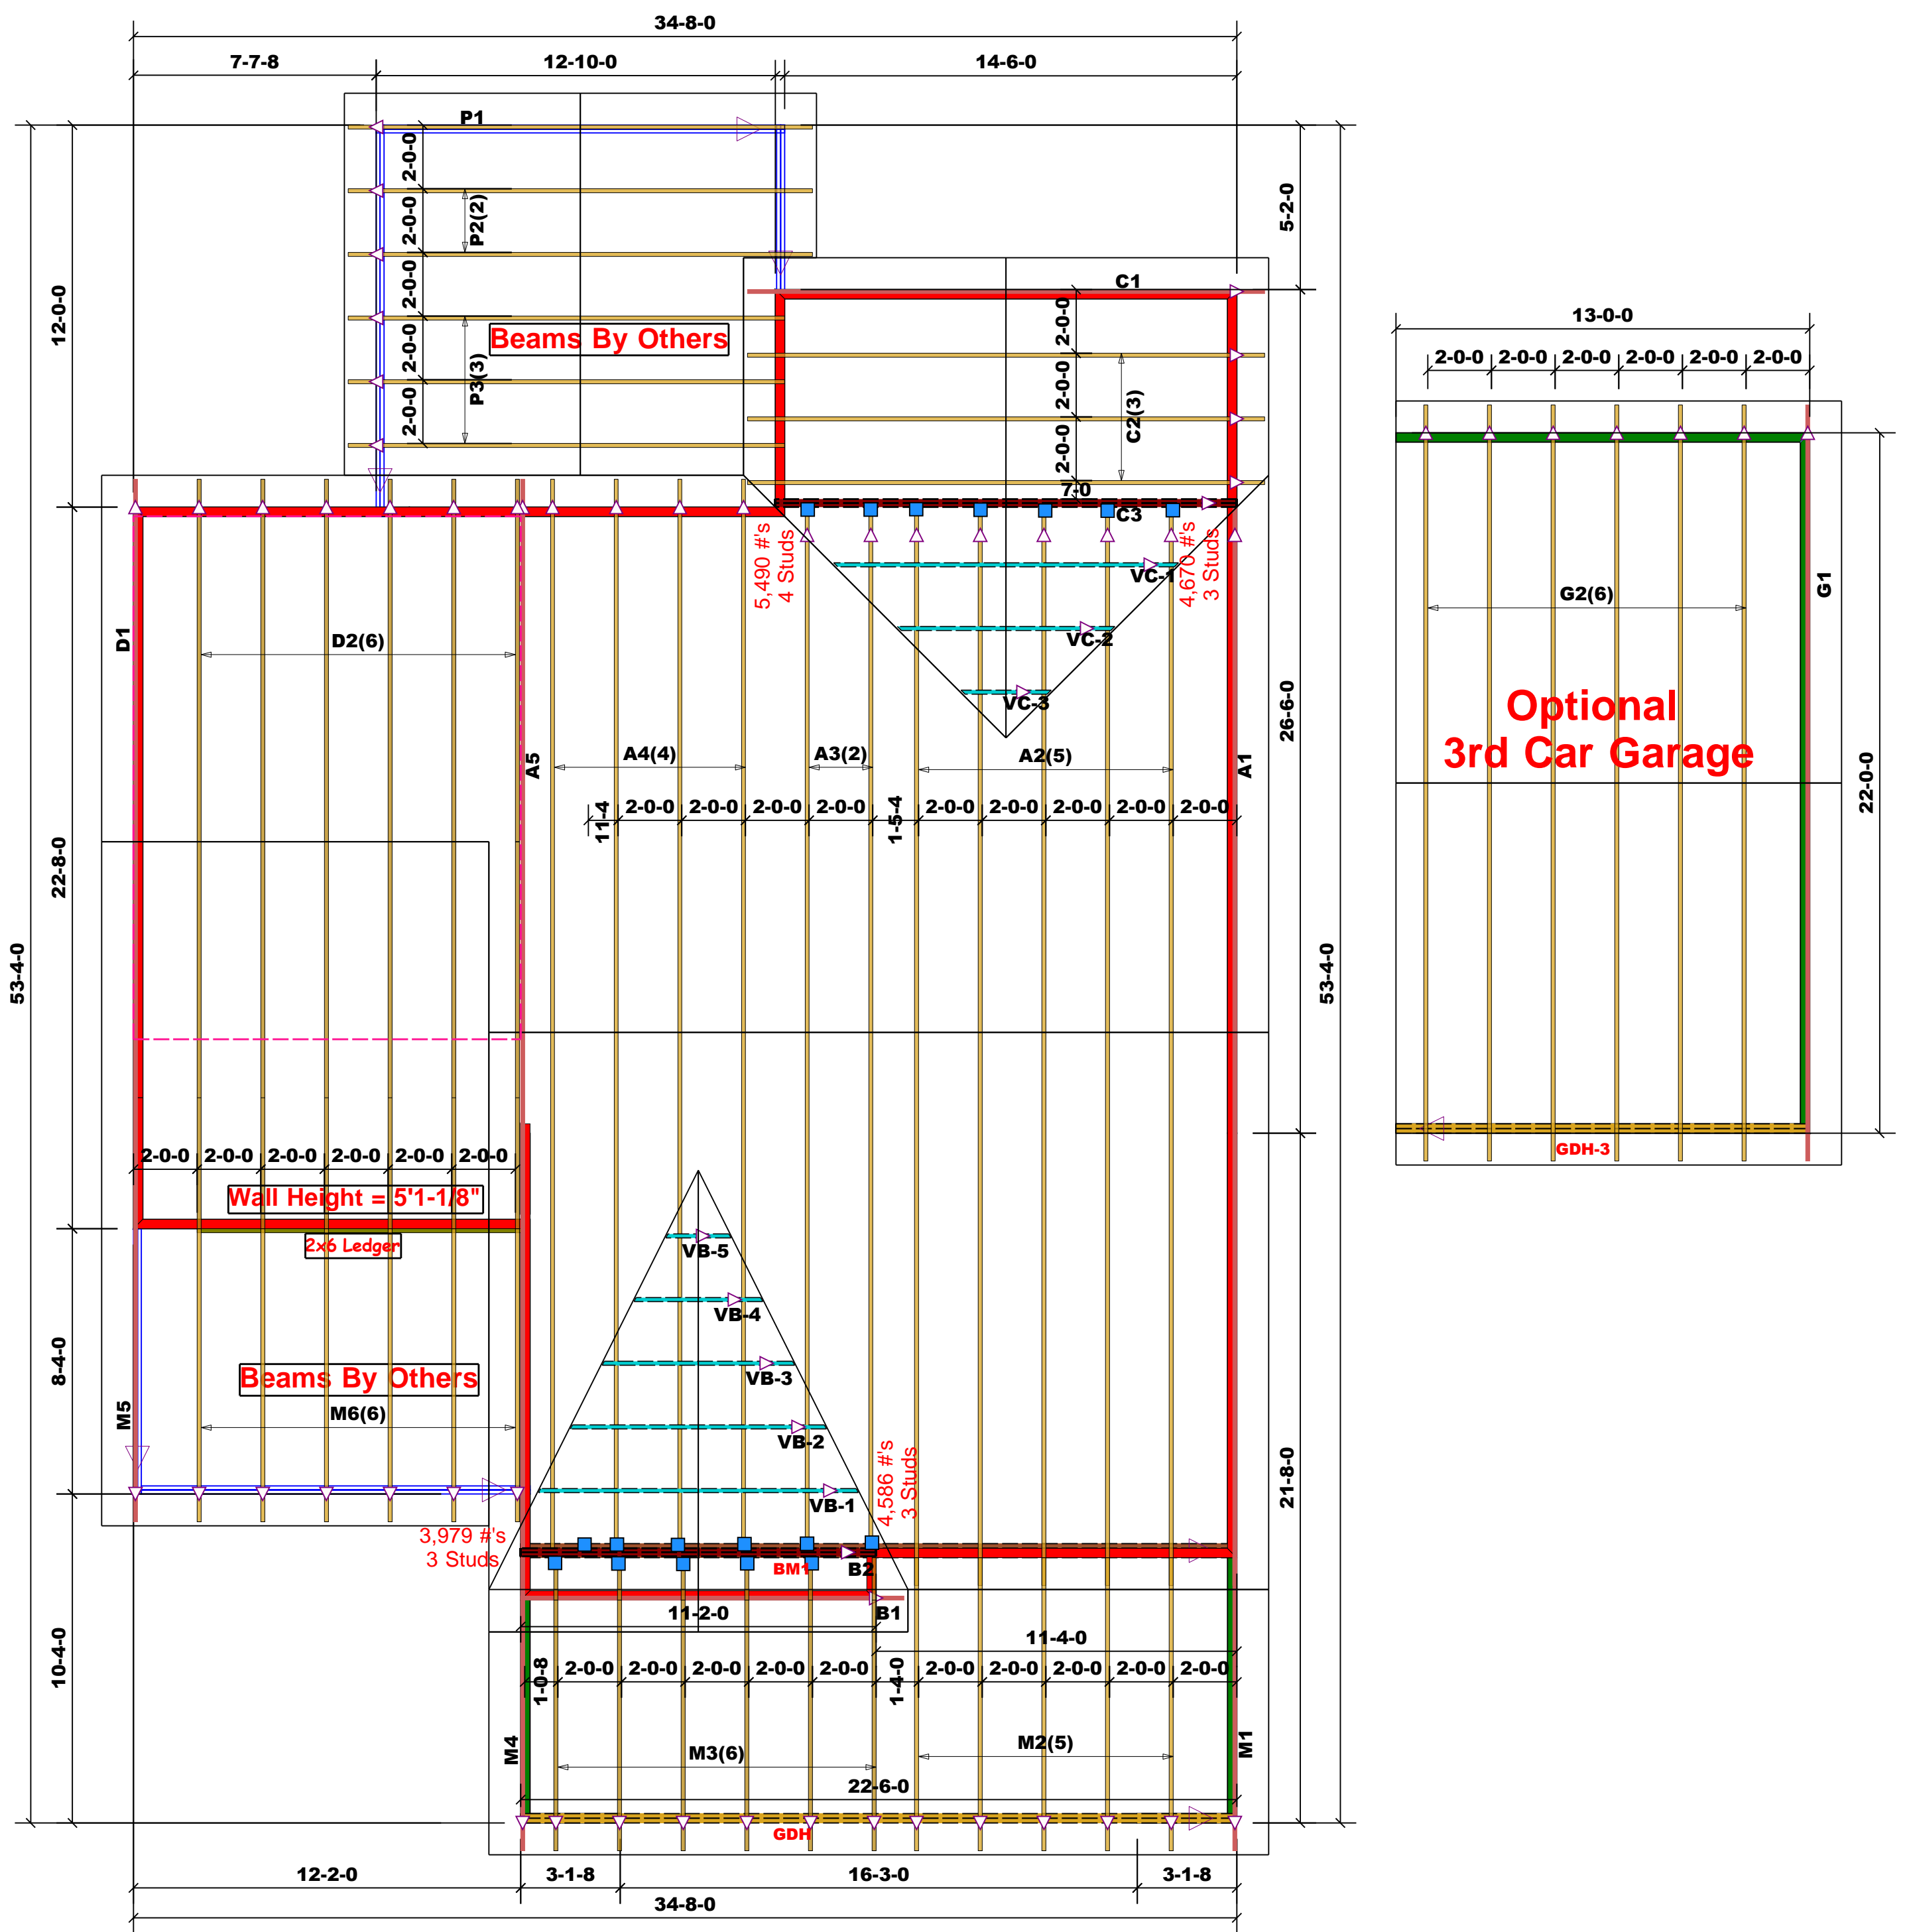

|   |       |     |    |    |            |            |
|---|-------|-----|----|----|------------|------------|
| ■ | HUS26 | USP | 18 | NA | 16d/3-1/2" | 16d/3-1/2" |
|---|-------|-----|----|----|------------|------------|

■ = 1st Level Wall  
 ■ = 2nd Level Wall

| LVL    |        |                             |       |         |          |
|--------|--------|-----------------------------|-------|---------|----------|
| PlotID | Length | Product                     | Plies | Net Qty | Fab Type |
| GDH-3  | 13-0-0 | 1-3/4"x 11-7/8" LVL Kerto-S | 2     | 2       | FF       |

All Truss reactions are Less than 3,000 lbs. Unless Noted Otherwise.  
 ○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

Truss Placement Plan  
 SCALE: 1/4"=1'

△ = Indicates Left End of Truss  
 (Reference Engineered Truss Drawing)  
 Do NOT Erect Truss Backwards

LOAD CHART FOR JACK STUDS  
 (BASED ON TABLES B502.5(1) & (2))  
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUADRE

| END REACTION (UP TO) (DOWN) (DOWN) | END REACTION (UP TO) (DOWN) (DOWN) | END REACTION (UP TO) (DOWN) (DOWN) |
|------------------------------------|------------------------------------|------------------------------------|
| 1700                               | 2550                               | 3400                               |
| 3400                               | 5100                               | 6800                               |
| 5100                               | 7650                               | 10200                              |
| 6800                               | 10200                              | 13600                              |
| 8500                               | 12750                              | 17000                              |
| 10200                              | 15300                              |                                    |
| 11900                              |                                    |                                    |
| 13600                              |                                    |                                    |
| 15300                              |                                    |                                    |

|                  |                               |                  |                  |
|------------------|-------------------------------|------------------|------------------|
| <b>BUILDER</b>   | Weaver Development Co. Inc.   | <b>COUNTY</b>    | Johnston         |
| <b>JOB NAME</b>  | Lot 5 West Pointe III         | <b>ADDRESS</b>   | 109 Hillwood Dr. |
| <b>PLAN</b>      | Gaston II (181035B) w/3rd Car | <b>MODEL</b>     | Roof             |
| <b>SEAL DATE</b> | N/A                           | <b>DATE REV.</b> | / /              |
| <b>QUOTE #</b>   |                               | <b>DRAWN BY</b>  | Marshall Naylor  |
| <b>JOB #</b>     | J0923-5063                    | <b>SALESMAN</b>  | Lenny Norris     |

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Marshall Naylor



**ROOF & FLOOR TRUSSES & BEAMS**  
 Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444