

BM1 Is Top Flush With Floor Trusses

HANGER LEGEND	
■	= USP MSH422 / Strap Hanger
■	= USP THD410 / Double Beam Hanger
■	= USP THD412 / Double Beam Hanger
◆	= USP JUS414 / Single 4x Hanger

Truss Placement Plan
SCALE: 1/4" = 1'

Beam Legend					
PlotID	Length	Product	Plies	Net Qty	Fab Type
BM6	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	3	3	FF
BM2	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM3	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM4	9' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM5	7' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM1	20' 0"	1-3/4"x 23-7/8" LVL Kerto-S	3	3	FF

▲ = Denotes Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

LOAD CHART FOR JACK STUDS		
(BASED ON TABLES R502.5(1) & (2))		
END REACTION (UP TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/BOARDS	END REACTION (UP TO)
1700	2	3400
2550	2	5100
3400	2	6800
5100	3	10200
6800	4	13600
8500	5	17000
10200	6	19300
11900	7	
13600	8	
15300	9	


BUILDER	Southern Touch Homes	CITY / CO.	Sanford / Harnett
JOB NAME	Lot 7 West Pointe III	ADDRESS	147 Hillwood Dr.
PLAN	The Savannah / 3 Car	MODEL	Floor
SEAL DATE	8/15/23	DATE REV.	09/20/23
QUOTE #	Quote #	DRAWN BY	Curtis Quick
JOB #	J0923-5296	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-B1 and BCSB-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Curtis Quick
Curtis Quick

comtech
ROOF & FLOOR TRUSSES & BEAMS
Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

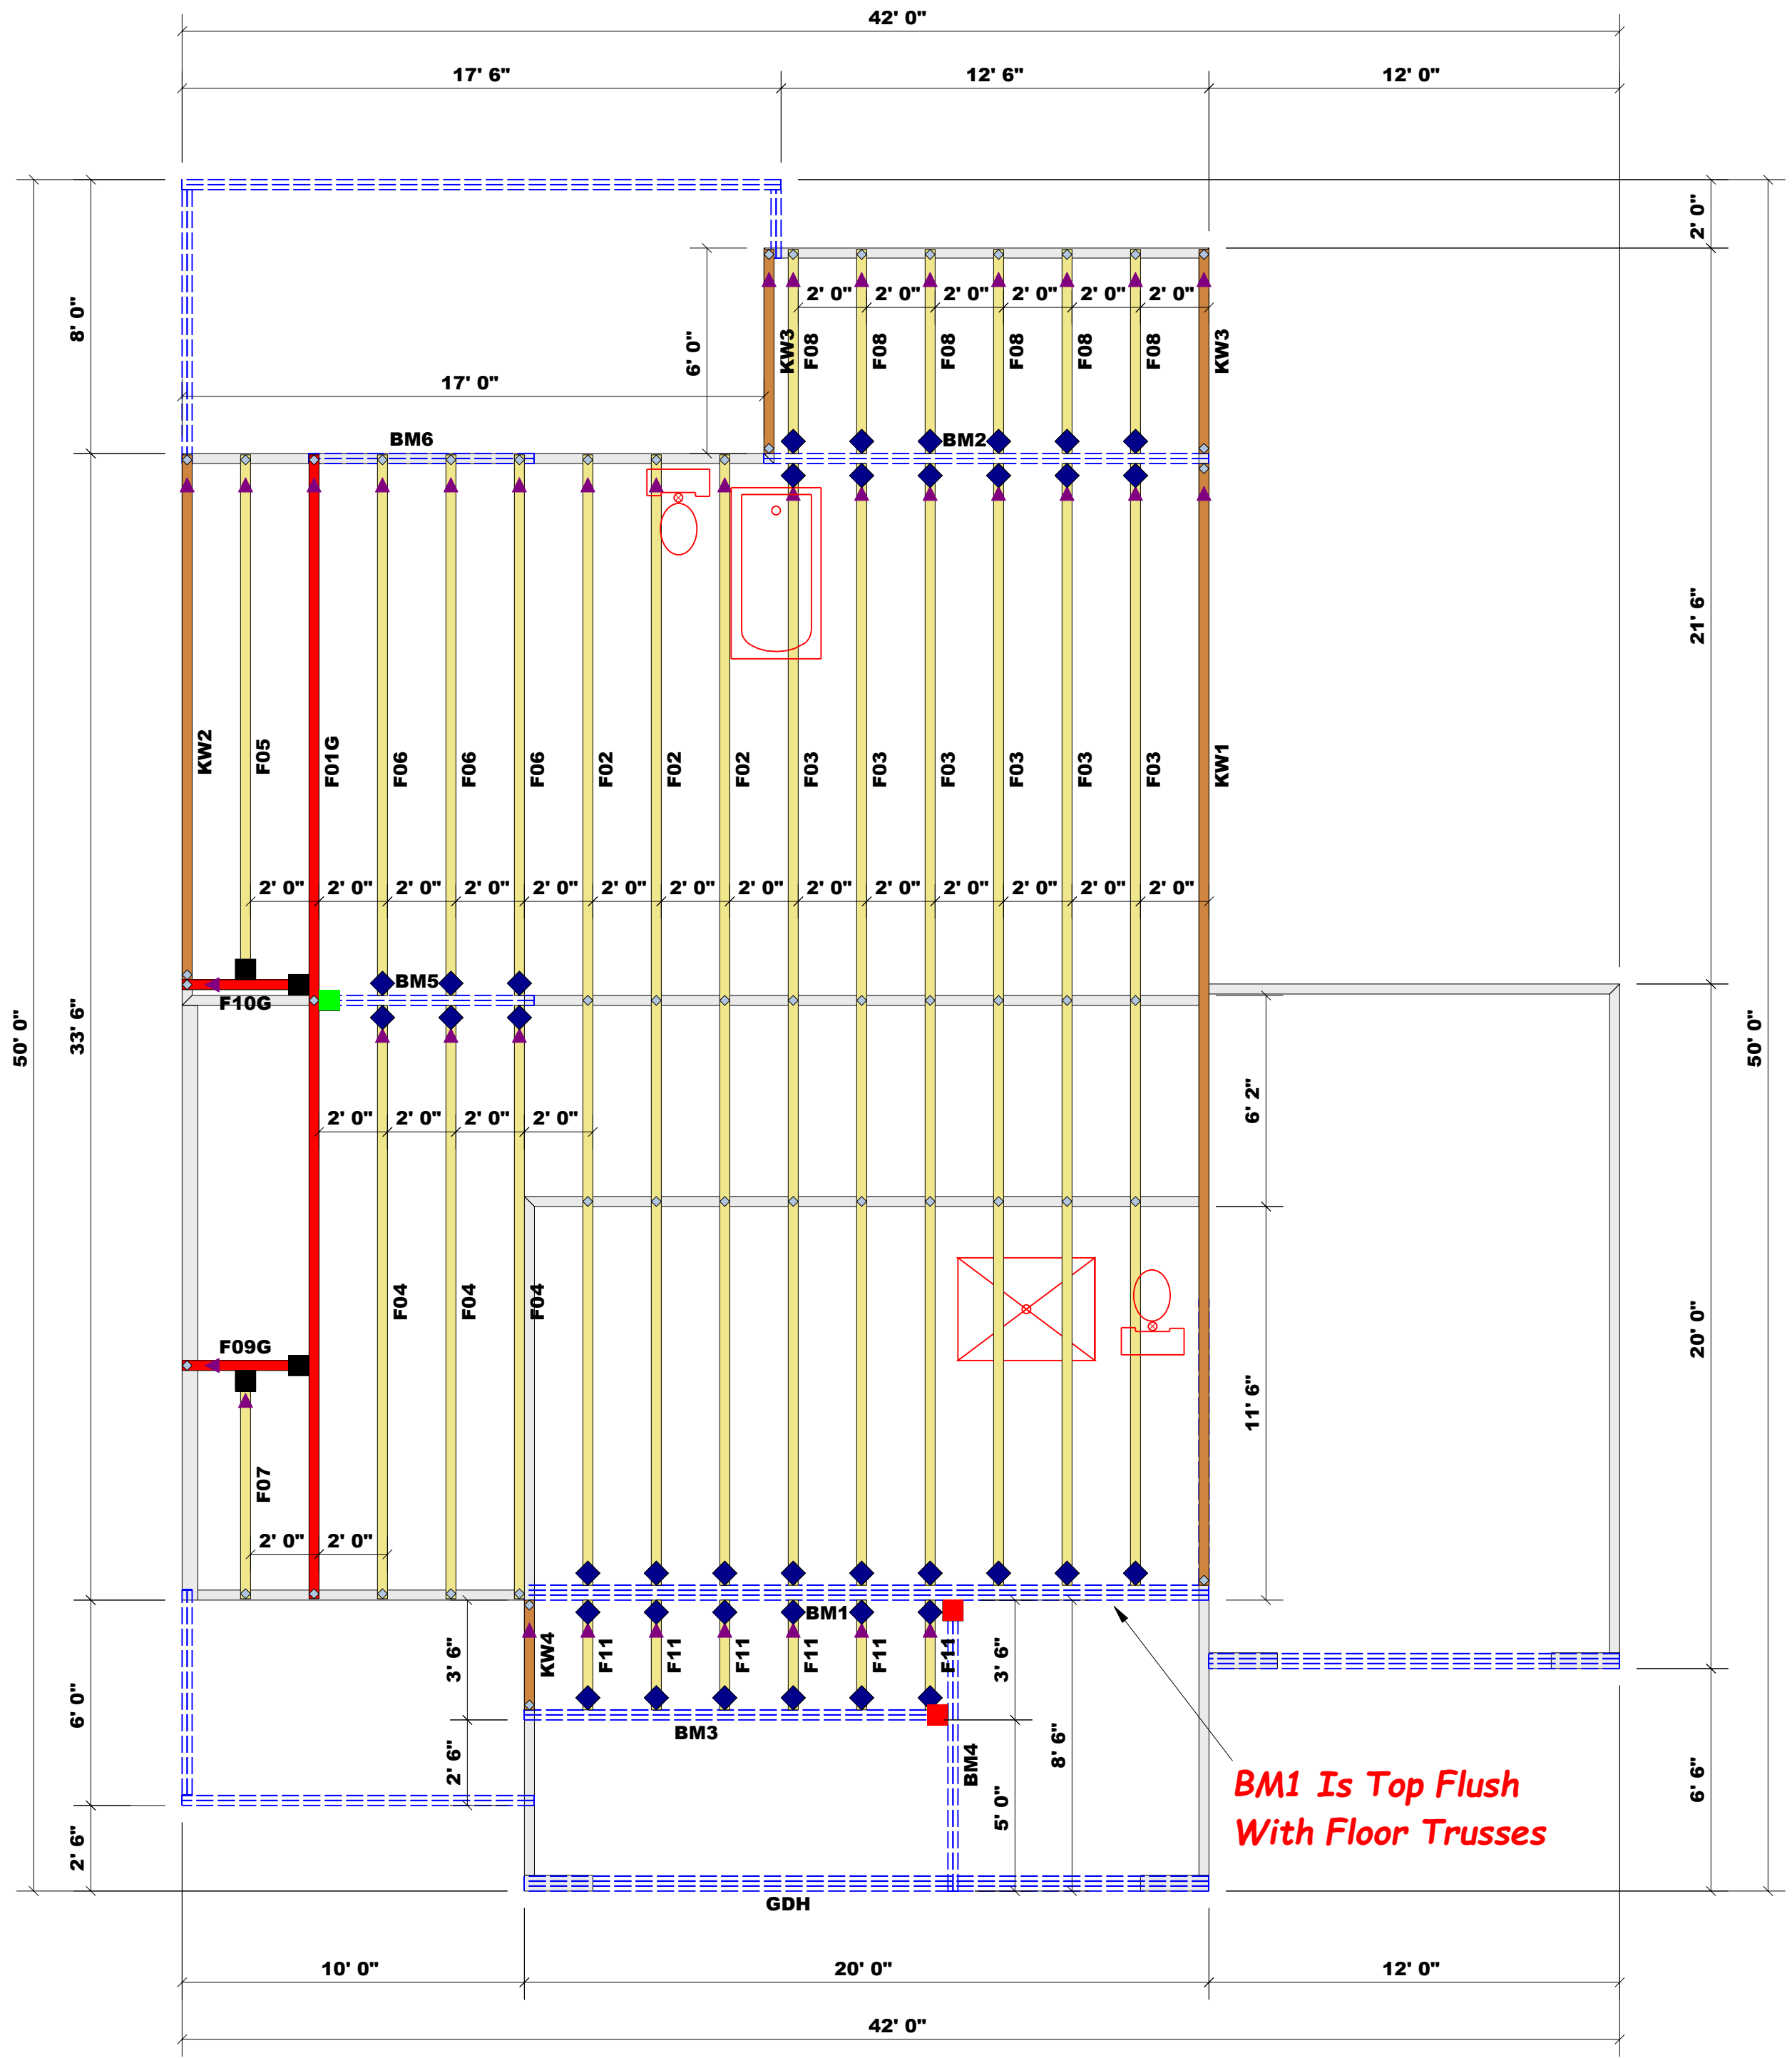

HANGER LEGEND

■	= USP MSH422 / Strap Hanger
■	= USP THD410 / Double Beam Hanger
■	= USP THD412 / Double Beam Hanger
◆	= USP JUS414 / Single 4x Hanger

Truss Placement Plan
SCALE: 1/4" = 1'

Beam Legend

PlotID	Length	Product	Plies	Net Qty	Fab Type
BM6	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	3	3	FF
BM2	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM3	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM4	9' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM5	7' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM1	20' 0"	1-3/4"x 23-7/8" LVL Kerto-S	3	3	FF

▲ = Denotes Left End of Truss
(Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

LOAD CHART FOR JACK STUDS
(BASED ON TABLES R502.5(1) & (2))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS

END REACTION (UP TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS	END REACTION (UP TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS	END REACTION (UP TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS
1700	2	2550	2	3400	2
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

BUILDER	Southern Touch Homes	CITY / CO.	Sanford / Harnett
JOB NAME	Lot 7 West Pointe III	ADDRESS	147 Hillwood Dr.
PLAN	The Savannah / 3 Car	MODEL	Floor
SEAL DATE	8/15/23	DATE REV.	09/20/23
QUOTE #	Quote #	DRAWN BY	Curtis Quick
JOB #	J0923-5296	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Curtis Quick
Curtis Quick

comtech
ROOF & FLOOR TRUSSES & BEAMS
Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444