

**Truss Placement Plan**  
**SCALE: 1/4" = 1'-0"**

● = Hanger / HUS 26

**Products**

PlotID	Length	Product	Plies	Net Qty	Fab Type
GDH (Dropped)	22' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF

**All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.**

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

**LOAD CHART FOR JACK STUDS**

(BASED ON TABLES B502.5(1) & (2))  
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUARTER

END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER
1700	2550	3400	
3400	5100	6800	2
5100	7650	10200	3
6800	10200	13600	4
8500	12750	17000	5
10200	15300		6
11900			7
13600			8
15300			9

<b>BUILDER</b>	Weaver Development Co. Inc.	<b>CITY / CO.</b>	Sanford / Johnston
<b>JOB NAME</b>	Lot 4 West Pointe III	<b>ADDRESS</b>	89 Hillwood Dr.
<b>PLAN</b>	Lindsay 1553 B (200505B)	<b>MODEL</b>	Roof
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	//
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Christine Shivy
<b>JOB #</b>	J0923-5062	<b>SALES REP.</b>	Lenny Norris

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
 These trusses are designed as individual building components to be incorporated into the building design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris  
**Lenny Norris**

**comTECH**

**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444

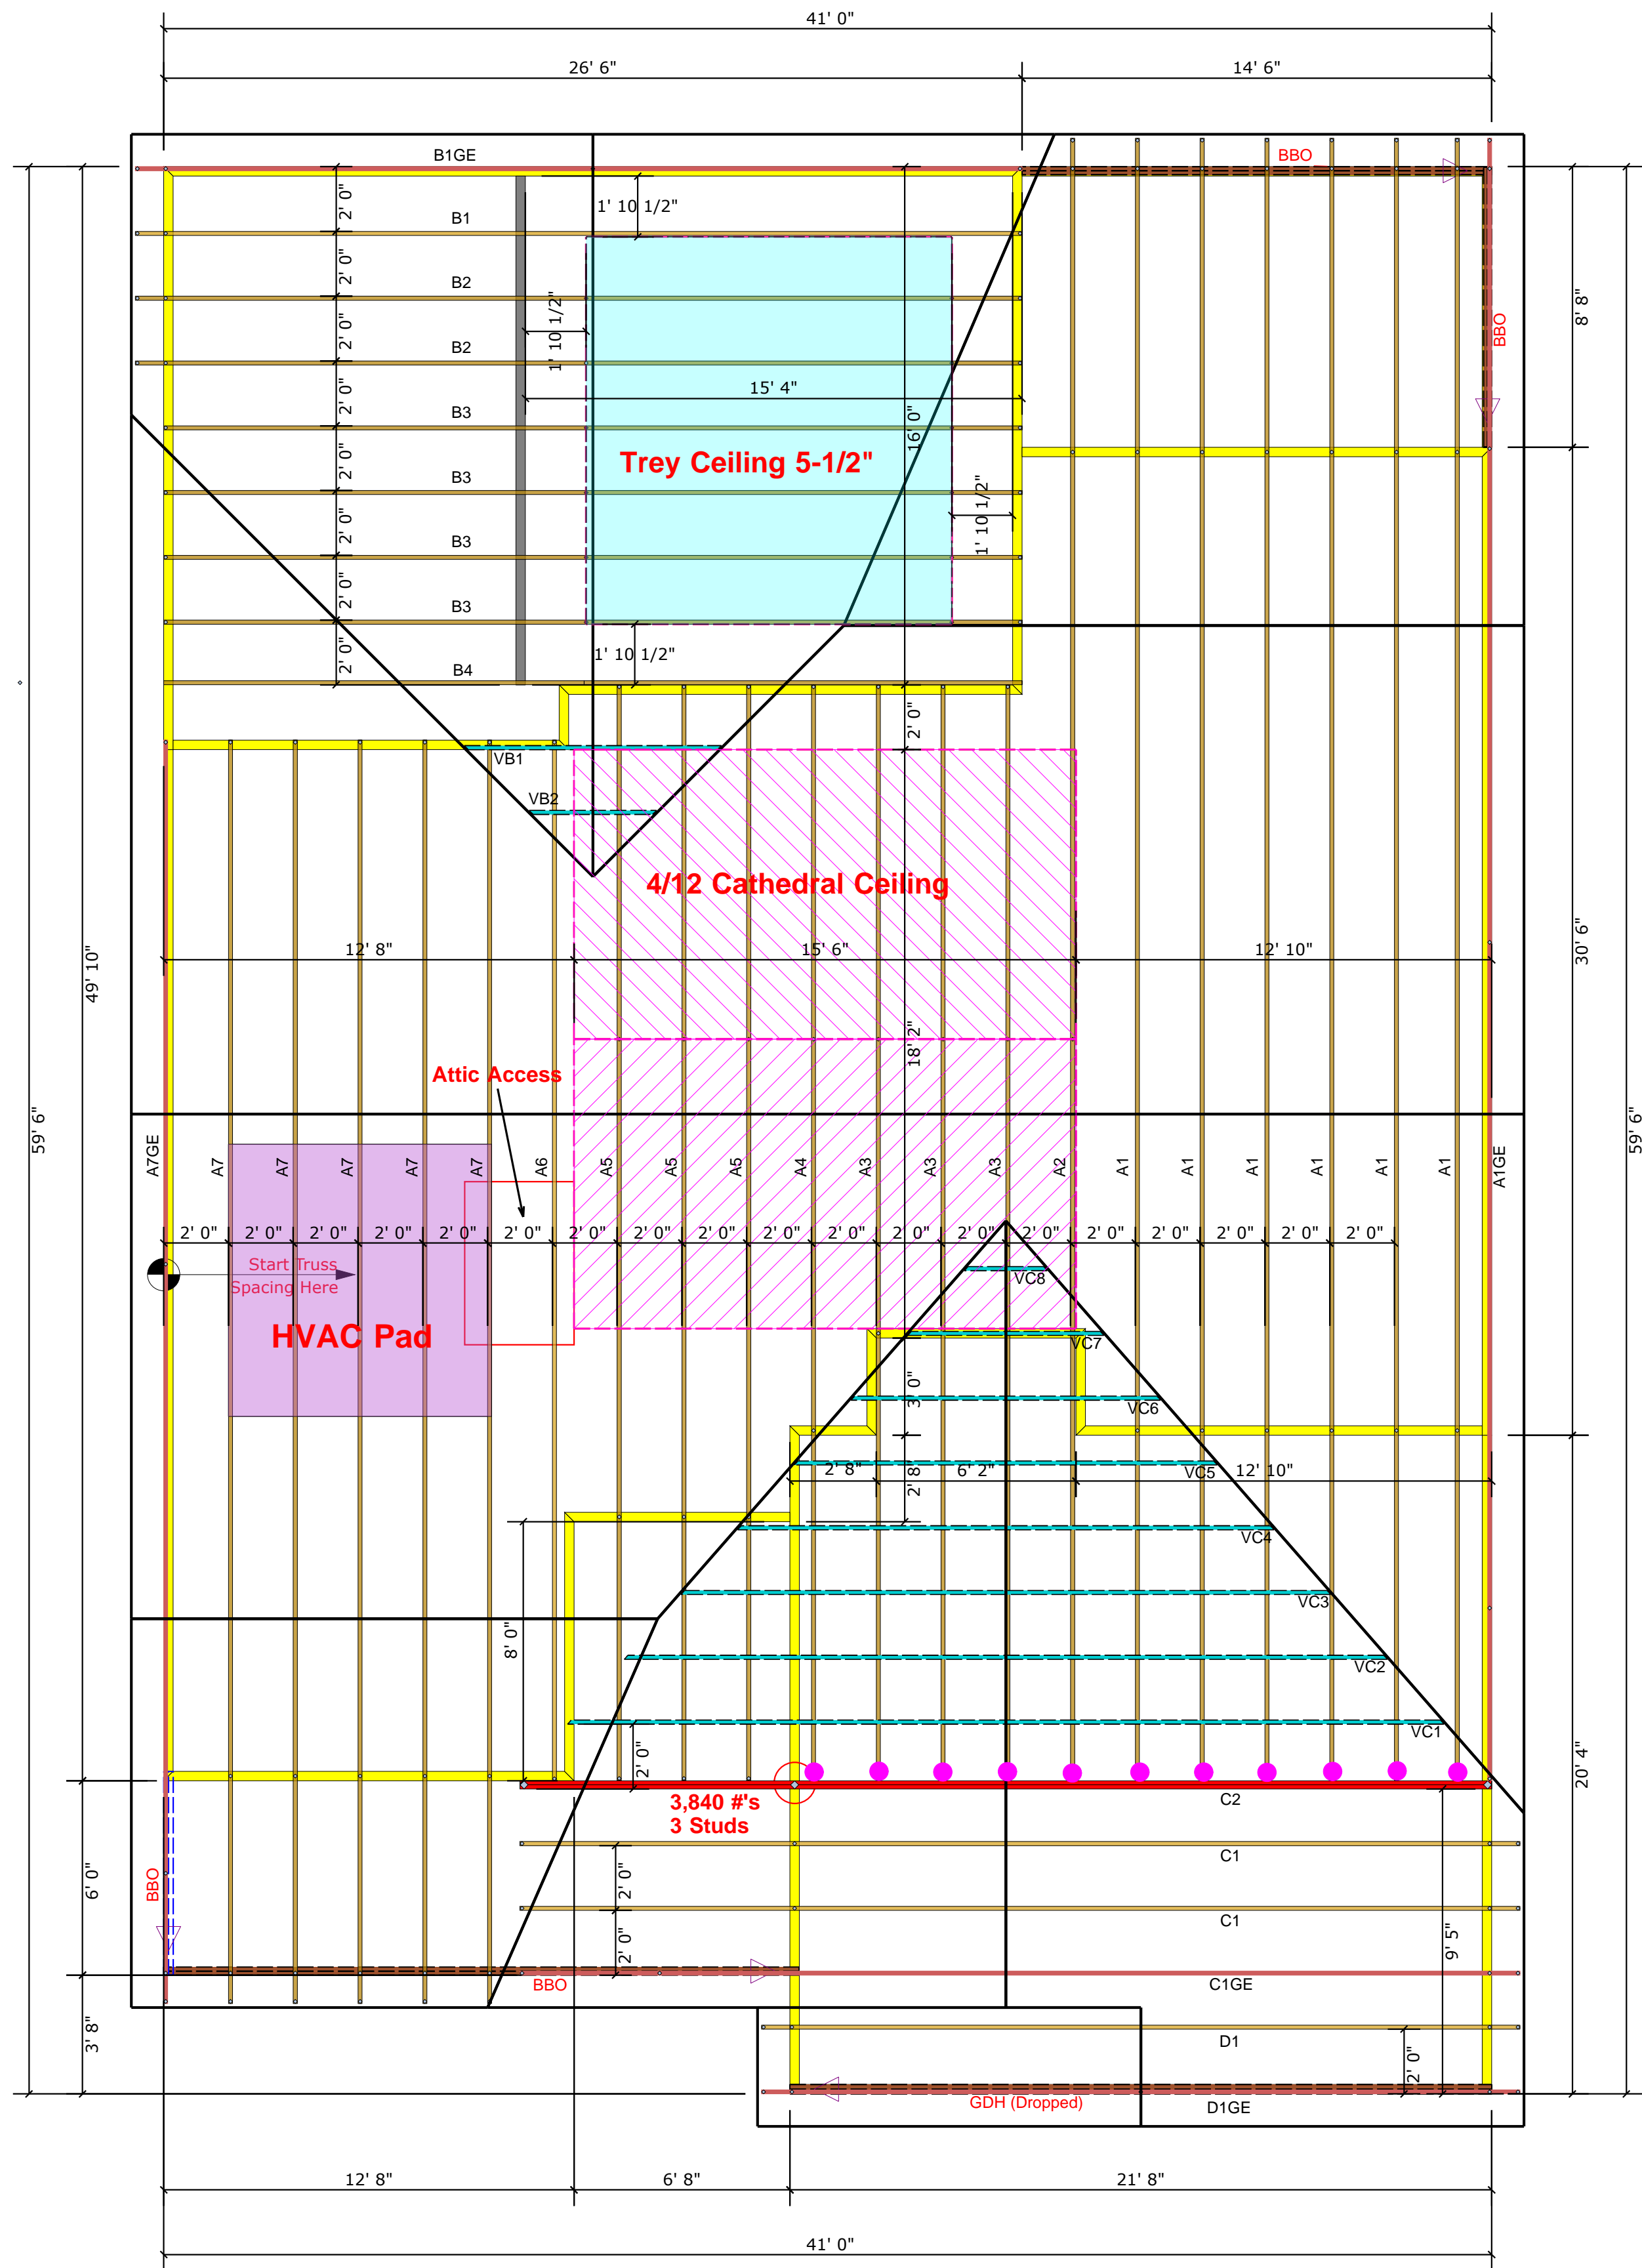

**Truss Placement Plan**  
**SCALE: 1/4" = 1'-0"**

● = Hanger / HUS 26

**All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.**

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
GDH (Dropped)	22' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF

LOAD CHART FOR JACK STUDS (BASED ON TABLES B502.5(1) & (2)) NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUARTER			
END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER	END REACTION (UP TO) @ END OF HEADQUARTER
1700	2550	3400	
3400	5100	6800	
5100	7650	10200	
6800	10200	13600	
8500	12750	17000	
10200	15300		
11900			
13600			
15300			

<b>BUILDER</b>	Weaver Development Co. Inc.	<b>CITY / CO.</b>	Sanford / Johnston
<b>JOB NAME</b>	Lot 4 West Pointe III	<b>ADDRESS</b>	89 Hillwood Dr.
<b>PLAN</b>	Lindsay 1553 B (200505B)	<b>MODEL</b>	Roof
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	/ /
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Christine Shivy
<b>JOB #</b>	J0923-5062	<b>SALES REP.</b>	Lenny Norris

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris  
**Lenny Norris**

**comTECH**

**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444