

▲ = Denotes Left End of Truss(Reference Engineered Truss Drawing)Do Not Erect Trusses Backwards

3400 1

6800 2

10200 3

13600 4

17000 5

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))

NUMBER OF JACK STUDS DEQUIRED @ EA END OF HEADER/GIRDER

2550 1 5100 2

7650 3

10200 4 12750 5

15300 6

HANGER LEGEND
= USP MSH422 / Strap Hanger
= USP THD410 / Double Beaam Hanger
= USP THDH412 / Double Beam Hanger
= USP JUS414 / Single 4x Hanger

Truss Placement Plan SCALE: 1/4" = 1'

Beam Legend					
PlotID	Length	Product	Plies	Net Qty	Fab Type
BM6	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	3	3	FF
BM2	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM3	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM4	9' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM5	7' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM1	20' 0"	1-3/4"x 23-7/8" LVL Kerto-S	3	3	FF

соттесн

**ROOF & FLOOR** 


**TRUSSES & BEAMS** 

Reilly Road Industrial Park

Fayetteville, N.C. 28309

Phone: (910) 864-8787 Fax: (910) 864-4444

BUILDER	Southern Touch Homes	CITY / CO.	Sanford / Harnett	THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.  These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer			
JOB NAME	Lot 24 West Preserve	ADDRESS	152 Thistle Ct.	is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package			
PLAN	The Savannah / 3 Car	MODEL	Floor	or online @ sbcindustry.com  Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables			
SEAL DATE	8/15/23	DATE REV.	09/20/23	( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those			
QUOTE#	Quote #	DRAWN BY	Curtis Quick	specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.  Courts Quick			
JOB#	J0923-5298	SALES REP.	Lenny Norris	Curtis Quick			

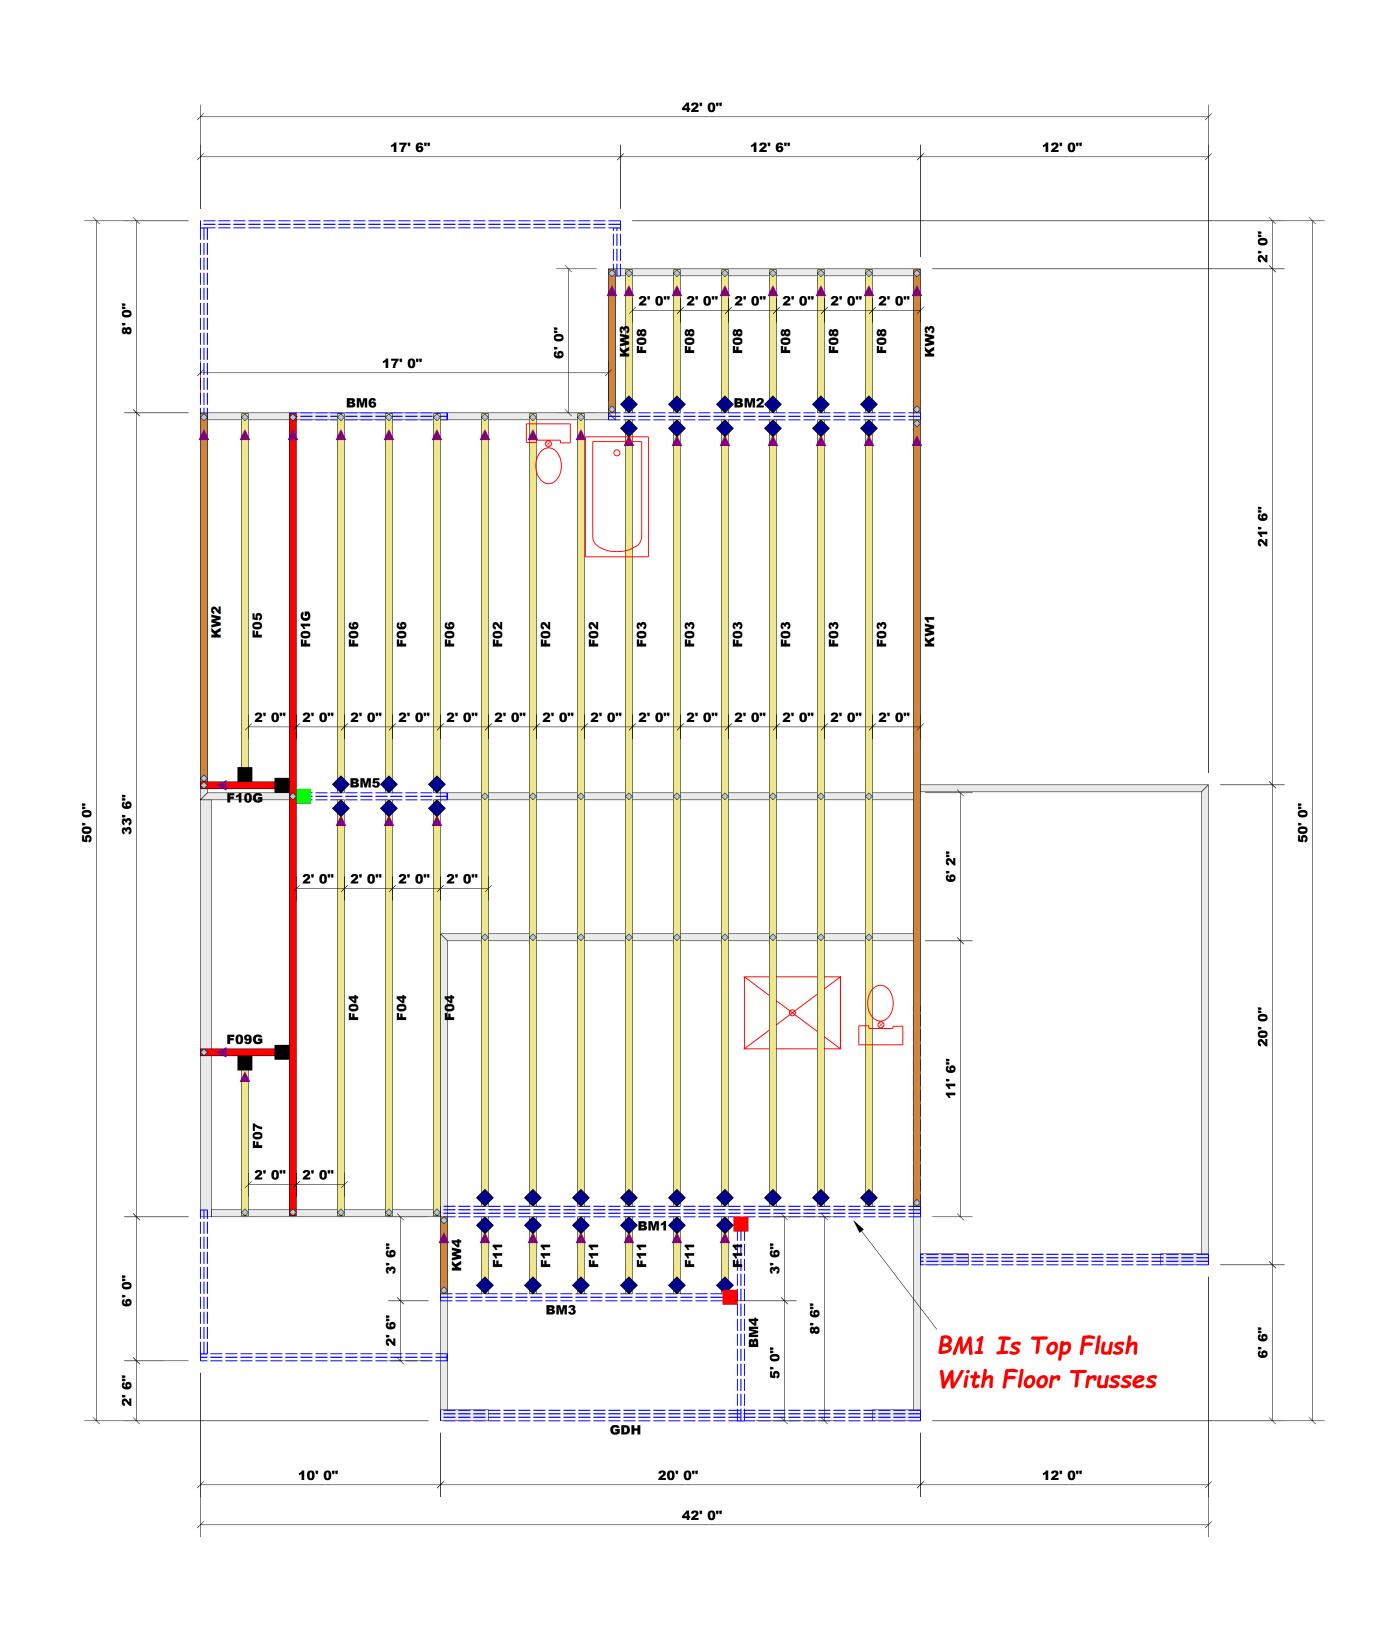

= Denotes Left End of Truss(Reference Engineered Truss Drawing)Do Not Erect Trusses Backwards

3400 1

6800 2

10200 3

13600 4

17000 5

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))

NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

5100 2

7650 3

10200 4

12750 5

15300 6

1700 1 3400 2

5100 3 6800 4 8500 5

10200 6

11900 7 13600 8 15300 9

	<u>HANGER</u> <u>LEGEND</u>				
	= USP MSH422 / Strap Hanger				
	= USP THD410 / Double Beaam Hanger				
	= USP THDH412 / Double Beam Hanger				
•	= USP JUS414 / Single 4x Hanger				

Truss Placement Plan SCALE: 1/4" = 1'

Beam Legend					
PlotID	Length	Product	Plies	Net Qty	Fab Type
BM6	7' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	3	3	FF
BM2	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM3	13' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM4	9' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM5	7' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF
BM1	20' 0"	1-3/4"x 23-7/8" LVL Kerto-S	3	3	FF
		·		·	·

BUILDER	Southern Touch Homes	CITY / CO.	Sanford / Harnett	THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.  These trusses are designed as individual building components to be inc the building design at the specification of the building designer. See individual specific pack truss design identified on the placement drawing. The bu	
JOB NAME	Lot 24 West Preserve	ADDRESS	152 Thistle Ct.	is responsible for temporary and permanent bracing of the roof and floor the overall structure. The design of the truss support structure including walls, and columns is the responsibility of the building designer. For gen regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss	
PLAN	The Savannah / 3 Car	MODEL	Floor	or online @ sbcindustry.com  Bearing reactions less than or equal to 3000# are deemed to con prescriptive Code requirements. The contractor shall refer to the ( derived from the prescriptive Code requirements) to determine foundation size and number of wood studs required to support r than 3000# but not greater than 15000#. A registered design prof be retained to design the support system for any reaction that every contraction that	
SEAL DATE	8/15/23	DATE REV.	09/20/23		
QUOTE#	Quote #	DRAWN BY	Curtis Quick	specified in the attached Tables. A registered design profes retained to design the support system for all reactions that  Cutting Quick	
JOB#	J0923-5298	SALES REP.	Lenny Norris	Curtis Quick	



Reilly Road Industrial Park Fayetteville, N.C. 28309 Phone: (910) 864-8787 Fax: (910) 864-4444