

RE: J0923-5065
 Weaver/Lot 50 West Pointe III/Harnett

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: J0923-5065
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.4
 Wind Code: ASCE 7-10 Wind Speed: 130 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 18 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I60868927	A1	9/20/2023
2	I60868928	A1SE	9/20/2023
3	I60868929	A2	9/20/2023
4	I60868930	A3	9/20/2023
5	I60868931	A4	9/20/2023
6	I60868932	A5	9/20/2023
7	I60868933	A6	9/20/2023
8	I60868934	A7	9/20/2023
9	I60868935	A8	9/20/2023
10	I60868936	A9	9/20/2023
11	I60868937	A9GE	9/20/2023
12	I60868938	B1	9/20/2023
13	I60868939	B1GE	9/20/2023
14	I60868940	C1	9/20/2023
15	I60868941	C2	9/20/2023
16	I60868942	C3	9/20/2023
17	I60868943	PB	9/20/2023
18	I60868944	PBGE	9/20/2023


The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.
 Truss Design Engineer's Name: Gilbert, Eric
 My license renewal date for the state of North Carolina is December 31, 2023.
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Job J0923-5065	Truss A1	Truss Type PIGGYBACK BASE	Qty 1	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868927
-------------------	-------------	------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314, 8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:18:59 2023 Page 1



Scale = 1:88.8


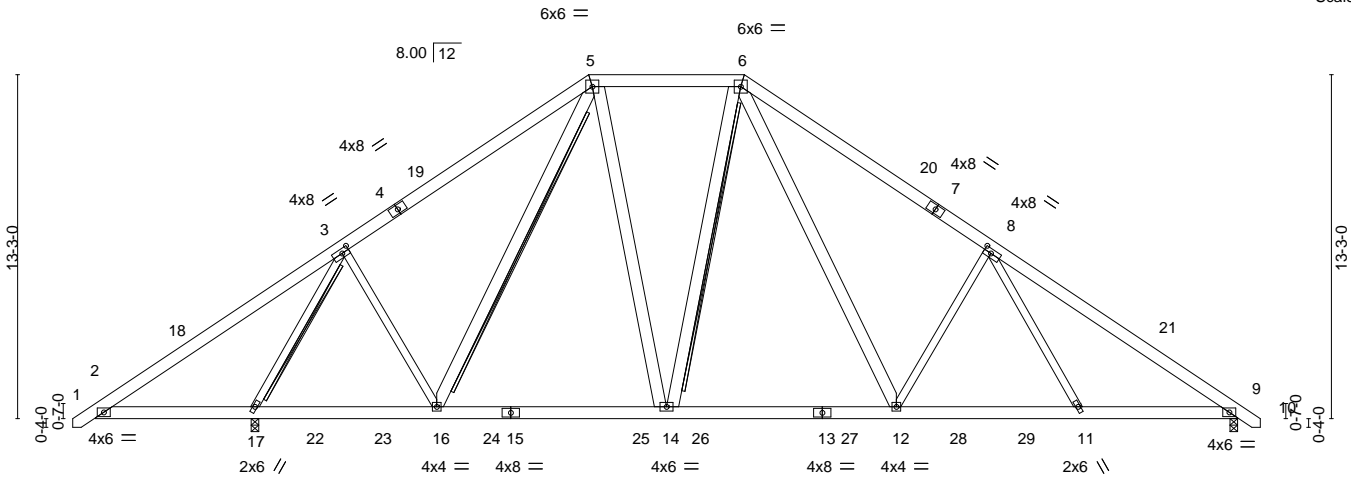


Plate Offsets (X, Y)--	[3:0-3-6,0-2-1], [8:0-3-6,0-2-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.47	Vert(LL) -0.10 12-14 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.45	Vert(CT) -0.17 12-14 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.68	Horz(CT) 0.05 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.04 12 >999 240		
				Weight: 394 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1 *Except*
 3-17,3-16,8-12,8-11: 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-7-4 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-17.
 WEBS T-Brace: 2x4 SPF No.2 - 3-17, 6-14
 2x6 SPF No.2 - 5-16
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS. (size) 17=0-3-8, 9=0-3-8
 Max Horz 17=-316(LC 10)
 Max Uplift 17=-107(LC 12), 9=-93(LC 13)
 Max Grav 17=2255(LC 2), 9=1722(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-406/690, 3-5=-1437/385, 5-6=-1265/435, 6-8=-2194/565, 8-9=-2621/429
 BOT CHORD 2-17=-460/457, 16-17=-180/960, 14-16=-13/1234, 12-14=0/1320, 11-12=-220/1919,
 9-11=-192/2035
 WEBS 3-17=-2289/707, 3-16=-21/658, 8-12=-735/361, 8-11=0/310, 5-16=-283/132,
 6-14=-277/181, 5-14=-69/680, 6-12=-230/1021

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-0-14, Exterior(2) 19-0-14 to 31-1-13, Interior(1) 31-1-13 to 44-8-9 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 17 and 93 lb uplift at joint 9.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

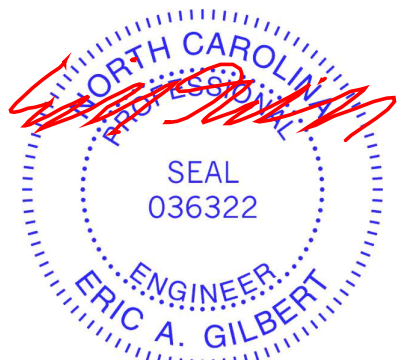

September 20,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MITEK AFFILIATE
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Weaver/Lot 50 West Pointe III/Harnett	160868928
J0923-5065	A1SE	GABLE	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:02 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzak1d-RIC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

-0-10-8	9-7-8	18-10-2	19-3-0	24-9-0	25-1-14	34-4-8	44-0-0	44-10-8
0-10-8	9-7-8	9-2-10	0-4-14	5-5-15	0-4-14	9-2-10	9-7-8	0-10-8

Scale = 1:87.6

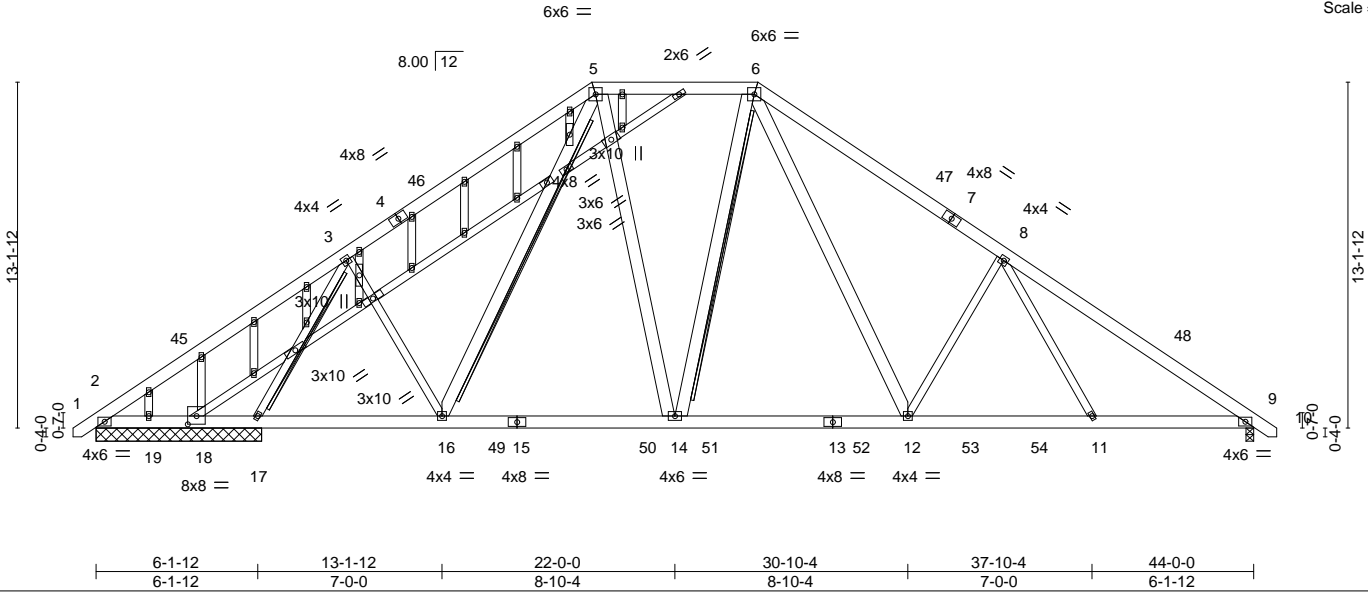



Plate Offsets (X,Y)--	[18:0-4-0-0-3-12]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.39	Vert(LL)	-0.10 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.46	Vert(CT)	-0.17 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.05 9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05 12	>999	240		
								Weight: 451 lb	FT = 20%

LUMBER-	BRACING-	
TOP CHORD 2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 4-7-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x6 SP No.1	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS	T-Brace: 2x4 SPF No.2 - 3-17, 6-14 2x6 SPF No.2 - 5-16
OTHERS 2x4 SP No.2		Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 6-3-8 except (jt=length) 9=0-3-8.
 (lb) - Max Horz 2=392(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2 except 17=353(LC 12), 9=322(LC 13), 18=123(LC 1), 19=208(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 2, 18 except 17=1923(LC 19), 9=1727(LC 20), 19=360(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-163/356, 3-5=-1477/491, 5-6=-1309/478, 6-8=-2189/609, 8-9=-2618/473
 BOT CHORD 2-19=-267/292, 18-19=-267/292, 17-18=-267/292, 16-17=-221/1050, 14-16=-93/1240, 12-14=-1/1317, 11-12=-270/1933, 9-11=-243/2043
 WEBS 3-17=-2034/465, 3-16=-33/585, 8-12=-729/476, 8-11=0/310, 6-14=-263/211, 5-16=-259/137, 5-14=-100/677, 6-12=-337/1035

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 18-11-0, Exterior(2) 18-11-0 to 31-3-11, Interior(1) 31-3-11 to 44-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are 2x4 MT20 unless otherwise indicated.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 17=353, 9=322, 18=123, 19=208.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

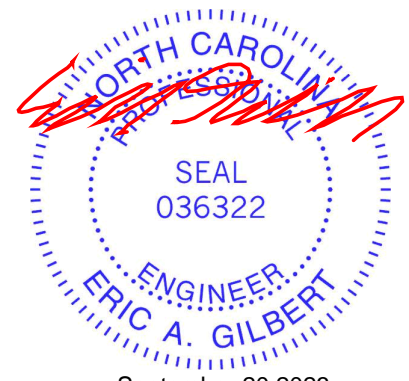


Job J0923-5065	Truss A2	Truss Type PIGGYBACK BASE	Qty 5	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868929
-------------------	-------------	------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:03 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RIC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:87.8


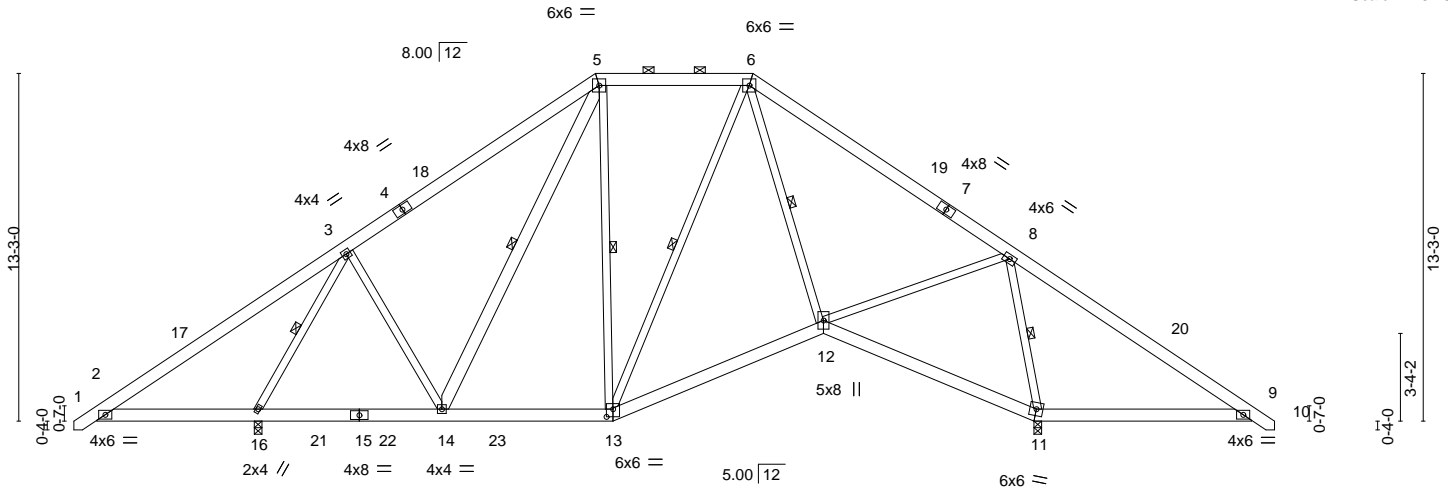


Plate Offsets (X,Y)--	[13:0-3-0,0-3-8]
-----------------------	------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(LL) -0.04 12-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.41	Vert(CT) -0.10 12-13 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.02 13-14 >999 240	Weight: 358 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 5-14: 2x6 SP No.1	WEBS 1 Row at midpt 3-16, 6-12, 8-11, 5-14, 6-13, 5-13

REACTIONS. (size) 11=0-3-8, 16=0-3-8
 Max Horz 16=-316(LC 10)
 Max Uplift 11=-118(LC 13), 16=-111(LC 12)
 Max Grav 11=1938(LC 1), 16=1684(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-408/689, 3-5=-895/254, 5-6=-700/287, 6-8=-873/97, 8-9=-478/752
 BOT CHORD 2-16=-461/458, 14-16=-210/657, 13-14=-63/686, 12-13=-30/746, 11-12=-353/495,
 9-11=-497/510
 WEBS 3-16=-1653/575, 8-12=-6/867, 6-12=-69/440, 3-14=-38/368, 8-11=-1658/536

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-0-13, Exterior(2) 19-0-13 to 31-1-13, Interior(1) 31-1-13 to 44-8-9 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=118, 16=111.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

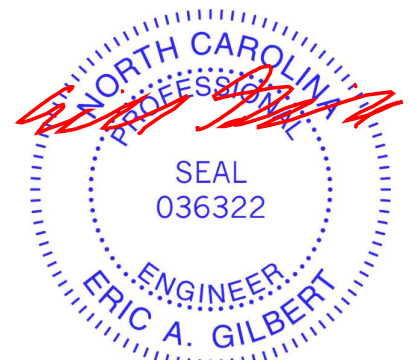

September 20, 2023

Job J0923-5065	Truss A3	Truss Type PIGGYBACK BASE	Qty 2	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868930
-------------------	-------------	------------------------------	----------	----------	---	-----------


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:05 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RIC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

-0-10-8 9-7-8 19-0-0 25-0-0 34-7-8 44-0-0 44-10-8
0-10-8 9-7-8 9-4-8 6-0-0 9-7-8 9-4-8 0-10-8

Scale = 1:87.0

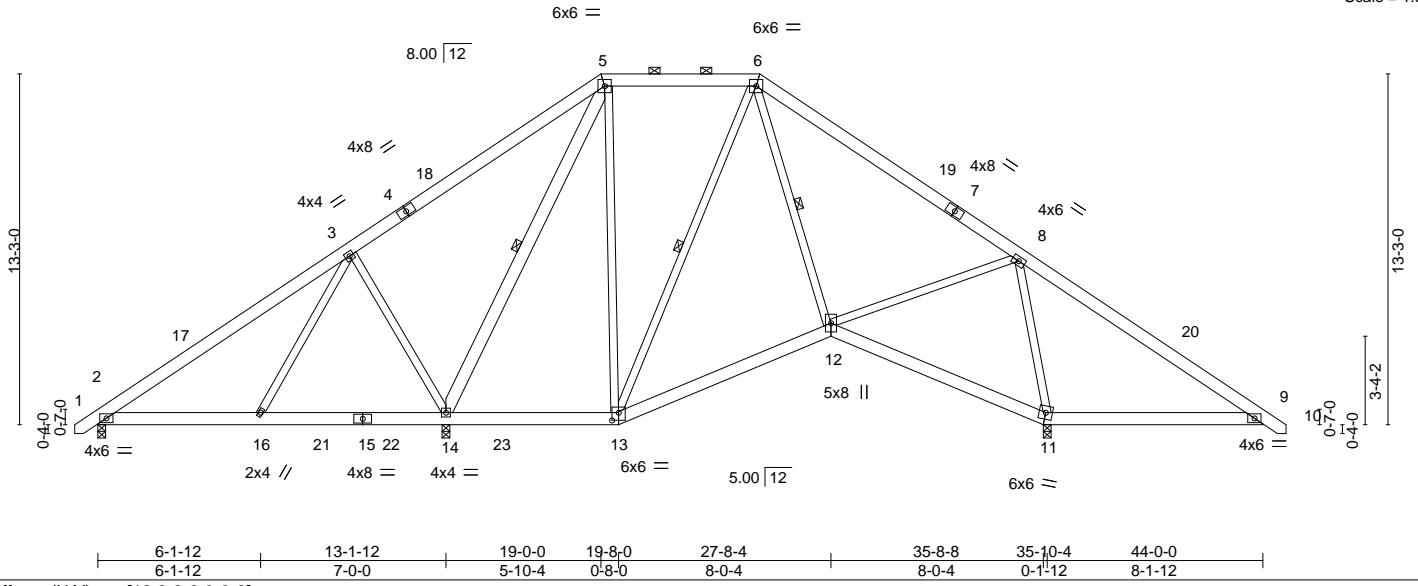

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(LL) -0.04 12-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.91	Vert(CT) -0.09 12-13 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 11 n/a n/a		
	Code IRC2015/TP12014		Wind(LL) 0.02 2-16 >999 240	Weight: 358 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
BOT CHORD 2x6 SP No.1	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SP No.2 *Except* 5-14: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
	WEBS 1 Row at midpt 6-12, 5-14, 6-13

REACTIONS. (size) 2=0-3-8, 11=0-3-8, 14=0-3-8
 Max Horz 2=-316(LC 10)
 Max Uplift 2=-66(LC 8), 11=-131(LC 13), 14=-209(LC 9)
 Max Grav 2=493(LC 23), 11=1683(LC 1), 14=1535(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-471/240, 3-5=-135/350, 5-6=-386/206, 6-8=-506/50, 8-9=-478/752
 BOT CHORD 2-16=-183/343, 14-16=-132/269, 13-14=-112/315, 12-13=-112/446, 11-12=-393/506,
 9-11=-497/510
 WEBS 3-16=-293/330, 8-12=0/582, 6-12=-100/447, 3-14=-738/529, 8-11=-1387/461,
 5-14=-838/146, 6-13=-252/11, 5-13=-5/355

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 19-0-13, Exterior(2) 19-0-13 to 31-1-13, Interior(1) 31-1-13 to 44-8-9 zone; cantilever right exposed ; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 11=131, 14=209.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



September 20, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY TRENCO <small>A MiTek Affiliate</small></p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0923-5065	Truss A4	Truss Type ROOF SPECIAL	Qty 2	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	I60868931
-------------------	-------------	----------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:06 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

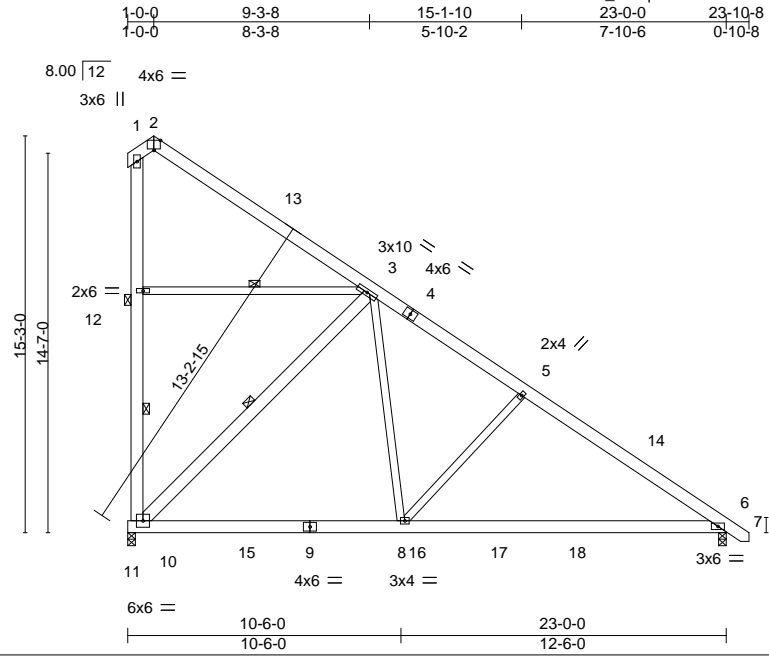

Scale = 1:88.5

Plate Offsets (X,Y)-- [2:0-3-0,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl L/d
TCLL 20.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.13 6-8	>999 360
TCDL 10.0	Lumber DOL	1.15	BC 0.56	Vert(CT)	-0.28 6-8	>970 240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.02 6	n/a n/a
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.03 6-8	>999 240
						PLATES MT20
						GRIP 244/190
						Weight: 219 lb FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-10,3-10: 2x6 SP No.1	WEBS 1 Row at midpt 10-12, 3-10, 3-12
	JOINTS 1 Brace at Jt(s): 12

REACTIONS. (size) 10=0-3-8, 6=0-3-8
 Max Horz 10=-482(LC 13)
 Max Uplift 10=-236(LC 13)
 Max Grav 10=1177(LC 20), 6=1071(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	3-5=-1052/0, 5-6=-1298/0, 10-12=-259/166, 1-12=-259/166
BOT CHORD	8-10=0/743, 6-8=0/987
WEBS	5-8=-424/234, 3-10=-1116/335, 3-8=-26/850

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=236.

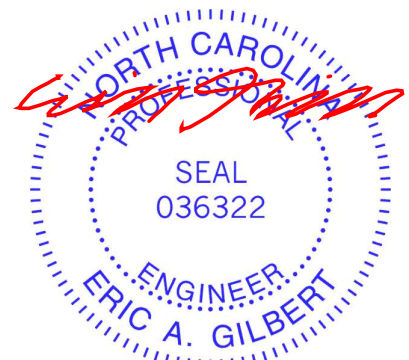

September 20,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

818 Soundside Road
Edenton, NC 27932

Job J0923-5065	Truss A5	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Weaver/Lot 50 West Pointe III/Harnett 160868932
-------------------	-------------	----------------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:07 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

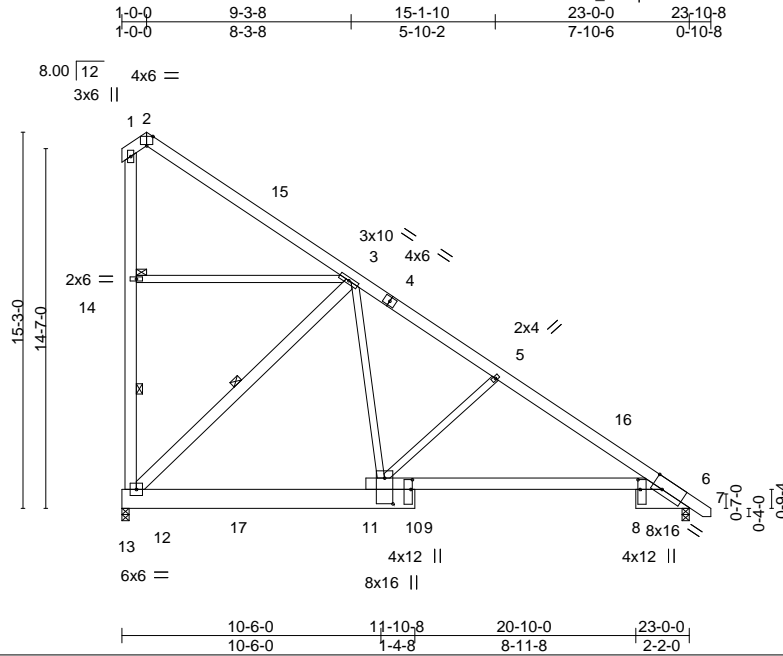


Plate Offsets (X,Y)--	[2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-4-12,0-1-0], [9:0-4-12,0-0-12], [10:1-0-8,0-4-0]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.12	6-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.49	Vert(CT)	-0.30	6-10	>887		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.08	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05	6-10	>999		
								Weight: 245 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-11-14 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1 *Except* 6-11: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-12,3-12: 2x6 SP No.1	WEBS 1 Row at midpt 12-14, 3-12
	JOINTS 1 Brace at Jt(s): 14

REACTIONS. (size) 6=0-3-8, 12=0-3-8
 Max Horz 12=481(LC 13)
 Max Uplift 12=233(LC 13)
 Max Grav 6=979(LC 20), 12=1127(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-5=-1079/0, 5-6=-1350/0, 12-14=-256/166, 1-14=-257/166
 BOT CHORD 10-12=0/827, 6-10=0/1044
 WEBS 5-10=-432/206, 3-12=-1146/302, 3-10=0/874

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=233.

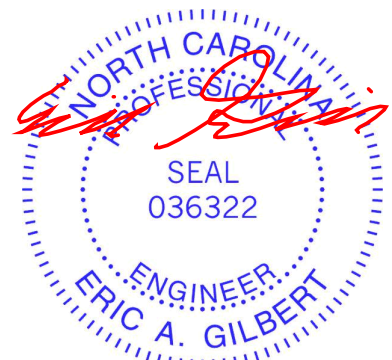

September 20, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY TRENCO <small>A MiTek Affiliate</small></p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0923-5065	Truss A6	Truss Type ROOF SPECIAL	Qty 1	Ply 2	Weaver/Lot 50 West Pointe III/Harnett 160868933
-------------------	-------------	----------------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:08 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

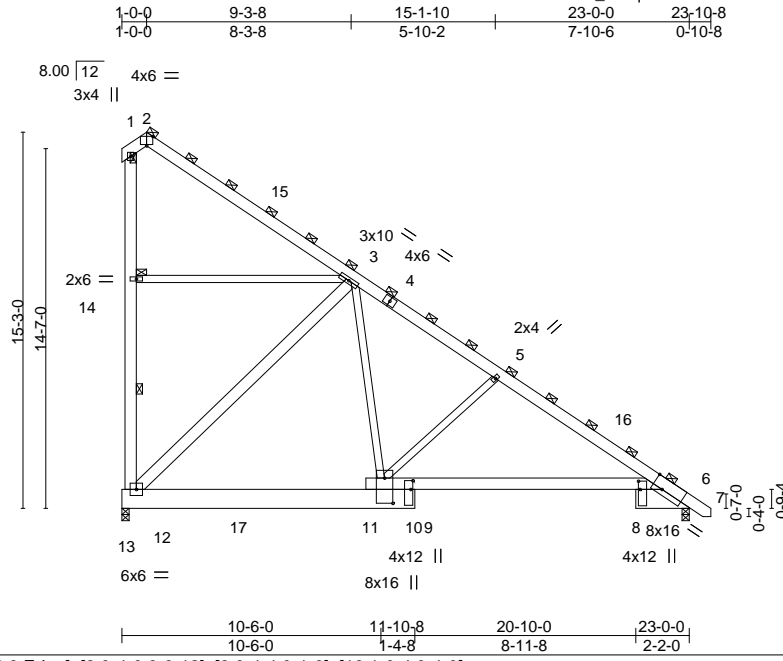

Scale = 1:93.4

Plate Offsets (X,Y)--	[2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-4-0,0-0-12], [9:0-4-4,0-1-0], [10:1-0-4,0-4-0]
-----------------------	---


LOADING (psf)	SPACING-	3-6-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.11	6-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.47	Vert(CT)	-0.27	6-10	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.65	Horz(CT)	0.07	6	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S	Wind(LL)	0.05	6-10	>999	Weight: 490 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
BOT CHORD 2x10 SP No.1 *Except* 6-11: 2x6 SP No.1	(Switched from sheeted: Spacing > 2-8-0).
WEBS 2x4 SP No.2 *Except* 1-12,3-12: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
	WEBS 1 Row at midpt 12-14
	JOINTS 1 Brace at Jt(s): 2, 1, 14

REACTIONS. (size) 6=0-3-8, 12=0-3-8
 Max Horz 12=-842(LC 13)
 Max Uplift 12=-407(LC 13)
 Max Grav 6=1713(LC 20), 12=1971(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-333/223, 2-3=-379/107, 3-5=-1889/0, 5-6=-2362/0, 12-14=-448/290,
 1-14=-449/291
 BOT CHORD 10-12=0/1448, 6-10=0/1827
 WEBS 5-10=-757/361, 3-12=-2006/528, 3-10=0/1529

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=407.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

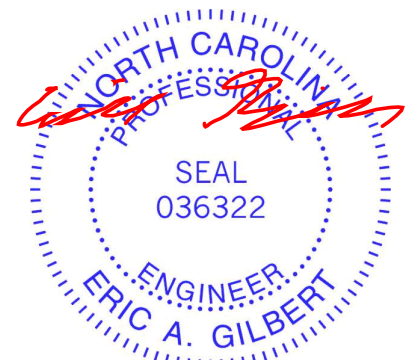


September 20, 2023

Job J0923-5065	Truss A7	Truss Type ROOF SPECIAL	Qty 1	Ply 2	Weaver/Lot 50 West Pointe III/Harnett 160868934
-------------------	-------------	----------------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:10 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3u1TXbGKWrcD0i7J4zJC?f

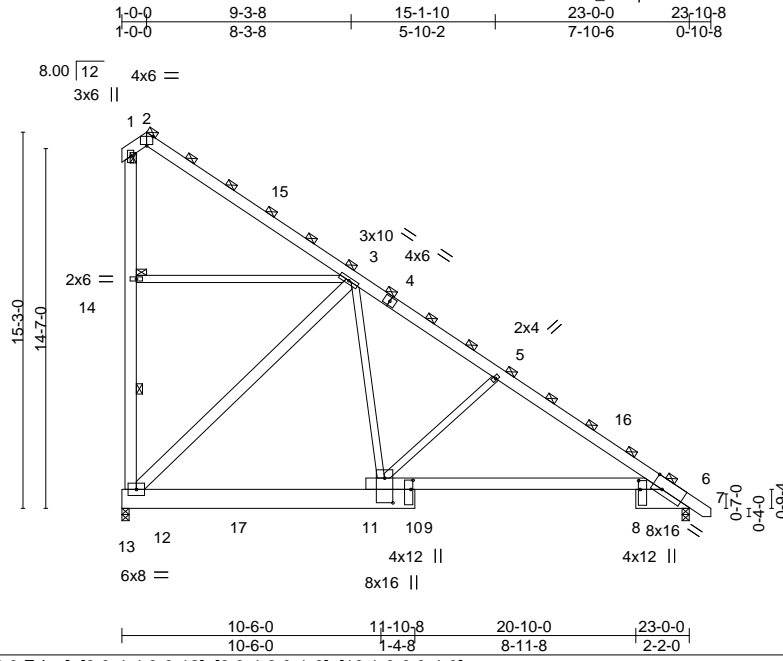

Scale = 1:93.4

Plate Offsets (X,Y)--	[2:0-3-0,Edge], [6:0-5-0,Edge], [8:0-4-4,0-0-12], [9:0-4-8,0-1-0], [10:1-0-0,0-4-0]				
LOADING (psf)	SPACING- 4-3-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.46	Vert(LL) -0.13 6-10 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.58	Vert(CT) -0.32 6-10 >835 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.79	Horz(CT) 0.09 6 n/a n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-S	Wind(LL) 0.06 6-10 >999 240	Weight: 490 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals (Switched from sheeted: Spacing > 2-8-0).
BOT CHORD 2x10 SP No.1 *Except* 6-11: 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-12,3-12: 2x6 SP No.1	WEBS 1 Row at midpt 12-14
	JOINTS 1 Brace at Jt(s): 2, 1, 14

REACTIONS. (size) 6=0-3-8, 12=0-3-8
 Max Horz 12=1022(LC 13)
 Max Uplift 12=495(LC 13)
 Max Grav 6=2081(LC 20), 12=2394(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-404/270, 2-3=-460/130, 3-5=-2294/0, 5-6=-2868/0, 12-14=-544/352,
 1-14=-545/353
 BOT CHORD 10-12=0/1758, 6-10=0/2219
 WEBS 5-10=-919/438, 3-12=-2436/641, 3-10=0/1857

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=495.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




September 20, 2023

Job J0923-5065	Truss A8	Truss Type ROOF TRUSS	Qty 1	Ply 2	Weaver/Lot 50 West Pointe III/Harnett	I60868935
-------------------	-------------	--------------------------	----------	----------	---------------------------------------	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:11 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzak1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrdoi7J4zJC?f



Scale = 1:89.8

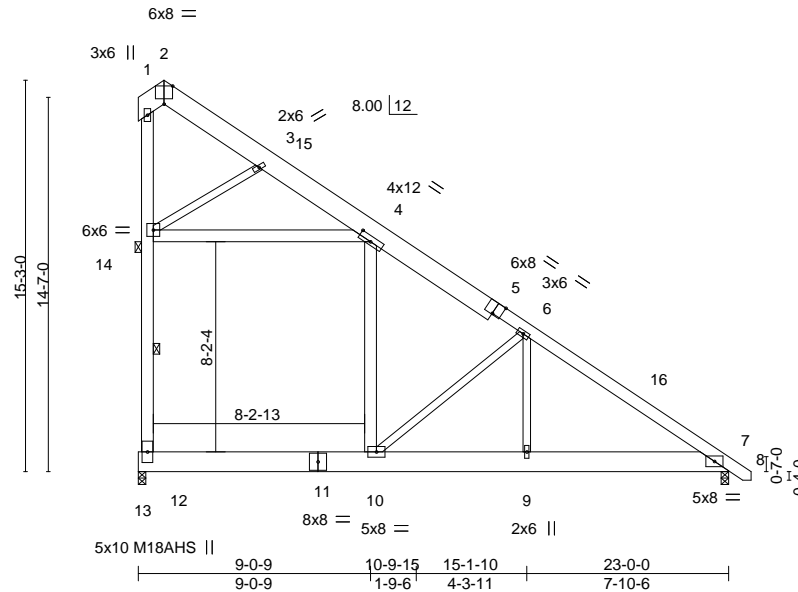


Plate Offsets (X,Y)--	[2:0-4-0,Edge], [4:0-6-0,0-2-8], [5:0-4-0,Edge]							
LOADING (psf)	SPACING- 2-8-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.73	Vert(LL) -0.21	10	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(CT) -0.46	10	>587	240	M18AHS	186/179
BCLL 0.0 *	Rep Stress Incr NO	WB 0.48	Horz(CT) 0.01	7	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-S	Wind(LL) 0.17	10	>999	240		Weight: 563 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 5-8: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x10 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 6-9,6-10,3-14: 2x4 SP No.2	WEBS 1 Row at midpt 12-14 1 Brace at Jt(s): 14
	JOINTS

REACTIONS. (size) 12=0-3-8, 7=0-3-8
Max Horz 12=633(LC 13)
Max Uplift 12=7(LC 13)
Max Grav 12=2288(LC 21), 7=1482(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-808/104, 4-6=-829/128, 6-7=-2233/92, 12-14=-1091/133
BOT CHORD 10-12=-119/629, 9-10=0/1720, 7-9=0/1720
WEBS 4-14=-184/957, 6-9=0/1086, 4-10=0/833, 6-10=-2198/295, 3-14=-1790/225

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s). 4-14; Wall dead load (5.0psf) on member(s).4-10
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12.
 - Attic room checked for L/360 deflection.



September 20, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job J0923-5065	Truss A9	Truss Type ROOF TRUSS	Qty 3	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868936
-------------------	-------------	--------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:13 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

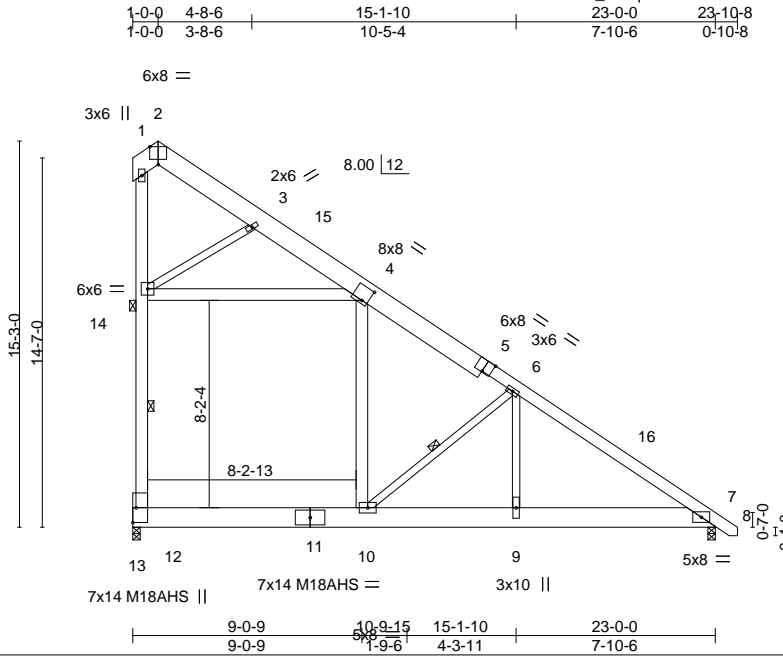

Scale = 1:91.0

Plate Offsets (X,Y)--	[2:0-4-0,Edge], [4:0-2-12,0-6-8], [5:0-4-0,Edge]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.96	Vert(LL)	-0.32	10	>844	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.69	10	>392	240	M18AHS	186/179
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.60	Horz(CT)	0.01	7	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.26	10	>999	240		
									Weight: 282 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 5-8: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x10 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 8-6-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 6-9,6-10,3-14: 2x4 SP No.2	WEBS 1 Row at midpt 12-14, 6-10
	JOINTS 1 Brace at Jt(s): 14

REACTIONS. (size) 12=0-3-8, 7=0-3-8
 Max Horz 12=-475(LC 13)
 Max Uplift 12=-5(LC 13)
 Max Grav 12=1716(LC 21), 7=1111(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-606/78, 4-6=-622/96, 6-7=-1675/69, 12-14=-818/100
 BOT CHORD 10-12=-89/471, 9-10=0/1290, 7-9=0/1290
 WEBS 4-14=-138/718, 6-9=0/815, 4-10=0/624, 6-10=-1648/221, 3-14=-1342/169

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 5-4-13, Interior(1) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Ceiling dead load (10.0 psf) on member(s). 4-14; Wall dead load (5.0psf) on member(s). 4-10
 - 7) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12.
 - 9) Attic room checked for L/360 deflection.




September 20, 2023

Job	Truss	Truss Type	Qty	Ply	Weaver/Lot 50 West Pointe III/Harnett	160868937
J0923-5065	A9GE	COMMON SUPPORTED GAB	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:15 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f



Scale = 1:91.0

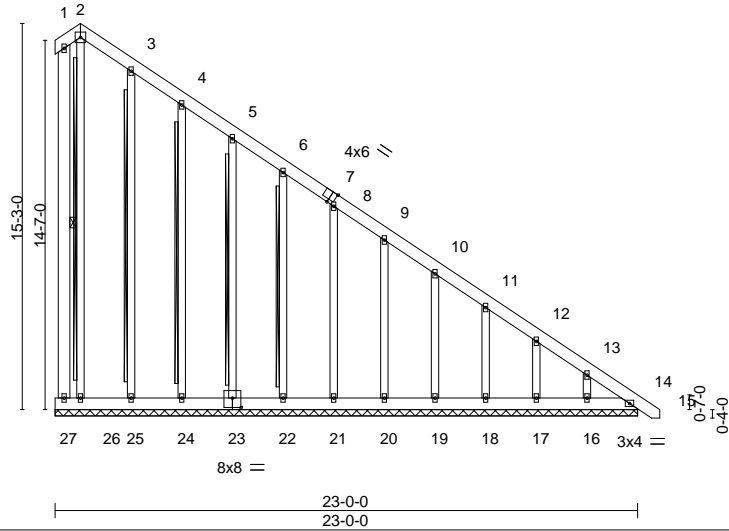


Plate Offsets (X, Y)--	[7:0-2-9,Edge], [23:0-4-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) 0.00 14 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.06	Vert(CT) 0.00 14 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.01 14 n/a n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-S		Weight: 280 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 1-27
 T-Brace: 2x4 SPF No.2 - 3-25, 4-24, 5-23, 6-22
 2x6 SPF No.2 - 2-26
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS. All bearings 23-0-0.
 (lb) - Max Horz 27=-695(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17 except 16=-116(LC 13), 14=-100(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16 except 14=414(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 5-6=-254/197, 6-8=-329/256, 8-9=-404/314, 9-10=-479/373, 10-11=-554/432, 11-12=-629/491, 12-13=-705/550, 13-14=-794/626
 BOT CHORD 26-27=-536/694, 25-26=-536/694, 24-25=-536/694, 23-24=-536/694, 22-23=-536/694, 21-22=-536/694, 20-21=-536/694, 19-20=-536/694, 18-19=-536/694, 17-18=-536/694, 16-17=-536/694, 14-16=-536/694

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-4-4 to 5-4-13, Exterior(2) 5-4-13 to 23-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17 except (jt=lb) 16=116, 14=100.
- 10) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

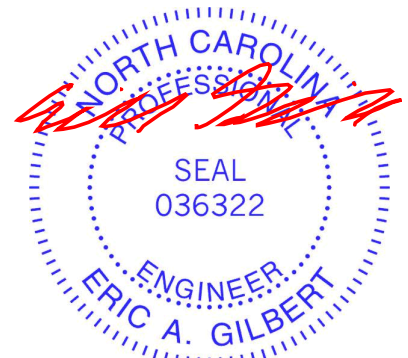

September 20, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0923-5065	Truss B1	Truss Type COMMON SUPPORTED GAB	Qty 5	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868938
-------------------	-------------	------------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:16 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



5x8 =

Scale = 1:84.5

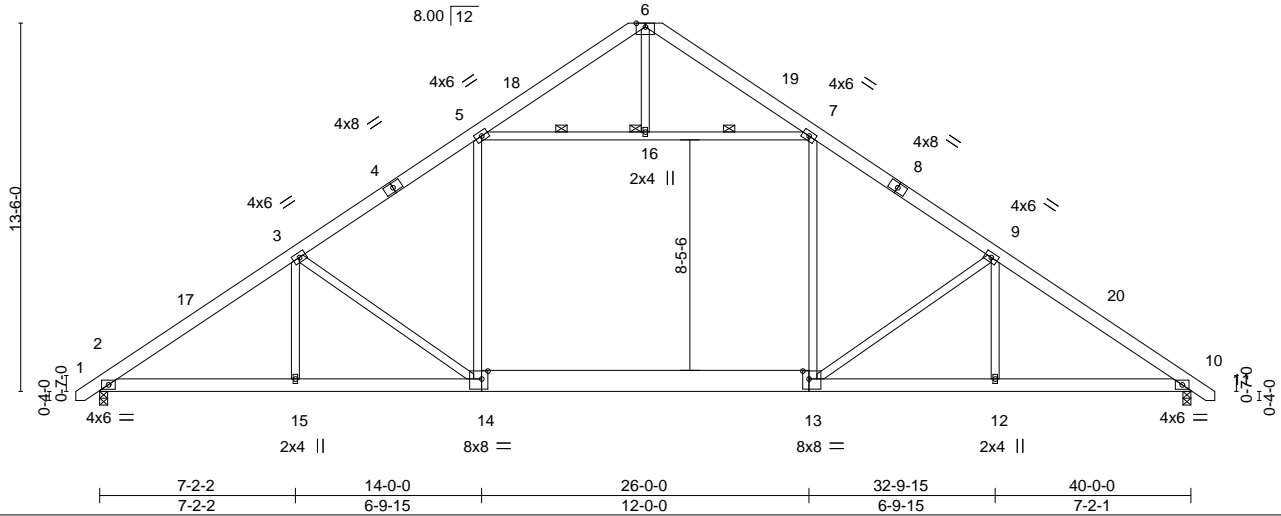


Plate Offsets (X,Y)--	[13:0-2-12,0-3-8], [14:0-2-12,0-3-8]
-----------------------	--------------------------------------


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.38	12-13	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.44	12-13	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.74	Horz(CT)	0.06	10	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S	Wind(LL)	0.33	14-15	>999		
								Weight: 316 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-7-8 oc purlins.
BOT CHORD 2x6 SP No.1 *Except* 13-14: 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 5-16, 7-16
	JOINTS 1 Brace at Jt(s): 16

REACTIONS.	(size)
	2=0-3-8, 10=0-3-8
	Max Horz 2=-331(LC 10)
	Max Uplift 2=-96(LC 12), 10=-96(LC 13)
	Max Grav 2=1796(LC 19), 10=1796(LC 20)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2750/460, 3-5=-2355/477, 5-6=-484/192, 6-7=-484/192, 7-9=-2357/477, 9-10=-2751/460
BOT CHORD	2-15=-245/2414, 14-15=-245/2414, 13-14=-82/1966, 12-13=-247/2167, 10-12=-247/2167
WEBS	5-14=-6/763, 7-13=-6/764, 5-16=-1571/395, 7-16=-1571/395, 3-15=-43/260, 3-14=-642/238, 9-12=-48/260, 9-13=-642/240

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-9 to 3-8-4, Interior(1) 3-8-4 to 20-0-0, Exterior(2) 20-0-0 to 24-4-13, Interior(1) 24-4-13 to 40-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.

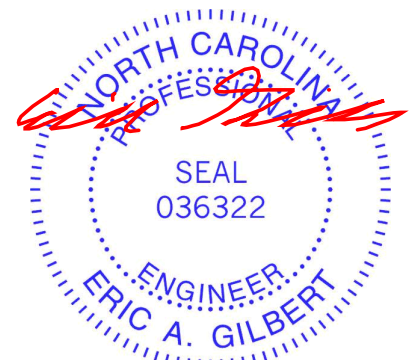

September 20, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0923-5065	Truss B1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868939
-------------------	---------------	------------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:19 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzKaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



5x8 =

Scale = 1:84.5

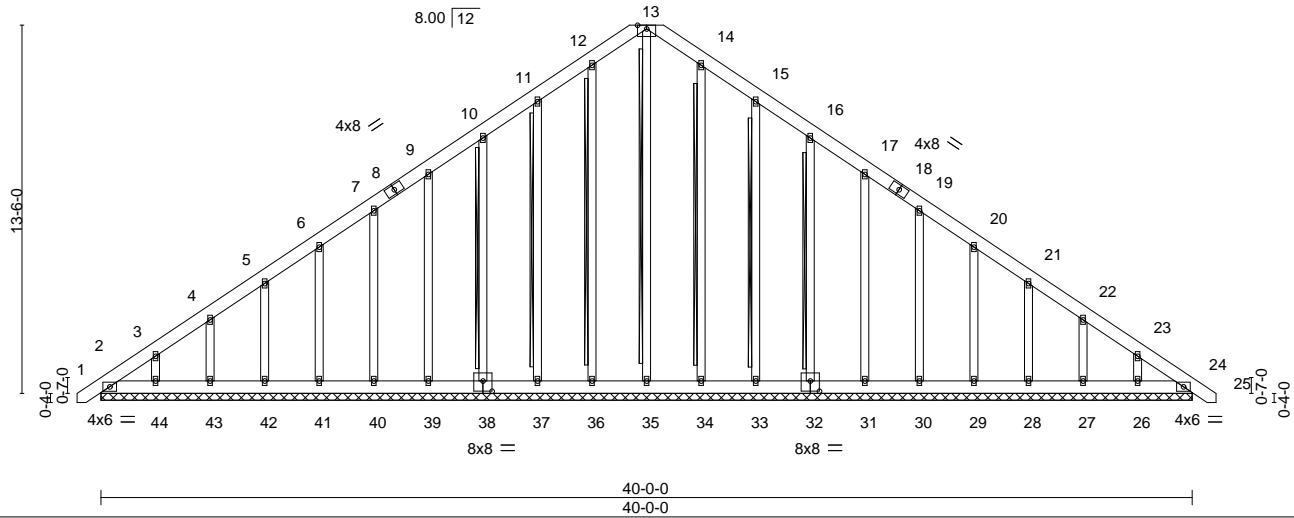


Plate Offsets (X, Y)--	[32:0-4-0,0-4-8], [38:0-4-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) 0.00 24 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) 0.00 24 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.25	Horz(CT) 0.01 24 n/a n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-S		Weight: 399 lb	FT = 20%

LUMBER-	BRACING-	
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.	
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
OTHERS 2x4 SP No.2	WEBS T-Brace: 2x4 SPF No.2 - 13-35, 12-36, 11-37, 10-38, 14-34, 15-33, 16-32	
	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.	
	Brace must cover 90% of web length.	

REACTIONS. All bearings 40-0-0.
 (lb) - Max Horz 2=414(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 35, 36, 38, 39, 40, 41, 42, 43, 34, 32, 31, 30, 29, 28, 27, 24 except 2=110(LC 8), 37=102(LC 12), 44=105(LC 12), 33=106(LC 13), 26=102(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 36, 37, 38, 39, 40, 41, 42, 43, 44, 34, 33, 32, 31, 30, 29, 28, 27, 26, 24 except 35=277(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-441/318, 3-4=-357/284, 4-5=-292/257, 10-11=-216/283, 11-12=-284/333, 12-13=-310/354, 13-14=-310/354, 14-15=-284/319, 22-23=-263/167, 23-24=-346/238
 BOT CHORD 2-44=-212/326, 43-44=-212/326, 42-43=-212/326, 41-42=-212/326, 40-41=-212/326, 39-40=-212/326, 38-39=-212/326, 37-38=-212/326, 36-37=-212/326, 35-36=-212/326, 34-35=-212/326, 33-34=-212/326, 32-33=-212/326, 31-32=-212/326, 30-31=-212/326, 29-30=-212/326, 28-29=-212/326, 27-28=-212/326, 26-27=-212/326, 24-26=-212/326
 WEBS 13-35=-256/167

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-8-9 to 3-8-4, Exterior(2) 3-8-4 to 20-0-0, Corner(3) 20-0-0 to 24-4-13, Exterior(2) 24-4-13 to 40-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 35, 36, 38, 39, 40, 41, 42, 43, 34, 32, 31, 30, 29, 28, 27, 24 except (jt=lb) 2=110, 37=102, 44=105, 33=106, 26=102.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



September 20, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job J0923-5065	Truss C1	Truss Type ATTIC	Qty 1	Ply 1	Weaver/Lot 50 West Pointe III/Harnett 160868940
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:21 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



6x8 =

Scale = 1:80.6

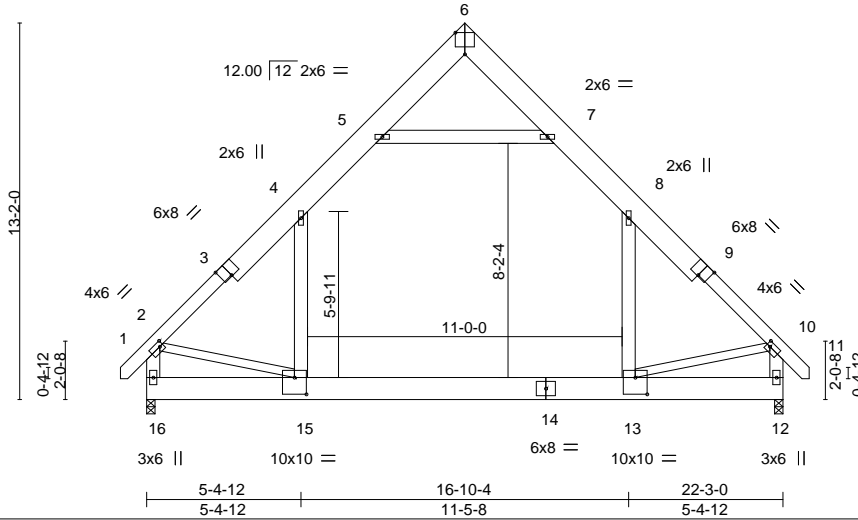


Plate Offsets (X,Y)--	[2:0-1-8,0-2-0], [3:0-4-0,Edge], [6:0-4-0,Edge], [9:0-4-0,Edge], [10:0-1-8,0-2-0], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	-0.12 13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.58	Vert(CT)	-0.19 13-15	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.01 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.05 15	>999	240	Weight: 268 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 1-3,9-11: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 2-15,10-13: 2x4 SP No.2	

REACTIONS. (size) 16=0-3-8, 12=0-3-8
 Max Horz 16=-419(LC 10)
 Max Grav 16=1469(LC 21), 12=1469(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1675/22, 4-5=-1045/187, 7-8=-1045/187, 8-10=-1675/21, 2-16=-1615/65,
 10-12=-1616/65
 BOT CHORD 15-16=-425/555, 13-15=0/1123
 WEBS 5-7=-1194/265, 4-15=0/744, 8-13=0/744, 2-15=-1/1037, 10-13=-10/1044

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-9-0 to 3-7-13, Exterior(2) 3-7-13 to 11-2-0, Corner(3) 11-2-0 to 15-6-13, Exterior(2) 15-6-13 to 23-1-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s). 4-15, 8-13
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 13-15
 - 7) Attic room checked for L/360 deflection.

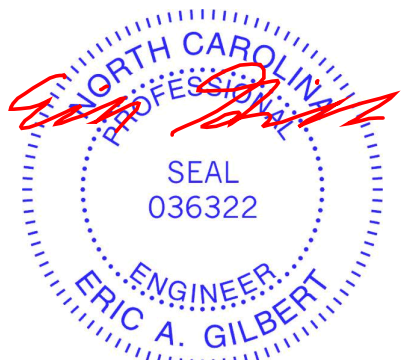

September 20, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job J0923-5065	Truss C2	Truss Type ATTIC	Qty 8	Ply 1	Weaver/Lot 50 West Pointe III/Harnett 160868941
-------------------	-------------	---------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:22 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



6x8 =

Scale = 1:80.6

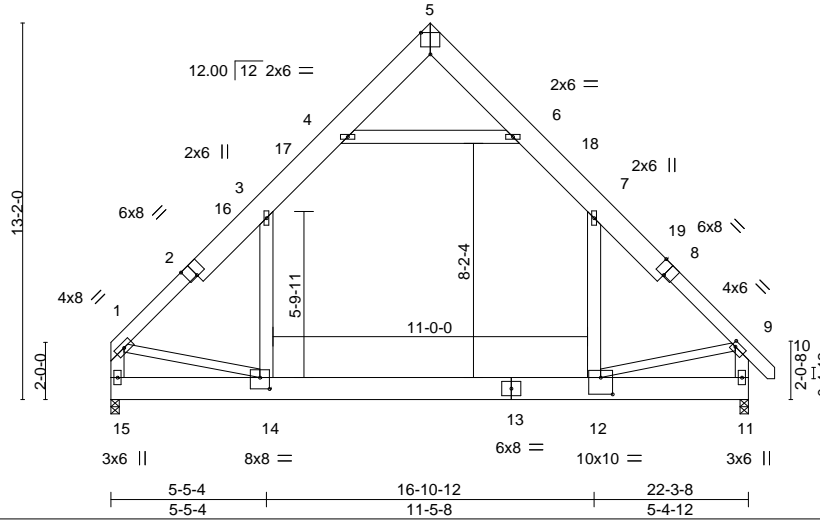


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [5:0-4-0,Edge], [8:0-4-0,Edge], [9:0-1-8,0-2-0], [12:0-5-0,0-7-0], [14:0-4-0,0-4-12]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.12 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.58	Vert(CT)	-0.20 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.01 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.04 14	>999	240	Weight: 265 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 1-2,8-10: 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-8-4 oc purlins, except end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 1-14,9-12: 2x4 SP No.2	


REACTIONS. (size) 15=0-3-8, 11=0-3-8
Max Horz 15=308(LC 11)
Max Grav 15=1434(LC 21), 11=1478(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-1661/0, 3-4=-1046/155, 6-7=-1041/146, 7-9=-1669/0, 1-15=-1558/0, 9-11=-1617/31
BOT CHORD 14-15=-292/402, 12-14=0/1100
WEBS 4-6=-1220/199, 3-14=0/727, 7-12=0/751, 1-14=0/1026, 9-12=0/1011

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 11-2-0, Exterior(2) 11-2-0 to 15-6-13, Interior(1) 15-6-13 to 23-1-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (10.0 psf) on member(s), 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s), 3-14, 7-12
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
 - 7) Attic room checked for L/360 deflection.

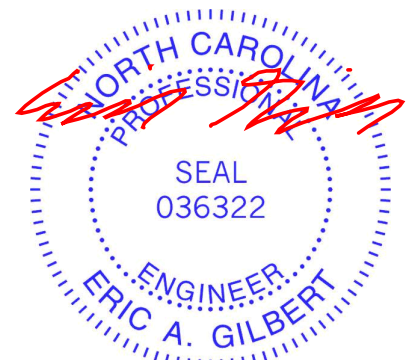

September 20, 2023


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job J0923-5065	Truss C3	Truss Type ATTIC	Qty 1	Ply 2	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868942
-------------------	-------------	---------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:24 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwCDoi7J4zJC?f



6x8 =

Scale = 1:80.6

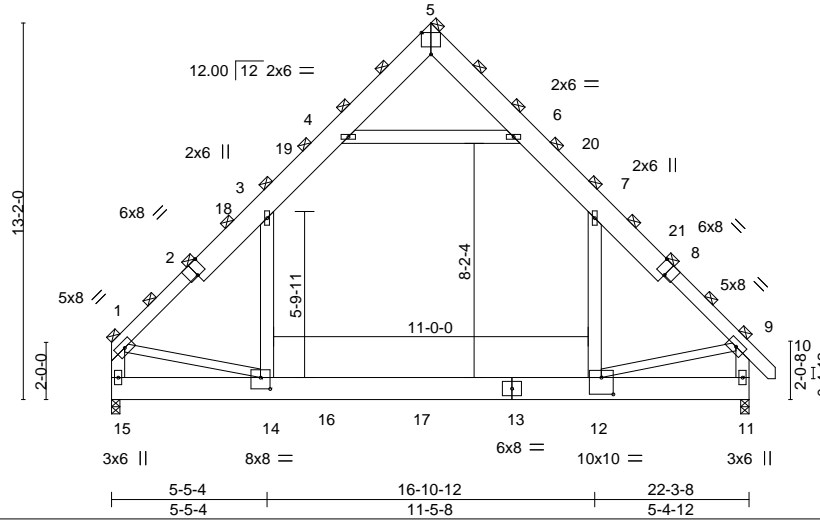


Plate Offsets (X,Y)-- [2:0-4-0,Edge], [5:0-4-0,Edge], [8:0-4-0,Edge], [12:0-5-0,0-7-0], [14:0-4-0,0-4-12]

LOADING (psf)	SPACING-	3-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.14 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.76	Vert(CT)	-0.22 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.23	Horz(CT)	0.01 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S	Wind(LL)	0.04 12-14	>999	240		
								Weight: 531 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1 *Except* 1-2,8-10: 2x6 SP No.1	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals (Switched from sheeted: Spacing > 2-8-0).
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1 *Except* 1-14,9-12: 2x4 SP No.2	

REACTIONS. (size) 15=0-3-8, 11=0-3-8
 Max Horz 15=461(LC 11)
 Max Grav 15=2782(LC 21), 11=2657(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-3258/53, 3-4=-1866/275, 4-5=-67/483, 5-6=-65/413, 6-7=-1937/271, 7-9=-3213/57,
 1-15=-3076/74, 9-11=-3100/140
 BOT CHORD 14-15=-440/631, 12-14=0/2132, 11-12=-90/352
 WEBS 4-6=-2527/395, 3-14=0/1661, 7-12=0/1519, 1-14=0/1953, 9-12=0/2038

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x10 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 11-2-0, Exterior(2) 11-2-0 to 15-6-13, Interior(1) 15-6-13 to 23-1-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s). 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s).3-14, 7-12
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 545 lb down and 76 lb up at 7-4-8, and 545 lb down and 76 lb up at 10-8-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

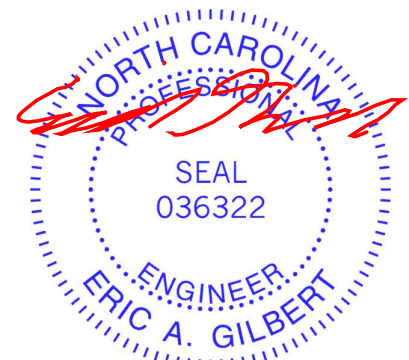

September 20, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job J0923-5065	Truss C3	Truss Type ATTIC	Qty 1	Ply 2	Weaver/Lot 50 West Pointe III/Harnett I60868942 Job Reference (optional)
-------------------	-------------	---------------------	----------	-----------------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:24 2023 Page 2
ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 14-15=-30, 12-14=-60, 11-12=-30, 1-3=-90, 3-4=-120, 4-5=-90, 5-6=-90, 6-7=-120, 7-9=-90, 9-10=-90, 4-6=-30

Drag: 3-14=-15, 7-12=-15

Concentrated Loads (lb)

Vert: 16=-300(B) 17=-300(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0923-5065	Truss PB	Truss Type PIGGYBACK	Qty 8	Ply 1	Weaver/Lot 50 West Pointe III/Harnett 160868943
-------------------	-------------	-------------------------	----------	----------	--


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:25 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RIC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



Scale = 1:14.0

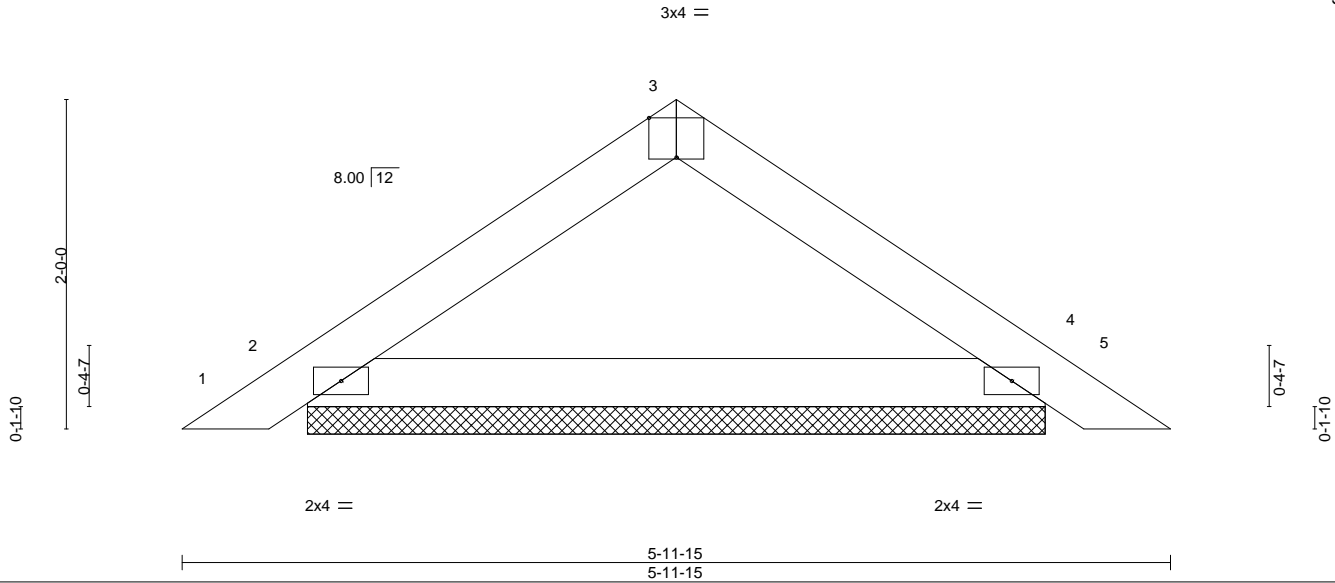

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	0.00	5	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	0.00	5	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 17 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-11-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-5-11, 4=4-5-11
 Max Horz 2=44(LC 11)
 Max Uplift 2=-17(LC 12), 4=-17(LC 13)
 Max Grav 2=209(LC 1), 4=209(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

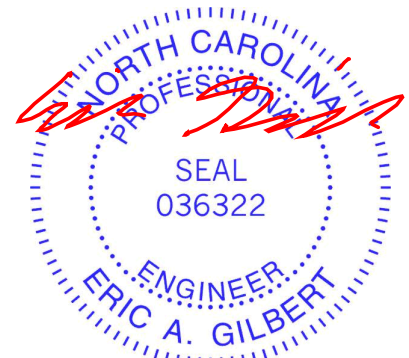

September 20, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0923-5065	Truss PBGE	Truss Type GABLE	Qty 1	Ply 1	Weaver/Lot 50 West Pointe III/Harnett Job Reference (optional)	160868944
-------------------	---------------	---------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue Sep 19 10:19:26 2023 Page 1

ID:FKRF2G2VvSGFSXRUG_ubJqzaK1d-RIC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

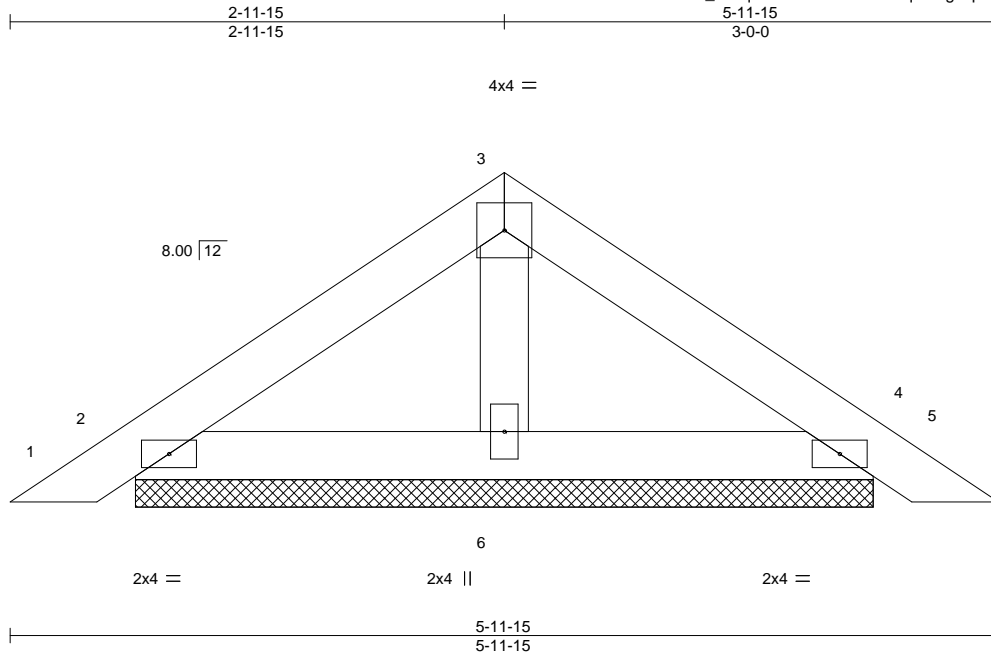

Scale = 1:14.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	Vert(LL)	0.00	5	n/r	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT)	0.00	5	n/r		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 19 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-11-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-5-11, 4=4-5-11, 6=4-5-11
Max Horz 2=55(LC 11)
Max Uplift 2=-49(LC 12), 4=-56(LC 13), 6=-1(LC 12)
Max Grav 2=130(LC 1), 4=130(LC 1), 6=158(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

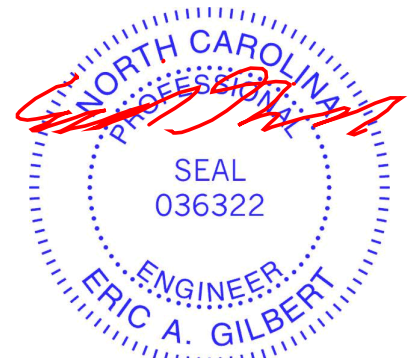

September 20, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

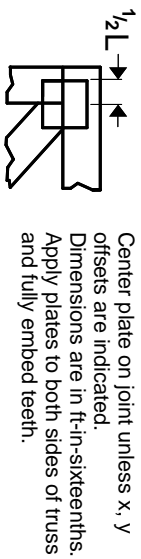

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

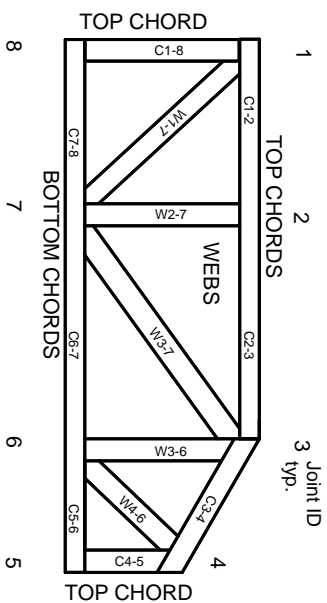

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.