COLEMAN

HARRINGTON PLACE LOT 0033

PLAN ID 060121.1201



110 VILLAGE TRAIL SUITE 215 WOODSTOCK, GA. 30188

DRAWING INDEX

A0.0	COVER SHEET
A1.1	FRONT ELEVATIONS
A2.1	SIDE & REAR ELEVATIONS
A3.1	SLAB FOUNDATION
A5.1	FIRST FLOOR PLANS & DETAILS
A5.2	SECOND FLOOR PLANS & DETAILS
A6.1	ROOF PLANS
A7.2-A7.3	ELECTRICAL PLANS

AREA TABULATION				
FIRST FLOOR	838			
SECOND FLOOR	1215			
TOTAL	2053			
GARAGE	438			
FRONT PORCH (COVERED)	84			
REAR PATIO	120			

GOVERNMENTAL CODES & STANDARDS

HOME TO BE BUILT TO CONFORM TO ALL APPLICABLE LOCAL CODES, PRACTICES AND STANDARDS

BUILDING CODE ANALYSIS / DESIGN CRITERIA


HOME TO BE BUILT TO MEET OR EXCEED ALL LOCAL CODES AND DESIGN CRITERIA


PLAN REVISIONS				
DATE	BY	REVISION	PAGE #	
10/30/2021	AW	Prototype walk revisions - see revision sheet	ALL	
4/1/2022	AW	Final walk revisions - see revision sheet	A5.2, A5.2, A7.3	
11/1/2022	AW	PCR #4985 Change 2x6 wall in laundry to 2-2x4s - takes 1.5" out of hall/linen	A5.2, A7.3	
12/1/2022	AW	PCR #5030 Added 8" in depth to kitchen (pantry & around island) - reduced Dining/Study 8" in depth	A3.1, A5.1, A7.2, A8.1	
9/21/2023	ВВ	REMOVED SHOWER AND TUB SIZES FROM ALL AFFECTED PAGES	A3.1, A5.1, A7.3	

ALL NON-MASONRY RETURNS TO BE HORIZONTAL SIDING

SEE SHEET D3 OF SDH TYPICAL DETAILS FOR SOFFIT DETAILS PER SOFFIT MATERIAL

HARRINGTON PLACE LOT 0033

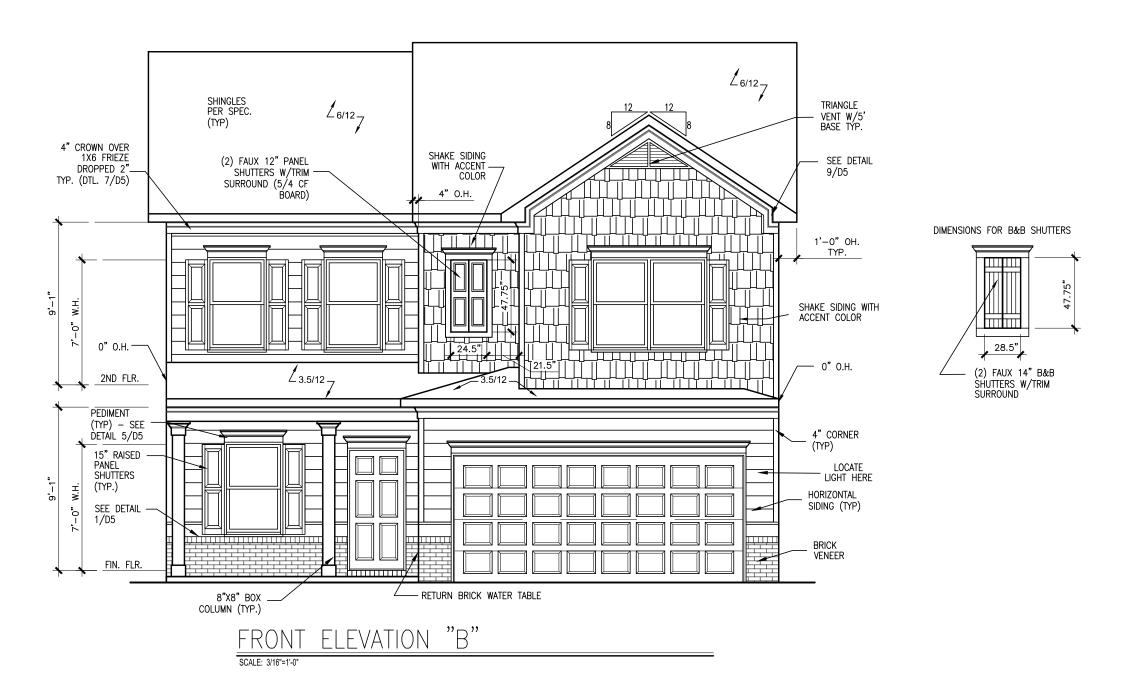



SMITH DOUGLAS HOMES QUALITY | INTEGRITY | VALUE


ELEVATIONS FRONT ELEVATION COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH DOUGLAS HOMES.





SHINGLES PER SPEC. (TYP) L_{8/12</sup>7} 1'-0" O.H. TYP. LEFT ELEVATION "B"

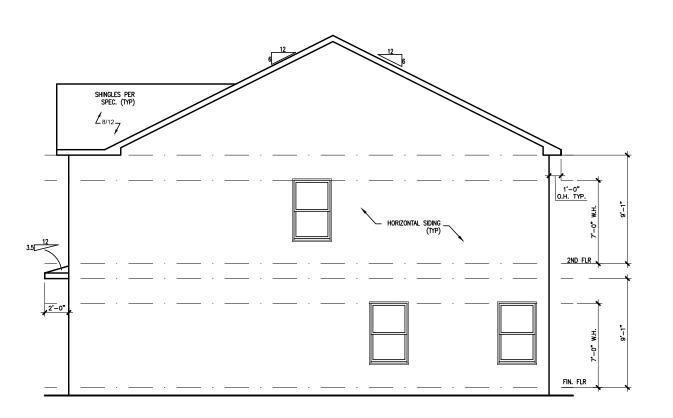

RIGHT ELEVATION "B"

HARRINGTON PLACE LOT 0033

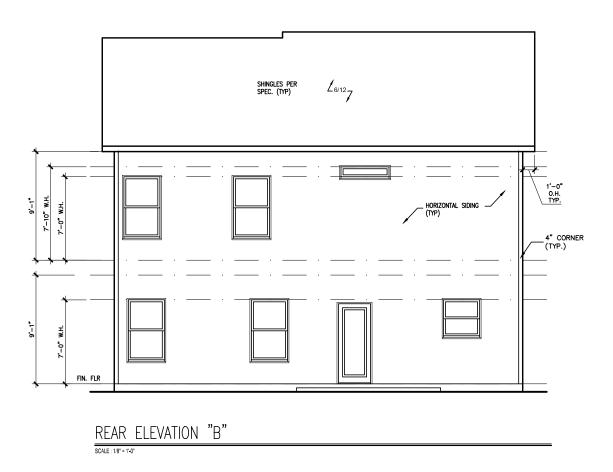



 ${\mathfrak P}_{\mathfrak P}$ smith douglas homes AND REAR

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SIDES

COLEMAN

ELEVATIONS




6'-10" 12'-0" 15'-2" DROP 4" BELOW HOUSE SLAB 7'-9" PROVIDE ELECTRICAL CONDUIT TO ISLAND 18"-5½" **(WH)** | DROP 4" BELOW HOUSE SLAB START AT THIS CORNER TO LAY OUT PLATES DROP 4" BELOW HOUSE SLAB 16' X 7' OHGD (R.O. 16'-3" X 7'-1 1/2") 1'-10%" 1'-10½" 16'-3" SLAB PLAN SCALE : 1/8" = 1'-0"

HARRINGTON PLACE LOT 0033

*RADON VENT PROVIDED PER LOCAL CODE

REFER TO DETAIL 3/D1 FOR BRICK LEDGE DETAIL WHEN BRICK VENEER IS CHOSEN



SMITH DOUGLAS HOMES

FOUNDATION PLAN
SLAB PLAN
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without writte consent from SMITH DOUGLAS HOMES.





HARRINGTON PLACE LOT 0033 15'-2" 10'X12' PATIO 15'-7"





SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com



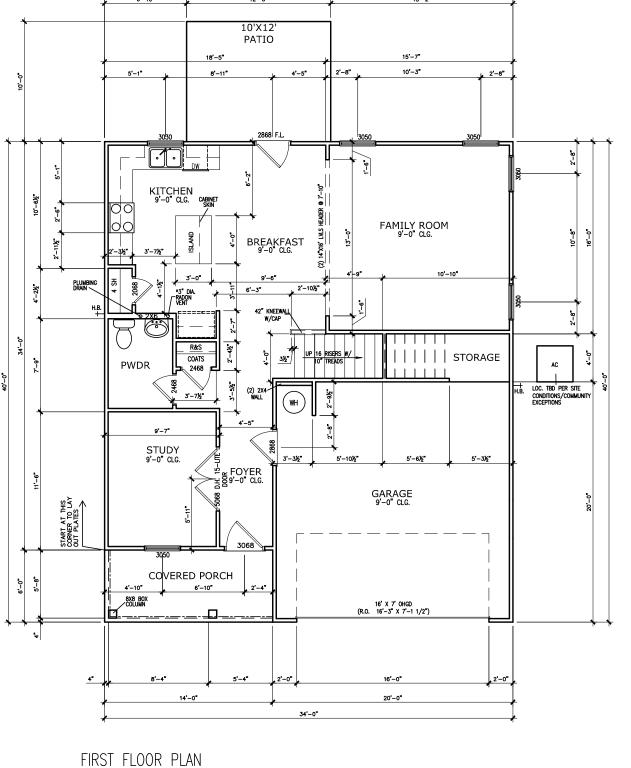


SCALE : 1/8" = 1'-0"

*RADON VENT PROVIDED

PER LOCAL CODE

HARRINGTON PLACE LOT 0033

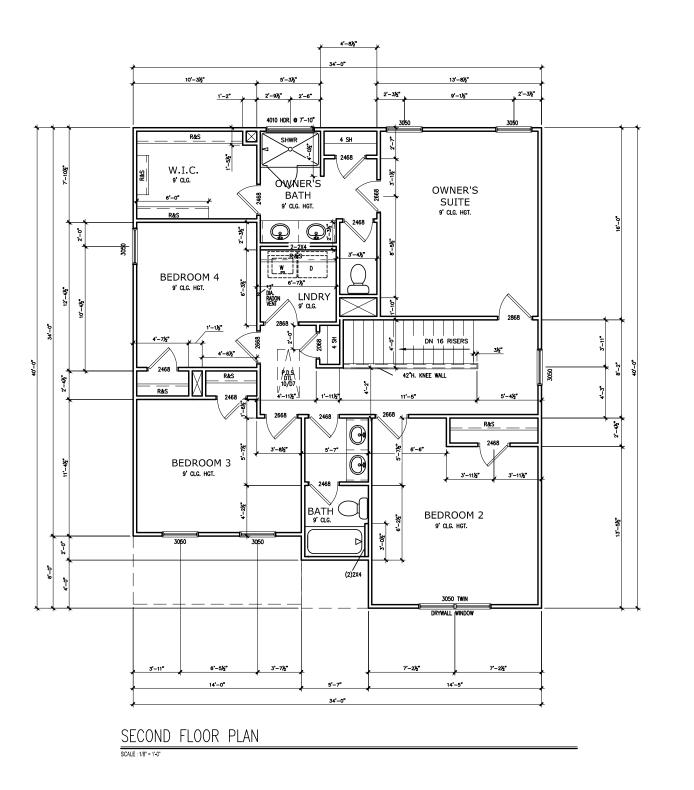

DATE

REVISION

REVISION

REVISION

REVISION

REVISION

SMITH DOUGLAS HOMES

FLOOR PLAN
SECOND FLOOR
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in thes plans and drawings. These plans and relate drawings are not to breproduced without writt consent from SMITH DOUGLAS HOMES.


*RADON VENT PROVIDED PER LOCAL CODE


REFER TO MANUFACTURER'S SPECS. FOR DRAIN LOCATIONS ON DETAIL SHEETS D12, D12.1, & D12.2

© SMITH DOUGLAS HOMES 2021



HARRINGTON PLACE LOT 0033

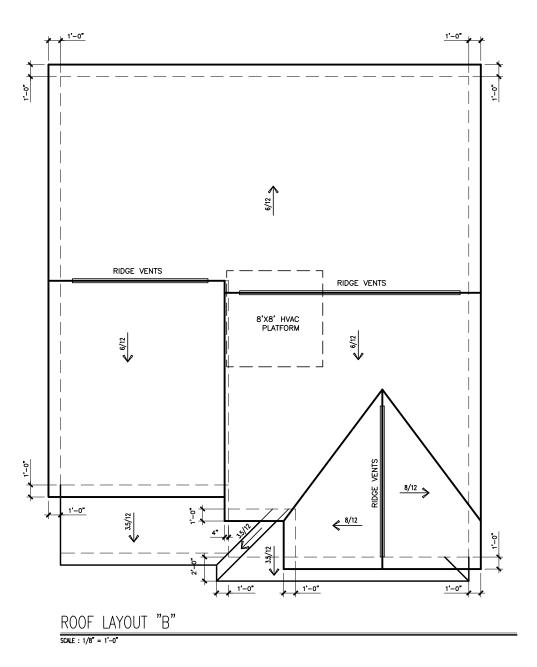









SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com


SMITH DOUGLAS HOME expressly reserves it' property rights in thet plans and drawings. These plans and relatt drawings are not to the reproduced without writ consent from SMITH DOUGLAS HOMES.



HARRINGTON PLACE LOT 0033

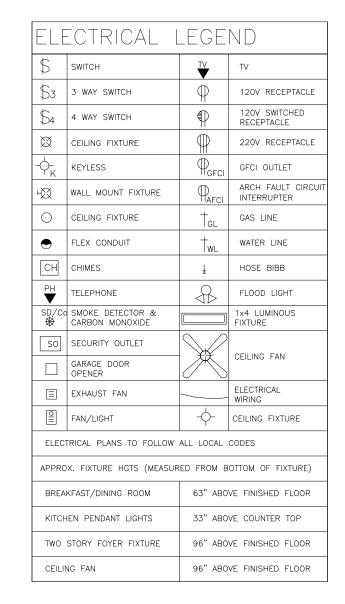


NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER

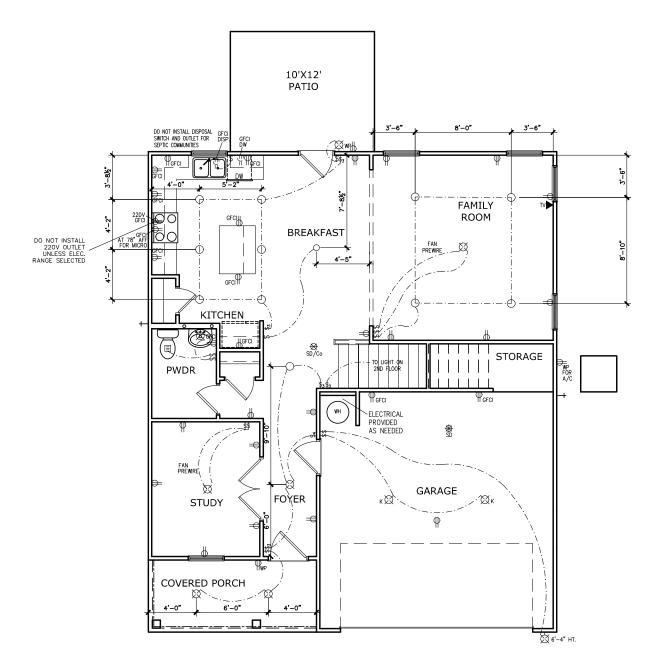

FIRST FLOOR ELECTRICAL PLAN

CALE : 1/8" = 1'-0"



SMITH DOUGLAS HOMES

FLOOR

FIRST

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES

COLEMAN


ELECTRICAL PLAN

W.I.C. OWNER'S BATH BEDROOM 4 PREWIE LNDRY BEDROOM 3 BEDROOM 3 BEDROOM 2 BEDROOM 2 BEDROOM 2

HARRINGTON PLACE LOT 0033

ELECTRICAL LEGEND					
\$	SWITCH	TV	TV		
\$3	3 WAY SWITCH	Ψ	120V RECEPTACLE		
\$4	4 WAY SWITCH		120V SWITCHED RECEPTACLE		
Ø	CEILING FIXTURE	•	220V RECEPTACLE		
- ∳ K	KEYLESS	P _{GFCI}	GFCI OUTLET		
₩X	WALL MOUNT FIXTURE	PAFCI	ARCH FAULT CIRCUIT INTERRUPTER		
0	CEILING FIXTURE	† _{GL}	GAS LINE		
•	FLEX CONDUIT	† _{wL}	WATER LINE		
СН	CHIMES	¥	HOSE BIBB		
PH	TELEPHONE	8	FLOOD LIGHT		
SD/Co	SMOKE DETECTOR & CARBON MONOXIDE		1x4 LUMINOUS FIXTURE		
SO	SECURITY OUTLET		05000 500		
	GARAGE DOOR OPENER		CEILING FAN		
	EXHAUST FAN		ELECTRICAL WIRING		
0			CEILING FIXTURE		
ELECTRICAL PLANS TO FOLLOW ALL LOCAL CODES					
APPROX. FIXTURE HGTS (MEASURED FROM BOTTOM OF FIXTURE)					
BREAKFAST/DINING ROOM 63" ABOVE FINISHED FLOOR					
KITCH	KITCHEN PENDANT LIGHTS 33" ABOVE COUNTER TOP				
TWO	TWO STORY FOYER FIXTURE 96" ABOVE FINISHED FLOOR				
CEILING FAN 96" ABOVE FINISHED FLOOR			VE FINISHED FLOOR		

NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER



SMITH DOUGLAS HOMES


SECOND FLOOR
COLEMAN

SMITH DOUGLAS HOMES
110 VILLAGE TRAIL
SUITE 115
WOODSTOCK, GA 30188
www.smithdouglas.com

SMITH DOUGLAS HOMES
expressly reserves it's
property rights in these
plans and drawings.
These plans and related
drawings are not to be
expreduced without written
consent from SMITH



SCALE : 1/8" = 1'-0"

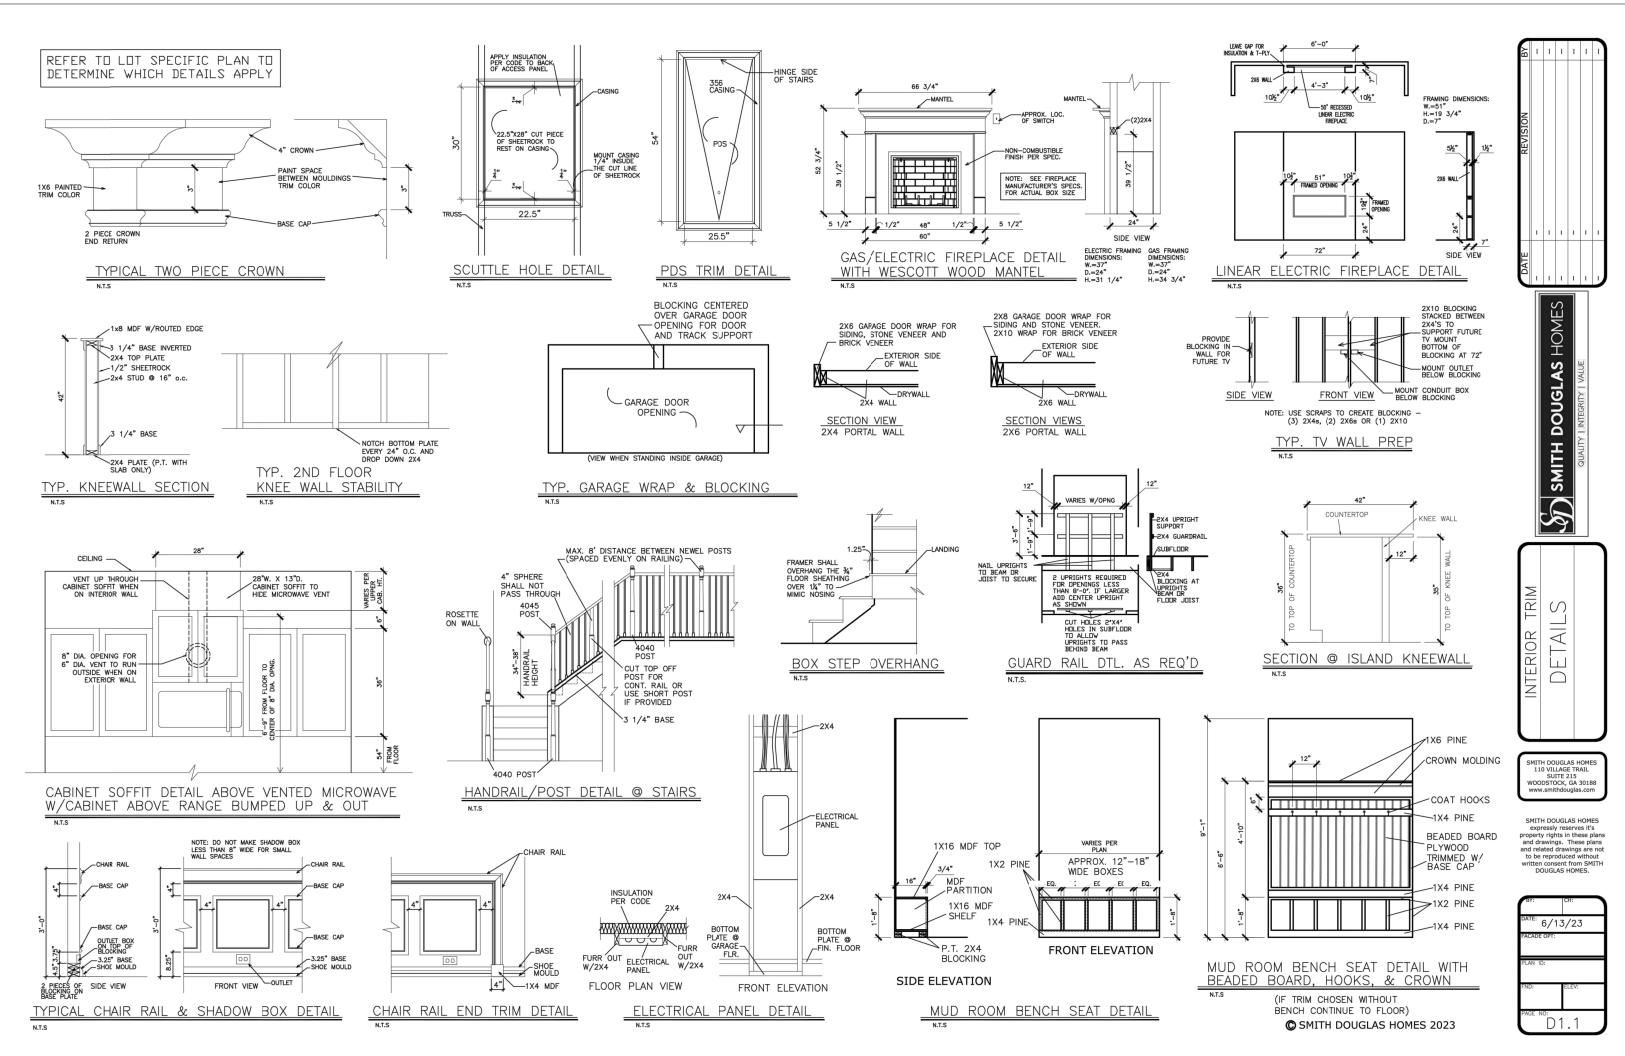

CONNECTION SPECIFICATIONS (TYP. U.N.O.)

DESCRIPTION OF BLDG. ELEMENT	3"x0.131" NAILS	3"x0.120" NAIL5
JOIST TO SOLE PLATE	(3) TOENAILS	(3) TOENAILS*
SOLE PL. TO JOIST/RIM OR BLK'G	NAILS @ 4" o.c.	NAILS @ 4" o.c.
STUD TO PLATE	(4) TOENAILS/ (3)END NAILS	(4) TOENAILS/ (4)END NAILS*
RIM TO TOP PLATE	TOENAILS @ 6" o.c.	TOENAILS @ 4" o.c.*
BLK'G. BTWN. JOISTS TO TOP PL.	(3) TOENAILS EA. END	(3) TOENAILS EA. END*
DOUBLE STUD	NAILS @ 16" o.c.	NAILS @ 16" o.c.
DOUBLE TOP PLATE	NAILS @ 12" o.c.	NAILS @ 8" o.c.
DOUBLE TOP PLATE LAP SPLICE	(12) NAILS IN LAPPED AREA (24" MIN.)	(15) NAILS IN LAPPED AREA (24" MIN.)
TOP PLATE LAP @ CORNERS & INTERSECTING WALLS	(3) NAILS	(3) NAILS
RAFTER/TRUSS TO TOP PLATE	(4) TOENAILS + (I) SIMPSON H2.5T	(4) TOENAILS + (1) SIMPSON H2.5T
GAB, END TRUSS TO DBL, TOP PL.	TOENAILS @ 8" o.c.	TOENAILS @ 6" o.c.
R.T. w/ HEEL HT. 91/4" TO 12"	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 6" O.C.	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. I2" TO I6"	2XI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 6" O.C.	2xI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. UP TO 24"	LAP WALL SHTG. W/ DBL. TOP PL. \$ INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C.	LAP WALL SHTG, W/ DBL, TOP PL. & INSTALL ON TRUSS VERT, - FASTEN W/ NAILS @ 6" O.C.*
R.T. w/ HEEL HT. 24" TO 48"	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL	LAP WALL SHTG, W DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL "
WALL TO FOUNDATION	WALL SHTG. LAP W/ SILL PL. & FASTENED PER SHEAR WALL FASTENING SPEC.	

2½°x0.113 IS AN ACCEPTABLE ALTERNATIVE TO A 3°x0.120°, SAME SPACING OR NUMBER OF NAILS. ONLY ACCEPTABLE WHERE * ARE SHOWN)

ADDITIONAL NOTES FOR TRUSS \$ I-JOIST MANUFACTURER

ROOF TRUSS AND ENGINEERED JOISTS SHALL BE DESIGNED TO MEET THE DEFLECTION CRITERIA BELOW UNLESS NOTED OTHERWISE ON PLAN. FOR ANY STRUCTURAL ISSUES RELATED TO ANY BUILDING COMPONENT IF COMPONENT SHOP DRAWINGS ARE NOT SUBMITTED TO M&K FOR REVIEW PRIOR TO FABRICATION, DELIVERY, OR INSTALLATION.

TRUSSES/JOISTS SHALL BE DESIGNED SO THAT DIFFERENTIAL DEFLECTION BETWEEN ADJACENT PARALLEL TRUSSES/JOISTS OR GIRDER TRUSSES/FLUSI BEAMS DO NOT EXCEED THE FOLLOWING:

- ROOF TRUSSES: 1/4" DEAD LOAD
- ATTIC TRUSSES, & I-JOISTS:
- 1/8" DEAD LOAD

ABSOLUTE DEAD LOAD DEFECTION OF ATTIC TRUSSES WHEN AD JACENT TO FLOOR FRAMING BY OTHERS SHALL BE LIMITED TO 3/16". (NOT DIFFERENTIAL DEEL ECTION)

VENEER LINTEL SCHEDULE

SPAN (MAX)	HEIGHT OF VENEER ABOVE LINTEL	STEEL ANGLE SIZE	
3'-0"	20 FT. MAX	L3"x3"x¼;"	
	3 FT. MAX	L3"x3"x¼"	
6'-0"	I2 FT. MAX	L4"x3"x¼"	
	20 FT. MAX	L5"x3½"x¾"	
8'-0"	3 FT. MAX	L4"x4"x¼" *	
0-0	I2 FT. MAX	L5"x3½"x¾"	
	l6 FT, MAX	L6"x3½"x3%"	
9'-6"	I2 FT. MAX	L6"x3½"x%;"	

L LINI (13-9) HALL SUPPORT 2 5%' - 3 ½' VENEER x/ 40 ps/ MAXIMUM VEIGHT. 6' SHALL HAVE 4" MIN. BEARING 16' SHALL HAVE 8" MIN. BEARING 16' SHALL NOT BE FASTENED BACK TO HEADER.

IS SHALL BY DE PERSIEDED BACK TO READER. IN WALL 64000. IN 1/5 DIA x 3 3/5 MAX VERSIEDE BACK TO ROOM FRANCER, IN WALL 64000. IN 1/5 DIA x 3 3/5 MAX VERBER HT. APPLIES TO ANY PORTION OF PRICK DVER THE OPENING. ALL INITIES SHALL BE LOAD LED VERTICAL. HERE SHPORTING VEREER x 27 MIDE THE EXTENSIOR TOE OF THE HORIZONTAL LES MAY DEC LOTH THE PELL TO DE 3/5 MIDE OVER THE DERANGL LEHHOL OF ON VERTICAL DINT FINISHING.

R QUEEN VENEER USE L4x3x/4".

GENERAL STRUCTURAL NOTES

FOUNDATION

- DESIGN IS BASED ON 2018 NCSBC-RESIDENTIAL CODE \$ 2018 IRC WITH SOUTH CAROLINA AMENDMENTS
- FOOTING DESIGN 2,000 PSF NET ALLOWABLE SOIL BEARING PRESSURE IS ASSUMED. BUILDER/CONTRACTOR MUST VERIFY.
- FASTEN 2x4/6 SILL PLATES TO CONC FND WITH A MINIMUM OF 2 ANCHORS PER PLATE, I2" MAX. FROM PLATE ENDS - UTILIZING
- I/2" DIA, ANCHOR BOLTS @ 6'-0" O.C.7" MIN, EMBEDMENT FA4 ANCHOR STRAPS @ 6'-0" O.C.
- FASTEN 2xIO SILL PLATES TO PRECAST BOMT WALLS WITH A MINIMUM OF 2 ANCHORS PER PLATE, 12" MAX. FROM PLATE ENDS - UTILIZING: I/2" DIA, BOLTS @ 2'-0" O.C
- ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT W/ PERIMETER FOUNDATION SHALL BE PRESERVATIVE TREATED SOUTHERN PINE #2
- BUILDER TO VERIEY CORROSION-RESISTANCE COMPATIBILITY OF HARDWARE & FASTENERS IN CONTACT W/ PRESERVATIVE-TREATED WOOD CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD
- FOUNDATION WALLS & FOOTINGS SHALL BE PLAIN CONCRETE, U.N.O.
- CONCRETE DESIGN BASED ON ACLIBIA CONCRETE SHALL ATTAIN THE FOLLOWING MIN. COMPRESSIVE STRENGTHS IN 28 DAYS, U.N.O.:
- f'c = 4,000 psi: FOUNDATION WALLS 3,000 psi: FOOTINGS & INTERIOR SLABS ON GRADE 3500 psi: GARAGE & EXTERIOR SLABS ON GRADE 60,000 psi
- BASEMENT FOUNDATION WALL DESIGN BASED ON:
 - 8' OR 9' HEIGHT (AS NOTED ON PLANS) TALLER WALLS MUST BE ENGINEERED
- BASEMENT WALL DESIGN IS BASED ON 30 OR 45 PCF BACKFILL SOIL TYPE CLASSIFICATIONS:
 - 30 PCF TYPF (GW GP SW SP) 45 PCF TYPE (GM, GC, SM, SM-SC, ML)
 - IMPORTANT IF 60 PCF SOIL TYPE (SC, ML-CL, OR CL) IS UTILIZED FOR BACKFILL, CONTACT MULHERN & KULP FOR FURTHER EVALUATION OF FOUNDATION DESIGN.
- BASEMENT WALLS SHALL BE BRACED, PRIOR TO BACKELLING, BY ADEQUATE TEMPORARY BRACING OR INSTALL ISE FLOOR DECK.
- ALL CONCRETE EXPOSED TO THE WEATHER SHALL NOT HAVE LESS THAN 5% OR MORE THAN 7% AIR ENTRAINMENT.
- ALL FOOTINGS SHALL BEAR BELOW FROST LINE (TYP.) OR 12" MIN IN REGIONS WHERE CODE FROST DEPTH IS NOT APPLICABLE. CONSULT SOILS REPORT OR BUILDING DEPT. FOR MINIMUM DEPTH BELOW GRADE
- FOOTINGS AND SLABS ON GRADE SHALL BEAR ON VIRGIN SOIL OR 95% COMPACTED FILL.
- PROVIDE CONTROL JOINTS AT ALL INSIDE CORNERS OF SLAB EDGES, AND OTHER LOCATIONS WHERE SLAB CRACKS ARE LIKELY TO DEVELOP.
- . JOINTS SHALL BE LOCATED @ 10'-0" O.C. (RECOMMENDED) OR 15'-O" OC. (MAXIMIM)
- JOINT GRID PATTERN SHALL BE AS CLOSE TO SQUARES AS POSSIBLE (I:I RATIO), WITH A MAXIMUM OF I:1.5 RATIO
- . CONTROL JOINTS SHALL NOT BE INSTALLED IN STRUCTURAL SI ABS
- TYPICAL REINFORGEMENT DETAILS: PROVIDE 3" MIN. CLEAR COVER WHERE CAST AGAINST EARTH, LI/2" MIN, CLEAR COVER AGAINST FORMS. LAP ALL REBAR 48 BAR DIAMETERS MIN. (24" FOR #4 BARS) & BEND BARS AND LAP AT CORNERS. PROVIDE 6" HOOK INTO SUPPORTING FOOTINGS WHEN FOOTINGS INTERSECT

DIMENSIONS BY OTHERS, BUILDER TO VERIFY.

LEGEND

R.T. NDICATES ROOF TRUSSES @ 24" O.C. PER ROOF MANUF (TYP IINO)

OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

F.J. NDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

- D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR. JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS
- IIIIIIII INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM/HEADER
- JL METAL HANGER
- INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

LATERAL/WALL BRACING & WALL SHEATHING SPECIFICATIONS

- THIS MODEL HAS BEEN DESIGNED TO RESIST LATERAL FORCES RESULTING FROM: MPH WIND IN 2018 NGSBC:RO
- \$ 120MPH WIND IN 2018 IRC (120 MPH WIND SPEED IN ASCE 7 WIND MAP, PER IRC R301,2,1,1) EXP. B, RISK CAT. 2 & SEISMIC CAT. A/B.
- HE DESIGN WAS COMPLETED PER 2015 & 2018 IBC FCTION 1609) & ASCE 7, AS PERMITTED BY R30113 THE 2018 NCSBC:RC & 2018 IRC. ACCORDINGLY THIS MODEL, AS DOCUMENTED AND DETAILED HEREWITHIN, IS ADEQUATE TO RESIST THE CODE REQUIRED LATERAL FORCES.

DESIGN WIND UPLIET LOADS HAVE BEEN CALCULATED UTIL 17ING ASCE 1 (ACCEPTED) ENGINEERING PRACTICE) AS ALLOWED PER 2018 NCSBC:RC & 2018 IRC SECTION R802.11.1.1. MODEL HAS BEEN DETAILED WHERE REQUIRED & ENGINEERED TO RESIST THE WIND UPLIET LOAD PATH PER SECTIONS R602.3.5¢ R802.II.

EXT. WALL SHEATHING SPECIFICATION

- 7/16" OSB OR 15/32" PLYWOOD: FASTEN SHEATHING w/ 2 3 "x0.113 NAILS @ 6" O.C. AT EDGES & @ 12" O.C. IN THE PANEL FIELD. (TYP, U.N.O.)
- ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUDS, AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT ALL UNSUPPORTED PANEL EDGES & EDGE
- ALL EXT. WALLS SHALL BE CONTINUOUSLY SHEATHED AND ARE CONSIDERED SHEAR WALLS.
- ALT, STAPLE CONNECTION SPEC: 1 3/4" 16 GA STAPLES (%" CROWN) @ 3" O.C. AT EDGES & @ 6" O.C IN FIELD.

3" O.C. EDGE NAILING

AT DESIGNATED AREAS - FASTEN PANEL EDGES OF WOOD STRUCTURAL WALL SHEATHING TO FRAMING W 2 3" x 0.113" NAILS @ 3" O.C. AND 12" O.C. IN THE PANEL FIELD NO STAPLE ALTERNATIVE AVAILABLE AT THIS SPEC. ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEI TO STUD) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR - 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT UNSUPPORTED PANEL EDGES AND 3" O.C. EDGE FASTENING

NOTES

- SEE CONNECTION SPECIFICATIONS CHART FOR STANDARD SHEAR TRANSFER DETAILING. IF ADDITIONAL CAPACITY IS REQUIRED BY DESIGN. WILL BE SPECIFICALLY NOTED ON PLAN.
- DESIGN ASSUMES 16" O.C MAX. STUD SPACING, U.N.O.
- ALL STRUCTURAL PANELS ARE TO BE DIRECTLY APPLIED TO STUD FRAMING.
- PRE-MANUFACTURED PANELIZED WALLS: FASTEN TOGETHER END STUDS OF WALL PANELS SHEATHED W/ OSB OR PLYWOOD W/ 3" x 0.120 NAILS @ 4" O.C. (THRU ONE SIDE ONLY)

INDICATES EXTENT OF INT. OSB SHEARWALL, AND/OR 3" O.C. EDGE NAILING

INDICATES HOLDOWN

FLOOR FRAMING

- I-, KOISTS SHALL BE DESIGNED BY MANUE TO MEET OR EXCEED L/480 LIVE LOAD DEFLECTION CRITERIA. (EXCLUDES STONE/MARBLE OR WET BED CONSTRUCTED FLOORS - CONTACT M&K FOR EXCLUDED FLOOR DESIGNS)
- PER THE GUIDELINES OF THE TILE COUNCIL OF NORTH AMERICA (TCNA HANDBOOK), IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO VERIFY THAT THE FINISHES TO BE INSTALLED MATCH THE DESIGN CRITERIA NOTED ABOVE (UNDER "DESIGN LOADS")
- FLOOR SYSTEMS & SHEATHING HAVE BEEN DESIGNED TO SUPPORT ADDITIONAL DEAD LOAD FROM CERAMIC TILE (EXCLUDING MARBLE OR STONE) HOWEVER IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO PROVIDE PROPER UNDERLAYMENT, UNCOUPLING MEMBRANE AND MORTAR/GROUT PER THE ASSEMBLY DESIGNATIONS IN THE TONA HANDBOOK (TILE COUNCIL OF NORTH AMERICA).
- AT I-JOIST FLOORS, PROVIDE I" MIN. OSB RIM BOARD.
- METAL HANGERS SHALL BE SPECIFIED BY MANUFACTURER, U.N.O. ● I-JOIST SHOP DWGS, SHALL BE SUBMITTED TO ARCH, & ENG. FOR
- REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY. FLOOR SHEATHING SHALL BE 23/32" A.P.A. RATED 'STURD-I-FLOOR'
- 24" O.C., EXPOSURE I (OR APPROVED EQUAL) WITH TONGUE AND GROOVE EDGES. FASTEN TO FRAMING MEMBERS W/ GLUE AND
- 2 ½" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES \$ @ 12"o.c. FIELD. 2 8 × 0.120" NAILS @ 4" O.C. @ PANEL EDGES & @ 8" O.C. FIELD.
- 2 🖁 × 0.113" NAILS @ 3" O.C. @ PANEL EDGES & @ 6" O.C. IN FIELD.

ROOF FRAMING

- ROOF SHEATHING SHALL BE 7/16" A.P.A. RATED SHEATHING 24/16 EXPOSURE I (OR APPROVED EQUAL). FASTEN TO FRAMING MEMBERS - w/ 2 ½" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES € @ 12" O.C. FIELD.
- w/ 2 3 × 0.120" NAILS @ 4"0.6. @ PANEL EDGES & @ 8" 0.6. FIELD. - W/2 3 × 0.113" NAILS @ 3"o.c. @ PANEL EDGES \$ @ 6" O.C. FIELD.
- WITHIN 48" OF ALL ROOF EDGES, RIDGES, & HIPS FASTEN ROOF SHEATHING FIELD'S PER EDGE NAILING SPEC.
- FASTEN EACH ROOF TRUSS TO TOP PLATE W USP RT7A CLIP (OR APPROVED EQUAL) @ ALL BEARING POINTS. PROVIDE (2) RT7A CLIPS AT 2-PLY GIRDER TRUSSES, (3) RT7A CLIPS AT 3-PLY GIRDER TRUSSES & ROOF BEAMS - AT ALL BEARING POINTS.
- METAL HANGERS SHALL BE SPECIFIED BY THE MANUFACTURER, U.N.C
- ROOF TRUSS SHOP DWGS, SHALL BE SUBMITTED TO ARCH & ENG. FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY ERECT AND INSTALL ROOF TRUSSES PER WTCA & TPI'S BCSI I "GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES.
- SUPPORT SHORT SPAN ROOF TRUSSES w/2x4 LEDGER FASTENED TO FRAMING w/(2) 3" \times 0.120" NAILS @ 16" O.C. (UP TO 7' SPAN).

MEANS & METHODS NOTES

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FINISHED AND ALL PLAN, DETAIL, AND NOTE SPECIFICATIONS HAVE BEEN COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE THE ERECTION PROCEDURES AND SEQUENCE TO INSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION. THIS INCLUDES, BUT IS NOT LIMITED TO THE ADDITION OF NECESSARY SHORING SHEETING EMPORARY BRACING, GUYS, AND TIE-DOWNS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING AND BRACING REQUIRED TO STABILIZE AND PROTECT EXISTING AND ADJACENT STRUCTURES AND SYSTEMS DURING COURSE OF DEMOLITION AND CONSTRUCTION OF THE PROJECT

STRUCTURAL DESIGN AND SPECIFICATIONS ASSUME THAT ALL SUPPORTING AND NON-SUPPORTING ELEMENTS IN CONTACT WITH LOOR FRAMING ARE LEVEL, INCLUDING, BUT NOT LIMITED TO FOUNDATIONS, SLABS ON GRADE, BEAMS, WALLS, AND NON-BEARING ELEMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIF LEVELNESS AND MAKE ADJUSTMENTS AS NECESSARY, INCLUDING CONSIDERATION OF THOSE AREAS THAT MAY BE WITHIN CONTRACTUAL, INDUSTRY, OR WARRANTY TOLERANCES.

GENERAL STRUCTURAL NOTES

- DESIGN IS BASED ON 2018 NGSBG-RESIDENTIAL CODE \$ 2018 IRC
- WOOD FRAME ENGINEERING IS BASED ON NDS, "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" - LATEST EDITION.

DESIGN LOADS ROOF

LIVE = 20 PSF DEAD = 7 PSF T.C., 10 PSF B.C. LOAD DURATION FACTOR = 1.25

FLOOR LIVE = 40 PSF (30 PSF @ SLEEPING AREAS) DEAD = 10 PSF (I-JOISTS)

2,000 PSF ASSUMED ALLOWABLE BEARING PRESSURE (TO BE VERIFIED BY BUILDER)

ADD'L IO PSF @ CERAMIC TILE IN BATHS & LAUND.

GENERAL FRAMING

- ALL TYP. NAIL FASTENER REQUIREMENTS ARE NOTED IN STANDARD CONNECTIONS TABLE (IRC TABLE R602.3(1)) OR ON PLANS. ALL NAILS SPECIFIED ARE MIN DIAMETER AND LENGTH REQUIRED FOR CONNECTION, ALL HANGER NAILS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS FOR MAX CHARTED CAPACITY. NOTE: HANGERS USE COMMON NAIL DIAMETERS NOT TYPICAL
- EXT. \$ INT. BEARING WALLS SHALL BE 2x4 OR 2x6 (AS SHOWN ON PLANS) @ 16" O.C. SPF/SP "STUD" GRADE LUMBER, OR BETTER, U.N.O · WALLS OVER 12' TALL SHALL BE PER PLAN.
- ALL INTERIOR BEARING WALLS ARE ASSUMED TO BE SHEATHED W/ GYP WALL BOARD (ONE SIDE MIN.) OR PROVIDE MID HT. BLOCKING.
- ALL HEADERS, BEAMS & OTHER STRUCTURAL MEMBERS SHALL BE SPRUCE-PINE-FIR #2 (SPF) OR SOUTHERN PINE #2 (SP) LUMBER, OR BETTER, SUPPORT ALL HEADERS/ BEAMS W/ (1)2x JACK STUD & (1)2x - THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE
- NUMBER OF JACK STUDS REQUIRED, U.N.O.. ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED
- WITH 2x 'STUD' GRADE MEMBERS SPACED @ 24" O.C. (MAX., U.N.O.) . HEADERS IN NON-LOAD BEARING WALLS SHALL BE (I)2x4/6 FLAT @ OPENINGS UP TO 4', (2)2x4/6 FLAT UP TO 8'.
- ALL FRAMING LUMBER SHALL BE DRIED TO 15% MC (KD-15) ENGINEERED LUMBER BEAMS TO MEET OR EXCEED THE FOLLOWING:
- 'LVL' Fb=2600 psi; Fv=285 psi; E=2.0xI0^6 psi ENGINEERED LUMBER POSTS TO MEET OR EXCEED THE FOLLOWING:
- 'LVL' Fb=2400 psi; FcII=2500 psi; E=I.8xI0^6 psi FOR 2 & 3 PLY BEAMS OF EQUAL 13/2" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 3"XO.120" NAILS @ 8" O/C OR 2 ROWS USP WS35 SCREWS (OR 31/5" TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWG FOR BEAM DEPTHG OF 14" OR GREATER.
 APPLY FASTENING AT BOTH FACES FOR 3-PLY CONDITION. LOCATE TOP & BOTTOM NAILS/SCREWS 2" FROM EDGE. SOLID 3 $\frac{1}{2}$ " OR 5 $\frac{1}{4}$ " BEAMS ARE ACCEPTABLE. USE 2 ROWS OF NAILS FOR 2x6 & 2x6
- FOR 4 PLY BEAMS OF EQUAL 13/4" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF USP WS6 SCREWS (OR 6 %." TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER, APPLY FASTENING AT BOTH FACES (ONE SIDE ONLY FOR TRUSSLOK SCREWS). LOCATE TOP AND BOTTOM SCREWS 2" FROM EDGE. A SOLID T" BEAM IS ACCEPTABLE.
- PROVIDE SOLID BLOCKING IN FLOOR SYSTEM UNDER ALL POSTS CONTINUOUS TO FND./BEARING. BLOCKING TO MATCH POST ABOVE.
- ALL EXTERIOR 4x4 WOOD POSTS SHALL HAVE USP BCS22-4 CAP &
- CORROSION NOTES
- BUILDER RESPONSIBLE TO DETERMINE CORROSION-RESISTANCE REQUIREMENTS AND COMPATIBILITY OF HARDWARE, FASTENERS AND CONNECTORS FOR ENVIRONMENTAL EXPOSURE AND IN CONTACT W PRESERVATIVE-TREATED WOOD OF ACTUAL FINAL CONDITIONS AND SOURCED MATERIALS. CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.
- ALL EASTENERS AND CONNECTORS EXPOSED TO SALT WATER (WITHIN 300' OF SALT WATER SHORELINE, INCLUDING VENTED SPACES) SHALL BE STAINLESS STEEL.

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS C-3825



Mulhern+Kulp project numbe 256-21006

SMK ILM ssue date: 10-21-202

REVISIONS

initial: 12/10/21 MIRRORED PLANS ADDEC JPP


DOUGL


SMITH STRUCTURAL NOTES 田田


MODI ZONI OLEMAN WIND CAROLI 120 NO


GENERAL

-larrington

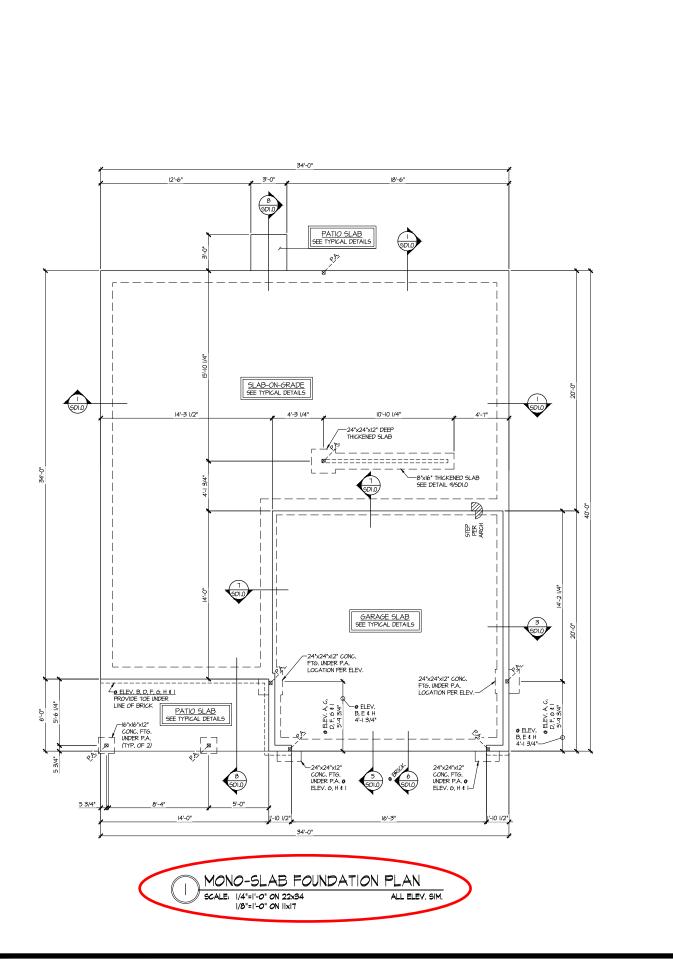

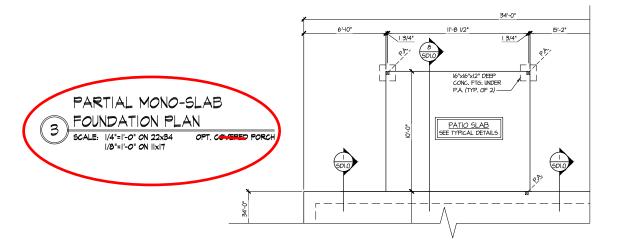

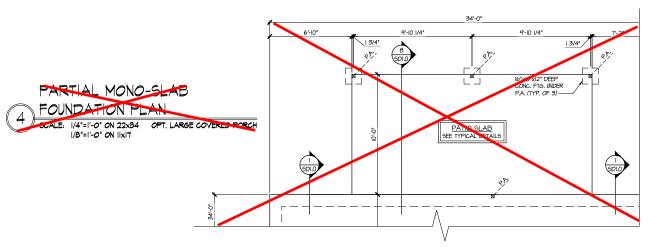

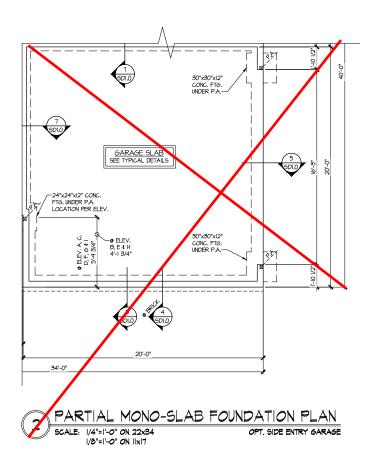

Harrington _ot 33

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

• RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

F.J. NIDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER • D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR

SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE

LOCATIONS.

• IIIIII INTERIOR BEARING WALL

● □===□ BEARING WALL ABOVE (B.W.A.)

• --- BEAM/HEADER

JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS reactives, State 165 - Agin 1 - stanform (agreem nse # C-3825



Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:


initial: 12/10/21 MIRRORED PLANS ADDED JPP

SMITH DOUGLAS HOMES

MODEL FOUNDATION

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

MONO-SLAB

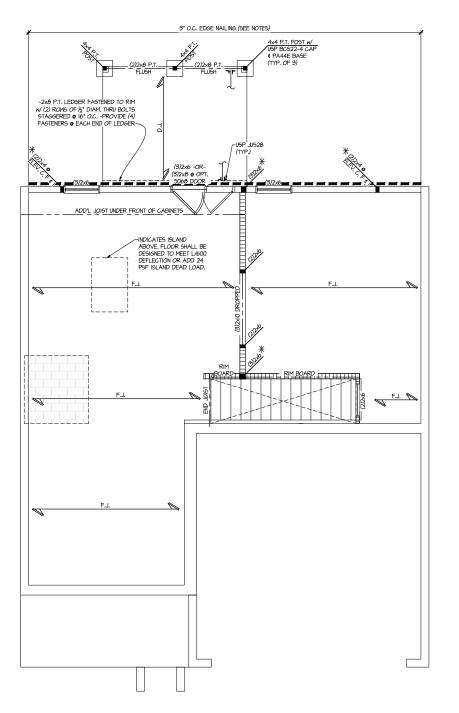


IST FLOOR FRAMING PLAN

ALL ELEV. SIM.

SCALE: 1/4"=1'-0" ON 22x34 1/8"=1'-0" ON 11x17



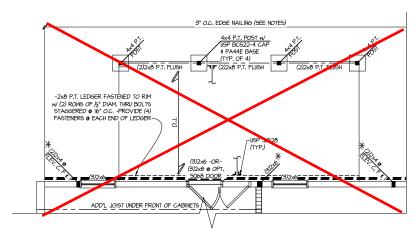

Lot 33

LEGEND

• RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

• F.J. INDICATES I4" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

LOCATIONS.

• IIIIII INTERIOR BEARING WALL

• --- BEAM/HEADER

• JL METAL HANGER

• * INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

Harrington

THIS LEVEL HAS BEEN DESIGNED FOR 9'-I" PLATE HEIGHT

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

• D.J. INDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.
JOIST MANUFACTURER SHALL DESIGN FLOOR
SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE

● □===□ BEARING WALL ABOVE (B.W.A.)

8/1/23

MUCHERNAL STRUCTURAL ENSINEERING
SESTIMATION STRUCTURAL ENSINEERING
STRUCTURAL STRUCTURAL ENSINEERING
STRUCTURAL STRUCTURAL SANION
STRUCTURAL STRUCTURAL SANION
STRUCTURAL STRUCTURAL SANION
STRUCTURAL SANION
NC LICENSE # C-3825



Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: 12/10/21 MIRRORED PLANS ADDED JPP


SMITH DOUGLAS HOMES


PLAN COLEMAN MODEI FRAMING FLOOR

120 MPH WIND ZONE NORTH CAROLINA


ST

S2.0

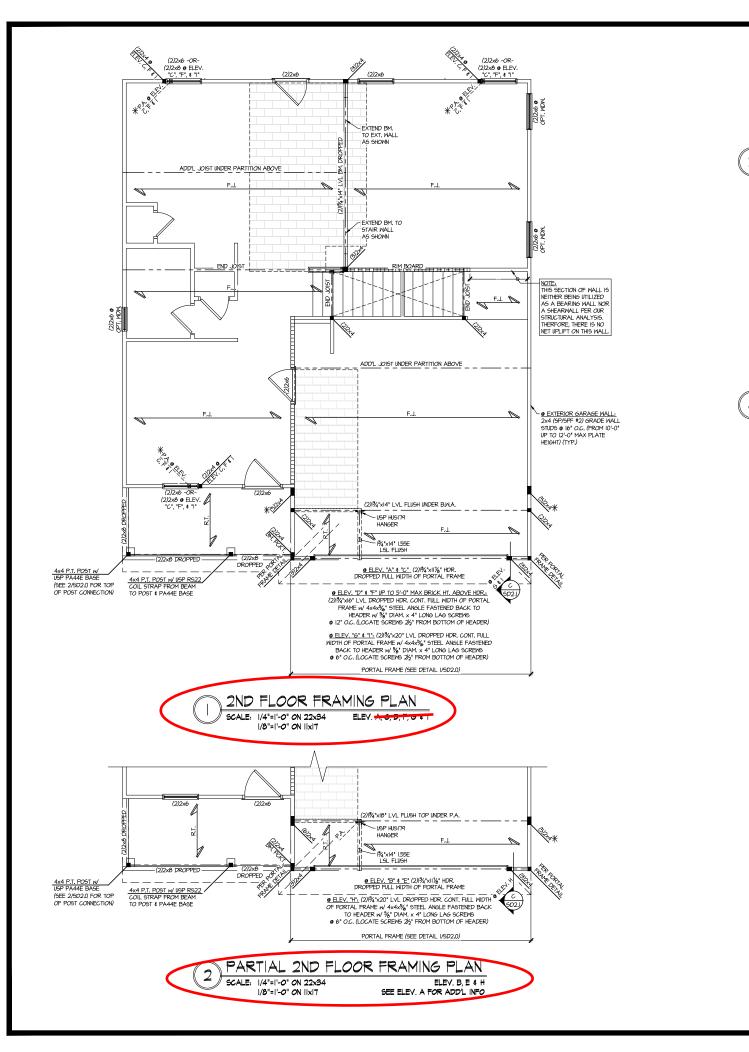

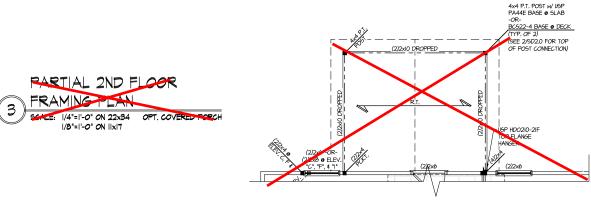

4x4 P.T. POST w/ USP RS22 COIL STRAP FROM BEAM TO POST & PA44E BASE @ SLAB -OR-4x4 P.T. POST w/ USP PA44E BASE • SLAB -OR-BC522-4 BASE • DECK (TYP. OF 2) (SEE 2/SD2.0 FOR TOP OF POST CONNECTION) (2)2xl2 DROPPED PARTIAL 2ND FLOOR FRAMING PLAN SCALE: I/4"=I'-0" ON 22x34 OPT, LARGE COVERED FORCH 1/8"=1'-0" ON 11x17

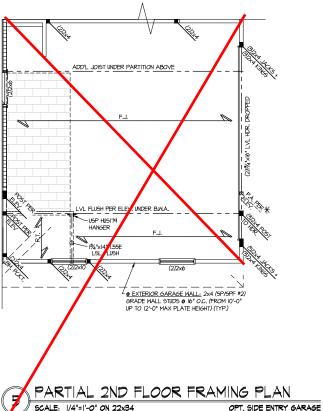

1/8"=1'-0" ON 11x17

Harrington Lot 33

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

• RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

OF. INDICATES TRUSS OVERFRAMING @ 24" O.C. (TYP. U.N.O.)

F.J. NDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

• D.J. INDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS

• IIIIII INTERIOR BEARING WALL

• ==== BEARING WALL ABOVE (B.W.A.)

● ■ ■ ■ BEAM/HEADER

JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

8/1/23

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINEERINS



Mulhern+Kulp project number: 256-21006

SMK MJF ssue date: 10-21-202

REVISIONS:


initial: 12/10/21 MIRRORED PLANS ADDED JPP

SMITH DOUGLAS HOMES

PLAN MODE FRAMING COLEMAN FLOOR 2ND

120 MPH WIND ZONE NORTH CAROLINA

S3.0

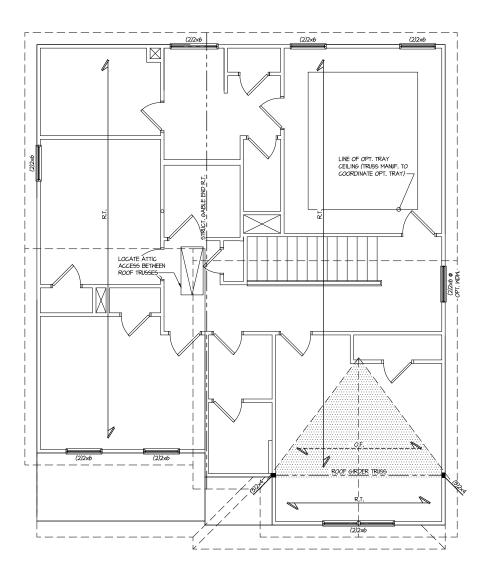



MULHERN+KULP

RESIDENTIAL STRUCTURAL ENGINEERING

RESIDENTIAL ENGINEERING

RESIDENTI



Mulhern+Kulp project number:

256-21006

SMK MJF issue date: 10-21-202

initial: 12/10/21 MIRRORED PLANS ADDED JPP

SMITH DOUGLAS HOMES

COLEMAN MODEL FRAMING PLAN

120 MPH WIND ZONE NORTH CAROLINA

ROOF

Harrington

THIS LEVEL HAS BEEN DESIGNED FOR 9'-I" PLATE HEIGHT

REFER TO 50.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

Lot 33

• --- BEAM/HEADER

• JL METAL HANGER

• * INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

LEGEND

• RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

• F.J. INDICATES 14" DEEP FLOOR I-JOISTS (24" O.C., MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER • D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.)


INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR


SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• IIIIII INTERIOR BEARING WALL


● □===□ BEARING WALL ABOVE (B.W.A.)

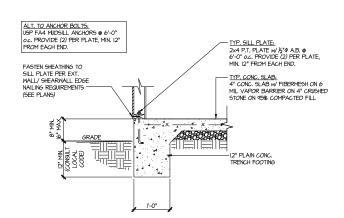

TYPICAL SLAB ON GRADE PERIMETER FOOTING



TYPICAL SLAB ON GRADE 2 PERIMETER FOOTING W/ BRICK VENEER

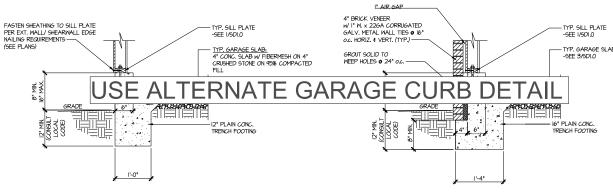


TYPICAL SLAB ON GRADE GARAGE 3 PERIMETER FOOTING


TYPICAL SLAB ON GRADE GARAGE 4 PERIMETER FOOTING W/ BRICK VENEER

-TYP. SILL PLATE BEYOND -SEE I/SDI.0 - TYP. GARAGE SLAB -SEE 3/SDI.0 I'-O"


TYPICAL SLAB ON GRADE GARAGE 5 ENTRY @ PERIMETER FOOTING



TYPICAL SLAB ON GRADE GARAGE 6 ENTRY @ PERIMETER FOOTING




TYPICAL MONOLITHIC INTERIOR GARAGE FOOTING

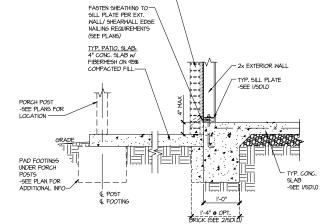


OPT. BRICK (SEE ARCH FOR LOCATIONS)

TYPICAL SLAB ON GRADE PERIMETER FOOTING @ PORCH/PATIO



TYPICAL THICKENED SLAB @ INTERIOR BEARING WALL



Harrington _ot 33

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS

ıse # C-3825

Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES

MODEI FOUNDATION DETAILS COLEMAN

120 MPH WIND ZONE NORTH CAROLINA

SD1.0



MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINEERING

3625 Brookside Parkway, Suite 165, Alpharetta, GA 30022 🔻 p 770-777-0074 🔻 mulhernkulp.com

August 18, 2023

lody Hunt

Director of Product Development

SMITH DOUGLAS HOMES

110 Village Trail, Suite 215 Woodstock, GA 30188

ALTERNATE GARAGE CURB DETAIL


Smith Douglas Homes

Reference

Current Structural Plans prepared by Mulhern & Kulp

Jody:

these are an acceptable alternative to the 6" wide curb at the garage per M&K foundation details 3 & 4 on sheet SD-1.0 at 2x4 garage Pursuant to your request, we have prepared this letter to address the "Alternate Garage Curb Details", prepared by Mulhern & Kulp for Smith Douglas Homes shown below. The foundation details shown below call for a 4" wide curb with a maximum of 8" stem wall height; wall locations.

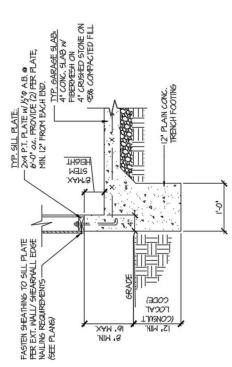

TYP. SILL PLATE.

— 2x4 P.T. PLATE W/\$'\$ AB. \$\text{6} \cdot 6'-0" oz. PROVIDE (2) PER PLATE, MIN. 12" FROM EACH BND. 8"MAX. STEM HEIGHT NIN .8 4" BRICK VENETR
W |" W. x 226A CORRUGATED
6ALY. METAL WALL TIES & I6"
0c. HORIZ. ‡ VERT. (TYP) GROUT SOLID TO WEEP HOLES & 24" (3002) | 1007|T |(00/301|TL |15|| WIN &" MN, 16" MAX.

> TYPICAL SLAB ON GRADE GARAGE PERIMETER FOOTING 4

M/ BRICK VENER TYPICAL SLAB ON GRADE GARAGE PERIMETER FOOTING m

MANAGORA

Please feel free to call if you have any questions.

Respectfully,


MULHERN & KULP STRUCTURAL ENGINEERING, INC.

NC License # C-3825

Project Manager + Atlanta Office Director Shaun M. Kreidel, P.E.



P:|Client Files|256 - Smith Douglas Homes|2023|23000 - 2023 Client Admin|2023-08-17 - 4in Garage Curb Letter|Alternate Garage Curb Detail - Letter - NC.docx

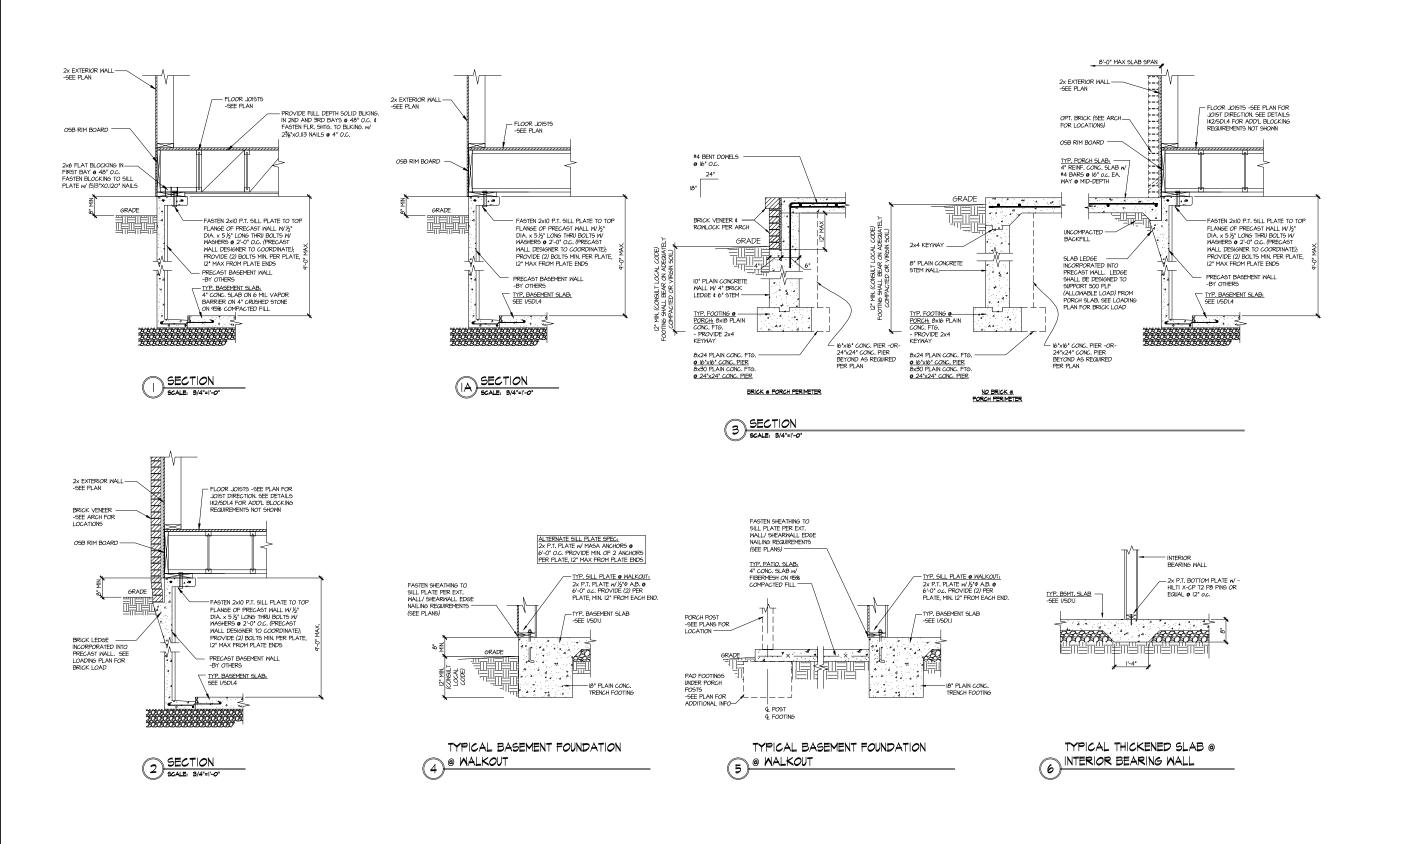

SEAL, WALLER & SALP

© copyright: MULHER & SALP

Structural Engineering, Inc.

RESIDENTIAL STRUCTURAL I RESIDENTIAL STRUCTURAL I RESIDENTIAL STRUCTURAL I RESIDENTIAL I RESIDENTIAL

Y

Mulhern+Kulp project number: 256-21006

project mgr: SMK drawn by: MJF issue date: 10-21-202

REVISIONS:

date: initial: 12/10/21 JPP

|2/IO//2| MIRRORED PLANS ADDED

> SMITH DOUGLAS HOMES


FOUNDATION DETAILS
COLEMAN MODEL

COLEMAN MO 120 MPH WIND ZONE NORTH CAROLINA

sheet:

Harrington

SD1.4

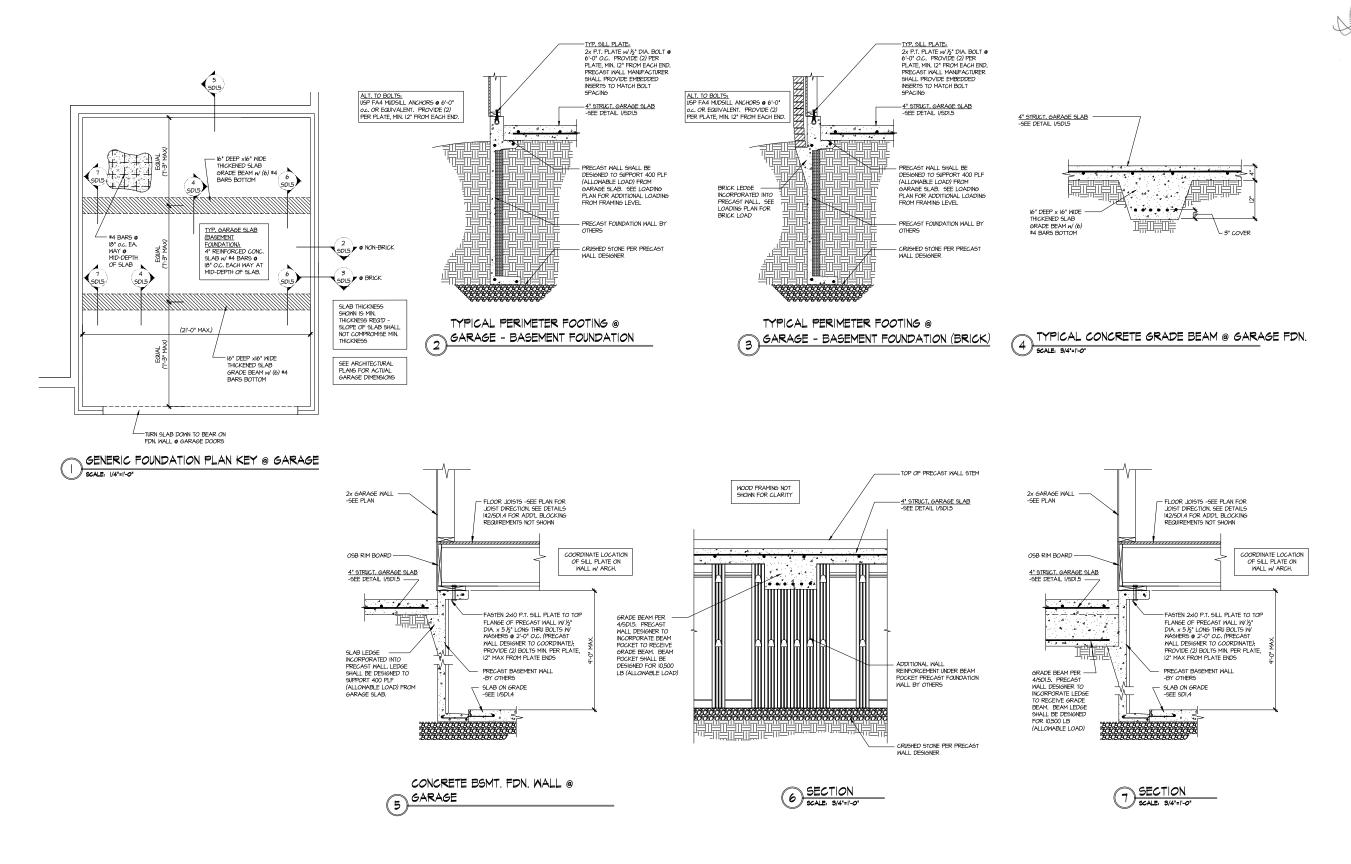

Harrington Lot 33 SEAL MATERIA & KULP STORUM INC.

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENSINERING
STRUCTURAL STRUCTURAL ENSINERING
\$770-777-474 - Indirectors
NC License # C-3825



Mulhern+Kulp project number: 256-21006

project mgr: SMK drawn by: MJF issue date: 10-21-2021

REVISIONS:

date: initial:
12/10/21 JPP
MIRRORED PLANS ADDED

SMITH DOUGLAS HOMES

SMITH


FOUNDATION DETAILS

COLEMAN MODE


120 MPH WIND ZONE
NORTH CAROLINA

sheet:

SD1.5

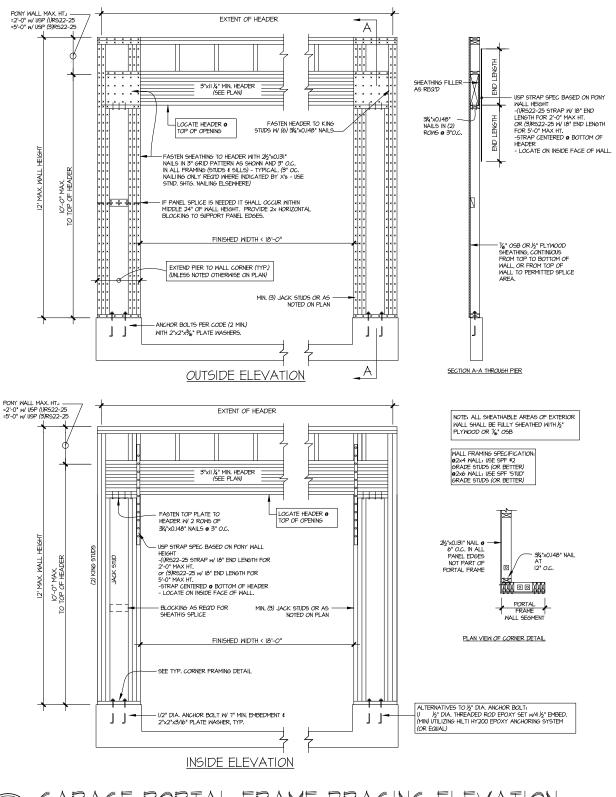

GARAGE PORTAL FRAME BRACING ELEVATION BOTH SIDES OF GARAGE DOOR 120 MPH WIND SPEED (ULT) SCALE: N.T.S.

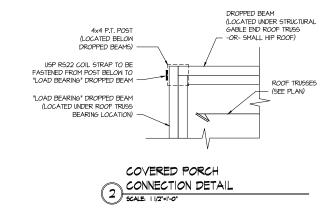

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENSINEERINS
SESSEMICIAL STRUCTURAL ENSINEERINS
STRUCTURAL STRUCTURAL ENSINEERINS
STRUCTURAL STRUCTURAL ENSINEERINS
STRUCTURAL STRUCTURAL ENSINEERINS
STRUCTURAL STRUCTURAL ENSINEERINS
NC License # C-3825

Mulhern+Kulp project number:

256-21006

MJF issue date: 10-21-202

REVISIONS:

initial: 12/10/21 MIRRORED PLANS ADDED JPP

SMITH DOUGLAS HOMES

MODE


FRAMING DETAILS COLEMAN


120 MPH WIND ZONE NORTH CAROLINA

Harrington

Lot 33

SD2.0

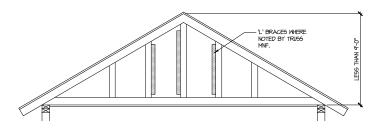


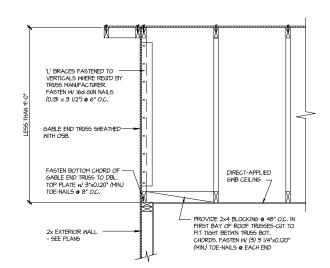

BRACE GABLE END TRUSGES PER ABOVE DETAIL WHEN GABLE HEIGHT IS LESS THAN 9'-O'. L' BRACES REQUIRED WHERE NOTED BY TRUSS MANUFACTURER.


TYPICAL GABLE END BRACING DETAIL SCALE: NONE REQUIRED TRUSS

- STRONG-BACK • MID-HEIGHT FOR DIAG. BRACES

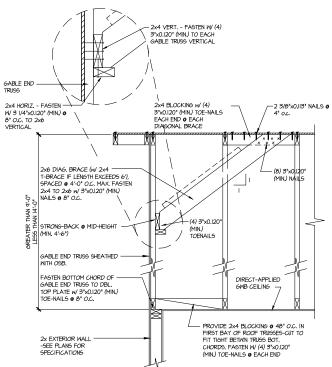

B TYPICAL GABLE END BRACING DETAIL SCALE. NONE RECT & SABLE END TRUSS

BRACE GABLE END TRUSSES PER ABOVE DETAIL WHEN GABLE HEIGHT EXCEEDS 9'-0'. 'L' BRACES NOT REQUIRED.

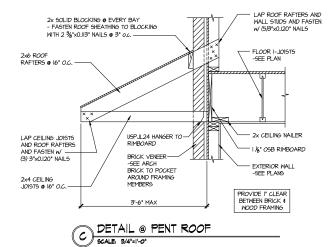

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

> Harrington Lot 33

MUCHERN + KULP

RESIDENTIAL STRUCTURAL ENSINEERINS

RESIDENTIAL STRUCTURAL ENSINEERINS

FIGURE PARTICULAR STRUCTURAL STRU

8/1/23

Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: 12/10/21 MIRRORED PLANS ADDED JPP


SMITH DOUGLAS HOMES

MODEI FRAMING DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN


SD2.1

72338022 33 HARRINGTON PLACE

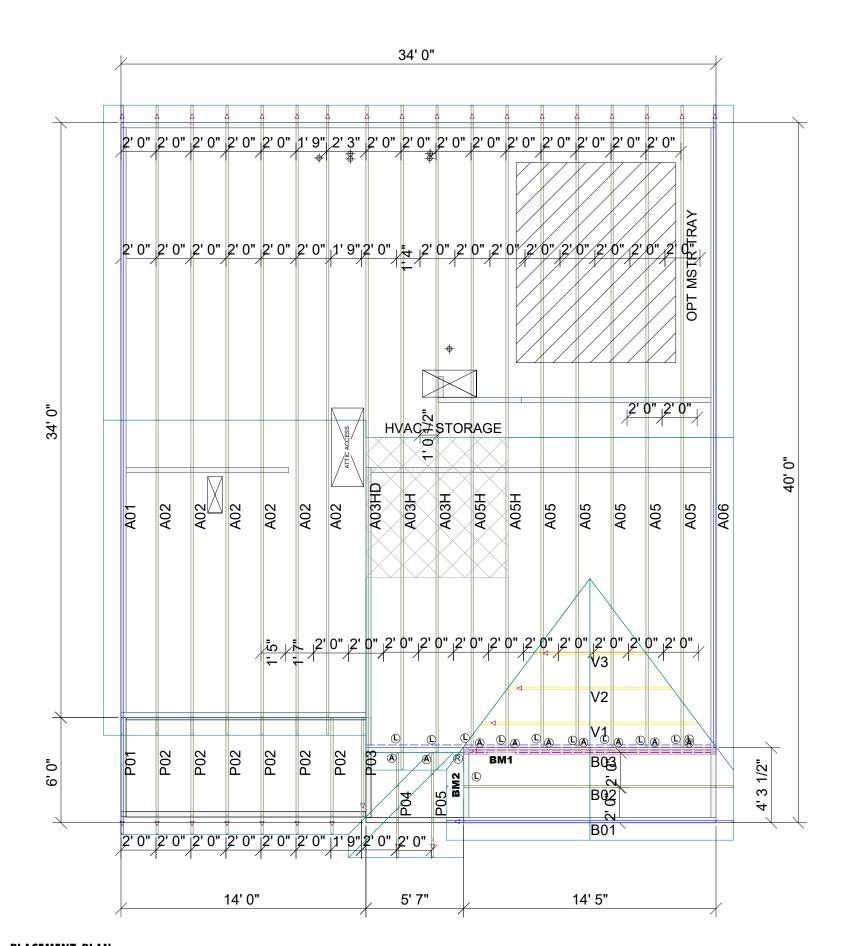

Roof Hanger List					
MARK	TYPE	DESCRIPTION	QTY		
(A)	HUS26	FACE MOUNT HANGER	9		

COLEMAN BEH NO TRAY

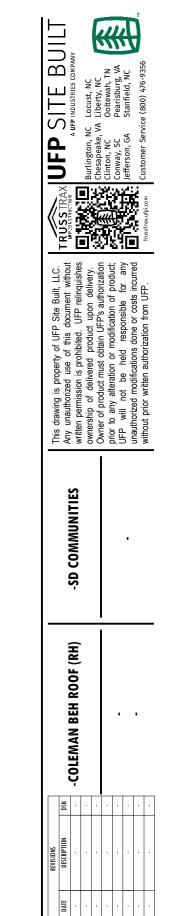

DESIGNER -THATHCOCK **LAYOUT DATE** -04.11.2022 ARCH DATE


JOB #: -22040623

PLACEMENT PLAN

SCALE: N.T.S

A1 1/8" RIMBOARD BAND

1 1/8" RIMBOARD BAND

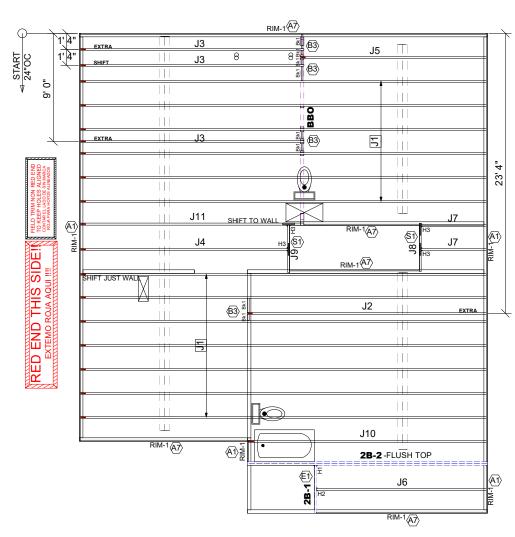

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	34' 0"	14" TJI® 110	1	13	MFD
J2	20' 0"	14" TJI® 110	1	1	MFD
J3	19' 0"	14" TJI® 110	1	3	MFD
J4	18' 0"	14" TJI® 110	1	1	MFD
J5	16' 0"	14" TJI® 110	1	1	MFD
J6	15' 0"	14" TJI® 110	1	1	MFD
J7	6' 0"	14" TJI® 110	1	2	MFD
J8	5' 0"	14" TJI® 110	1	1	MFD
J9	4' 0"	14" TJI® 110	1	1	MFD
J10	20' 0"	14" TJI® 210	1	1	MFD
J11	19' 0"	14" TJI® 210	1	1	MFD
2B-1	4' 0"	1 3/4" x 14" 1.55E TimberStrand® LSL	1	1	MFD
2B-2	20' 0"	1 3/4" x 18" 2.0E Microllam® LVL	2	2	MFD
RIM-1	16' 0"	1 1/8" x 14" TJ® Rim Board	1	10	FF
Bk1	2' 0"	14" TJI® 110	1	8	MFD

Connector Summary				
PlotID	Qty	Manuf	Product	
H1	1	USP	HUS179	
H2	1	USP	IHFL1714	
H3	4	USP	TFL1714	

GENERAL NOTES:

1.) TOP CHORD OF JOISTS ARE PAINTED RED AT NUMBERED END. PLACE PAINTED END AS

NOTED ON PLAN. 2.) FOLLOW SPECIAL SPACING AND LOCATION DIMENSIONS FOR EXTRAS OR SHIFTED JOISTS AS SHOWN ON PLAN.

AS SHOWN ON PLAN.
3.) ALL INTERIOR WALL PLATES MUST BE LEVEL WITH OUTSIDE WALL TOP PLATES.
4.) DO NOT STACK CONSTRUCTION LOADS ON UN-BRACED JOISTS.
5.) PROVIDE SOLID SUPPORT BELOW ALL BEAM AND HEADER BEARING POINTS IN WALL AND JOIST SPACES CONTINUOUS DOWN TO THE FOUNDATION.
6.) LOCATE CRIPPLE STUDS IN JOIST SPACE DIRECTLY BELOW HEADER JACKS AT ALL FIRST

DIRECTLY BELOW HEADER JACKS AT ALL FIRST FLOOR EXTERIOR DOOR LOCATIONS. (.) INSTALL NAILS IN ALL HOLES PROVIDED IN JOIST HANGERS EXCEPT AT BOTTOM CHORD SEAT. PLACE A DAB OF GLUE IN THE HANGER SEAT BEFORE SETTING JOISTS

BEAT BEFORE SET TIME JUSTIS.

8.) IMPORTANT NOTE! NO STRUCTURAL

ANALYSIS OF CONVENTIONAL HEADERS HAS

BEEN CONDUCTED IF NOT NOTED. THEY ARE CONSIDERED TO BE ADEQUATE TO SUPPORT THE APPLIED LOADS.

FRAMER NOTE

DENOTES DUCT HOLE RUNS

ALL DIMENSIONS TO CENTERLINE UNLESS OTHERWISE NOTED

• Avoid Plumbing Drops

FRAMER NOTE

GLUE AND NAIL PLYWOOD SUBFLOOR TO BEAMS AND GIRDERS AT 6" O/C WHERE NO WALL IS ABOVE. 2. FILL HANGER SEAT WITH GLUE

BEFORE SETTING JOIST IN HANGER. FILL ROUND HOLES WITH

CRITICAL !!

INSTALL 2X4 SQUASH BLOCKS IN FLOOR TRUSS SPACE BELOW ALL EXTERIOR DOOR HEADER JACKS. CUT 1/16" TALLER THAN TRUSS.

PLAN LEGEND

1B-, 2B-

*INDICATES BEAM ABOVE TOP PLATE (FLUSH WITH FLOOR SYSTEM)

H-, 1H-, GDH- INDICATES BEAM BELOW TOP PLATE (DROPPED BELOW FLOOR SYSTEM)

*BEAMS MAY PROTRUDE ABOVE OR BELOW DECKING OR TOP PLATE RESPECTIVELY, REFER TO DETAIL IF BEAM IS A DIFFERENT DEPTH THAN FLOOR SYSTEM

(ADD LINE FOR EACH ADDITIONAL PLY)

SHIFT JOIST TO MISS PLUMBING, ALIGN W/WALL OR SUPPORT FURNITURE

A JOIST ADDED TO THE LAYOUT IN ADDITION TO THE ON CENTER JOISTS

FIELD TRIM NON RED END

TO KEEP HOLES ALIGNED CONTAR EL LADO DE SIN MARCA **ROJA PARA HOYOS ALINEADOS** *______*

FIELD LOCATE PLUMBING DROPS/CAN LIGHTS, ETC... PRIOR TO JOIST SECUREMENT TO AVOID INTERFERENCE.

LAYOUT FOR 19.2" O/C

1= 19-3/16" 9= 172-13/16" 2= 38-3/8" 10= 192" 3=57-5/8" 11= 211-3/16" 4= 76-13/16" 12= 230-3/8" 5= 96" 13= 249-13/16" 6= 115-3/16" 14= 268-13/16" 7= 134-3/8" 15= 288" 8= 153-5/8"

FIELD VERIFY DIMENSIONS TO **JOISTS LOCATED UNDER WALLS!!**

2ND FLOOR LAYOUT

2ND FLOOR PLACEMENT PLAN

SCALE: 1/8"=1'



BUILT

ةً لـــا S | S

UFP

製業

use of this documents prohibited. UFP relayed product upon coust obtain UFP's author or modification of higher life.

Douglas I

Smith

2nd

Coleman

DESIGNER PB2 LAYOUT DATE 10/11/2023 ARCH DATE 12/2/2021 **STRUC DATE** 5/24/2023

JOB #: 21062814F2