

# Harnett County Department of Public Health

PERMIT # SFD 2310-0030

## Operation Permit

New Installation    Septic Tank    Nitrification Line    Repair    Expansion

PROPERTY LOCATION: 345 Castle Pond Way, Fuquay Varina

Name: (owner) Davidson Homes      SUBDIVISION Prince Place      LOT # 43

System Installer: Quality Septic


Basement with plumbing:  Garage  Number of Bedrooms 4

Type of Water Supply:  Community    Public    Well   Distance from well \_\_\_\_\_ feet

System Type: 25% Reduction System EZ Flow      Types V and VI Systems expire in 5 years.

(In accordance with Table V a)      Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

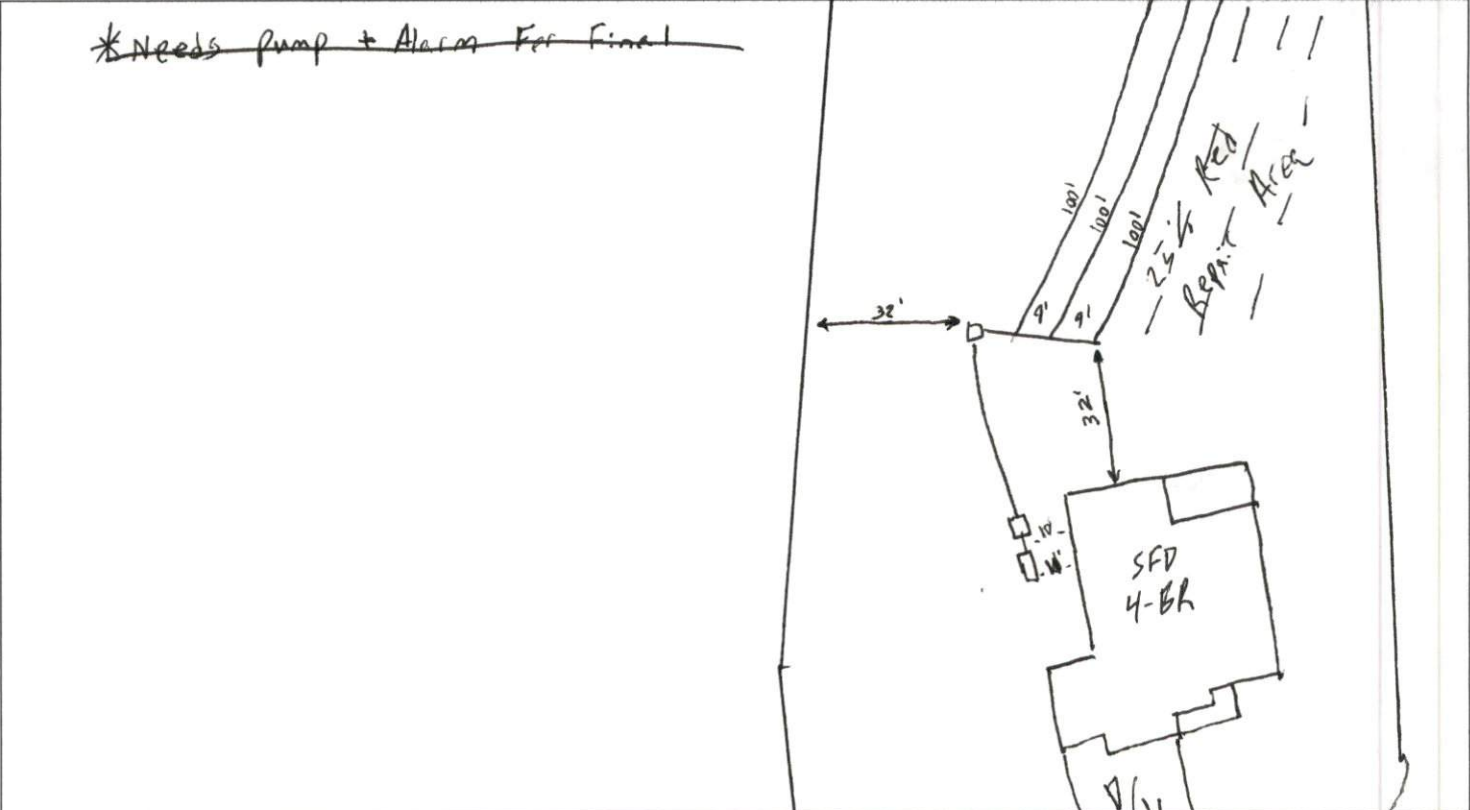

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
Subsurface system operator required? Yes  No   
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box    Pump    Alarm    H2O Line    PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional    Other 25% Reduction System EZ Flow   Septic Tank: 1,000 gallons   Pump Tank: 1,000 gallons  
Subsurface      No. of      exact length      width of      depth of  
Drainage Field      ditches 3      of each ditch 100'      ditches 3'      ditches 26"-28" inches  
French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]      Date 4-23-24