


Floor Area: 2145.64 SF
 Floor Plywood: 2467.49
 Roof Area: 6334.42 SF
 Roof Plywood: 90 sheets
 Roof Shingles: 79 Squares

ROOF TRUSS LAYOUT

1/4" = 1'-0"

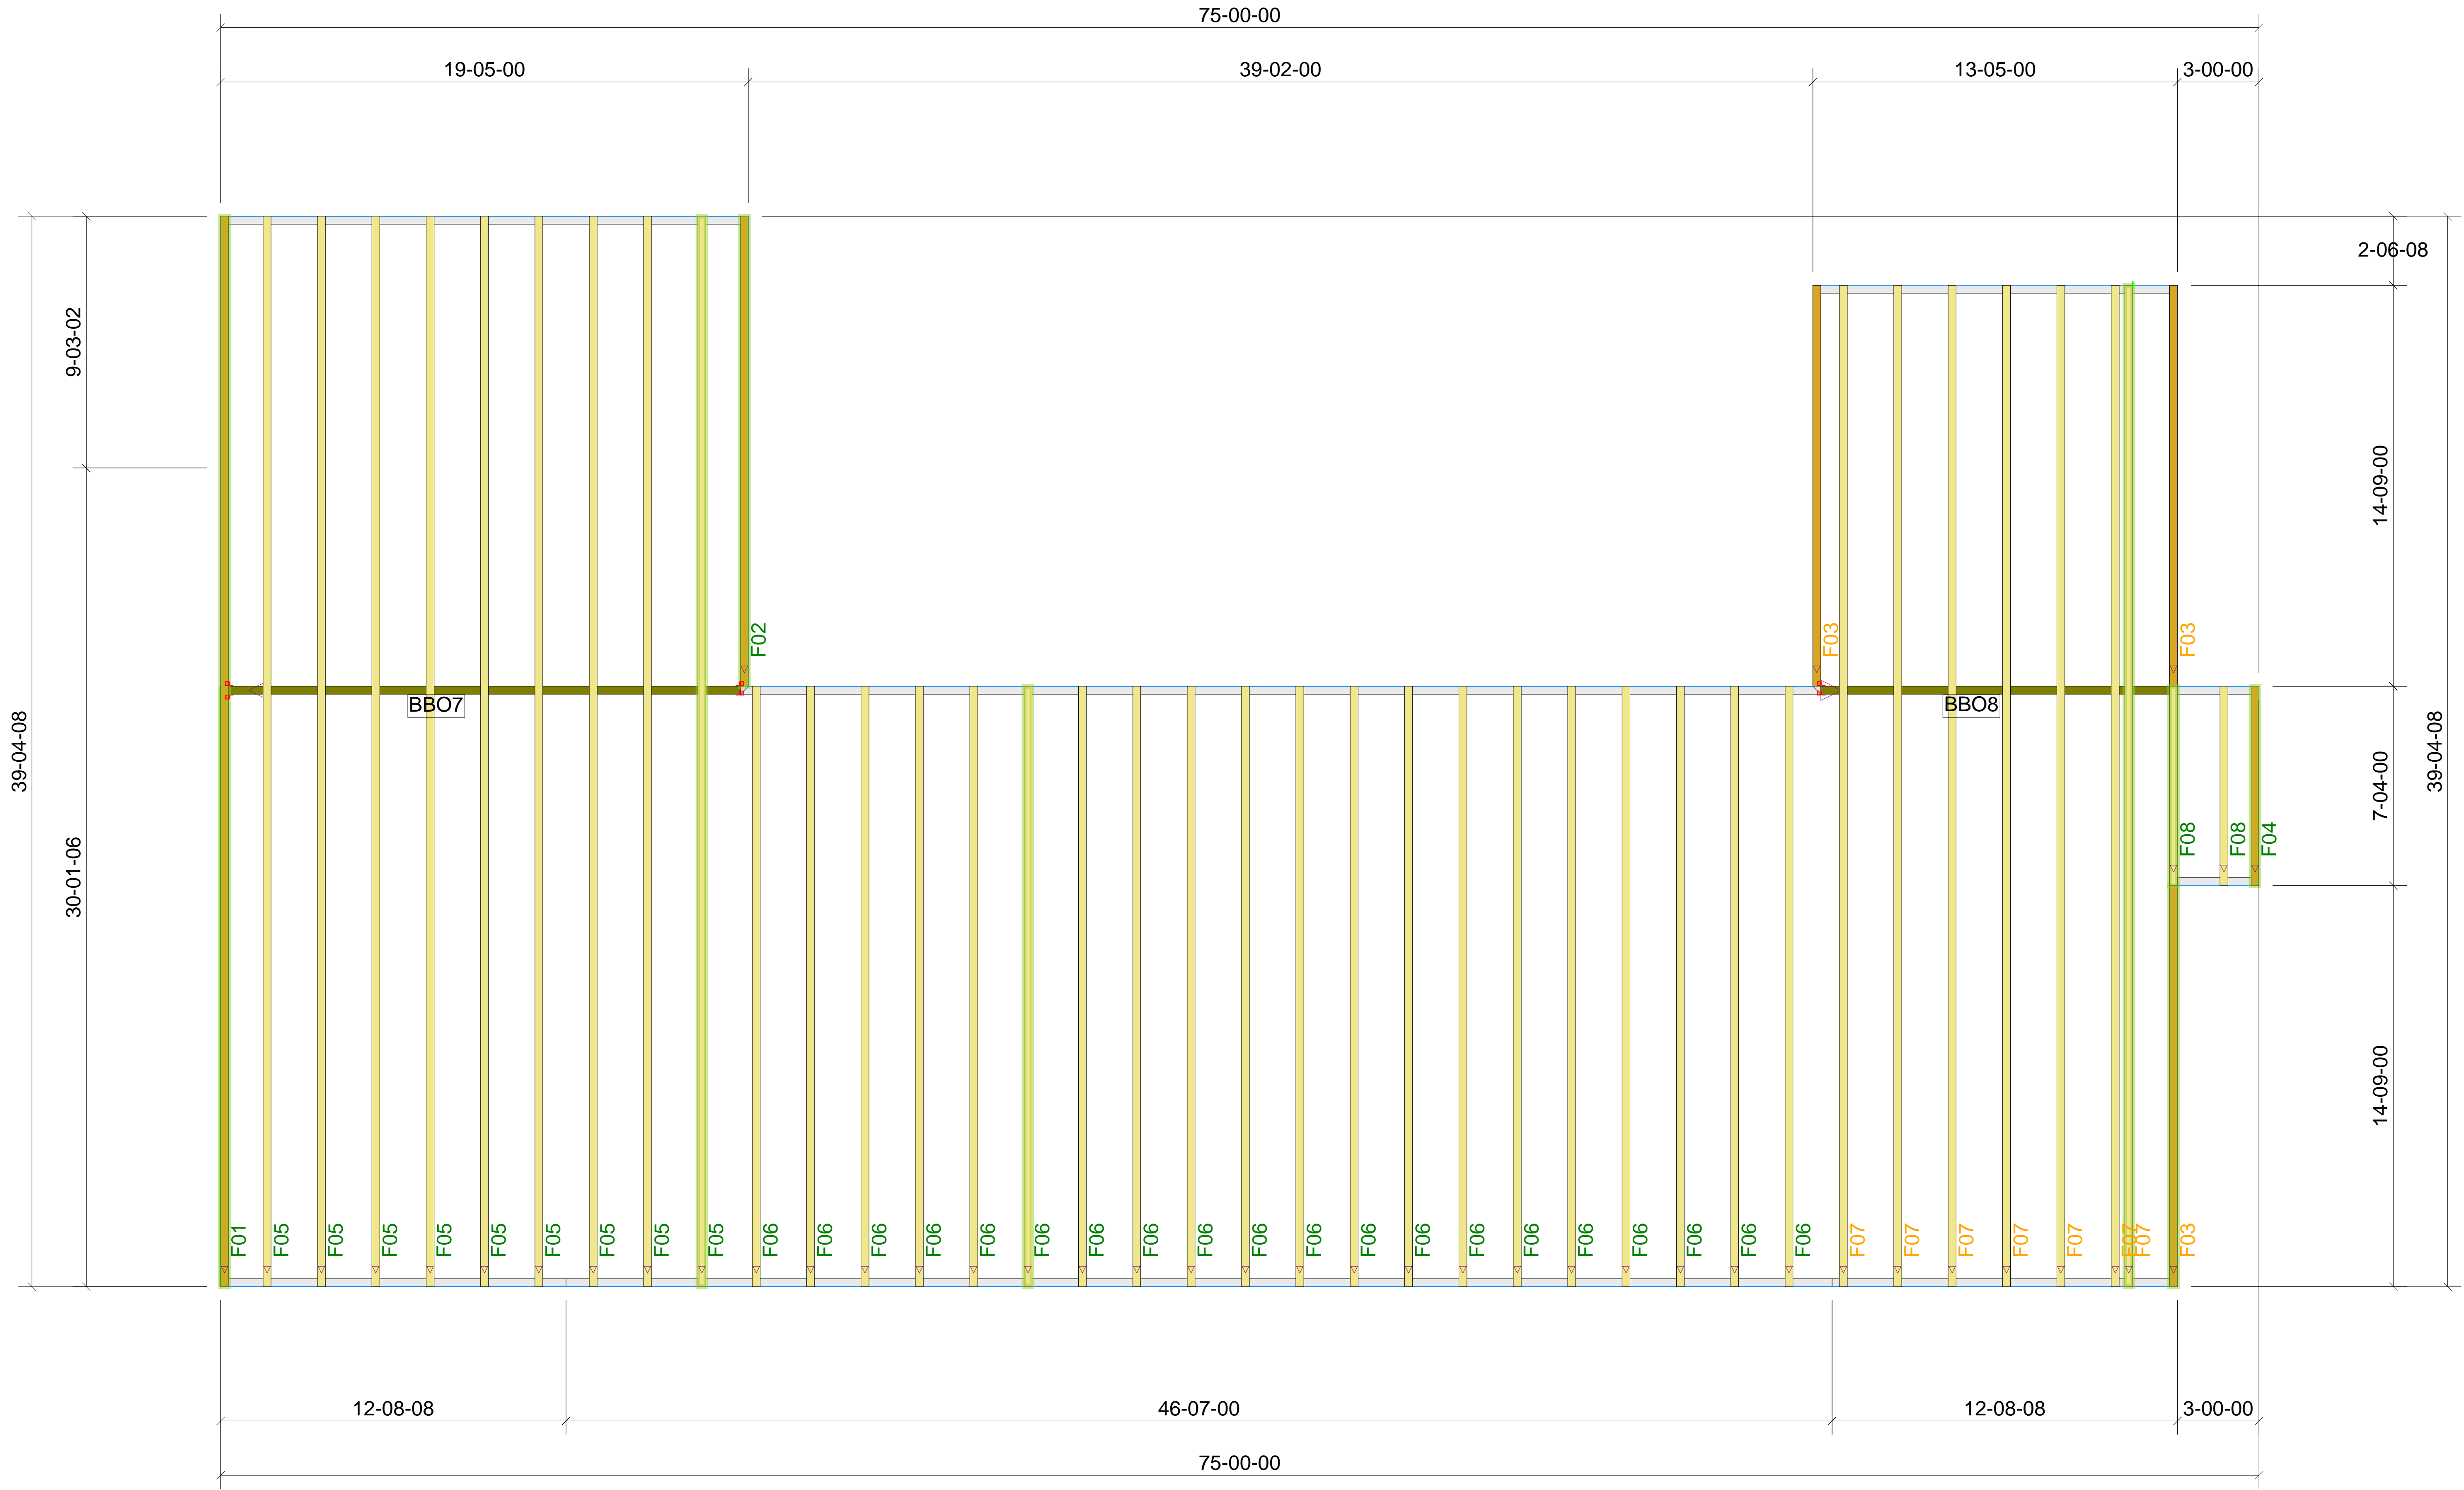

Client: SERVICE BUILDING SUPPLY
 Project: BERUBE
 Model: Model
 Lot #: Subdivision:
 Order #: P23120611
 Designer: Chad Miller
 Date: 62

LONGLEAF TRUSS CO.
 4476 Hwy. 21 W
 West End, NC 27376
 (910) 673-4711


NOTE
 IT IS THE RESPONSIBILITY OF THE BUILDING DESIGNER OR ARCHITECT TO PROVIDE AN APPROPRIATE CONNECTION FOR TRUSSES TO SUPPORTING STRUCTURE PERFECTIONS SHOWN ON TRUSS ENGINEERING SPECIAL CONSIDERATIONS FOR MECHANICAL EQUIPMENT AND/OR PLUMBING (AND THEIR CONNECTIONS) IN TRUSS SPACE MUST BE DIAGRAMMED BY BUILDER ON APPROVED TRUSS LAYOUT PRIOR TO FABRICATION.
 THIS COMPANY IS A TRUSS MANUFACTURER WHOSE RESPONSIBILITIES ARE LIMITED TO THOSE DESCRIBED IN WTCAL-1995 "DESIGN RESPONSIBILITIES". ACCORDINGLY, IT DISCLAIMS ANY RESPONSIBILITIES AND/OR LIABILITY FOR THE CONSTRUCTION, DESIGN, DRAWINGS, DOCUMENTS INCLUDING THE INSTALLATION AND BRACING OF TRUSSES MANUFACTURED BY THIS COMPANY. SEE <http://support.sbindustry.com/pubs/TBDResp-D>

Job P23120611	Truss F01	Truss Type Floor Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	-------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:14 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Rdm?HPc6Y_4sgclqNIMul2W6WjTWAhxPWFQ8VrzyoKV

0'-1-8 0'-1-8
Scale = 1:66.7

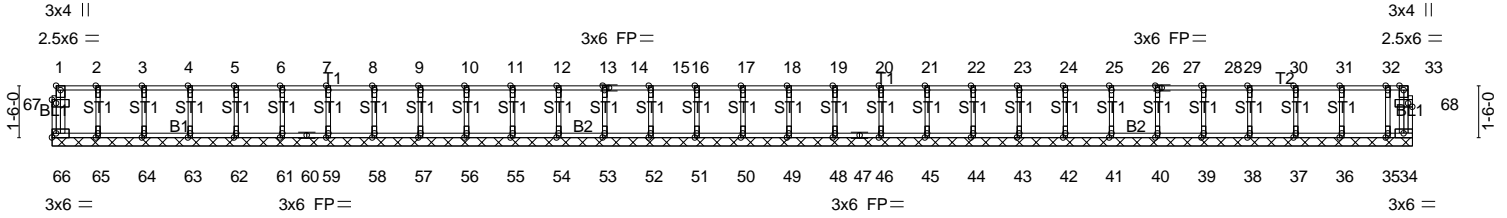

39-4-8
39-4-8

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [67:0-1-8,0-1-4], [68:0-1-8,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	34	n/a		
BCDL 5.0	Code IRC2018/TPI2014	Matrix-R						
							Weight: 181 lb	FT = 8%F, 4%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 39-4-8.

(lb) - Max Grav All reactions 250 lb or less at joint(s) 66, 34, 65, 64, 63, 62, 61, 59, 58, 57, 56, 55, 54, 53, 52, 51, 50, 49, 48, 46, 45, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 0 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss F02	Truss Type Floor Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	-------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:15 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-vqKNVldkJCJlmK1xTt7qG3HH7pDvkCYlv9i2HzyoKU

0-1-8

0-1-8

Scale = 1:28.8

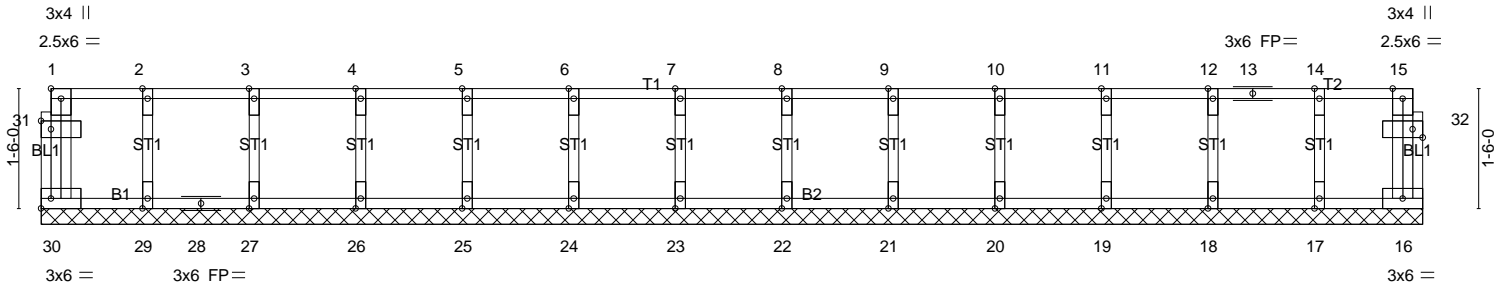


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [31:0-1-8,0-1-4], [32:0-1-8,0-1-4]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 16 n/a n/a		
BCDL 5.0	Code IRC2018/TPI2014	Matrix-R			
				Weight: 84 lb	FT = 8%F, 4%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 17-3-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 30, 16, 29, 27, 26, 25, 24, 23, 22, 21, 20, 19, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Plates checked for a plus or minus 0 degree rotation about its center.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss F03	Truss Type Floor Supported Gable	Qty 3	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	-------------------------------------	----------	----------	------------------------------------


Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:17 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-sCS7wRf_rvSRX4TP2tvtbv8dnxVgNehrCDEp69zyoKS

0-1-8

0-1-8

Scale = 1:24.5

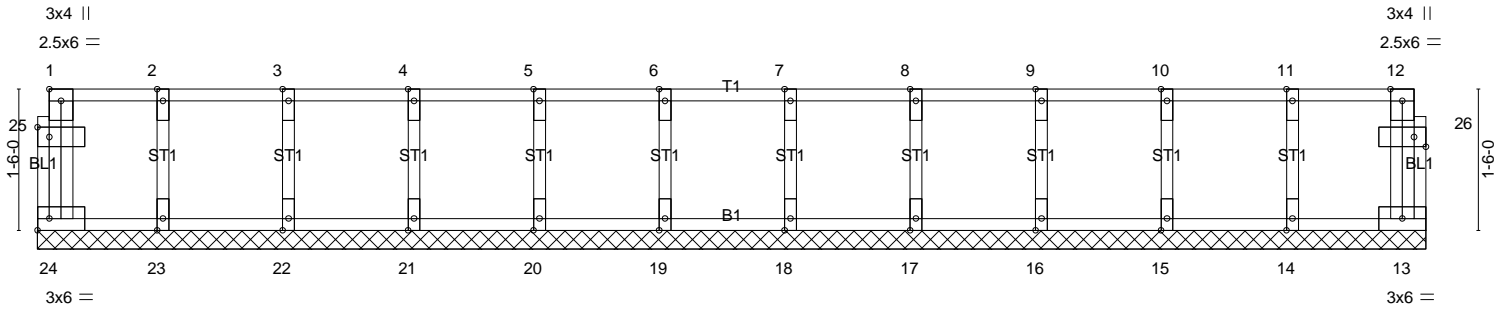

14-9-0
14-9-0

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [25:0-1-8,0-1-4], [26:0-1-8,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Code IRC2018/TPI2014	Matrix-R						
							Weight: 73 lb	FT = 8%F, 4%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 14-9-0.

(lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 23, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 0 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss F04	Truss Type Floor Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	-------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:18 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-KP0V7nfccDal9D2ccbQqSuhoULrp65w?RtOMeczyoKR

0-1-8

0-1-8

Scale = 1:13.8

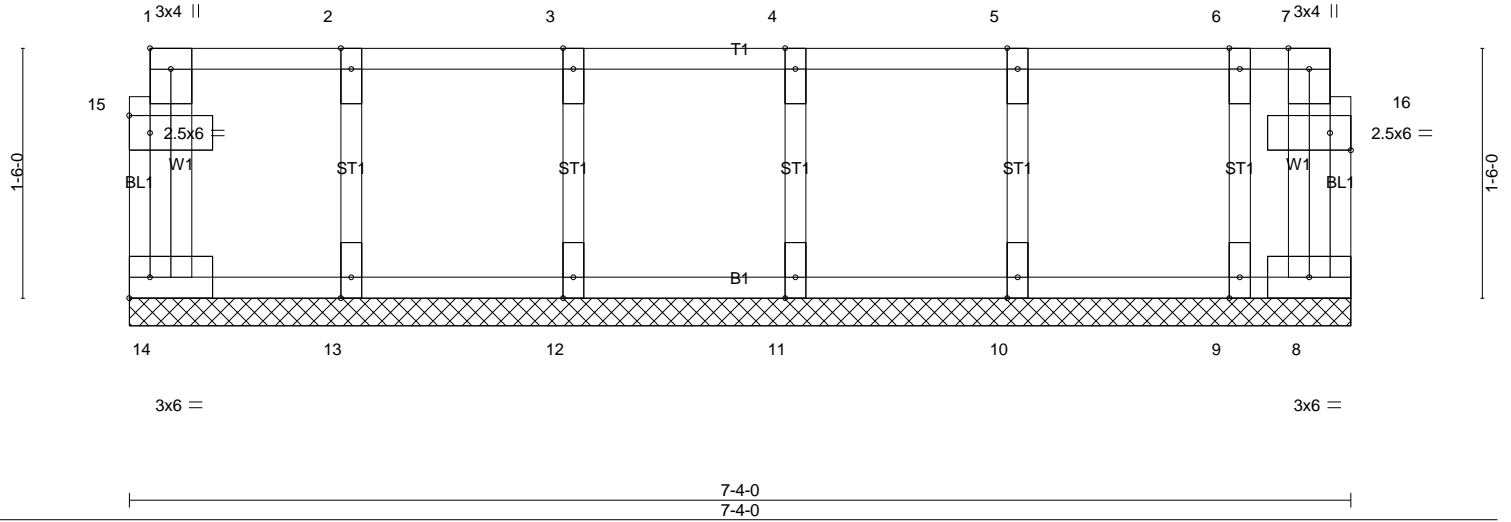


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [15:0-1-8,0-1-4], [16:0-1-8,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	8	n/a		
BCDL 5.0	Code IRC2018/TPI2014	Matrix-R						
							Weight: 41 lb	FT = 8%F, 4%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 7-4-0.

(lb) - Max Grav All reactions 250 lb or less at joint(s) 14, 8, 13, 12, 11, 10, 9

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 0 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss F05	Truss Type Floor	Qty 9	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	---------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:19 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-obauL7gENWi8mNdoAly3_6Emlk_grJH8gX7vB2zyoKQ

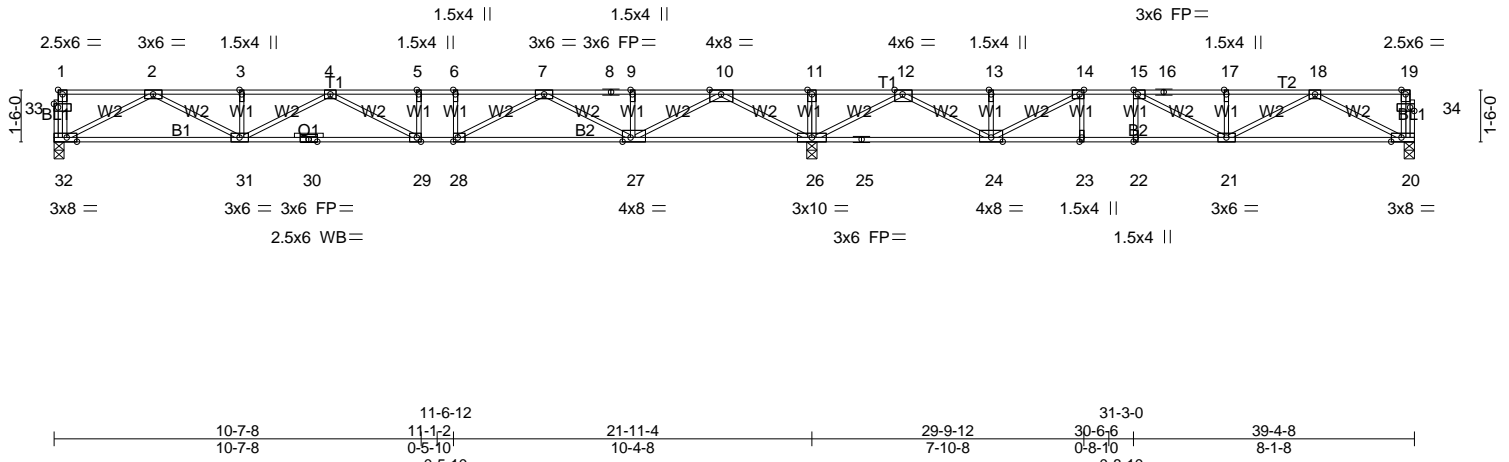


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [12:0-2-12,Edge], [14:0-1-8,Edge], [15:0-1-8,Edge], [20:0-3-8,Edge], [27:0-2-12,Edge], [28:0-1-8,Edge], [29:0-1-8,Edge], [32:0-3-8,Edge], [33:0-1-8,0-1-4], [34:0-1-8,0-1-4]

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.86	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.87	Vert(LL) -0.34 29-31 >763 480		
BCLL 0.0	Rep Stress Incr YES	WB 0.99	Vert(CT) -0.48 29-31 >548 360		
BCDL 5.0	Code IRC2018/TPI2014	Matrix-S	Horz(CT) 0.06 20 n/a n/a		
				Weight: 205 lb	FT = 8%F, 4%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 20=684/0-3-8 (min. 0-1-8), 32=985/0-3-8 (min. 0-1-8), 26=2608/0-3-8 (min. 0-1-8)
Max Grav 20=809(LC 4), 32=1035(LC 3), 26=2608(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2921/0, 3-4=-2921/0, 4-5=-3512/0, 5-6=-3512/0, 6-7=-3512/0, 7-8=-1607/311, 8-9=-1607/311, 9-10=-1607/311, 10-11=0/3152, 11-12=0/3152, 12-13=-1367/1038, 13-14=-1367/1038, 14-15=-2135/422, 15-16=-2080/11, 16-17=-2080/11, 17-18=-2080/11
BOT CHORD 31-32=0/1781, 30-31=0/3500, 29-30=0/3500, 28-29=0/3512, 27-28=0/2780, 26-27=-1022/0, 25-26=-1668/152, 24-25=-1668/152, 23-24=-422/2135, 22-23=-422/2135, 21-22=-422/2135, 20-21=0/1336
WEBS 11-26=-282/0, 2-32=-1995/0, 10-26=-2643/0, 2-31=0/1294, 10-27=0/2070, 9-27=-265/0, 4-31=-657/0, 7-27=-1434/0, 4-29=-470/291, 7-28=0/1119, 6-28=-344/0, 18-20=-1496/0, 12-26=-2225/0, 18-21=-57/844, 12-24=0/1630, 17-21=-347/0, 15-21=-62/591, 14-24=-1315/0, 14-23=0/268

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) The Fabrication Tolerance at joint 30 = 4%
 - 5) Plates checked for a plus or minus 0 degree rotation about its center.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

Job P23120611	Truss F06	Truss Type Floor	Qty 20	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	---------------------	-----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:20 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Gn7GYTh8qr?OXC_j0TIXJm_L8JwapuluBtTjUzyoKP

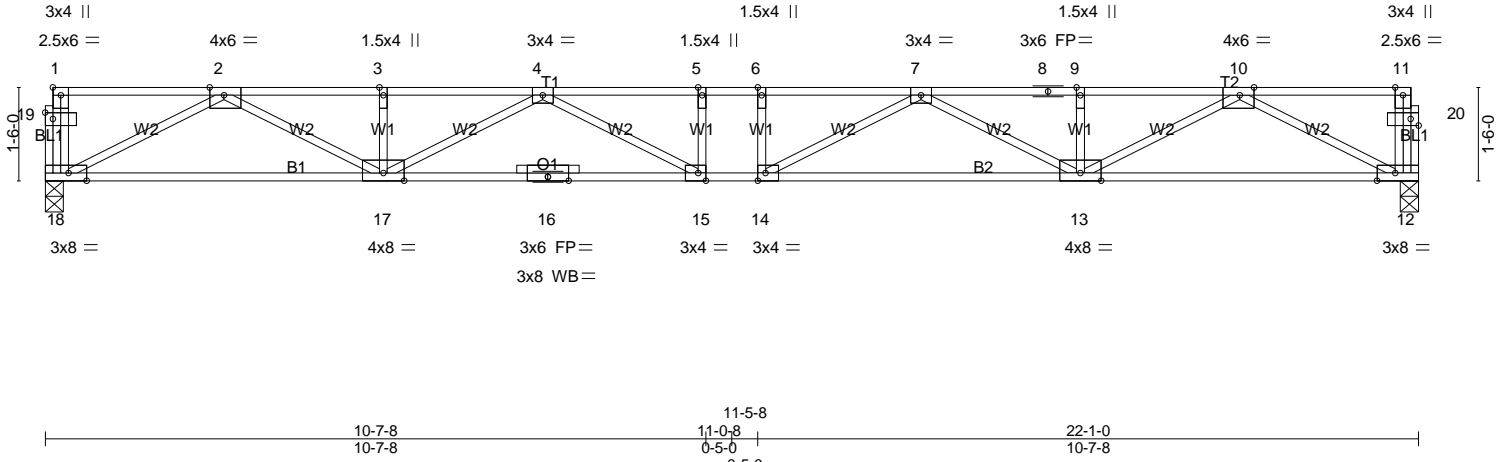



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-2-12,Edge], [10:0-2-12,Edge], [12:0-3-8,Edge], [14:0-1-8,Edge], [15:0-1-8,Edge], [18:0-3-8,Edge], [19:0-1-8,0-1-4], [20:0-1-8,0-1-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.62	Vert(LL) -0.40	15	>651	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.87	Vert(CT) -0.55	15-17	>474	360		
BCLL 0.0	Rep Stress Incr YES		WB 0.77	Horz(CT) 0.10	12	n/a	n/a		
BCDL 5.0	Code IRC2018/TPI2014		Matrix-S						
								Weight: 118 lb	FT = 8%F, 4%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Sheathed or 5-4-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 12=1188/0-3-8 (min. 0-1-8), 18=1188/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3502/0, 3-4=-3502/0, 4-5=-4725/0, 5-6=-4725/0, 6-7=-4725/0, 7-8=-3502/0,
8-9=-3502/0, 9-10=-3502/0
BOT CHORD 17-18=0/2076, 16-17=0/4366, 15-16=0/4366, 14-15=0/4725, 13-14=0/4366, 12-13=0/2076
WEBS 10-12=-2326/0, 2-18=-2326/0, 10-13=0/1618, 2-17=0/1618, 7-13=-981/0, 4-17=-981/0,
7-14=-102/719, 4-15=-102/719

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - 3) The Fabrication Tolerance at joint 16 = 4%
 - 4) Plates checked for a plus or minus 0 degree rotation about its center.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss F07	Truss Type Floor	Qty 7	Ply 1	BERUBE
------------------	--------------	---------------------	----------	----------	--------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:22 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-CAF0z9j7gR5jdrMNRVmcjsJ_y_p2hRaMVMaoNzyoKN

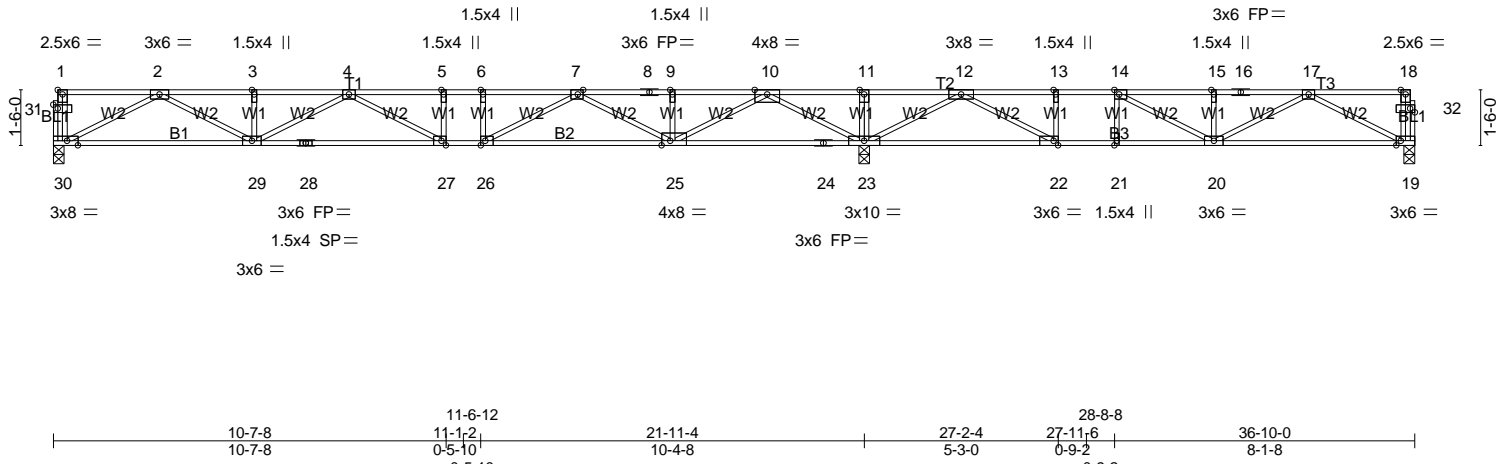


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-12,Edge], [14:0-1-8,Edge], [19:0-1-8,Edge], [22:0-1-8,Edge], [25:0-2-12,Edge], [26:0-1-8,Edge], [27:0-1-8,Edge], [30:0-3-8,Edge], [31:0-1-8,0-1-4], [32:0-1-8,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.67	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.91	Vert(LL) -0.34 27-29 >765 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.96	Vert(CT) -0.48 27-29 >544 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.07 23 n/a n/a		
	Code IRC2018/TPI2014			Weight: 191 lb	FT = 8%F, 4%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat) *Except*
T2: 2x4 SP DSS(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Sheathed or 5-11-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 19=558/0-3-8 (min. 0-1-8), 30=1025/0-3-8 (min. 0-1-8), 23=2415/0-3-8 (min. 0-1-8)
Max Grav 19=708(LC 4), 30=1045(LC 10), 23=2415(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2960/0, 3-4=-2960/0, 4-5=-3591/0, 5-6=-3591/0, 6-7=-3591/0, 7-8=-1739/0,
8-9=-1739/0, 9-10=-1739/0, 10-11=0/2636, 11-12=0/2636, 12-13=-1482/814,
13-14=-1482/814, 14-15=-1710/231, 15-16=-1710/231, 16-17=-1710/231
BOT CHORD 29-30=0/1801, 28-29=0/3558, 27-28=0/3558, 26-27=0/3591, 25-26=0/2885, 24-25=-464/9,
23-24=-464/9, 22-23=-1579/466, 21-22=-814/1482, 20-21=-814/1482, 19-20=-79/1139
WEBS 11-23=-312/0, 2-30=-2017/0, 10-23=-2576/0, 2-29=0/1316, 10-25=0/2014, 9-25=-267/0,
4-29=-678/0, 7-25=-1358/0, 4-27=-367/392, 7-26=0/1012, 6-26=-314/0, 17-19=-1273/90,
12-23=-1905/0, 17-20=-172/648, 12-22=0/1574, 15-20=-389/0, 13-22=-530/0,
14-20=0/849

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) The Fabrication Tolerance at joint 28 = 4%
 - 5) Plates checked for a plus or minus 0 degree rotation about its center.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

Job P23120611	Truss F08	Truss Type Floor	Qty 2	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	---------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:23 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-gMpOAUjiRIDaF?xZP80?9yOZMMVnnKDKb957KpzyoKM

0-1-8



0-1-8
Scale = 1:13.8


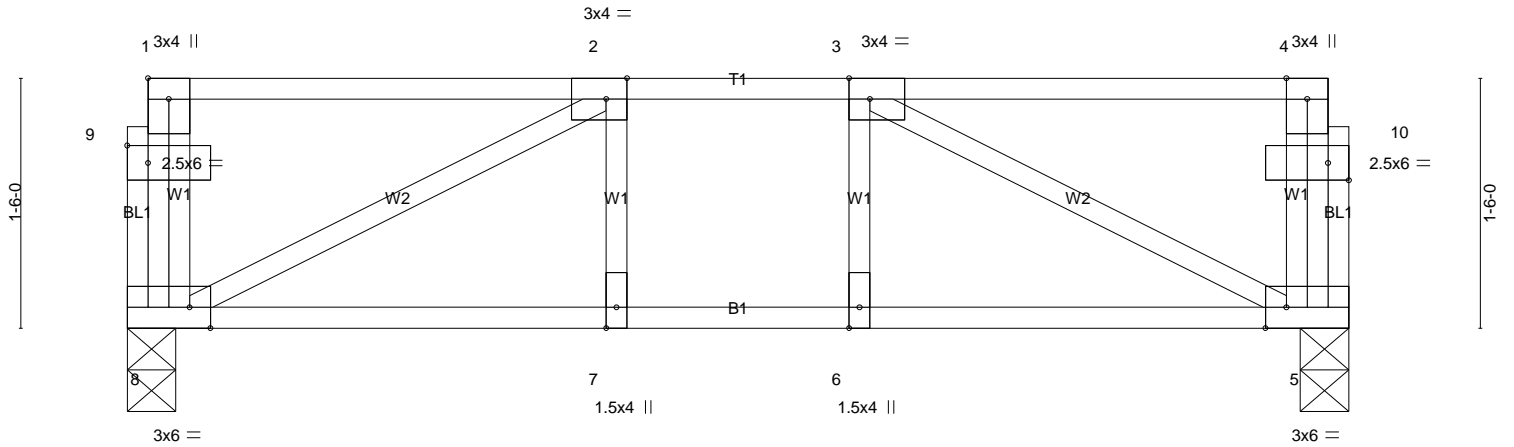


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [5:0-1-8,Edge], [8:0-1-8,Edge], [9:0-1-8,0-1-4], [10:0-1-8,0-1-4]										
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.37	Vert(LL)	-0.04	7-8	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.22	Vert(CT)	-0.04	7-8	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.01	5	n/a	n/a		
BCDL 5.0	Code IRC2018/TPI2014		Matrix-S						Weight: 44 lb	FT = 8%F, 4%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 5=376/0-3-8 (min. 0-1-8), 8=376/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-505/0
BOT CHORD 7-8=0/505, 6-7=0/505, 5-6=0/505
WEBS 3-5=-559/0, 2-8=-559/0

NOTES-

- Unbalanced floor live loads have been considered for this design.
- As requested, plates have not been designed to provide for placement tolerances or rough handling and erection conditions. It is the responsibility of the fabricator to increase plate sizes to account for these factors.
- Plates checked for a plus or minus 0 degree rotation about its center.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

Job P23120611	Truss G01	Truss Type Common Girder	Qty 1	Ply 2	BERUBE
------------------	--------------	-----------------------------	----------	----------	--------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:27 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Z72v0smGU_j0kcEKe_5xJoZGSz8Nj0cJWm3KTazyokI

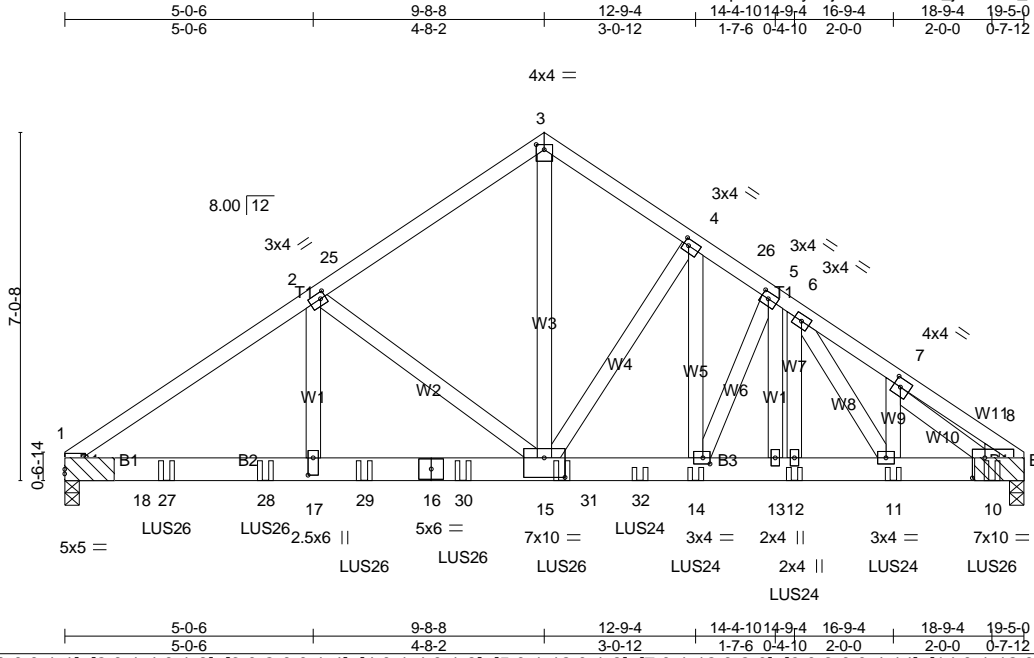


Plate Offsets (X,Y)-- [1:0-0-0,0-1-1], [2:0-1-4,0-1-8], [3:0-2-0,0-1-4], [4:0-1-4,0-1-8], [5:0-1-12,0-1-8], [7:0-1-12,0-2-0], [9:0-3-0,0-4-14], [14:0-1-12,0-1-8], [15:0-5-0,0-4-12], [17:0-4-4,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	Plate Grip DOL 1.15	TC 0.30	Vert(LL) -0.09 15-17	>999	240		MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Lumber DOL 1.15	BC 0.69	Vert(CT) -0.16 15-17	>999	180			
TCDL 10.0	Rep Stress Incr NO	WB 0.64	Horz(CT) 0.04 9	n/a	n/a			
BCLL 0.0 *	Code IRC2018/TPI2014	Matrix-MS						
BCDL 10.0							Weight: 303 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.3 *Except*
 W3: 2x4 SP No.2

BRACING-
 TOP CHORD Sheathed or 4-9-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 1=4034/(0-3-8 + bearing block) (req. 0-3-13), 9=4352/(0-3-8 + bearing block) (req. 0-4-1)
 Max Horz 1=-162(LC 35)
 Max Uplift1=-349(LC 12)
 Max Grav 1=4865(LC 3), 9=5169(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-7122/501, 2-25=-5005/278, 3-25=-4946/306, 3-4=-4957/314, 4-26=-6209/154,
 5-26=-6250/146, 5-6=-6516/89, 6-7=-7257/0, 7-8=-5383/0, 8-9=-5631/0
 BOT CHORD 1-18=-350/5870, 18-27=-350/5870, 27-28=-350/5870, 17-28=-350/5870, 17-29=-350/5870,
 16-29=-350/5870, 16-30=-350/5870, 15-30=-350/5870, 15-31=-6/5149, 31-32=-6/5149,
 14-32=-6/5149, 13-14=0/5624, 12-13=0/5624, 11-12=0/5624, 10-11=0/5975, 9-10=0/4479
 WEBS 3-15=-257/5241, 5-13=0/790, 2-15=-2206/338, 2-17=-207/2278, 4-14=0/2237,
 4-15=-1875/0, 5-14=-1141/0, 7-11=-78/340, 6-11=0/735, 8-10=0/449, 7-10=-2108/6

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, except member 8-10 2x4 - 1 row at 0-5-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - 2x6 SP No.1 bearing block 12" long at jt. 1 attached to each face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners per block. User Defined Bearing crushing capacity= 425psi.
 - 2x6 SP No.1 bearing block 12" long at jt. 9 attached to each face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners per block. User Defined Bearing crushing capacity= 425psi.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	G01	Common Girder	1	2	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:27 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Z72v0smGU_j0kcEKe_5xJoZGSzINj0cJWm3KTazyoKI

NOTES-

- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 349 lb uplift at joint 1.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 10-0-12 to connect truss(es) T08 (1 ply 2x4 SP) to front face of bottom chord.
- 14) Use Simpson Strong-Tie LUS24 (4-SD9112 Girder, 2-SD9212 Truss, Single Ply Girder) or equivalent at 11-7-12 from the left end to connect truss(es) T09 (1 ply 2x4 SP) to front face of bottom chord.
- 15) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 12-9-4 from the left end to 16-9-4 to connect truss(es) T15 (1 ply 2x4 SP), T16 (1 ply 2x4 SP) to front face of bottom chord.
- 16) Use Simpson Strong-Tie LUS26 (4-10d Girder, 3-10d Truss, Single Ply Girder) or equivalent at 18-9-4 from the left end to connect truss(es) T16 (1 ply 2x4 SP) to front face of bottom chord.
- 17) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-51, 3-9=-51, 19-22=-20


Concentrated Loads (lb)

Vert: 14=-625(F) 12=-625(F) 11=-625(F) 10=-629(F) 27=-747(F) 28=-747(F) 29=-747(F) 30=-747(F) 31=-747(F) 32=-772(F)

Job P23120611	Truss G02	Truss Type Common Girder	Qty 1	Ply 2	BERUBE
------------------	--------------	-----------------------------	----------	----------	--------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:29 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-VWAFRYoW0bzkzwOjIP7PODeelmSCBxqcz4YRXTzyoKG



Scale = 1:32.8

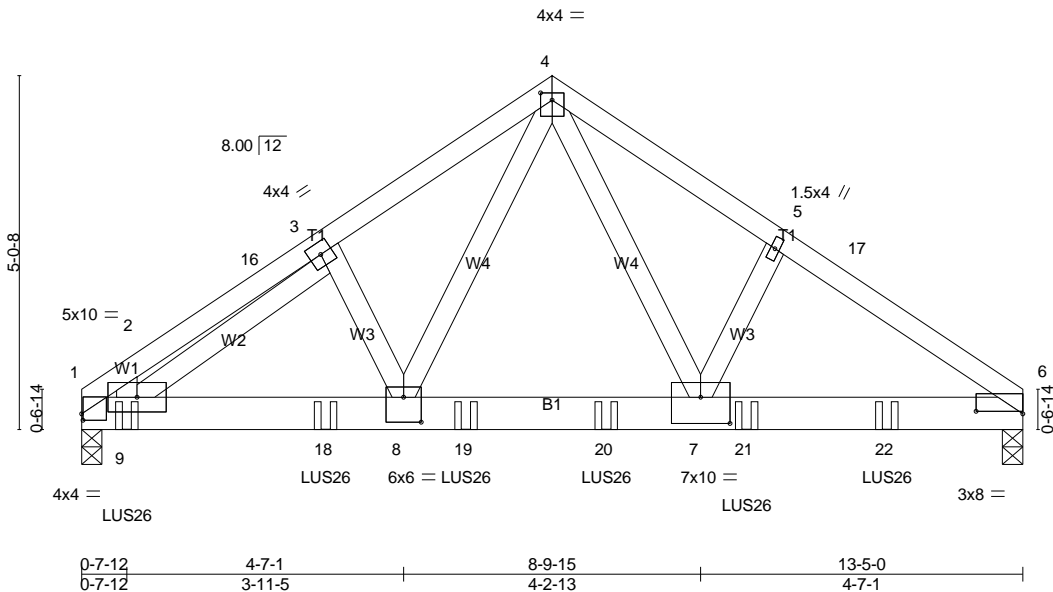


Plate Offsets (X,Y)--	[1:0-0-4,0-1-1], [4:0-2-0,0-1-4], [6:0-8-0,0-0-7], [7:0-5-0,0-4-8], [8:0-3-0,0-4-4]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.15	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.60	Vert(LL) -0.05 7-8 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.60	Vert(CT) -0.08 7-8 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.02 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 165 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (lb/size) 1=3176/0-3-8 (min. 0-2-15), 6=2875/0-3-8 (min. 0-2-12)
 Max Horz 1=112(LC 36)
 Max Uplift 1=363(LC 12), 6=363(LC 12)
 Max Grav 1=3753(LC 3), 6=3526(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-3825/359, 2-16=-3670/390, 3-16=-3621/400, 3-4=-4577/539, 4-5=-4737/559,
 5-17=-4749/522, 6-17=-4805/510
 BOT CHORD 1-9=-287/3043, 9-18=-367/3787, 8-18=-367/3787, 8-19=-217/2726, 19-20=-217/2726,
 7-20=-217/2726, 7-21=-386/3971, 21-22=-386/3971, 6-22=-386/3971
 WEBS 4-7=-313/2888, 4-8=-275/2554, 2-9=-81/296, 3-9=-994/107

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 363 lb uplift at joint 1 and 363 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Use Simpson Strong-Tie LUS26 (4-10d Girder, 3-10d Truss) or equivalent at 0-7-12 from the left end to connect truss(es) T12 (1 ply 2x4 SP) to front face of bottom chord.
 - Use Simpson Strong-Tie LUS26 (4-SD912 Girder, 4-SD912 Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 3-5-12 from the left end to 11-5-12 to connect truss(es) T13 (1 ply 2x4 SP) to front face of bottom chord.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	G02	Common Girder	1	2	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:29 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-VWfRYoW0bzkzwOjIP7PODeImSCBxqcz4YRXTzyoKG

NOTES-

13) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-51, 4-6=-51, 10-13=-20

Concentrated Loads (lb)

Vert: 12=-835(F) 18=-853(F) 19=-853(F) 20=-853(F) 21=-853(F) 22=-853(F)

Job P23120611	Truss PB01	Truss Type Piggyback	Qty 25	Ply 1	BERUBE Job Reference (optional)
------------------	---------------	-------------------------	-----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:31 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-RvIQsDqmYCDRCDY5tq9tUdjyOaFcfzkvQO1YcLzYoKE

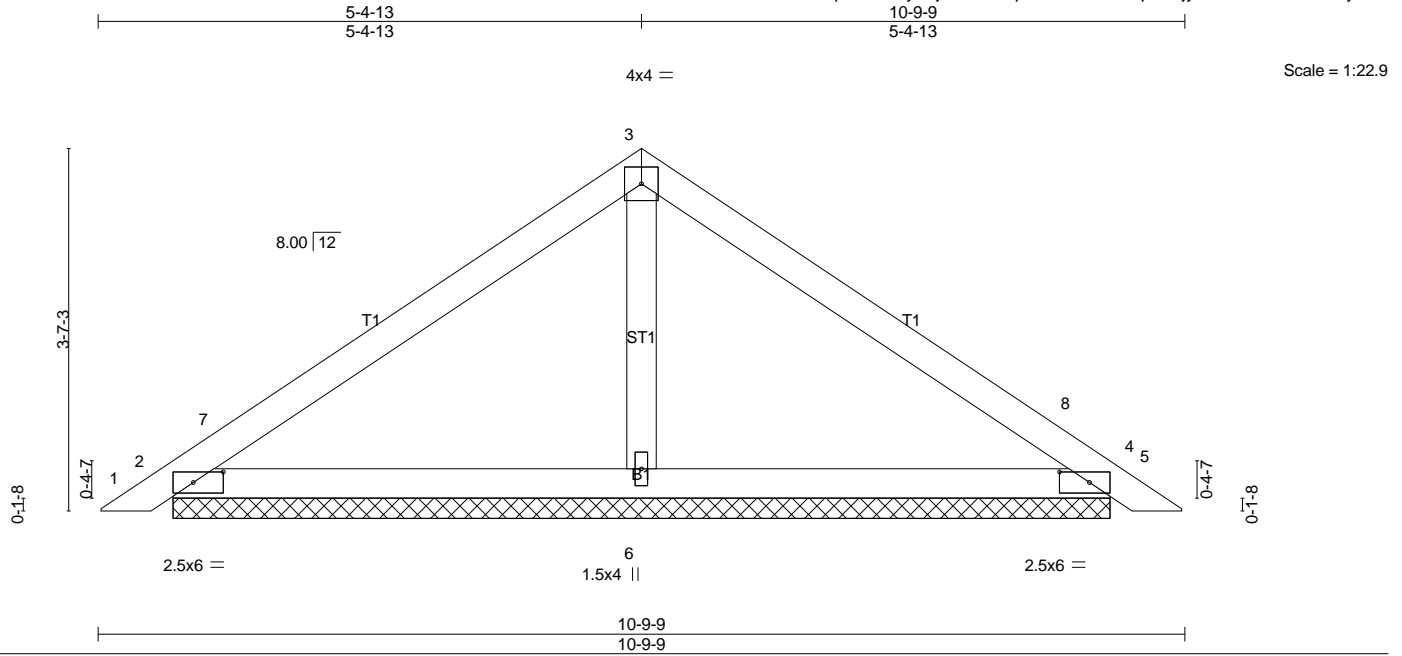


Plate Offsets (X,Y)-- [2:0-3-9,0-1-4], [4:0-3-9,0-1-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.16	Vert(LL) 0.01 5 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.06	Vert(CT) 0.01 5 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 4 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 37 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=188/9-3-11 (min. 0-1-8), 4=188/9-3-11 (min. 0-1-8), 6=331/9-3-11 (min. 0-1-8)
Max Horz 2=86(LC 11)
Max Uplift 2=-53(LC 12), 4=-53(LC 12), 6=-2(LC 12)
Max Grav 2=247(LC 17), 4=247(LC 18), 6=370(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 2, 53 lb uplift at joint 4 and 2 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

Job P23120611	Truss T01	Truss Type Common	Qty 17	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	-----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:32 2024 Page 1
ID:DfAk8NRn2VuAb4Ep4AV?ezyoXj-v5so3ZqOJWLiQn7IQXg60rG?F_P0OLR3f2n58ozyoKD

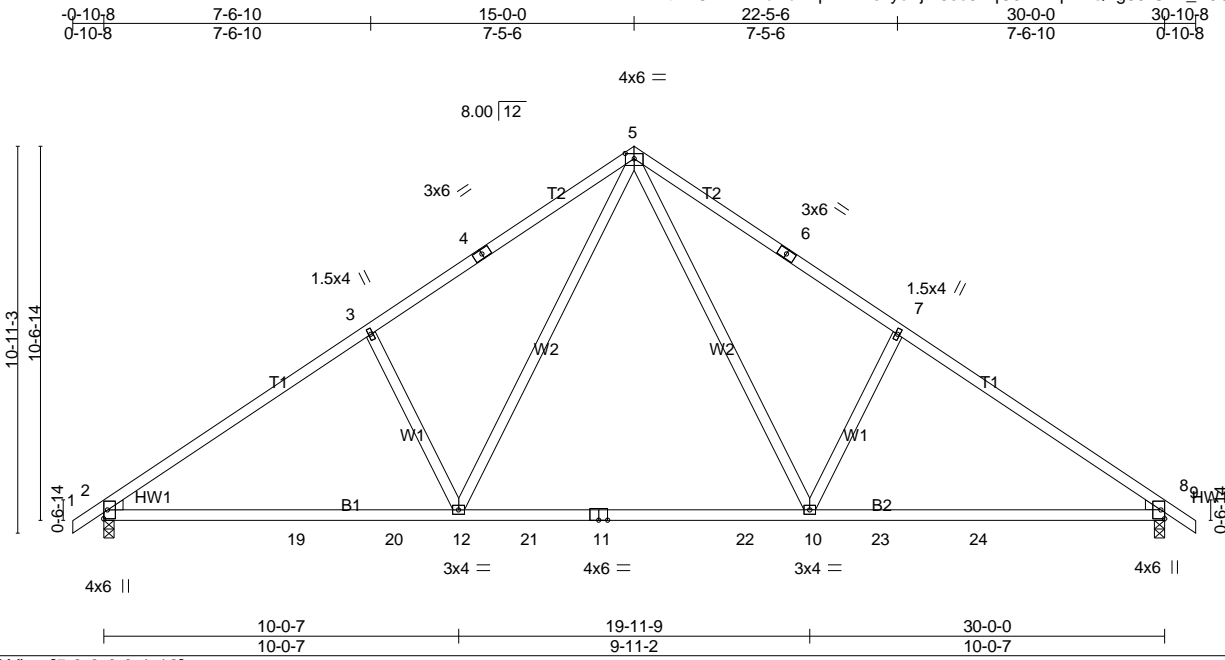


Plate Offsets (X,Y)-- [5:0-3-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.81	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.85	Vert(LL) -0.27 10-12 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.35	Vert(CT) -0.40 10-12 >892 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.04 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 153 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 2-2-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1106/0-3-8 (min. 0-2-5), 8=1106/0-3-8 (min. 0-2-5)
 Max Horz 2=-278(LC 10)
 Max Uplift 2=-151(LC 12), 8=-151(LC 12)
 Max Grav 2=1474(LC 24), 8=1474(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1963/221, 3-4=-1833/273, 4-5=-1715/301, 5-6=-1716/301, 6-7=-1834/273,
 7-8=-1963/221
 BOT CHORD 2-19=-56/1747, 19-20=-56/1747, 12-20=-56/1747, 12-21=0/1126, 11-21=0/1126,
 11-22=0/1126, 10-22=0/1126, 10-23=-56/1556, 23-24=-56/1556, 8-24=-56/1556
 WEBS 5-10=-96/957, 7-10=-467/226, 5-12=-96/957, 3-12=-467/226

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=30ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 151 lb uplift at joint 2 and 151 lb uplift at joint 8.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T01GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	----------------	--------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:34 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-sU_YUFsfr7b03hHgYyja5GLWlnl3s13L7MGCDgzyoKB

-0-10-8 0-10-8	15-0-0 15-0-0	30-0-0 15-0-0	30-10-8 0-10-8
-------------------	------------------	------------------	-------------------

Scale = 1:65.4

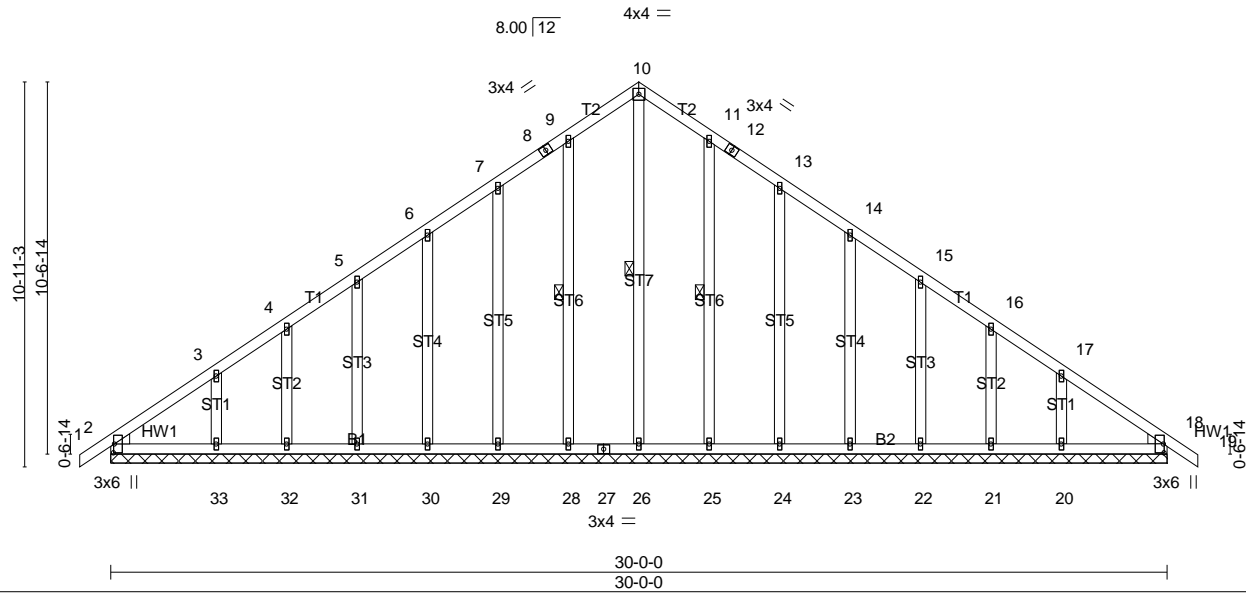


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [18:0-3-0,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.07	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) 0.00 19 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.15	Vert(CT) 0.00 19 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 18 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 214 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 10-26, 9-28, 11-25

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 30-0-0.
(lb) - Max Horz 2=278(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20
Max Grav All reactions 250 lb or less at joint(s) 2, 26, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21, 18 except 33=263(LC 24), 20=258(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=30ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 18.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T01SGE	Common Structural Gable	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:36 2024 Page 1
ID: DtfAk8NRn2VuAb4Ep4AV?ezyoXj-os5JvxtvNliskJ_Q3fNi2BhRjFbvXKC4eagJHZzyoK9



Scale = 1:65.3

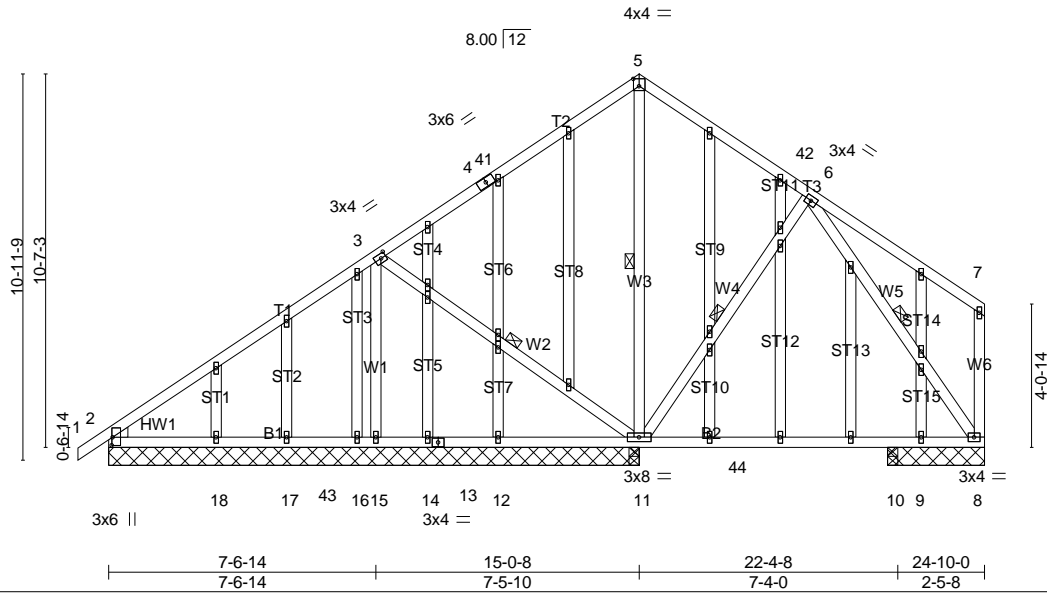


Plate Offsets (X,Y)-- [2:0-2-12,0-0-4], [3:0-1-12,0-1-8], [5:0-2-0,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.62	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.37	Vert(LL) -0.07 10-11 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.18	Vert(CT) -0.11 10-11 >791 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.01 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 233 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 3-11, 5-11, 6-11, 6-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 15-0-8 except (jt=length) 8=2-9-0, 9=2-9-0, 10=0-3-8.
 (lb) - Max Horz 2=324(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 15, 8, 17, 18 except 11=113(LC 12), 9=-316(LC 19)
 Max Grav All reactions 250 lb or less at joint(s) 12, 14, 16, 17 except 2=331(LC 25), 15=322(LC 17), 11=693(LC 26), 11=566(LC 1), 8=348(LC 2), 18=257(LC 24), 10=573(LC 19), 2=277(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-346/97
 BOT CHORD 2-18=-134/263, 17-18=-134/263, 17-43=-134/263, 16-43=-134/263, 15-16=-134/263, 14-15=-134/263, 13-14=-134/263, 12-13=-134/263, 11-12=-134/263
 WEBS 3-15=-326/92, 5-11=-283/16

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 15, 8, 17, 18, 2 except (jt=lb) 11=113, 9=316.

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T01SGE	Common Structural Gable	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:36 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-os5JvxtvNlskJ_Q3fNI2BhRjFbvXKC4eagJHZzyoK9

NOTES-
12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T02	Truss Type Common	Qty 11	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	-----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:37 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-G3fh6HuX82_bw8?FD4GHjuztf?Ar3dLopKVsp?zyoK8

-0-10-8	6-11-10	13-10-0	20-8-6	27-8-0	28-6-8
0-10-8	6-11-10	6-10-6	6-10-6	6-11-10	0-10-8

Scale = 1:60.5

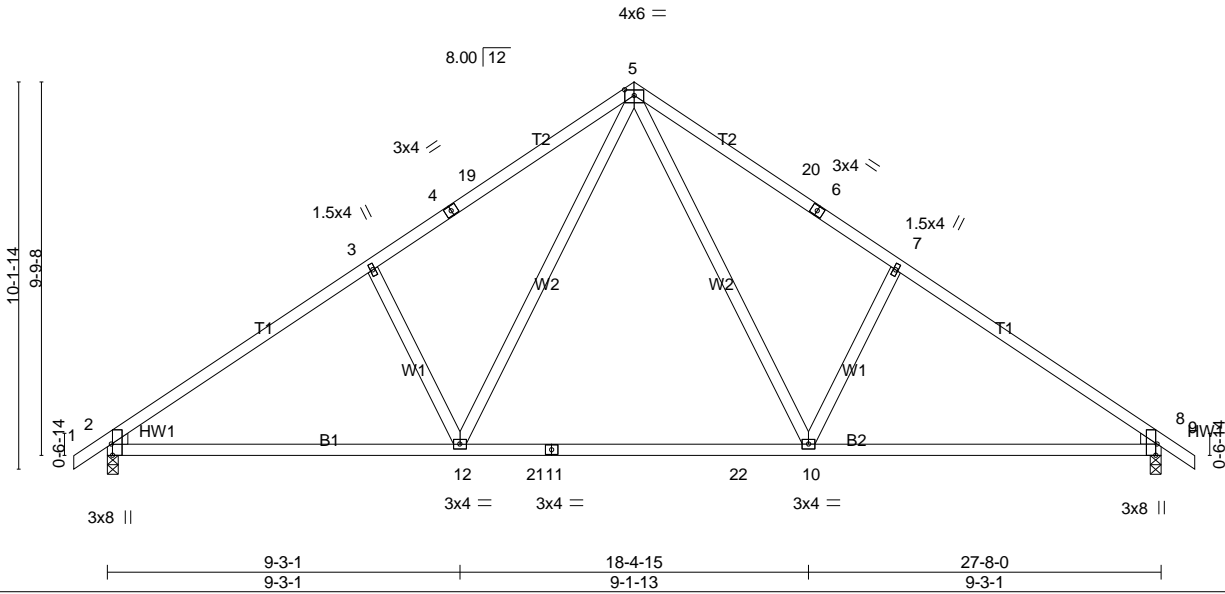


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [5:0-3-0,0-1-12], [8:0-3-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.64	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.68	Vert(LL) -0.25 10-12 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.31	Vert(CT) -0.36 10-12 >934 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.04 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 141 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 4-3-14 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1024/0-3-8 (min. 0-2-1), 8=1024/0-3-8 (min. 0-2-1)
 Max Horz 2=-253(LC 10)
 Max Uplift 2=-142(LC 12), 8=-142(LC 12)
 Max Grav 2=1320(LC 24), 8=1320(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1745/203, 3-4=-1626/236, 4-19=-1546/250, 5-19=-1518/277, 5-20=-1519/277,
 6-20=-1546/250, 6-7=-1626/236, 7-8=-1746/203
 BOT CHORD 2-12=-48/1554, 12-21=0/1005, 11-21=0/1005, 11-22=0/1005, 10-22=0/1005,
 8-10=-48/1381
 WEBS 5-10=-88/840, 7-10=-420/207, 5-12=-88/840, 3-12=-420/207

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=28ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=142, 8=142.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T02GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	----------------	--------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:39 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-CRnRXzwnngEJAS9eLVlloJ3M1o?DXZl5Ge_zuuzyoK6

-0-10-8 0-10-8	15-0-0 15-0-0	30-0-0 15-0-0	30-10-8 0-10-8
-------------------	------------------	------------------	-------------------

Scale = 1:65.4

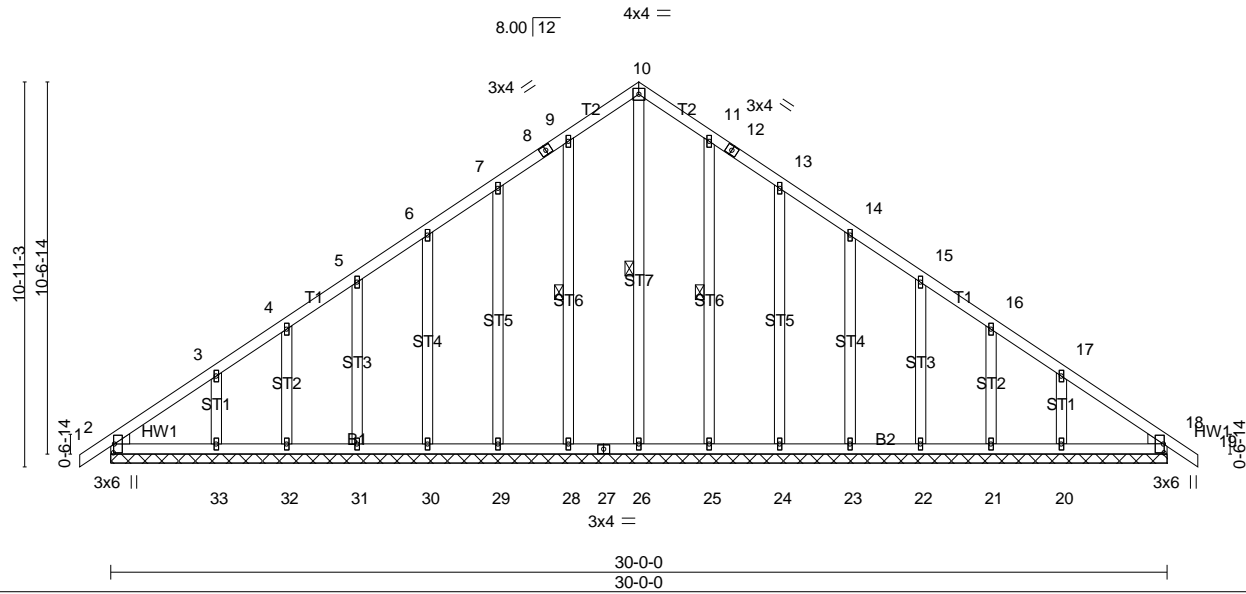


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [18:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	19	n/r	120	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	0.00	19	n/r	120		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	18	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-S								
BCDL	10.0										Weight: 214 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 10-26, 9-28, 11-25

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 30-0-0.
(lb) - Max Horz 2=278(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20
Max Grav All reactions 250 lb or less at joint(s) 2, 26, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21, 18 except 33=263(LC 24), 20=258(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=30ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T03	Truss Type Common	Qty 4	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:41 2024 Page 1
ID: DtfAk8NRn2VuAb4Ep4AV?ezyoXj-9qvCyex2BHU1PmJ0SwLDuk8f6cYO?SnNkyT4zmzyoK4

0-10-8	4-10-14	9-8-8	14-6-2	19-5-0	20-3-8
0-10-8	4-10-14	4-9-10	4-9-10	4-10-14	0-10-8

4x4 =

Scale = 1:43.3

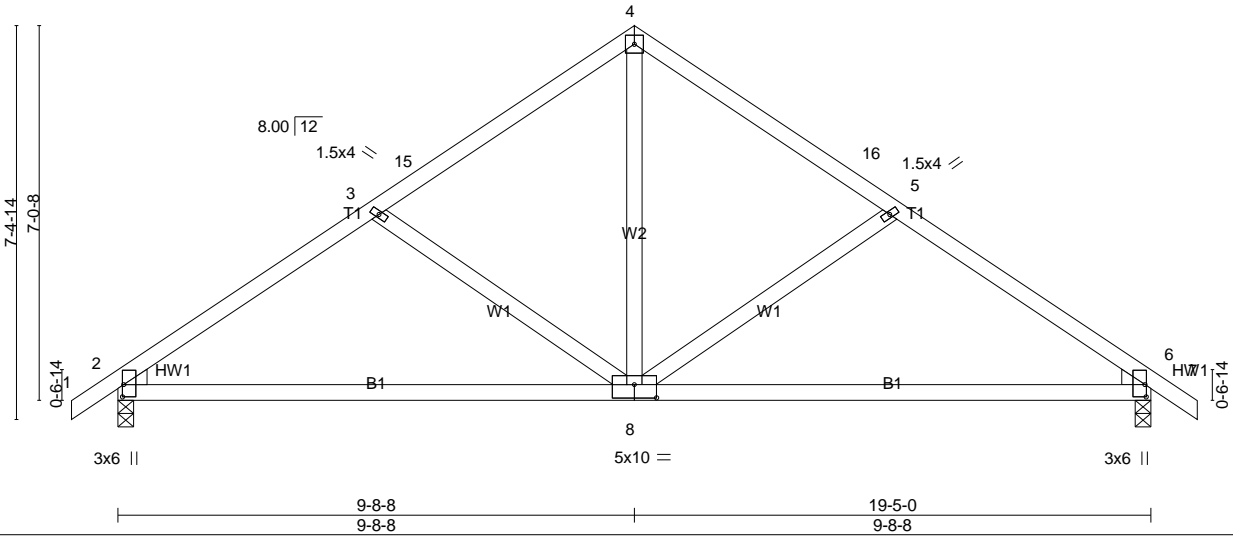


Plate Offsets (X,Y)-- [2:0-2-12,0-0-4], [6:0-2-12,0-0-4], [8:0-5-0,0-3-0]

LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	-0.11	8-11	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.22	8-11	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.02	6	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MS								
BCDL	10.0										Weight: 95 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=732/0-3-8 (min. 0-1-8), 6=732/0-3-8 (min. 0-1-8)
 Max Horz 2=-177(LC 10)
 Max Uplift 2=-109(LC 12), 6=-109(LC 12)
 Max Grav 2=829(LC 2), 6=829(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1029/156, 3-15=-799/108, 4-15=-710/138, 4-16=-710/138, 5-16=-799/108,
 5-6=-1029/156
 BOT CHORD 2-8=-31/852, 6-8=-31/822
 WEBS 4-8=-41/557, 5-8=-317/139, 3-8=-317/139

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=109, 6=109.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Job P23120611	Truss T03GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	----------------	--------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:42 2024 Page 1
ID:DfAk8NRn2VuAb4Ep4AV?ezyoXj-d0SaA_ygybcu1vuD0dsSQyhtc00PkvIXycCdVDzYoK3

0-10-8 0-10-8	13-10-0 13-10-0	27-8-0 13-10-0	28-6-8 0-10-8
------------------	--------------------	-------------------	------------------

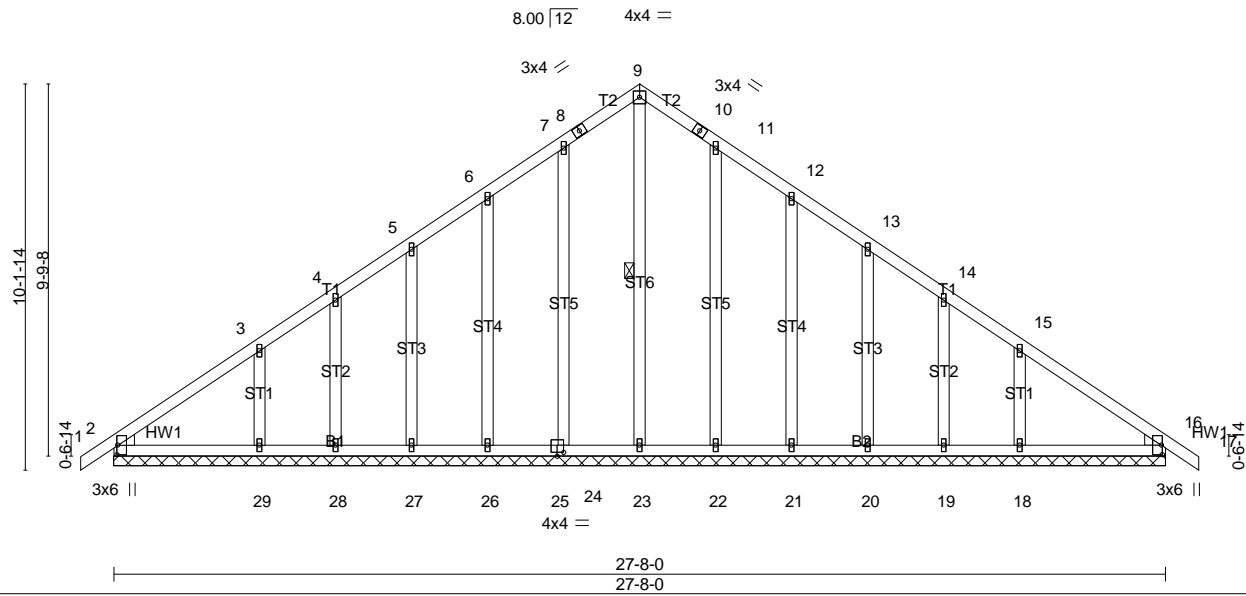

Scale = 1:60.6

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [16:0-3-0,0-0-4], [25:0-2-0,0-1-4]

LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	0.00	17	n/r	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	Vert(CT)	0.01	17	n/r		
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.01	16	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-S						
BCDL	10.0								Weight: 187 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 9-23

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 27-8-0.
(lb) - Max Horz 2--253(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 24, 26, 27, 28, 29, 22, 21, 20, 19, 18
Max Grav All reactions 250 lb or less at joint(s) 2, 23, 24, 26, 27, 28, 22, 21, 20, 19, 16 except 29=331(LC 24), 18=328(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=28ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 24, 26, 27, 28, 29, 22, 21, 20, 19, 18.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T04	Truss Type Common	Qty 4	Ply 1	BERUBE
------------------	--------------	----------------------	----------	----------	--------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:44 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-ZPaKag_wUCsbGD2b72uwVNmAMpa4CpTqQwhkZ5zyoK1

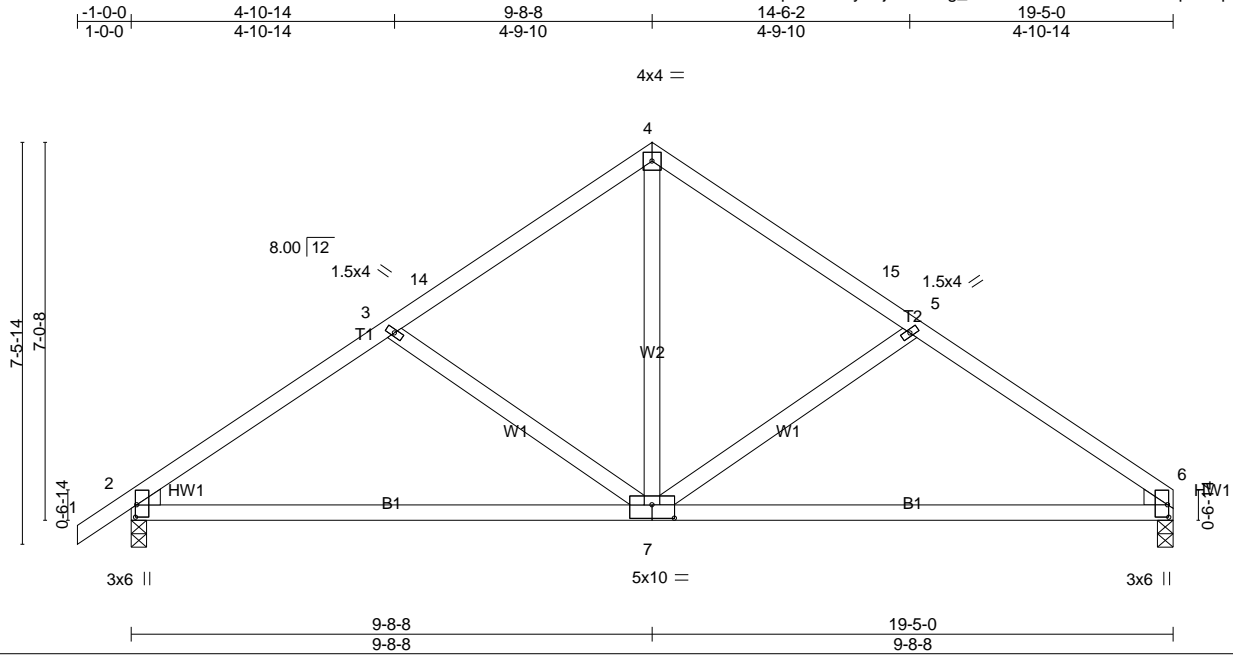

Scale = 1:42.9

Plate Offsets (X,Y)-- [2:0-2-12,0-0-4], [6:0-2-12,0-0-4], [7:0-5-0,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.29	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.58	Vert(LL) -0.11 7-13 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.22	Vert(CT) -0.23 7-13 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.02 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 94 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=739/0-3-8 (min. 0-1-8), 6=686/0-3-8 (min. 0-1-8)
 Max Horz 2=174(LC 11)
 Max Uplift 2=-115(LC 12), 6=-76(LC 12)
 Max Grav 2=838(LC 2), 6=775(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1044/156, 3-14=-801/109, 4-14=-711/139, 4-15=-711/139, 5-15=-801/110,
 5-6=-1032/158
 BOT CHORD 2-7=-59/844, 6-7=-63/826
 WEBS 4-7=-42/557, 5-7=-321/142, 3-7=-315/138

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 2=115.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T04GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	----------------	--------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:45 2024 Page 1
ID: DtfAk8NRn2VuAb4Ep4AV?ezyoXj-1b8jo0_YFW_SuNcohmP92aJO_D1CxlQzeaRH6YzyoK0



4x4 =

Scale = 1:44.2

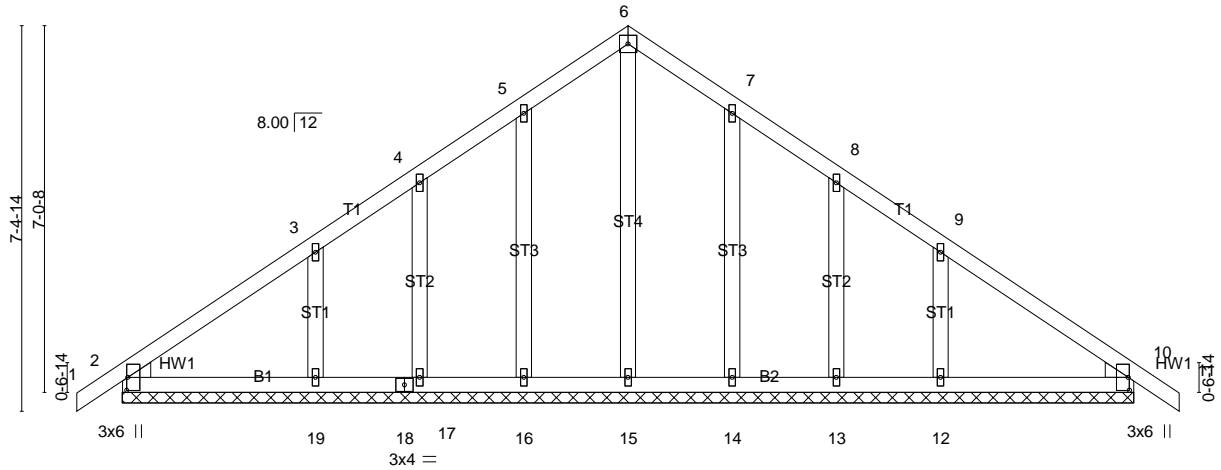


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [10:0-3-0,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.11	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.07	Vert(LL) 0.00 11 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.11	Vert(CT) 0.01 11 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 10 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 112 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 19-5-0.
 (lb) - Max Horz 2=177(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 16, 17, 19, 14, 13, 12, 10
 Max Grav All reactions 250 lb or less at joint(s) 2, 15, 16, 17, 14, 13, 10 except 19=315(LC 24), 12=312(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 16, 17, 19, 14, 13, 12, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T05	Truss Type Common	Qty 2	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:46 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-Vni5?M?AOp6JWXB_FTxOborS0dJqglY6tEARe_zyoK?

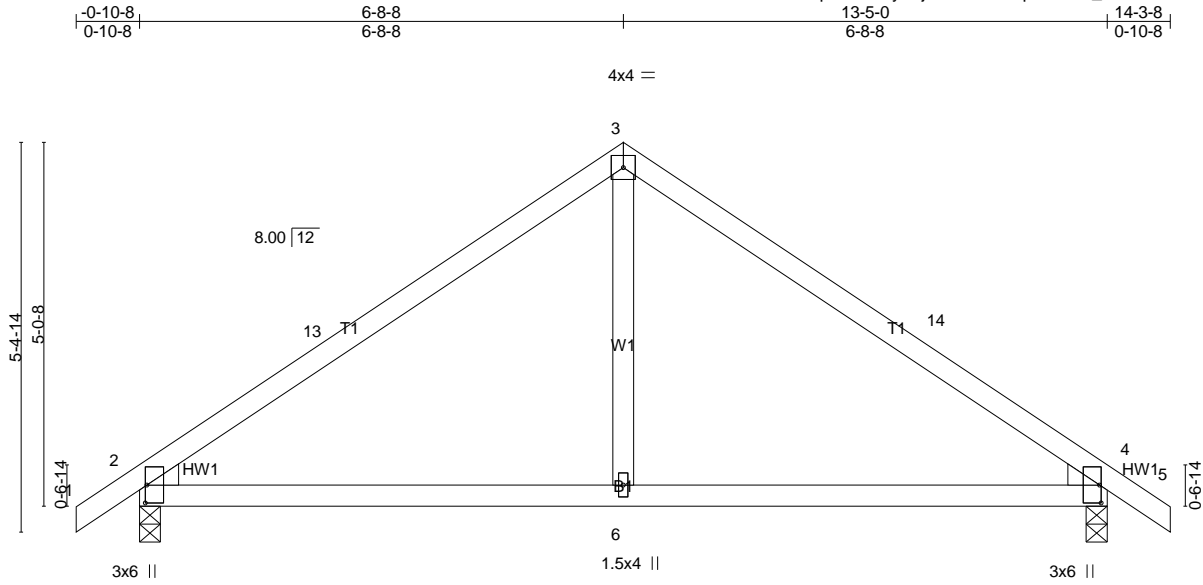

Scale: 3/8"=1'

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-3-0,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.37	Vert(LL) -0.06 6-12 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.12	Vert(CT) -0.11 6-12 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.02 2 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 55 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=519/0-3-8 (min. 0-1-8), 4=519/0-3-8 (min. 0-1-8)
 Max Horz 2=-127(LC 10)
 Max Uplift 2=-85(LC 12), 4=-85(LC 12)
 Max Grav 2=589(LC 2), 4=589(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-13=-626/66, 3-13=-526/93, 3-14=-526/93, 4-14=-626/66
 BOT CHORD 2-6=0/438, 4-6=0/438
 WEBS 3-6=0/305

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T05GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE
					Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:47 2024 Page 1
ID: DtfAk8NRn2VuAb4Ep4AV?ezyoXj-z_GTDi0pn7EA7hmApBSd7?OIK1kDPDrG6uwOAZyoK_

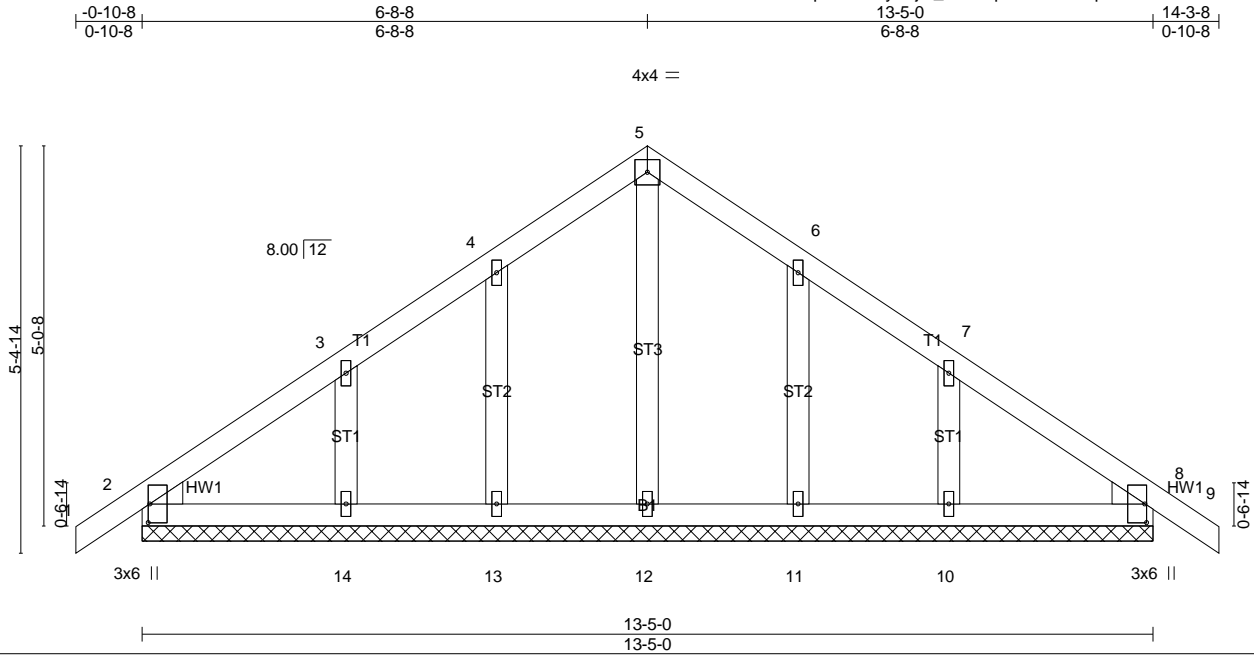

Scale = 1:30.6

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [8:0-3-0,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.05	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.04	Vert(LL) 0.00 8 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.05	Vert(CT) 0.00 9 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 70 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 13-5-0.
 (lb) - Max Horz 2=-127(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
 Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T06	Truss Type Common	Qty 3	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:48 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-RAqrQ11RYRM1lqLNMuzsgDxoPR_18f2PLYfhszyoZJ

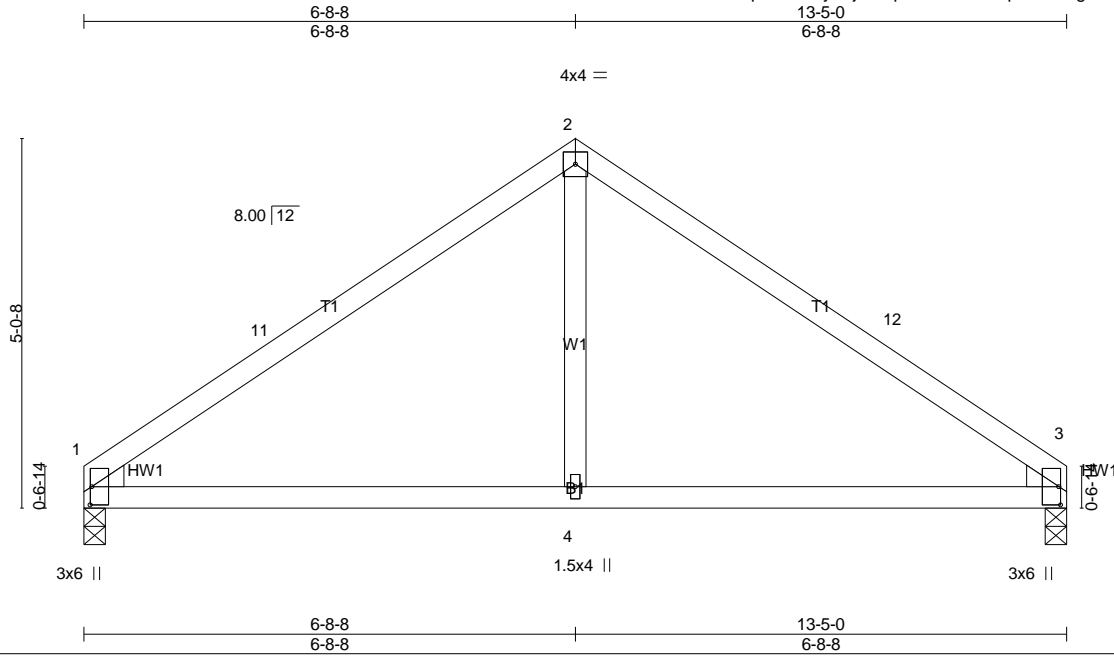

Scale = 1:31.5

Plate Offsets (X,Y)-- [1:0-3-0,0-0-4], [3:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.07 4-10	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.11 4-10	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.02 1	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MS						Weight: 52 lb	FT = 20%
BCDL	10.0										

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6'-0" oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=475/0-3-8 (min. 0-1-8), 3=475/0-3-8 (min. 0-1-8)
 Max Horz 1=112(LC 11)
 Max Uplift1=-53(LC 12), 3=-53(LC 12)
 Max Grav 1=537(LC 2), 3=537(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-634/71, 2-11=-534/97, 2-12=-534/97, 3-12=-634/71
 BOT CHORD 1-4=0/445, 3-4=0/445
 WEBS 2-4=0/307

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCdL=6.0psf; BCdL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T06GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	----------------	--------------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:50 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-OZxcrj2h42cl_8VlUJ?Kle0DRElzcZnior82mlzyoJx



Scale = 1:20.3

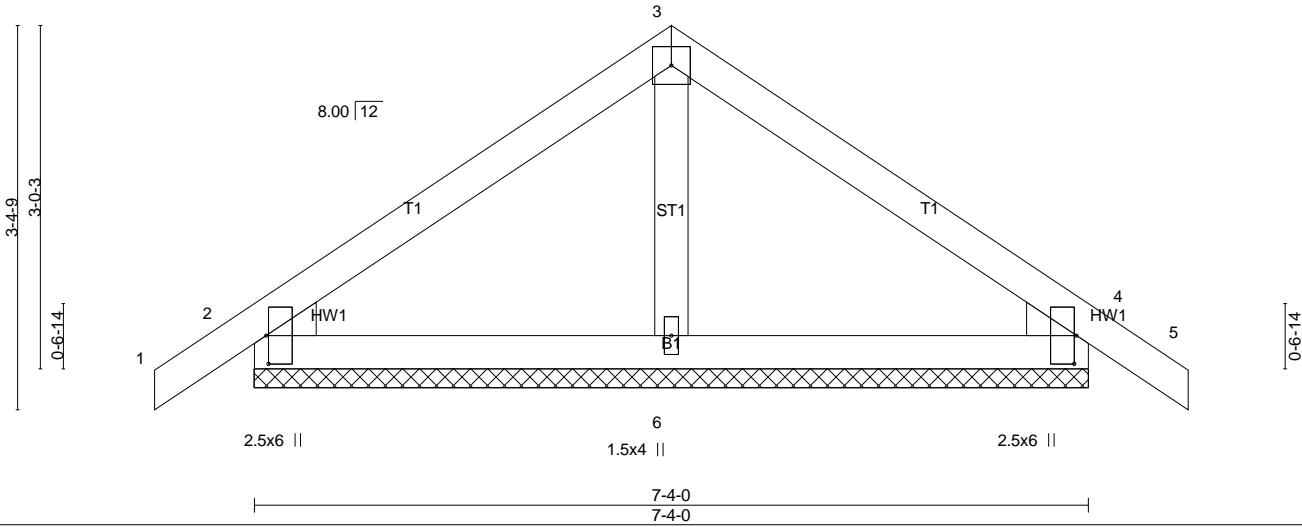


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	0.01	5	n/r	120	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	Vert(CT)	0.02	5	n/r	120		
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-P						Weight: 33 lb	FT = 20%
BCDL	10.0										

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=192/7-4-0 (min. 0-1-8), 4=192/7-4-0 (min. 0-1-8), 6=225/7-4-0 (min. 0-1-8)
Max Horz 2=-76(LC 10)
Max Uplift 2=-75(LC 12), 4=-75(LC 12)
Max Grav 2=252(LC 17), 4=252(LC 18), 6=249(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T07	Truss Type Common	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:51 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-sIV_233JrMlcl4x10WZHRYPhe4YL0fs1VuclBzyoJw



4x4 =

Scale = 1:21.0

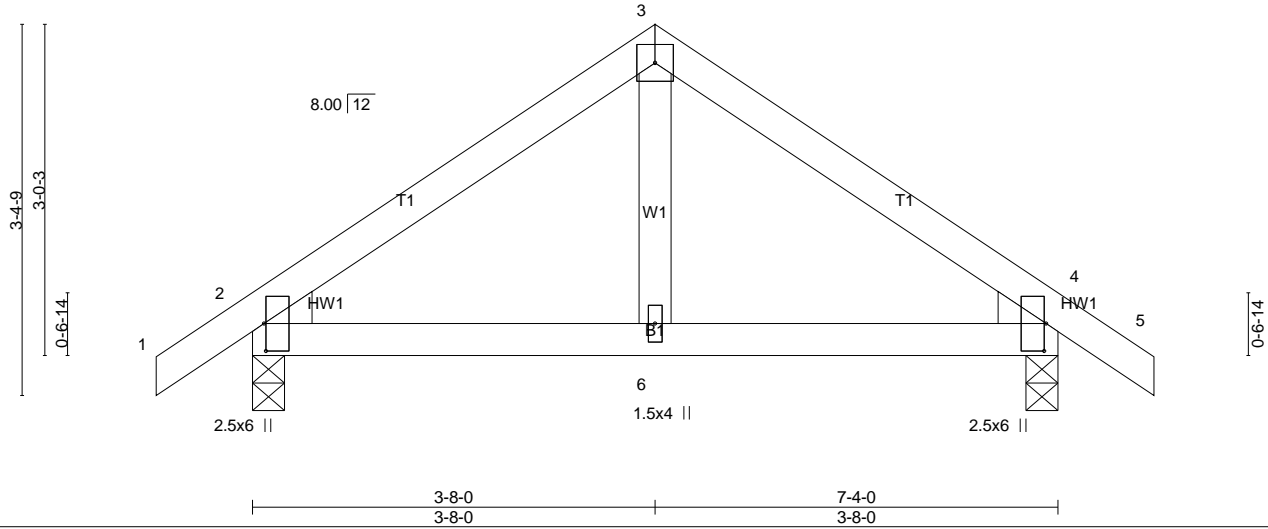


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	-0.01	6-9	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.14	Vert(CT)	-0.01	6-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MP							Weight: 33 lb	FT = 20%
BCDL	10.0											

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=304/0-3-8 (min. 0-1-8), 4=304/0-3-8 (min. 0-1-8)
 Max Horz 2=-76(LC 10)
 Max Uplift 2=61(LC 12), 4=-61(LC 12)
 Max Grav 2=373(LC 17), 4=373(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-319/44, 3-4=-319/44

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T07GE	Truss Type Common Supported Gable	Qty 1	Ply 1	BERUBE
					Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:52 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Kx3MGP4xctfTESf8bk1oq35XL2Q_4RP?F9d9qezyoJV

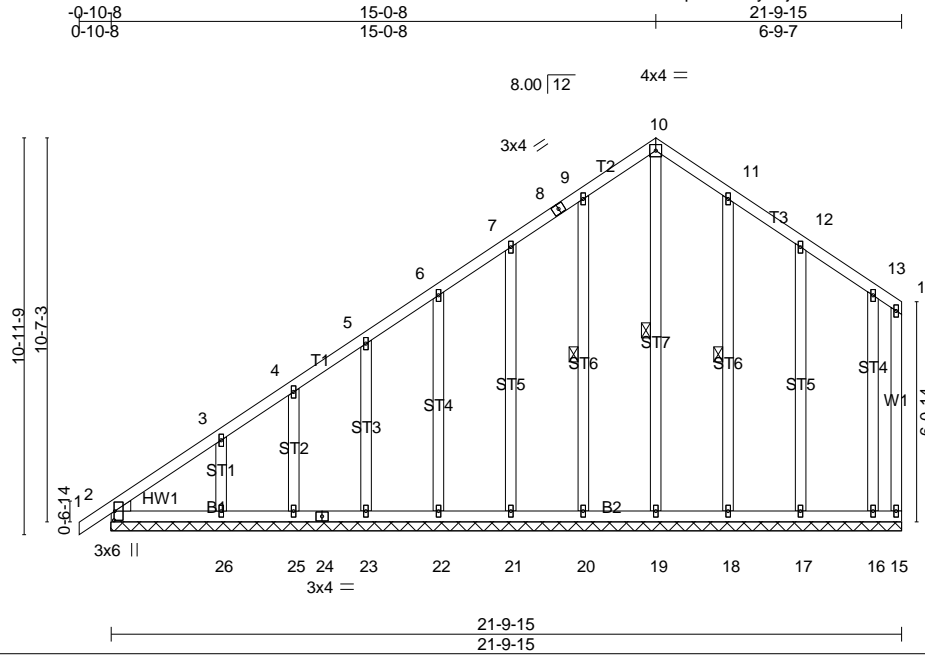

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.29	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.06	Vert(LL) -0.00 1 n/r 120		
TCDL 10.0	Lumber DOL 1.15	WB 0.16	Vert(CT) 0.00 1 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-S	Horz(CT) -0.00 15 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 178 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 10-19, 9-20, 11-18

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS.

All bearings 21-9-15.
 (lb) - Max Horz 2=352(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 15, 2, 19, 20, 21, 22, 23, 25, 26, 18, 17, 16
 Max Grav All reactions 250 lb or less at joint(s) 15, 19, 20, 21, 22, 23, 25, 18, 17, 16 except 2=255(LC 25), 26=266(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-321/271, 3-4=-285/216, 4-5=-265/200

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 2, 19, 20, 21, 22, 23, 25, 26, 18, 17, 16.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T08	Truss Type Common	Qty 5	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:54 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-GKB6h55C7H7BTlpWj94GvJAl2r0KYIEIjT6GvWzYoJt

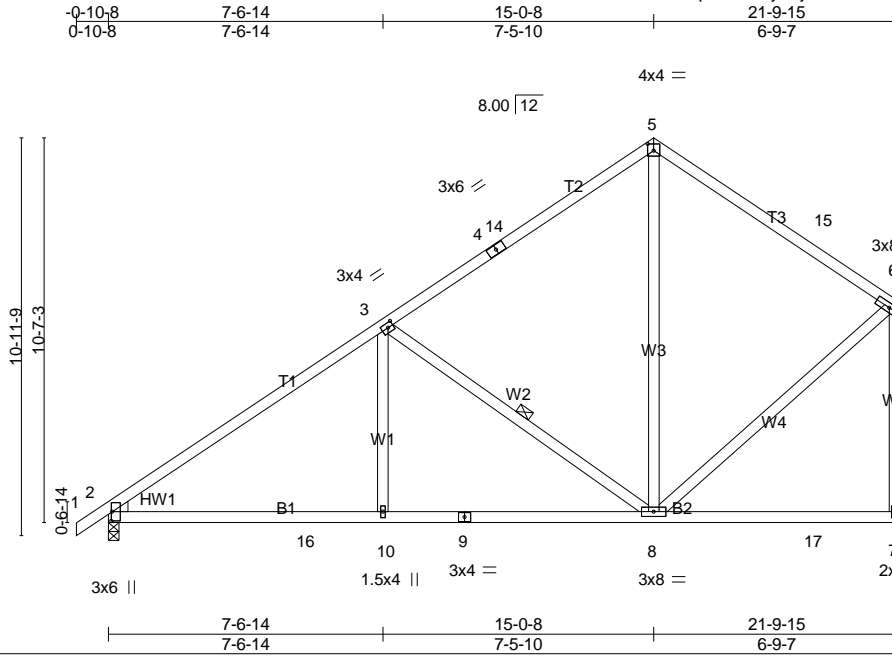

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [3:0-1-12,0-1-8], [5:0-2-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.79	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.46	Vert(LL) -0.08 10-13 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.33	Vert(CT) -0.15 10-13 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.02 7 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 131 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 5-1-5 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 3-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=813/0-3-8 (min. 0-1-10), 7=767/Mechanical
 Max Horz 2=353(LC 11)
 Max Uplift 2=-114(LC 12), 7=-90(LC 12)
 Max Grav 2=1047(LC 24), 7=1015(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1288/145, 3-4=-705/130, 4-14=-610/148, 5-14=-595/175, 5-15=-580/174,
 6-15=-662/147, 6-7=-886/126
 BOT CHORD 2-16=-144/1158, 10-16=-144/1158, 9-10=-144/1158, 8-9=-144/1158
 WEBS 3-10=0/347, 3-8=-764/176, 5-8=-34/302, 6-8=-27/667

NOTES-


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 2=114.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T09	Common	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:55 2024 Page 1
ID:DttAk8NRn2VuAb4Ep4AV?ezyoXj-kWIVuR6quaF25vNjGsbVShj0nFN?HnvRy7spRzyoJs



4x4 =

Scale: 1/4"=1'

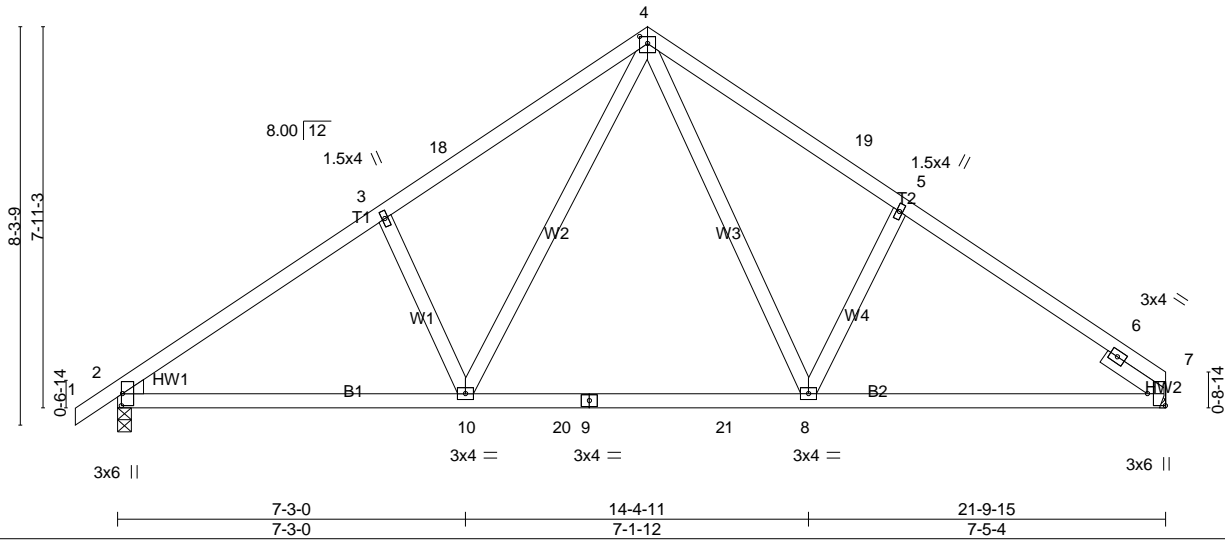


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-2-0,0-1-12], [7:Edge,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.41	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.10 8-10 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.24	Vert(CT) -0.16 8-10 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.03 7 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 113 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3
SLIDER Right 2x4 SP No.3 1-6-0

BRACING-

TOP CHORD Sheathed or 5-3-12 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 7=772/Mechanical, 2=818/0-3-8 (min. 0-1-10)
Max Horz 2=192(LC 11)
Max Uplift 7=-86(LC 12), 2=-119(LC 12)
Max Grav 7=989(LC 25), 2=1042(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1340/158, 3-18=-1257/190, 4-18=-1173/223, 4-19=-1112/216, 5-19=-1192/184,
5-6=-1275/158, 6-7=-552/0
BOT CHORD 2-10=-63/1184, 10-20=0/764, 9-20=0/764, 9-21=0/764, 8-21=0/764, 7-8=-58/1003
WEBS 3-10=-323/165, 4-10=-75/649, 4-8=-65/594, 5-8=-292/159

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 2=119.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job P23120611	Truss T10	Truss Type Piggyback Base	Qty 19	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	------------------------------	-----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:57 2024 Page 1
ID: DtfAk8NRn2VuAb4Ep4AV?ezyoXj-hvtFJ684QCVIKDX5OHdzX6oDZ31slWKKPRLwWrzyoJq

-0-10-8	7-10-8	15-7-11	21-0-8	26-5-5	34-2-8	42-1-0	42-11-8
0-10-8	7-10-8	7-9-4	5-4-13	5-4-13	7-9-4	7-10-8	0-10-8

Scale = 1:83.3

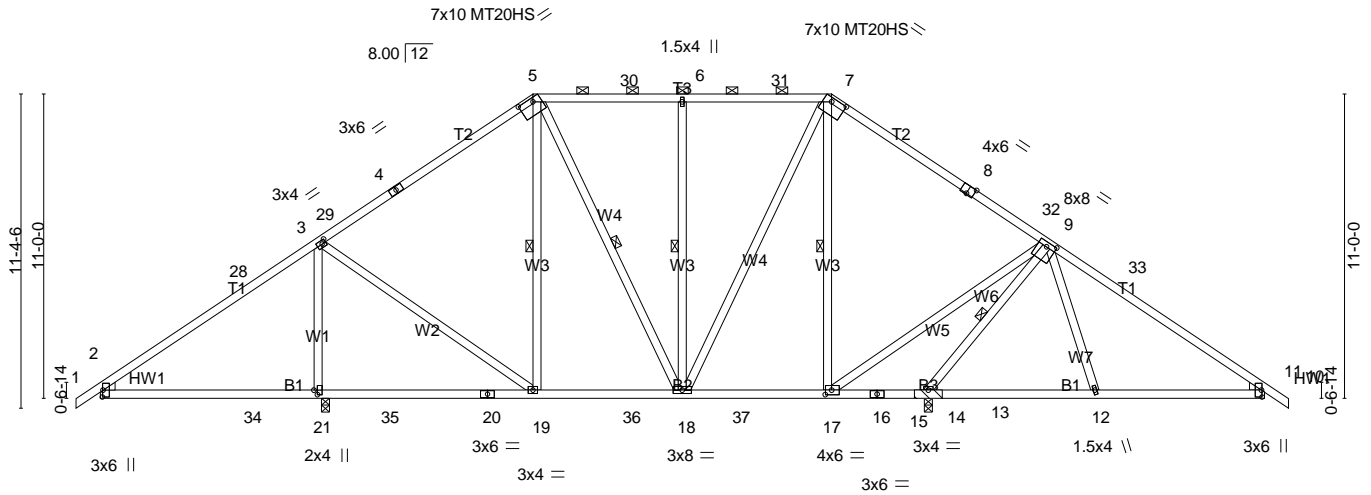

8-0-0	8-1-12	15-7-11	21-0-8	26-5-5	29-11-4 30-1-0	35-11-8	42-1-0
8-0-0	0-1-12	7-5-15	5-4-13	5-4-13	3-5-15 0-1-12	5-10-8	6-1-8

Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [3:0-1-12,0-1-8], [5:0-6-8,0-1-12], [7:0-6-8,0-1-12], [8:0-3-0,Edge], [9:0-4-0,0-2-0], [10:0-3-0,0-0-4], [17:0-2-12,0-2-0], [21:0-2-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.96	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.53	Vert(LL) -0.07 17-18 >999 240	MT20HS	187/143
TCDL 10.0	Lumber DOL 1.15	WB 0.94	Vert(CT) -0.13 17-18 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.02 14 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 275 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3, Right: 2x4 SP No.3

BRACING-
TOP CHORD Sheathed or 2-2-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-7.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 4-0-3 oc bracing: 14-17.
WEBS 1 Row at midpt 5-19, 5-18, 6-18, 7-17, 9-14

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 21=1270/0-3-8 (min. 0-2-11), 14=1906/(0-3-8 + bearing block) (req. 0-3-12)
Max Horz 21=-304(LC 10)
Max Uplift 21=-372(LC 12), 14=-206(LC 12)
Max Grav 21=1715(LC 49), 14=2398(LC 47)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-28=-234/518, 3-28=-194/656, 3-29=-410/11, 4-29=-399/16, 4-5=-343/156, 5-30=-308/121, 6-30=-308/121, 6-31=-308/121, 7-31=-308/121, 7-8=-93/600, 8-32=-119/343, 9-32=-124/252, 9-33=-57/612, 10-33=-100/464
BOT CHORD 2-34=-438/280, 21-34=-438/280, 21-35=-583/280, 20-35=-583/280, 19-20=-583/280, 19-36=-134/406, 18-36=-134/406, 18-37=-392/262, 17-37=-392/262, 16-17=-2228/376, 15-16=-2228/376, 14-15=-2228/376, 13-14=-470/155, 12-13=-470/155, 10-12=-410/171
WEBS 3-21=-1329/345, 3-19=-26/718, 5-19=-276/122, 5-18=-322/83, 6-18=-577/98, 7-18=-62/813, 7-17=-1161/132, 9-17=-140/2308, 9-14=-2844/347, 9-12=-91/298

- NOTES-**
- 2x4 SP No.1 bearing block 12" long at jt. 14 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. User Defined Bearing crushing capacity= 425psi.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=42ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T10	Piggyback Base	19	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:57 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-hvtFJ684QCVIKDX5OHdzX6oDZ31siWKKPRLwWrzyoJq


- NOTES-**
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=372, 14=206.
 - 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job P23120611	Truss T11	Truss Type Piggyback Base	Qty 1	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	------------------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:59 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-dH_?ko9KypITZXhUVifRcXuaAskrDQQ1slq1akzyoJo

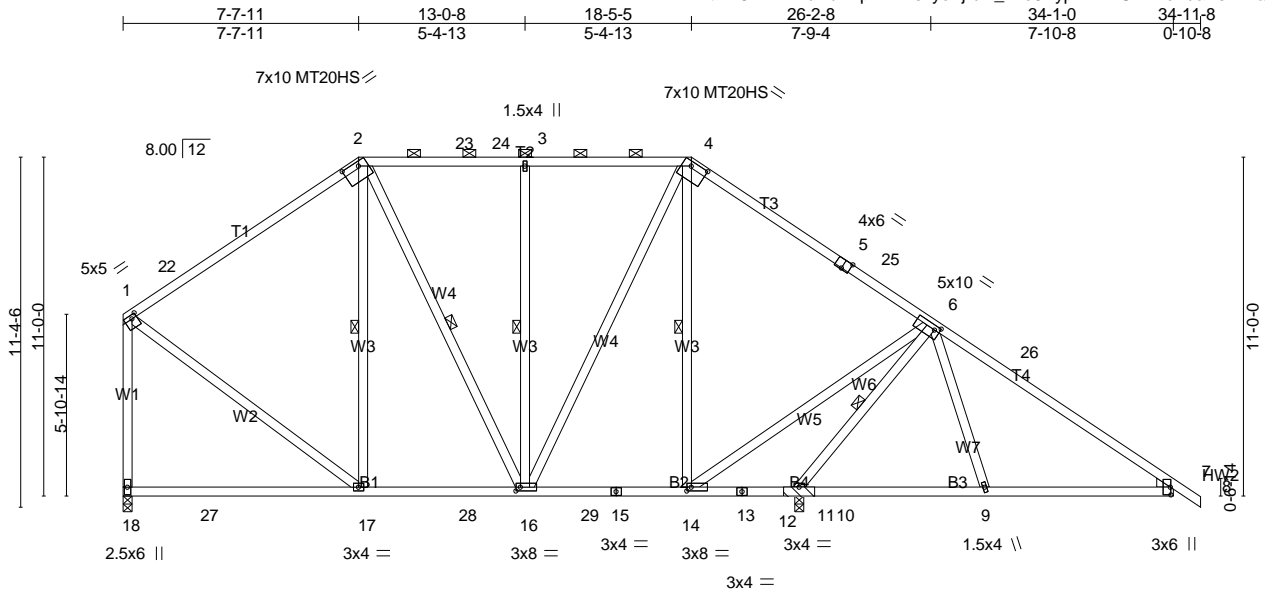

Scale = 1:74.7

7-7-11	13-0-8	18-5-5	21-11-4	22-1-0	27-11-8	34-1-0
7-7-11	5-4-13	5-4-13	3-5-15	0-1-12	5-10-8	6-1-8

Plate Offsets (X, Y)-- [1:0-2-0,0-1-8], [2:0-6-8,0-1-12], [4:0-6-8,0-1-12], [5:0-3-0,Edge], [6:0-2-0,0-1-12], [7:0-3-0,0-0-4], [14:0-1-12,0-1-8], [16:0-1-12,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.96	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.11 17-18 >999 240	MT20HS	187/143
TCDL 10.0	Lumber DOL 1.15	WB 0.91	Vert(CT) -0.21 17-18 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.01 11 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 247 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 *Except* T1: 2x4 SP DSS	TOP CHORD Sheathed or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-4.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 3-11-0 oc bracing.
WEBS 2x4 SP No.3 *Except* W5,W1: 2x4 SP No.2	WEBS 1 Row at midpt 2-17, 2-16, 3-16, 4-14, 6-11
WEDGE Right: 2x4 SP No.3	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 18=539/0-3-8 (min. 0-1-8), 11=2016/(0-3-8 + bearing block) (req. 0-3-14)
Max Horz 18=370(LC 10)
Max Uplift 18=44(LC 12), 11=257(LC 12)
Max Grav 18=804(LC 49), 11=2487(LC 47)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-22=-544/89, 2-22=-538/139, 2-23=-373/154, 23-24=-373/154, 3-24=-373/154,
3-4=-373/154, 4-5=-92/555, 5-25=-103/298, 6-26=-57/612, 7-26=-100/464,
1-18=-651/87
BOT CHORD 18-27=-241/309, 17-27=-241/309, 17-28=-70/532, 16-28=-70/532, 16-29=-350/245,
15-29=-350/245, 14-15=-350/245, 13-14=-2302/418, 12-13=-2302/418, 11-12=-2302/418,
10-11=-470/155, 9-10=-470/155, 7-9=-406/171
WEBS 2-16=-481/85, 3-16=-570/93, 4-16=-83/910, 4-14=-1239/171, 6-14=-211/2448,
6-11=-2960/413, 6-9=-91/297, 1-17=-43/492

- NOTES-**
- 2x4 SP No.1 bearing block 12" long at jt. 11 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. User Defined Bearing crushing capacity= 425psi.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - The Fabrication Tolerance at joint 2 = 8%
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T11	Piggyback Base	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:04:59 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-dH_?ko9KypITZXhUVifRcXuaAskrDQQ1slq1akzyoJo

NOTES-


- 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18 except (jt=lb) 11=257.
- 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job P23120611	Truss T12	Truss Type Piggyback Base	Qty 1	Ply 1	BERUBE
Job Reference (optional)					

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:00 2024 Page 1
ID:DfAk8NRn2VuAb4Ep4AV?ezyoXj-5UYNx8Aj7iKBgGg3PBg9lQlyG45y3A5PZa6AzyoJn



5x10 = 7x10 MT20HS

Scale = 1:74.7


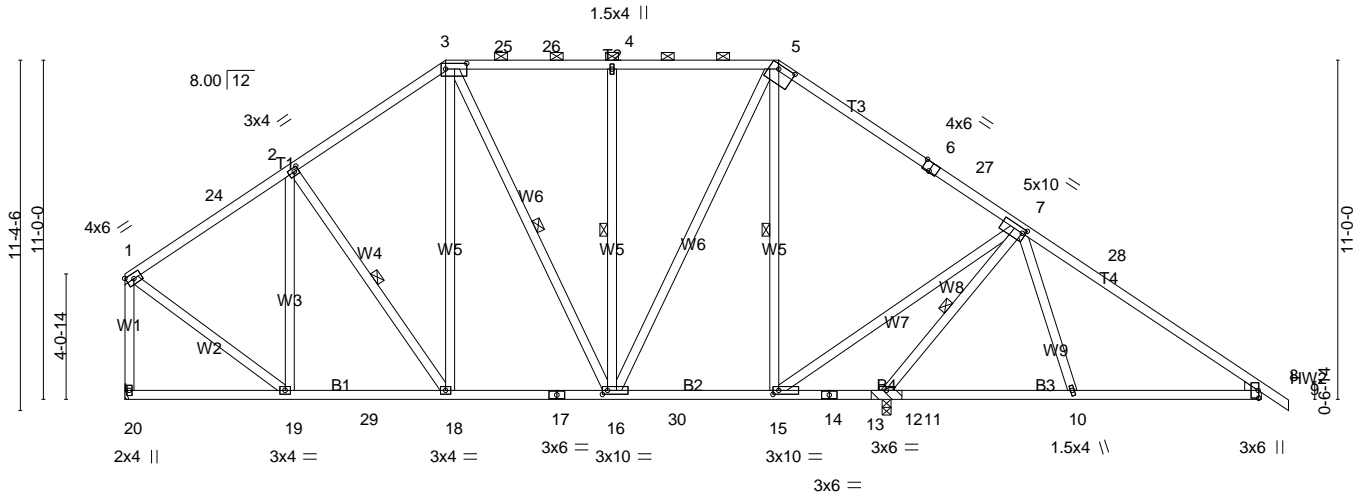


Plate Offsets (X,Y)-- [2:0-1-12,0-1-8], [3:0-8-4,0-2-4], [5:0-6-8,0-1-12], [6:0-3-0,Edge], [7:0-1-4,0-1-12], [8:0-3-0,0-0-4], [15:0-2-4,0-1-8], [16:0-2-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.95	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.08 15-16 >999 240	MT20HS	187/143
TCDL 10.0	Lumber DOL 1.15	WB 0.95	Vert(CT) -0.14 15-16 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.01 12 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014				Weight: 272 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3 *Except*
 W7,W1: 2x4 SP No.2
 WEDGE
 Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
 BOT CHORD Rigid ceiling directly applied or 3-10-0 oc bracing.
 WEBS 1 Row at midpt 2-18, 3-16, 4-16, 5-15, 7-12

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 20=662/Mechanical, 12=2088/(0-3-8 + bearing block) (req. 0-4-1)
 Max Horz 20=348(LC 10)
 Max Uplift 20=57(LC 12), 12=265(LC 12)
 Max Grav 20=1007(LC 43), 12=2597(LC 47)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-24=-776/100, 2-24=-647/119, 2-3=-682/178, 3-25=-465/161, 25-26=-465/161,
 4-26=-465/161, 4-5=-465/161, 5-6=-101/521, 6-27=-113/274, 7-28=-57/613,
 8-28=-100/464, 1-20=-930/86
 BOT CHORD 19-20=-259/304, 19-29=-43/729, 18-29=-43/729, 17-18=-28/650, 16-17=-28/650,
 16-30=-321/243, 15-30=-321/243, 14-15=-2387/425, 13-14=-2387/425, 12-13=-2387/425,
 11-12=-470/155, 10-11=-470/155, 8-10=-408/171
 WEBS 2-18=-345/124, 3-18=-40/499, 3-16=-539/72, 4-16=-581/106, 5-16=-93/1035,
 5-15=-1321/175, 7-15=-223/2579, 7-12=-3095/424, 7-10=-91/296, 1-19=0/659

NOTES-

- 2x4 SP No.1 bearing block 12" long at jt. 12 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. User Defined Bearing crushing capacity= 425psi.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=37ft; eave=5ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T12	Piggyback Base	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:01 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-Zg6m9UBbUQ?Bpqrsd7ivhyzwhgQKhKJKK3J8fczoJm


- NOTES-**
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 20 except (jt=lb) 12=265.
 - 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job P23120611	Truss T13	Truss Type Common	Qty 6	Ply 1	BERUBE
					Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:02 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-1sg8MqCDFk72Q_Q3BqD8EAW8o4gEQwOTZj2hB2zyoJl



Scale = 1:66.2

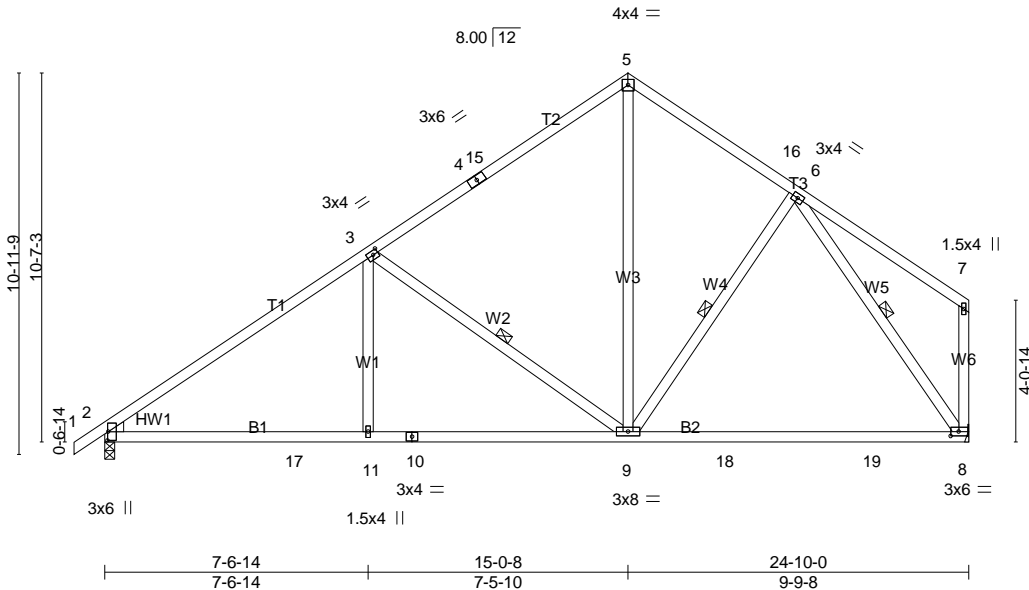


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [3:0-1-12,0-1-8], [8:0-2-12,0-1-8]

LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.37	8-9	>806	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.58	8-9	>511	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.38	Horz(CT)	0.03	8	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MS								
BCDL	10.0											Weight: 149 lb FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-
TOP CHORD Sheathed or 4-8-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-9, 6-9, 6-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=919/0-3-8 (min. 0-1-14), 8=873/Mechanical
Max Horz 2=324(LC 11)
Max Uplift 2=-129(LC 12), 8=-99(LC 12)
Max Grav 2=1191(LC 24), 8=1131(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1525/173, 3-4=-955/166, 4-15=-860/168, 5-15=-840/195, 5-16=-804/212, 6-16=-902/183
BOT CHORD 2-17=-97/1360, 11-17=-97/1360, 10-11=-97/1360, 9-10=-97/1360, 9-18=-26/632, 18-19=-26/632, 8-19=-26/632
WEBS 3-11=0/302, 3-9=-731/186, 5-9=-94/636, 6-8=-1012/58

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 2=129.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T15	Truss Type Piggyback Base	Qty 1	Ply 1	BERUBE
Job Reference (optional)					

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:04 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-_FounWDtLnmgIZRIFcJbbQRtR0ug7m01XoGxzyoJj

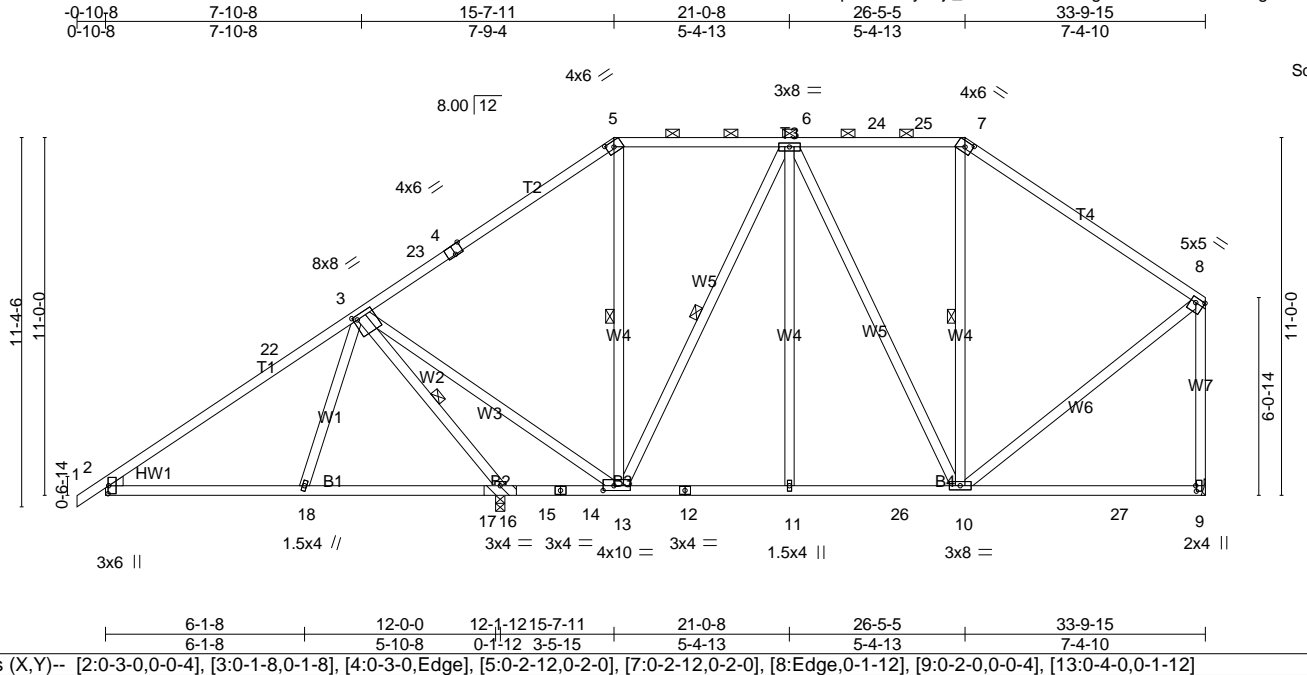

Scale = 1:70.9

Plate Offsets (X, Y)-- [2:0-3-0,0-0-4], [3:0-1-8,0-1-8], [4:0-3-0,Edge], [5:0-2-12,0-2-0], [7:0-2-12,0-2-0], [8:Edge,0-1-12], [9:0-2-0,0-0-4], [13:0-4-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.99	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.10 9-10 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 1.00	Vert(CT) -0.19 9-10 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.01 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 246 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-
 TOP CHORD Sheathed, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.
 BOT CHORD Rigid ceiling directly applied or 3-11-1 oc bracing.
 WEBS 1 Row at midpt 3-16, 5-13, 6-13, 7-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 16=2010/(0-3-8 + bearing block) (req. 0-3-14), 9=527/Mechanical
 Max Horz 16=372(LC 11)
 Max Uplift 16=-619(LC 12)
 Max Grav 16=2477(LC 49), 9=797(LC 46)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-22=-193/464, 3-22=-154/613, 4-23=-117/302, 4-5=-106/559, 5-6=-26/325,
 6-24=-423/117, 24-25=-423/117, 7-25=-423/117, 7-8=-529/73, 8-9=-649/20
 BOT CHORD 2-18=-406/248, 17-18=-470/282, 16-17=-470/282, 15-16=-2410/718, 14-15=-2410/718,
 13-14=-2410/718, 12-13=-128/434, 11-12=-128/434, 11-26=-128/434, 10-26=-128/434
 WEBS 3-18=-113/297, 3-16=-2938/769, 3-13=-474/2426, 5-13=-642/184, 6-13=-927/179,
 6-11=0/299, 6-10=-130/441, 7-10=-349/105, 8-10=-47/490

- NOTES-**
- 2x4 SP No.1 bearing block 12" long at jt. 16 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. User Defined Bearing crushing capacity= 425psi.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=619.

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T15	Piggyback Base	1	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:04 2024 Page 2
ID:DfAk8NRn2VuAb4Ep4AV?ezyoXj_FounWDTnLNmgIZRIFFcJbbQRtR0ug7m01XoGxzyoJj

NOTES-

- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job P23120611	Truss T16	Truss Type Piggyback Base	Qty 3	Ply 1	BERUBE
Job Reference (optional)					

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:05 2024 Page 1
ID: DfAk8NRn2VuAb4Ep4AV?ezyoXj-SRLG?sE5YfVdHS8eszmrso8bBHnFc7NvFhL0NzYoJi

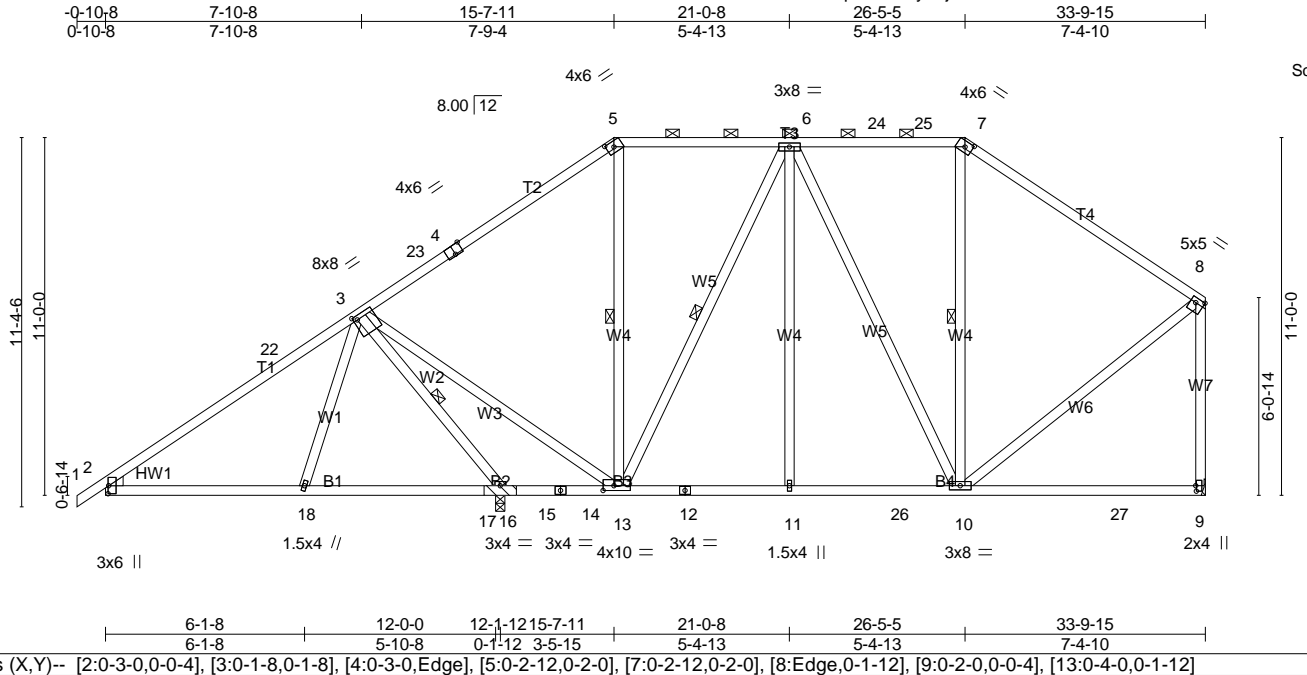


Plate Offsets (X, Y)-- [2:0-3-0,0-0-4], [3:0-1-8,0-1-8], [4:0-3-0,Edge], [5:0-2-12,0-2-0], [7:0-2-12,0-2-0], [8:Edge,0-1-12], [9:0-2-0,0-0-4], [13:0-4-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 20.0	2-0-0	TC 0.99	in (loc) l/defl L/d	MT20	244/190
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.10 9-10 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 1.00	Vert(CT) -0.19 9-10 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-MS	Horz(CT) -0.01 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 246 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.
 BOT CHORD Rigid ceiling directly applied or 3-11-1 oc bracing.
 WEBS 1 Row at midpt 3-16, 5-13, 6-13, 7-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 16=2010/(0-3-8 + bearing block) (req. 0-3-14), 9=527/Mechanical
 Max Horz 16=372(LC 11)
 Max Uplift 16=-619(LC 12)
 Max Grav 16=2477(LC 49), 9=797(LC 46)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-22=-193/464, 3-22=-154/613, 4-23=-117/302, 4-5=-106/559, 5-6=-26/325,
 6-24=-423/117, 24-25=-423/117, 7-25=-423/117, 7-8=-529/73, 8-9=-649/20
 BOT CHORD 2-18=-406/248, 17-18=-470/282, 16-17=-470/282, 15-16=-2410/718, 14-15=-2410/718,
 13-14=-2410/718, 12-13=-128/434, 11-12=-128/434, 11-26=-128/434, 10-26=-128/434
 WEBS 3-18=-113/297, 3-16=-2938/769, 3-13=-474/2426, 5-13=-642/184, 6-13=-927/179,
 6-11=0/299, 6-10=-130/441, 7-10=-349/105, 8-10=-47/490

NOTES-

- 2x4 SP No.1 bearing block 12" long at jt. 16 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. User Defined Bearing crushing capacity= 425psi.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=619.

Job	Truss	Truss Type	Qty	Ply	BERUBE
P23120611	T16	Piggyback Base	3	1	Job Reference (optional)

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:06 2024 Page 2
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-wevfCBFjJzdUvbjqQgH5O0gmxh7ULad3TL0vKqzyoJh

NOTES-


- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

Job P23120611	Truss T17	Truss Type Common	Qty 4	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:05:07 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-OqT1PXFL4GmLXll0zOpKxDD905ZX4FvCi?mSsGzyoJg



4x4 =

Scale = 1:16.9

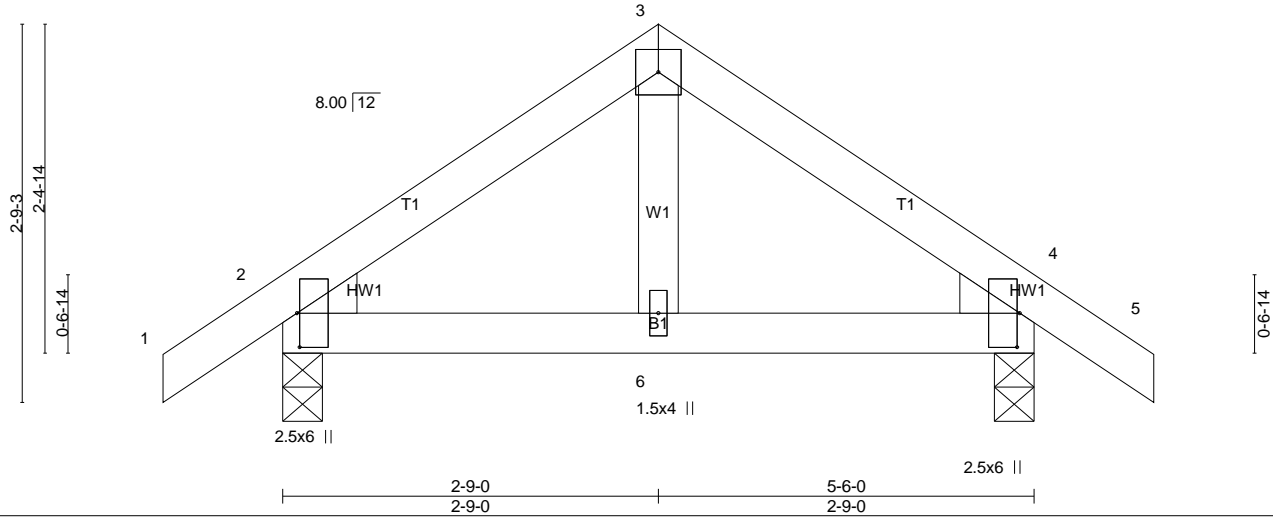


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	-0.00	9	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.00	6-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MP								
BCDL	10.0										Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 5-6-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=239/0-3-8 (min. 0-1-8), 4=239/0-3-8 (min. 0-1-8)
 Max Horz 2=-61(LC 10)
 Max Uplift 2=-54(LC 12), 4=-54(LC 12)
 Max Grav 2=311(LC 17), 4=311(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

Job P23120611	Truss T17	Truss Type Common	Qty 4	Ply 1	BERUBE Job Reference (optional)
------------------	--------------	----------------------	----------	----------	------------------------------------

Longleaf Truss Company, West End, N.C.

Run: 8.630 s Feb 9 2023 Print: 8.630 s Feb 9 2023 MiTek Industries, Inc. Thu Jan 4 09:11:26 2024 Page 1
ID:DtfAk8NRn2VuAb4Ep4AV?ezyoXj-oktJy7r4pjWZV?msgU6Co8PwMtwBOgj?sS30gozyoDI



4x4 =

Scale = 1:16.9

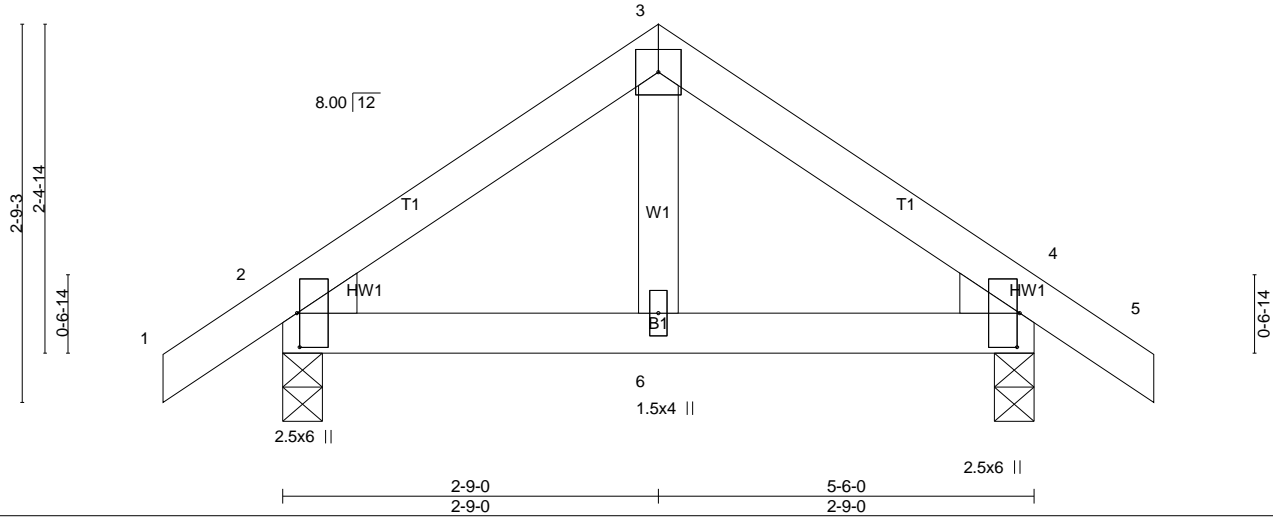


Plate Offsets (X,Y)-- [2:0-3-0,0-0-4], [4:0-3-0,0-0-4]

LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	-0.00	9	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.00	6-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0 *	Code IRC2018/TPI2014		Matrix-MP								
BCDL	10.0										Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Sheathed or 5-6-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=239/0-3-8 (min. 0-1-8), 4=239/0-3-8 (min. 0-1-8)
 Max Horz 2=-61(LC 10)
 Max Uplift 2=-54(LC 12), 4=-54(LC 12)
 Max Grav 2=311(LC 17), 4=311(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=150mph (3-second gust) Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=12ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard