

RE: J0923-5138  
 Precision/63 Liberty Meadows/Harnett

**Trenco**  
 818 Soundside Rd  
 Edenton, NC 27932

**Site Information:**

Customer: Project Name: J0923-5138  
 Lot/Block: Model:  
 Address: Subdivision:  
 City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.4  
 Wind Code: ASCE 7-10 Wind Speed: 130 mph  
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 36 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal#     | Truss Name | Date      | No. | Seal#     | Truss Name | Date      |
|-----|-----------|------------|-----------|-----|-----------|------------|-----------|
| 1   | I57341282 | A1         | 3/23/2023 | 21  | I57341302 | P3         | 3/23/2023 |
| 2   | I57341283 | A2         | 3/23/2023 | 22  | I57341303 | XA1        | 3/23/2023 |
| 3   | I57341284 | A3         | 3/23/2023 | 23  | I57341304 | XB1        | 3/23/2023 |
| 4   | I57341285 | A4         | 3/23/2023 | 24  | I57341305 | XB2        | 3/23/2023 |
| 5   | I57341286 | A5         | 3/23/2023 | 25  | I57341306 | YA1        | 3/23/2023 |
| 6   | I57341287 | A6         | 3/23/2023 | 26  | I57341307 | YA2        | 3/23/2023 |
| 7   | I57341288 | A7         | 3/23/2023 | 27  | I57341308 | YA3        | 3/23/2023 |
| 8   | I57341289 | A8         | 3/23/2023 | 28  | I57341309 | YB1        | 3/23/2023 |
| 9   | I57341290 | B1         | 3/23/2023 | 29  | I57341310 | YB2        | 3/23/2023 |
| 10  | I57341291 | B2         | 3/23/2023 | 30  | I57341311 | YP1        | 3/23/2023 |
| 11  | I57341292 | B3         | 3/23/2023 | 31  | I57341312 | YP2        | 3/23/2023 |
| 12  | I57341293 | B4         | 3/23/2023 | 32  | I57341313 | ZA1        | 3/23/2023 |
| 13  | I57341294 | B5         | 3/23/2023 | 33  | I57341314 | ZB1        | 3/23/2023 |
| 14  | I57341295 | B6         | 3/23/2023 | 34  | I57341315 | ZB2        | 3/23/2023 |
| 15  | I57341296 | B7         | 3/23/2023 | 35  | I57341316 | ZP1        | 3/23/2023 |
| 16  | I57341297 | B8         | 3/23/2023 | 36  | I57341317 | ZP2        | 3/23/2023 |
| 17  | I57341298 | C1SG       | 3/23/2023 |     |           |            |           |
| 18  | I57341299 | C2         | 3/23/2023 |     |           |            |           |
| 19  | I57341300 | P1         | 3/23/2023 |     |           |            |           |
| 20  | I57341301 | P2         | 3/23/2023 |     |           |            |           |


The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Truss Design Engineer's Name: Johnson, Andrew

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

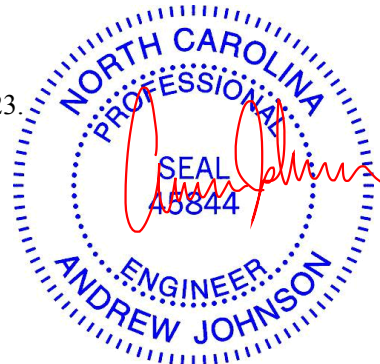


March 23, 2023

|                   |             |                          |          |          |   |
|-------------------|-------------|--------------------------|----------|----------|---|
| Job<br>J0923-5138 | Truss<br>A1 | Truss Type<br>HIP GIRDER | Qty<br>1 | Ply<br>2 | Precision/63 Liberty Meadows/Harnett<br>157341282 |
|-------------------|-------------|--------------------------|----------|----------|---|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:31 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-PIXUjYWCPtNV46h1BJunqhgTmuZ1iGRQwWIMczY6dQ



Scale = 1:66.2

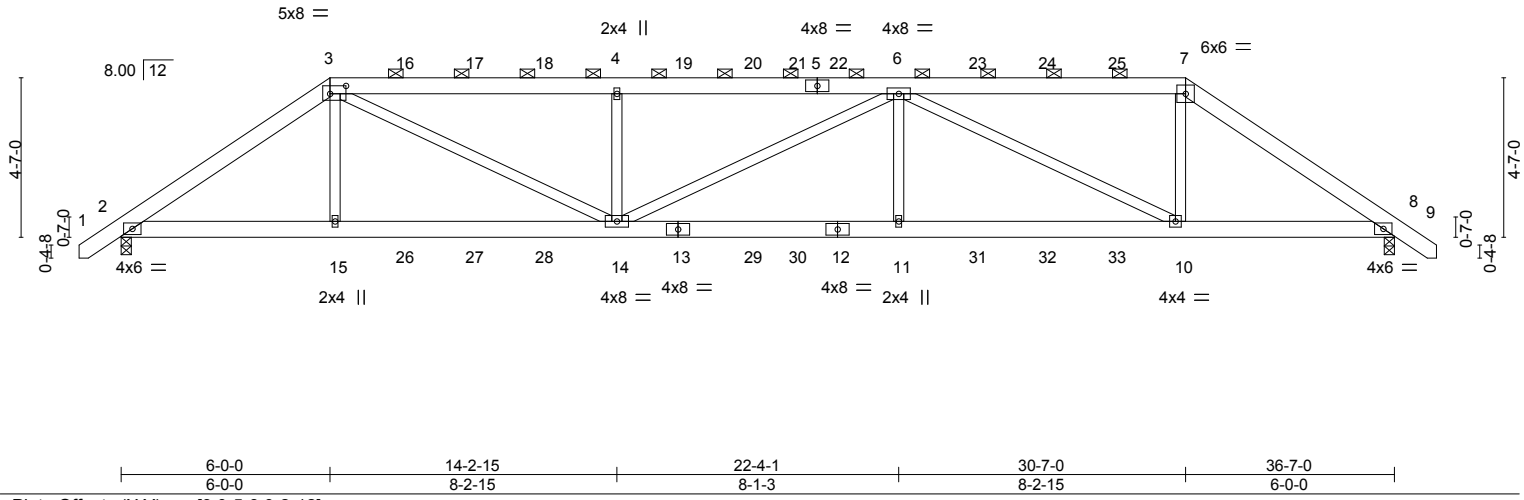


| LOADING (psf) | SPACING-             | CSI.     | DEFL.                         | PLATES         | GRIP     |
|---------------|----------------------|----------|-------------------------------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.36  | in (loc) l/defl L/d           | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.50  | Vert(LL) -0.15 11-14 >999 360 |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.90  | Vert(CT) -0.31 11-14 >999 240 |                |          |
| BCDL 10.0     | Rep Stress Incr NO   | Matrix-S | Horz(CT) 0.08 8 n/a n/a       |                |          |
|               | Code IRC2015/TPI2014 |          | Wind(LL) 0.17 11-14 >999 240  | Weight: 489 lb | FT = 20% |

| LUMBER-               | BRACING-   |
|-----------------------|--|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (6-0-0 max.): 3-7.  |
| WEBS 2x4 SP No.2      | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=-114(LC 25)  
 Max Uplift 2=-653(LC 8), 8=-653(LC 9)  
 Max Grav 2=2833(LC 1), 8=2833(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-4582/1150, 3-4=-6352/1681, 4-6=-6351/1681, 6-7=-3751/991, 7-8=-4580/1148  
 BOT CHORD 2-15=-975/3684, 14-15=-974/3704, 11-14=-1652/6353, 10-11=-1652/6353,  
 8-10=-874/3682  
 WEBS 3-15=0/728, 3-14=-865/3006, 4-14=-993/579, 6-11=0/674, 6-10=-2969/860,  
 7-10=-359/1914

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 653 lb uplift at joint 2 and 653 lb uplift at joint 8.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 23, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

**ENGINEERING BY TRENCO**  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932

|                   |             |                          |          |                 |   |
|-------------------|-------------|--------------------------|----------|-----------------|---|
| Job<br>J0923-5138 | Truss<br>A1 | Truss Type<br>HIP GIRDER | Qty<br>1 | Ply<br><b>2</b> | Precision/63 Liberty Meadows/Harnett<br>I57341282<br>Job Reference (optional) |
|-------------------|-------------|--------------------------|----------|-----------------|---|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:32 2023 Page 2

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-uV5swuWqABVMiGGDIOP0N6ERDAEom9VafaFiv2zY6dP

**NOTES-**

10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 137 lb down and 121 lb up at 6-0-0, 142 lb down and 118 lb up at 8-0-12, 142 lb down and 118 lb up at 10-0-12, 142 lb down and 118 lb up at 12-0-12, 142 lb down and 118 lb up at 14-0-12, 142 lb down and 118 lb up at 16-0-12, 142 lb down and 118 lb up at 18-0-12, 142 lb down and 118 lb up at 18-6-4, 142 lb down and 118 lb up at 20-6-4, 142 lb down and 118 lb up at 22-6-4, 142 lb down and 118 lb up at 24-6-4, 142 lb down and 118 lb up at 26-6-4, and 142 lb down and 118 lb up at 28-6-4, and 137 lb down and 121 lb up at 30-7-0 on top chord, and 351 lb down and 123 lb up at 6-0-0, 76 lb down at 8-0-12, 76 lb down at 10-0-12, 76 lb down at 12-0-12, 76 lb down at 14-0-12, 76 lb down at 16-0-12, 76 lb down at 18-0-12, 76 lb down at 18-6-4, 76 lb down at 20-6-4, 76 lb down at 22-6-4, 76 lb down at 24-6-4, 76 lb down at 26-6-4, and 76 lb down at 28-6-4, and 351 lb down and 123 lb up at 30-6-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-60, 3-7=-60, 7-9=-60, 2-8=-20

Concentrated Loads (lb)

Vert: 3=-104(B) 7=-104(B) 13=-38(B) 15=-351(B) 14=-38(B) 4=-104(B) 11=-38(B) 10=-351(B) 6=-104(B) 12=-38(B) 16=-104(B) 17=-104(B) 18=-104(B) 19=-104(B) 20=-104(B) 21=-104(B) 22=-104(B) 23=-104(B) 24=-104(B) 25=-104(B) 26=-38(B) 27=-38(B) 28=-38(B) 29=-38(B) 30=-38(B) 31=-38(B) 32=-38(B) 33=-38(B)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341283 |
| J0923-5138 | A2    | HIP        | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:33 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-MhfE8EXSxVdDJQrQlkwFwJmZmac9ViNktE?rRUzY6dO



Scale = 1:68.8

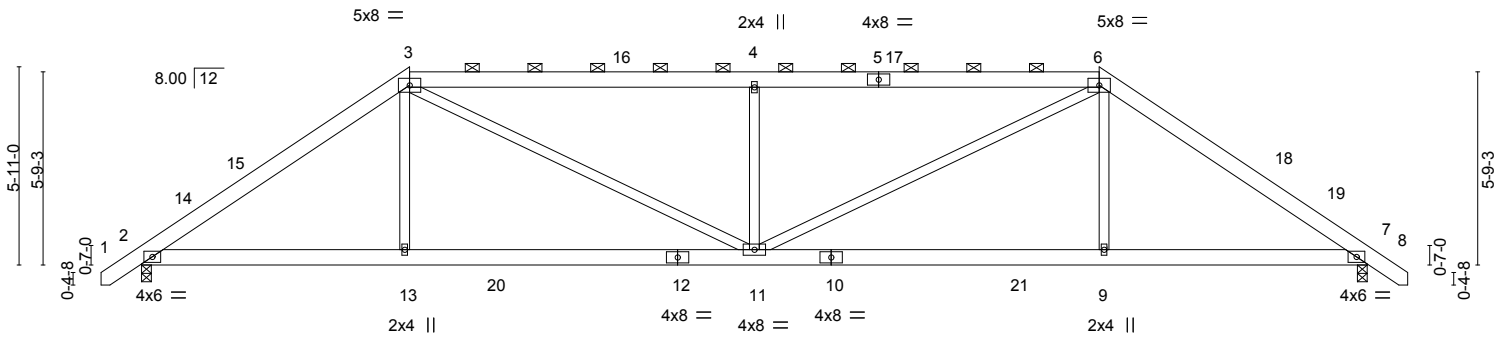

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |         |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|---------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.50  | Vert(LL) | -0.10    | 11     | >999 | 360            | MT20     | 244/190 |
| BCDL 10.0     | Lumber DOL           | 1.15  | BC 0.36  | Vert(CT) | -0.22    | 9-11   | >999 | 240            |          |         |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.54  | Horz(CT) | 0.06     | 7      | n/a  | n/a            |          |         |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-S | Wind(LL) | 0.08     | 11     | >999 | 240            |          |         |
|               |                      |       |          |          |          |        |      | Weight: 241 lb | FT = 20% |         |

**LUMBER-**  
 TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-11-1 oc purlins, except  
 2-0-0 oc purlins (4-2-15 max.): 3-6.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 7=0-3-8  
 Max Horz 2=-144(LC 10)  
 Max Uplift 2=-55(LC 9), 7=-55(LC 8)  
 Max Grav 2=1525(LC 1), 7=1525(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2234/504, 3-4=-2621/698, 4-6=-2620/697, 6-7=-2235/504  
 BOT CHORD 2-13=-247/1741, 11-13=-250/1735, 9-11=-256/1737, 7-9=-253/1743  
 WEBS 3-13=0/400, 3-11=-226/1090, 4-11=-729/346, 6-11=-226/1088, 6-9=0/400

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 8-0-0, Exterior(2) 8-0-0 to 14-2-11, Interior(1) 14-2-11 to 28-7-0, Exterior(2) 28-7-0 to 34-9-11, Interior(1) 34-9-11 to 37-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 2 and 55 lb uplift at joint 7.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341284 |
| J0923-5138 | A3    | HIP        | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:35 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-l4n?ZwZiT6uxZk?oQ9yj?kstYNFazem0LYjWNzY6dM



Scale = 1:68.8

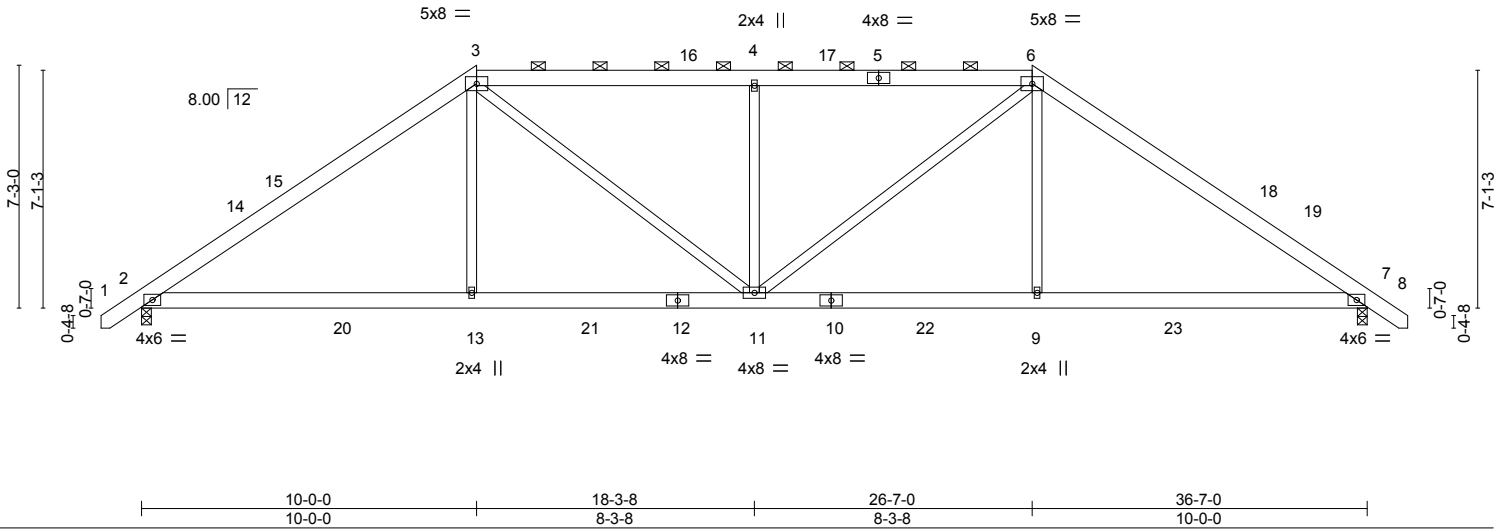

| LOADING (psf) | SPACING-             | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |
|---------------|----------------------|----------|----------|----------|--------|------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.61  | Vert(LL) | -0.10    | 2-13   | >999 | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.49  | Vert(CT) | -0.19    | 2-13   | >999 |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.42  | Horz(CT) | 0.06     | 7      | n/a  |                |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-S | Wind(LL) | 0.06     | 2-13   | >999 | Weight: 246 lb | FT = 20% |
|               | Code IRC2015/TPI2014 |          |          |          |        |      |                |          |

| LUMBER-               | BRACING-   |
|-----------------------|--|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-1-5 oc purlins, except |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (5-0-0 max.); 3-6.  |
| WEBS 2x4 SP No.2      | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |

**REACTIONS.** (size) 2=0-3-8, 7=0-3-8  
 Max Horz 2=-176(LC 10)  
 Max Uplift 2=-50(LC 12), 7=-50(LC 13)  
 Max Grav 2=1664(LC 2), 7=1664(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2419/486, 3-4=-2262/594, 4-6=-2261/593, 6-7=-2420/487  
 BOT CHORD 2-13=-206/1891, 11-13=-208/1879, 9-11=-216/1880, 7-9=-214/1892  
 WEBS 3-13=0/613, 3-11=-176/655, 4-11=-564/255, 6-11=-176/653, 6-9=0/613

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 1-0-15 to 3-3-14, Interior(1) 3-3-14 to 10-0-0, Exterior(2) 10-0-0 to 16-2-11, Interior(1) 16-2-11 to 26-7-0, Exterior(2) 26-7-0 to 32-9-11, Interior(1) 32-9-11 to 37-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 2 and 50 lb uplift at joint 7.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

**ENGINEERING BY**  
**TRENCO**  
 A MiTek Affiliate


818 Soundside Road  
 Edenton, NC 27932

|            |       |              |     |     |                                      |           |
|------------|-------|--------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type   | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341285 |
| J0923-5138 | A4    | ROOF SPECIAL | 1   | 1   |                                      |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:36 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-mGKNmFaLEQ0oBta?.sTyXy00Vnaf6FAZCDW2pzY6dL



Scale = 1:70.0

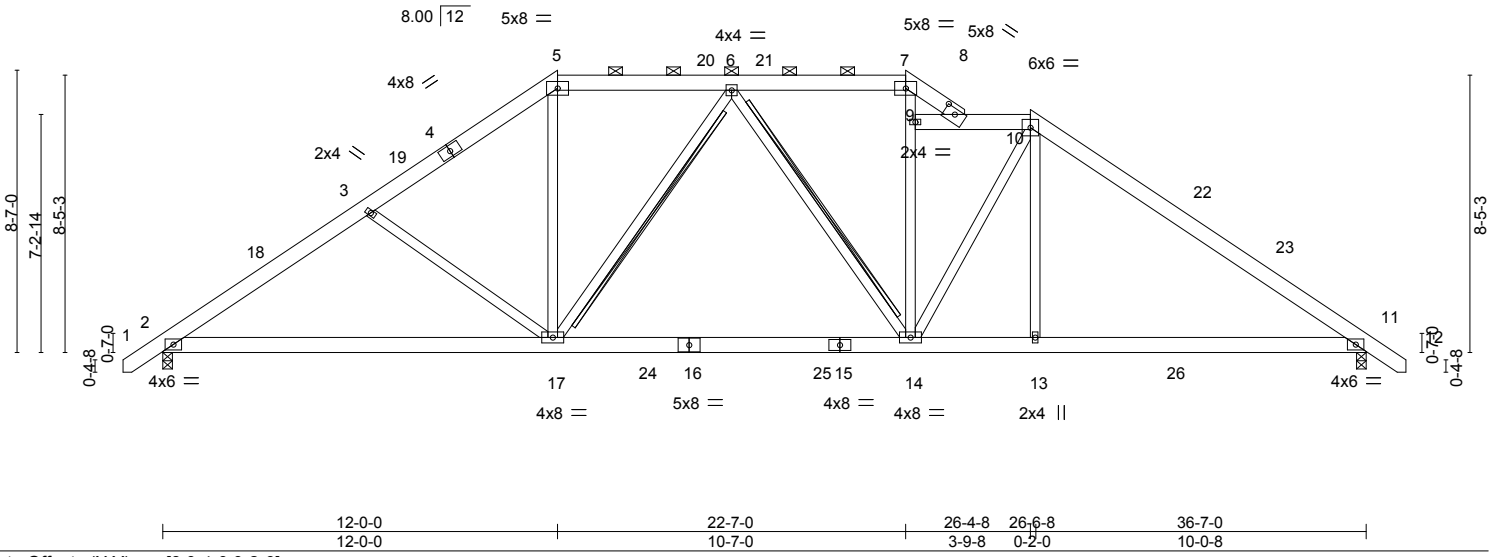

|                       |                      |       |             |              |             |        |               |                |          |
|-----------------------|----------------------|-------|-------------|--------------|-------------|--------|---------------|----------------|----------|
| Plate Offsets (X,Y)-- | [8:0-4-0,0-2-0]      |       |             |              |             |        |               |                |          |
| <b>LOADING</b> (psf)  | <b>SPACING-</b>      | 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> | in (loc)    | l/defl | <b>PLATES</b> | <b>GRIP</b>    |          |
| TCLL 20.0             | Plate Grip DOL       | 1.15  | TC 0.73     | Vert(LL)     | -0.22 14-17 | >999   | 360           | MT20           | 244/190  |
| TCDL 10.0             | Lumber DOL           | 1.15  | BC 0.57     | Vert(CT)     | -0.34 14-17 | >999   | 240           |                |          |
| BCLL 0.0 *            | Rep Stress Incr      | YES   | WB 0.34     | Horz(CT)     | 0.06 11     | n/a    | n/a           |                |          |
| BCDL 10.0             | Code IRC2015/TPI2014 |       | Matrix-S    | Wind(LL)     | 0.06 11-13  | >999   | 240           |                |          |
|                       |                      |       |             |              |             |        |               | Weight: 274 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-3-12 oc purlins, except                                     |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (4-5-0 max.): 5-7, 9-10.   |
| WEBS 2x4 SP No.2      | Rigid ceiling directly applied or 10-0-0 oc bracing.  |
|                       | T-Brace: 2x4 SPF No.2 - 6-17, 6-14  |
|                       | Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. |
|                       | Brace must cover 90% of web length.   |

**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
 Max Horz 2=210(LC 11)  
 Max Uplift 2=64(LC 12), 11=-79(LC 13)  
 Max Grav 2=1525(LC 1), 11=1591(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2201/526, 3-5=-1970/485, 5-6=-1560/463, 6-7=-1722/497, 7-8=-1999/548, 8-10=-1713/447, 10-11=-2269/479  
 BOT CHORD 2-17=305/1849, 14-17=-191/1732, 13-14=-213/1765, 11-13=-212/1772  
 WEBS 3-17=-408/238, 5-17=-105/777, 6-17=-389/173, 9-14=-71/371, 7-9=-162/732, 10-13=0/334

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 12-0-0, Exterior(2) 12-0-0 to 16-4-13, Interior(1) 16-4-13 to 22-7-0, Exterior(2) 22-7-0 to 24-4-8, Interior(1) 24-4-8 to 26-4-8, Exterior(2) 26-4-8 to 30-9-5, Interior(1) 30-9-5 to 37-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 2 and 79 lb uplift at joint 11.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 8) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.






|            |       |              |     |     |                                      |           |
|------------|-------|--------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type   | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341286 |
| J0923-5138 | A5    | ROOF SPECIAL | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:38 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-ieS7Bxbm1GVQBjN5HWQdNUlvbK0Ax5T1Wic6izY6dJ



Scale = 1:73.9

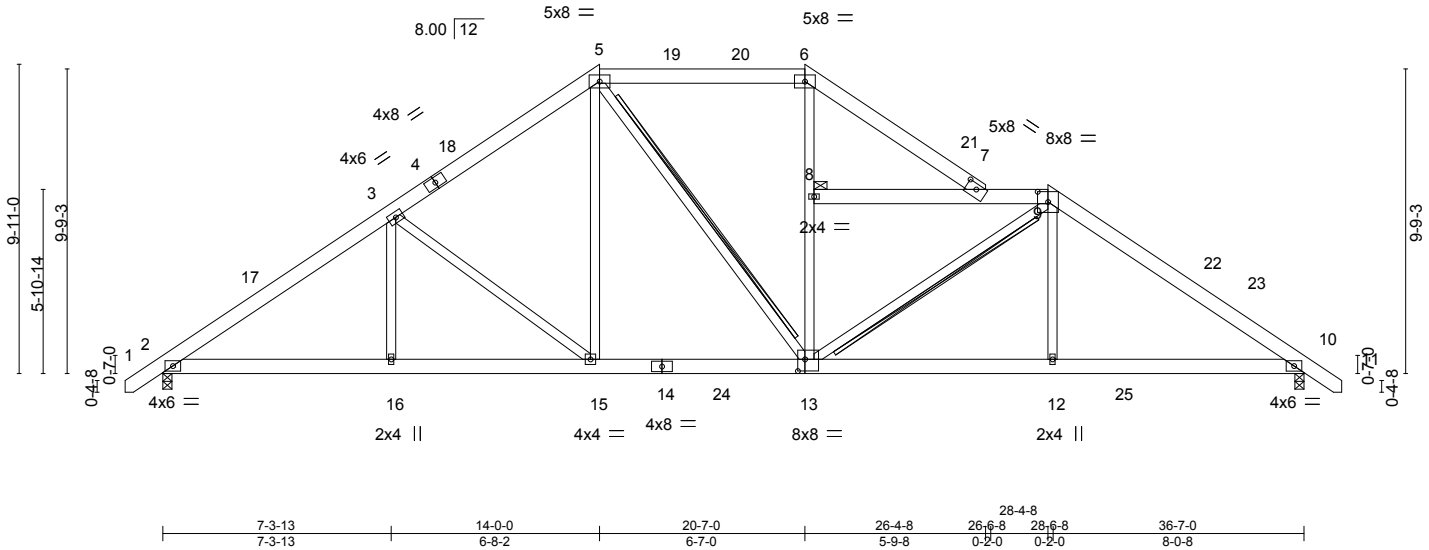

|                       |  |
|-----------------------|--|
| Plate Offsets (X,Y)-- | [7:0-4-0,0-2-0], [9:0-4-0,0-3-15], [13:0-2-12,0-4-8] |
|-----------------------|--|

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.99  | Vert(LL) | -0.14    | 13-15  | >999 | MT20           | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.32  | Vert(CT) | -0.25    | 13-15  | >999 |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.70  | Horz(CT) | 0.06     | 10     | n/a  |                |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-S | Wind(LL) | 0.09     | 13     | >999 |                |          |
|               |                      |       |          |          |          |        |      | Weight: 287 lb | FT = 20% |

| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-0-2 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 5-6, 8-9.   |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  |
| WEBS 2x4 SP No.2      | WEBS T-Brace: 2x4 SPF No.2 - 9-13, 5-13<br>Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.<br>Brace must cover 90% of web length. |
|                       | JOINTS 1 Brace at Jt(s): 8  |

**REACTIONS.** (size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=241(LC 11)  
 Max Uplift 2=-76(LC 12), 10=-90(LC 13)  
 Max Grav 2=1525(LC 1), 10=1525(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2229/479, 3-5=-1740/503, 5-6=-1410/499, 6-7=-1721/497, 7-9=-1390/334, 9-10=-2246/490  
 BOT CHORD 2-16=-246/1844, 15-16=-246/1844, 13-15=-73/1411, 12-13=-265/1764, 10-12=-263/1769  
 WEBS 3-16=0/295, 3-15=-619/215, 5-15=-59/606, 8-13=0/398, 6-8=-49/557, 9-13=-520/208, 9-12=0/349, 5-13=-113/250

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 14-0-0, Exterior(2) 14-0-0 to 18-4-13, Interior(1) 18-4-13 to 20-7-0, Exterior(2) 20-7-0 to 24-11-13, Interior(1) 24-11-13 to 28-4-8, Exterior(2) 28-4-8 to 32-9-5, Interior(1) 32-9-5 to 37-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 2 and 90 lb uplift at joint 10.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 8) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.









|                   |             |                            |          |          |                                      |           |
|-------------------|-------------|----------------------------|----------|----------|--------------------------------------|-----------|
| Job<br>J0923-5138 | Truss<br>A7 | Truss Type<br>ROOF SPECIAL | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett | 157341288 |
|-------------------|-------------|----------------------------|----------|----------|--------------------------------------|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:42 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-bQie1Je5pFmxvo18K7aMnDe7NCZg6mN2y8gqFTzY6dF

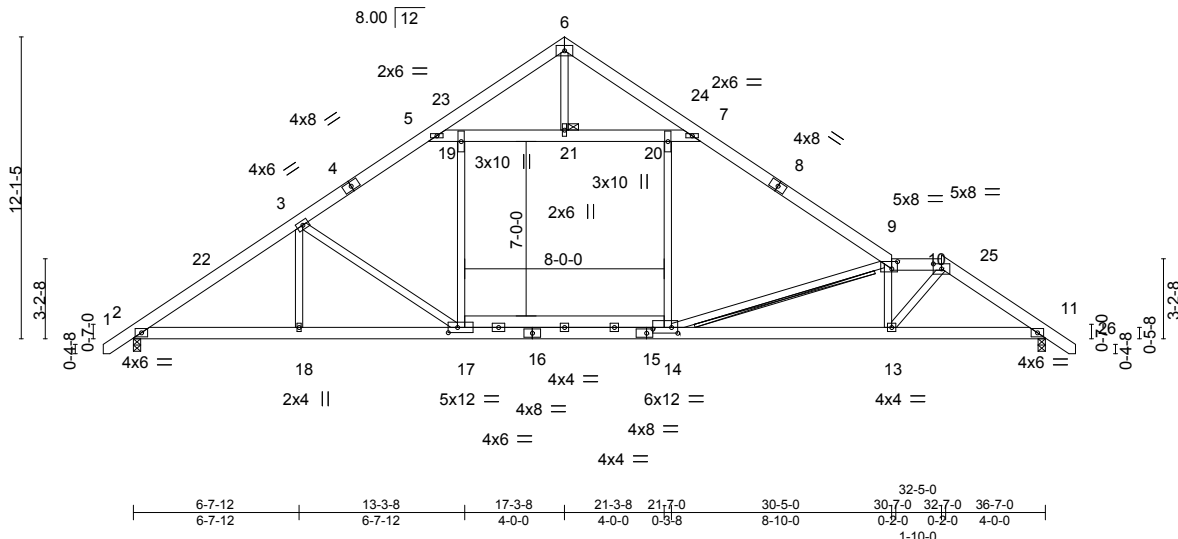

|                       |   |
|-----------------------|---|
| Plate Offsets (X,Y)-- | [9:0-2-12,0-3-8], [10:0-4-0,0-2-6], [14:0-3-0,0-2-12], [15:0-3-0,0-2-0], [17:0-4-8,0-2-8] |
|-----------------------|---|

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.38  | Vert(LL) | -0.30    | 13-14  | >999 | MT20           | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.79  | Vert(CT) | -0.47    | 13-14  | >934 |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.62  | Horz(CT) | 0.07     | 11     | n/a  |                |          |
| BCDL 10.0     | Code IRC2015/TP12014 |       | Matrix-S | Wind(LL) | 0.22     | 13-14  | >999 |                |          |
|               |                      |       |          |          |          |        |      | Weight: 306 lb | FT = 20% |

| LUMBER-                                       | BRACING-  |
|---|---|
| TOP CHORD 2x6 SP No.1                         | TOP CHORD Structural wood sheathing directly applied or 4-11-3 oc purlins, except                                     |
| BOT CHORD 2x6 SP No.1                         | 2-0-0 oc purlins (4-7-10 max.): 9-10.   |
| WEBS 2x4 SP No.2 *Except*<br>5-7: 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  |
|   | WEBS T-Brace: 2x4 SPF No.2 - 9-14   |
|   | Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. |
|   | Brace must cover 90% of web length.   |
|   | JOINTS 1 Brace at Jt(s): 21   |


**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
 Max Horz 2=-294(LC 10)  
 Max Uplift 2=-90(LC 12), 11=-102(LC 13)  
 Max Grav 2=1611(LC 19), 11=1564(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2365/404, 3-5=-2055/454, 5-6=-720/137, 6-7=-746/136, 7-9=-2111/430,  
 9-10=-2856/559, 10-11=-2381/450  
 BOT CHORD 2-18=-184/2063, 17-18=-184/2063, 14-17=-97/1739, 13-14=-390/2769, 11-13=-261/1887  
 WEBS 3-17=-495/220, 9-13=-1025/288, 10-13=-246/1539, 9-14=-1289/325, 5-19=-1209/415,  
 19-21=-1209/415, 20-21=-1209/415, 7-20=-1209/415, 17-19=-21/588, 14-20=0/686,  
 6-21=0/467


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 17-3-8, Exterior(2) 17-3-8 to 21-8-5, Interior(1) 21-8-5 to 32-5-0, Exterior(2) 32-5-0 to 36-9-13, Interior(1) 36-9-13 to 37-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 2 and 102 lb uplift at joint 11.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 8) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



|   |       |                     |     |     |                                      |  |
|---|-------|---------------------|-----|-----|--------------------------------------|--|
| Job                                     | Truss | Truss Type          | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341289  |
| J0923-5138                              | A8    | ROOF SPECIAL GIRDER | 1   | 1   |                                      |  |
| Comtech, Inc. Fayetteville, NC - 28314, |       |                     |     |     |                                      | 8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:44 2023 Page 1  |
|   |       |                     |     |     |                                      | ID:3YJEq_u8zX16RsP?VvW_V6zd0wB-XopOS_gMLt0f86BXSXdqsejTk0G8aaKLPs9xKMzY6dD |
|   |       |                     |     |     |                                      | Job Reference (optional)   |



Scale = 1:94.9

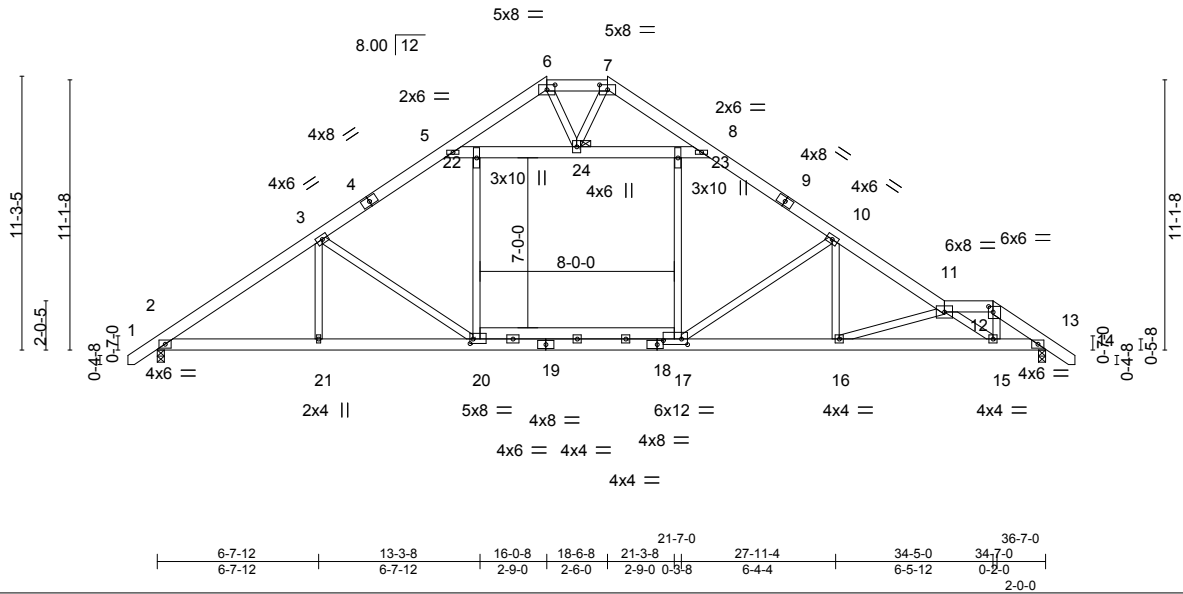

|                       |  |
|-----------------------|--|
| Plate Offsets (X,Y)-- | [6:0-4-0,0-2-6], [7:0-4-0,0-2-6], [12:0-2-4,0-2-12], [17:0-3-0,0-2-12], [18:0-3-0,0-2-0], [20:0-1-8,0-2-4] |
|-----------------------|--|

| LOADING (psf) | SPACING-             | CSI.     | DEFL.                         | PLATES         | GRIP     |
|---------------|----------------------|----------|-------------------------------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.39  | in (loc) l/defl L/d           | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.72  | Vert(LL) -0.22 16-17 >999 360 |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.97  | Vert(CT) -0.36 16-17 >999 240 |                |          |
| BCDL 10.0     | Rep Stress Incr NO   | Matrix-S | Horz(CT) 0.07 13 n/a n/a      |                |          |
|               | Code IRC2015/TPI2014 |          | Wind(LL) 0.17 16-17 >999 240  | Weight: 315 lb | FT = 20% |

|                           |  |
|---------------------------|--|
| <b>LUMBER-</b>            | <b>BRACING-</b>  |
| TOP CHORD 2x6 SP No.1     | TOP CHORD Structural wood sheathing directly applied or 4-8-2 oc purlins, except |
| BOT CHORD 2x6 SP No.1     | 2-0-0 oc purlins (6-0-0 max.): 6-7, 11-12.                                       |
| WEBS 2x4 SP No.2 *Except* | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |
| 5-8: 2x6 SP No.1          | JOINTS 1 Brace at Jt(s): 24  |

|                   |  |
|-------------------|--|
| <b>REACTIONS.</b> | (size) 2=0-3-8, 13=0-3-8               |
|                   | Max Horz 2=273(LC 26)                  |
|                   | Max Uplift 2=-86(LC 8), 13=-101(LC 9)  |
|                   | Max Grav 2=1595(LC 33), 13=1563(LC 34) |

|                |  |
|----------------|--|
| <b>FORCES.</b> | (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.   |
| TOP CHORD      | 2-3=-2343/123, 3-5=-1978/151, 5-6=-770/54, 6-7=-692/60, 7-8=-762/57,<br>8-10=-2021/142, 10-11=-2742/161, 11-12=-1683/79, 12-13=-2245/74  |
| BOT CHORD      | 2-21=-135/2030, 20-21=-135/2030, 17-20=0/1686, 16-17=-21/2238, 15-16=-133/3325,<br>13-15=-12/1770  |
| WEBS           | 3-20=-491/192, 20-22=0/593, 17-23=0/736, 11-15=-2041/152, 12-15=0/1156,<br>10-17=-920/208, 10-16=0/565, 11-16=-1155/118, 5-22=-1086/173, 22-24=-1086/173,<br>23-24=-1050/168, 8-23=-1050/168, 7-24=-71/303, 6-24=-60/399 |

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 2 and 101 lb uplift at joint 13.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 66 lb down and 36 lb up at 34-5-0 on top chord, and 10 lb down at 34-5-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

|                                 |  |
|---------------------------------|--|
| <b>LOAD CASE(S)</b>             | Standard   |
| 1) Dead + Roof Live (balanced): | Lumber Increase=1.15, Plate Increase=1.15                        |
|                                 | Uniform Loads (plf)  |
|                                 | Vert: 1-6=-60, 6-7=-60, 7-11=-60, 11-12=-60, 12-14=-60, 2-13=-20 |



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

**TRENCO**  
ENGINEERING BY  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341290 |
| J0923-5138 | B1    | HIP GIRDER | 1   | 2   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:46 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-TBx9sghtUGNNQKwZyflx3prRp3a2fgetme1OEzY6dB



Scale = 1:51.1

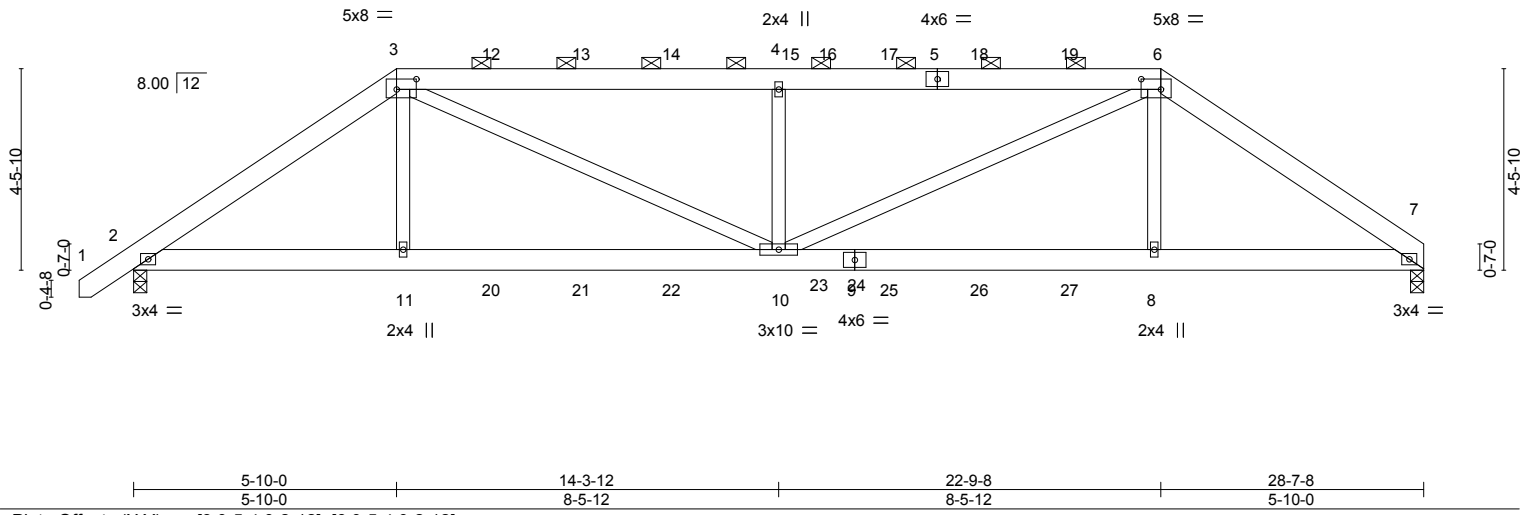

|                       |                                    |
|-----------------------|------------------------------------|
| Plate Offsets (X,Y)-- | [3:0-5-4,0-2-12], [6:0-5-4,0-2-12] |
|-----------------------|------------------------------------|

| LOADING (psf) | SPACING-             | CSI.     | DEFL.                         | PLATES         | GRIP     |
|---------------|----------------------|----------|-------------------------------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.32  | in (loc) l/defl L/d           | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.28  | Vert(LL) -0.07 10 >999 360    |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.21  | Vert(CT) -0.13 10-11 >999 240 |                |          |
| BCDL 10.0     | Rep Stress Incr NO   | Matrix-S | Horz(CT) 0.04 7 n/a n/a       |                |          |
|               | Code IRC2015/TPI2014 |          | Wind(LL) 0.07 10 >999 240     | Weight: 372 lb | FT = 20% |

| LUMBER-               | BRACING-   |
|-----------------------|--|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (6-0-0 max.): 3-6.  |
| WEBS 2x4 SP No.2      | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |

**REACTIONS.** (size) 7=0-3-8, 2=0-3-8  
 Max Horz 2=106(LC 24)  
 Max Uplift 7=-483(LC 9), 2=-501(LC 8)  
 Max Grav 7=2100(LC 1), 2=2177(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-3447/843, 3-4=-4284/1127, 4-6=-4285/1127, 6-7=-3431/844  
 BOT CHORD 2-11=-732/2755, 10-11=-731/2776, 8-10=-646/2782, 7-8=-647/2761  
 WEBS 3-11=0/714, 3-10=-536/1723, 4-10=-1085/640, 6-10=-536/1720, 6-8=0/716

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 483 lb uplift at joint 7 and 501 lb uplift at joint 2.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 134 lb down and 118 lb up at 5-10-0, 139 lb down and 115 lb up at 7-10-12, 139 lb down and 115 lb up at 9-10-12, 139 lb down and 115 lb up at 11-10-12, 139 lb down and 115 lb up at 13-10-12, 139 lb down and 115 lb up at 14-8-12, 139 lb down and 115 lb up at 16-8-12, 139 lb down and 115 lb up at 18-8-12, and 139 lb down and 115 lb up at 20-8-12, and 134 lb down and 118 lb up at 22-9-8 on top chord, and 329 lb down and 119 lb up at 5-10-0, 73 lb down at 7-10-12, 73 lb down at 9-10-12, 73 lb down at 11-10-12, 73 lb down at 13-10-12, 73 lb down at 14-8-12, 73 lb down at 16-8-12, 73 lb down at 18-8-12, and 73 lb down at 20-8-12, and 329 lb down and 119 lb up at 22-8-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



March 23, 2023

**LOAD CASE(S)** Standard  
 Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

**TRENCO**  
 ENGINEERING BY  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932

|                   |             |                          |          |                 |   |
|-------------------|-------------|--------------------------|----------|-----------------|---|
| Job<br>J0923-5138 | Truss<br>B1 | Truss Type<br>HIP GIRDER | Qty<br>1 | Ply<br><b>2</b> | Precision/63 Liberty Meadows/Harnett<br>I57341290<br>Job Reference (optional) |
|-------------------|-------------|--------------------------|----------|-----------------|---|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:47 2023 Page 2  
ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-xNVX40iEeoOE?av67gAXUGL0BD0pn6wo5QObxhzY6dA

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-60, 3-6=-60, 6-7=-60, 2-7=-20

Concentrated Loads (lb)

Vert: 3=-99(F) 6=-99(F) 11=-329(F) 8=-329(F) 12=-99(F) 13=-99(F) 14=-99(F) 15=-99(F) 16=-99(F) 17=-99(F) 18=-99(F) 19=-99(F) 20=-36(F) 21=-36(F) 22=-36(F) 23=-36(F) 24=-36(F) 25=-36(F) 26=-36(F) 27=-36(F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))




818 Soundside Road  
Edenton, NC 27932

|                   |             |                                   |          |          |  |           |
|-------------------|-------------|-----------------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>B2 | Truss Type<br>ROOF SPECIAL GIRDER | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341291 |
|-------------------|-------------|-----------------------------------|----------|----------|--|-----------|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:49 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-umdHVikUAPeyEt3VE5C?ZhRle10kFsi4Zjti?ZzY6d8



Scale = 1:65.1

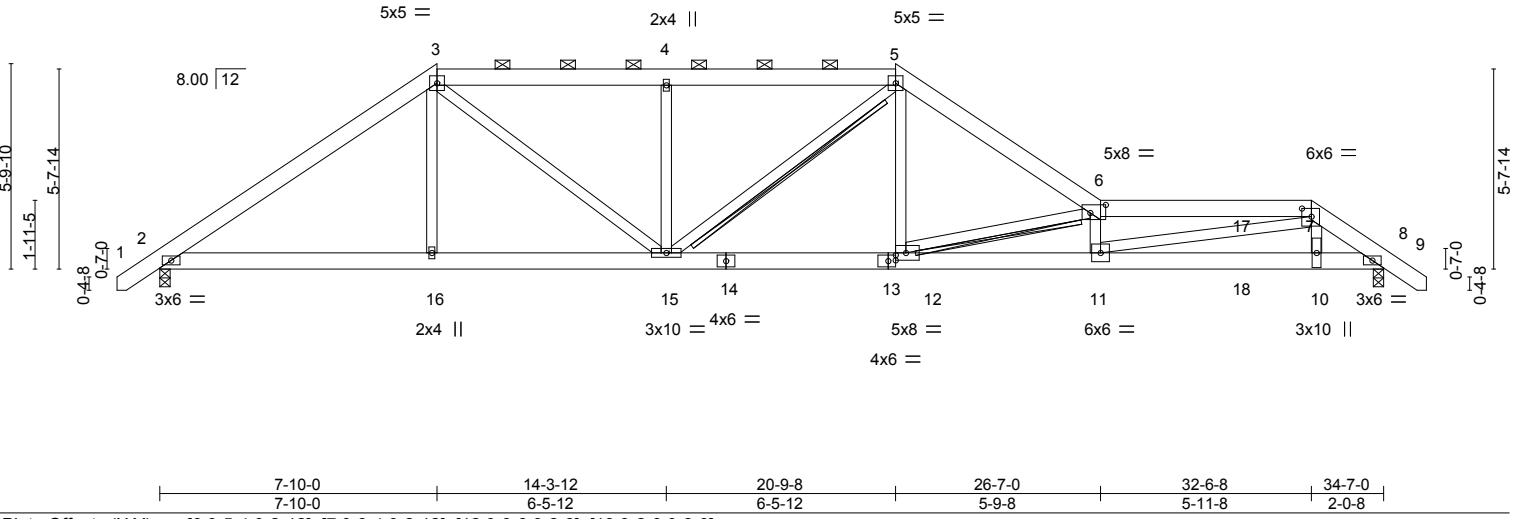

| LOADING (psf) | SPACING-             | CSI.     | DEFL.                         | PLATES         | GRIP     |
|---------------|----------------------|----------|-------------------------------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.51  | in (loc) l/defl L/d           | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.57  | Vert(LL) -0.26 11-12 >999 360 |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.83  | Vert(CT) -0.53 11-12 >776 240 |                |          |
| BCDL 10.0     | Rep Stress Incr NO   | Matrix-S | Horz(CT) 0.07 8 n/a n/a       |                |          |
|               | Code IRC2015/TPI2014 |          | Wind(LL) 0.18 11-12 >999 240  | Weight: 242 lb | FT = 20% |

| LUMBER-   | BRACING-  |
|---|---|
| TOP CHORD 2x6 SP No.1                                     | TOP CHORD Structural wood sheathing directly applied or 4-5-1 oc purlins, except 2-0-0 oc purlins (3-1-1 max.): 3-5, 6-7.   |
| BOT CHORD 2x6 SP No.1 *Except*<br>8-13: 2x6 SP 2400F 2.0E | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  |
| WEBS 2x4 SP No.2  | WEBS T-Brace: 2x4 SPF No.2 - 5-15, 6-12<br>Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.<br>Brace must cover 90% of web length. |

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=142(LC 26)  
 Max Uplift 2=-39(LC 8), 8=-93(LC 9)  
 Max Grav 2=1445(LC 1), 8=1445(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2078/53, 3-4=-2225/85, 4-5=-2225/85, 5-6=-2717/82, 6-7=-5290/211, 7-8=-2543/104  
 BOT CHORD 2-16=-78/1610, 15-16=-80/1605, 12-15=0/2203, 11-12=-136/5193, 10-11=-48/1988, 8-10=-42/2029  
 WEBS 3-16=0/325, 3-15=-138/880, 4-15=-451/161, 5-12=0/1051, 6-12=-3058/216, 6-11=-971/107, 7-11=-102/3398, 7-10=0/463

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 2 and 93 lb uplift at joint 8.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 64 lb down and 27 lb up at 30-5-12, and 132 lb down and 62 lb up at 32-6-8 on top chord, and 6 lb down at 30-5-12, and 15 lb down at 32-5-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
  - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard



March 23, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)





|                   |             |                                   |          |          |  |           |
|-------------------|-------------|-----------------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>B2 | Truss Type<br>ROOF SPECIAL GIRDER | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | I57341291 |
|-------------------|-------------|-----------------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:49 2023 Page 2  
ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-umdHVikUAPeyEt3VE5C?ZhRle10kFsi4Zjti?ZzY6d8

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-60, 3-5=-60, 5-6=-60, 6-7=-60, 7-9=-60, 2-8=-20

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932



|                   |             |                            |          |          |   |
|-------------------|-------------|----------------------------|----------|----------|---|
| Job<br>J0923-5138 | Truss<br>B4 | Truss Type<br>ROOF SPECIAL | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>157341293 |
|-------------------|-------------|----------------------------|----------|----------|---|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:51 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-q9k2wOli0vfUBDtMWFTe6WhnqfjktIN01Mo4SzY6d6



Scale = 1:65.2

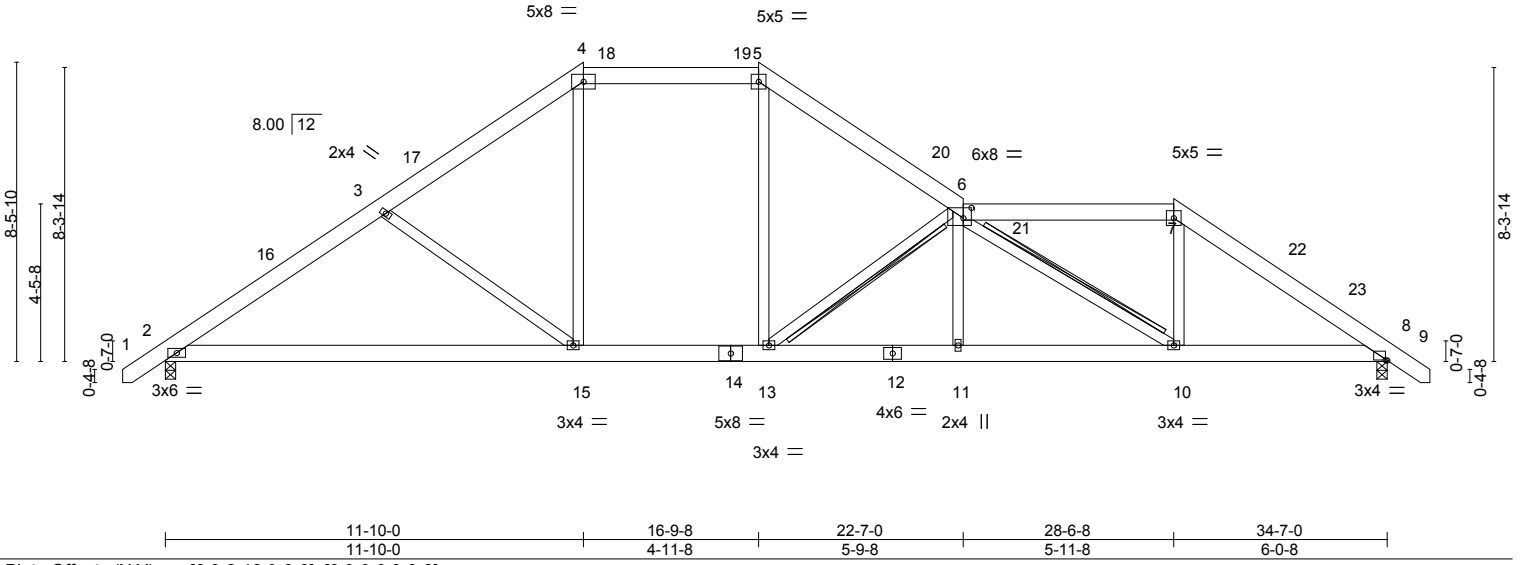


|                       |                                   |             |                                  |                |             |
|-----------------------|-----------------------------------|-------------|----------------------------------|----------------|-------------|
| Plate Offsets (X,Y)-- | [6:0-2-12,0-3-8], [8:0-0-9,0-0-2] |             |                                  |                |             |
| <b>LOADING</b> (psf)  | <b>SPACING</b> - 2-0-0            | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b>  | <b>GRIP</b> |
| TCLL 20.0             | Plate Grip DOL 1.15               | TC 0.28     | Vert(LL) -0.24 11-13 >999 360    | MT20           | 244/190     |
| TCDL 10.0             | Lumber DOL 1.15                   | BC 0.72     | Vert(CT) -0.40 11-13 >999 240    |                |             |
| BCLL 0.0 *            | Rep Stress Incr YES               | WB 0.41     | Horz(CT) 0.06 8 n/a n/a          |                |             |
| BCDL 10.0             | Code IRC2015/TPI2014              | Matrix-S    | Wind(LL) 0.17 11-13 >999 240     | Weight: 244 lb | FT = 20%    |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-2-13 oc purlins, except                                     |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (5-10-12 max.): 4-5, 6-7.  |
| WEBS 2x4 SP No.2      | Rigid ceiling directly applied or 10-0-0 oc bracing.  |
|                       | T-Brace: 2x4 SPF No.2 - 6-13, 6-10  |
|                       | Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. |
|                       | Brace must cover 90% of web length.   |

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=205(LC 11)  
 Max Uplift 2=64(LC 12), 8=-105(LC 13)  
 Max Grav 2=1445(LC 1), 8=1445(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2081/517, 3-4=-1826/490, 4-5=-1461/471, 5-6=-1871/506, 6-7=-1658/453, 7-8=-2144/481  
 BOT CHORD 2-15=-294/1741, 13-15=-120/1480, 11-13=-476/2661, 10-11=-478/2654, 8-10=-263/1687  
 WEBS 3-15=-366/214, 4-15=-60/610, 5-13=-146/818, 6-13=-1508/446, 6-11=0/290, 6-10=-1216/271, 7-10=-80/807

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 11-10-0, Exterior(2) 11-10-0 to 16-2-13, Interior(1) 16-2-13 to 16-9-8, Exterior(2) 16-9-8 to 21-2-5, Interior(1) 21-2-5 to 28-6-8, Exterior(2) 28-6-8 to 32-11-5, Interior(1) 32-11-5 to 35-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 2 and 105 lb uplift at joint 8.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.




|                   |             |                            |          |          |   |
|-------------------|-------------|----------------------------|----------|----------|---|
| Job<br>J0923-5138 | Truss<br>B5 | Truss Type<br>ROOF SPECIAL | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>157341294 |
|-------------------|-------------|----------------------------|----------|----------|---|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:53 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-mXsoK3n?Ee9NjVNGTwhXjXb0KePzBf6gULrv8KzY6d4



Scale = 1:66.6

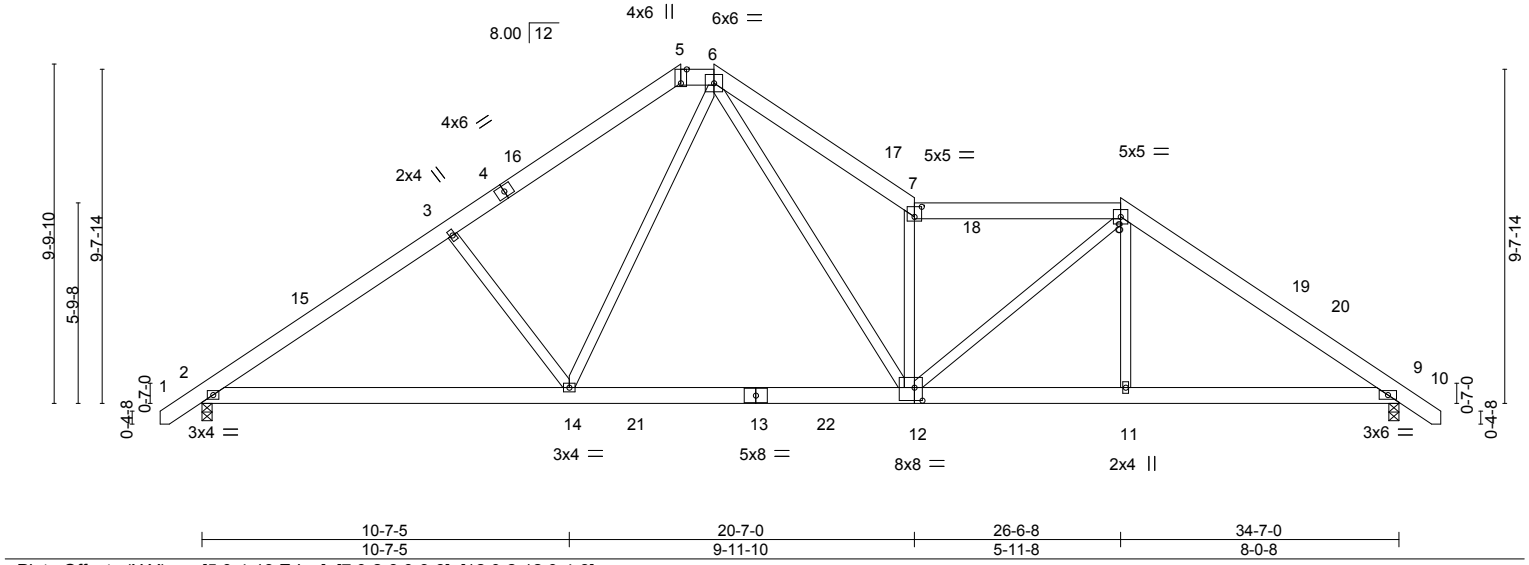

|               |                      |       |          |          |          |        |      |                |          |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|
| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.34  | Vert(LL) | -0.22    | 12-14  | >999 | MT20           | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.48  | Vert(CT) | -0.36    | 12-14  | >999 |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.93  | Horz(CT) | 0.05     | 9      | n/a  |                |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-S | Wind(LL) | 0.09     | 12-14  | >999 | Weight: 248 lb | FT = 20% |

|                       |  |
|-----------------------|--|
| <b>LUMBER-</b>        | <b>BRACING-</b>  |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-5-0 oc purlins, except |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (5-3-2 max.): 5-6, 7-8.   |
| WEBS 2x4 SP No.2      | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |

**REACTIONS.** (size) 2=0-3-8, 9=0-3-8  
 Max Horz 2=237(LC 11)  
 Max Uplift 2=-75(LC 12), 9=-112(LC 13)  
 Max Grav 2=1461(LC 19), 9=1445(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2074/448, 3-5=-1866/484, 5-6=-1544/480, 6-7=-2712/753, 7-8=-2168/541, 8-9=-2067/449  
 BOT CHORD 2-14=-226/1774, 12-14=-45/1312, 11-12=-208/1594, 9-11=-207/1599  
 WEBS 3-14=-364/250, 6-14=-81/696, 6-12=-463/1767, 7-12=-1787/570, 8-12=-124/879, 8-11=0/301

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 13-10-0, Exterior(2) 13-10-0 to 19-2-5, Interior(1) 19-2-5 to 26-6-8, Exterior(2) 26-6-8 to 30-11-5, Interior(1) 30-11-5 to 35-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 75 lb uplift at joint 2 and 112 lb uplift at joint 9.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




March 23, 2023

|            |       |              |     |     |                                      |           |
|------------|-------|--------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type   | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341295 |
| J0923-5138 | B6    | ROOF SPECIAL | 1   | 1   |                                      |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:54 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-EJQAYPod?xHELEyS1eoAGI87?2kJwACpi?aTgnzY6d3



Scale = 1:74.3

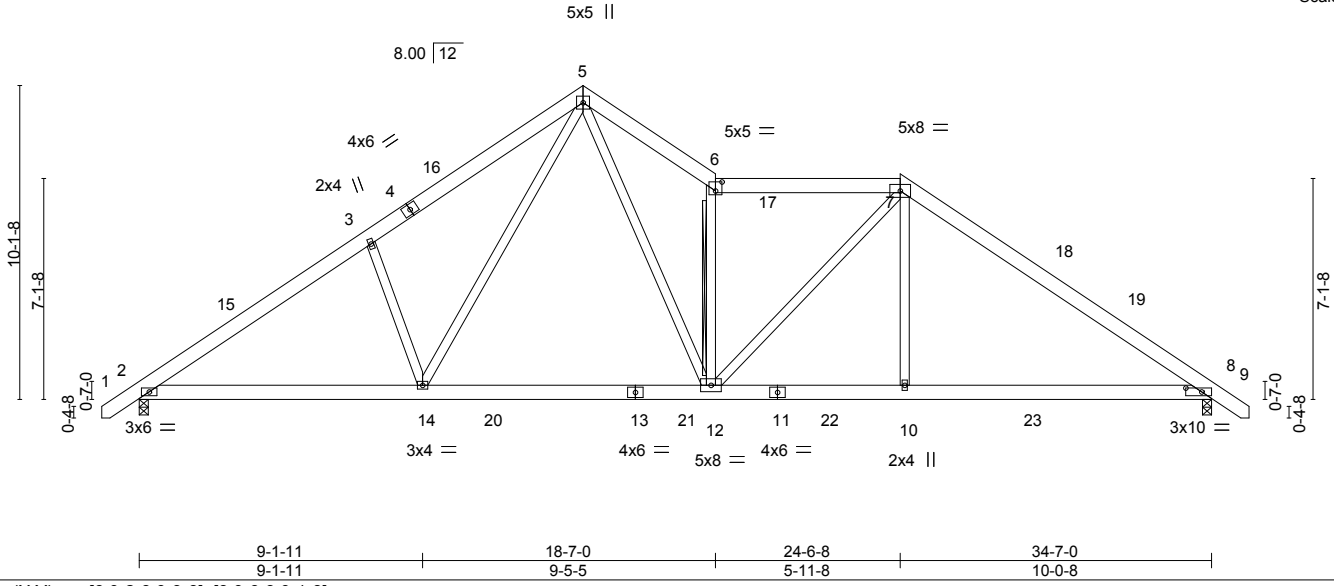

|                       |                                  |
|-----------------------|----------------------------------|
| Plate Offsets (X,Y)-- | [6:0-2-8,0-3-8], [8:0-6-3,0-1-8] |
|-----------------------|----------------------------------|

| LOADING (psf) | SPACING-             | CSI.     | DEFL.                         | PLATES         | GRIP     |
|---------------|----------------------|----------|-------------------------------|----------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.60  | in (loc) l/defl L/d           | MT20           | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.48  | Vert(LL) -0.18 12-14 >999 360 |                |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.69  | Vert(CT) -0.28 12-14 >999 240 |                |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-S | Horz(CT) 0.05 8 n/a n/a       |                |          |
|               | Code IRC2015/TP12014 |          | Wind(LL) 0.06 8-10 >999 240   | Weight: 253 lb | FT = 20% |

| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-3-8 oc purlins, except 2-0-0 oc purlins (5-5-7 max.): 6-7.  |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  |
| WEBS 2x4 SP No.2      | WEBS T-Brace: 2x4 SPF No.2 - 6-12   |
|                       | Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. |
|                       | Brace must cover 90% of web length.   |

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=246(LC 11)  
 Max Uplift 2=-78(LC 12), 8=-113(LC 13)  
 Max Grav 2=1551(LC 19), 8=1599(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2273/436, 3-5=-2172/553, 5-6=-2397/642, 6-7=-2005/485, 7-8=-2243/428  
 BOT CHORD 2-14=-211/1950, 12-14=-30/1420, 10-12=-161/1757, 8-10=-160/1766  
 WEBS 3-14=-477/288, 5-14=-181/837, 5-12=-371/1629, 6-12=-1501/461, 7-12=-56/452, 7-10=0/507

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 14-3-12, Exterior(2) 14-3-12 to 18-7-0, Interior(1) 18-7-0 to 24-6-8, Exterior(2) 24-6-8 to 28-11-5, Interior(1) 28-11-5 to 35-7-15 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 2 and 113 lb uplift at joint 8.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.






|                   |             |                            |          |          |  |           |
|-------------------|-------------|----------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>B7 | Truss Type<br>ROOF SPECIAL | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341296 |
|-------------------|-------------|----------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:56 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-B6Yxz5ptWZyay5r93qeLADRCrMTO8d6AJ3ZlfzY6d1

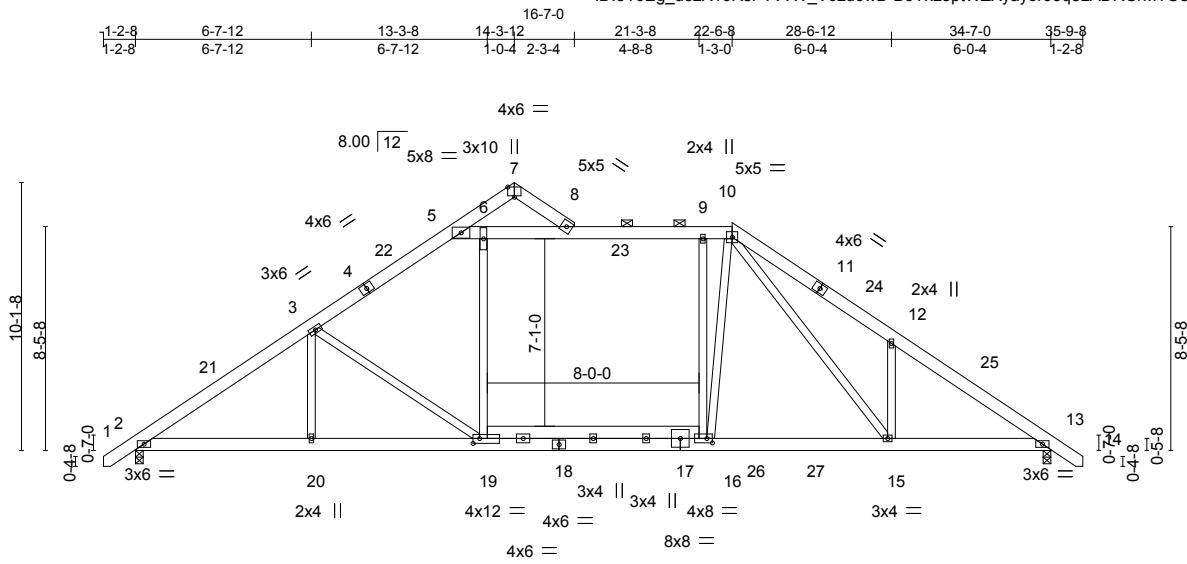

Scale = 1:87.0




Plate Offsets (X, Y)-- [7:0-3-0,Edge], [16:0-2-8,0-2-0], [19:0-3-0,0-2-4]


| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.75  | Vert(LL) | -0.29    | 15-16  | >999 | MT20           | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.75  | Vert(CT) | -0.42    | 15-16  | >981 |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.44  | Horz(CT) | 0.06     | 13     | n/a  |                |          |
| BCDL 10.0     | Code IRC2015/TP12014 |       | Matrix-S | Wind(LL) | 0.14     | 15-16  | >999 |                |          |
|               |                      |       |          |          |          |        |      | Weight: 283 lb | FT = 20% |

| LUMBER-               | BRACING-   |
|-----------------------|--|
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-1-5 oc purlins, except |
| BOT CHORD 2x6 SP No.1 | 2-0-0 oc purlins (5-4-1 max.): 5-10.   |
| WEBS 2x4 SP No.2      | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                   |

**REACTIONS.** (size) 2=0-3-8, 13=0-3-8  
 Max Horz 2=246(LC 11)  
 Max Uplift 2=-78(LC 12), 13=-113(LC 13)  
 Max Grav 2=1561(LC 19), 13=1581(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2239/411, 3-5=-1946/447, 5-6=-1615/445, 6-8=-1615/445, 8-9=-1679/451,  
 9-10=-1683/456, 10-12=-2406/617, 12-13=-2399/437  
 BOT CHORD 2-20=-199/1908, 19-20=-199/1908, 16-19=-101/1743, 15-16=-90/1645, 13-15=-239/1893  
 WEBS 6-19=0/503, 9-16=-313/274, 3-19=-414/204, 12-15=-392/265, 10-15=-249/681,  
 10-16=-235/679

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-0-15 to 3-3-14, Interior(1) 3-3-14 to 14-3-12, Exterior(2) 14-3-12 to 16-7-0, Interior(1) 16-7-0 to 22-6-8, Exterior(2) 22-6-8 to 26-11-5, Interior(1) 26-11-5 to 35-7-15 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 2 and 113 lb uplift at joint 13.
  - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 23, 2023




|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341298 |
| J0923-5138 | C1SG  | GABLE      | 1   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:59 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-bhD3b7mpUvXRQqQqBOLzor4v3YJbbLzSHIEM\_zY6d\_



Scale = 1:22.7

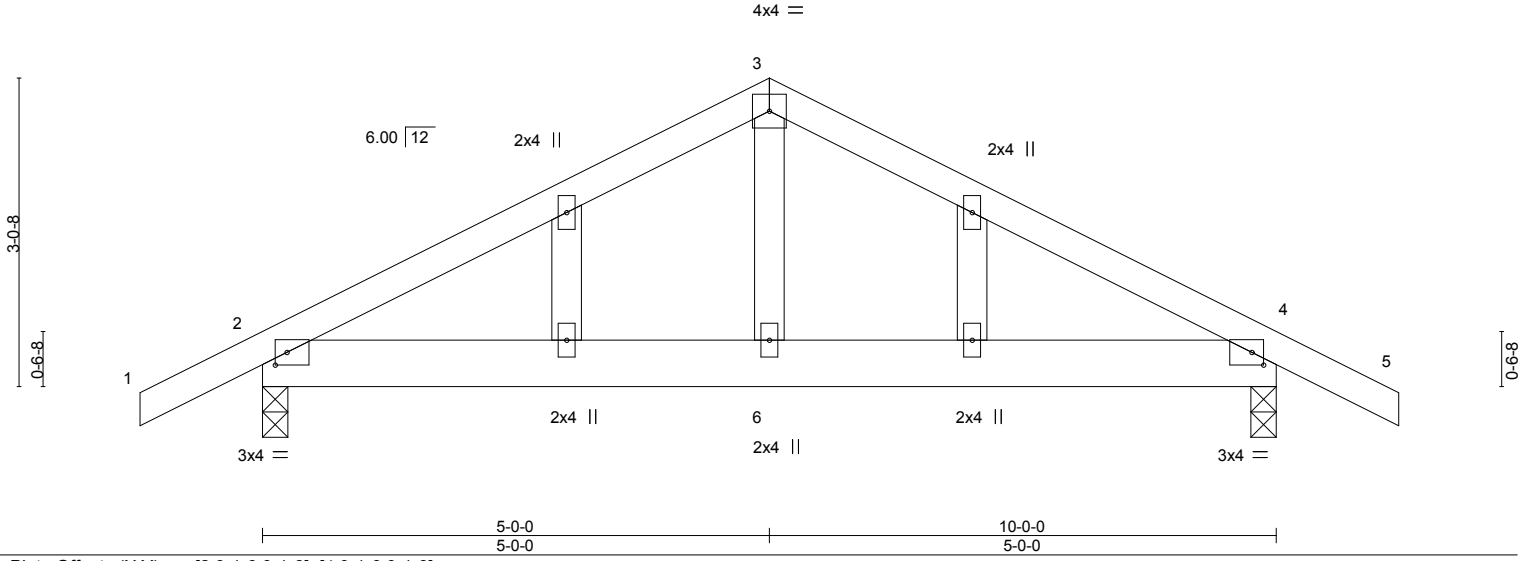


Plate Offsets (X,Y)-- [2:0-1-6,0-1-8], [4:0-1-6,0-1-8]


|                      |                       |             |                                  |               |             |
|----------------------|-----------------------|-------------|----------------------------------|---------------|-------------|
| <b>LOADING</b> (psf) | <b>SPACING-</b> 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b> |
| TCLL 20.0            | Plate Grip DOL 1.15   | TC 0.20     | Vert(LL) 0.02 4-6 >999 240       | MT20          | 244/190     |
| TCDL 10.0            | Lumber DOL 1.15       | BC 0.10     | Vert(CT) -0.01 4-6 >999 240      |               |             |
| BCLL 0.0 *           | Rep Stress Incr YES   | WB 0.05     | Horz(CT) 0.00 4 n/a n/a          |               |             |
| BCDL 10.0            | Code IRC2015/TPI2014  | Matrix-S    |                                  | Weight: 52 lb | FT = 20%    |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| WEBS 2x4 SP No.2      |   |
| OTHERS 2x4 SP No.2    |   |

**REACTIONS.** (size) 2=0-3-0, 4=0-3-0  
 Max Horz 2=63(LC 16)  
 Max Uplift 2=-121(LC 9), 4=-121(LC 8)  
 Max Grav 2=470(LC 1), 4=470(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-515/590, 3-4=-515/590  
 BOT CHORD 2-6=-397/387, 4-6=-397/387  
 WEBS 3-6=-326/240

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Gable studs spaced at 2-0-0 oc.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 2 and 121 lb uplift at joint 4.




March 23, 2023

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341299 |
| J0923-5138 | C2    | COMMON     | 4   | 1   |                                      |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:00 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-3tnSoTsOan1O3ZPcOvvaW0OfaStXK2bi5x2ntQzY6cz



Scale = 1:22.7

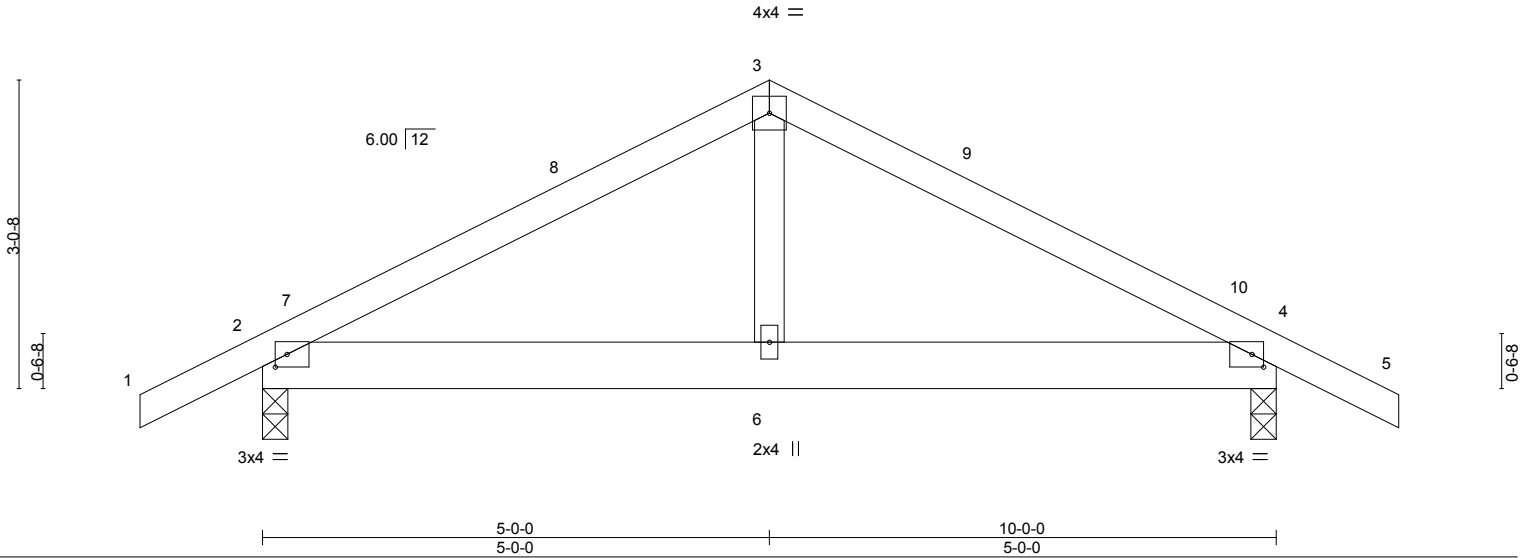

|                       |                                  |
|-----------------------|----------------------------------|
| Plate Offsets (X,Y)-- | [2:0-1-6,0-1-8], [4:0-1-6,0-1-8] |
|-----------------------|----------------------------------|

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.21  | Vert(LL) | -0.01    | 6      | >999 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.10  | Vert(CT) | -0.01    | 4-6    | >999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.05  | Horz(CT) | 0.00     | 4      | n/a  |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-S | Wind(LL) | 0.02     | 4-6    | >999 | Weight: 48 lb | FT = 20% |


| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| WEBS 2x4 SP No.2      |   |

**REACTIONS.** (size) 2=0-3-0, 4=0-3-0  
 Max Horz 2=40(LC 11)  
 Max Uplift 2=-91(LC 9), 4=-91(LC 8)  
 Max Grav 2=470(LC 1), 4=470(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-515/568, 3-4=-515/568  
 BOT CHORD 2-6=-376/387, 4-6=-376/387  
 WEBS 3-6=-327/240

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 5-0-0, Exterior(2) 5-0-0 to 9-4-13, Interior(1) 9-4-13 to 11-2-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 91 lb uplift at joint 2 and 91 lb uplift at joint 4.



March 23, 2023

|   |   |
|---|---|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road<br/>Edenton, NC 27932</p> |
|---|---|

|                   |             |                            |          |          |                                      |           |
|-------------------|-------------|----------------------------|----------|----------|--------------------------------------|-----------|
| Job<br>J0923-5138 | Truss<br>P1 | Truss Type<br>ROOF SPECIAL | Qty<br>7 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett | 157341300 |
|-------------------|-------------|----------------------------|----------|----------|--------------------------------------|-----------|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:01 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-X4Lq0pt0L59Fgj\_oxcQp2DxLisCu3VhrJbnKPtzY6cy  
6-5-0 6-5-0



3x4 || 3 Scale = 1:16.4

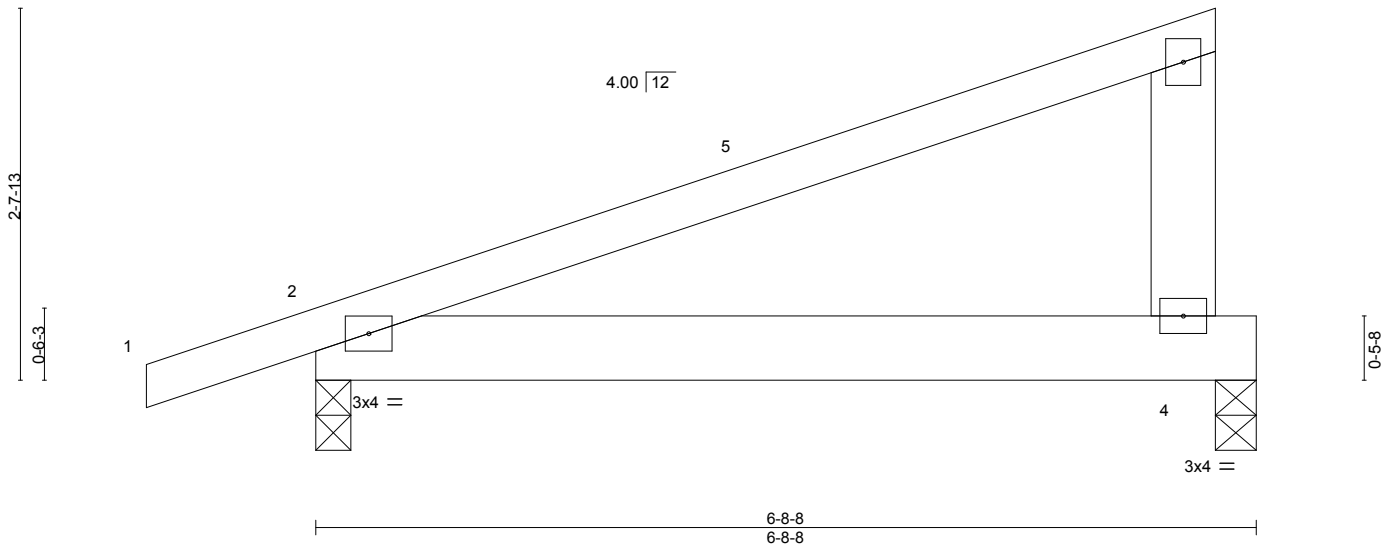

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.57  | Vert(LL) | -0.02 2-4 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.16  | Vert(CT) | -0.04 2-4 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | NO    | WB 0.00  | Horz(CT) | 0.00      | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.04 2-4  | >999   | 240 | Weight: 32 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x6 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 4=0-3-8, 2=0-3-0  
Max Horz 2=85(LC 8)  
Max Uplift 4=-294(LC 8), 2=-134(LC 8)  
Max Grav 4=734(LC 1), 2=331(LC 1)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 6-2-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 294 lb uplift at joint 4 and 134 lb uplift at joint 2.
- 5) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 500 lb down and 669 lb up at 6-2-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 6) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-60, 2-4=-20  
Concentrated Loads (lb)  
Vert: 4=-500(F)

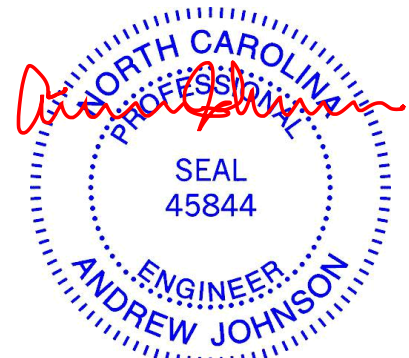

March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932




|                   |             |                        |           |          |                                      |           |
|-------------------|-------------|------------------------|-----------|----------|--------------------------------------|-----------|
| Job<br>J0923-5138 | Truss<br>P2 | Truss Type<br>MONOPICH | Qty<br>10 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett | I57341301 |
|-------------------|-------------|------------------------|-----------|----------|--------------------------------------|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:02 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-?GvCD8ue6PH6ItZ\_VJx2bRTcTGYKoyx?YFXuyJzY6cx

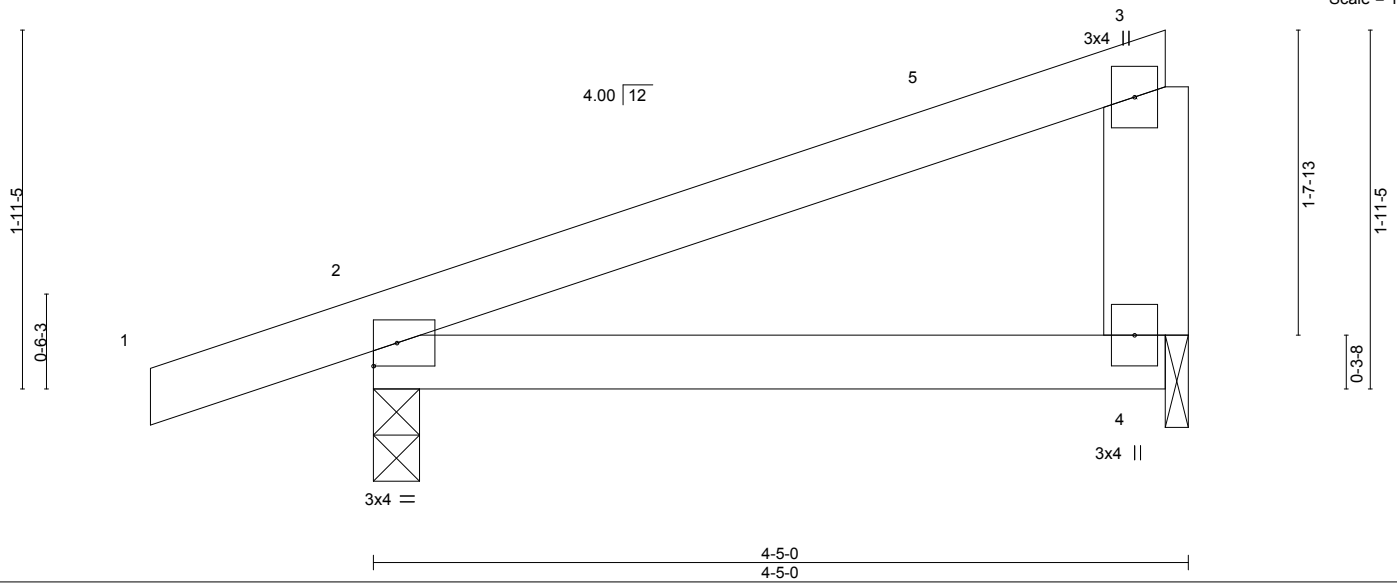


| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.18  | Vert(LL) | -0.01 2-4 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.15  | Vert(CT) | -0.03 2-4 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | 0.00      | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.03 2-4  | >999   | 240 | Weight: 18 lb | FT = 20% |

| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-5-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x6 SP No.1      |   |

**REACTIONS.** (size) 2=0-3-0, 4=0-1-8  
 Max Horz 2=62(LC 8)  
 Max Uplift 2=-109(LC 8), 4=-65(LC 8)  
 Max Grav 2=256(LC 1), 4=149(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 4-2-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 2 and 65 lb uplift at joint 4.




March 23, 2023

|                   |             |                        |          |          |  |           |
|-------------------|-------------|------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>P3 | Truss Type<br>MONOPICH | Qty<br>3 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | I57341302 |
|-------------------|-------------|------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:04 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-yf1yeqvve0XpXBjNdkzWgsYvs4FIGrQIOZ0\_0BzY6cv  
5-9-8 5-9-8

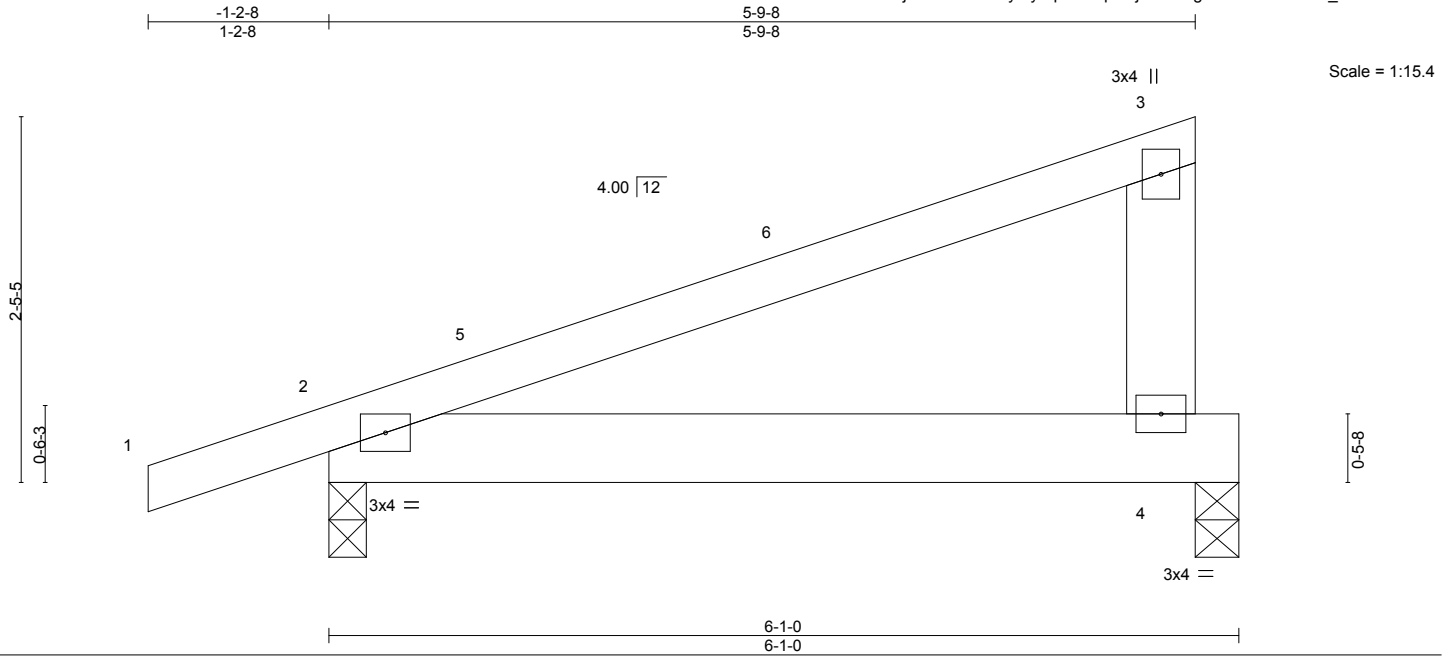

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.38  | Vert(LL) | -0.01 2-4 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.11  | Vert(CT) | -0.02 2-4 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | 0.00      | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.03 2-4  | >999   | 240 | Weight: 29 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x6 SP No.1

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 4=0-3-8, 2=0-3-0  
 Max Horz 2=78(LC 8)  
 Max Uplift 4=90(LC 8), 2=127(LC 8)  
 Max Grav 4=208(LC 1), 2=307(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 5-6-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 4 and 127 lb uplift at joint 2.




March 23, 2023

|                   |              |                         |           |          |                                      |           |
|-------------------|--------------|-------------------------|-----------|----------|--------------------------------------|-----------|
| Job<br>J0923-5138 | Truss<br>XA1 | Truss Type<br>JACK-OPEN | Qty<br>14 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett | 157341303 |
|-------------------|--------------|-------------------------|-----------|----------|--------------------------------------|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:05 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-QrblsAwXPKfg9LHZASVID350XTaG?IgREDIYYezY6cu  
6-0-0  
6-0-0

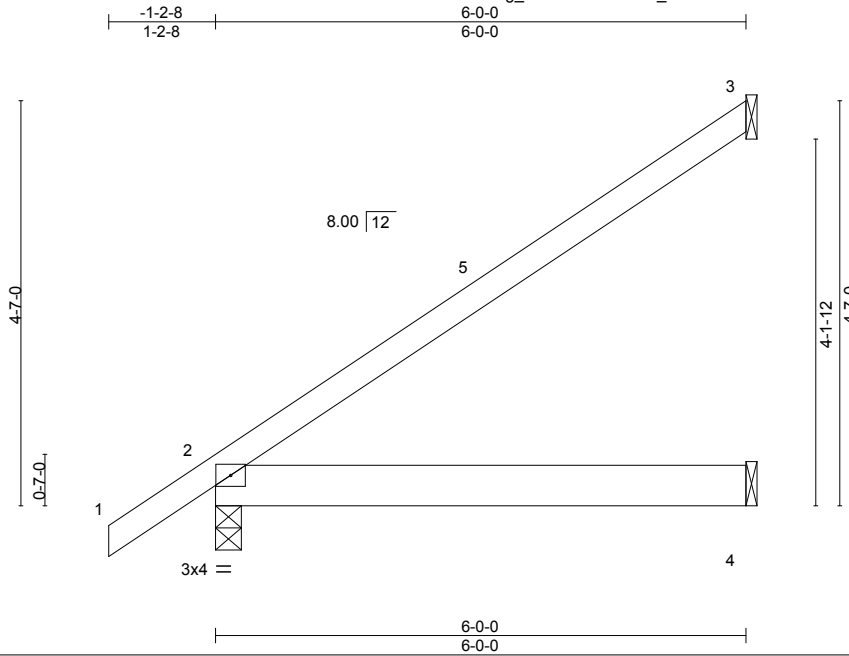

| LOADING (psf) | SPACING-             | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.51  | Vert(LL) | -0.02 2-4 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.13  | Vert(CT) | -0.03 2-4 | >999   | 240 |               |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.00  | Horz(CT) | -0.00 3   | n/a    | n/a |               |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-P | Wind(LL) | 0.00 2    | ****   | 240 |               |          |
|               | Code IRC2015/TPI2014 |          |          |           |        |     | Weight: 27 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=151(LC 12)  
Max Uplift 3=105(LC 12)  
Max Grav 3=184(LC 19), 2=322(LC 1), 4=116(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 5-11-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 105 lb uplift at joint 3.



March 23, 2023



|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341305 |
| J0923-5138 | XB2   | JACK-OPEN  | 2   | 1   |                                      |           |

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:07 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-MEi5GsynxwOPeRyItXDIUATfHhTCaKiXEfdWzY6cs

Job Reference (optional)



Scale = 1:13.1

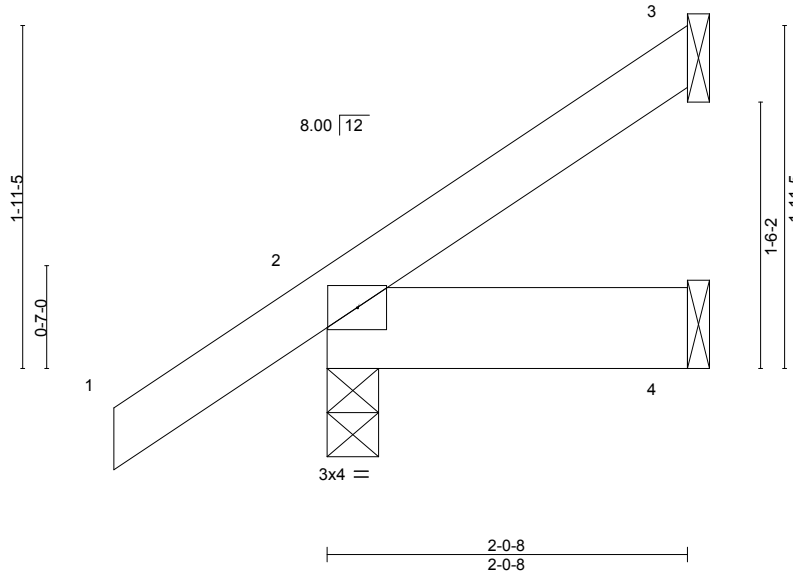

| LOADING (psf) | SPACING-             | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.09  | Vert(LL) | -0.00    | 2      | >999 | MT20          | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.01  | Vert(CT) | -0.00    | 2      | >999 |               |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.00  | Horz(CT) | 0.00     | 3      | n/a  |               |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-P | Wind(LL) | 0.00     | 2      | **** |               |          |
|               | Code IRC2015/TPI2014 |          |          |          |        |      | Weight: 11 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x6 SP No.1

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 2-0-8 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
 Max Horz 2=65(LC 12)  
 Max Uplift 3=-29(LC 12), 2=-16(LC 12)  
 Max Grav 3=34(LC 19), 2=185(LC 1), 4=37(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 3 and 16 lb uplift at joint 2.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
 Edenton, NC 27932



|                   |              |                         |          |          |  |           |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>YA1 | Truss Type<br>JACK-OPEN | Qty<br>4 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | I57341306 |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:08 2023 Page 1

ID:3YJeg\_u8zX16RsP?VvW\_V6zd0wB-qQGTUCyPiF2F0o08sa2SqqjeedrCfQtwB\_C9zzY6cr



Scale = 1:12.6

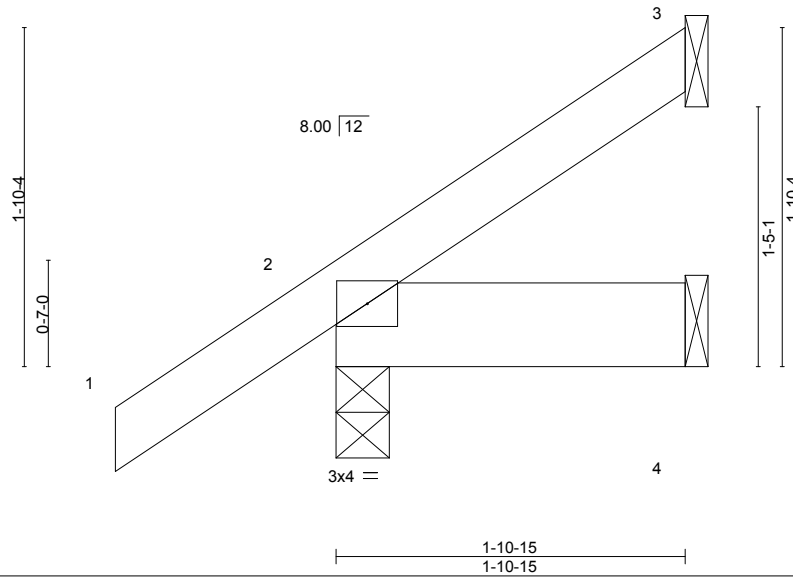

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.08  | Vert(LL) | -0.00    | 2 >999 | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.01  | Vert(CT) | -0.00    | 2 >999 | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | 0.00     | 3 n/a  | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00     | 2 **** | 240 |               |          |
|               |                      |       |          |          |          |        |     | Weight: 10 lb | FT = 20% |

| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.              |

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
 Max Horz 2=63(LC 12)  
 Max Uplift 3=-29(LC 12), 2=-15(LC 12)  
 Max Grav 3=40(LC 19), 2=174(LC 1), 4=37(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 3 and 15 lb uplift at joint 2.




March 23, 2023

|                   |              |                         |          |          |  |           |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>YA2 | Truss Type<br>JACK-OPEN | Qty<br>4 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341307 |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:09 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-IcqrhYz1TYA6eybLPiZhNvGnG5zUx6g19rjhhPzY6cc  
3-10-15 3-10-15

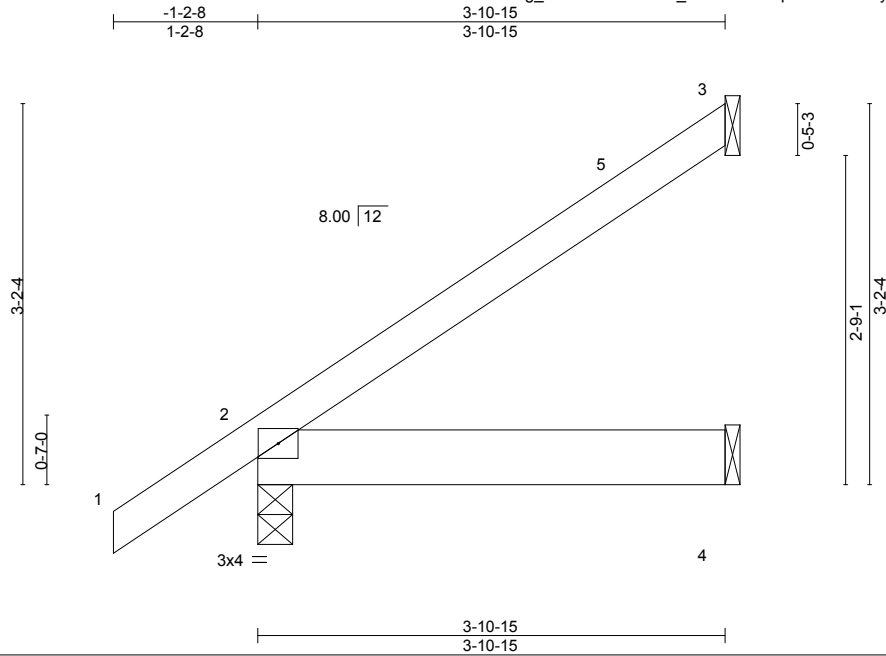

Scale = 1:19.3

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.21  | Vert(LL) | -0.00 2-4 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.05  | Vert(CT) | -0.01 2-4 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | -0.00 3   | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00 2    | ****   | 240 | Weight: 19 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=106(LC 12)  
Max Uplift 3=-66(LC 12), 2=-6(LC 12)  
Max Grav 3=110(LC 19), 2=244(LC 1), 4=74(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 3-10-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 66 lb uplift at joint 3 and 6 lb uplift at joint 2.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

|                   |              |                               |          |          |  |           |
|-------------------|--------------|-------------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>YA3 | Truss Type<br>Half Hip Girder | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341308 |
|-------------------|--------------|-------------------------------|----------|----------|--|-----------|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:10 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-moODvt\_gDszG6AXz74ww7ozUUJ6gZvAOVTJErzY6cp



Scale = 1:13.0

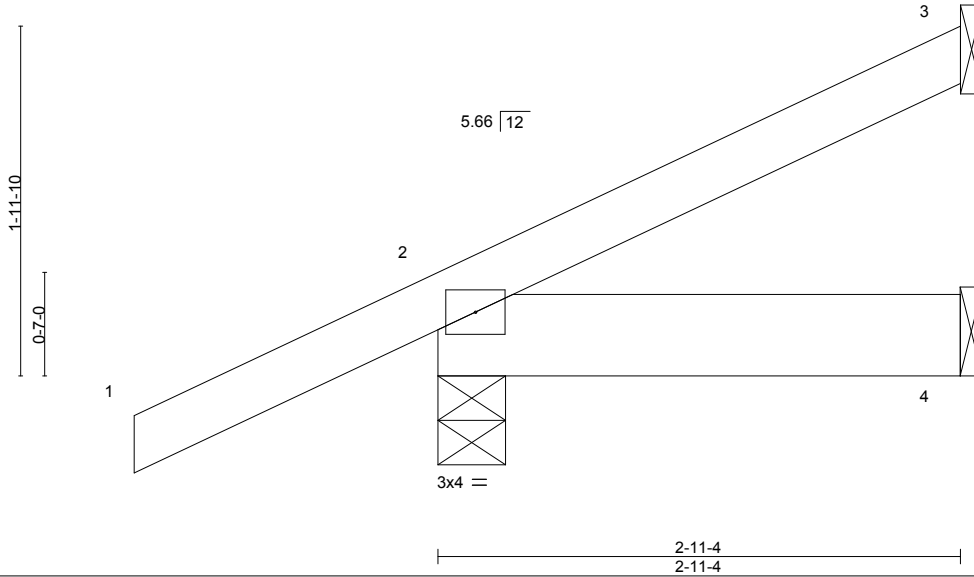

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES | GRIP          |          |
|---------------|----------------------|-------|----------|----------|----------|--------|------|--------|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.18  | Vert(LL) | -0.00    | 2      | >999 | 360    | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.02  | Vert(CT) | -0.00    | 2-4    | >999 | 240    |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | -0.00    | 3      | n/a  | n/a    |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00     | 2      | **** | 240    |               |          |
|               |                      |       |          |          |          |        |      |        | Weight: 15 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-11-4 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-4-9, 4=Mechanical  
Max Horz 2=66(LC 12)  
Max Uplift 3=-31(LC 12), 2=-34(LC 12)  
Max Grav 3=40(LC 1), 2=262(LC 1), 4=54(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 3 and 34 lb uplift at joint 2.

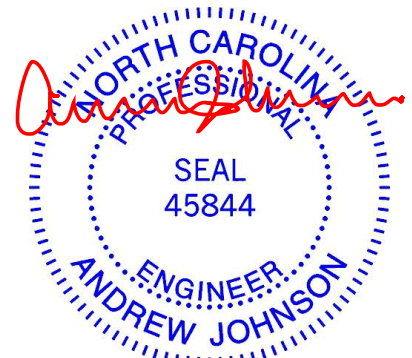

March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

|                   |              |                         |          |          |  |           |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>YB1 | Truss Type<br>JACK-OPEN | Qty<br>4 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341309 |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:11 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-E?yc6D?l\_AQqtGijXicASKL9tufaP09Kd9CsmHzY6co

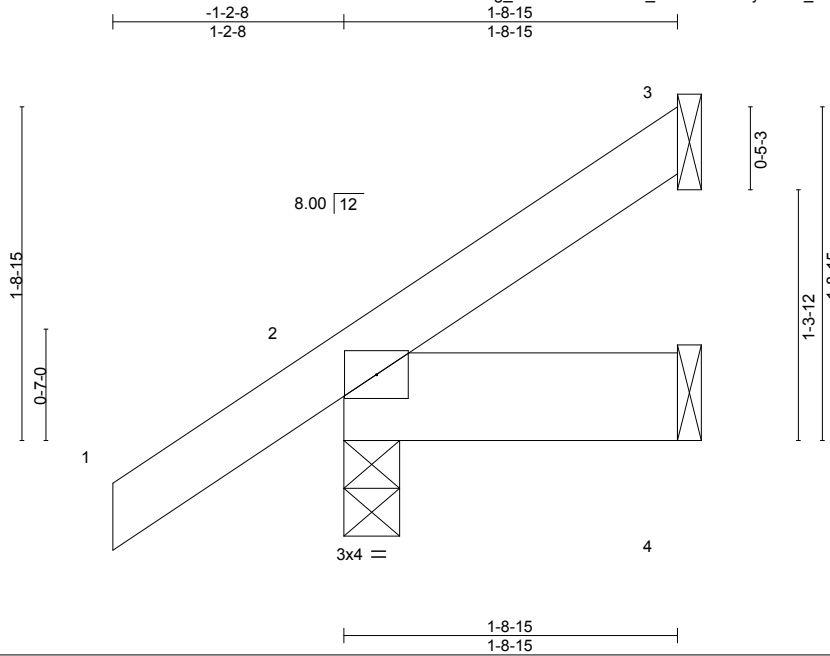

Scale: 1"=1'

| LOADING (psf) | SPACING-             | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.08  | Vert(LL) | -0.00    | 2      | >999 | MT20          | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.01  | Vert(CT) | -0.00    | 2      | >999 |               |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.00  | Horz(CT) | 0.00     | 3      | n/a  |               |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-P | Wind(LL) | 0.00     | 2      | **** | Weight: 10 lb | FT = 20% |
|               | Code IRC2015/TPI2014 |          |          |          |        |      |               |          |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 1-8-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=60(LC 12)  
Max Uplift 3=-25(LC 12), 2=-17(LC 12)  
Max Grav 3=32(LC 19), 2=169(LC 1), 4=34(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 3 and 17 lb uplift at joint 2.

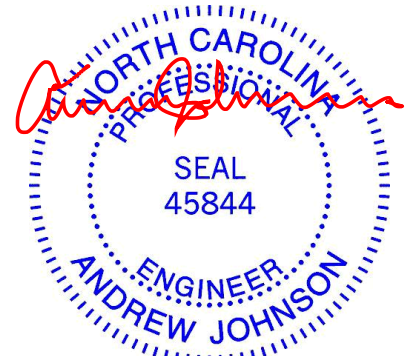

March 23, 2023


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932

|   |       |            |     |     |                                      |  |
|---|-------|------------|-----|-----|--------------------------------------|--|
| Job                                     | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341310  |
| J0923-5138                              | YB2   | JACK-OPEN  | 4   | 1   |                                      |  |
| Comtech, Inc. Fayetteville, NC - 28314, |       |            |     |     |                                      | 8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:12 2023 Page 1  |
|   |       |            |     |     |                                      | ID:3YJEq_u8zX16RsP?VvW_V6zd0wB-jBW_KZ?wITyhVPKv5Q7P?Yulni?G8TPTroyQlkzY6cn |
|   |       |            |     |     |                                      | Job Reference (optional)   |

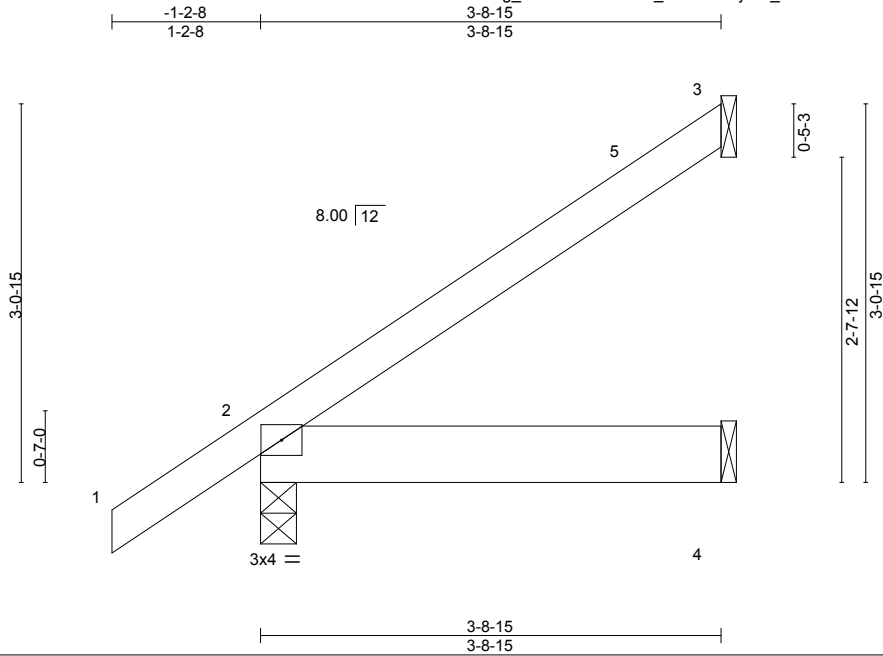

Scale = 1:18.7

| LOADING (psf) | SPACING-             | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | 2-0-0                | TC 0.19  | Vert(LL) | -0.00    | 2-4    | >999 | MT20          | 244/190  |
| TCDL 10.0     | Plate Grip DOL 1.15  | BC 0.04  | Vert(CT) | -0.00    | 2-4    | >999 |               |          |
| BCLL 0.0 *    | Lumber DOL 1.15      | WB 0.00  | Horz(CT) | -0.00    | 3      | n/a  |               |          |
| BCDL 10.0     | Rep Stress Incr YES  | Matrix-P | Wind(LL) | 0.00     | 2      | **** | Weight: 18 lb | FT = 20% |
|               | Code IRC2015/TPI2014 |          |          |          |        |      |               |          |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-8-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=102(LC 12)  
Max Uplift 3=-63(LC 12), 2=-7(LC 12)  
Max Grav 3=104(LC 19), 2=238(LC 1), 4=71(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 3-8-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 3 and 7 lb uplift at joint 2.




|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341311 |
| J0923-5138 | YP1   | JACK-OPEN  | 4   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:13 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfh3PFB-BN4MXv0YWngY7Zv6e7eeXIQVDiKetwfc4ShzqAzY6cm

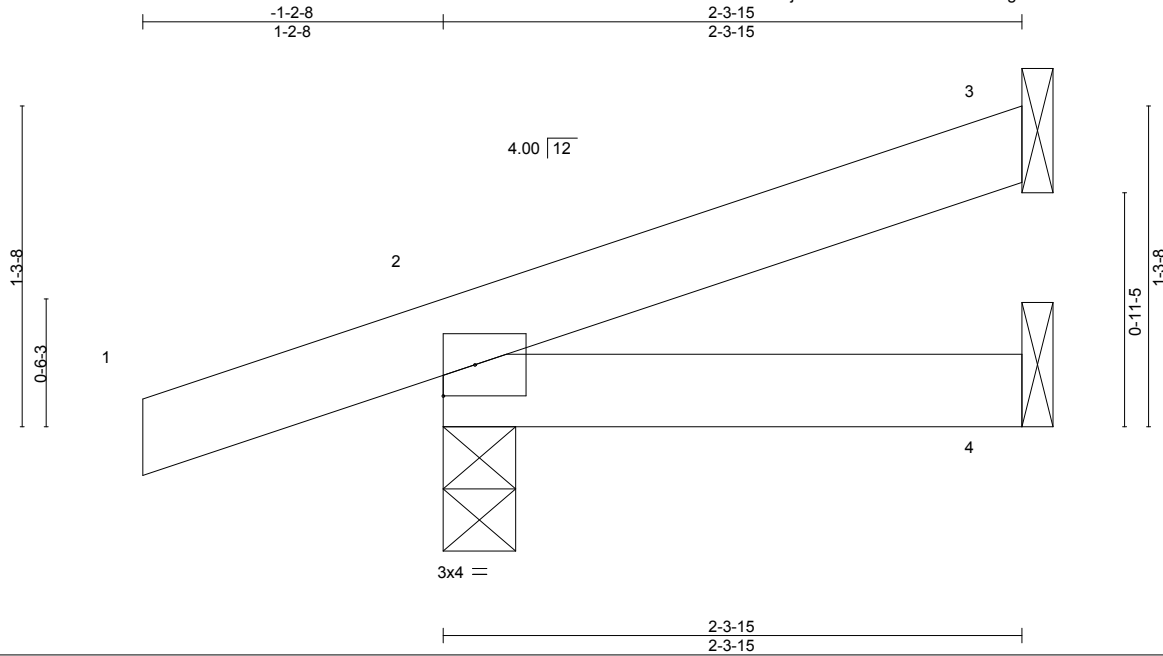

Scale = 1:9.3

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES       | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|--------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.09  | Vert(LL) | -0.00 2-4 | >999   | 360 | MT20         | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.04  | Vert(CT) | -0.00 2-4 | >999   | 240 |              |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | -0.00 3   | n/a    | n/a |              |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00 2    | ****   | 240 | Weight: 9 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x4 SP No.1


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 2-3-15 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
 Max Horz 2=41(LC 8)  
 Max Uplift 3=-23(LC 12), 2=-67(LC 8)  
 Max Grav 3=38(LC 1), 2=192(LC 1), 4=42(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 3 and 67 lb uplift at joint 2.

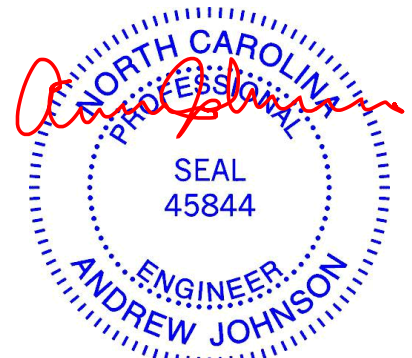

March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
 Edenton, NC 27932




|                   |              |                         |          |          |                                      |           |
|-------------------|--------------|-------------------------|----------|----------|--------------------------------------|-----------|
| Job<br>J0923-5138 | Truss<br>YP2 | Truss Type<br>JACK-OPEN | Qty<br>2 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett | 157341312 |
|-------------------|--------------|-------------------------|----------|----------|--------------------------------------|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:14 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-fadklF1AH5oPkjTICr9t4zzel6e3cNvmJ6RWnczY6cl

Job Reference (optional)

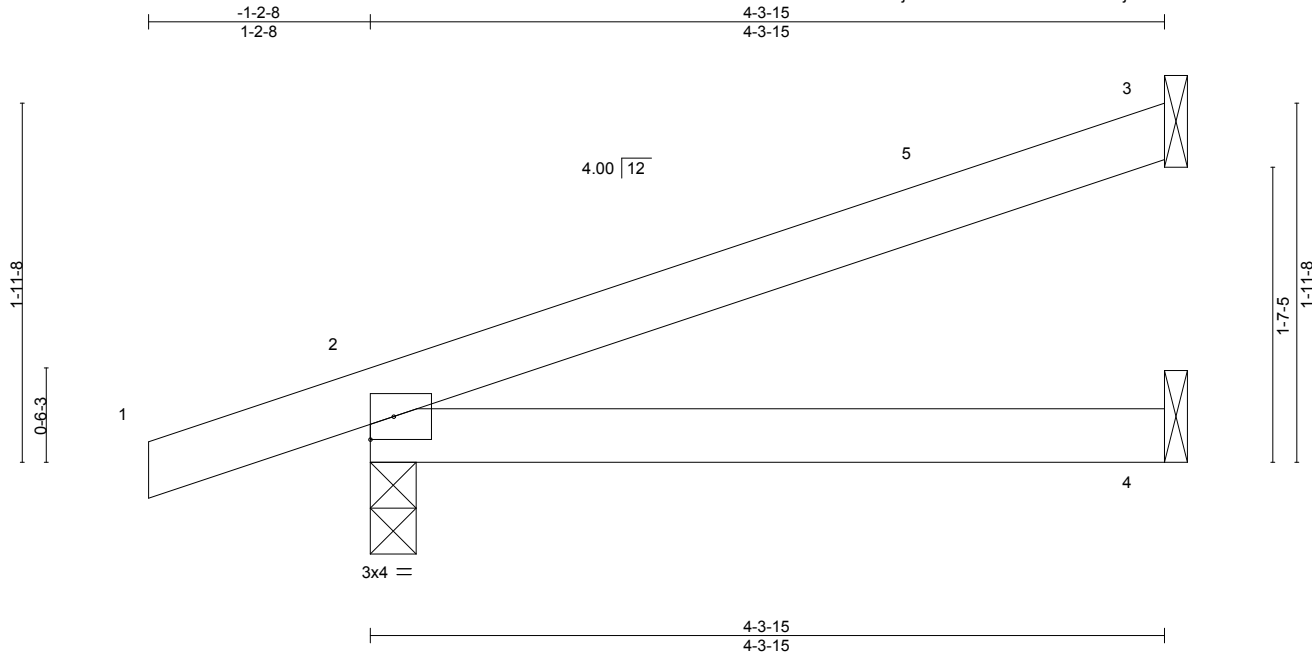

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.19  | Vert(LL) | -0.02    | 2-4    | >999 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.15  | Vert(CT) | -0.03    | 2-4    | >999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.00  | Horz(CT) | -0.00    | 3      | n/a  |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00     | 2      | **** | Weight: 15 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-3-15 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-0, 4=Mechanical  
Max Horz 2=62(LC 8)  
Max Uplift 3=-50(LC 12), 2=-63(LC 8)  
Max Grav 3=111(LC 1), 2=259(LC 1), 4=83(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -1-2-8 to 3-2-5, Interior(1) 3-2-5 to 4-3-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 3 and 63 lb uplift at joint 2.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

|            |       |                     |     |     |                                      |           |
|------------|-------|---------------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type          | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341313 |
| J0923-5138 | ZA1   | DIAGONAL HIP GIRDER | 2   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:16 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0WB-byIV9x3Qpi26\_1dhKGBL9O2\_YvLT4F83mQwdRVzY6cj

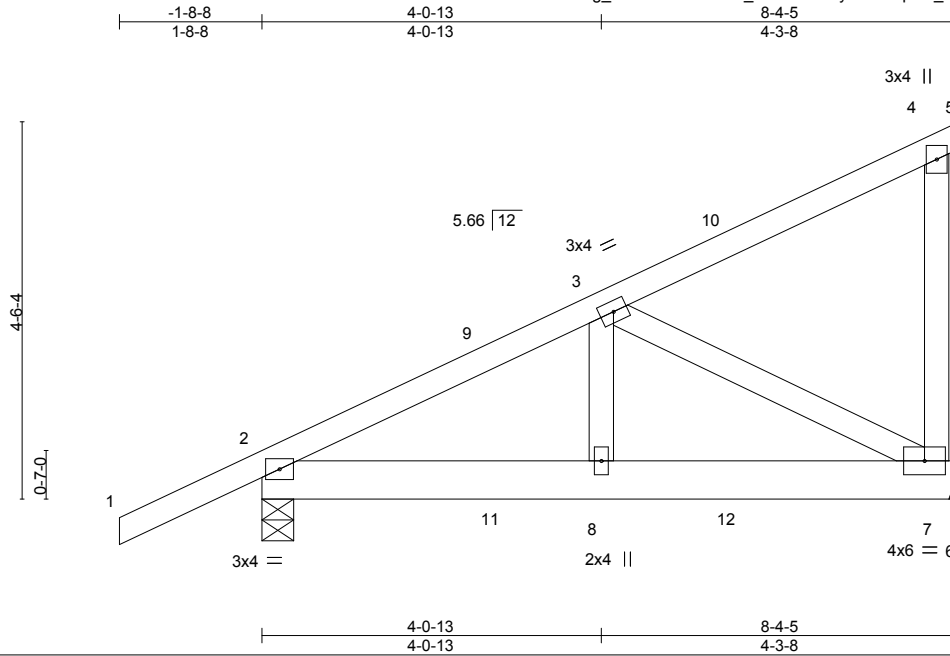

Scale = 1:27.6

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.21  | Vert(LL) | -0.00    | 7-8    | >999 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.09  | Vert(CT) | -0.01    | 7-8    | >999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | NO    | WB 0.15  | Horz(CT) | 0.00     | 7      | n/a  |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00     | 8      | >999 |               |          |
|               |                      |       |          |          |          |        |      | Weight: 51 lb | FT = 20% |

**LUMBER-**

TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 7=Mechanical, 2=0-4-9  
 Max Horz 2=150(LC 8)  
 Max Uplift 7=-110(LC 8), 2=-50(LC 8)  
 Max Grav 7=353(LC 29), 2=456(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-523/31  
 BOT CHORD 2-8=-118/381, 7-8=-118/381  
 WEBS 3-7=-430/133

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 2.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 75 lb down and 33 lb up at 2-9-8, 75 lb down and 33 lb up at 2-9-8, and 107 lb down and 84 lb up at 5-7-7, and 107 lb down and 84 lb up at 5-7-7 on top chord, and 2 lb down at 2-9-8, 2 lb down at 2-9-8, and 20 lb down at 5-7-7, and 20 lb down at 5-7-7 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-60, 4-5=-20, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-23(F=-11, B=-11) 12=-17(F=-9, B=-9)

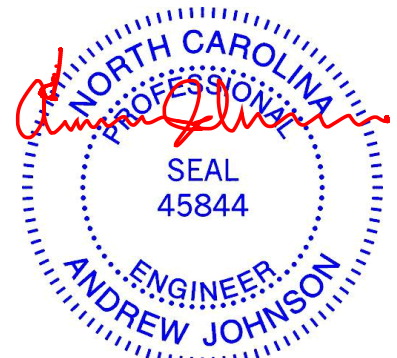

March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

|            |       |                     |     |     |                                      |           |
|------------|-------|---------------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type          | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341314 |
| J0923-5138 | ZB1   | DIAGONAL HIP GIRDER | 2   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:17 2023 Page 1  
 ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-39JtNH33a0AzBcTtziabb9HJhpicC?4fA\_xzY6ci

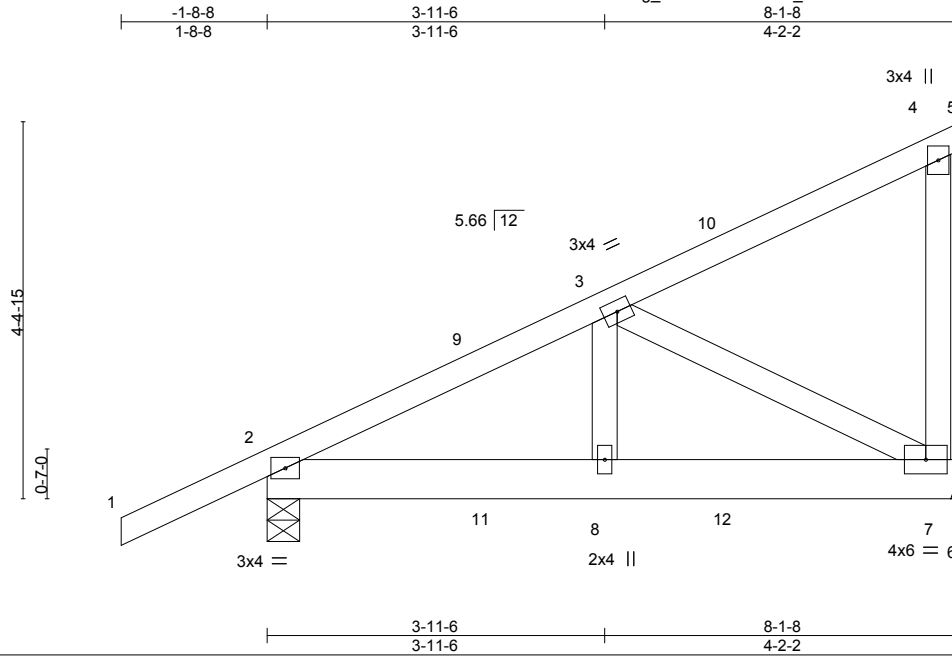

Scale = 1:27.0

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.21  | Vert(LL) | -0.00 7-8 | >999   | 360 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.08  | Vert(CT) | -0.01 7-8 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | NO    | WB 0.13  | Horz(CT) | 0.00 7    | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00 8    | >999   | 240 |               |          |
|               |                      |       |          |          |           |        |     | Weight: 49 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=Mechanical, 2=0-4-9  
 Max Horz 2=146(LC 8)  
 Max Uplift 7=-104(LC 8), 2=-48(LC 8)  
 Max Grav 7=336(LC 29), 2=443(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-502/26  
 BOT CHORD 2-8=-112/361, 7-8=-112/361  
 WEBS 3-7=-408/127

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 104 lb uplift at joint 7 and 48 lb uplift at joint 2.
  - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 74 lb down and 28 lb up at 2-6-11, 74 lb down and 28 lb up at 2-6-11, and 104 lb down and 79 lb up at 5-4-10, and 104 lb down and 79 lb up at 5-4-10 on top chord, and 0 lb down at 2-6-11, 0 lb down at 2-6-11, and 18 lb down at 5-4-10, and 18 lb down at 5-4-10 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-60, 4-5=-20, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-11(F=-6, B=-6) 12=-14(F=-7, B=-7)

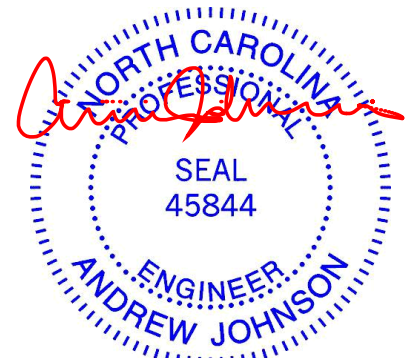

March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

|                   |              |                         |          |          |  |           |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|
| Job<br>J0923-5138 | Truss<br>ZB2 | Truss Type<br>JACK-OPEN | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | I57341315 |
|-------------------|--------------|-------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:18 2023 Page 1

ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-XLlFad4hLJlqDKn3RgEp8Jcj21YBuMEKPkWOzY6ch

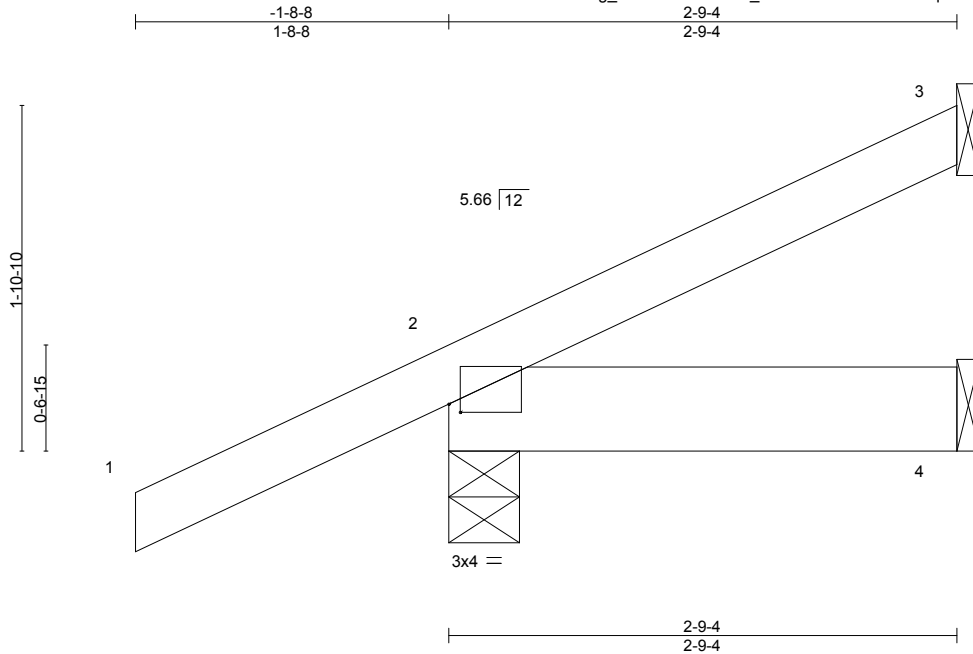

Scale = 1:12.6

|                       |                       |             |                                  |               |             |
|-----------------------|-----------------------|-------------|----------------------------------|---------------|-------------|
| Plate Offsets (X,Y)-- | [2:0-0-12,0-0-9]      |             |                                  |               |             |
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b> |
| TCLL 20.0             | Plate Grip DOL 1.15   | TC 0.30     | Vert(LL) -0.00 2 >999 360        | MT20          | 244/190     |
| TCDL 10.0             | Lumber DOL 1.15       | BC 0.02     | Vert(CT) -0.00 2-4 >999 240      |               |             |
| BCLL 0.0 *            | Rep Stress Incr YES   | WB 0.00     | Horz(CT) -0.00 3 n/a n/a         |               |             |
| BCDL 10.0             | Code IRC2015/TPI2014  | Matrix-P    | Wind(LL) 0.00 2 **** 240         | Weight: 14 lb | FT = 20%    |

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-9-4 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-4-10, 4=Mechanical  
Max Horz 2=64(LC 12)  
Max Uplift 3=28(LC 12), 2=35(LC 12)  
Max Grav 3=32(LC 1), 2=258(LC 1), 4=50(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Corner(3) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 3 and 35 lb uplift at joint 2.



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932

|            |       |                     |     |     |                                      |           |
|------------|-------|---------------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type          | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341316 |
| J0923-5138 | ZP1   | DIAGONAL HIP GIRDER | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:19 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-?XRdoy5J6dQhrUMG?OI2n0gVj7KKGHeHVS08H2qzY6cg



Scale = 1:14.7

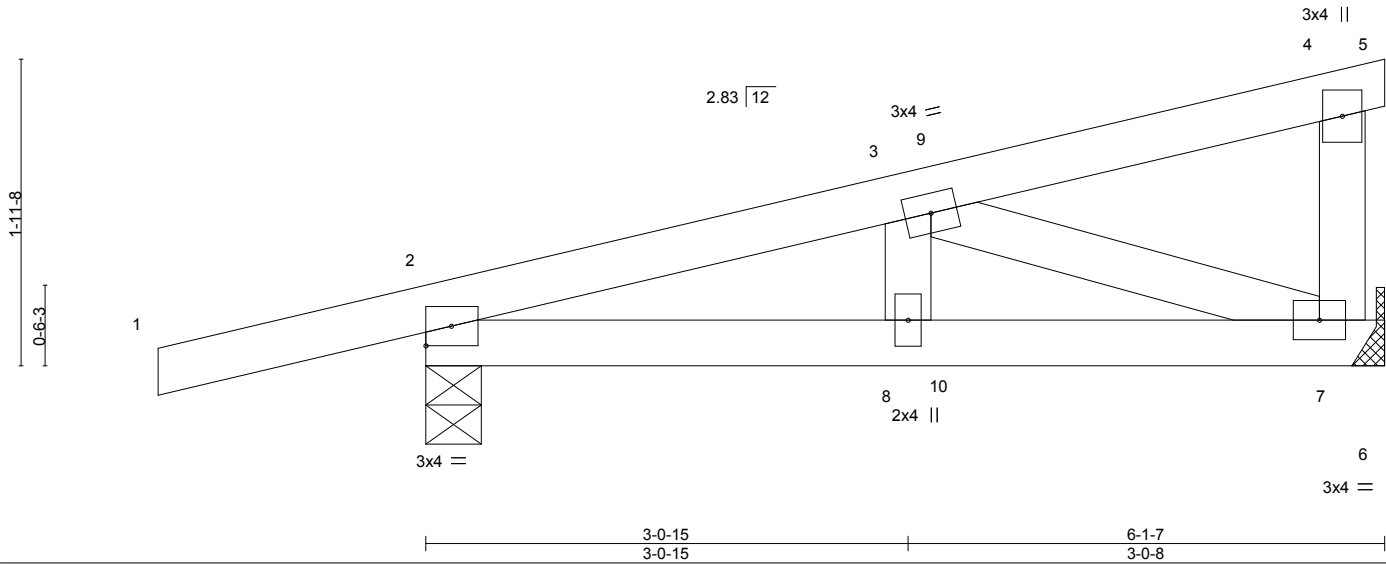

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|------|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.21  | Vert(LL) | -0.00    | 8      | >999 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.21  | Vert(CT) | -0.01    | 8      | >999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | NO    | WB 0.06  | Horz(CT) | 0.00     | 7      | n/a  |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P | Wind(LL) | 0.00     | 8      | >999 | Weight: 28 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x4 SP No.1  
 WEBS 2x4 SP No.2

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=Mechanical, 2=0-4-4  
 Max Horz 2=63(LC 19)  
 Max Uplift 7=-28(LC 8), 2=-96(LC 4)  
 Max Grav 7=219(LC 1), 2=359(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-360/8  
 BOT CHORD 2-8=-40/308, 7-8=-40/308  
 WEBS 3-7=-325/42

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 7 and 96 lb uplift at joint 2.
  - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 18 lb down and 20 lb up at 3-4-9, and 18 lb down and 20 lb up at 3-4-9 on top chord, and 4 lb down at 3-4-9, and 4 lb down at 3-4-9 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-60, 4-5=-20, 2-6=-20



March 23, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
 Edenton, NC 27932

|            |       |                     |     |     |                                      |           |
|------------|-------|---------------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type          | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341317 |
| J0923-5138 | ZP2   | DIAGONAL HIP GIRDER | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:04:21 2023 Page 1

ID:F7e3nXrh6oAXz?Vjil5mfhz3PFB-ywYODE6ZeEgP4oWe6pnWsRmoRw?glUoowidO7izY6ce



Scale = 1:19.6

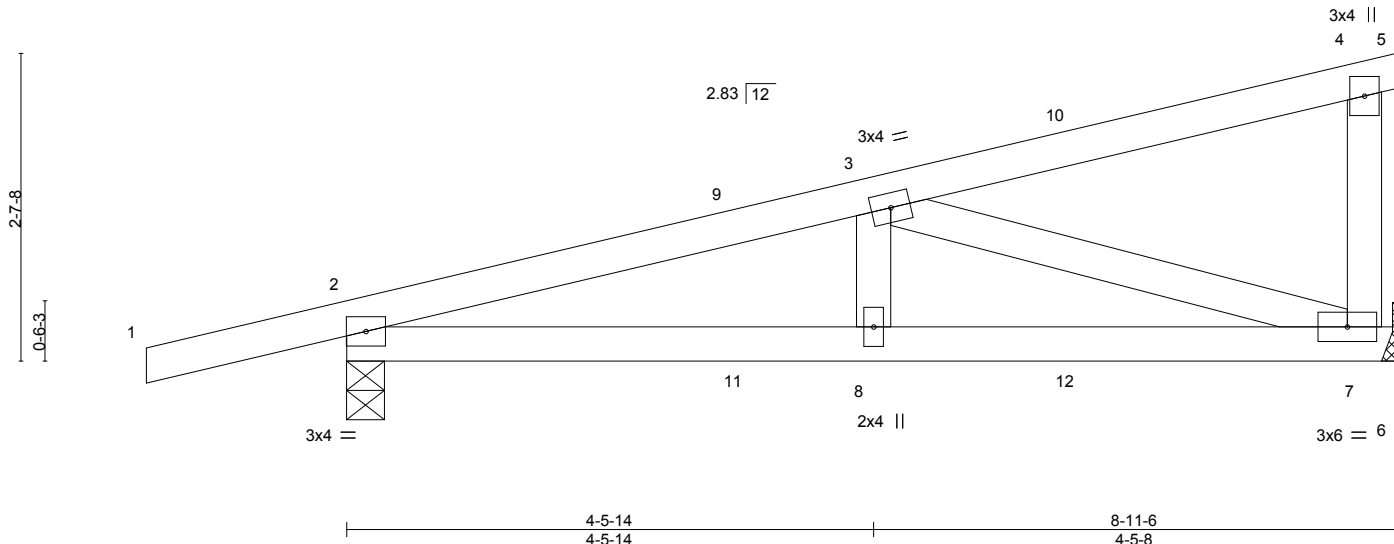

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.15  | TC 0.33  | Vert(LL) | 0.03 2-8  | >999   | 240 | MT20          | 244/190  |
| TCDL 10.0     | Lumber DOL           | 1.15  | BC 0.28  | Vert(CT) | -0.04 7-8 | >999   | 240 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | NO    | WB 0.25  | Horz(CT) | 0.01 7    | n/a    | n/a |               |          |
| BCDL 10.0     | Code IRC2015/TPI2014 |       | Matrix-P |          |           |        |     | Weight: 40 lb | FT = 20% |

**LUMBER-**  
 TOP CHORD 2x4 SP No.1  
 BOT CHORD 2x4 SP No.1  
 WEBS 2x4 SP No.2

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=Mechanical, 2=0-3-14  
 Max Horz 2=84(LC 4)  
 Max Uplift 7=-153(LC 4), 2=-204(LC 4)  
 Max Grav 7=396(LC 1), 2=488(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-777/243  
 BOT CHORD 2-8=-279/710, 7-8=-279/710  
 WEBS 3-7=-742/292

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 153 lb uplift at joint 7 and 204 lb uplift at joint 2.
  - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 18 lb down and 20 lb up at 3-4-9, 18 lb down and 20 lb up at 3-4-9, and 46 lb down and 62 lb up at 6-2-8, and 46 lb down and 62 lb up at 6-2-8 on top chord, and 4 lb down at 3-4-9, 4 lb down at 3-4-9, and 26 lb down at 6-2-8, and 26 lb down at 6-2-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-60, 4-5=-20, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-53(F=-26, B=-26) 12=-26(F=-13, B=-13)




**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)






# Symbols


## PLATE LOCATION AND ORIENTATION

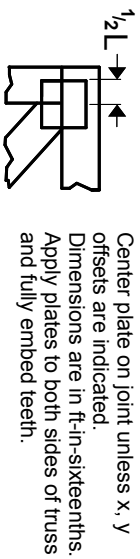

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

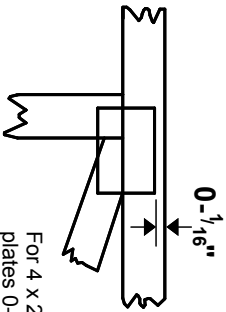

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

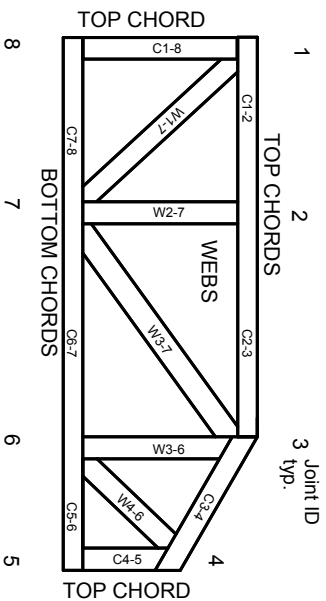

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

**MITek**

ENGINEERING BY  
**TRANGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MI-7473 rev. 1/2/2023

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor 1 bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

# Reaction Summary of Order






























**ROOF & FLOOR TRUSSES & BEAMS**  
 Reilly Road Industrial Park P.O. Box 40408  
 Fayetteville, N.C. 28309 (910) 864-TRUS

|                 |                 |                 |              |
|-----------------|-----------------|-----------------|--------------|
| REQ. QUOTE DATE | / /             | ORDER #         | J0923-5139   |
| ORDER DATE      | 09/15/23        | QUOTE #         |              |
| DELIVERY DATE   | / /             | CUSTOMER ACCT # | 0000007216   |
| DATE OF INVOICE | / /             | CUSTOMER PO #   |              |
| ORDERED BY      | Shaun Garderner | INVOICE #       |              |
| COUNTY          | Harnett         | TERMS           |              |
| SUPERINTENDANT  | Shaun Garderner | SALES REP       | Neil Baggett |
| JOBSITE PHONE # | (910) 988-8172  | SALES AREA      | Neil Baggett |

|         |   |  |   |
|---------|---|--|---|
| SOLD TO | <b>Precision Custom Homes</b><br>206 Shoreline Drive<br>Raeford, NC 28376<br>(910) 988-8172 | <b>JOB NAME:</b> 63 Liberty Meadows<br><b>MODEL:</b> Floor <b>TAG:</b> Hayek<br><b>DELIVERY INSTRUCTIONS:</b><br>52 MILES ROUND TRIP | <b>LOT #</b> 63 <b>SUBDIV:</b> Liberty Meadows<br><b>JOB CATEGORY:</b> B & S - Build and Ship |
|         | SHIPP TO  | <b>Precision Custom Homes and</b><br>57 Rush Lane<br>Cameron, NC   | <b>SPECIAL INSTRUCTIONS:</b><br>Like 27 Liberty Meadows                                       |

|                                    |               |             |             |              |                  |           |                     |
|------------------------------------|---------------|-------------|-------------|--------------|------------------|-----------|---------------------|
| BUILDING DEPARTMENT<br>Floor Order | OVERHANG INFO | HEEL HEIGHT | 00-04-05    | REQ. LAYOUTS | REQ. ENGINEERING | QUOTE     | / /                 |
|                                    | END CUT       | RETURN      |             |              |                  | LAYOUT    | NB 11/20/23         |
|                                    | PLUMB         |             | GABLE STUDS | 24 IN. OC    | JOBSITE 1        | JOBSITE 1 | CUTTING NB 11/20/23 |

|                      |                     |                     |              |   |
|----------------------|---------------------|---------------------|--------------|---|
| <b>FLOOR TRUSSES</b> | LOADING INFORMATION | TCLL-TCDL-BCLL-BCDL | STRESS INCR. | FLOOR TRUSS SPACING: 24.0 IN. O.C. (TYP.) |
|                      |                     | 40.0,10.0,0.0,5.0   | 1.00         |   |

| FLOOR PROFILE   | QTY PLY | DEPTH ID     | BASE SPAN | O/A SPAN | END TYPE  |   | INT BEARING |          | REACTIONS                             |  |                                      |                        |                        |
|---|---------|--------------|-----------|----------|---|---|-------------|----------|---------------------------------------|--|--------------------------------------|------------------------|------------------------|
|   |         |              |           |          | LEFT  | RIGHT   | SIZE        | LOCATION |                                       |  |                                      |                        |                        |
|    | 1       | 01-04-00 ET1 | 28-06-08  | 28-06-08 |    |    |             |          | Joint 25<br>6.3 lbs.                  | Joint 26<br>101.5 lbs.                 | Joint 27<br>153.1 lbs.               | Joint 28<br>145.0 lbs. | Joint 29<br>147.1 lbs. |
|    | 1       | 01-04-00 ET2 | 19-05-08  | 19-05-08 |    |    |             |          | Joint 18<br>24.0 lbs.                 | Joint 19<br>111.3 lbs.                 | Joint 20<br>153.0 lbs.               | Joint 21<br>145.1 lbs. | Joint 22<br>147.1 lbs. |
|  | 4       | 01-04-00 F01 | 34-06-00  | 34-06-00 |  |  |             |          | Joint 25<br>841.4 lbs.<br>147.4 lbs.  | Joint 33<br>2183.6 lbs.<br>1363.9 lbs. | Joint 41<br>839.4 lbs.<br>173.1 lbs. |                        |                        |
|  | 3       | 01-04-00 F02 | 28-06-08  | 28-06-08 |  |  |             |          | Joint 20<br>550.9 lbs.<br>33.9 lbs.   | Joint 25<br>1787.4 lbs.<br>945.5 lbs.  | Joint 33<br>869.8 lbs.<br>226.5 lbs. |                        |                        |
|  | 9       | 01-04-00 F03 | 22-03-00  | 22-03-00 |  |  |             |          | Joint 16<br>1203.1 lbs.<br>572.6 lbs. | Joint 27<br>1203.1 lbs.<br>628.3 lbs.  |                                      |                        |                        |
|  | 6       | 01-04-00 F04 | 19-05-08  | 19-05-08 |  |  |             |          | Joint 14<br>1050.2 lbs.<br>498.6 lbs. | Joint 23<br>1050.2 lbs.<br>557.3 lbs.  |                                      |                        |                        |
|  | 2       | 01-04-00 F05 | 17-03-00  | 17-03-00 |  |  |             |          | Joint 13<br>928.8 lbs.<br>449.7 lbs.  | Joint 21<br>928.8 lbs.<br>507.0 lbs.   |                                      |                        |                        |
|  | 2       | 01-04-00 F06 | 13-04-08  | 13-04-08 |  |  |             |          | Joint 10<br>721.9 lbs.<br>499.1 lbs.  | Joint 16<br>715.6 lbs.<br>281.6 lbs.   |                                      |                        |                        |
|  | 4       | 01-04-00 F07 | 13-08-00  | 13-08-00 |  |  |             |          | Joint 10<br>731.7 lbs.<br>495.6 lbs.  | Joint 16<br>731.7 lbs.<br>293.6 lbs.   |                                      |                        |                        |

# Reaction Summary of Order



|                 |                 |                 |              |
|-----------------|-----------------|-----------------|--------------|
| REQ. QUOTE DATE | / /             | ORDER #         | J0923-5139   |
| ORDER DATE      | 09/15/23        | QUOTE #         |              |
| DELIVERY DATE   | / /             | CUSTOMER ACCT # | 0000007216   |
| DATE OF INVOICE | / /             | CUSTOMER PO #   |              |
| ORDERED BY      | Shaun Garderner | INVOICE #       |              |
| COUNTY          | Harnett         | TERMS           |              |
| SUPERINTENDANT  | Shaun Garderner | SALES REP       | Neil Baggett |
| JOBSITE PHONE # | (910) 988-8172  | SALES AREA      | Neil Baggett |

|         |   |  |   |
|---------|---|--|---|
| SOLD TO | <b>Precision Custom Homes</b><br>206 Shoreline Drive<br>Raeford, NC 28376<br>(910) 988-8172 | <b>JOB NAME:</b> 63 Liberty Meadows<br><b>MODEL:</b> Floor <b>TAG:</b> Hayek<br><b>DELIVERY INSTRUCTIONS:</b><br>52 MILES ROUND TRIP | <b>LOT #</b> 63 <b>SUBDIV:</b> Liberty Meadows<br><b>JOB CATEGORY:</b> B & S - Build and Ship |
|         | SHIPP TO  | <b>Precision Custom Homes and</b><br>57 Rush Lane<br>Cameron, NC   | <b>SPECIAL INSTRUCTIONS:</b><br>Like 27 Liberty Meadows                                       |

|                            |                      |                    |                    |                     |                         |              |                            |
|----------------------------|----------------------|--------------------|--------------------|---------------------|-------------------------|--------------|----------------------------|
| <b>BUILDING DEPARTMENT</b> | <b>OVERHANG INFO</b> | <b>HEEL HEIGHT</b> | 00-04-05           | <b>REQ. LAYOUTS</b> | <b>REQ. ENGINEERING</b> | <b>QUOTE</b> | / /                        |
| Floor Order                | END CUT              | RETURN             |                    |                     |                         | LAYOUT       | NB 11/20/23                |
|                            | PLUMB                |                    | <b>GABLE STUDS</b> | 24 IN. OC           | JOBSITE 1               | JOBSITE 1    | <b>CUTTING</b> NB 11/20/23 |

|                      |                            |                     |              |  |
|----------------------|----------------------------|---------------------|--------------|--|
| <b>FLOOR TRUSSES</b> | <b>LOADING INFORMATION</b> | TCLL-TCDL-BCLL-BCDL | STRESS INCR. | <b>FLOOR TRUSS SPACING:</b> 24.0 IN. O.C. (TYP.) |
|                      |                            | 40.0,10.0,0.0,5.0   | 1.00         |  |

| FLOOR PROFILE | QTY PLY | DEPTH ID        | BASE SPAN | O/A SPAN | END TYPE |       | INT BEARING |          | REACTIONS   |
|---------------|---------|-----------------|-----------|----------|----------|-------|-------------|----------|---|
|               |         |                 |           |          | LEFT     | RIGHT | SIZE        | LOCATION |   |
|               | 1       | 01-04-00<br>F08 | 10-01-00  | 10-01-00 |          |       |             |          | Joint 7      Joint 12<br>534.6 lbs.      534.6 lbs.<br>295.7 lbs.      287.6 lbs.   |
|               | 1       | 01-04-00<br>FG1 | 34-06-00  | 34-06-00 |          |       |             |          | Joint 27      Joint 35      Joint 43<br>764.7 lbs.      2937.8 lbs.      952.8 lbs.<br>80.3 lbs.      2167.7 lbs.      294.9 lbs. |
|               | 1       | 01-04-00<br>FG2 | 05-03-08  | 05-03-08 |          |       |             |          | Joint 5      Joint 8<br>892.9 lbs.      899.1 lbs.<br>831.5 lbs.      820.8 lbs.  |

| <b>ITEMS</b> |                   |                           |                 |             |   |  |
|--------------|-------------------|---------------------------|-----------------|-------------|---|--|
| QTY          | ITEM TYPE         | SIZE                      | LENGTH FT-IN-16 | PART NUMBER | NOTES   |  |
| 4            | LVL Beams (Sized) | LVL, 1-3/4" x 9-1/4" (S)  | 07-00-00        |             | DB2 & HDR2  |  |
| 4            | LVL Beams (Sized) | LVL, 1-3/4" x 9-1/4" (S)  | 06-00-00        |             | HDR1 & HDR3   |  |
| 2            | LVL Beams (Sized) | LVL, 1-3/4" x 11-7/8" (S) | 22-00-00        |             | GDH   |  |
| 3            | LVL Beams (Sized) | LVL, 1-3/4" x 24" (S)     | 24-00-00        |             | 24" LVL is <<ONLY>> sold in 20, 24, 28 or 48 foot lengths!!! (sm) FB1 |  |
| 3            | Hangers, USP      | MSH422                    |                 |             | SIMPSON (THA422)  |  |

RE: J0923-5139  
 Precision/63 Liberty Meadows/Harnett

**Trenco**  
 818 Soundside Rd  
 Edenton, NC 27932

**Site Information:**

Customer: Project Name: J0923-5139  
 Lot/Block: Model:  
 Address: Subdivision:  
 City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.4  
 Wind Code: N/A Wind Speed: N/A mph  
 Roof Load: N/A psf Floor Load: 55.0 psf

This package includes 12 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal#     | Truss Name | Date      |
|-----|-----------|------------|-----------|
| 1   | I57341318 | ET1        | 3/23/2023 |
| 2   | I57341319 | ET2        | 3/23/2023 |
| 3   | I57341320 | F01        | 3/23/2023 |
| 4   | I57341321 | F02        | 3/23/2023 |
| 5   | I57341322 | F03        | 3/23/2023 |
| 6   | I57341323 | F04        | 3/23/2023 |
| 7   | I57341324 | F05        | 3/23/2023 |
| 8   | I57341325 | F06        | 3/23/2023 |
| 9   | I57341326 | F07        | 3/23/2023 |
| 10  | I57341327 | F08        | 3/23/2023 |
| 11  | I57341328 | FG1        | 3/23/2023 |
| 12  | I57341329 | FG2        | 3/23/2023 |


The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Truss Design Engineer's Name: Johnson, Andrew

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

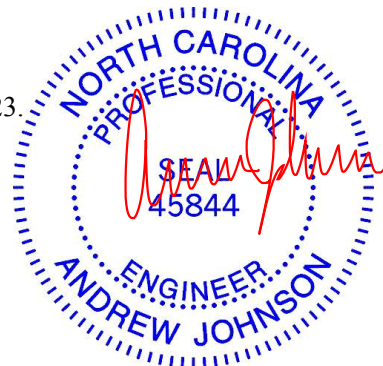

March 23, 2023

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341318 |
| J0923-5139 | ET1   | GABLE      | 1   | 1   | Job Reference (optional)             |           |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:30 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-00?RVmR8golTm?p\_b503OB8AUMfviTXHBGmBqAzY6dR

0-1/8

0-1/8

Scale: 1/4"=1'

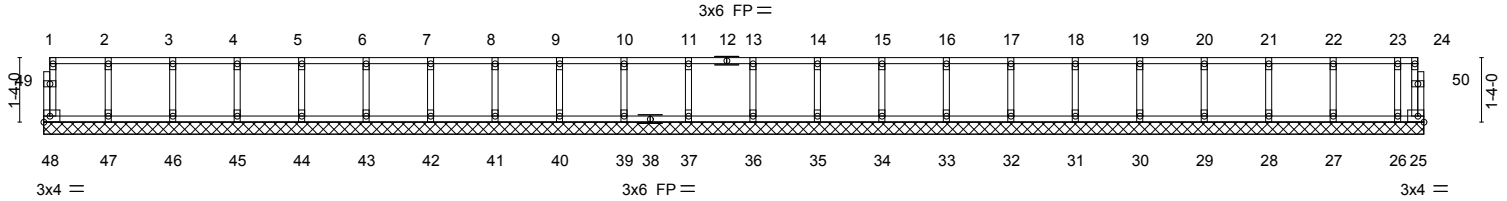

|       |       |       |       |       |       |       |        |        |        |        |        |        |        |        |        |        |        |        |        |        |        |
|-------|-------|-------|-------|-------|-------|-------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| 1-4-0 | 2-8-0 | 4-0-0 | 5-4-0 | 6-8-0 | 8-0-0 | 9-4-0 | 10-8-0 | 12-0-0 | 13-4-0 | 14-8-0 | 16-0-0 | 17-4-0 | 18-8-0 | 20-0-0 | 21-4-0 | 22-8-0 | 24-0-0 | 25-4-0 | 26-8-0 | 28-0-0 | 28-6-8 |
| 1-4-0 | 1-4-0 | 1-4-0 | 1-4-0 | 1-4-0 | 1-4-0 | 1-4-0 | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 1-4-0  | 0-6-8  |

|                      |                      |       |             |              |      |       |        |     |                |                 |
|----------------------|----------------------|-------|-------------|--------------|------|-------|--------|-----|----------------|-----------------|
| <b>LOADING</b> (psf) | <b>SPACING-</b>      | 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> | in   | (loc) | l/defl | L/d | <b>PLATES</b>  | <b>GRIP</b>     |
| TCLL 40.0            | Plate Grip DOL       | 1.00  | TC 0.06     | Vert(LL)     | n/a  | -     | n/a    | 999 | MT20           | 244/190         |
| TCDL 10.0            | Lumber DOL           | 1.00  | BC 0.01     | Vert(CT)     | n/a  | -     | n/a    | 999 |                |                 |
| BCLL 0.0             | Rep Stress Incr      | YES   | WB 0.03     | Horz(CT)     | 0.00 | 25    | n/a    | n/a |                |                 |
| BCDL 5.0             | Code IRC2015/TPI2014 |       | Matrix-R    |              |      |       |        |     | Weight: 124 lb | FT = 20%F, 11%E |

|                             |   |
|-----------------------------|---|
| <b>LUMBER-</b>              | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)      |   |
| OTHERS 2x4 SP No.3(flat)    |   |

**REACTIONS.** All bearings 28-6-8.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 48, 25, 47, 46, 45, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 27, 26

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Plates checked for a plus or minus 1 degree rotation about its center.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 23, 2023

|   |  |
|---|--|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (<a href="http://www.tpinst.org">www.tpinst.org</a>) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (<a href="http://www.sbcacomponents.com">www.sbcacomponents.com</a>)</p> | <p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road<br/>       Edenton, NC 27932</p> |
|---|--|

|                   |              |                     |          |          |  |           |
|-------------------|--------------|---------------------|----------|----------|--|-----------|
| Job<br>J0923-5139 | Truss<br>ET2 | Truss Type<br>GABLE | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341319 |
|-------------------|--------------|---------------------|----------|----------|--|-----------|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:31 2023 Page 1  
ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-UCZpj6SmR5tKO9OA9pYlwOhLDm?A1wnRQwWIMczY6dQ

0-1/8

0-1/8

Scale: 3/8"=1'

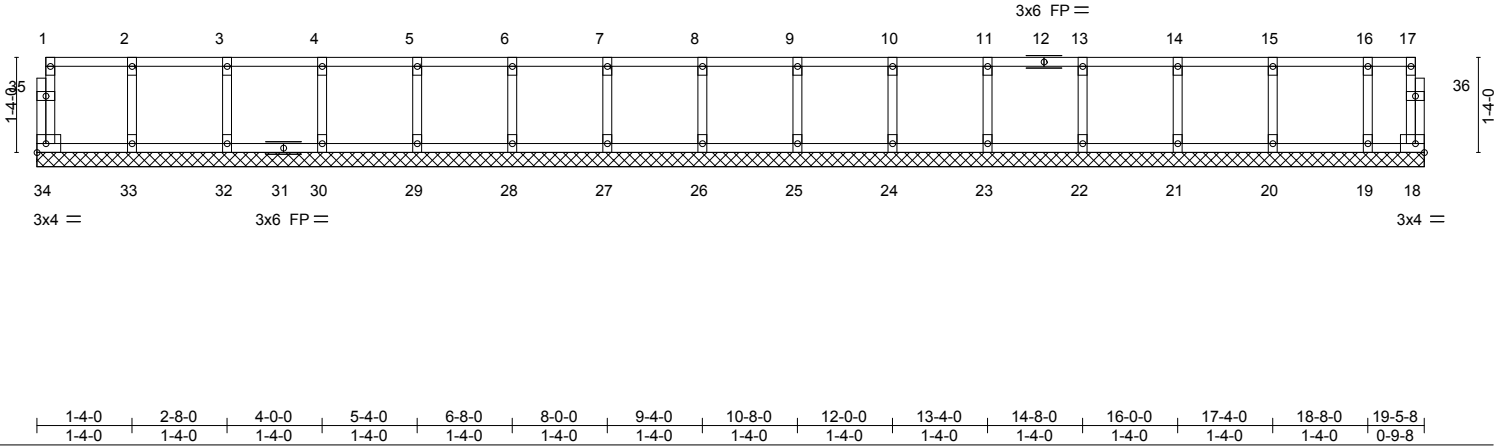

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES | GRIP          |                 |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|--------|---------------|-----------------|
| TCLL 40.0     | Plate Grip DOL       | 1.00  | TC 0.06  | Vert(LL) | n/a      | -      | n/a | 999    | MT20          | 244/190         |
| TCDL 10.0     | Lumber DOL           | 1.00  | BC 0.01  | Vert(CT) | n/a      | -      | n/a | 999    |               |                 |
| BCLL 0.0      | Rep Stress Incr      | YES   | WB 0.03  | Horz(CT) | 0.00     | 18     | n/a | n/a    |               |                 |
| BCDL 5.0      | Code IRC2015/TPI2014 |       | Matrix-R |          |          |        |     |        | Weight: 86 lb | FT = 20%F, 11%E |

| LUMBER-                     | BRACING-  |
|-----------------------------|---|
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)      |   |
| OTHERS 2x4 SP No.3(flat)    |   |

**REACTIONS.** All bearings 19-5-8.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 34, 18, 33, 32, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 19

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Plates checked for a plus or minus 1 degree rotation about its center.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 23, 2023






|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341321 |
| J0923-5139 | F02   | Floor      | 3   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:34 2023 Page 1  
 ID:3YJEq\_u8zX16RsP?VvW\_V6zd0wB-vnFxL8Uek0FvFd7lqx5?Y1Jfq\_rXE9lt6ukPzzzY6dN

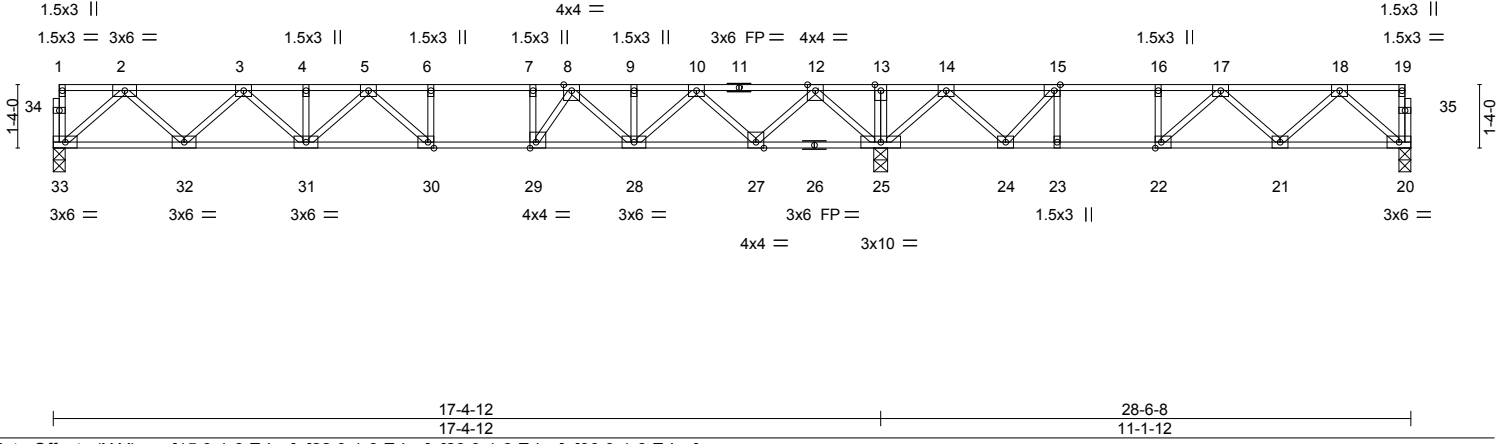

|                       |  |             |                                  |                |                 |
|-----------------------|--|-------------|----------------------------------|----------------|-----------------|
| Plate Offsets (X,Y)-- | [15:0-1-8,Edge], [22:0-1-8,Edge], [29:0-1-8,Edge], [30:0-1-8,Edge] |             |                                  |                |                 |
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0  | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b>  | <b>GRIP</b>     |
| TCLL 40.0             | Plate Grip DOL 1.00  | TC 0.80     | Vert(LL) -0.20 30-31 >999 480    | MT20           | 244/190         |
| TCDL 10.0             | Lumber DOL 1.00  | BC 0.80     | Vert(CT) -0.28 30-31 >737 360    |                |                 |
| BCLL 0.0              | Rep Stress Incr YES  | WB 0.53     | Horz(CT) 0.05 20 n/a n/a         |                |                 |
| BCDL 5.0              | Code IRC2015/TP12014   | Matrix-S    |                                  | Weight: 149 lb | FT = 20%F, 11%E |

|                             |   |
|-----------------------------|---|
| <b>LUMBER-</b>              | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.                                   |
| WEBS 2x4 SP No.3(flat)      |   |

**REACTIONS.** (size) 33=0-3-0, 20=0-3-0, 25=0-3-8  
 Max Grav 33=870(LC 10), 20=551(LC 4), 25=1787(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1558/0, 3-4=-2542/0, 4-5=-2542/0, 5-6=-2818/0, 6-7=-2818/0, 7-8=-2818/0, 8-9=-2111/0, 9-10=-2111/0, 10-12=-826/0, 12-13=0/1418, 13-14=0/1418, 14-15=-650/619, 15-16=-1081/304, 16-17=-1081/304, 17-18=-883/0

BOT CHORD 32-33=0/938, 31-32=0/2155, 30-31=0/2787, 29-30=0/2818, 28-29=0/2533, 27-28=0/1567, 25-27=-305/58, 24-25=-893/218, 23-24=-304/1081, 22-23=-304/1081, 21-22=-76/1124, 20-21=0/581

WEBS 2-33=-1246/0, 2-32=0/863, 3-32=-831/0, 3-31=0/526, 5-31=-333/0, 5-30=-218/326, 7-29=-478/0, 12-25=-1482/0, 12-27=0/1109, 10-27=-1068/0, 10-28=0/779, 8-28=-620/0, 18-20=-770/0, 18-21=-19/421, 17-21=-334/119, 17-22=-362/0, 15-23=0/294, 14-25=-959/0, 14-24=0/763, 8-29=0/756, 15-24=-884/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Plates checked for a plus or minus 1 degree rotation about its center.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.



March 23, 2023



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341322 |
| J0923-5139 | F03   | FLOOR      | 9   | 1   |                                      |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:35 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-N\_pKZUVGVK0mtrixOfcE5EsydNDQzbX0LYUyWNzY6dM

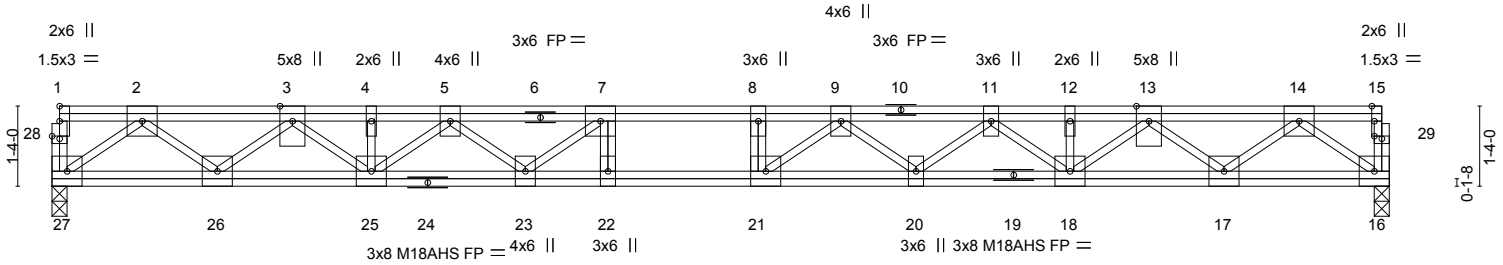


|   |                       |             |                                  |                |                 |
|---|-----------------------|-------------|----------------------------------|----------------|-----------------|
| Plate Offsets (X,Y)-- [15:0-3-0,Edge], [28:0-1-8,0-0-8], [29:0-1-8,0-0-8] |                       |             |                                  |                |                 |
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b>  | <b>GRIP</b>     |
| TCLL 40.0   | Plate Grip DOL 1.00   | TC 0.29     | Vert(LL) -0.32 21 >820 480       | MT20           | 244/190         |
| TCDL 10.0   | Lumber DOL 1.00       | BC 0.63     | Vert(CT) -0.44 21 >596 360       | M18AHS         | 186/179         |
| BCLL 0.0  | Rep Stress Incr YES   | WB 0.62     | Horz(CT) 0.05 16 n/a n/a         |                |                 |
| BCDL 5.0  | Code IRC2015/TP12014  | Matrix-S    |                                  | Weight: 177 lb | FT = 20%F, 11%E |

|                             |   |
|-----------------------------|---|
| <b>LUMBER-</b>              | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)      |   |

**REACTIONS.** (size) 27=0-3-0, 16=0-3-0  
 Max Grav 27=1203(LC 1), 16=1203(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2456/0, 3-4=-4314/0, 4-5=-4314/0, 5-7=-5453/0, 7-8=-5953/0, 8-9=-5953/0, 9-11=-5456/0, 11-12=-4309/0, 12-13=-4309/0, 13-14=-2456/0  
 BOT CHORD 26-27=0/1471, 25-26=0/3495, 23-25=0/5013, 22-23=0/5953, 21-22=0/5953, 20-21=0/5834, 18-20=0/5027, 17-18=0/3494, 16-17=0/1472  
 WEBS 2-27=-1819/0, 2-26=0/1306, 3-26=-1375/0, 3-25=0/1063, 5-25=-906/0, 5-23=0/717, 7-23=-941/0, 14-16=-1819/0, 14-17=0/1306, 13-17=-1373/0, 13-18=0/1057, 11-18=-930/0, 11-20=0/568, 9-20=-536/0, 9-21=-298/676, 8-21=-288/42

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 6x6 MT20 unless otherwise indicated.
  - 4) Plates checked for a plus or minus 1 degree rotation about its center.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.





March 23, 2023

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341323 |
| J0923-5139 | F04   | Floor      | 6   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:36 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-rAMimpWvGeWdVwH8yM7TdSO4SnYli38AZCDW2pzY6dL

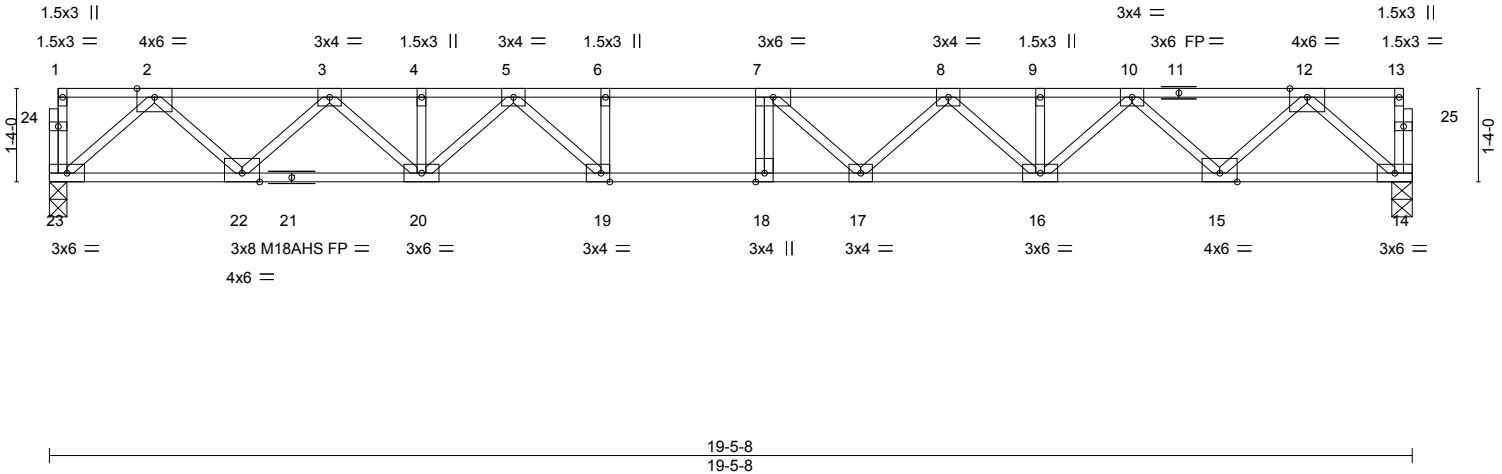


| Plate Offsets (X,Y)-- [19:0-1-8,Edge] |                       | 19-5-8      |                                  | 19-5-8         |                 |
|---------------------------------------|-----------------------|-------------|----------------------------------|----------------|-----------------|
| <b>LOADING</b> (psf)                  | <b>SPACING-</b> 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b>  | <b>GRIP</b>     |
| TCLL 40.0                             | Plate Grip DOL 1.00   | TC 0.48     | Vert(LL) -0.27 18 >842 480       | MT20 244/190   |                 |
| TCDL 10.0                             | Lumber DOL 1.00       | BC 0.69     | Vert(CT) -0.37 18 >615 360       | M18AHS 186/179 |                 |
| BCLL 0.0                              | Rep Stress Incr YES   | WB 0.54     | Horz(CT) 0.06 14 n/a n/a         |                |                 |
| BCDL 5.0                              | Code IRC2015/TPI2014  | Matrix-S    |                                  |                |                 |
|                                       |                       |             |                                  | Weight: 103 lb | FT = 20%F, 11%E |

|                                   |   |
|-----------------------------------|---|
| <b>LUMBER-</b>                    | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP 2400F 2.0E(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP 2400F 2.0E(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)            |   |

**REACTIONS.** (size) 23=0-3-0, 14=0-3-8  
 Max Grav 23=1050(LC 1), 14=1050(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1952/0, 3-4=-3301/0, 4-5=-3301/0, 5-6=-4143/0, 6-7=-4143/0, 7-8=-3998/0,  
 8-9=-3296/0, 9-10=-3296/0, 10-12=-1951/0  
 BOT CHORD 22-23=0/1144, 20-22=0/2724, 19-20=0/3756, 18-19=0/4143, 17-18=0/4143, 16-17=0/3795,  
 15-16=0/2729, 14-15=0/1143  
 WEBS 2-23=-1521/0, 2-22=0/1123, 3-22=-1073/0, 3-20=0/785, 5-20=-617/0, 5-19=0/809,  
 6-19=-366/0, 12-14=-1519/0, 12-15=0/1124, 10-15=-1081/0, 10-16=0/771, 8-16=-679/0,  
 8-17=0/446, 7-17=-530/153

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) Plates checked for a plus or minus 1 degree rotation about its center.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



March 23, 2023



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341324 |
| J0923-5139 | F05   | FLOOR      | 2   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:37 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?vVw\_V6zd0wB-JMw4\_9WX1xeU64rkV3eiAfxFLBrXRgJosz3aGzY6dK

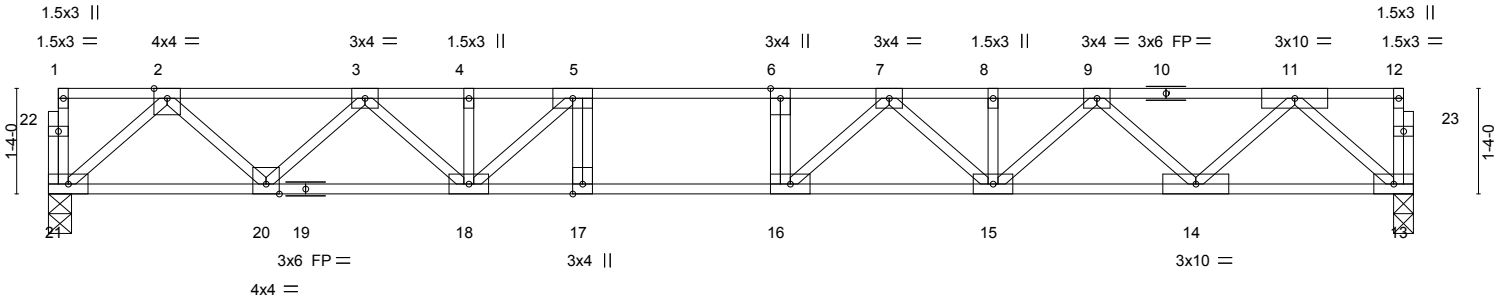


| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc)    | l/defl | L/d | PLATES        | GRIP            |
|---------------|----------------------|-------|----------|----------|-------------|--------|-----|---------------|-----------------|
| TCLL 40.0     | Plate Grip DOL       | 1.00  | TC 0.47  | Vert(LL) | -0.23 15-16 | >887   | 480 | MT20          | 244/190         |
| TCDL 10.0     | Lumber DOL           | 1.00  | BC 0.89  | Vert(CT) | -0.31 15-16 | >663   | 360 |               |                 |
| BCLL 0.0      | Rep Stress Incr      | YES   | WB 0.45  | Horz(CT) | 0.05 13     | n/a    | n/a |               |                 |
| BCDL 5.0      | Code IRC2015/TPI2014 |       | Matrix-S |          |             |        |     | Weight: 94 lb | FT = 20%F, 11%E |

| LUMBER-                           | BRACING-  |
|-----------------------------------|---|
| TOP CHORD 2x4 SP 2400F 2.0E(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat)       | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)            |   |


**REACTIONS.** (size) 21=0-3-8, 13=0-3-0  
 Max Grav 21=929(LC 1), 13=929(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1690/0, 3-4=-2767/0, 4-5=-2767/0, 5-6=-3229/0, 6-7=-3229/0, 7-8=-2794/0, 8-9=-2794/0, 9-11=-1685/0  
 BOT CHORD 20-21=0/1006, 18-20=0/2339, 17-18=0/3229, 16-17=0/3229, 15-16=0/3101, 14-15=0/2342, 13-14=0/1005  
 WEBS 11-13=-1335/0, 11-14=0/947, 9-14=-913/0, 9-15=0/615, 7-15=-417/0, 7-16=-130/522, 6-16=-269/6, 2-21=-1336/0, 2-20=0/951, 3-20=-903/0, 3-18=0/582, 5-18=-858/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x6 MT20 unless otherwise indicated.
  - 3) Plates checked for a plus or minus 1 degree rotation about its center.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.




March 23, 2023

|   |   |
|---|---|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (<a href="http://www.tpinst.org">www.tpinst.org</a>) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (<a href="http://www.sbcacomponents.com">www.sbcacomponents.com</a>)</p> | <p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road<br/>       Edenton, NC 27932</p> |
|---|---|

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341325 |
| J0923-5139 | F06   | Floor      | 2   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:38 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-nYUSBVX9oFmKKEQW3nAxjtUMtbDFA?wT1Wic6izY6dJ

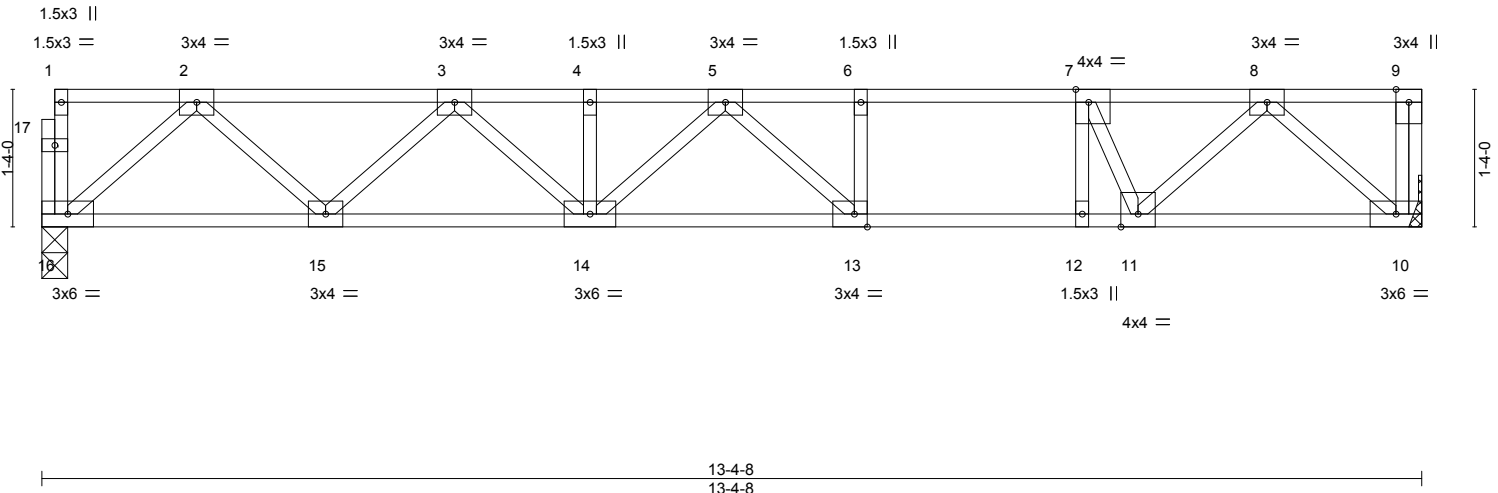


|                       |                                 |             |                                  |               |                 |
|-----------------------|---------------------------------|-------------|----------------------------------|---------------|-----------------|
| Plate Offsets (X,Y)-- | [7:0-1-8,Edge], [13:0-1-8,Edge] |             |                                  |               |                 |
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0           | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b>     |
| TCLL 40.0             | Plate Grip DOL 1.00             | TC 0.74     | Vert(LL) -0.19 13-14 >820 480    | MT20          | 244/190         |
| TCDL 10.0             | Lumber DOL 1.00                 | BC 0.75     | Vert(CT) -0.26 13-14 >603 360    |               |                 |
| BCLL 0.0              | Rep Stress Incr YES             | WB 0.39     | Horz(CT) 0.02 10 n/a n/a         |               |                 |
| BCDL 5.0              | Code IRC2015/TPI2014            | Matrix-S    |                                  | Weight: 72 lb | FT = 20%F, 11%E |

|                                   |   |
|-----------------------------------|---|
| <b>LUMBER-</b>                    | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat)       | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP 2400F 2.0E(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)            |   |

**REACTIONS.** (size) 16=0-3-0, 10=Mechanical  
 Max Grav 16=716(LC 1), 10=722(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1220/0, 3-4=-1896/0, 4-5=-1896/0, 5-6=-1704/0, 6-7=-1704/0, 7-8=-1302/0  
 BOT CHORD 15-16=0/760, 14-15=0/1670, 13-14=0/1949, 12-13=0/1704, 11-12=0/1704, 10-11=0/716  
 WEBS 2-16=-1010/0, 2-15=0/639, 3-15=-626/0, 3-14=0/308, 5-13=-412/72, 7-12=0/568, 8-10=-953/0, 8-11=0/815, 7-11=-1014/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) Plates checked for a plus or minus 1 degree rotation about its center.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.



March 23, 2023


|  |  |
|--|--|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TP1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road<br/>       Edenton, NC 27932</p> |
|--|--|



|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341326 |
| J0923-5139 | F07   | Floor      | 4   | 1   |                                      |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:39 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-FI2qOrYnZZuBMO?jdUhf40X2?Z4vTncGASAf8zY6dl

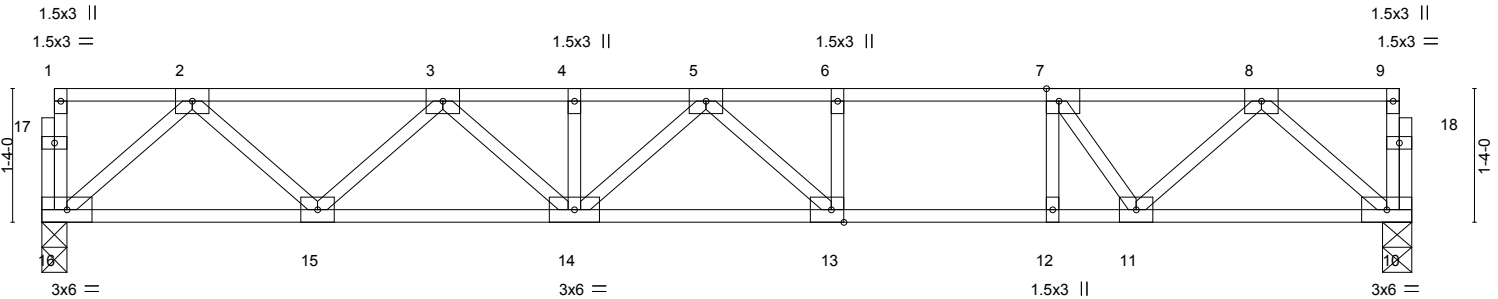


|                        |                                 |             |                                  |               |                 |  |  |
|------------------------|---------------------------------|-------------|----------------------------------|---------------|-----------------|--|--|
| Plate Offsets (X, Y)-- | [7:0-1-8,Edge], [13:0-1-8,Edge] |             |                                  |               |                 |  |  |
| <b>LOADING</b> (psf)   | <b>SPACING-</b> 2-0-0           | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b>     |  |  |
| TCLL 40.0              | Plate Grip DOL 1.00             | TC 0.71     | Vert(LL) -0.20 13-14 >823 480    | MT20          | 244/190         |  |  |
| TCDL 10.0              | Lumber DOL 1.00                 | BC 0.71     | Vert(CT) -0.26 13-14 >608 360    |               |                 |  |  |
| BCLL 0.0               | Rep Stress Incr YES             | WB 0.38     | Horz(CT) 0.02 10 n/a n/a         |               |                 |  |  |
| BCDL 5.0               | Code IRC2015/TPI2014            | Matrix-S    |                                  |               |                 |  |  |
|                        |                                 |             |                                  | Weight: 73 lb | FT = 20%F, 11%E |  |  |

|                                   |   |
|-----------------------------------|---|
| <b>LUMBER-</b>                    | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat)       | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP 2400F 2.0E(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)            |   |

**REACTIONS.** (size) 16=0-3-0, 10=0-3-8  
 Max Grav 16=732(LC 1), 10=732(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1255/0, 3-4=-1964/0, 4-5=-1964/0, 5-6=-1816/0, 6-7=-1816/0, 7-8=-1303/0  
 BOT CHORD 15-16=0/779, 14-15=0/1721, 13-14=0/2036, 12-13=0/1816, 11-12=0/1816, 10-11=0/736  
 WEBS 2-16=-1034/0, 2-15=0/662, 3-15=-648/0, 3-14=0/330, 5-13=-393/101, 7-12=0/417, 8-10=-975/0, 8-11=0/789, 7-11=-918/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Plates checked for a plus or minus 1 degree rotation about its center.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.





March 23, 2023

|                   |              |                     |          |          |  |           |
|-------------------|--------------|---------------------|----------|----------|--|-----------|
| Job<br>J0923-5139 | Truss<br>F08 | Truss Type<br>Floor | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | 157341327 |
|-------------------|--------------|---------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:40 2023 Page 1  
ID:3YJEG\_u8zX16RsP?VvW\_V6zd0wB-kxcDcBZPKs02zYavBCCPolZpnO\_FezYmUqBjBazY6dH

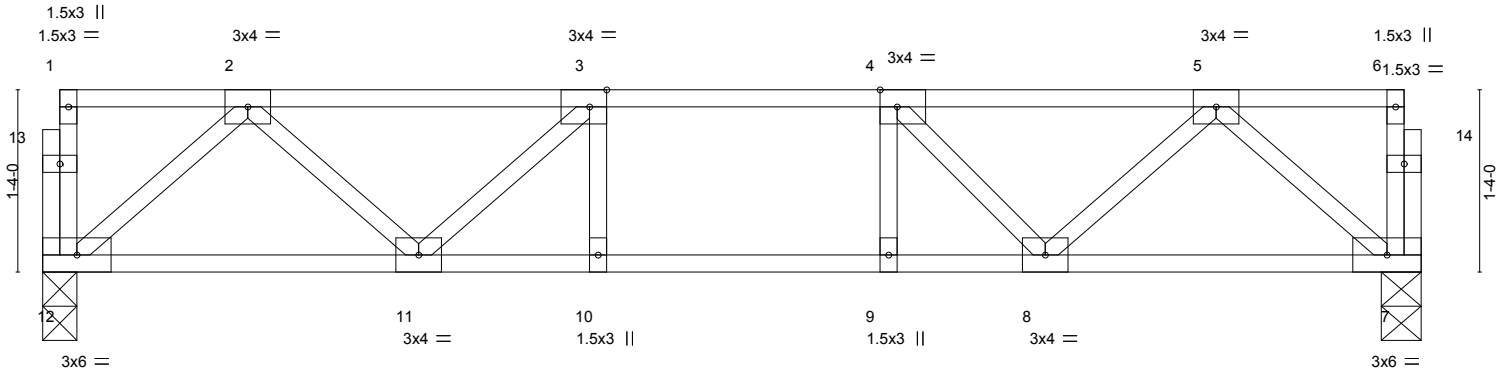

|                       |                                |
|-----------------------|--------------------------------|
| Plate Offsets (X,Y)-- | [3:0-1-8,Edge], [4:0-1-8,Edge] |
|-----------------------|--------------------------------|

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES        | GRIP            |
|---------------|----------------------|-------|----------|----------|----------|--------|------|---------------|-----------------|
| TCLL 40.0     | Plate Grip DOL       | 1.00  | TC 0.26  | Vert(LL) | -0.05    | 10-11  | >999 | MT20          | 244/190         |
| TCDL 10.0     | Lumber DOL           | 1.00  | BC 0.40  | Vert(CT) | -0.06    | 10     | >999 |               |                 |
| BCLL 0.0      | Rep Stress Incr      | YES   | WB 0.19  | Horz(CT) | 0.01     | 7      | n/a  |               |                 |
| BCDL 5.0      | Code IRC2015/TPI2014 |       | Matrix-S |          |          |        |      |               |                 |
|               |                      |       |          |          |          |        |      | Weight: 53 lb | FT = 20%F, 11%E |

| LUMBER-                     | BRACING-  |
|-----------------------------|---|
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)      |   |

**REACTIONS.** (size) 12=0-3-0, 7=0-3-8  
Max Grav 12=535(LC 1), 7=535(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-833/0, 3-4=-1083/0, 4-5=-838/0  
BOT CHORD 11-12=0/561, 10-11=0/1083, 9-10=0/1083, 8-9=0/1083, 7-8=0/553  
WEBS 2-12=-745/0, 2-11=0/377, 3-11=-379/0, 5-7=-734/0, 5-8=0/396, 4-8=-397/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) Plates checked for a plus or minus 1 degree rotation about its center.
  - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.




March 23, 2023

|   |  |
|---|--|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (<a href="http://www.tpinst.org">www.tpinst.org</a>) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (<a href="http://www.sbcacomponents.com">www.sbcacomponents.com</a>)</p> | <p>ENGINEERING BY</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road<br/>Edenton, NC 27932</p> |
|---|--|

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | 157341328 |
| J0923-5139 | FG1   | Floor      | 1   | 1   |                                      |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:42 2023 Page 1  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-gKkz1tafrTGmDrkHidEttje?TCYg6mN2y8gqfTzY6dF

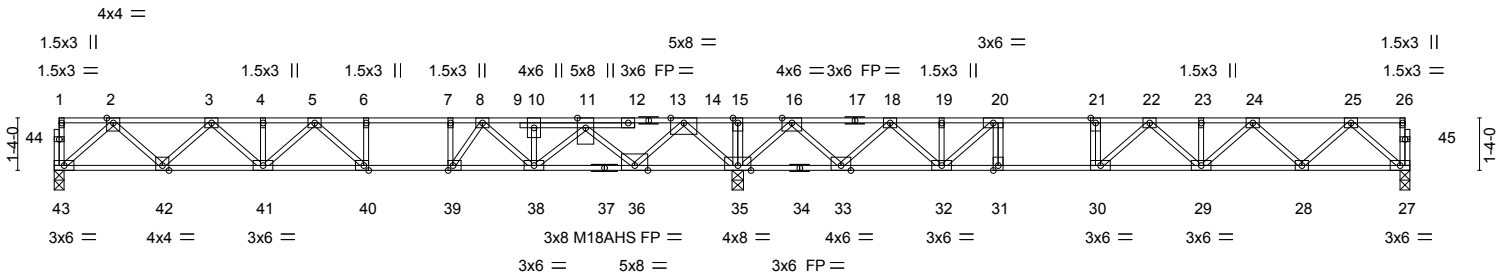

|                       |                                  |        |
|-----------------------|----------------------------------|--------|
|                       | 17-4-12                          | 34-6-0 |
|                       | 17-4-12                          | 17-1-4 |
| Plate Offsets (X,Y)-- | [39:0-1-8,Edge], [40:0-1-8,Edge] |        |

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d  | PLATES         | GRIP            |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|-----------------|
| TCLL 40.0     | Plate Grip DOL       | 1.00  | TC 0.95  | Vert(LL) | -0.23    | 29-30  | >878 | MT20           | 244/190         |
| TCDL 10.0     | Lumber DOL           | 1.00  | BC 0.85  | Vert(CT) | -0.31    | 29-30  | >648 | M18AHS         | 186/179         |
| BCLL 0.0      | Rep Stress Incr      | NO    | WB 0.62  | Horz(CT) | 0.06     | 27     | n/a  |                |                 |
| BCDL 5.0      | Code IRC2015/TP12014 |       | Matrix-S |          |          |        |      |                |                 |
|               |                      |       |          |          |          |        |      | Weight: 187 lb | FT = 20%F, 11%E |

| LUMBER-  | BRACING-  |
|--|---|
| TOP CHORD 2x4 SP No.1(flat) *Except*<br>17-26: 2x4 SP 2400F 2.0E(flat) | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) *Except*<br>27-34: 2x4 SP 2400F 2.0E(flat) | BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.                                   |
| WEBS 2x4 SP No.3(flat) *Except*<br>14-36: 2x4 SP No.2(flat)            |   |

**REACTIONS.** (size) 43=0-3-0, 27=0-3-0, 35=0-3-8  
 Max Grav 43=953(LC 3), 27=765(LC 4), 35=2938(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1739/0, 3-4=-2892/0, 4-5=-2892/0, 5-6=-3424/0, 6-7=-3424/0, 7-8=-3424/0, 8-10=-3016/0, 10-11=-3016/0, 11-14=-1021/0, 14-15=0/3063, 15-16=0/3063, 16-18=0/1580, 18-19=-1140/968, 19-20=-1140/968, 20-21=-2003/416, 21-22=-2003/416, 22-23=-2104/0, 23-24=-2104/0, 24-25=-1326/0

BOT CHORD 42-43=0/1033, 41-42=0/2417, 40-41=0/3231, 39-40=0/3424, 38-39=0/3244, 36-38=0/2605, 35-36=-1179/0, 33-35=-2004/0, 32-33=-1239/576, 31-32=-416/2003, 30-31=-416/2003, 29-30=-86/2221, 28-29=0/1826, 27-28=0/816

WEBS 2-43=-1373/0, 2-42=0/982, 3-42=-943/0, 3-41=0/646, 14-35=-2577/0, 14-36=0/2181, 11-36=-2209/0, 11-38=0/620, 5-41=-460/0, 5-40=-39/469, 8-38=-404/0, 8-39=0/599, 7-39=-391/0, 25-27=-1084/0, 25-28=0/710, 24-28=-695/0, 24-29=-73/378, 16-35=-1628/0, 16-33=0/1269, 18-33=-1212/0, 18-32=0/831, 19-32=0/283, 20-32=-1442/0, 22-30=-637/0, 20-31=0/355

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 3x4 MT20 unless otherwise indicated.
  - 4) Plates checked for a plus or minus 1 degree rotation about its center.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 879 lb down at 13-6-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
  - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00



Continued on page 2

|  |  |
|--|--|
| <p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TP1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p><b>ENGINEERING BY</b><br/> <b>TRENCO</b><br/> <small>A MiTek Affiliate</small></p> <p>818 Soundside Road<br/>       Edenton, NC 27932</p> |
|--|--|

|            |       |            |     |     |                                      |           |
|------------|-------|------------|-----|-----|--------------------------------------|-----------|
| Job        | Truss | Truss Type | Qty | Ply | Precision/63 Liberty Meadows/Harnett | I57341328 |
| J0923-5139 | FG1   | Floor      | 1   | 1   | Job Reference (optional)             |           |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:42 2023 Page 2  
 ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-gKz1tafrTGmDrkHidEttje?TCYg6mN2y8gqFTzY6dF

**LOAD CASE(S)** Standard

Uniform Loads (plf)

Vert: 27-43=-10, 1-26=-100

Concentrated Loads (lb)

Vert: 11=-799(B)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))




818 Soundside Road  
 Edenton, NC 27932

|                   |              |                            |          |          |  |           |
|-------------------|--------------|----------------------------|----------|----------|--|-----------|
| Job<br>J0923-5139 | Truss<br>FG2 | Truss Type<br>FLOOR GIRDER | Qty<br>1 | Ply<br>1 | Precision/63 Liberty Meadows/Harnett<br>Job Reference (optional) | I57341329 |
|-------------------|--------------|----------------------------|----------|----------|--|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Thu Mar 23 08:03:43 2023 Page 1

ID:3YJEg\_u8zX16RsP?VvW\_V6zd0wB-8WHLedblcnOdq?JUUsKI6QwBNic2TrIMCAoQNovzY6dE

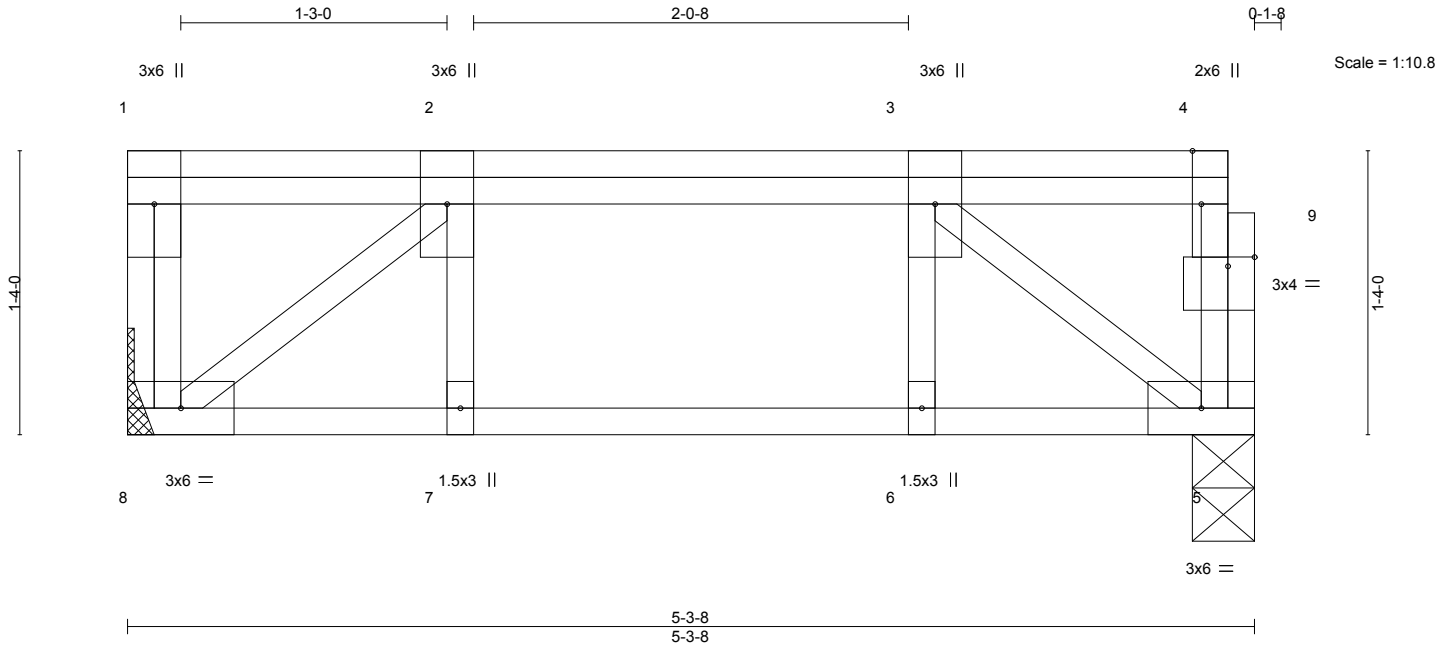

|                       |                                 |             |                                  |               |                 |
|-----------------------|---------------------------------|-------------|----------------------------------|---------------|-----------------|
| Plate Offsets (X,Y)-- | [4:0-3-0,Edge], [9:0-1-8,0-0-8] |             |                                  |               |                 |
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0           | <b>CSI.</b> | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b>     |
| TCLL 40.0             | Plate Grip DOL 1.00             | TC 0.09     | Vert(LL) -0.01 6-7 >999 480      | MT20          | 244/190         |
| TCDL 10.0             | Lumber DOL 1.00                 | BC 0.24     | Vert(CT) -0.02 6-7 >999 360      |               |                 |
| BCLL 0.0              | Rep Stress Incr NO              | WB 0.31     | Horz(CT) 0.01 5 n/a n/a          |               |                 |
| BCDL 5.0              | Code IRC2015/TPI2014            | Matrix-S    |                                  | Weight: 36 lb | FT = 20%F, 11%E |

|                             |   |
|-----------------------------|---|
| <b>LUMBER-</b>              | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.1(flat) | TOP CHORD Structural wood sheathing directly applied or 5-3-8 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1(flat) | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3(flat)      |   |

**REACTIONS.** (size) 8=Mechanical, 5=0-3-8  
Max Grav 8=899(LC 1), 5=893(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1036/0  
BOT CHORD 7-8=0/1036, 6-7=0/1036, 5-6=0/1036  
WEBS 2-8=-1325/0, 3-5=-1321/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) Plates checked for a plus or minus 1 degree rotation about its center.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.
  - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 650 lb down at 1-10-4, and 667 lb down at 3-10-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
  - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard


- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 5-8=10, 1-4=100  
Concentrated Loads (lb)  
Vert: 2=622(B) 3=622(B)




March 23, 2023

# Symbols


## PLATE LOCATION AND ORIENTATION

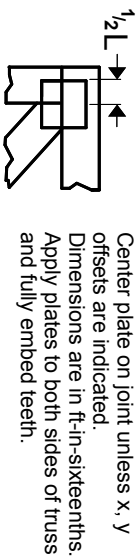

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

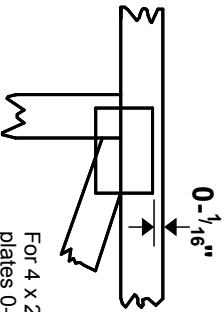

For 4 x 2 orientation, locate plates 0-  $\frac{1}{16}$ \"/>



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


## Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System



1 2 3 Joint ID typ.

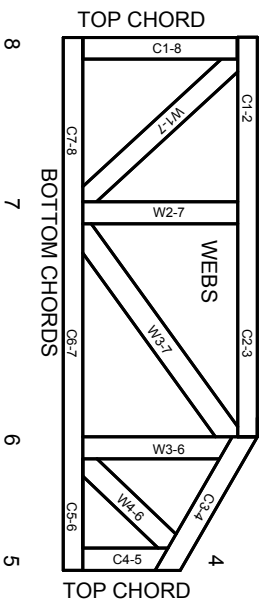

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

**MITek**



ENGINEERING BY  
**TRENGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MI-7473 rev. 1/2/2023



**FB1 Kerto-S LVL 1.750" X 24.000" 3-Ply - PASSED**

Level: Level

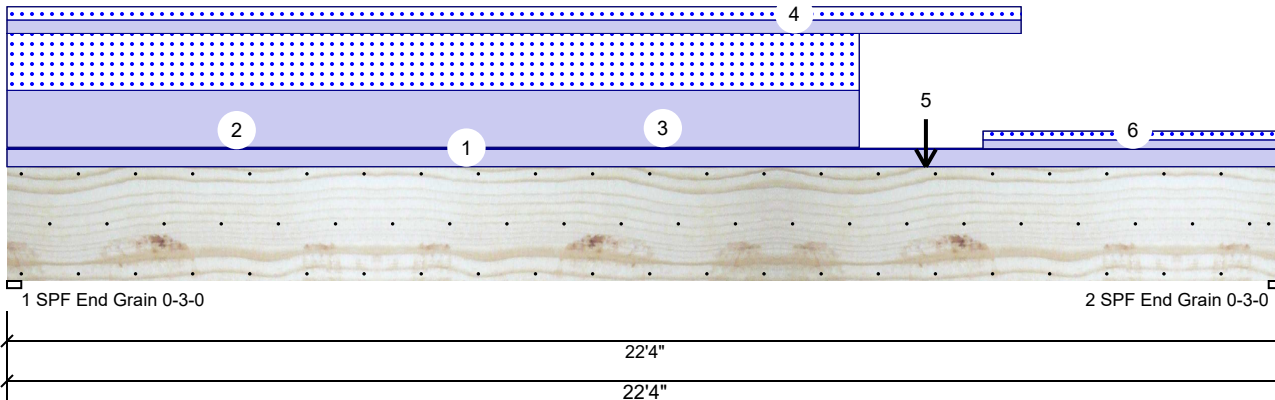

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 3             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | Yes          |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED lb (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 112  | 7018 | 5324 | 0    | 0     |
| 2   | Vertical  | 112  | 5588 | 3893 | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------|------|--------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.000" | Vert | 93%  | 7018 / 5324  | 12342 | L        | D+S       |
| 2 - SPF End Grain | 3.000" | Vert | 72%  | 5588 / 3893  | 9480  | L        | D+S       |

**Analysis Results**

| Analysis     | Actual         | Location  | Allowed       | Capacity     | Comb. | Case |
|--------------|----------------|-----------|---------------|--------------|-------|------|
| Moment       | 65847 ft-lb    | 11' 1/4"  | 131295 ft-lb  | 0.502 (50%)  | D+S   | L    |
| Unbraced     | 65847 ft-lb    | 11' 1/4"  | 66073 ft-lb   | 0.997 (100%) | D+S   | L    |
| Shear        | 9886 lb        | 2'3"      | 30912 lb      | 0.320 (32%)  | D+S   | L    |
| LL Defl inch | 0.228 (L/1158) | 11'1"     | 0.549 (L/480) | 0.414 (41%)  | S     | L    |
| TL Defl inch | 0.530 (L/498)  | 11'1 1/4" | 0.733 (L/360) | 0.723 (72%)  | D+S   | L    |

**Design Notes**

- Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6". Nail from both sides.
- Refer to last page of calculations for fasteners required for specified loads.
- Girders are designed to be supported on the bottom edge only.
- Top loads must be supported equally by all plies.
- Top must be laterally braced at a maximum of 3'11 15/16" o.c.
- Bottom must be laterally braced at end bearings.
- Lateral slenderness ratio based on single ply width.

| ID | Load Type     | Location         | Trib Width | Side     | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments      |
|----|---------------|------------------|------------|----------|----------|--------|-----------|----------|-------------|---------------|
| 1  | Uniform       |                  |            | Top      | 120 PLF  | 0 PLF  | 0 PLF     | 0 PLF    | 0 PLF       | WALL          |
| 2  | Tie-In Far    | 0-0-0 to 22-4-0  | 0-3-0      | Far Face | 15 PSF   | 40 PSF | 0 PSF     | 0 PSF    | 0 PSF       | FLOOR LOADING |
| 2  | Tie-In Near   | 0-0-0 to 22-4-0  | 0-0-0      | Top      | 15 PSF   | 40 PSF | 0 PSF     | 0 PSF    | 0 PSF       | FLOOR LOADING |
| 3  | Part. Uniform | 0-0-0 to 14-11-0 |            | Top      | 392 PLF  | 0 PLF  | 392 PLF   | 0 PLF    | 0 PLF       | A TRUSSES     |

Continued on page 2...

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

- Dry service conditions, unless noted otherwise
- LVL not to be treated with fire retardant or corrosive chemicals

**Handling & Installation**

- LVL beams must not be cut or drilled
- Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
- Damaged Beams must not be used
- Design assumes top edge is laterally restrained
- Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding



This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**FB1 Kerto-S LVL 1.750" X 24.000" 3-Ply - PASSED**

Level: Level

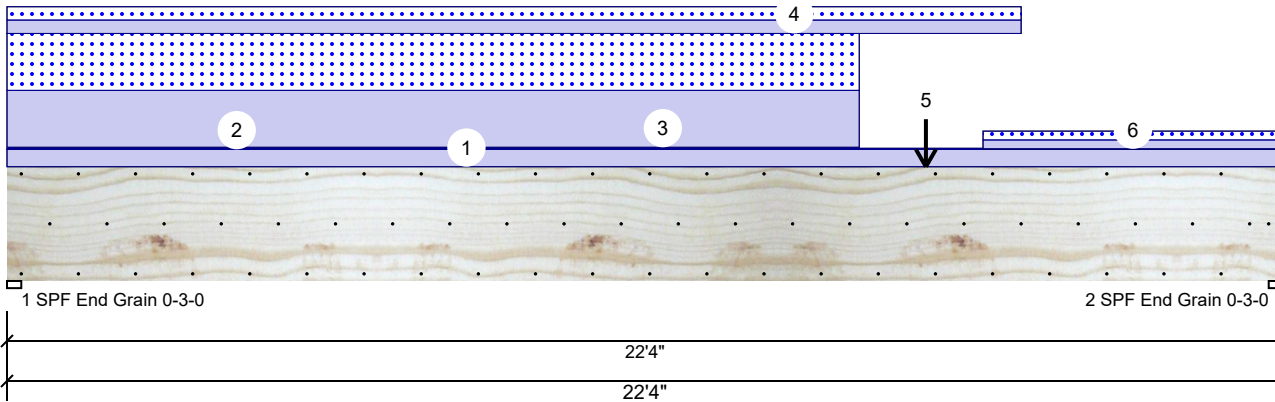

...Continued from page 1

| ID | Load Type      | Location         | Trib Width | Side      | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments  |
|----|----------------|------------------|------------|-----------|----------|--------|-----------|----------|-------------|-----------|
| 4  | Part. Uniform  | 0-0-0 to 17-9-0  |            | Near Face | 92 PLF   | 0 PLF  | 92 PLF    | 0 PLF    | 0 PLF       | P TRUSSES |
| 5  | Point          | 16-1-0           |            | Top       | 1416 lb  | 0 lb   | 1416 lb   | 0 lb     | 0 lb        | A1        |
|    | Bearing Length | 0-3-8            |            |           |          |        |           |          |             |           |
| 6  | Part. Uniform  | 17-1-0 to 22-4-0 |            | Top       | 61 PLF   | 0 PLF  | 61 PLF    | 0 PLF    | 0 PLF       | Y TRUSSES |
|    | Self Weight    |                  |            |           | 28 PLF   |        |           |          |             |           |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**FB1 Kerto-S LVL 1.750" X 24.000" 3-Ply - PASSED**

Level: Level

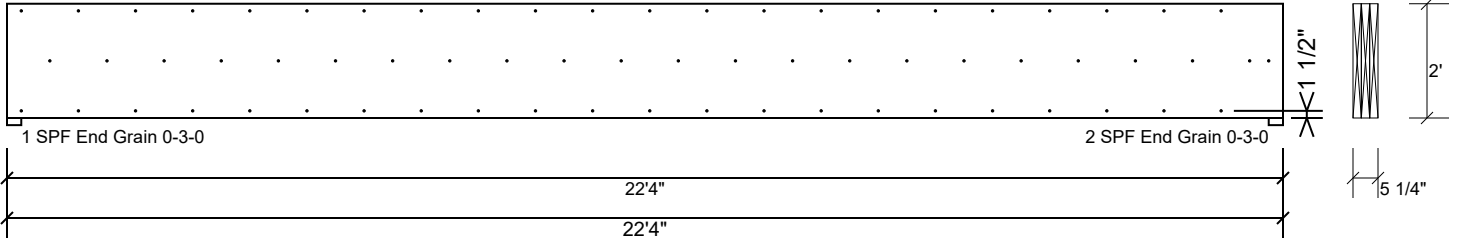

**Multi-Ply Analysis**

Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c.. Nail from both sides. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 43.4 %    |
| Load                     | 122.7 PLF |
| Yield Limit per Foot     | 282.4 PLF |
| Yield Limit per Fastener | 94.1 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         | D+S       |
| Duration Factor          | 1.15      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**DB2 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

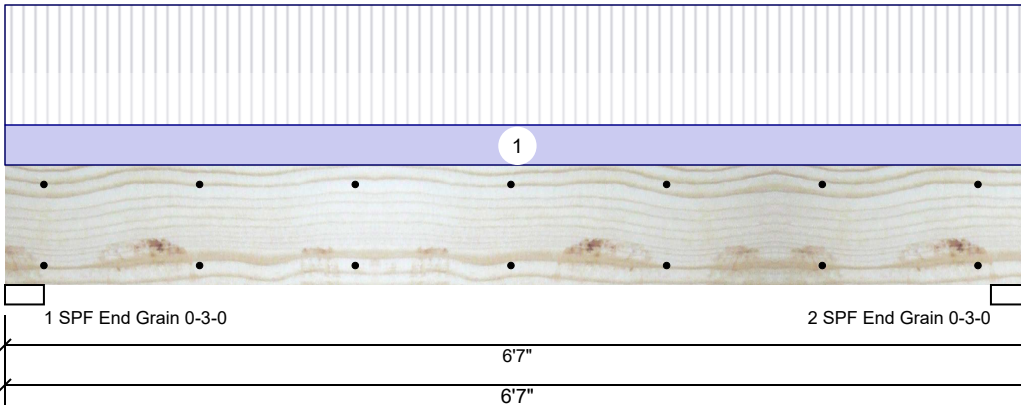

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED lb (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 2696 | 922  | 0    | 0    | 0     |
| 2   | Vertical  | 2696 | 922  | 0    | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------|------|--------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.000" | Vert | 41%  | 922 / 2696   | 3618  | L        | D+L       |
| 2 - SPF End Grain | 3.000" | Vert | 41%  | 922 / 2696   | 3618  | L        | D+L       |

**Analysis Results**

| Analysis     | Actual         | Location | Allowed       | Capacity    | Comb. | Case |
|--------------|----------------|----------|---------------|-------------|-------|------|
| Moment       | 5296 ft-lb     | 3'3 1/2" | 12542 ft-lb   | 0.422 (42%) | D+L   | L    |
| Unbraced     | 5296 ft-lb     | 3'3 1/2" | 9872 ft-lb    | 0.536 (54%) | D+L   | L    |
| Shear        | 2502 lb        | 1' 1/4"  | 6907 lb       | 0.362 (36%) | D+L   | L    |
| LL Defl inch | 0.073 (L/1016) | 3'3 1/2" | 0.155 (L/480) | 0.473 (47%) | L     | L    |
| TL Defl inch | 0.098 (L/757)  | 3'3 1/2" | 0.207 (L/360) | 0.476 (48%) | D+L   | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at end bearings.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

| ID | Load Type   | Location | Trib Width | Side | Dead 0.9 | Live 1  | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|-------------|----------|------------|------|----------|---------|-----------|----------|-------------|----------|
| 1  | Uniform     |          |            | Top  | 273 PLF  | 819 PLF | 0 PLF     | 0 PLF    | 0 PLF       | F01      |
|    | Self Weight |          |            |      | 7 PLF    |         |           |          |             |          |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding



This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**DB2 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

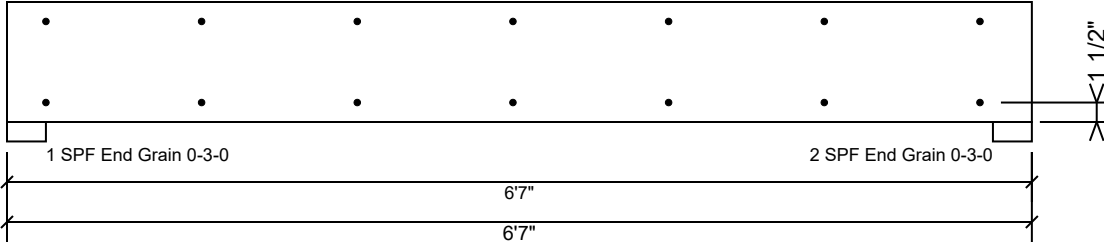

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 163.7 PLF |
| Yield Limit per Fastener | 81.9 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**HDR1 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

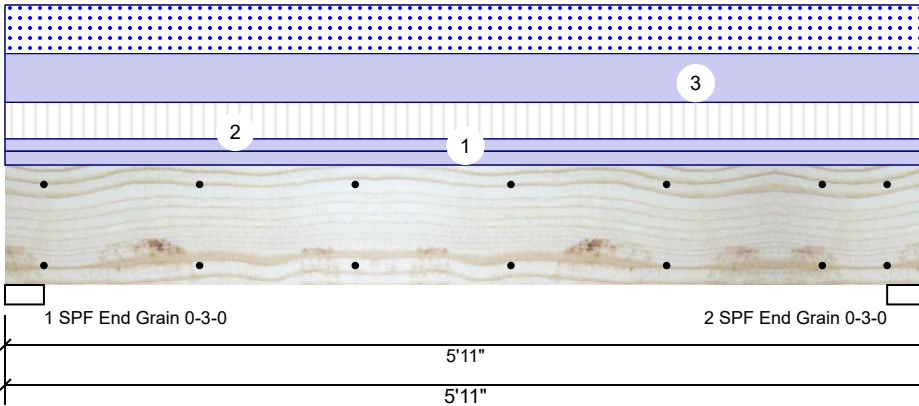

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED lb (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 932  | 1926 | 1240 | 0    | 0     |
| 2   | Vertical  | 932  | 1926 | 1240 | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb.   |
|-------------------|--------|------|------|--------------|-------|----------|-------------|
| 1 - SPF End Grain | 3.000" | Vert | 40%  | 1926 / 1629  | 3555  | L        | D+0.75(L+S) |
| 2 - SPF End Grain | 3.000" | Vert | 40%  | 1926 / 1629  | 3555  | L        | D+0.75(L+S) |

**Analysis Results**

| Analysis     | Actual         | Location  | Allowed       | Capacity    | Comb.       | Case |
|--------------|----------------|-----------|---------------|-------------|-------------|------|
| Moment       | 4613 ft-lb     | 2'11 1/2" | 14423 ft-lb   | 0.320 (32%) | D+0.75(L+S) | L    |
| Unbraced     | 4613 ft-lb     | 2'11 1/2" | 11027 ft-lb   | 0.418 (42%) | D+0.75(L+S) | L    |
| Shear        | 2334 lb        | 4'10 3/4" | 7943 lb       | 0.294 (29%) | D+0.75(L+S) | L    |
| LL Defl inch | 0.033 (L/2026) | 2'11 1/2" | 0.139 (L/480) | 0.237 (24%) | 0.75(L+S)   | L    |
| TL Defl inch | 0.072 (L/928)  | 2'11 1/2" | 0.185 (L/360) | 0.388 (39%) | D+0.75(L+S) | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at end bearings.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

| ID | Load Type   | Location | Trib Width | Side | Dead 0.9 | Live 1  | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments      |
|----|-------------|----------|------------|------|----------|---------|-----------|----------|-------------|---------------|
| 1  | Uniform     |          |            | Top  | 120 PLF  | 0 PLF   | 0 PLF     | 0 PLF    | 0 PLF       | WALL          |
| 2  | Uniform     |          |            | Top  | 105 PLF  | 315 PLF | 0 PLF     | 0 PLF    | 0 PLF       | FLOOR TRUSSES |
| 3  | Uniform     |          |            | Top  | 419 PLF  | 0 PLF   | 419 PLF   | 0 PLF    | 0 PLF       | ROOF TRUSSES  |
|    | Self Weight |          |            |      | 7 PLF    |         |           |          |             |               |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 6/28/2026



**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us



**HDR1 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

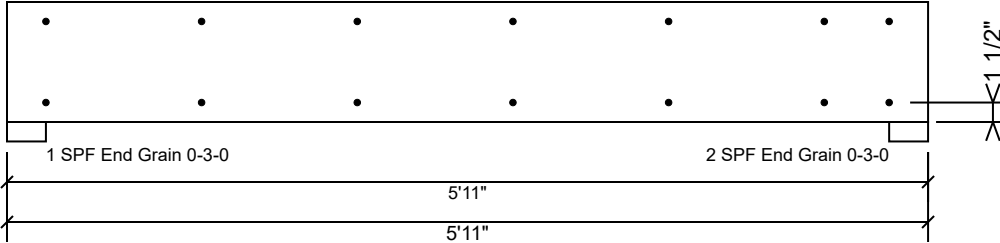

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 163.7 PLF |
| Yield Limit per Fastener | 81.9 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding



This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**DB3 SP #2 2.000" X 12.000" 2-Ply - PASSED**

Level: Level

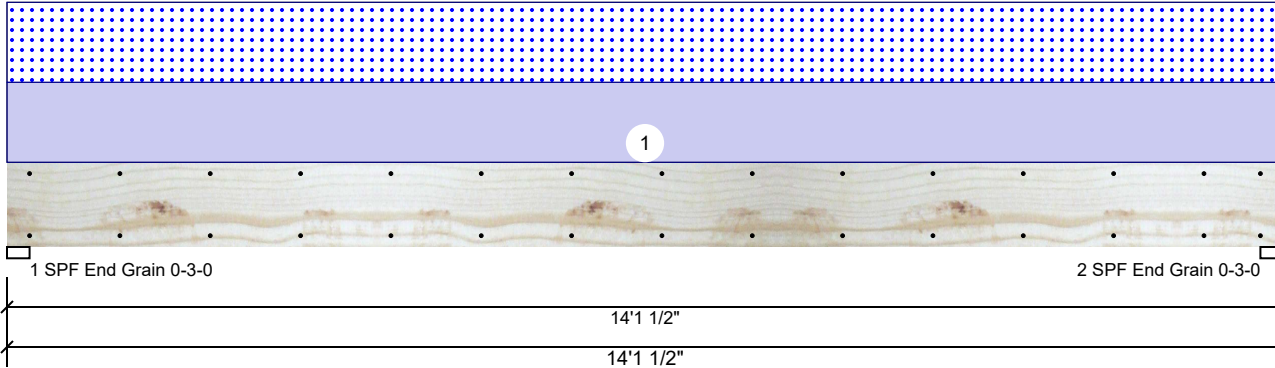

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED Ib (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 0    | 586  | 586  | 0    | 0     |
| 2   | Vertical  | 0    | 586  | 586  | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------|------|--------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.000" | Vert | 23%  | 586 / 586    | 1172  | L        | D+S       |
| 2 - SPF End Grain | 3.000" | Vert | 23%  | 586 / 586    | 1172  | L        | D+S       |

**Analysis Results**

| Analysis     | Actual         | Location  | Allowed       | Capacity     | Comb. | Case |
|--------------|----------------|-----------|---------------|--------------|-------|------|
| Moment       | 3923 ft-lb     | 7' 3/4"   | 4548 ft-lb    | 0.863 (86%)  | D+S   | L    |
| Unbraced     | 3923 ft-lb     | 7' 3/4"   | 3925 ft-lb    | 1.000 (100%) | D+S   | L    |
| Shear        | 975 lb         | 1'2 1/4"  | 4528 lb       | 0.215 (22%)  | D+S   | L    |
| LL Defl inch | 0.134 (L/1232) | 7' 13/16" | 0.344 (L/480) | 0.390 (39%)  | S     | L    |
| TL Defl inch | 0.268 (L/616)  | 7' 13/16" | 0.458 (L/360) | 0.585 (58%)  | D+S   | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at a maximum of 7'2 3/8" o.c.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.


| ID | Load Type | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments  |
|----|-----------|----------|------------|------|----------|--------|-----------|----------|-------------|-----------|
| 1  | Uniform   |          |            | Top  | 83 PLF   | 0 PLF  | 83 PLF    | 0 PLF    | 0 PLF       | P TRUSSES |

**Manufacturer Info**

This design is valid until 6/28/2026

**DB3 SP #2 2.000" X 12.000" 2-Ply - PASSED**

Level: Level

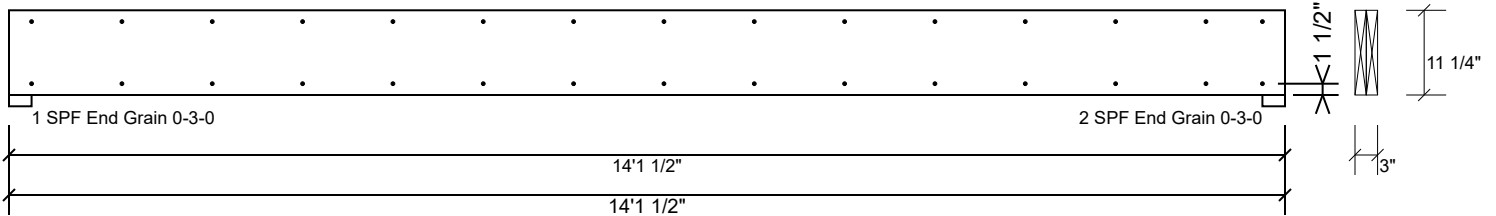

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".


|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 202.6 PLF |
| Yield Limit per Fastener | 101.3 lb. |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

|                          |  |
|--------------------------|--|
| <b>Manufacturer Info</b> |  |
|                          |  |

This design is valid until 6/28/2026

**HDR2 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

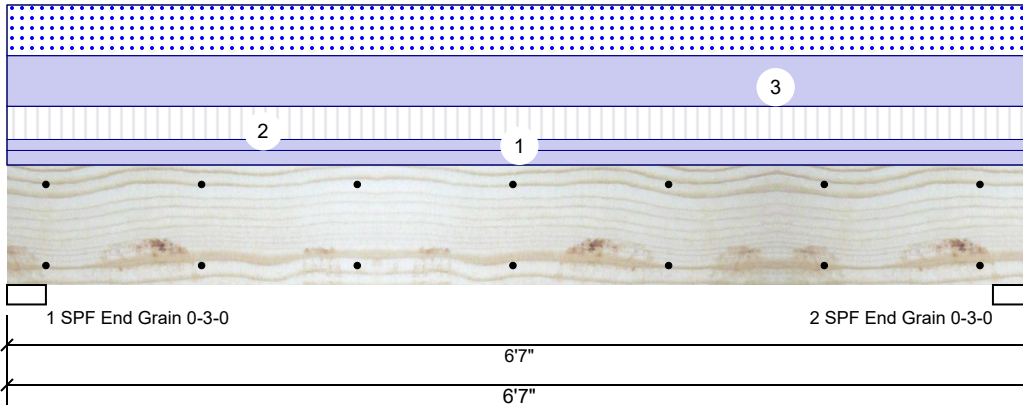

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED lb (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 902  | 2097 | 1379 | 0    | 0     |
| 2   | Vertical  | 902  | 2097 | 1379 | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb.   |
|-------------------|--------|------|------|--------------|-------|----------|-------------|
| 1 - SPF End Grain | 3.000" | Vert | 43%  | 2097 / 1711  | 3808  | L        | D+0.75(L+S) |
| 2 - SPF End Grain | 3.000" | Vert | 43%  | 2097 / 1711  | 3808  | L        | D+0.75(L+S) |

**Analysis Results**

| Analysis     | Actual         | Location | Allowed       | Capacity    | Comb.       | Case |
|--------------|----------------|----------|---------------|-------------|-------------|------|
| Moment       | 5574 ft-lb     | 3' 1/2"  | 14423 ft-lb   | 0.386 (39%) | D+0.75(L+S) | L    |
| Unbraced     | 5574 ft-lb     | 3' 1/2"  | 10370 ft-lb   | 0.538 (54%) | D+0.75(L+S) | L    |
| Shear        | 2633 lb        | 1' 1/4"  | 7943 lb       | 0.331 (33%) | D+0.75(L+S) | L    |
| LL Defl inch | 0.047 (L/1601) | 3' 1/2"  | 0.155 (L/480) | 0.300 (30%) | 0.75(L+S)   | L    |
| TL Defl inch | 0.104 (L/719)  | 3' 1/2"  | 0.207 (L/360) | 0.501 (50%) | D+0.75(L+S) | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at end bearings.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

| ID | Load Type   | Location | Trib Width | Side | Dead 0.9 | Live 1  | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments      |
|----|-------------|----------|------------|------|----------|---------|-----------|----------|-------------|---------------|
| 1  | Uniform     |          |            | Top  | 120 PLF  | 0 PLF   | 0 PLF     | 0 PLF    | 0 PLF       | WALL          |
| 2  | Uniform     |          |            | Top  | 91 PLF   | 274 PLF | 0 PLF     | 0 PLF    | 0 PLF       | FLOOR TRUSSES |
| 3  | Uniform     |          |            | Top  | 419 PLF  | 0 PLF   | 419 PLF   | 0 PLF    | 0 PLF       | ROOF TRUSSES  |
|    | Self Weight |          |            |      | 7 PLF    |         |           |          |             |               |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding



This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**HDR2 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

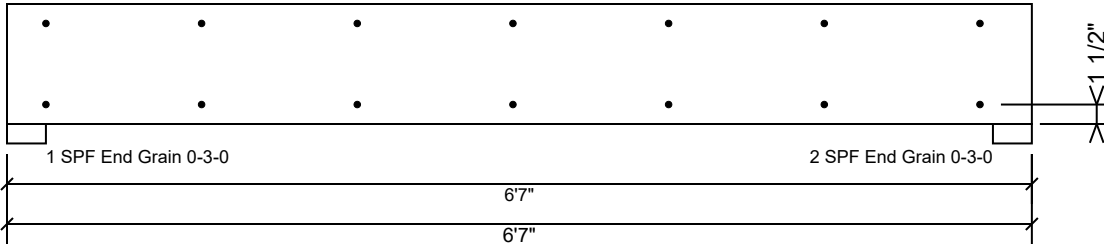

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 163.7 PLF |
| Yield Limit per Fastener | 81.9 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**HDR3 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

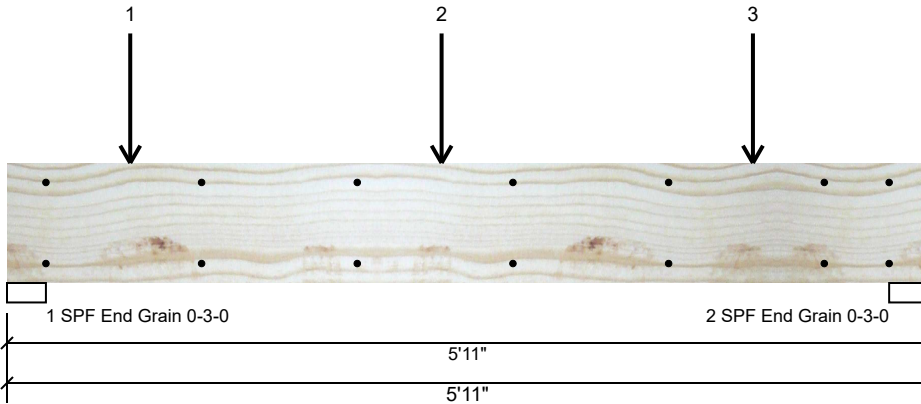

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED lb (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 0    | 1472 | 1451 | 0    | 0     |
| 2   | Vertical  | 0    | 871  | 850  | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------|------|--------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.000" | Vert | 33%  | 1472 / 1451  | 2923  | L        | D+S       |
| 2 - SPF End Grain | 3.000" | Vert | 20%  | 871 / 850    | 1721  | L        | D+S       |

**Analysis Results**

| Analysis     | Actual         | Location | Allowed       | Capacity    | Comb. | Case |
|--------------|----------------|----------|---------------|-------------|-------|------|
| Moment       | 4533 ft-lb     | 2'9 1/2" | 14423 ft-lb   | 0.314 (31%) | D+S   | L    |
| Unbraced     | 4533 ft-lb     | 2'9 1/2" | 11027 ft-lb   | 0.411 (41%) | D+S   | L    |
| Shear        | 2468 lb        | 1' 1/4"  | 7943 lb       | 0.311 (31%) | D+S   | L    |
| LL Defl inch | 0.031 (L/2162) | 2'9 1/2" | 0.139 (L/480) | 0.222 (22%) | S     | L    |
| TL Defl inch | 0.062 (L/1074) | 2'9 1/2" | 0.185 (L/360) | 0.335 (34%) | D+S   | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at end bearings.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

| ID | Load Type      | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|----------------|----------|------------|------|----------|--------|-----------|----------|-------------|----------|
| 1  | Point          | 0-9-8    |            | Top  | 763 lb   | 0 lb   | 763 lb    | 0 lb     | 0 lb        | A2       |
|    | Bearing Length | 0-3-8    |            |      |          |        |           |          |             |          |
| 2  | Point          | 2-9-8    |            | Top  | 1416 lb  | 0 lb   | 1416 lb   | 0 lb     | 0 lb        | A1       |
|    | Bearing Length | 0-3-8    |            |      |          |        |           |          |             |          |
| 3  | Point          | 4-9-8    |            | Top  | 122 lb   | 0 lb   | 122 lb    | 0 lb     | 0 lb        | YA2      |



Continued on page 2...

|  |  |   |   |
|--|--|---|---|
| <p><b>Notes</b></p> <p>Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.</p> <p><b>Lumber</b></p> <ol style="list-style-type: none"> <li>1. Dry service conditions, unless noted otherwise</li> <li>2. LVL not to be treated with fire retardant or corrosive chemicals</li> </ol> | <p><b>Handling &amp; Installation</b></p> <ol style="list-style-type: none"> <li>1. LVL beams must not be cut or drilled</li> <li>2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals</li> <li>3. Damaged Beams must not be used</li> <li>4. Design assumes top edge is laterally restrained</li> <li>5. Provide lateral support at bearing points to avoid lateral displacement and rotation</li> </ol> | <p>6. For flat roofs provide proper drainage to prevent ponding</p> | <p><b>Manufacturer Info</b></p> <p>Metsä Wood<br/>301 Merritt 7 Building, 2nd Floor<br/>Norwalk, CT 06851<br/>(800) 622-5850<br/>www.metsawood.com/us</p> |
|  |  |   | <p>This design is valid until 6/28/2026</p>   |



**HDR3 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

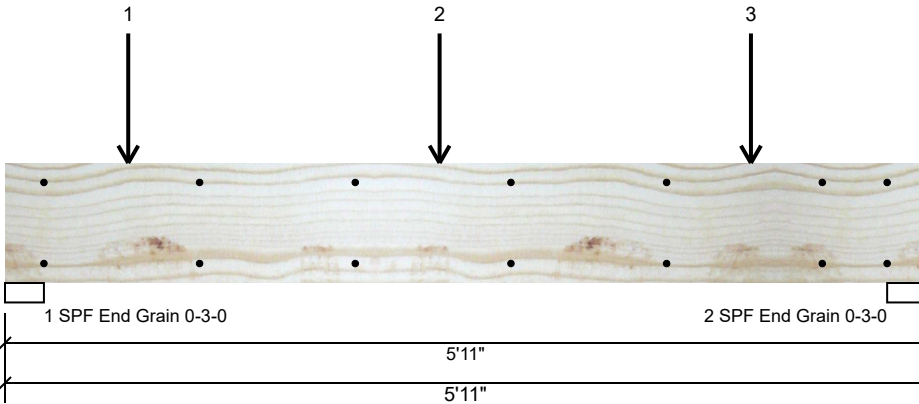

...Continued from page 1

| ID | Load Type      | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|----------------|----------|------------|------|----------|--------|-----------|----------|-------------|----------|
|    | Bearing Length | 0-3-8    |            |      |          |        |           |          |             |          |
|    | Self Weight    |          |            |      | 7 PLF    |        |           |          |             |          |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding



This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**HDR3 Kerto-S LVL 1.750" X 9.250" 2-Ply - PASSED**

Level: Level

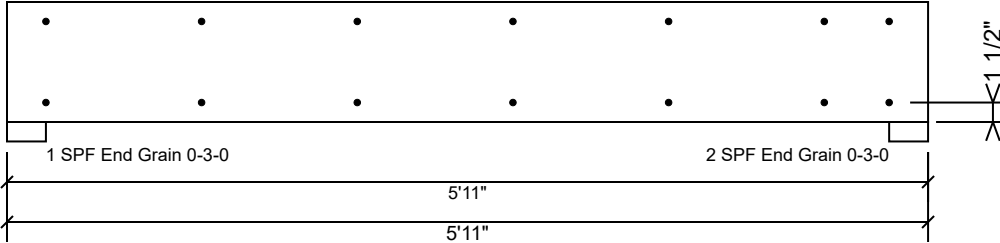

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 163.7 PLF |
| Yield Limit per Fastener | 81.9 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**GDH Kerto-S LVL 1.750" X 11.875" 2-Ply - PASSED**

Level: Level

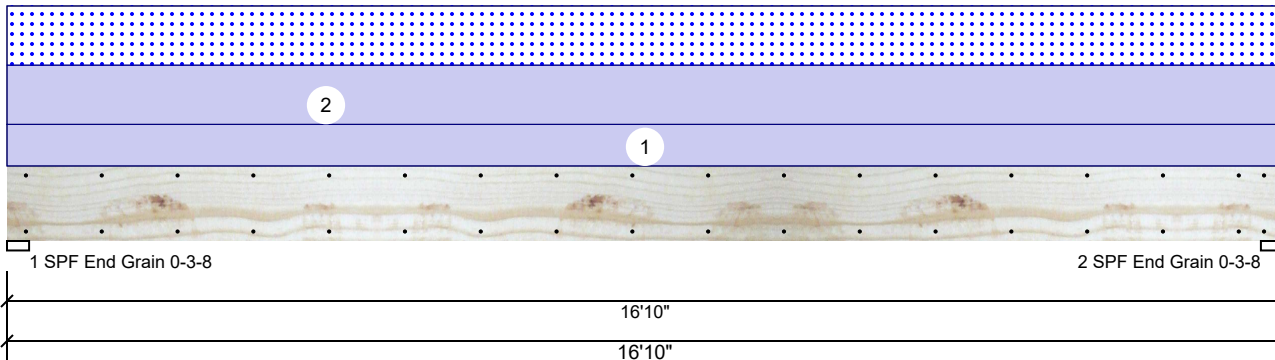

**Member Information**

|                     |               |                |              |
|---------------------|---------------|----------------|--------------|
| Type:               | Girder        | Application:   | Floor        |
| Plies:              | 2             | Design Method: | ASD          |
| Moisture Condition: | Dry           | Building Code: | IBC/IRC 2015 |
| Deflection LL:      | 480           | Load Sharing:  | No           |
| Deflection TL:      | 360           | Deck:          | Not Checked  |
| Importance:         | Normal - II   |                |              |
| Temperature:        | Temp <= 100°F |                |              |

**Reactions UNPATTERNED Ib (Uplift)**

| Brg | Direction | Live | Dead | Snow | Wind | Const |
|-----|-----------|------|------|------|------|-------|
| 1   | Vertical  | 0    | 995  | 539  | 0    | 0     |
| 2   | Vertical  | 0    | 995  | 539  | 0    | 0     |

**Bearings**

| Bearing           | Length | Dir. | Cap. | React D/L lb | Total | Ld. Case | Ld. Comb. |
|-------------------|--------|------|------|--------------|-------|----------|-----------|
| 1 - SPF End Grain | 3.500" | Vert | 15%  | 995 / 539    | 1534  | L        | D+S       |
| 2 - SPF End Grain | 3.500" | Vert | 15%  | 995 / 539    | 1534  | L        | D+S       |

**Analysis Results**

| Analysis     | Actual         | Location  | Allowed       | Capacity     | Comb. | Case |
|--------------|----------------|-----------|---------------|--------------|-------|------|
| Moment       | 6108 ft-lb     | 8'5"      | 22897 ft-lb   | 0.267 (27%)  | D+S   | L    |
| Unbraced     | 6108 ft-lb     | 8'5"      | 6109 ft-lb    | 1.000 (100%) | D+S   | L    |
| Shear        | 1309 lb        | 1'3 3/8"  | 10197 lb      | 0.128 (13%)  | D+S   | L    |
| LL Defl inch | 0.112 (L/1755) | 8'5 1/16" | 0.409 (L/480) | 0.273 (27%)  | S     | L    |
| TL Defl inch | 0.319 (L/617)  | 8'5 1/16" | 0.546 (L/360) | 0.584 (58%)  | D+S   | L    |

**Design Notes**

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at a maximum of 16'3 3/4" o.c.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

| ID | Load Type   | Location | Trib Width | Side | Dead 0.9 | Live 1 | Snow 1.15 | Wind 1.6 | Const. 1.25 | Comments |
|----|-------------|----------|------------|------|----------|--------|-----------|----------|-------------|----------|
| 1  | Uniform     |          |            | Top  | 45 PLF   | 0 PLF  | 0 PLF     | 0 PLF    | 0 PLF       | WALL     |
| 2  | Uniform     |          |            | Top  | 64 PLF   | 0 PLF  | 64 PLF    | 0 PLF    | 0 PLF       | P2       |
|    | Self Weight |          |            |      | 9 PLF    |        |           |          |             |          |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding


This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us

**GDH Kerto-S LVL 1.750" X 11.875" 2-Ply - PASSED**

Level: Level

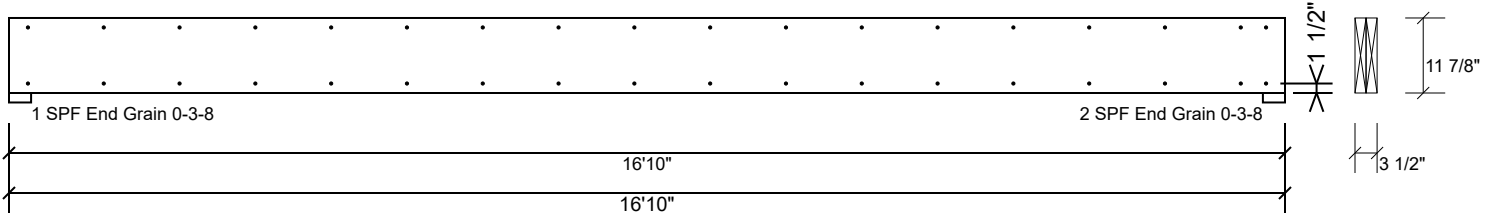

**Multi-Ply Analysis**

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

|                          |           |
|--------------------------|-----------|
| Capacity                 | 0.0 %     |
| Load                     | 0.0 PLF   |
| Yield Limit per Foot     | 163.7 PLF |
| Yield Limit per Fastener | 81.9 lb.  |
| C <sub>m</sub>           | 1         |
| Yield Mode               | IV        |
| Edge Distance            | 1 1/2"    |
| Min. End Distance        | 3"        |
| Load Combination         |           |
| Duration Factor          | 1.00      |

**Notes**

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

**Lumber**

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

**Handling & Installation**

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 6/28/2026

**Manufacturer Info**

Metsä Wood  
301 Merritt 7 Building, 2nd Floor  
Norwalk, CT 06851  
(800) 622-5850  
www.metsawood.com/us