REVISION LOG

REVISION:001

ADJUST OPTION SQUARE FOOTAGES TO ACCURATELY SHOW THE DIFFERENCES FROM THE BASE PLAN SQUARE FOOTAGE TOTALS.

REVISION:002

1. ADJUST OPTION SQUARE FOOTAGES TO ACCURATELY SHOW THE DIFFERENCES FROM THE BASE PLAN SQUARE FOOTAGE TOTALS.
2. EXTENDED TRIM AT GARAGE DOOR DOWN TO BASE AND CUT STONE BACK
3. ADJUSTED KITCHEN ISLAND
4. RESIZED THE FIREPLACE OPTION
5. RELOCATED THE WINDOW IN THE MESSY KITCHEN TO BEHIND THE OPT. SINK
6. CHANGED MESSY KITCHEN WINDOW TO OPTIONAL
7. ADDED CHASE TO OWNER'S WIC
8. ADDED DIMST TO 0. BATH VANITY FOR CLARIFICATION
9. REMOVED OPT. DOOR TO LOFT
10. ADDED CHASE TO LOFT WIC
11. RELOCATED LINEN IN THE 0. BATH OPTIONS
12. REMOVED THE OPT. SUPER SHOWER (ZERO ENTRY)
13. FLIPPED SMART DOOR DELIVERY DOOR HANDING
14. CHANGED ALL LINEN CLOSETS TO HAVE ONLY 4 SHELVES
15. CHANGED SIZE OF BASE SHOWER TO GOX36
16. UPDATED OPTIONAL SQ. FTIG. CHART
17. REMOVED HALE WALLS AT KITCHEN ISLAND AND UPDATED PER CABINET PROVIDER
18. EXTEND PORCH SLAB 4* AF FRONT AND EXTEND AROUND CORNER 20* TO SUPPORT STONE VENEER
19. EXTEND PORCH SLAB 4* AROUND THE PERMETER AT THE 'CRAFTSMAN' ELEVATION

DATE: 3/30/2022

EXTEND PORCH SLAB 4" AROUND THE PERIMETER AT THE 'CRAFTSMAN' ELEVATION

ADDED A COLUMN DETAIL FOR CLARITY ON THE "CRAFTSMAM" ELEVATION
ADDED A SEPARATE OPTION FOR THE POCKET OFFICE WITH THE SMART DELIVERY DOOR
ADDED ELECTRICAL PLAN SHEETS

REVISION:004 DATE: 6/20/2022

1. ADD SIDE LOAD GARAGE.

REVISION:005

DATE: 7/22/2022

ADD STEM WALL SLAB FOUNDATION SHEETS CORRECT OPTIONAL SMART DELIVERY DOOR LOCATION ON FOUNDATION PLANS TO MATCH FLOOR PLAN.

SQUARE FOOTAGE **ENGLISH COUNTRY** UNHEATED HEATED FIRST FLOOR 872 SECOND FLOOR 1337 2 CAR GARAGE 437 SUBTOTALS 2209 TOTAL UNDER ROOF **OPTIONS** UNHEATED S.F. HEATED S.F. COVERED PATIO EXTENDED CAFE +152 FRONT PORCH W/ 0 FRONT POCKET OFFICE +61 W/ SMART DOOR

Lot 2B Heritage @ Neill's Creek

1701 Neills Creek Road Lillington, NC 27546

NC.



PLAN 2 The Holly - LH **'ENGLISH COUNTRY' ELEVATION**

Sheet No.	Sheet Description								
0.0	Cover Sheet								
1.1	Foundation (Slab)								
1.1.1	Foundation Options (Slab)								
1.1.2	Foundation Options (Slab)								
1.2	Foundation (Crawl)								
1.2.1	Foundation Options (Crawl)								
1.2.2	Foundation Options (Crawl)								
1.3	Foundation (Stem Wall Slab)								
1.3.1	Foundation Options (Stem Wall Slab)								
1.3.2	Foundation Options (Stem Wall Slab)								
2.1	First Floor Plan								
2.1.1	First Floor Plan Options								
2.2	Second Floor Plan								
2.2.1	Second Floor Plan Options								
2.4	Covered Porch Plans & Elevations (Slab)								
2.4.1	Covered Porch Plans & Elevations (Crawl/Stem Wall)								
2.5	Covered Porch w/ Extended Cafe Plans & Elevations (Slab)								
2.5.1	Covered Porch w/ Extended Cafe Plans & Elevations (Crawl/ Stem Wall)								
2.6	Extended Cafe Plans & Elevations (Slab)								
2.6.1	Extended Cafe Plans & Elevations (Crawl/ Stem Wall)								
2.7	2-Car Sideload Garage Plans								
2.7.1	2-Car Sideload Garage Elevations								
3.1	Front & Rear Elevations (Slab)								
3.1.1	Front & Rear Elevations (Crawl/ Stem Wall)								
3.2	Side Elevations (Slab)								
3.2.1	Side Elevations (Crawl/ Stem Wall)								
3.3	Roof Plan								
5.1	First Floor Electrical								
5.1.1	First Floor Options Electrical								
5.2	Second Floor Electrical								
5.2.1	Second Floor Options Electrical								

DESIGN CRITERIA:

THIS PLAN IS TO BE BUILT IN CONFORMANCE WITH THE 2018 NORTH CAROLINA STATE BUILDING CODE: RESIDENTIAL CODE

DIMENSIONS SHALL GOVERN OVER SCALE, AND CODE SHALL GOVERN OVER DIMENSIONS.


DATE		-							
DESCRIPTION		-	ł	1	1	1	1		
REV.#	1	2	3	4	2	9	7	8	
ı									


THE HOLLY 1 PLAN 2 Sheet 'English Country


DRAWN BY: South Designs ISSUE DATE:


IRRENT REVISION DATE

1/8" = 1'-0"

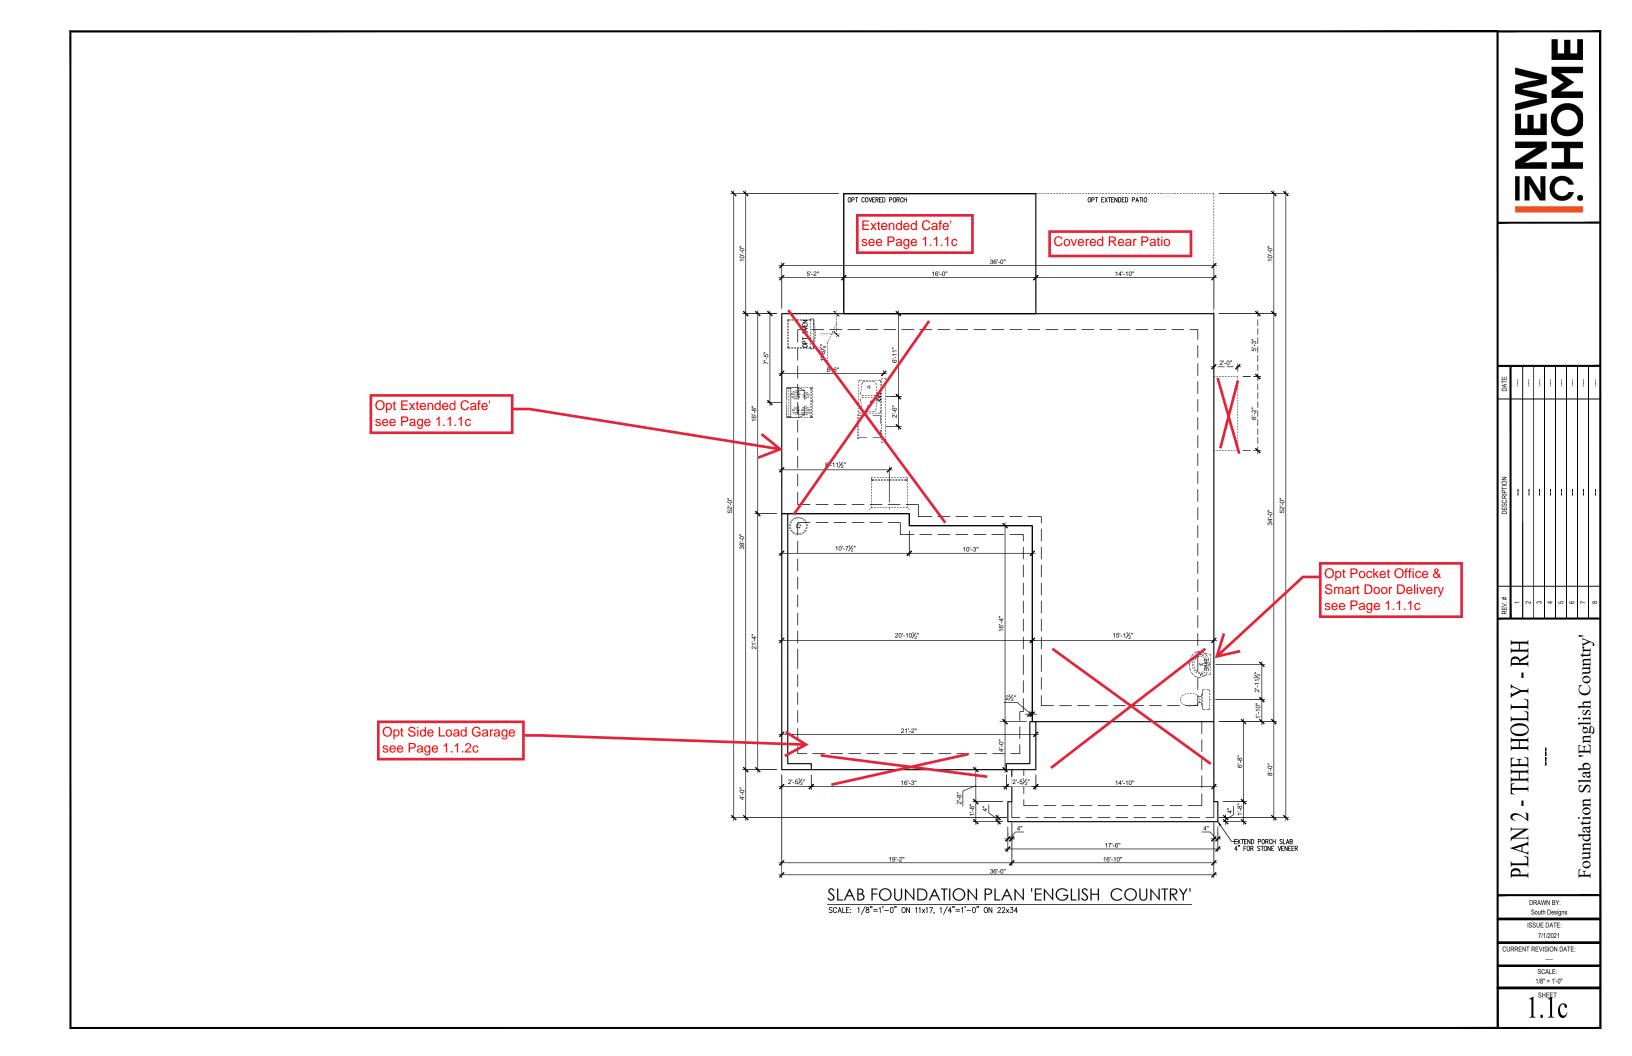

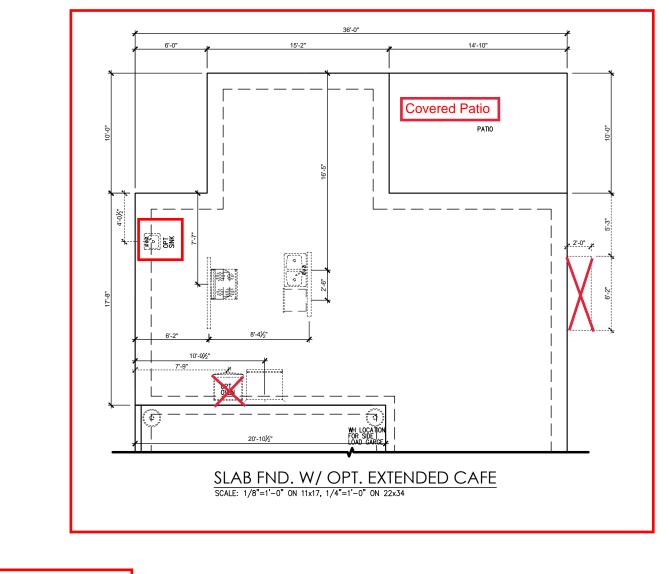

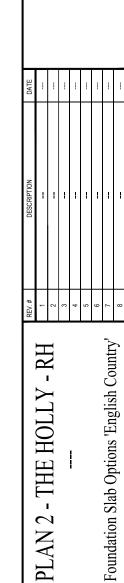


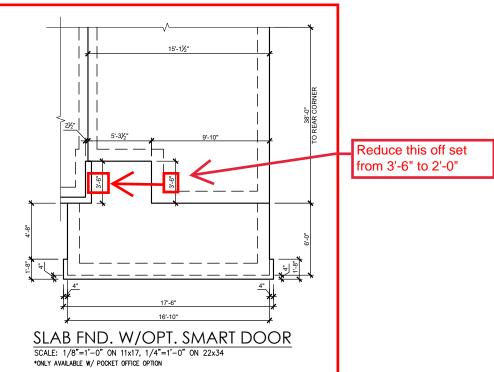

PLAN 2 - THE HOLLY

DRAWN BY: South Designs ISSUE DATE:

URRENT REVISION DATE: SCALE: 1/8" = 1'-0"

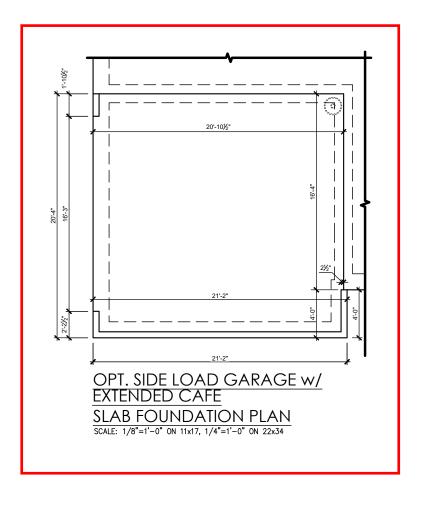



	REV.#	DESCRIPTION	DATE
Ц	1	-	1
	2	1	
	3	1	1
	4	1	-
	2	1	-
ich	9	1	
1161	7	1	
	8	1	

PLAN 2 - THE HOLLY - R
--Foundation Slab Options 'Engli
Country'

DRAWN BY: South Designs

ISSUE DATE:
7/1/2021


CURRENT REVISION DATE:

SCALE:

1/8" = 1'-0" 1 1 1 7


General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9"-1 1/2" at first floor and 8"-1 1/2" at second floor and attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 6'-11" AFF at First Floor, and 6'-11" AFF at Second Floor U.N.O. on elevation drawings. Windows at front elevation may be higher at the first floor.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4
 jack stud SPF on each side. Openings greater than
 3'-4" wide shall have (2) 2x4 jack studs SPF on each
 side.
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling pian elements are shown on the floor pians and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinety.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure alazina.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pontries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more than 4" between guards.
- 11. Aftic Access shall be provided at all aftic area with a height greater than 30". Minimum clear aftic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

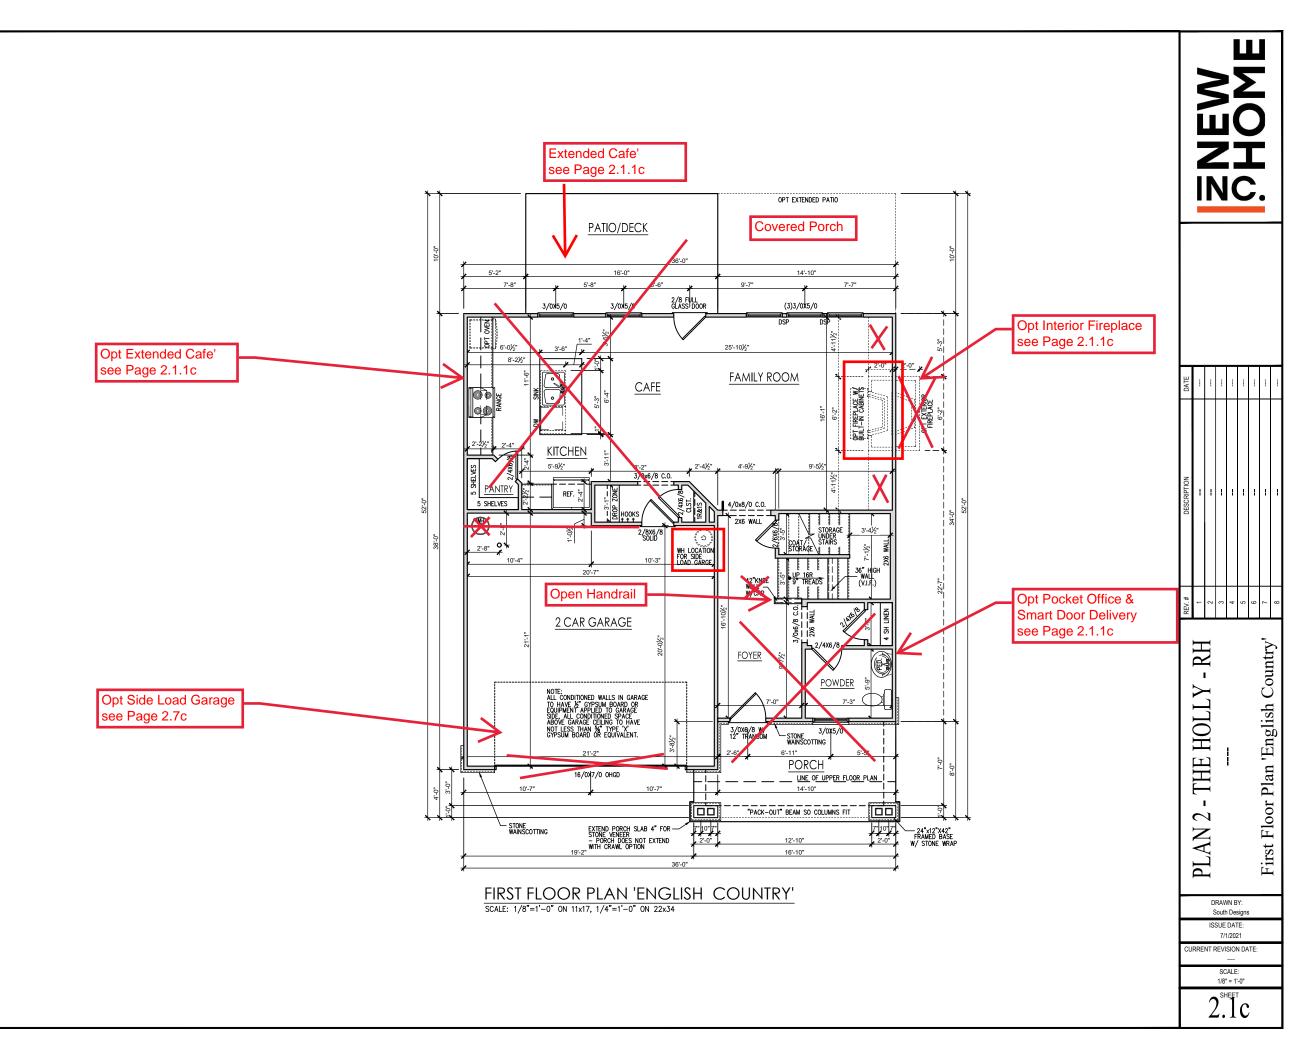


General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9-1 1/2" at first floor and 8'-1 1/2" at second floor and attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 6'-11" AFF at First Floor, and 6'-11" AFF at Second Floor U.N.O. on elevation drawings. Windows at front elevation may be higher at the first floor.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4
 jack stud SPF on each side. Openings greater than
 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling pian elements are shown on the floor pians and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinety.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handrails and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handrails at landings and overlooks of multillevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30". Minimum clear attic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

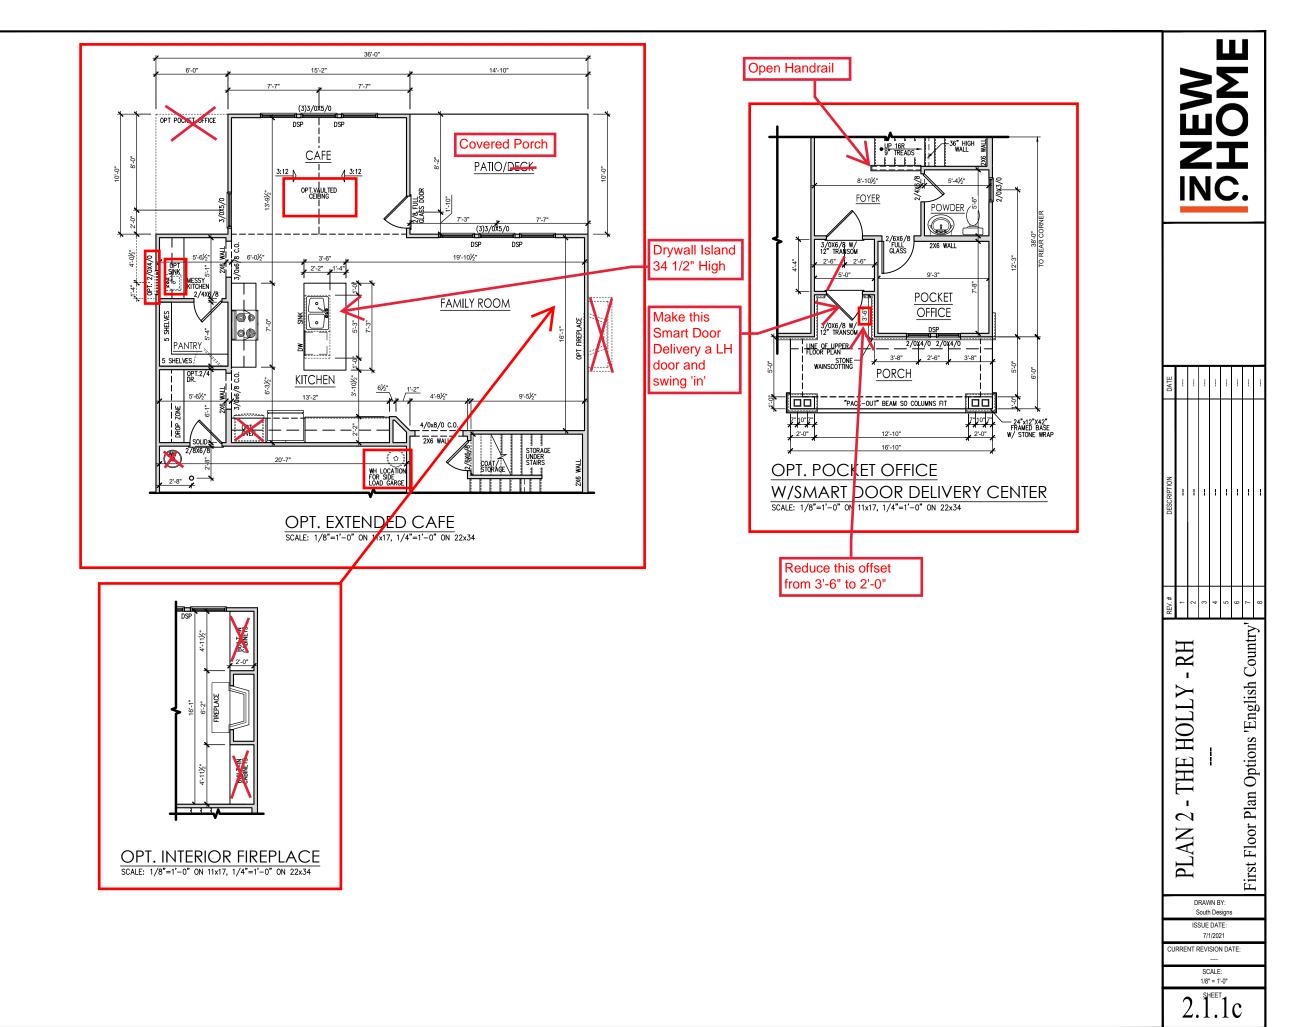

General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9-1 1/2" at first floor and 8-1 1/2" at second floor and attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures.
 Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 6'-11" AFF at First Floor, and 6'-11" AFF at Second Floor U.N.O. on elevation drawings. Windows at front elevation may be higher at the first floor.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4 jack stud SPF on each side. Openings greater than 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling pian elements are shown on the floor pians and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinety.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/sheff. Closets for linen shall have 4 open equal shelves. Closets for pantries shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handralls and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handralls at landings and overlooks of multilevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30". Minimum clear attic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

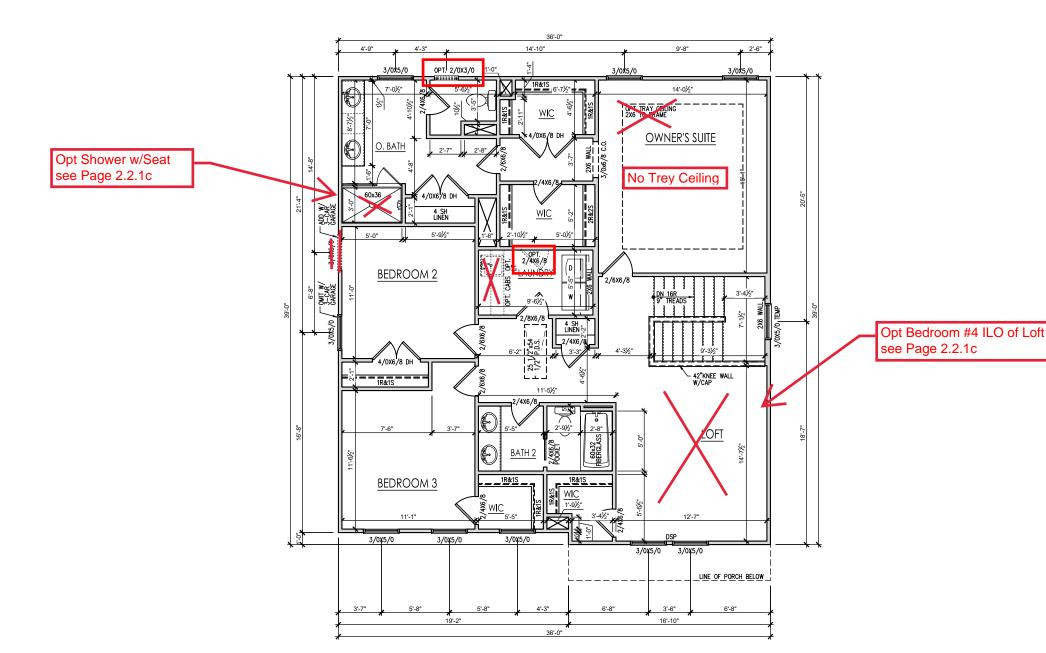

SECOND FLOOR PLAN 'ENGLISH COUNTRY'

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

NEW PHOME

PLAN 2 - THE HOLLY - RH --- Country'

Plan 'English

Floor

Second

DRAWN BY: South Designs


7/1/2021 JRRENT REVISION DATE:


> SCALE: 1/8" = 1'-0"

2.2c

General Floor Plan Notes shall apply unless noted otherwise on plan.

- Wall Heights: Typically 9°-1 1/2" at first floor and 8°-1 1/2" at second floor and attics U.N.O. All walls are constructed using a double top plate. Splices at Double Top Plate do not need to occur at Vertical Studs but must be at least 24" apart from Joint in other Top Plate layer. Special wall heights are noted on plans where they occur.
- Wall Thickness is typically 3 1/2". 2x6 frame shall be used at walls that back up to plumbing fixtures. Walls greater than 10' high shall be framed with 2x6 framing or greater and will be noted as a special condition where it occurs on plan.
- Typical header height shall be 6'-11" AFF at First Floor, and 6'-11" AFF at Second Floor U.N.O. on elevation drawings. Windows at front elevation may be higher at the first floor.
- Jacks: Openings up to 3'-4" wide shall have (1) 2x4 jack stud SPF on each side. Openings greater than 3'-4" wide shall have (2) 2x4 jack studs SPF on each
- Soffits, Coffered Ceilings, Trey Ceilings and other significant ceiling plan elements are shown on the floor plans and are denoted as single dashed lines. Unless specifically call out as included, Kitchens do not include soffits over wall cabinetry.
- Door & Window Frames, where occurring near corners, shall be a minimum of 4 1/2" from corner. Except for walk-in closets with doors near a corner, doors at closets shall be centered on closet.
- Windows: Shall have at least (1) window in each sleeping room, that meets egress. Shall be provided with tempered glass at hazardous glazing areas. False windows shall be installed with obscure glazing.
- Closets for clothing or coat storage shall be equipped with 1 rod/shelf. Closets for linen shall have 4 open equal shelves. Closets for panties shall have 4 equal wood shelves, painted.
- Stair treads shall be a min of 9" deep, risers shall be a maximum of 8 1/4", unless noted otherwise, per the current North Carolina Residential Code
- 10. Handralls and Guards at stairs shall be 34" above the finished surface of the ramp surface of the stair. Handralls at landings and overlooks of multillevel spaces shall be 36" above finished floor. Guards (pickets or balusters) shall be spaced with no more than 4" between guards.
- 11. Attic Access shall be provided at all attic area with a height greater than 30". Minimum clear attic access shall be 20" x 30". Pull down stairs and access doors in knee walls meeting minimum criteria are also acceptable.
- 12. Garage Door to Living Space shall be 2'-8" x 6'-8" minimum size and shall be 20 minute fire rated and weather sealed.
- 13. Garage Walls, as a minimum, shall be separated from living space by installing 1/2" gypsum board on the garage side of the wall. With habitable space above, the inside of all garage walls require 1/2" GWB supporting 5/8" type X GWB on ceiling.

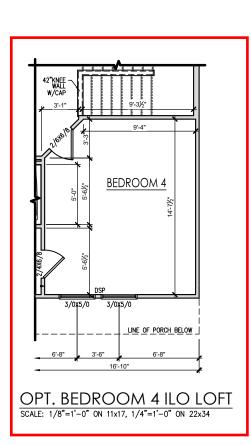



NEW SHOME

DATE									
DESCRIPTION		-	1	1	1	1	1		
REV.#	1	2	3	4	2	9	7	8	


PLAN 2 - THE HOLLY - RH --- Second Floor Plan Options 'English Country'

DRAWN BY: South Designs


ISSUE DATE: 7/1/2021 CURRENT REVISION DATE:


> SCALE: 1/8" = 1'-0"

2.2.10

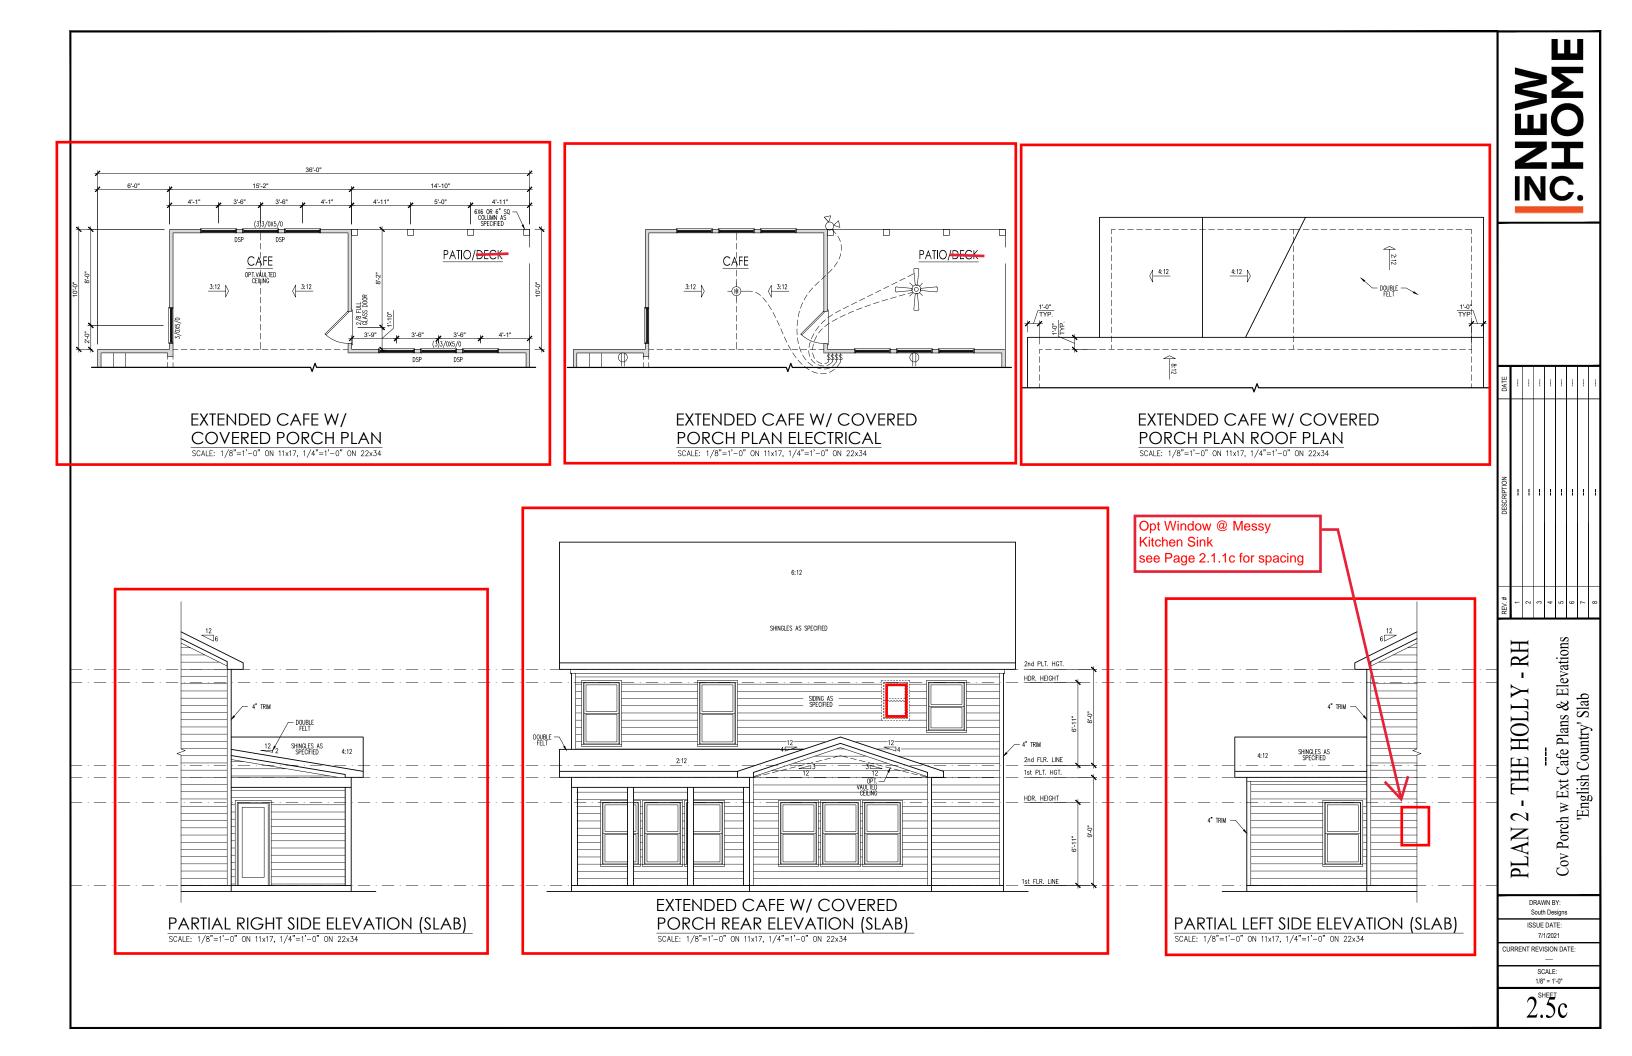



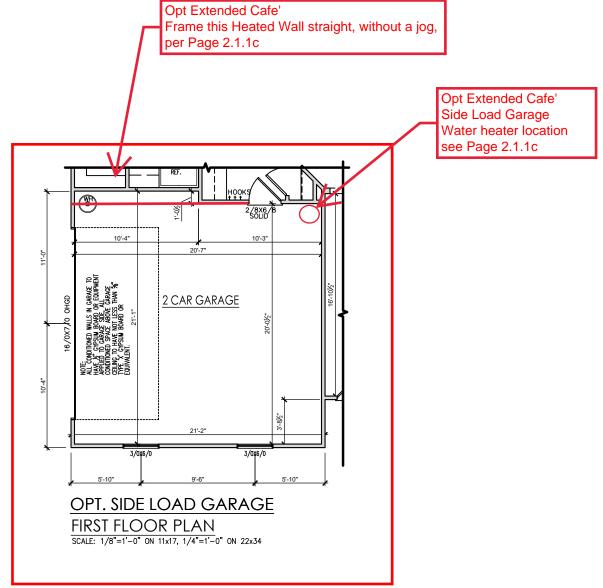

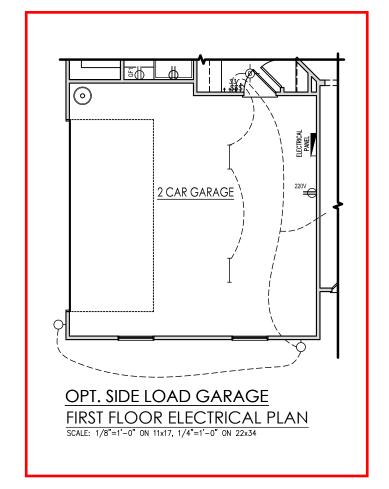

 REV.#
 DESCRIPTION
 DATE

 1
 - -

 2
 - -

 3
 - -

 4
 - -

 5
 - -

 6
 - -

 7
 - -

 8
 - -


PLAN 2 - THE HOLLY - RH
--2-Car Sideload Garage Plans 'English Country'

DRAWN BY: South Designs

ISSUE DATE: 7/1/2021

CURRENT REVISION DATE:
---SCALE:
1/8" = 1'-0"

2.7.c

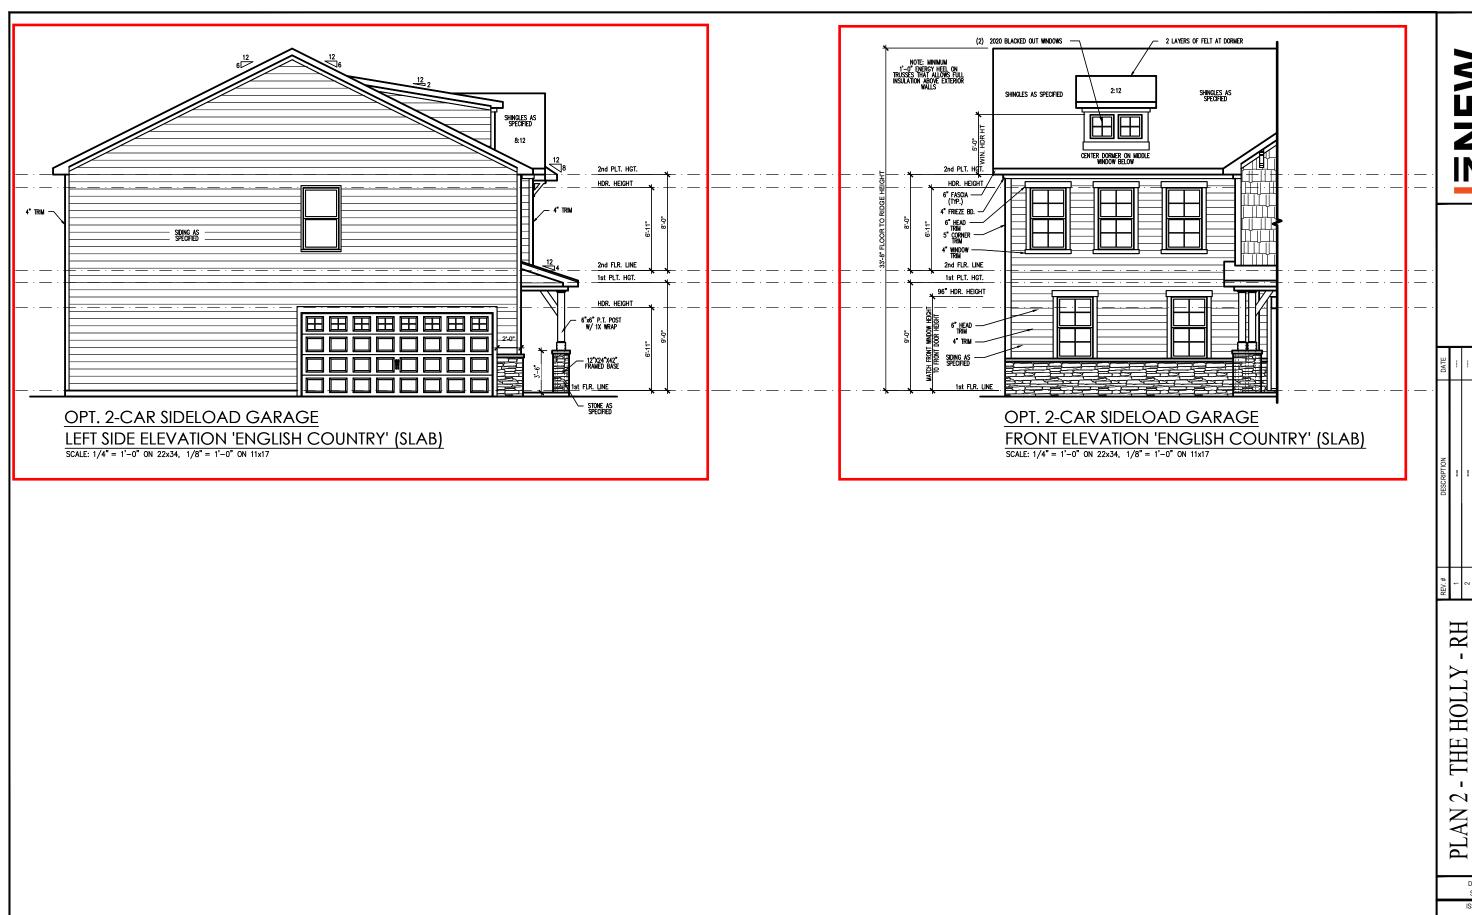

NEW NOHC:



2-Car Sideload Garage Elevations 'English Country'

DRAWN BY: South Designs

ISSUE DATE: JRRENT REVISION DATE:

SCALE: 1/8" = 1'-0"

2.7.1c

General Elevation Notes

General Elevation Notes shall apply unless

- Roof shall be finished with architectural composition shingles with slopes as noted on plan.
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation drawings.
- 8. Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67sf of brick is supported by (1) tie. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that if laps under the house wrap material a minimum of 2".
 Weepholes shall be provided at a rate of 48" oc and shall not be less than 3/16" in diameter and shall be located immediately obove flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited to L/600.

Masonry Opening Lintel Schedule

Opening Size Angle

 up to 4'-0"
 3-1/2" x 3-1/2" x 5/16"

 4'-1" to 5'-6"
 4" x 3-1/2" x 5/16" LLV

 5'-7" to 6'-6"
 5" x 3-1/2" x 5/16" LLV

 6'-7" to 8'-4"
 6" x 3-1/2" x 5/16" LLV


 8'-5" to 16'-4"
 7" x 4" x 3/8" LLV

Rear Elevation


see Page 2.5c

Opt Extended Cafe' & Covered Porch

(2) 2020 BLACKED OUT WINDOWS -_ 2 LAYERS OF FELT AT DORMER 2:12 SHINGLES AS SHINGLES AS SPECIFIED — BRACKETS AS SPECIFIED - BRACKETS AS SPECIFIED CENTER DORMER ON MIDDLE WINDOW BELOW 8:12 8:12 2nd PLT. HGT. HDR. HEIGHT 6" FASCIA— (TYP.) SHAKE AS SPECIFIED 4" FRIEZE BD.-6" HEAD -5" CORNER -4" WINDOW— 2nd FLR. LINE SHINGLES AS SPECIFIED 1st PLT. HGT. 12 96" HDR. HEIGHT 6"_HEAD — 4" TRIM -HH1st FLR. LINE Opt Side Load Garage FRONT ELEVATION 'ENGLISH COUNTRY' (SLAB) OPT. POCKET OFFICE see Page 2.7.1c SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17 SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

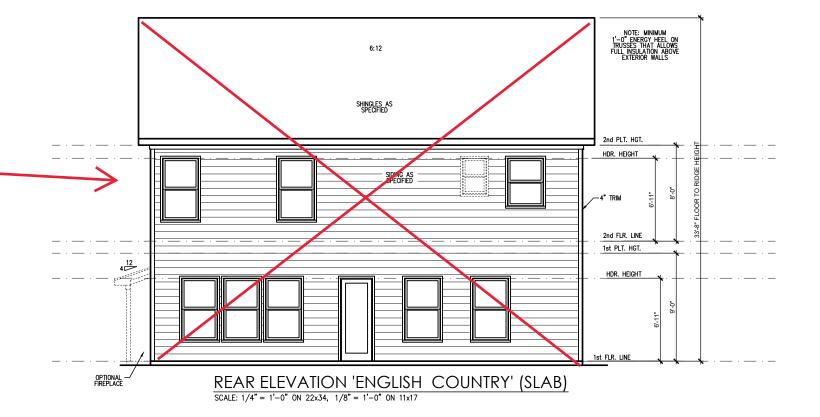





PLAN 2 - THE HOLLY ---- Elevations 'English Country' Slab

Front & Rear

RH

DRAWN BY: South Designs

7/1/2021 CURRENT REVISION DATE:

3.1c


General Elevation Notes

General Elevation Notes shall apply unless noted otherwise on plan.

- Roof shall be finished with architectural composition shingles with slopes as noted on plan.
- Ridge Vent shall be provided and installed on all ridges greater than 6' in length per manufacturer's specifications.
- 3. Soffit Vent shall be continuous soffit vent
- House Wrap, "tyvek" or approved equal shall be installed over entire exterior wall per manufacturer's specifications and recommendations.
- Flashing shall be provided above all door and window openings, above finish wall material changes and at wall surfaces where lower roof areas abut vertical wall surfaces.
- Porch Railings shall be provided at all porch walking surfaces greater than 30" above adjacent finished grade. It shall be 36" high with guards spaced no more than 4" apart. Consult community specifications for material.
- Finish Wall Material shall be as noted on elevation
- Brick Veneer, if included on elevation shall be tied to wall surface with galvanized corrugated metal ties at a rate of 24" oc horizontally and 16" oc vertically so a rate of 24" oc horizontally and 16" oc vertically so that no more than 2.67st of brick is supported by (1) the. Space between face of wall and back face of brick shall be limited to a maximum of 1". Flashing shall be provided behind brick above all wall openings and at base of brick wall. Flashing shall be a minimum of 6-mil poly or other corrosion resistant material and shall be installed so that it laps under the house wrap material a minimum of 2". Weepholes shall be provided at a rate of 48" oc and shall no be less than 3716" in diameter and shall be located immediately above flashing.
- Brick Veneer Support Lintels shall be provided if brick veneer is included on elevation. Lintels shall be provided as listed in the following schedule and shall have a minimum bearing length of 6". Masonry Lintels shall be provided so that deflection is limited to 1/600.

Masonry Opening Lintel Schedule


Opening	Size	Angle
up to 4'-0		3-1/2" x 3-1/2" x 5/16
4'-1" to	5'-6"	4" x 3-1/2" x 5/16" LL
5'-7" to	6'-6"	5" x 3-1/2" x 5/16" LL
6'-7" to	8'-4"	6" x 3-1/2" x 5/16" LL
8'-5" to	16'-4"	7" x 4" x 3/8" LLV

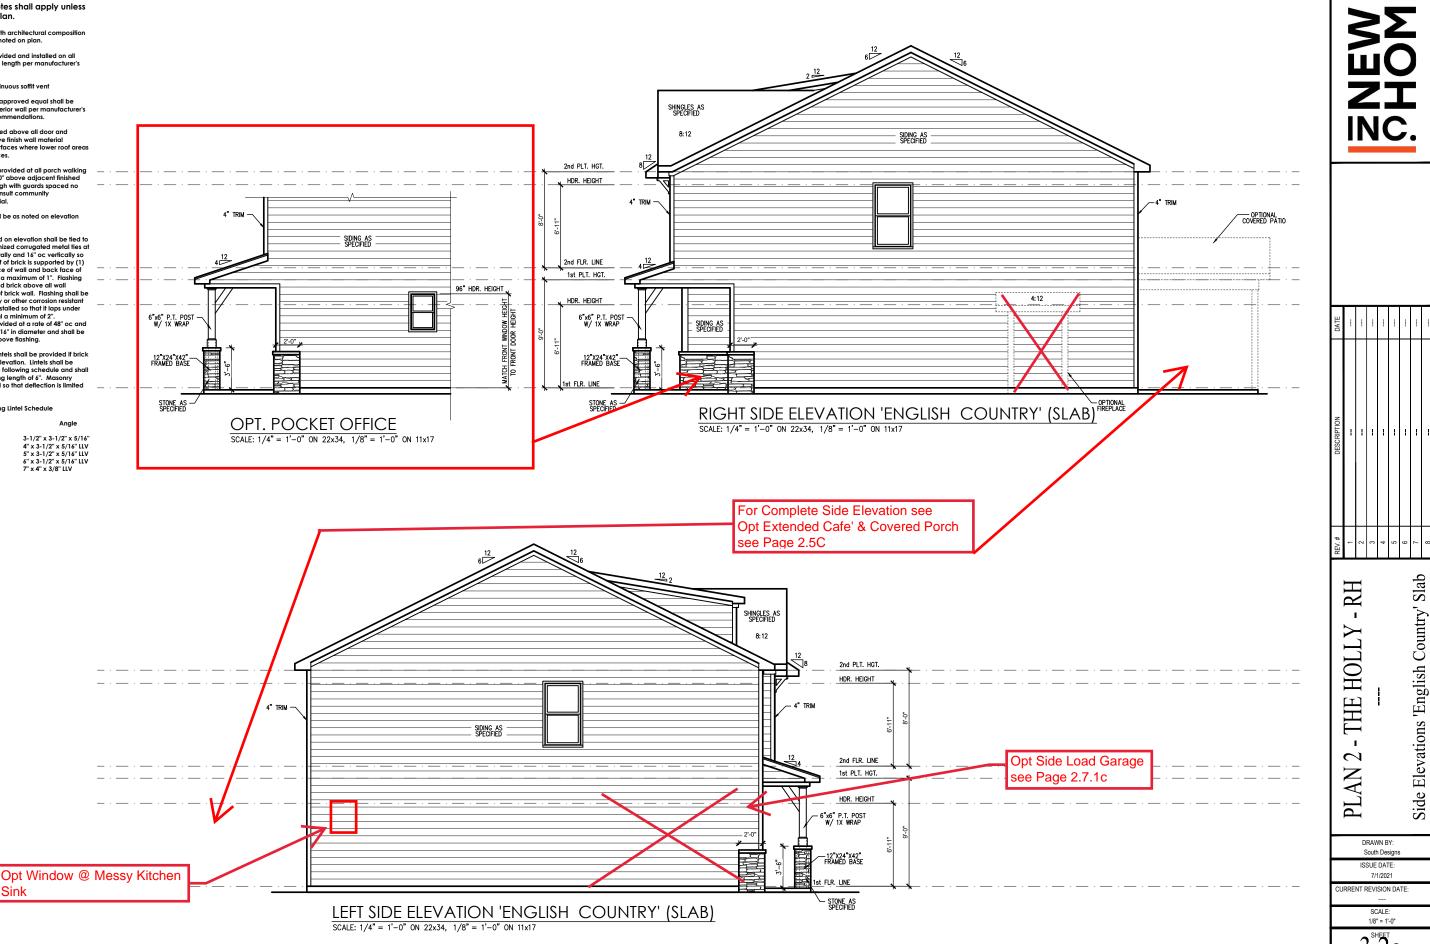





See Roof Plan Opt Extended Cafe' & Covered Rear Porch see Page 2.5c

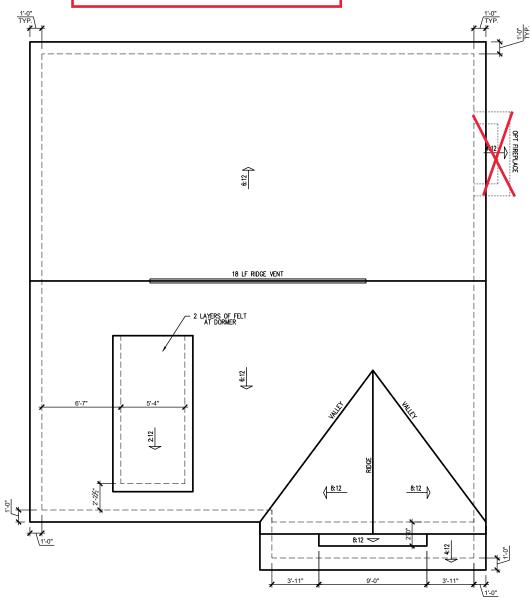

	ATTIC VENT SCHEDULE											
	ENGLISH COUNTRY											
ſ	MAIN HOUSE SQ FTG 1393 AT / NEAR RIDGE AT / NEAR EA									AR EAVE		
			. FT. JIRED	SQ. FT.	PERCENT OF TOTAL	POT LARGE (SQ. FT. EACH)	POT SMALL (SQ. FT. EACH)	RIDGE VENT (SQ. FT. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)		
L	72.11.12	RANGE SUPPLIED		SUPPLIED	SUPPLIED	0.4236	0.2778	0.125	0.1944	0.0625		
. Н	0				_		_					
L	RIDGE VENT	1.86	2.32	3.00	44.44	0	0	24.00				
	SOFFIT VENTS	2.79	2.32	3.75	55.56				0	60.00		
	TOTAL (MIN)	4.64	4.64	6.75	100.00	POT VENTS MAY B	E REQUIRED IF THER	IS INSUFFICIENT RIE	OGE AVAILABLE			

* SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-60% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION

PLAN 2 - THE HOLLY - RH ---


Roof Plan 'English Country'

DRAWN BY: South Designs ISSUE DATE:

CURRENT REVISION DATE:

SCALE: 1/8" = 1'-0" 3.3c


ENGLISH COUNTRY ROOF PLAN SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17



RISER HEIGHTS PER STAIR CONFIGURATION									
PLATE HEIGHT	10" FLOOR SYSTEM	14" FLOOR SYSTEM	16" FLOOR SYSTEM						
8'-1 1/2"	14 RISERS @ 7 11/16"	15 RISERS @ 7 1/2"	15 RISERS @ 7 5/8"						
9'-1 1/2"	16 RISERS @ 7 1/2"	16 RISERS @ 7 3/4"	17 RISERS @ 7 7/16"						
10'-1 1/2"	17 RISERS @ 7 3/4"	18 RISERS @ 7 9/16"	18 RISERS @ 7 11/16"						


TYPICAL STAIR DETAIL

SCALE: 1'' = 1'-0'' ON 22x34, 1/2'' = 1'-0'' ON 11x17

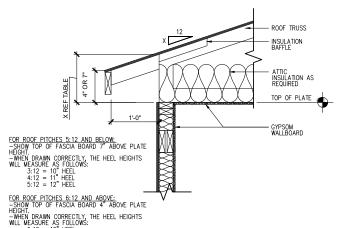

IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLLOW THE 7" ABOVE PLATE HEIGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.


ENERGY HEEL DETAIL: CZ 2 & 3 SCALE: 1'' = 1'-0'' ON 22x34, 1/2'' = 1'-0'' ON 11x17

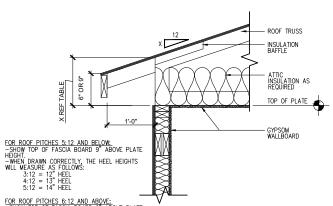


FOR ROOF PITCHES 6:12 AND ABOVE:
-SHOW TOP OF FASCIA BOARD 6" ABOVE PLATE
HEIGHT.
-WHEN DRAWN CORRECTLY, THE HEEL HEIGHTS
WILL MEASURE AS FOLLOWS:
6:12 = 12" HEEL
7:12 = 13" HEEL
8:12 = 14" HEEL
6:12 = 14" HEEL
9:12 = 15" HEEL
10:12 = 16" HEEL
6:12 ROOF IN IMPORTANT REMINDER: THE LOWEST PITCH ROOF ALWAYS MANDATES THE CONDITION. FOR EXAMPLE, A ROOF WITH A 4:12 PITCH AND A 6:12 PITCH, WOULD FOLLOW THE 9" ABOVE PLATE HEIGHT RULE. THE HEEL FOR THE 6:12 ROOF IN THIS CONDITION WILL DIFFER FROM WHAT IS LISTED HERE.


ENERGY HEEL DETAIL: CZ 4 & 5

SCALE: 1'' = 1'-0'' ON 22x34, 1/2'' = 1'-0'' ON 11x17

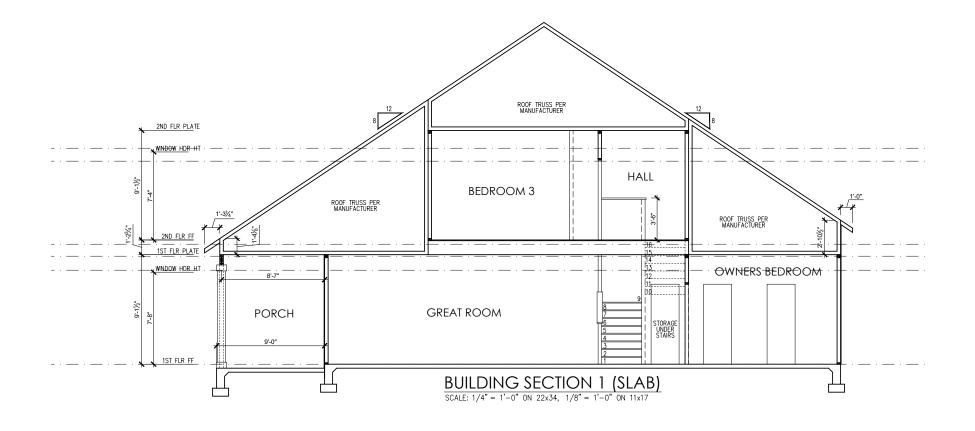

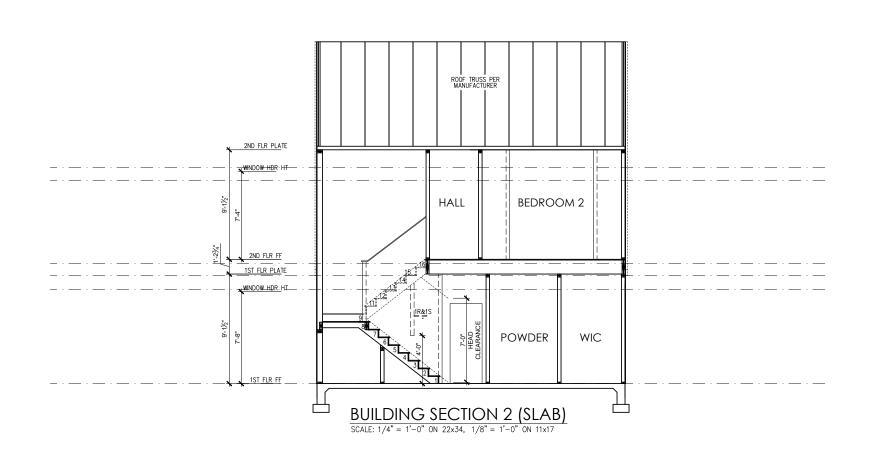





- RH Building Sections 'English Country' - THE HOLLY PLAN 2

DRAWN BY: South Designs ISSUE DATE:

7/1/2021 CURRENT REVISION DATE:

> SCALE: 1/8" = 1'-0"

PROJECT # 21-2816-LH

ions.

In sare to be brought to the reers. Failure to do so will reers. Failure to de seel.


document.
Seal does not include construction means, methods, techni
sequences, procedures or safety precautions.
Any deviations or discrepancies on plans are to be brough
immediate attention of Southern Engineers. Failure to do sy
void Southern Engineer's liability.
Seal is valid for projects permitted one wear from date of se


Southern Engineers, P.A. 3716 Benson Drive, Raleigh, NC 27609 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com


SOUTH DESIGNS

Plan 2 - The Holly - L.F.

S-1.1

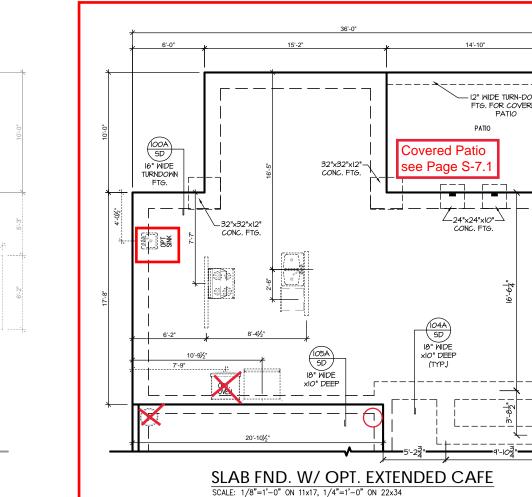

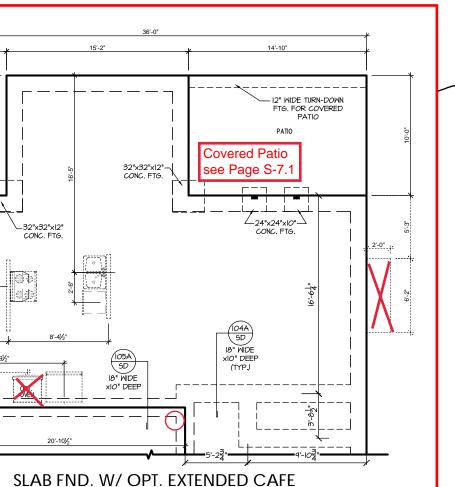

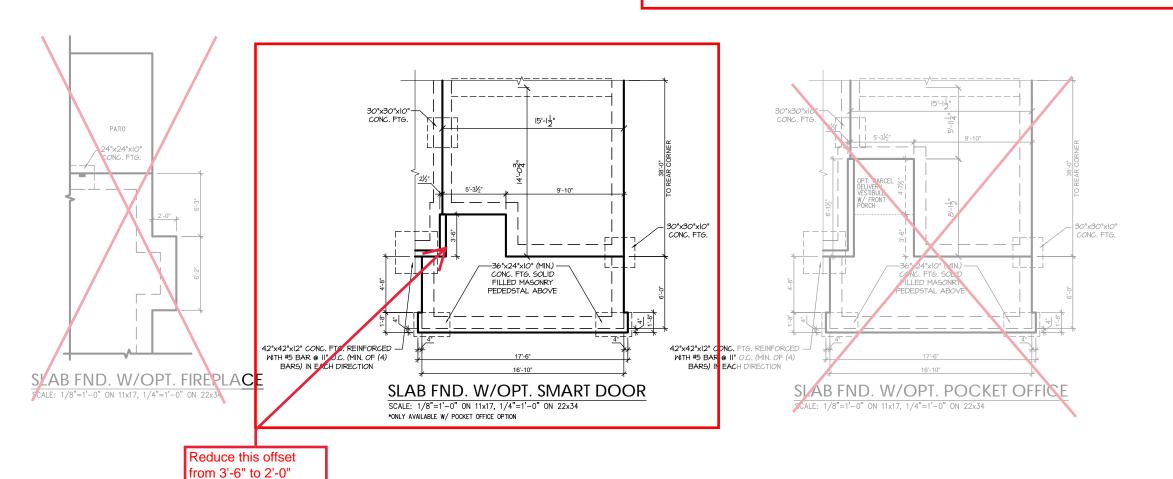

FTG. FOR COVER

∠24"x24"x10"∠ CONC. FTG.

100A SD 16" WIDE TURNDOWN FTG.

32"x32"x12"-CONC. FTG.

SLAB FND. W/ EXT. CAFE & OPT. POCKET OFFICE

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34


*ONLY AVAILABLE W/ EXTENDED CAFE OPTION

PROJECT # 21-2816-LH

P.A. 27609 Southern Engineers, P. 3716 Benson Drive, Raleigh, NC 276 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com

SOUTH DESIGNS

The Holly NEW HOME, Plan

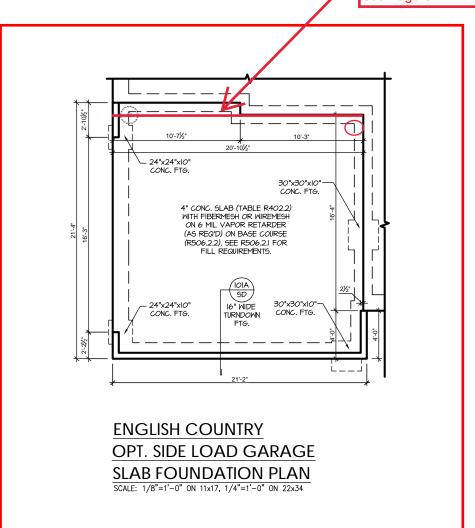

PROJECT # 21-2816-LH

Southern Engineers, P.A. 3716 Benson Drive, Raleigh, NC 27609 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com

SOUTH DESIGNS

The Holly NEW HOME, INC. Plan

TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph

- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
- ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS

HEADER/BEAM & COLUMN NOTES

- ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2x6 (4" WALL) OR (3)2x6 (6" WALL) WITH (I) SUPPORT STUD, UNLESS NOTED
- 2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602.3(5)
 OR AS BELOW PER NCDO! COMMENTARY "KING STUDS AT WALL OPENINGS" REVISED I-9-2020: UP TO 3' SPAN: (I) KING STUD
- OVER 3' UP TO 6' SPAN: (2) KING STUDS OVER 6' UP TO 9' SPAN: (3) KING STUDS
- OVER 9' UP TO 12' SPAN: (4) KING STUDS
- OVER 12' UP TO 15' SPAN: (5) KING STUDS

WOOD "I" JOISTS

(SHALL BE ONE OF THE FOLLOWING):

• TJI 210 BY TRUS JOIST

- I PI 20 PI I/S BY I P
- ALL WOOD "I"JOISTS SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
- INSTALL SQUASH BLOCKS, WEB STIFFENERS. ETC. AS REQUIRED BY AND ACCORDING TO THE 1-JOIST MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS
- HANGERS FOR I-JOISTS ARE THE RESPONSIBILITY OF THE I-JOIST SUPPLIER.
- FLOOR TRUSSES BY MANUFACTURER MAY BE

- PORCH POST NOTES:


 4X4 (6x6) TRT'D POST (OR EQUAL). ATTACH TRUSSES (RAFTERS) AT PORCH WITH HURRIGANE CONNECTORS.
- POST CAP: SIMPSON AC4-MAX (AC6-MAX)
 POST CAP AT CORNER: (2) SIMPSON LCE4
 (MITER HEADER AT CORNER). HIGH WIND; ADD (1) SIMPSON H6.
- POST BASE: SIMPSON ABU44 (ABU66).
- MONO: 5%" ANCHOR (EMBED 7")

 CMJ: 5%" ANCHOR (EXTEND TO FOOTING HIGH WIND ONLY) POST BASE: WOOD FOUNDATION: (2) SIMPSON
- CSI6 STRAPS AT POSTS. EXTEND 12" ONTO EACH POST (UPPER AND LOWER) OR TO GIRDER
- NOTE: EQUIVALENT POST CAP AND BASE ACCEPTABLE.

FRAMING NOTES

NC (2018 NCRC): Wind: 115-120 mph

- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP: C5-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY SECTION R602.10 OF THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B: 7/16", EXPOSURE C: 15/32"), SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF PER SECTION R602.IO.4.5 AND ATTACH BRACED WALLS PER CODE WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE MSP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD.
- 4. "HD" = HOLDOWN: HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS)
 SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS.
 SEE DETAILS FOR HD ASSEMBLY.
- **GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV.)
- (OR ECUIV.)
 **UIPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON C522
 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR
 HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH I/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL MITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "I<u>BM-MSP</u>" ON PLANS). ATTACH ONE SIDE WITH 1/6" MSP SHEATHING MITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES, ATTACH GB OVER WSP AS REQUIRED, ATTACH OPPOSITE SIDE WITH I/2" GB WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE

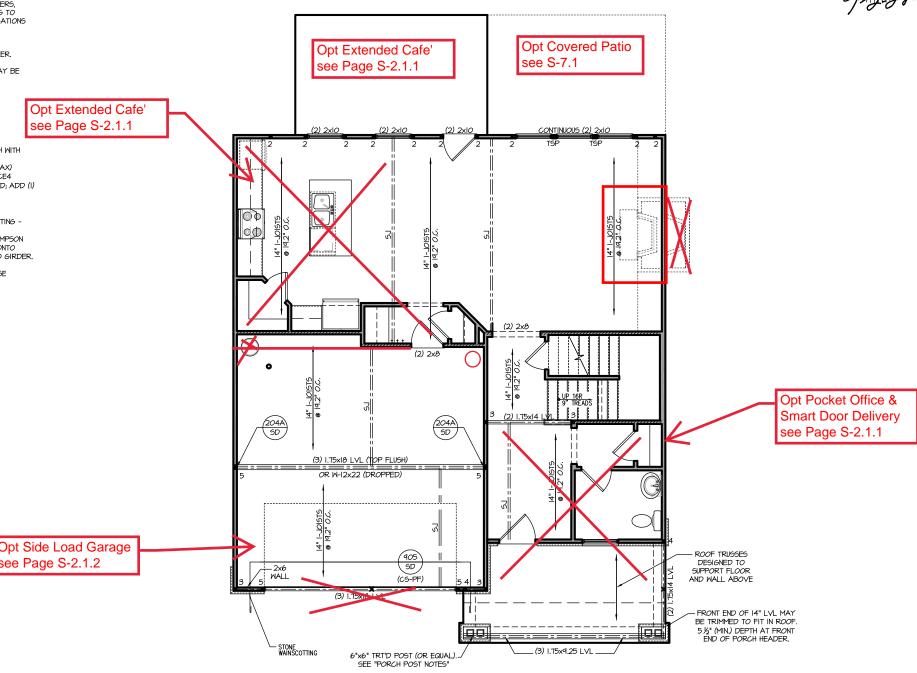

FIRST FLOOR PLAN 'ENGLISH COUNTRY' SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS BRACING DETAILS AND STRUCTURAL NOTES.

PROJECT # 21-2816-LH


CARO


to be brought to t Failure to do so wi


P.A. 27609


Engineers, Drive, Raleigh, NC Southern Engi 3716 Benson Drive, Ra Phone: (919) 8

Plan

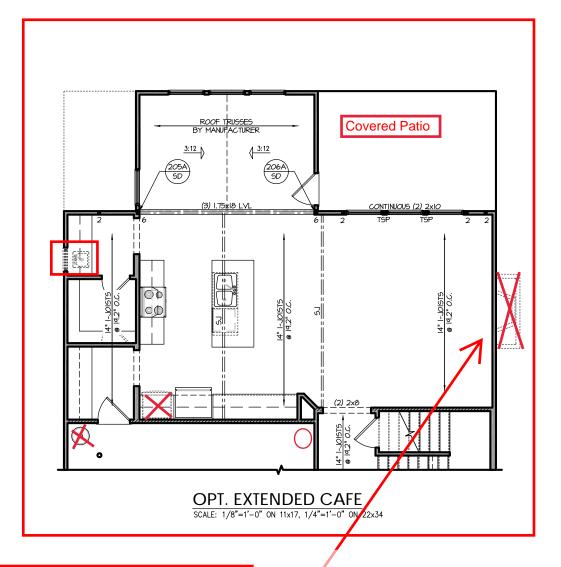

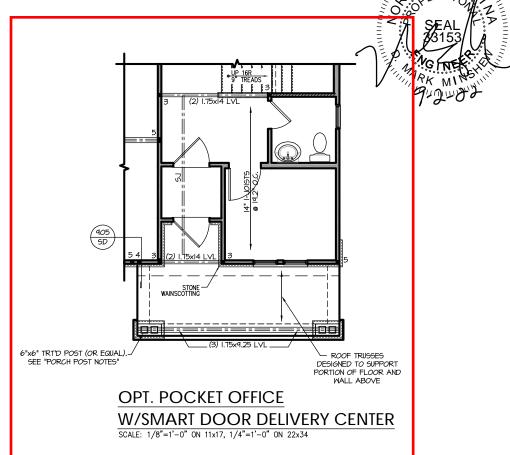

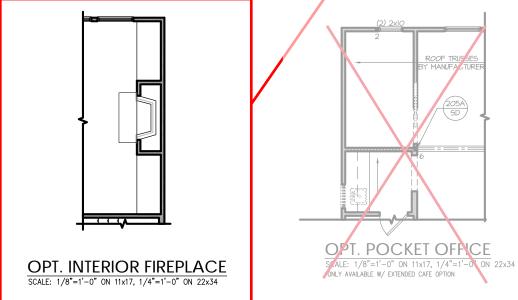

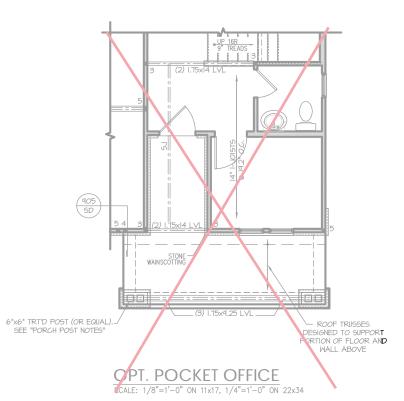

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES. PROJECT # 21-2816-LH

e to do so will are of seal.

int.


snot include construction means, methods, techniques,
es, procedures or safety precautions.
viations or discrepancies on plans are to be brought to the
ate attention of Southern Engineers. Failure to do so will

Southern Engineers, P.A. 3716 Benson Drive, Raleigh, NC 27609 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com

SOUTH DESIGNS

Plan 2 - The Holly - L.F.

S-2.1.1

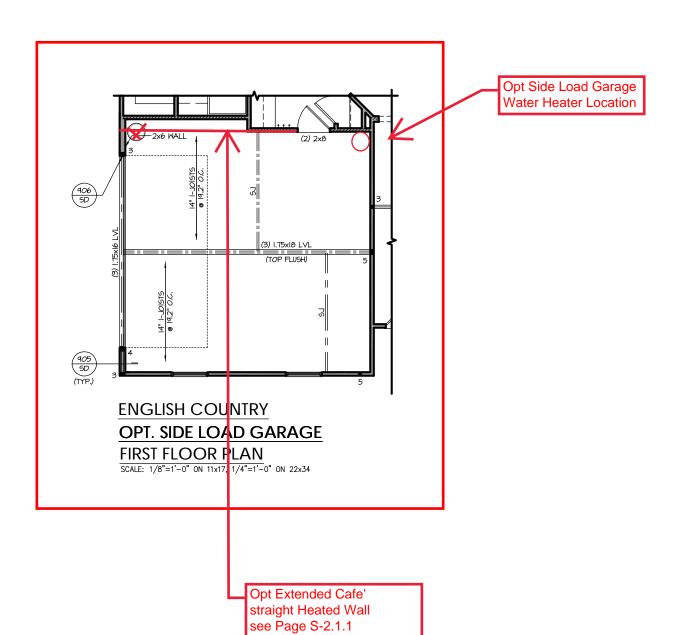

PROJECT # 21-2816-LH

Southern Engineers, P.A. 3716 Benson Drive, Raleigh, NC 27609 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com

SOUTH DESIGNS

The Holly - LH NEW HOME, INC. Plan 2

TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph

- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
- ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS

HEADER/BEAM & COLUMN NOTES

- ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2x6 (4" WALL) OR (3)2x6 (6" WALL) WITH (I) SUPPORT STUD, UNLESS NOTED
- 2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602.3(5)
 OR AS BELOW PER NCDO! COMMENTARY "KING STUDS AT WALL OPENINGS" REVISED I-9-2020: UP TO 3' SPAN: (I) KING STUD
- OVER 3' UP TO 6' SPAN: (2) KING STUDS OVER 6' UP TO 9' SPAN: (3) KING STUDS
- OVER 9' UP TO 12' SPAN: (4) KING STUDS
- OVER 12' UP TO 15' SPAN: (5) KING STUDS

FRAMING NOTES

NC (2018 NCRC): Wind: 115-120 mph


- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP: C5-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY SECTION R602.10 OF THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B. 7/16" EXPOSURE (J. 15/32") SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF PER SECTION R602.IO.4.5 AND ATTACH BRACED WALLS PER CODE, WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE WSP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD.
- 4. "HD" = HOLDOWN: HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS)
 SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS.
 SEE DETAILS FOR HD ASSEMBLY.
- **GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV.)
- (OR ECUIV.)

 "*UPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON C522

 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR

 HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH I/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "I<u>BM-MSP</u>" ON PLANS). ATTACH ONE SIDE WITH 1/6" MSP SHEATHING MITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES, ATTACH GB OVER WSP AS REQUIRED, ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE



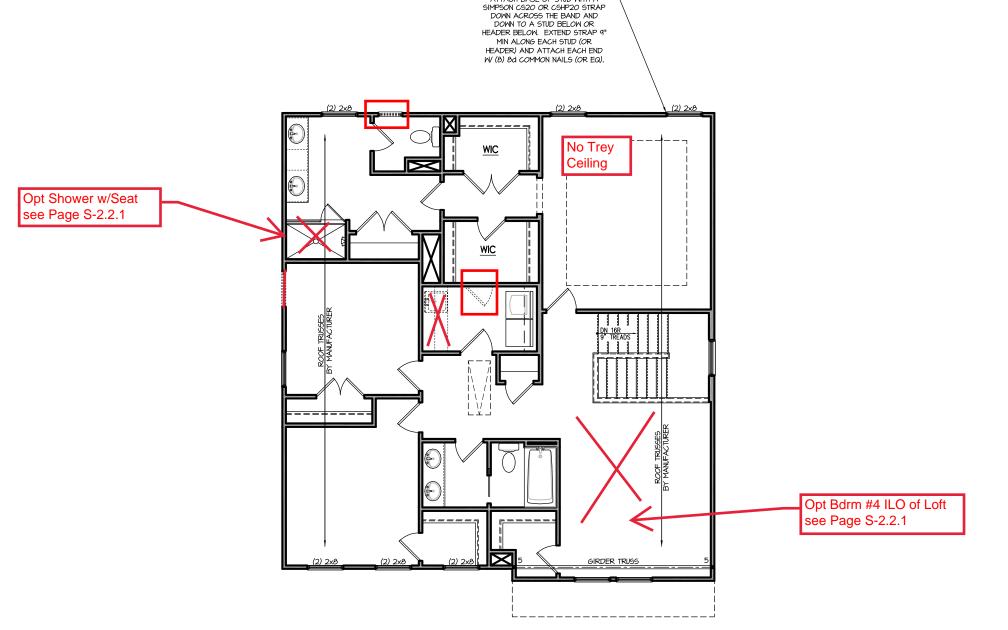

ATTACH BASE OF STUD WITH A

SECOND FLOOR PLAN 'ENGLISH COUNTRY'

SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

PROJECT # 21-2816-LH

e to be brought to t Failure to do so wi

P.A. 27609

Southern Engineers, F 3716 Benson Drive, Raleigh, NC 2' Phone: (919) 878-1617

SOUTH DESIGNS

Holly HOME, The

Plan

PROJECT # 21-2816-LH

Southern Engineers, P.A. 3716 Benson Drive, Raleigh, NC 27609 Phone: (919) 878-1617 License: C-4772 www.southernengineers.com

SOUTH DESIGNS


NEW HOME, INC.


The Holly Plan

S-2.2.

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.

NO STRUCTURAL CHANGES FROM BASE PLAN

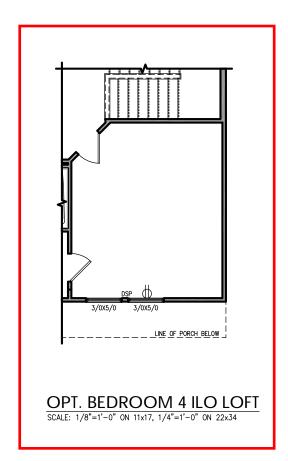







OPT. TUB/SHOWER
SCALE: 1/8"=1'-0" ON 11x17, 1/4"=1'-0" ON 22x34

TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph


- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS, ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
- ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS

	ATTIC VENT SCHEDULE											
	ENGLISH COUNTRY											
MAIN	HOUSE		SQ FTG	1393	AT	/ NEAR RID	AT / NEAR EAVE					
VENT TYPE	SQ. REOL	. FT. JIRED	SQ. FT.		POT LARGE (SQ. FT. EACH)	POT SMALL (SQ. FT. EACH)	RIDGE VENT (SQ. FT. PER LF)	EAVE VENT (SQ. IN. EACH)	CONT. VENT (SQ. IN. PER LF)			
	RAN	IGE	SUPPLIED		0.4236	0.2778	0.125	0.1944	0.0625			
RIDGE VENT	RIDGE VENT 1.86 2.32 3.00 44.44 0 0 24.00											
SOFFIT VENTS						0	60.00					
VO YEAR	2.77	2.32	3.73	33.30					55.00			
TOTAL (MIN)	4.64	4.64	6.75	100.00	POT VENTS MAY BE REQUIRED IF THERE IS INSUFFICIENT RIDGE AVAILABLE							

^{*} SCHEDULE HAS BEEN CALCULATED ASSUMING EAVE VENTILATION AT 50-60% OF TOTAL AND RIDGE AT 40-50% OF TOTAL REQUIRED VENTILATION



Opt Extended Cafe' Opt Covered Rear Patio see Page S-7.1

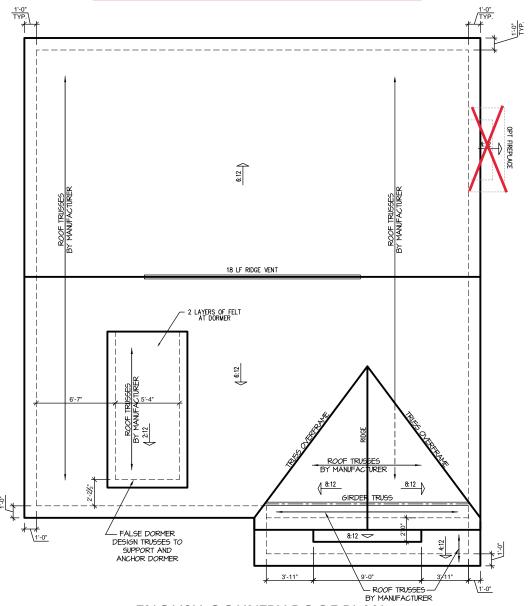

ENGLISH COUNTRY ROOF PLAN

SCALE: 1/4" = 1'-0" ON 22x34, 1/8" = 1'-0" ON 11x17

PROJECT # 21-2816-LH


P.A. 27609

Southern Engineers, P


SOUTH DESIGNS


The Holly NEW HOME,


Plan

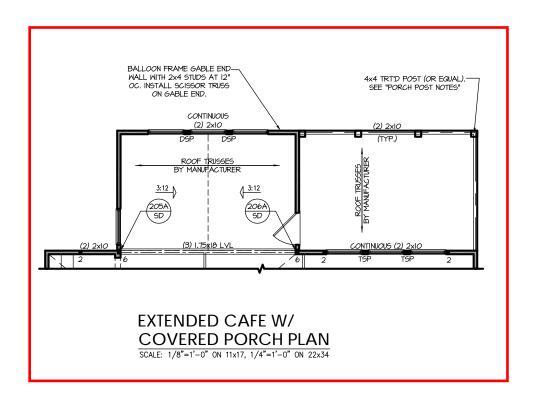




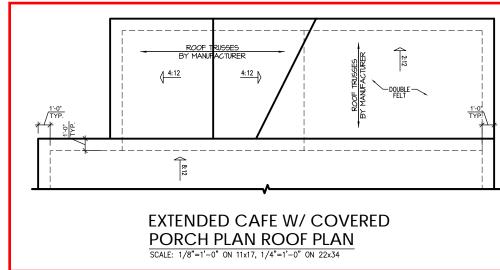

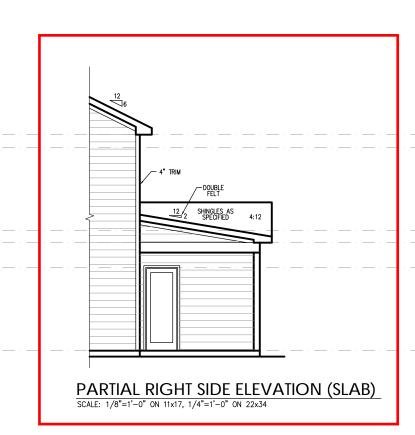

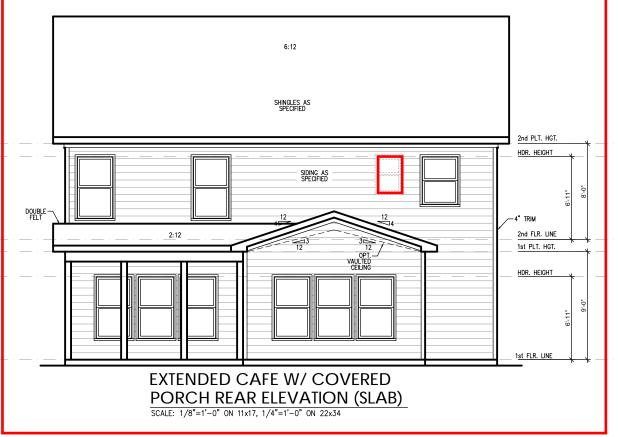

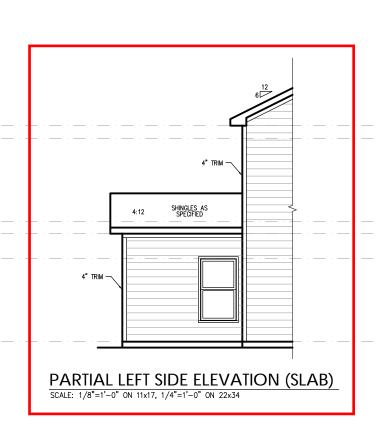

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.

PROJECT # 21-2816-LH

P.A. 27609 Southern Engineers, P 3716 Benson Drive, Raleigh, NC 2. Phone: (919) 878-1617

SOUTH DESIGNS

The Holly Plan