

Harnett County Department of Public Health

PERMIT # SFD 2312-0184

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 76 YATES MILL DR, FUGHAY

Name: (owner) NEW HOME

SUBDIVISION Wood Bridge South

LOT # 3

System Installer: Dennis Meadlin

Basement with plumbing: Garage Number of Bedrooms

Type of Water Supply: Community Public Well


System Type: 25% Reduction Type III(b) EZ FLOW

(In accordance with Table V a)

Distance from well _____ feet
Types V and VI Systems expire in 5 years.

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal and all conditions of the Improvement Permit and Construction Authorization.

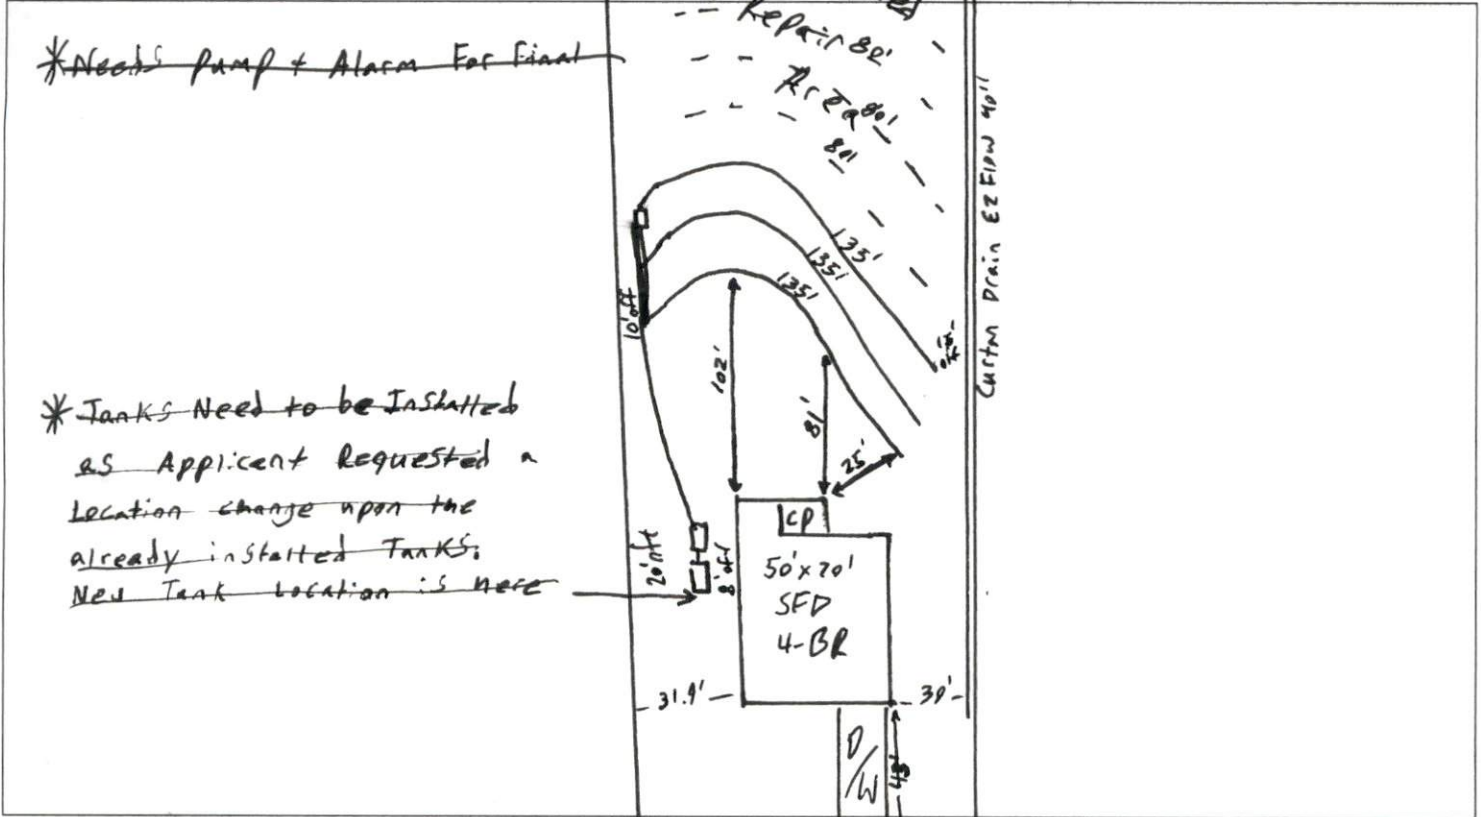

~~*Needs pump + Alarm For Final~~

~~*Tanks Need to be Installed as Applicant Requested a Location change upon the already installed Tanks. New Tank Location is here~~

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other Type III(b) EZ FLOW Septic Tank: 1,000 gallons Pump Tank: 1,000 gallons
Subsurface Drainage Field No. of ditches 3 exact length of each ditch 135' width of ditches 3 feet depth of ditches 15" inches
French Drain Required: _____ Linear feet

Authorized State Agent [Signature] Date 7-11-24