



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature *Johnnie Baggett*
Johnnie Baggett

LOAD CHART FOR JACK STUDS


(BASED ON TABLES R502.5(1) & (b))
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ. STUDS FOR (1) 1/2" HEADER	END REACTION (UP TO)	REQ. STUDS FOR (1) 1/2" HEADER	END REACTION (UP TO)	REQ. STUDS FOR (1) 1/2" HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

BUILDER	CITY / CO.	Fuquay-Varina / Wake
Job Name	ADDRESS	140 Yates Mill Drive
PLAN	MODEL	Roof
SEAL DATE	DATE REV.	4/12/24
QUOTE #	DRAWN BY	Johnnie Baggett
JOB #	SALES REP.	Paul Hawkins

BUILDER	NEW HOME INC
JOB NAME	Lot 4 Woodbridge South
PLAN	The Selma - English Country
SEAL DATE	Seal Date
QUOTE #	Quote #
JOB #	JO424-2150

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

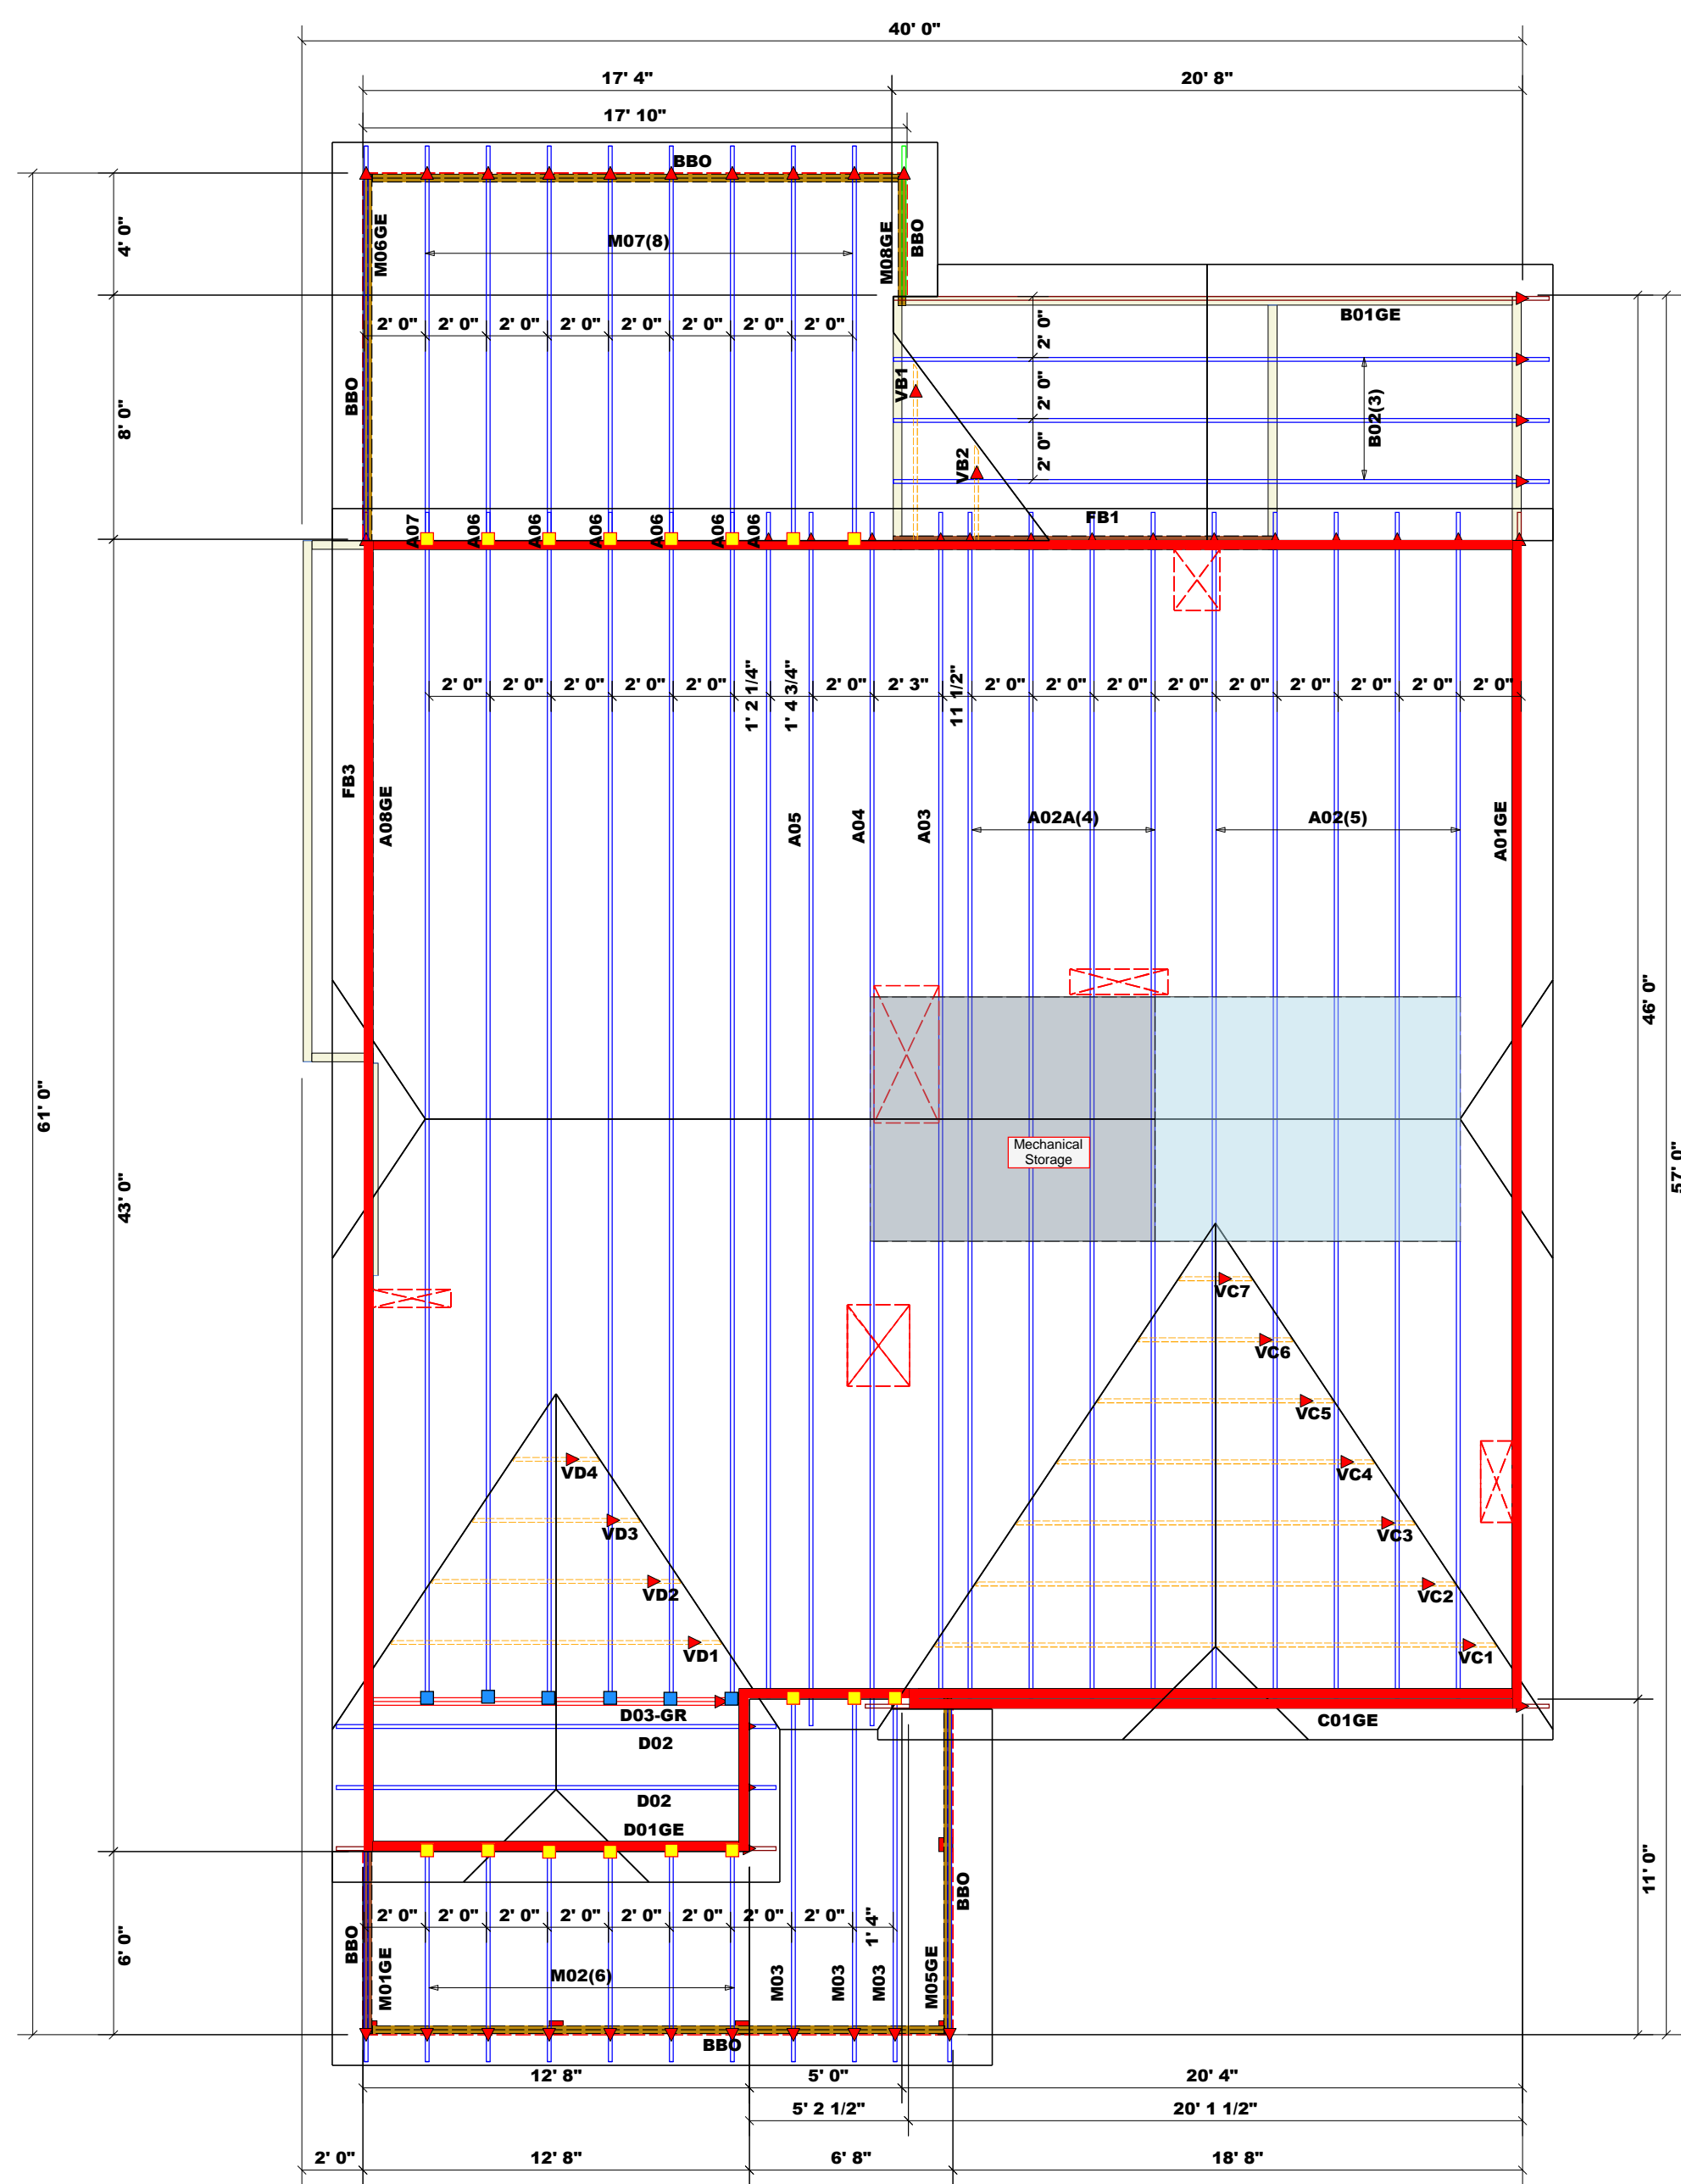

Plumbing Drop Notes
 1. Plumbing drop locations shown are NOT exact.
 2. Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
 3. Adjust spacing as needed not to exceed 19.2"oc or 16"oc.

Dimension Notes
 1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise.
 2. All interior wall dimensions are to face of stud unless noted otherwise.
 3. All exterior wall to truss dimensions are to face of stud unless noted otherwise.

= 2582.88 sq.ft. Roof Area
 = 69.8 ft. Ridge Line
 = 43.25 ft. Hip Line
 = 182.52 ft. Horiz. OH
 = 163.77 ft. Raked OH
 = 89 sheets Decking

All Walls Shown Are Considered Load Bearing

= Indicates Left End of Truss (Reference Engineered Truss Drawing)
 Do Not Erect Trusses Backwards

WALL SCHEDULE

1st Floor Walls	—
2nd Floor Walls	—
Non-Bearing Walls	---
Garage Walls Dropped	---

Products

Net Qty	Plies	Product	Length	PlotID
2	2	1-3/4"x 14" LVL Kerto-S	18' 0"	FB3
3	3	1-3/4"x 14" LVL Kerto-S	13' 0"	FB1
2	2	1-3/4"x 14" LVL Kerto-S	11' 0"	FB2

Nail Information		Connector Information				
Truss	Header	Supported Member	Qty	Manuf	Product	Sym
16d/3-1/2"	16d/3-1/2"	NA	1#	USP	HHUS52P0	■
10d/3"	10d/3"	Vbl/ies	1#	USP	MISH52Z2	■

Truss Placement Plan
 SCALE: NTS

▲ = Indicates Left End of Truss
 (Reference Engineered Truss Drawing)
 Do NOT Erect Truss Backwards