

SOIL/SITE EVALUATION for ON-SITE WASTEWATER SYSTEM
 (Complete all fields in full)

OWNER: Stanisl Builders INC DATE EVALUATED: 1-18-24
 ADDRESS: 146 Yates Mill Drive, Furlong, VA 22031
 PROPOSED FACILITY: SFD 50'x70' PROPOSED DESIGN FLOW (.0400): 480 PROPERTY SIZE: _____
 LOCATION OF SITE: _____ PROPERTY RECORDED: _____
 WATER SUPPLY: Public Single Family Well Shared Well Spring Other _____ WATER SUPPLY SETBACK: _____
 EVALUATION METHOD: Auger Boring Pit Cut TYPE OF WASTEWATER: Domestic High Strength IPWW

P R O F I L E #	.0502 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY		OTHER PROFILE FACTORS				.0509 PROFILE CLASS & LTAR*	.0503 SLOPE CORRE CTION
			.0503 STRUCTURE/ TEXTURE	.0503 CONSISTENCE/ MINERALOGY	.0504 SOIL WETNESS/ COLOR	.0505 SOIL DEPTH	.0506 SAPRO CLASS	.0507 RESTR HORIZ		
1	2-3% LS	0-14	SL, gr	Fr, NS, NP, SE	7.5YR 5/8 7/2=36"	48"		Water table at 40"	.35	
		14-36	SCL, SBK	Fr, SS, NP, SE						
		36-48	CL, ^W SBK	Fr, SS, NP, SE						
2	2-3% LS	0-12	SL, gr	Fr, NS, NP, SE	7.5YR 5/8 7/2=26"-29"	48"		Water Table at 30"	.3- 4	
		12-26	SCL, SBK	Fr, SS, NP, SE						
		26-48	CL, ^W SBK	Fr, SS, NP, SE						
3/ 4	2-3% LS	0-22	SL, gr	Fr, NS, NP, SE	7.5YR 5/8 7/2=36"	48"			.35	
		22-36	SCL, SBK	Fr, SS, NP, SE						
		36-48	CL, ^W SBK	Fr, SS, NP, SE						
5/ 6/ 7		0-30	SL, gr	Fr, NS, NP, SE	7.5YR 5/8 7/2=40"	48"			.4	
		30- 40	SCL, SBK	Fr, SS, NP, SE						
		40 40-48	CL, ^W SBK	Fr, SS, NP, SE						

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM	SITE CLASSIFICATION (.0509): <u>RS</u> EVALUATED BY: <u>RL/JM</u> OTHER(S) PRESENT: _____
Available Space (.0508)	✓	✓	
System Type(s)	23% Red	25% Red	
Site LTAR	.4	.4	
Maximum Trench Depth	18"-20"	18"-20"	

Comments: _____

LEGEND

LANDSCAPE POSITION	SOIL GROUP	SOIL TEXTURE	CONVENTIONAL LTAR (gpd/ft ²)	SAPROLITE LTAR (gpd/ft ²)	LPP LTAR (gpd/ft ²)	MINERALOGY/ CONSISTENCE		STRUCTURE	
						MOIST	WET		
CC (Concave slope)	I	S (Sand)	0.8 - 1.2	0.6 - 0.8	0.4 - 0.6	MOIST	WET	SG (Single grain)	
CV (Convex Slope)		LS (Loamy sand)		0.5 - 0.7		Lo (Loose)	NS (Non-sticky)	M (Massive)	
D (Drainage way)	II	SL (Sandy loam)	0.6 - 0.8	0.4 - 0.6	0.3 - 0.4	VFR (Very friable)	SS (Slightly sticky)	GR (Granular)	
FP (Flood plain)		L (Loam)		0.2 - 0.4		FR (Friable)	S (Sticky)	SBK (Subangular blocky)	
FS (Foot slope)	III	SiL (Silt loam)	0.3 - 0.6	0.1 - 0.3	0.15 - 0.3	FI (Firm)	VS (Very sticky)	ABK (Angular blocky)	
H (Head slope)		SCL (Sandy clay loam)		0.05 - 0.15**		VFI (Very firm)	NP (Non-plastic)	PR (Prismatic)	
L (Linear Slope)		CL (Clay loam)		None		0.15 - 0.3	EFI (Extremely firm)	SP (Slightly plastic)	PL (Platy)
N (Nose slope)		SiCL (Silty clay loam)					P (Plastic)		
R (Ridge/summit)		Si (Silt)						VP (Very plastic)	
S (Shoulder slope)	IV	SC (Sandy clay)	0.1 - 0.4	0.05 - 0.2	SEXP (Slightly expansive)				
T (Terrace)		SiC (Silty clay)			EXP (Expansive)				
TS (Toe Slope)		C (Clay)							
		O (Organic)	None						

* Adjust LTAR due to depth, consistence, structure, soil wetness, landscape, position, wastewater flow and quality.

**Sandy clay loam saprolite can only be used with advanced pretreatment in accordance with 15A NCAC 18E .1200.

HORIZON DEPTH In inches below natural soil surface

DEPTH OF FILL In inches from land surface


RESTRICTIVE HORIZON Thickness and depth from land surface

SAPROLITE S(suitable) or U(unsuitable); Evaluation of saprolite shall be by pits.

SOIL WETNESS Inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less - record Munsell color chip designation

CLASSIFICATION S (Suitable) or U (Unsuitable)

Show profile locations and other site features (dimensions, reference or benchmark, and North).

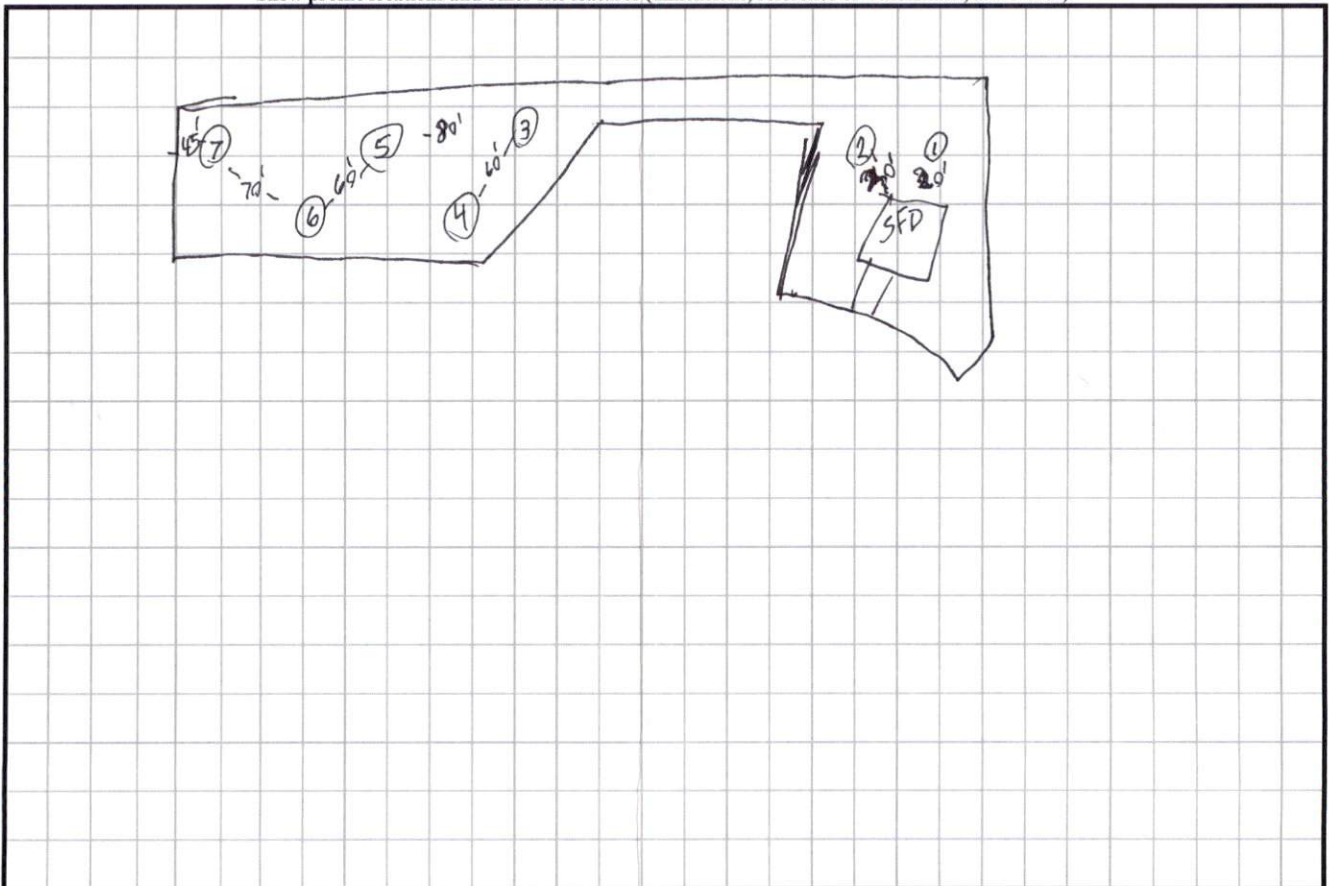



NEW HOME INC., LLC
 146 YATES MILL DRIVE
 LOT 5, WOODBRIDGE SOUTH
 BUCKHORN TOWNSHIP, HARNETT COUNTY, NORTH CAROLINA

LINE	BEARING	DISTANCE
L1	N47°31'35"E	26.25'


NUM	RADIUS	ARC	DELTA	CHORD BRG	CHORD
C1	255.00'	56.22'	12°37'54"	S58°04'51"E	56.10'

N\F
 RANDY M. & JOSHUA C. JONES
 D.B. 3515, PG. 836
 P.B. 2018, PG. 272

N\F
 JEFFREY MOORE
 D.B. 2139, PG. 569

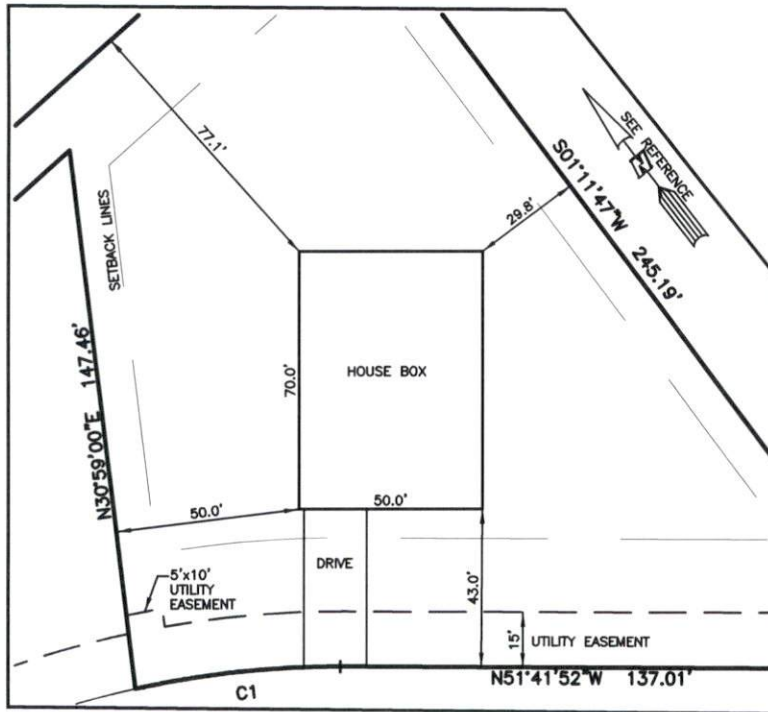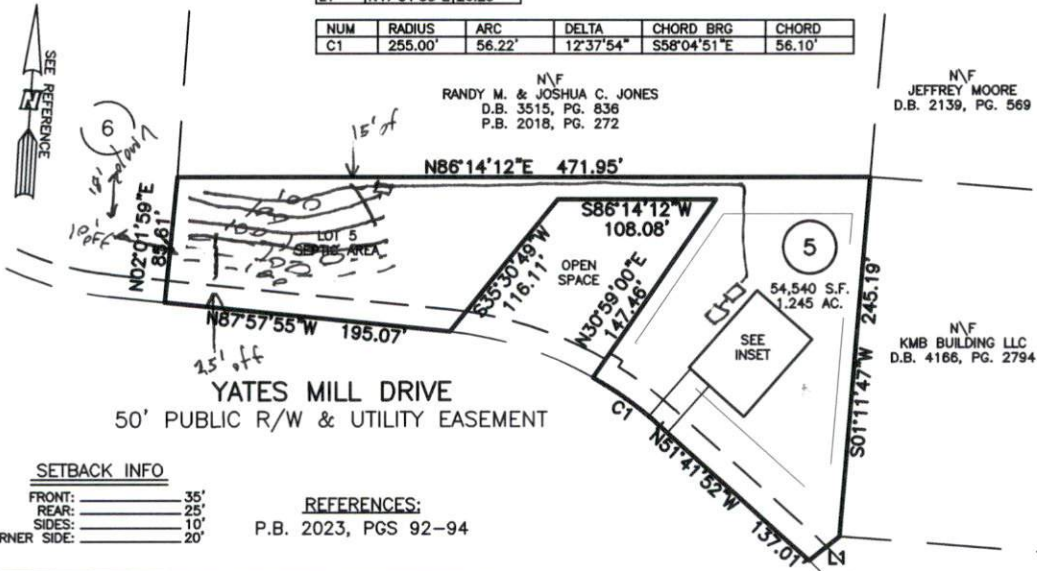

- LEGEND**
- ⊠ AIR CONDITIONER
 - ⊞ BACK OF CURB
 - ⊞ BACK FLOW PREVENTER
 - CLEANOUT
 - ⊞ CURB INLET
 - DHS DRILL HOLE SET
 - EDM EXISTING CONCRETE MONUMENT
 - EDH EXISTING DRILL HOLE
 - EIS EXISTING IRON STAKE
 - EIP EXISTING IRON PIPE
 - EM ELECTRIC METER
 - EPK EXISTING PK NAIL
 - ES ELECTRIC STUB
 - ⊞ FLARED END SECTION
 - ⊞ FIRE HYDRANT
 - ⊞ FIBER OPTIC PEDESTAL
 - ⊞ GAS METER
 - GUY
 - INV INVERT
 - IPS IRON PIPE SET
 - IRS IRON ROD SET
 - ⊞ LIGHT POLE
 - MNS MAGNETIC NAIL SET
 - ⊞ MANHOLE SANITARY SEWER
 - ⊞ MANHOLE STORM SEWER
 - OHW OVERHEAD WIRES
 - PKS PK NAIL SET
 - ⊞ POINT NOT SET
 - RRS RAIL ROAD SPIKE
 - ⊞ TELEPHONE PEDESTAL
 - ⊞ TRANSFORMER
 - ⊞ CABLE TV PEDESTAL
 - ⊞ UTILITY POLE
 - ⊞ WATER METER
 - ⊞ WATER VALVE
 - ⊞ YARD INLET
 - () FIELD MEASUREMENT



FOR REPRESENTATIVE PURPOSES ONLY
 NOT FOR PERMITTING, RECORDATION,
 CONVEYANCE OR SALES

- NOTES**
- THIS SURVEY SUBJECT TO ANY FACTS THAT MAY BE DISCLOSED BY A FULL AND ACCURATE TITLE SEARCH.
 - THIS MAP MAY NOT BE A CERTIFIED SURVEY AND HAS NOT BEEN REVIEWED BY A LOCAL GOVERNMENT AGENCY FOR COMPLIANCE WITH ANY APPLICABLE LAND DEVELOPMENT REGULATIONS AND HAS NOT BEEN REVIEWED FOR COMPLIANCE WITH RECORDING REQUIREMENTS FOR PLATS.

HOUSE FIT
 ONLY

DATE: DEC. 06, 2023

F.B. _____

RWK, PA
 ENGINEERING - SURVEYING
 CORPORATE LICENSE: C-1771
 101 W. MAIN ST., SUITE 202
 GARNER, NC 27529
 PHONE (919) 779-4854
 FAX (919) 779-4056