

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0224-0868
Lot 29 Woodbridge South

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I63692466 thru I63692499

My license renewal date for the state of North Carolina is December 31, 2024.

North Carolina COA: C-0844



February 19, 2024

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0224-0868	Truss A01GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692466
-------------------	----------------	------------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:15 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

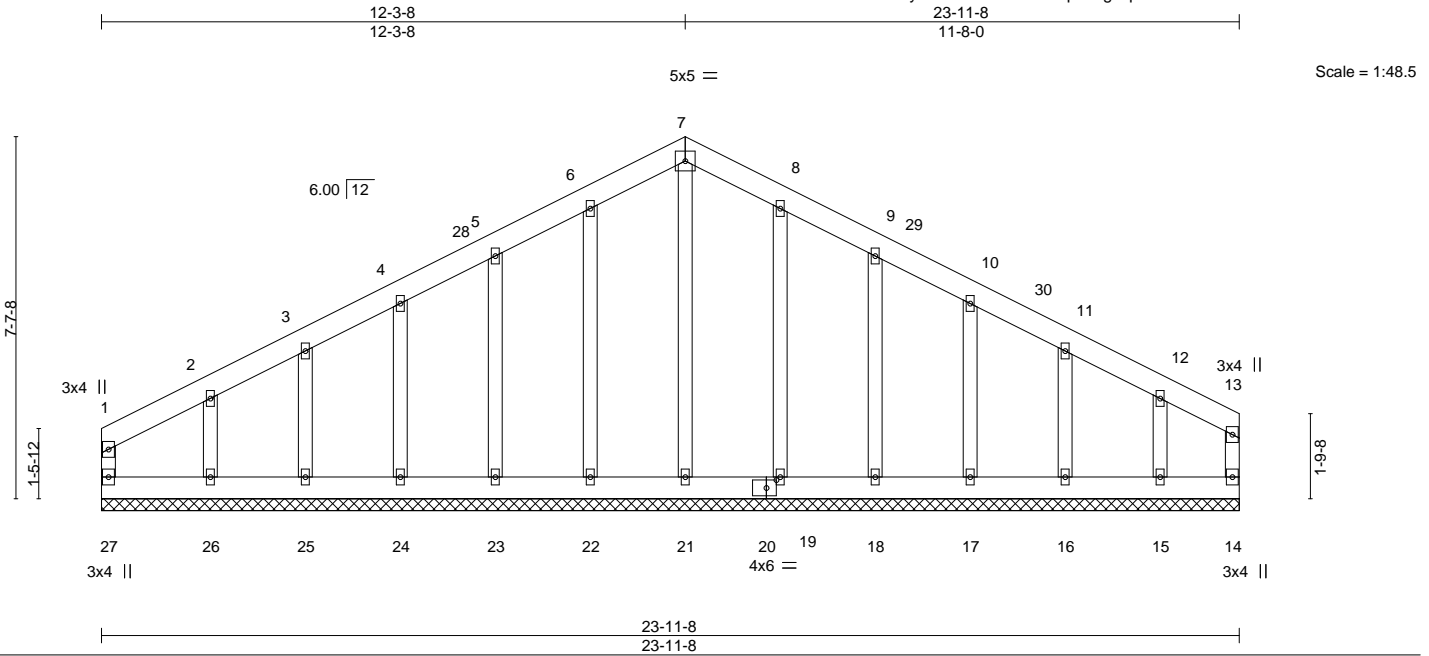



Plate Offsets (X,Y)--	[20:0-2-8,0-2-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	14	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R							
									Weight: 187 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 23-11-8.
 (lb) - Max Horz 27=131(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 27, 14, 22, 23, 24, 25, 19, 18, 17, 16 except 26=156(LC 12), 15=129(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 27, 14, 21, 22, 23, 24, 25, 26, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 5-6=-95/312, 6-7=-112/354, 7-8=-112/355, 8-9=-95/313, 9-10=-73/251

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-3-8, Exterior(2) 4-3-8 to 12-3-8, Corner(3) 12-3-8 to 16-8-5, Exterior(2) 16-8-5 to 23-9-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 27, 14, 22, 23, 24, 25, 19, 18, 17, 16 except (jt=lb) 26=156, 15=129.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss A02	Truss Type Common	Qty 7	Ply 1	Lot 29 Woodbridge South 163692467
-------------------	--------------	----------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:16 2024 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:47.5

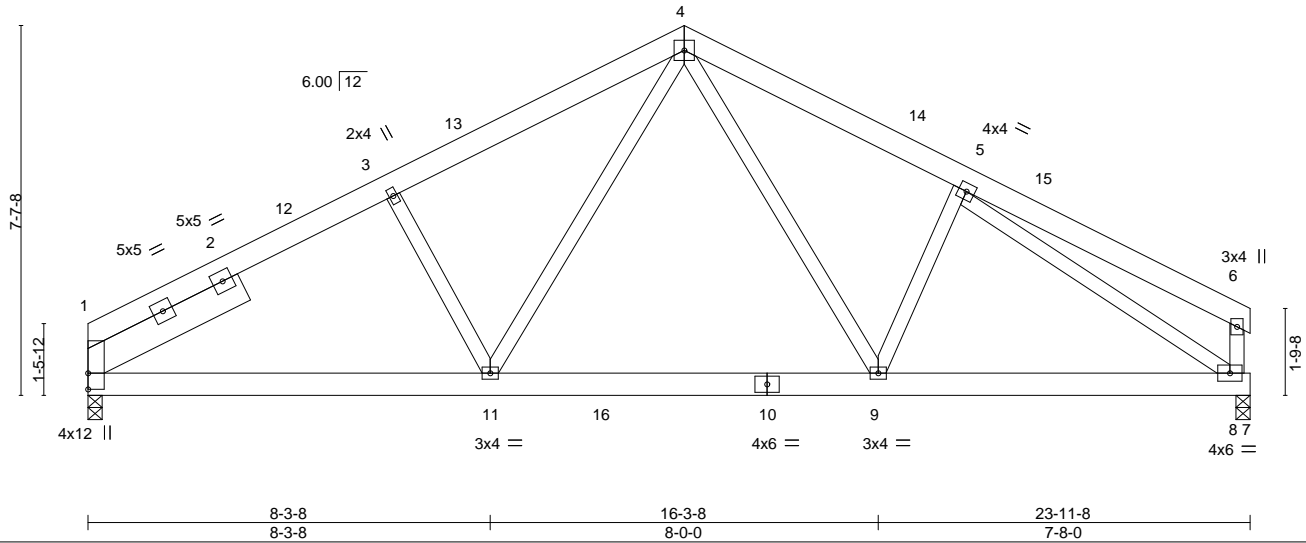


Plate Offsets (X, Y)-- [1:Edge,0-0-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.07 9-11	>999	360
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.11 9-11	>999	240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.92	Horz(CT)	0.02 8	n/a	n/a
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.02 9-11	>999	240
							PLATES
							MT20
							GRIP
							244/190
							Weight: 178 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
SLIDER Left 2x8 SP No.1 3-8-1	

REACTIONS.	(size) 1=0-3-8, 8=0-3-8
	Max Horz 1=115(LC 12)
	Max Uplift 1=-55(LC 12), 8=-49(LC 13)
	Max Grav 1=947(LC 1), 8=953(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-3=-1372/355, 3-4=-1170/385, 4-5=-1136/384
BOT CHORD	1-11=-235/1081, 9-11=-99/799, 8-9=-208/987
WEBS	4-11=-89/444, 4-9=-79/382, 5-8=-1112/248

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-0 to 4-4-13, Interior(1) 4-4-13 to 12-3-8, Exterior(2) 12-3-8 to 16-8-5, Interior(1) 16-8-5 to 23-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss A03	Truss Type Common	Qty 12	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692468
-------------------	--------------	----------------------	-----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:17 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

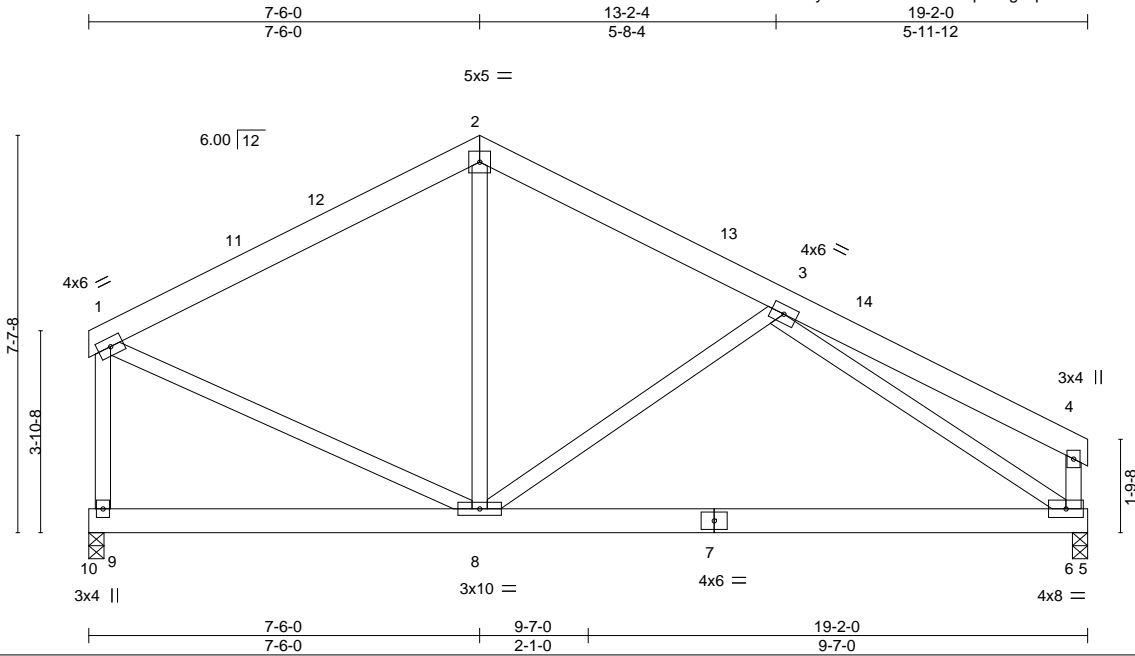

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.10 6-8	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.35	Vert(CT)	-0.19 6-8	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.58	Horz(CT)	0.01 6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.01 8	>999	240		
								Weight: 143 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 9=0-3-8, 6=0-3-8
 Max Horz 9=-111(LC 13)
 Max Uplift 9=-28(LC 13), 6=-38(LC 13)
 Max Grav 9=750(LC 1), 6=750(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-661/209, 2-3=-649/221, 1-9=-695/245
 BOT CHORD 6-8=-168/689
 WEBS 2-8=0/274, 3-8=-258/201, 3-6=-682/248, 1-8=-75/536

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-3-4 to 4-8-1, Interior(1) 4-8-1 to 7-6-0, Exterior(2) 7-6-0 to 11-10-13, Interior(1) 11-10-13 to 18-10-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 6.

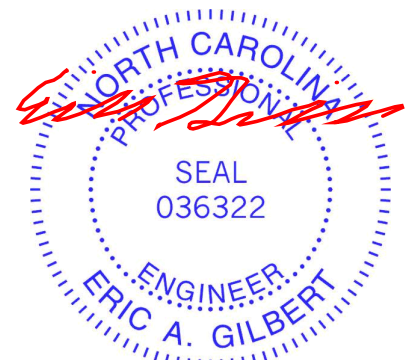

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss A04GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692469
-------------------	----------------	------------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:19 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

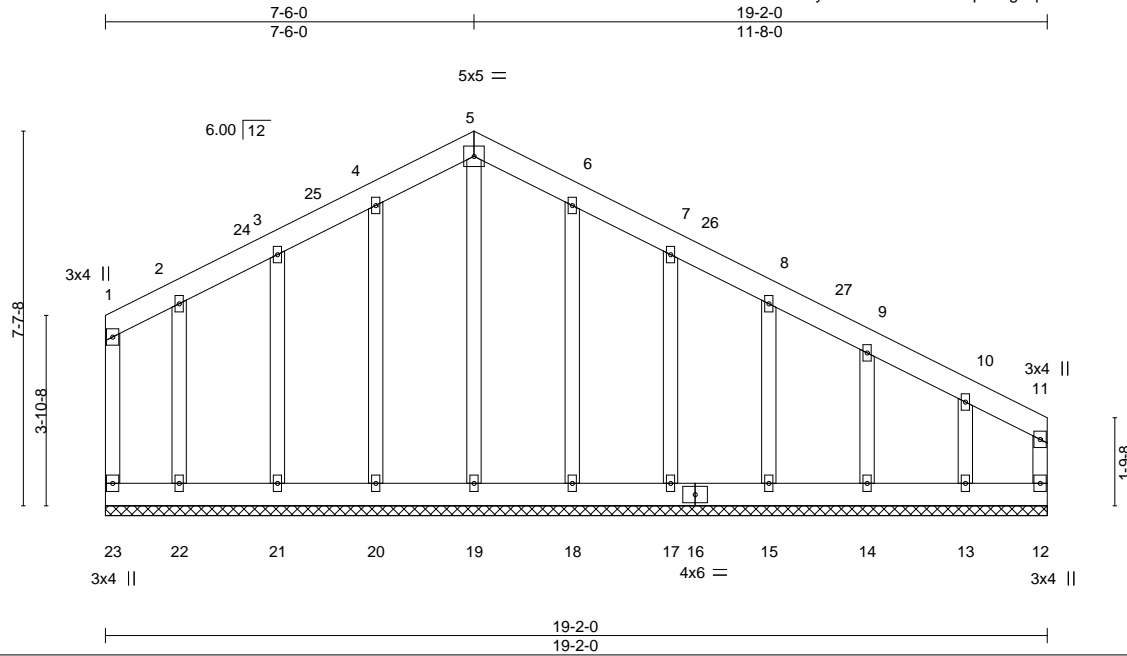

Scale = 1:46.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 161 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 19-2-0.
(lb) - Max Horz 23=172(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 23, 12, 20, 21, 22, 18, 17, 15, 14 except 13=260(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 23, 12, 19, 20, 21, 22, 18, 17, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 4-5=-75/264, 5-6=-75/263

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-6-9, Exterior(2) 4-6-9 to 7-6-0, Corner(3) 7-6-0 to 11-10-13, Exterior(2) 11-10-13 to 19-0-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 7) Gable studs spaced at 2-0-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 23, 12, 20, 21, 22, 18, 17, 15, 14 except (jt=lb) 13=260.

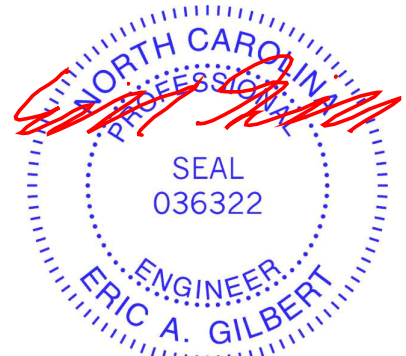

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss B01GE	Truss Type GABLE	Qty 1	Ply 1	Lot 29 Woodbridge South 163692470
-------------------	----------------	---------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:20 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f



Scale = 1:61.4

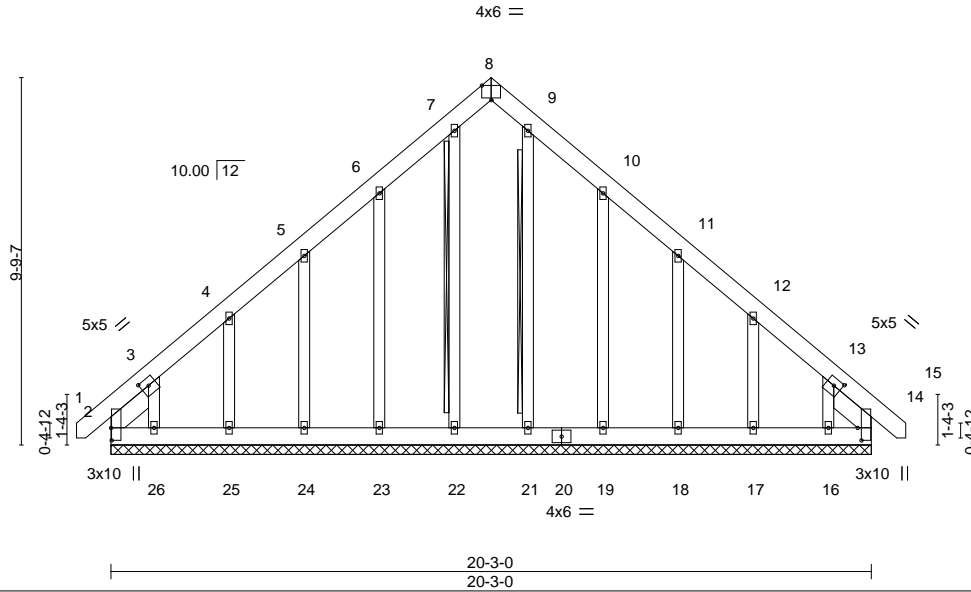


Plate Offsets (X, Y)--	[2:0-4-0,0-0-3], [3:0-2-8,0-2-4], [8:0-3-0,Edge], [13:0-2-8,0-2-4], [14:0-4-0,0-1-3]
------------------------	--


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	14	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	14	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.00	14	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 193 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	WEBS T-Brace: 2x4 SPF No.2 - 7-22, 9-21
SLIDER Left 2x6 SP No.1 1-5-14, Right 2x6 SP No.1 1-5-14	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 20-3-0.
 (lb) - Max Horz 2=276(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 22 except 2=170(LC 10), 23=126(LC 12), 24=112(LC 12), 25=120(LC 12), 26=277(LC 12), 19=129(LC 13), 18=113(LC 13), 14=104(LC 11), 17=119(LC 13), 16=257(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 22, 23, 24, 25, 26, 21, 19, 18, 17, 16 except 2=362(LC 12), 14=318(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=459/269, 13-14=407/266
 BOT CHORD 2-26=178/265, 25-26=178/265, 24-25=178/265, 23-24=178/265, 22-23=178/265, 21-22=178/265, 19-21=178/265, 18-19=178/265, 17-18=178/265, 16-17=178/265, 14-16=178/265
 WEBS 3-26=231/266

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-9-9 to 3-7-4, Exterior(2) 3-7-4 to 10-1-8, Corner(3) 10-1-8 to 14-6-5, Exterior(2) 14-6-5 to 21-0-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22 except (jt=lb) 2=170, 23=126, 24=112, 25=120, 26=277, 19=129, 18=113, 14=104, 17=119, 16=257.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss B02	Truss Type COMMON	Qty 2	Ply 1	Lot 29 Woodbridge South 163692471
-------------------	--------------	----------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:21 2024 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



6x6 =

Scale = 1:57.4

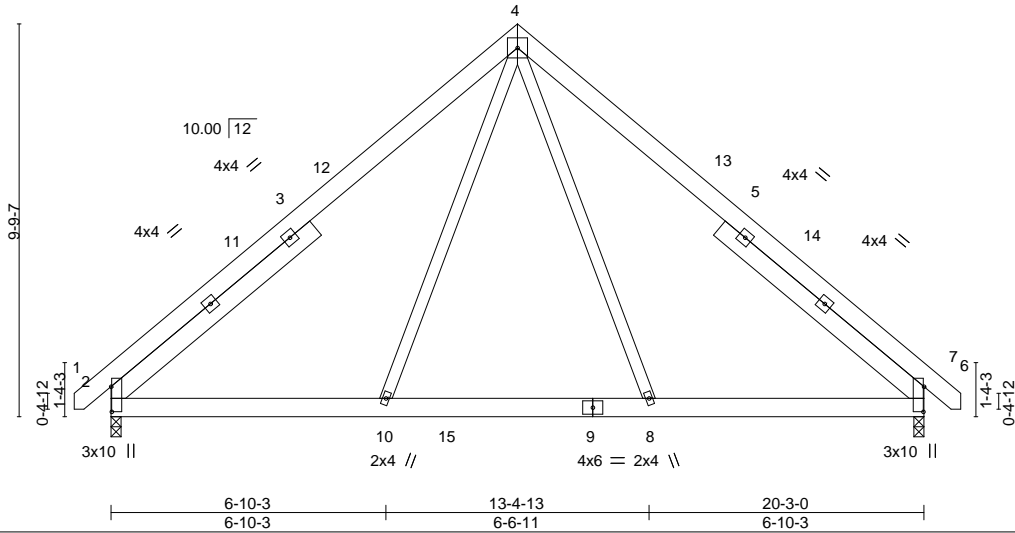


Plate Offsets (X, Y)--	[2:0-7-8,0-0-3], [6:0-7-8,0-0-3]
------------------------	----------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.44	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.22	Vert(LL) -0.04 8-10 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.61	Vert(CT) -0.05 8-10 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.04 8-10 >999 240	Weight: 175 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
SLIDER Left 2x6 SP No.1 6-7-9, Right 2x6 SP No.1 6-7-9	


REACTIONS.
(size) 2=0-3-0, 6=0-3-0
Max Horz 2=-222(LC 8)
Max Uplift 2=-106(LC 9), 6=-106(LC 8)
Max Grav 2=858(LC 1), 6=858(LC 1)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-948/796, 4-6=-949/796
BOT CHORD 2-10=-377/592, 8-10=-250/495, 6-8=-375/580
WEBS 4-8=-374/308, 4-10=-374/308

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-9 to 3-7-4, Interior(1) 3-7-4 to 10-1-8, Exterior(2) 10-1-8 to 14-6-5, Interior(1) 14-6-5 to 21-0-9 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=106, 6=106.



February 19, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	 <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss C01GE	Truss Type GABLE	Qty 2	Ply 1	Lot 29 Woodbridge South 163692472
-------------------	----------------	---------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:22 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



Scale = 1:11.1

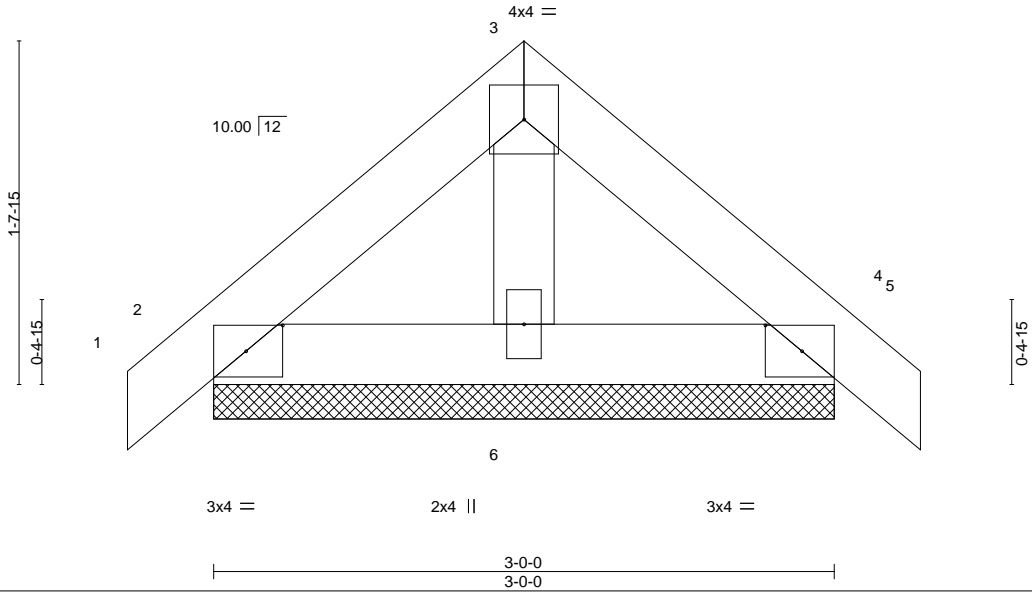


Plate Offsets (X,Y)--	[2:0-2-2,0-1-8], [4:0-2-2,0-1-8]
-----------------------	----------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) 0.00 4 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Vert(CT) 0.00 4 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 4 n/a n/a		
	Code IRC2015/TPI2014			Weight: 14 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	

REACTIONS. (size) 2=3-0-0, 4=3-0-0, 6=3-0-0
 Max Horz 2=-48(LC 10)
 Max Uplift 2=-36(LC 12), 4=-41(LC 13)
 Max Grav 2=97(LC 1), 4=97(LC 1), 6=96(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



February 19, 2024

Job J0224-0868	Truss C02	Truss Type Common	Qty 8	Ply 1	Lot 29 Woodbridge South 163692473
-------------------	--------------	----------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:23 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f



Scale = 1:11.1

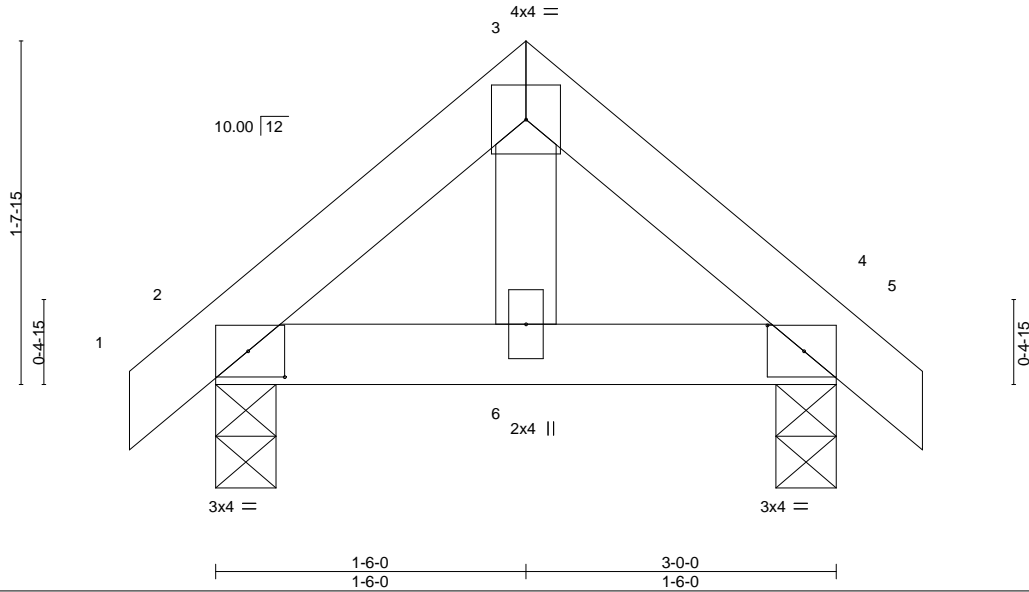


Plate Offsets (X, Y)--	[2:0-2-2,0-1-8], [4:0-2-2,0-1-8]
------------------------	----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) -0.00 6 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Vert(CT) -0.00 6 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 4 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) -0.00 2 >999 240	Weight: 14 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 2=0-3-8, 4=0-3-8
 Max Horz 2=38(LC 11)
 Max Uplift 2=-12(LC 12), 4=-12(LC 13)
 Max Grav 2=142(LC 1), 4=142(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job J0224-0868	Truss M01GE	Truss Type MONOPITCH SUPPORTED	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692474
-------------------	----------------	-----------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:25 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

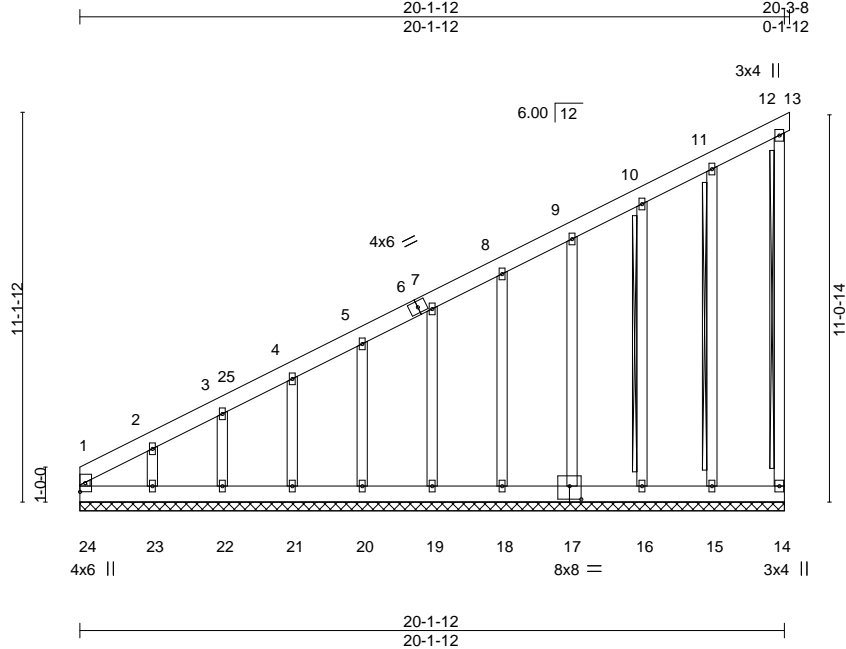

Scale = 1:65.9

Plate Offsets (X, Y)--	[17:0-4-0-0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.28	Vert(LL) 0.00 12 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.09	Vert(CT) 0.00 12 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) -0.00 17 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R		Weight: 185 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 16-17,15-16,14-15.
 WEBS T-Brace: 2x4 SPF No.2 - 12-14, 10-16, 11-15
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS. All bearings 20-1-12.
 (lb) - Max Horz 24=471(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 14, 19, 20, 21, 22, 18, 17, 16, 15 except 23=293(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 14, 19, 20, 21, 22, 23, 18, 17, 16, 15 except 24=387(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-24=-353/89, 1-2=-680/219, 2-3=-564/178, 3-4=-517/162, 4-5=-457/141, 5-7=-400/121, 7-8=-342/101, 8-9=-284/81
 WEBS 2-23=-130/321

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 4-6-9, Exterior(2) 4-6-9 to 20-3-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 19, 20, 21, 22, 18, 17, 16, 15 except (jt=lb) 23=293.
 - 10) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

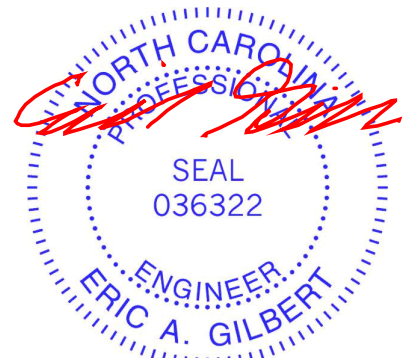

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss M02	Truss Type Monopitch	Qty 6	Ply 1	Lot 29 Woodbridge South 163692475
-------------------	--------------	-------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:26 2024 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

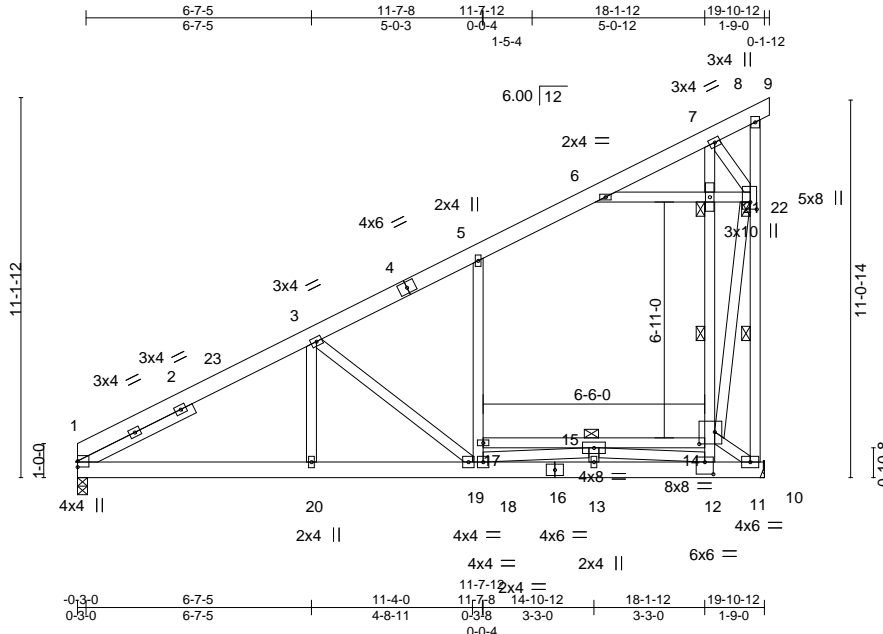

Scale = 1:67.6

Plate Offsets (X,Y)--	[12:0-3-0,0-4-4], [14:0-5-8,0-4-4], [22:0-2-8,0-2-4]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.56	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.51	Vert(LL) -0.16 19-20 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.60	Vert(CT) -0.35 19-20 >683 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.16 19-20 >999 240		
				Weight: 199 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 14-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12. 6-0-0 oc bracing: 14-17
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 11-22, 12-21
SLIDER Left 2x4 SP No.2 3-9-13	JOINTS 1 Brace at Jt(s): 21, 22

REACTIONS. (size) 11=Mechanical, 1=0-3-8
 Max Horz 1=346(LC 12)
 Max Uplift 11=120(LC 12)
 Max Grav 11=929(LC 1), 1=829(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-1295/4, 3-5=-709/0, 5-6=-477/0, 6-7=-289/638, 11-22=-1686/370
 BOT CHORD 1-20=-326/1064, 19-20=-326/1064, 18-19=-121/517, 13-18=0/284, 12-13=0/284,
 11-12=-1023/239, 14-15=-377/1723
 WEBS 3-19=-714/268, 17-18=0/257, 5-17=0/316, 12-14=-22/785, 14-21=-1134/441,
 6-21=-1068/292, 21-22=-1081/298, 7-22=-278/907, 7-21=-1081/424, 11-14=-275/1175,
 14-22=-585/2444, 15-18=-311/632, 12-15=-1422/126, 3-20=0/371

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-0-11 to 4-4-2, Interior(1) 4-4-2 to 20-3-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=120.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss M02A	Truss Type Monopitch	Qty 3	Ply 1	Lot 29 Woodbridge South 163692476
-------------------	---------------	-------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:27 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

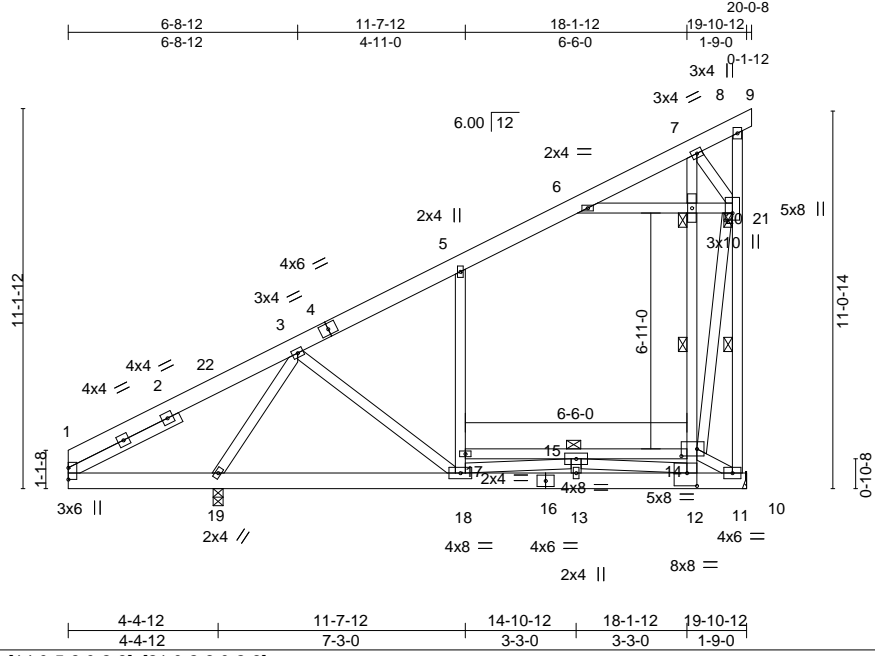

Scale = 1:67.6

Plate Offsets (X,Y)--	[12:0-3-8,0-4-8], [14:0-5-8,0-2-8], [21:0-2-8,0-2-8]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.45	Vert(LL) -0.12	18	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.35	Vert(CT) -0.21	18	>899	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.51	Horz(CT) 0.01	11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.09	18	>999	240		
							Weight: 199 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 14-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
WEBS 2x4 SP No.2	6-0-0 oc bracing: 14-17
SLIDER Left 2x4 SP No.2 3-8-3	WEBS 1 Row at midpt 11-21, 12-20
	JOINTS 1 Brace at Jt(s): 20, 21

REACTIONS. (size) 11=Mechanical, 19=0-3-8
 Max Horz 19=346(LC 12)
 Max Uplift 11=128(LC 12)
 Max Grav 11=1055(LC 19), 19=1126(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-137/379, 3-5=-613/0, 5-6=-423/0, 6-7=-270/480, 11-21=-1586/321
 BOT CHORD 18-19=-291/374, 13-18=0/818, 12-13=0/818, 11-12=-567/209, 14-15=-333/1226
 WEBS 3-19=-1039/98, 5-17=-26/266, 12-14=-13/943, 14-20=-859/416, 15-18=-308/195,
 12-15=-1593/116, 6-20=-850/262, 20-21=-860/269, 7-20=-818/401, 14-21=-534/2143,
 11-14=-241/656, 7-21=-248/652

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-0 to 4-4-13, Interior(1) 4-4-13 to 20-0-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=128.



February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss M03	Truss Type Monopitch	Qty 1	Ply 1	Lot 29 Woodbridge South 163692477
-------------------	--------------	-------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:29 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

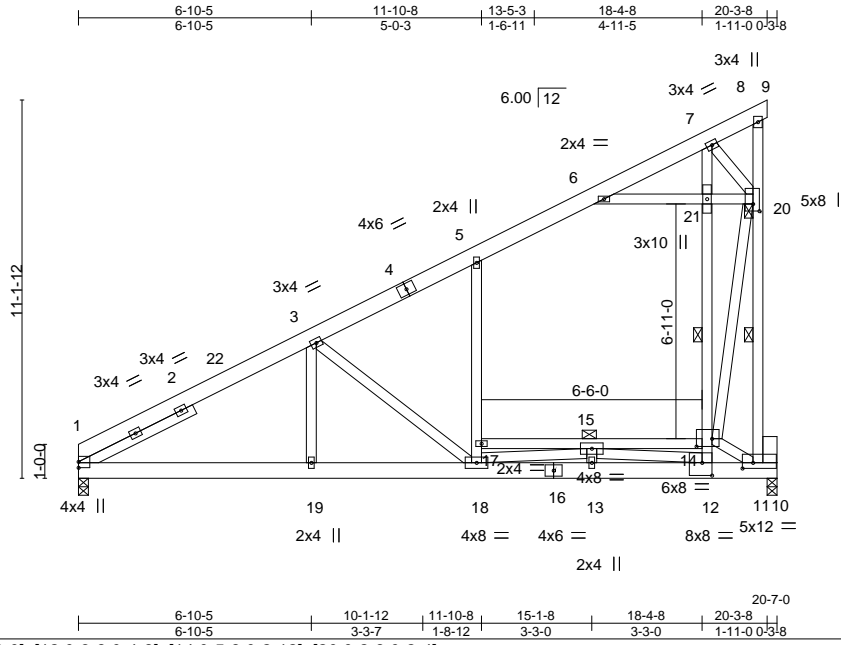

Scale = 1:67.9

Plate Offsets (X,Y)--	[11:0-3-12,0-2-0], [12:0-3-8,0-4-8], [14:0-5-8,0-2-12], [20:0-2-8,0-2-4]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.59	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.48	Vert(LL) -0.15 18-19 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.60	Vert(CT) -0.34 18-19 >727 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.16 18-19 >999 240	Weight: 202 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 10-11: 2x10 SP No.1, 14-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12. 6-0-0 oc bracing: 14-17
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 11-20, 12-21
SLIDER Left 2x4 SP No.2 3-9-3	JOINTS 1 Brace at Jt(s): 20

REACTIONS. (size) 1=0-3-8, 10=0-3-8
 Max Horz 1=347(LC 12)
 Max Uplift 10=112(LC 12)
 Max Grav 1=859(LC 1), 10=893(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-1346/31, 3-5=-770/0, 5-6=-542/0, 6-7=-265/591, 11-20=-1809/358
 BOT CHORD 1-19=-335/1106, 18-19=-335/1106, 13-18=0/346, 12-13=0/346, 11-12=-807/197,
 10-11=-65/336, 14-15=-355/1618
 WEBS 3-18=-686/261, 17-18=0/253, 5-17=0/312, 6-21=-1088/298, 20-21=-1099/304,
 12-14=-86/1060, 14-21=-973/404, 7-21=-925/389, 7-20=-251/789, 15-18=-300/596,
 12-15=-1352/111, 11-14=-222/910, 14-20=-580/2456, 3-19=0/355

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-0 to 4-4-13, Interior(1) 4-4-13 to 20-3-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=112.

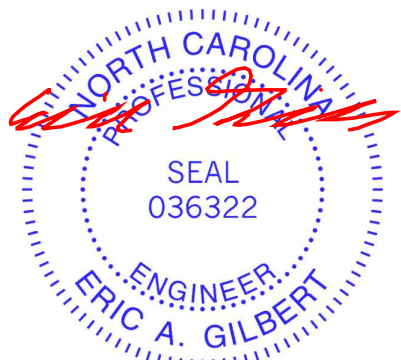

February 19, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-0868	Truss M04	Truss Type MONOPITCH	Qty 2	Ply 1	Lot 29 Woodbridge South 163692478
-------------------	--------------	-------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:30 2024 Page 1

ID:7e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

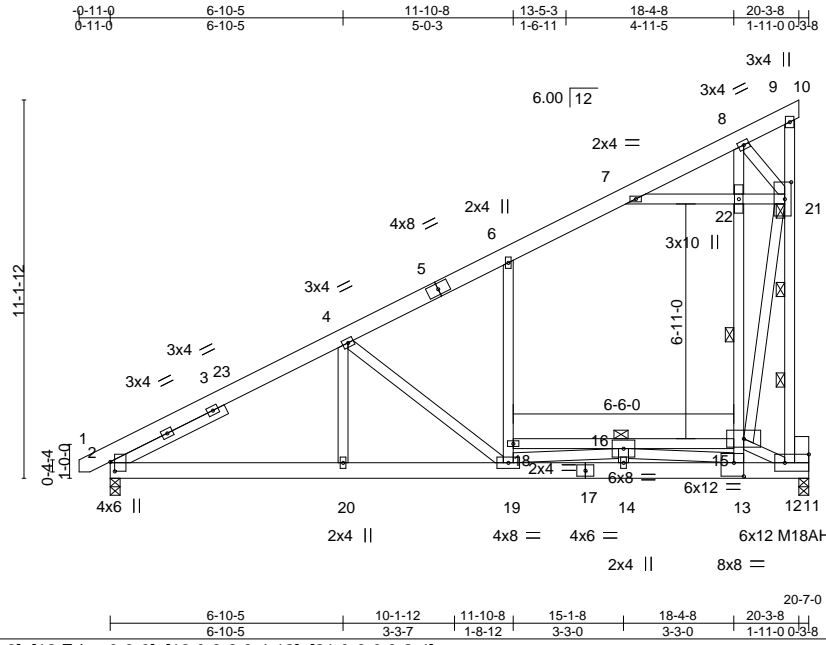

Scale = 1:67.9

Plate Offsets (X, Y)--	[2:0-3-6,0-1-9], [12:Edge,0-3-0], [13:0-3-8,0-4-12], [21:0-6-0,0-2-4]
------------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-5-0	TC 0.80	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	Lumber DOL 0.70	Vert(LL) -0.29 19 >839 360	M18AHS	186/179
BCLL 0.0 *	Lumber DOL 1.15	WB 0.95	Vert(CT) -0.52 19-20 >478 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.01 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.19 19-20 >999 240	Weight: 204 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-3-13 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 15-18: 2x4 SP No.1, 11-12: 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13. 6-0-0 oc bracing: 15-18
WEBS 2x4 SP No.2 *Except* 9-12: 2x4 SP No.1	WEBS 1 Row at midpt 13-22 2 Rows at 1/3 pts 12-21
SLIDER Left 2x4 SP No.2 3-9-3	JOINTS 1 Brace at Jt(s): 21

REACTIONS.
(size) 2=0-3-8, 11=0-3-8
Max Horz 2=414(LC 12)
Max Uplift 11=-135(LC 12)
Max Grav 2=1173(LC 19), 11=1528(LC 19)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-1848/20, 4-6=-1190/0, 6-7=-838/0, 7-8=-311/781, 12-21=-3098/425
BOT CHORD 2-20=-383/1569, 19-20=-383/1569, 14-19=0/948, 13-14=0/948, 12-13=-1247/240, 11-12=-78/576, 16-18=-300/52, 15-16=-426/2622
WEBS 4-19=-821/293, 18-19=0/342, 6-18=0/485, 7-22=-1625/347, 21-22=-1635/354, 13-15=-99/2011, 15-22=-1181/473, 8-22=-1114/455, 8-21=-288/1056, 16-19=-362/756, 13-16=-2530/129, 12-15=-271/1409, 15-21=-681/3958, 4-20=0/422

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 20-3-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=135.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 29 Woodbridge South	163692479
J0224-0868	M04A	MONOPITCH	1	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:32 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?fi

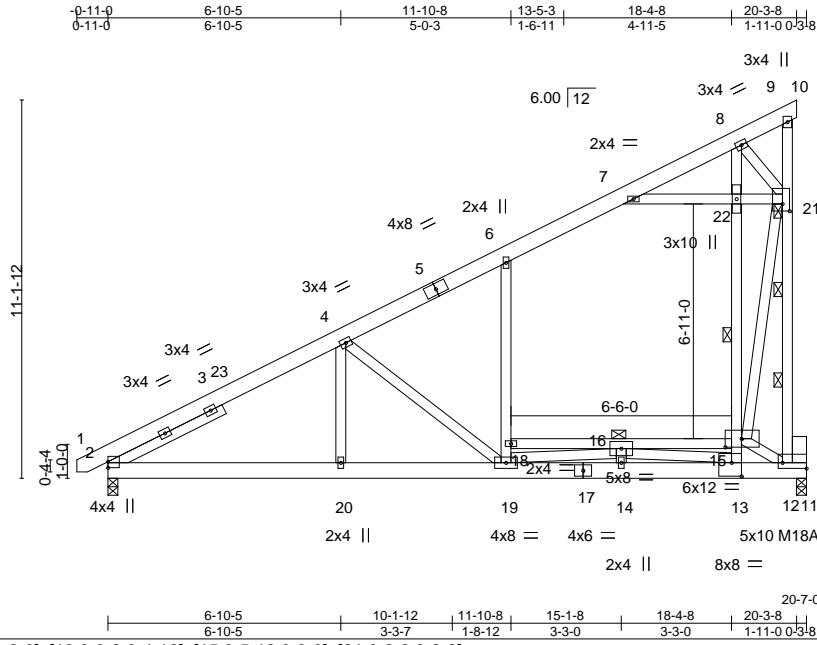

Scale = 1:67.9

Plate Offsets (X,Y)--	[12:Edge,0-2-0], [13:0-3-8,0-4-12], [15:0-5-12,0-3-0], [21:0-2-8,0-2-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.84	Vert(LL) -0.25 19 >977 360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.60	Vert(CT) -0.45 19-20 >553 240	M18AHS	186/179
BCLL 0.0 *	Lumber DOL 1.15	WB 0.83	Horz(CT) 0.01 11 n/a n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Wind(LL) 0.16 19-20 >999 240		
	Code IRC2015/TPI2014			Weight: 204 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 11-12: 2x10 SP No.1, 15-18: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13. 6-0-0 oc bracing: 15-18
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 13-22 2 Rows at 1/3 pts 12-21
SLIDER Left 2x4 SP No.2 3-9-3	JOINTS 1 Brace at Jt(s): 21

REACTIONS. (size) 2=0-3-8, 11=0-3-8
 Max Horz 2=343(LC 12)
 Max Uplift 11=-141(LC 12)
 Max Grav 2=999(LC 19), 11=1518(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1586/37, 4-6=-1038/0, 6-7=-739/14, 7-8=-252/631, 12-21=-2771/437
 BOT CHORD 2-20=-335/1347, 19-20=-335/1347, 14-19=0/870, 13-14=0/870, 12-13=-767/141,
 11-12=-98/572, 16-18=-256/45, 15-16=-313/2022
 WEBS 4-19=-683/243, 18-19=0/294, 6-18=0/413, 7-22=-1379/296, 21-22=-1386/301,
 13-15=-214/2017, 15-22=-953/376, 8-22=-897/362, 8-21=-226/860, 16-19=-278/550,
 13-16=-2035/90, 12-15=-160/871, 15-21=-639/3475, 4-20=0/351

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 20-3-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=141.
 - 6) Magnitude of user added load(s) on this truss have been applied uniformly across all gravity load cases with no adjustments.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-9=-60, 9-10=-20, 2-11=-20, 15-18=-20



February 19, 2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MITEK Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss M04A	Truss Type MONOPITCH	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692479
-------------------	---------------	-------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:32 2024 Page 2
ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 13=-300

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss M05	Truss Type MONOPICH	Qty 6	Ply 1	Lot 29 Woodbridge South 163692480
-------------------	--------------	------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:33 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJC?f

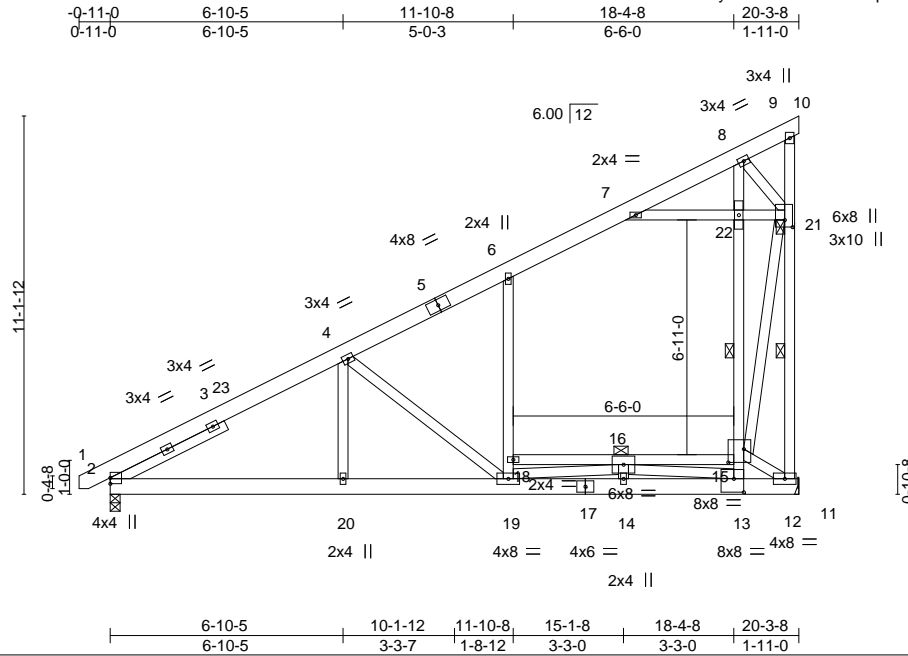

Scale = 1:67.9

Plate Offsets (X,Y)-- [13:0-3-8,0-4-12], [15:0-5-8,0-4-12], [21:0-2-8,0-2-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.79	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.53	Vert(LL) -0.24 19 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.72	Vert(CT) -0.41 19-20 >581 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.15 19-20 >999 240		
				Weight: 202 lb	FT = 20%

LUMBER-

TOP CHORD	2x6 SP No.1
BOT CHORD	2x6 SP No.1 *Except* 15-18: 2x4 SP No.1
WEBS	2x4 SP No.2
SLIDER	Left 2x4 SP No.2 3-9-3

BRACING-


TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13. 6-0-0 oc bracing: 15-18
WEBS	1 Row at midpt 12-21, 13-22
JOINTS	1 Brace at Jt(s): 21

REACTIONS. (size) 12=Mechanical, 2=0-3-8
 Max Horz 2=343(LC 12)
 Max Uplift 12=-118(LC 12)
 Max Grav 12=1294(LC 19), 2=937(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1461/8, 4-6=-912/0, 6-7=-618/0, 7-8=-267/723, 12-21=-2214/307
 BOT CHORD 2-20=-309/1239, 19-20=-309/1239, 14-19=0/744, 13-14=0/744, 12-13=-1274/229,
 15-16=-362/2253
 WEBS 4-19=-689/243, 18-19=0/287, 6-18=0/405, 7-22=-1347/287, 21-22=-1358/294,
 13-15=-16/1157, 15-22=-1110/409, 8-22=-1052/394, 8-21=-255/994, 16-19=-296/611,
 13-16=-2200/120, 12-15=-257/1428, 15-21=-531/3017, 4-20=0/351

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-6 to 3-7-7, Interior(1) 3-7-7 to 20-3-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=118.




February 19, 2024

Job J0224-0868	Truss M06GE	Truss Type MONOPITCH SUPPORTED	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692481
-------------------	----------------	-----------------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:35 2024 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:66.2

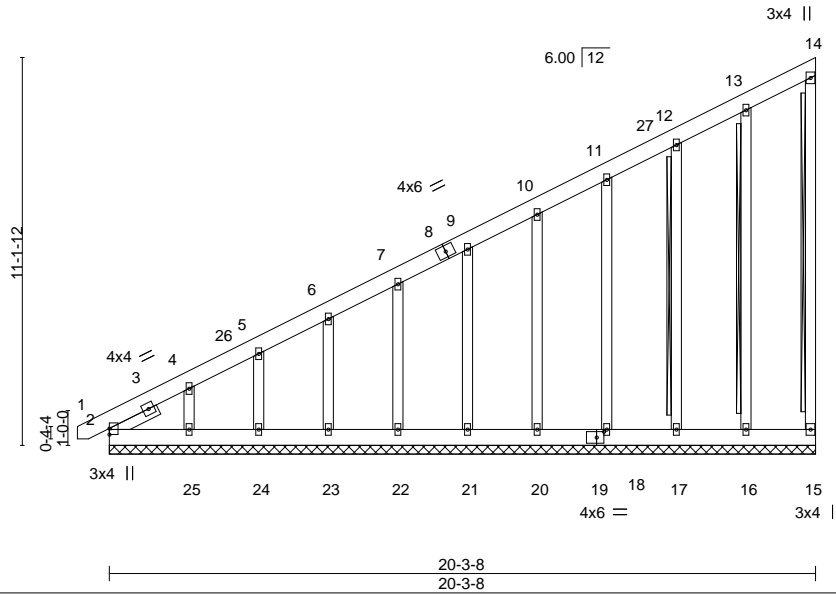


Plate Offsets (X,Y)--	[19:0-2-8,0-2-0]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	1	n/r 120
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	1	n/r 120
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	-0.00	15	n/a n/a
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S				
							PLATES MT20
							GRIP 244/190
							Weight: 191 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS T-Brace: 2x4 SPF No.2 - 14-15, 13-16, 12-17
OTHERS 2x4 SP No.2	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
SLIDER Left 2x4 SP No.2 1-6-4	Brace must cover 90% of web length.

REACTIONS. All bearings 20-3-8.
 (lb) - Max Horz 2=490(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 15, 16, 17, 18, 20, 21, 22, 23, 24 except 25=-224(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 15, 16, 17, 18, 20, 21, 22, 23, 24, 25 except 2=302(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-702/222, 4-5=-556/175, 5-6=-509/159, 6-7=-450/138, 7-9=-392/118, 9-10=-335/98, 10-11=-278/78
 WEBS 4-25=-147/349


- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-9-2 to 3-7-11, Exterior(2) 3-7-11 to 20-1-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 16, 17, 18, 20, 21, 22, 23, 24 except (jt=lb) 25=224.
 - 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



February 19, 2024

Job J0224-0868	Truss M07GE	Truss Type GABLE	Qty 1	Ply 1	Lot 29 Woodbridge South 163692482
Comtech, Inc. Fayetteville, NC - 28314,					Job Reference (optional)

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:36 2024 Page 1
 ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f
 0-11-0 10-11-8 23-6-4 23-8-0
 0-11-0 10-11-8 12-6-12 0-1-12

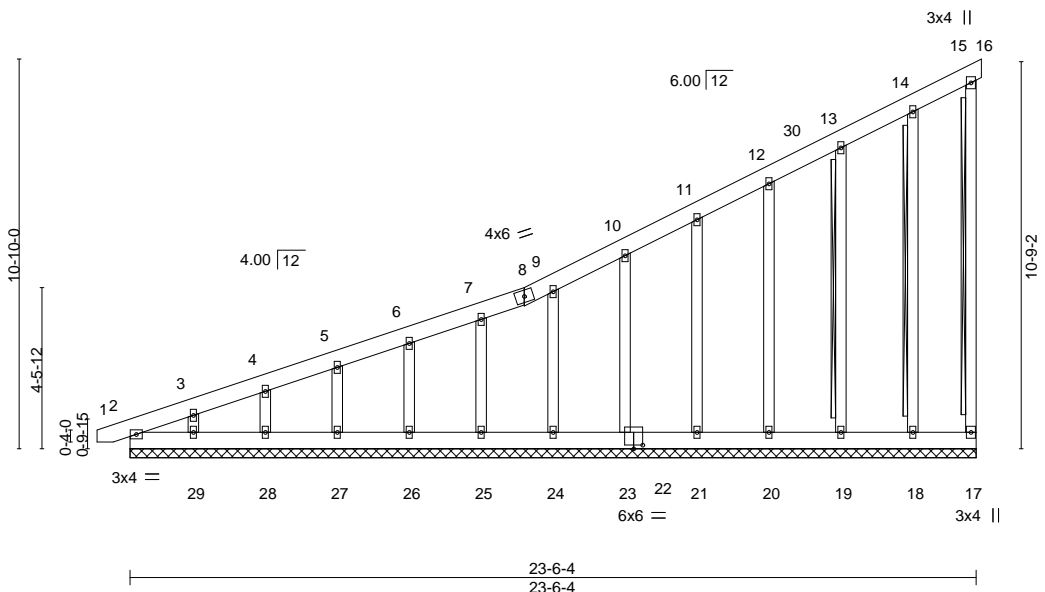

Scale: 3/16"=1'


Plate Offsets (X,Y)--	[22:0-3-0-0-1-4]						
LOADING (psf)	SPACING - 2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.02	Vert(LL) 0.00	15	n/r	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.01	Vert(CT) 0.00	15	n/r		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) -0.00	17	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					
						Weight: 204 lb	FT = 20%

LUMBER-	BRACING-	
TOP CHORD 2x6 SP No.1	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS	T-Brace: 2x4 SPF No.2 - 15-17, 13-19, 14-18
OTHERS 2x4 SP No.2		Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 23-6-4.
 (lb) - Max Horz 2=479(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 17, 24, 25, 26, 27, 28, 23, 21, 20, 19, 18 except 29=145(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 17, 2, 24, 25, 26, 27, 28, 29, 23, 21, 20, 19, 18

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-655/209, 3-4=-568/178, 4-5=-529/164, 5-6=-494/152, 6-7=-456/139, 7-8=-428/123, 8-9=-424/131, 9-10=-395/118, 10-11=-335/97, 11-12=-278/77
 WEBS 3-29=-113/254

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-5 to 3-9-2, Exterior(2) 3-9-2 to 23-8-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 24, 25, 26, 27, 28, 23, 21, 20, 19, 18 except (jt=lb) 29=145.
 - 9) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

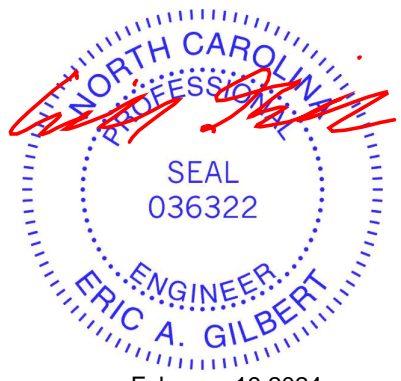

Job J0224-0868	Truss M08	Truss Type ROOF SPECIAL	Qty 7	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692483
-------------------	--------------	----------------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:37 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:59.7

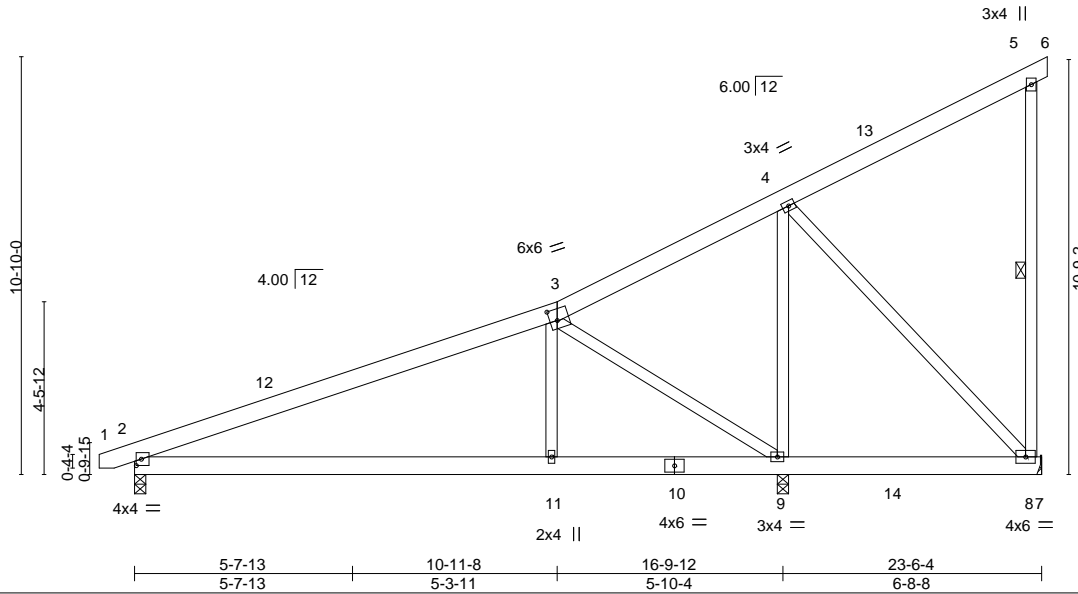


Plate Offsets (X,Y)--	[2:0-1-9,0-2-0], [3:0-2-4,0-3-8]
-----------------------	----------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.60	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(LL) -0.09 2-11 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.73	Vert(CT) -0.21 2-11 >971 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 9 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 2-11 >999 240	Weight: 171 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 8-9.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 5-8

REACTIONS. (size) 8=Mechanical, 2=0-3-8, 9=0-3-8
 Max Horz 2=333(LC 12)
 Max Uplift 8=102(LC 12), 2=-46(LC 8), 9=-104(LC 12)
 Max Grav 8=134(LC 19), 2=641(LC 1), 9=1207(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-705/0
 BOT CHORD 2-11=-190/558, 9-11=-193/549
 WEBS 3-11=0/406, 3-9=-849/177, 4-9=-629/158

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-11 to 3-8-2, Interior(1) 3-8-2 to 23-8-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 8=102, 9=104.




February 19, 2024

Job	Truss	Truss Type	Qty	Ply	Lot 29 Woodbridge South	163692484
J0224-0868	M09	GABLE	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:39 2024 Page 1

ID: ?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f



Scale = 1:80.5

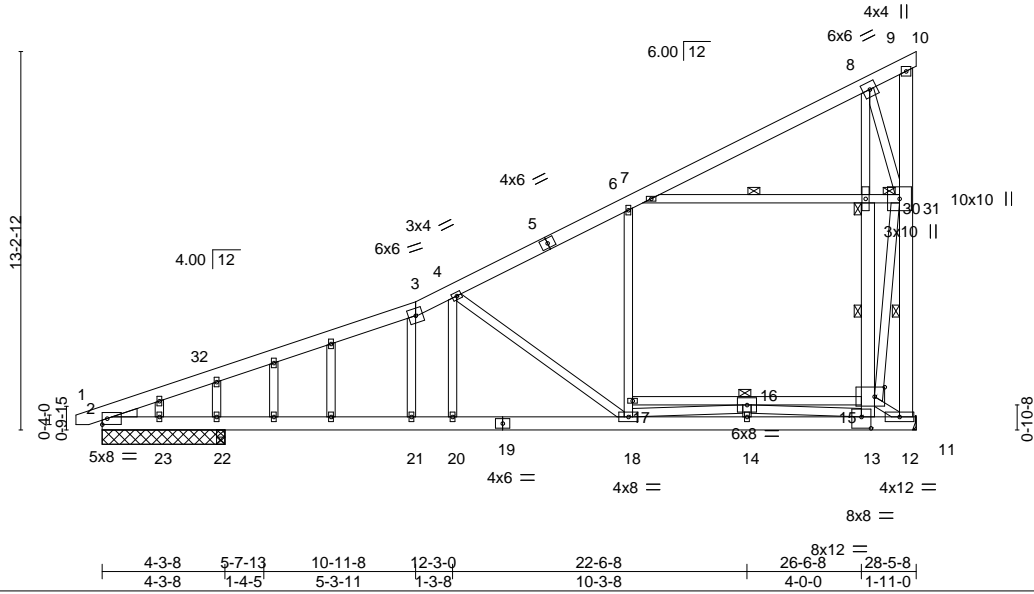


Plate Offsets (X,Y)-- [13:0-4-0,0-4-12], [15:0-4-4,0-4-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.31	18	>921	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.72	Vert(CT)	-0.56	18-20	>516		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.95	Horz(CT)	0.03	12	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S	Wind(LL)	0.30	18-20	>966		
								Weight: 293 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1 *Except*
15-17: 2x4 SP No.1
WEBS 2x4 SP No.2 *Except*
9-12,13-30: 2x6 SP No.1, 15-31: 2x4 SP No.1
OTHERS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-2-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
9-7-14 oc bracing: 2-23
6-0-0 oc bracing: 12-13.
6-0-0 oc bracing: 15-17
WEBS 1 Row at midpt 12-31, 13-30, 7-30
JOINTS 1 Brace at Jt(s): 30, 31

REACTIONS. All bearings 4-3-8 except (jt=length) 12=Mechanical.
(lb) - Max Horz 2=591(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 22 except 12=366(LC 12), 23=272(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 23 except 12=1653(LC 2), 2=683(LC 2), 22=542(LC 3), 22=475(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1957/68, 3-4=-1937/179, 4-6=-1297/0, 6-7=-862/22, 7-8=-355/806, 12-31=-2612/601, 9-31=-179/307
BOT CHORD 2-23=-536/1736, 22-23=-536/1736, 21-22=-536/1736, 20-21=-546/1752, 18-20=-546/1752, 14-18=0/1011, 13-14=0/1011, 12-13=-1137/399, 15-16=-803/3005
WEBS 3-21=-472/263, 13-15=-73/1408, 15-30=-2571/948, 17-18=0/524, 6-17=0/666, 7-30=-1667/424, 30-31=-1750/460, 8-30=-2520/933, 8-31=-412/1659, 4-18=-942/342, 12-15=-473/1362, 15-31=-1208/4624, 16-18=-579/930, 13-16=-2726/293, 4-20=-168/581

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-5 to 3-8-8, Interior(1) 3-8-8 to 28-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 22 except (jt=lb) 12=366, 23=272.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




Job	Truss	Truss Type	Qty	Ply	Lot 29 Woodbridge South
J0224-0868	M10	MONOPICH	2	1	63692485

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:40 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:81.2

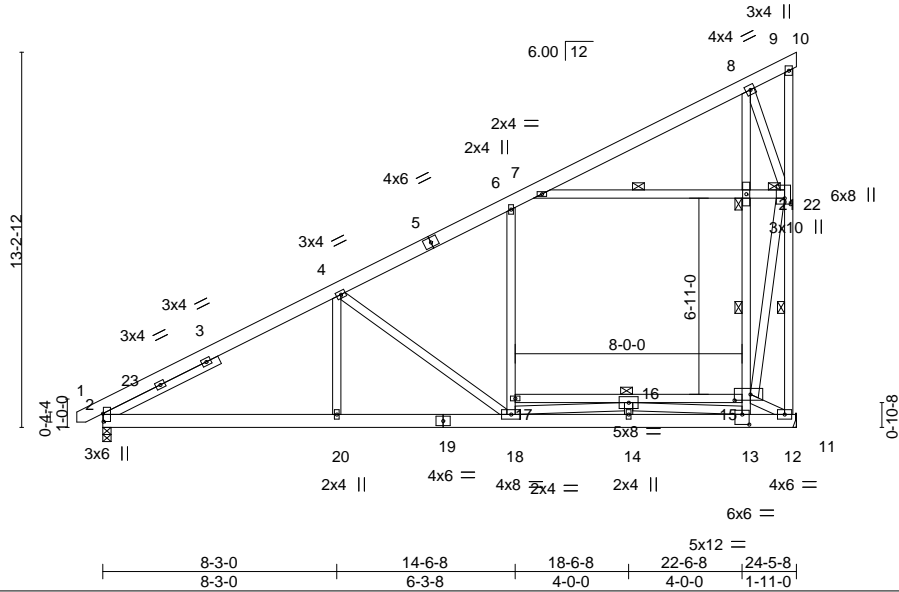


Plate Offsets (X, Y)--	[2:0-3-6,0-0-4], [13:0-3-0,0-4-4], [15:0-6-12,0-2-8], [22:0-2-8,0-2-8]
------------------------	--


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.69	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.62	Vert(LL) -0.18 18-20 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.81	Vert(CT) -0.40 18-20 >732 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.19 18-20 >999 240		
				Weight: 249 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1 *Except* 15-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13, 6-0-0 oc bracing: 15-17
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 12-22, 13-21, 7-21
SLIDER Left 2x4 SP No.2 4-6-8	JOINTS 1 Brace at Jt(s): 21, 22

REACTIONS. (size) 12=Mechanical, 2=0-3-8
 Max Horz 2=411(LC 12)
 Max Uplift 12=139(LC 12)
 Max Grav 12=1102(LC 1), 2=1052(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1570/0, 4-6=-939/0, 6-7=-634/0, 7-8=-252/667, 12-22=-1792/353
 BOT CHORD 2-20=-361/1292, 18-20=-361/1292, 14-18=0/519, 13-14=0/519, 12-13=-1003/272,
 15-16=-449/1938
 WEBS 4-20=0/370, 4-18=-696/250, 17-18=0/398, 6-17=0/469, 13-15=0/784, 15-21=-2058/615,
 8-21=-2023/607, 8-22=-262/1286, 16-18=-408/676, 13-16=-1571/87, 12-15=-306/1130,
 15-22=-736/3313, 7-21=-1212/259, 21-22=-1243/269

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=139.

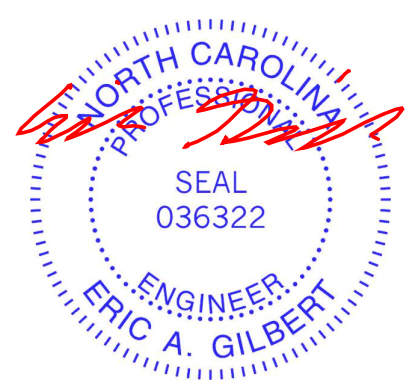

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MITEK Affiliate

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 29 Woodbridge South	163692486
J0224-0868	M11	MONOPITCH	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:41 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

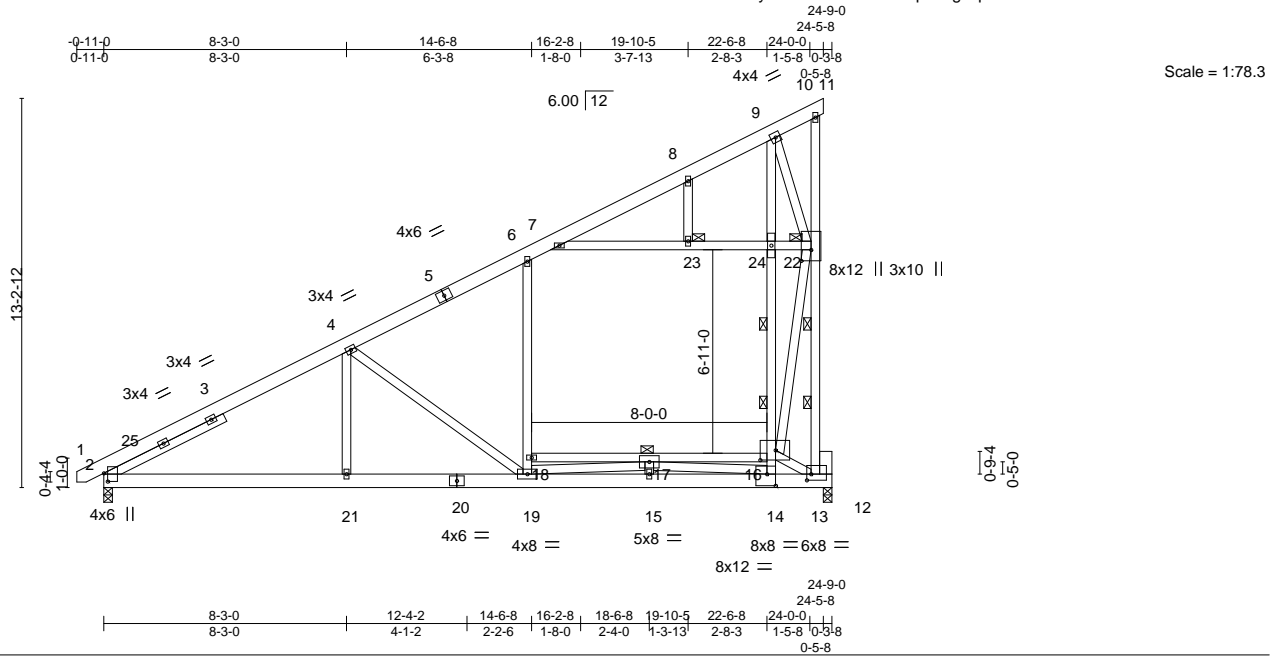


Plate Offsets (X, Y)-- [2:0-3-6,0-1-9], [13:0-1-12,0-2-8], [14:0-3-8,0-4-12], [16:0-6-4,0-4-0], [22:0-4-8,0-4-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-5-4	TC 0.39	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.61	Vert(LL) -0.25 19-21 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.86	Vert(CT) -0.53 19-21 >556 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.01 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.25 19-21 >999 240		
				Weight: 254 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-9-12 oc purlins.
BOT CHORD 2x6 SP No.1 *Except* 12-13: 2x10 SP No.1, 16-18: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 5-9-2 oc bracing: 13-14. 6-0-0 oc bracing: 16-18
WEBS 2x4 SP No.2 *Except* 10-13,16-22: 2x4 SP No.1	WEBS 2 Rows at 1/3 pts 13-22, 14-24
SLIDER Left 2x4 SP No.2 4-6-8	JOINTS 1 Brace at Jt(s): 22, 23

REACTIONS. (size) 12=0-3-8, 2=0-3-8
 Max Horz 2=501(LC 12)
 Max Uplift 12=161(LC 12)
 Max Grav 12=1320(LC 1), 2=1313(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1978/11, 4-6=-1198/0, 6-7=-849/0, 7-8=-290/502, 8-9=-236/571
 BOT CHORD 2-21=-450/1631, 19-21=-450/1631, 15-19=0/513, 14-15=0/513, 13-14=-1326/377,
 12-13=-129/497, 16-17=-624/2643
 WEBS 4-19=861/310, 7-23=-1327/273, 23-24=-1327/273, 22-24=-1360/285, 13-22=-2881/698,
 18-19=0/441, 6-18=0/526, 4-21=0/459, 14-16=-166/1551, 16-24=-2277/739,
 16-22=-1066/4561, 9-24=-2052/629, 9-22=-261/1334, 13-16=-445/1603, 17-19=-550/1038,
 14-17=-1983/137

- NOTES-**
 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 2) All plates are 2x4 MT20 unless otherwise indicated.
 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=161.



February 19, 2024

Job J0224-0868	Truss M12	Truss Type MONOPITCH	Qty 7	Ply 1	Lot 29 Woodbridge South 163692487
-------------------	--------------	-------------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:43 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

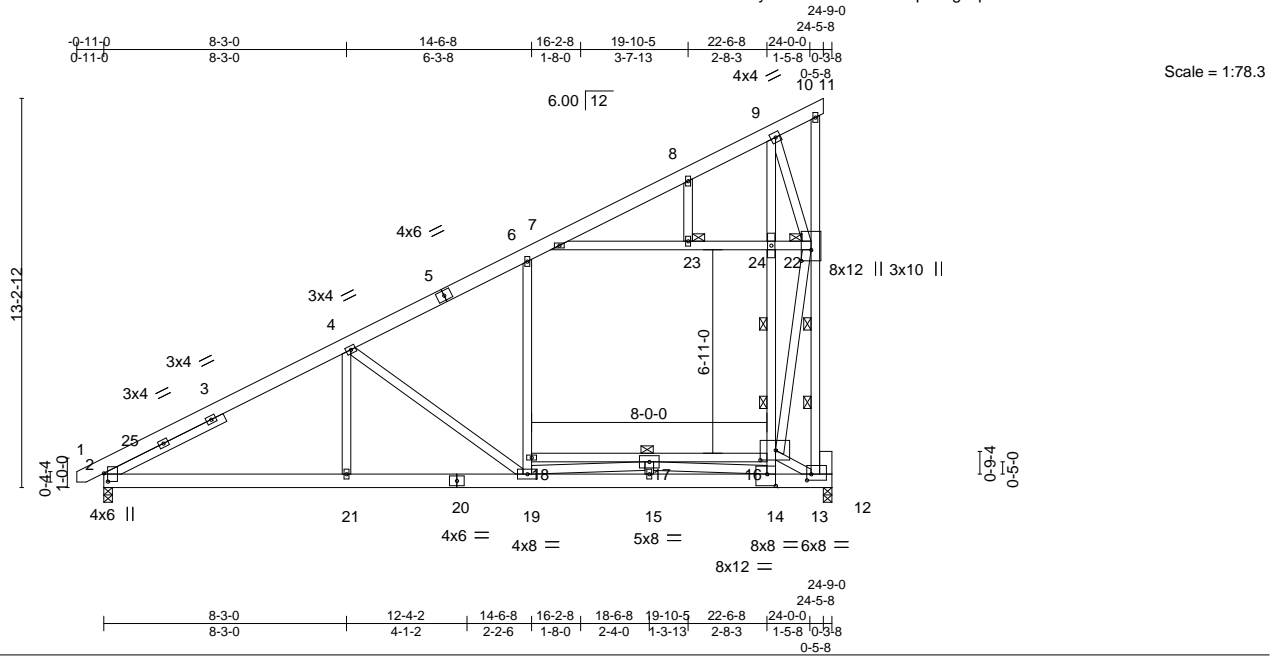


Plate Offsets (X,Y)--	[2:0-3-6,0-1-9], [13:0-1-12,0-2-8], [14:0-3-8,0-4-12], [16:0-6-4,0-4-0], [22:0-4-8,0-4-0]
-----------------------	---


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-5-4	TC 0.39	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.61	Vert(LL) -0.25 19-21 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.86	Vert(CT) -0.53 19-21 >556 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.01 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.25 19-21 >999 240		
				Weight: 254 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-9-12 oc purlins.
BOT CHORD 2x6 SP No.1 *Except* 12-13: 2x10 SP No.1, 16-18: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 5-9-2 oc bracing: 13-14. 6-0-0 oc bracing: 16-18
WEBS 2x4 SP No.2 *Except* 10-13,16-22: 2x4 SP No.1	WEBS 2 Rows at 1/3 pts 13-22, 14-24
SLIDER Left 2x4 SP No.2 4-6-8	JOINTS 1 Brace at Jt(s): 22, 23

REACTIONS.
(size) 12=0-3-8, 2=0-3-8
Max Horz 2=501(LC 12)
Max Uplift 12=161(LC 12)
Max Grav 12=1320(LC 1), 2=1313(LC 1)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-1978/11, 4-6=-1198/0, 6-7=-849/0, 7-8=-290/502, 8-9=-236/571
BOT CHORD 2-21=-450/1631, 19-21=-450/1631, 15-19=0/513, 14-15=0/513, 13-14=-1326/377, 12-13=-129/497, 16-17=-624/2643
WEBS 4-19=861/310, 7-23=-1327/273, 23-24=-1327/273, 22-24=-1360/285, 13-22=-2881/698, 18-19=0/441, 6-18=0/526, 4-21=0/459, 14-16=-166/1551, 16-24=-2277/739, 16-22=-1066/4561, 9-24=-2052/629, 9-22=-261/1334, 13-16=-445/1603, 17-19=-550/1038, 14-17=-1983/137

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 24-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are 2x4 MT20 unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=161.



February 19, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job	Truss	Truss Type	Qty	Ply	Lot 29 Woodbridge South	163692488
J0224-0868	M13GE	MONOPITCH SUPPORTED	1	1	Job Reference (optional)	


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:44 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

0-11-0 24-5-8 24-9-0
 0-11-0 24-5-8 0-3-8

Scale = 1:74.4

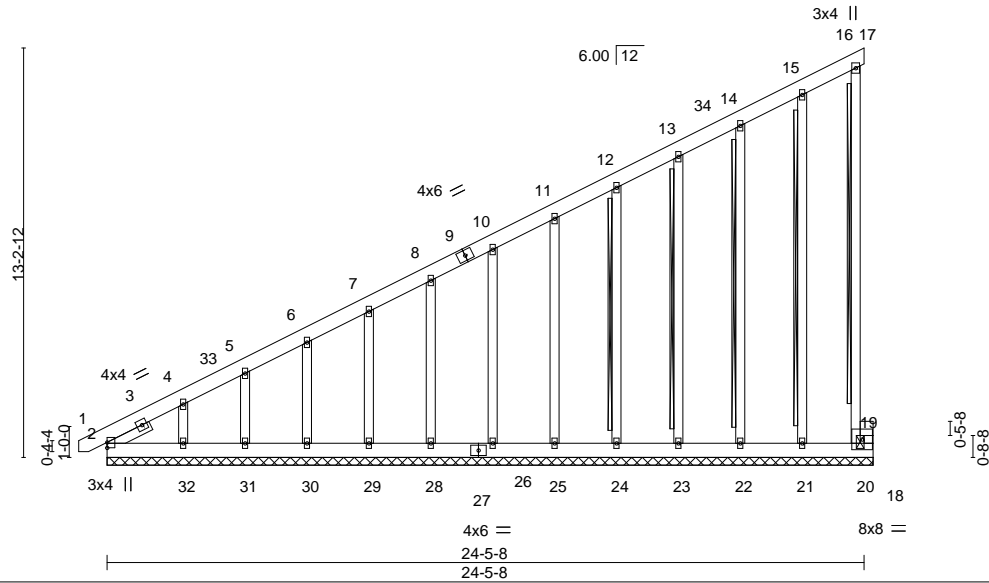

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.00	16	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	0.00	16	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	-0.00	19	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 250 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 OTHERS 2x4 SP No.2
 SLIDER Left 2x4 SP No.2 1-6-4

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. Except: 6-0-0 oc bracing: 16-19
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS T-Brace: 2x4 SP No.2 - 16-19, 15-21, 14-22, 13-23, 12-24
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 24-9-0.
 (lb) - Max Horz 2=590(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 21, 22, 23, 24, 25, 26, 28, 29, 30, 31, 19 except 32=255(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 21, 22, 23, 24, 25, 26, 28, 29, 30, 31, 32, 19, 20 except 2=368(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-828/266, 4-5=-671/214, 5-6=-629/199, 6-7=-569/179, 7-8=-511/159, 8-10=-453/138, 10-11=-395/118, 11-12=-338/98, 12-13=-281/78
 WEBS 4-32=-160/378

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-9-2 to 3-7-11, Exterior(2) 3-7-11 to 24-5-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 19 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 21, 22, 23, 24, 25, 26, 28, 29, 30, 31, 19 except (jt=lb) 32=255.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

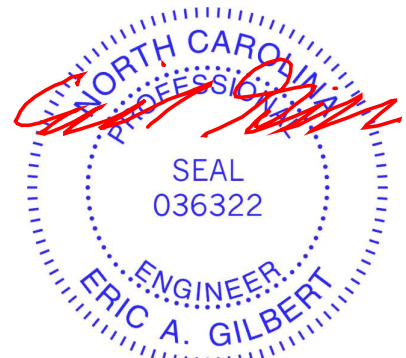

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss V1	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692489
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:46 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

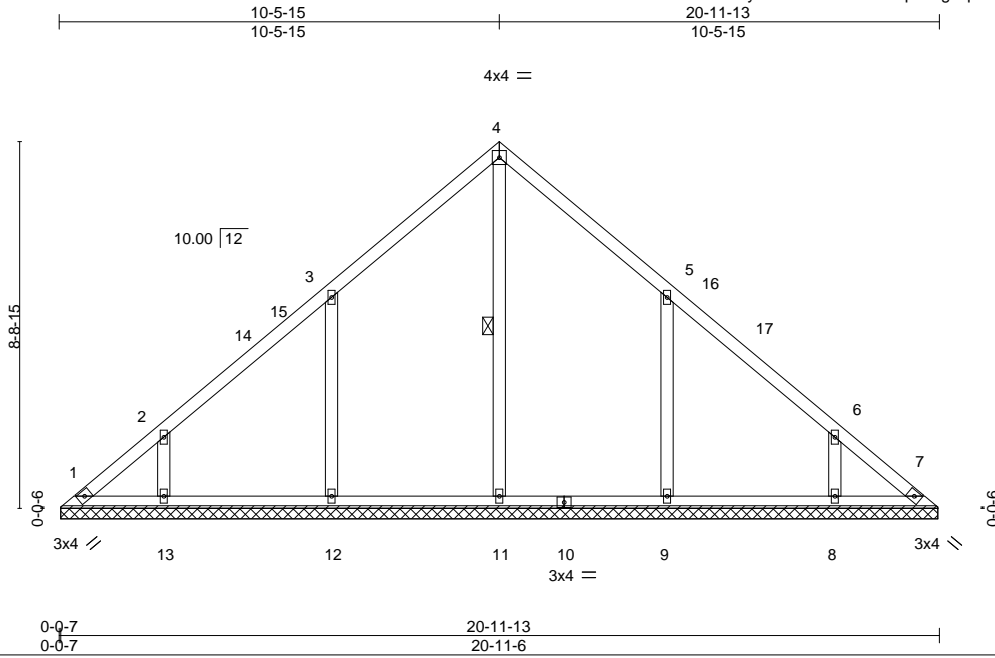

Scale = 1:54.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.19	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 101 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 4-11

REACTIONS. All bearings 20-10-15.
 (lb) - Max Horz 1=-202(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7 except 12=-141(LC 12), 13=-104(LC 12), 9=-140(LC 13), 8=-104(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 11=443(LC 22), 12=473(LC 19), 13=285(LC 19), 9=473(LC 20), 8=285(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-12=-357/254, 2-13=-277/212, 5-9=-357/254, 6-8=-277/212

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 10-5-15, Exterior(2) 10-5-15 to 14-10-11, Interior(1) 14-10-11 to 20-7-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7 except (jt=lb) 12=141, 13=104, 9=140, 8=104.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss V2	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692490
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:47 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

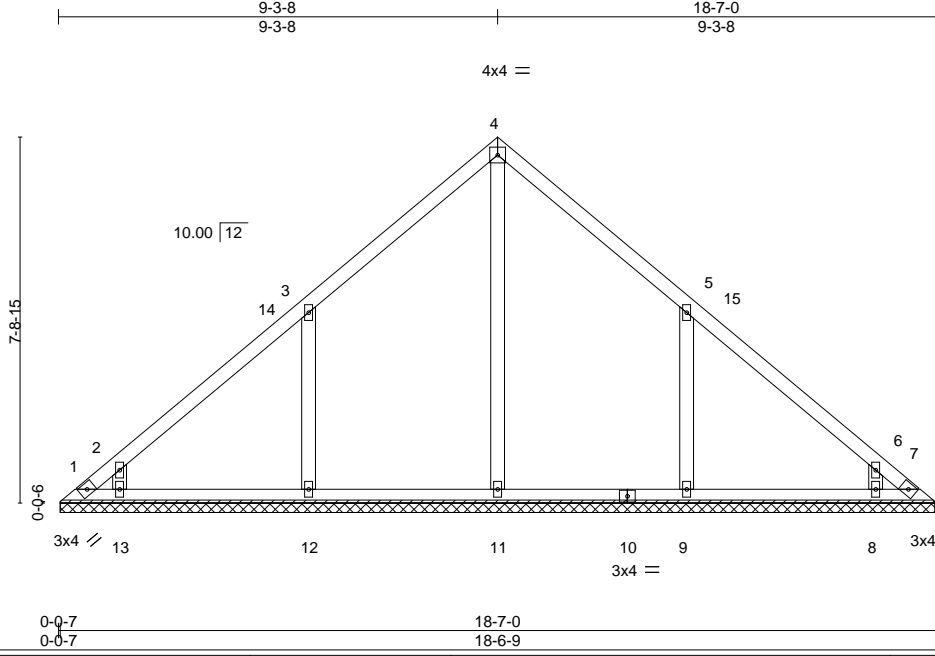

Scale = 1:48.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 86 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 18-6-2.
(lb) - Max Horz 1=178(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 7 except 1=131(LC 10), 12=141(LC 12), 13=105(LC 12), 9=141(LC 13), 8=105(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 11=433(LC 22), 12=474(LC 19), 13=282(LC 19), 9=473(LC 20), 8=282(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-12=-356/255, 2-13=-293/238, 5-9=-356/254, 6-8=-293/238

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 9-3-8, Exterior(2) 9-3-8 to 13-8-5, Interior(1) 13-8-5 to 18-2-3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 1=131, 12=141, 13=105, 9=141, 8=105.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss V3	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692491
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:48 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

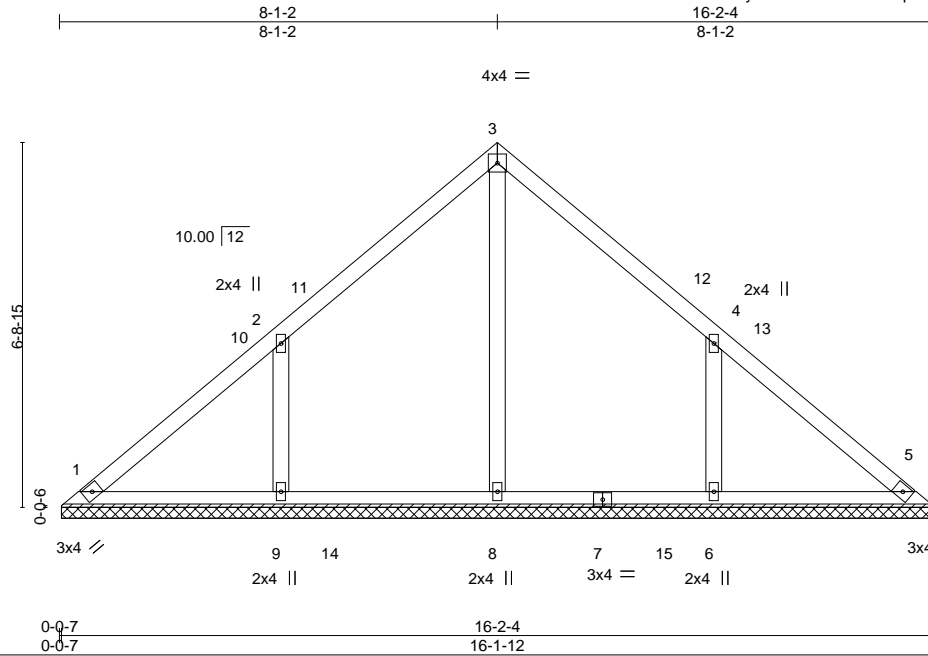

Scale = 1:42.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 71 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 16-1-5.
 (lb) - Max Horz 1=154(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 9=147(LC 12), 6=147(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 8=413(LC 19), 9=450(LC 19), 6=450(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-9=-366/259, 4-6=-366/259

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 8-1-2, Exterior(2) 8-1-2 to 12-5-15, Interior(1) 12-5-15 to 15-9-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=147, 6=147.

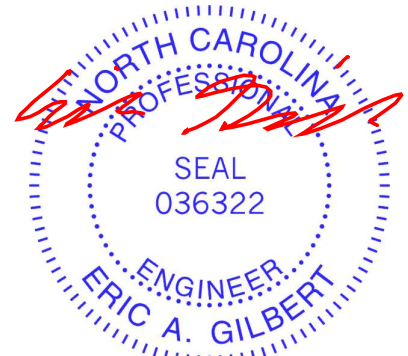

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss V4	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692492
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:49 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

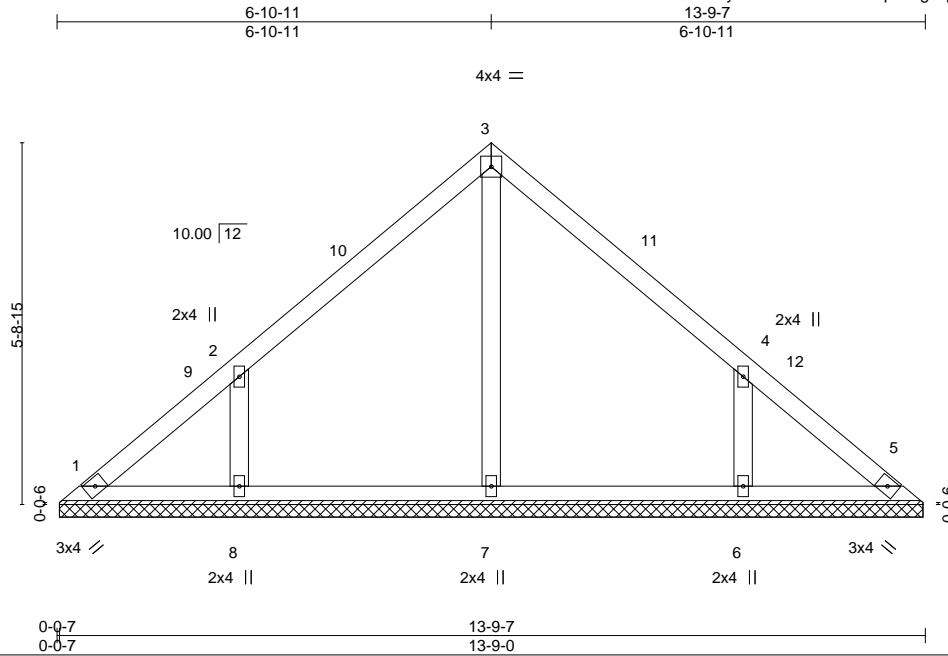

Scale = 1:36.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 59 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-8-8.
 (lb) - Max Horz 1=-130(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=-128(LC 12), 6=-128(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=344(LC 19), 6=343(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-322/240, 4-6=-322/240

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 6-10-11, Exterior(2) 6-10-11 to 11-3-8, Interior(1) 11-3-8 to 13-4-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=128, 6=128.

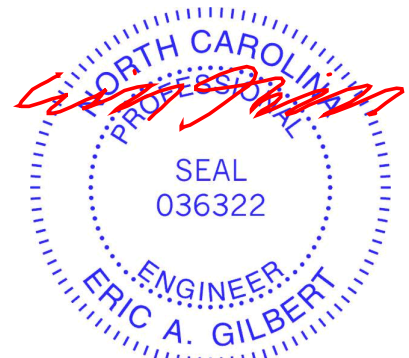

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss V5	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692493
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:50 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

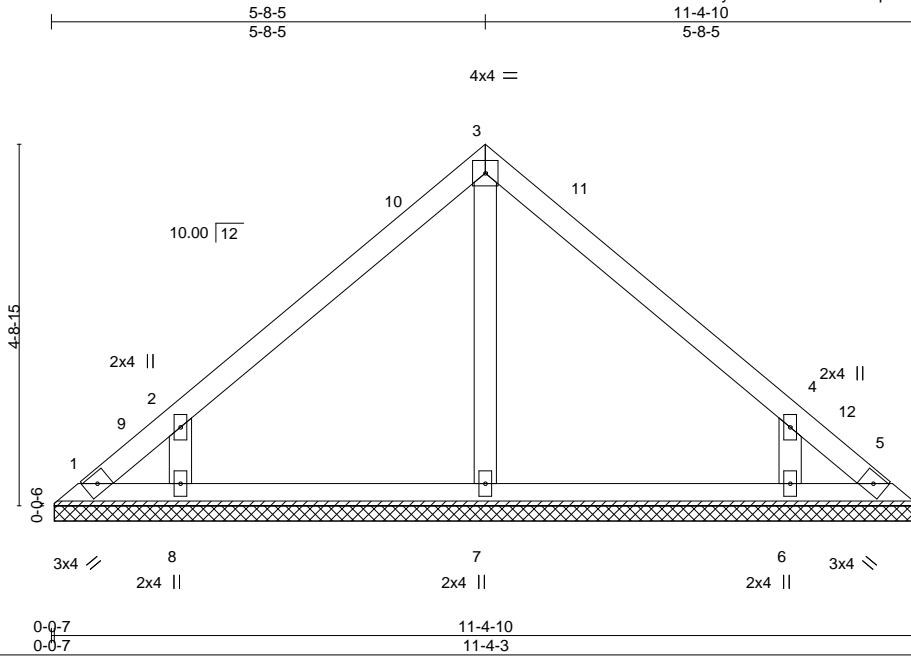

Scale = 1:30.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.09	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 46 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS. All bearings 11-3-12.
 (lb) - Max Horz 1=106(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=126(LC 12), 6=126(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=330(LC 19), 6=329(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-323/257, 4-6=-323/257

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 5-8-5, Exterior(2) 5-8-5 to 10-1-2, Interior(1) 10-1-2 to 10-11-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=126, 6=126.

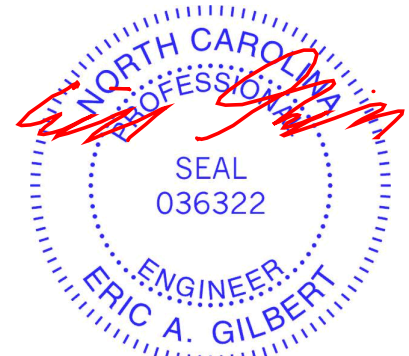

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss V6	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692494
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc, Fayetteville, NC - 28314,



8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:51 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



4x4 =

Scale = 1:25.3

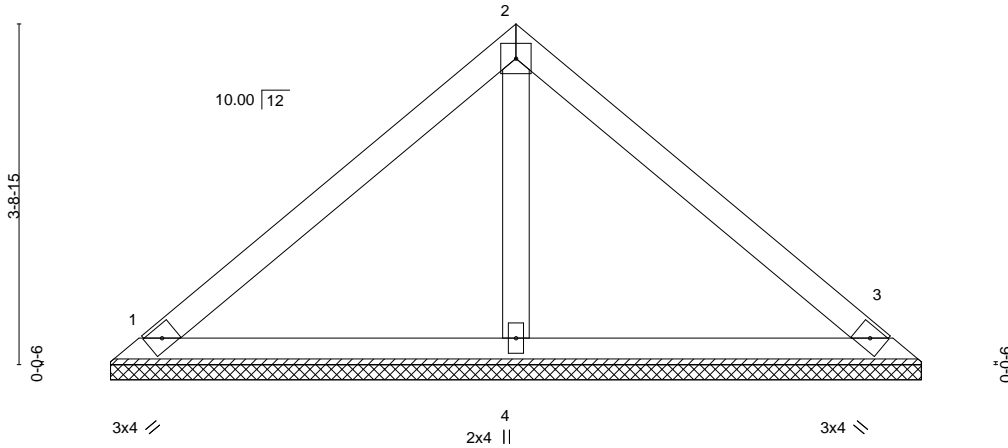

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.12	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 34 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=8-10-15, 3=8-10-15, 4=8-10-15
Max Horz 1=82(LC 9)
Max Uplift 1=29(LC 13), 3=36(LC 13)
Max Grav 1=189(LC 1), 3=189(LC 1), 4=276(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

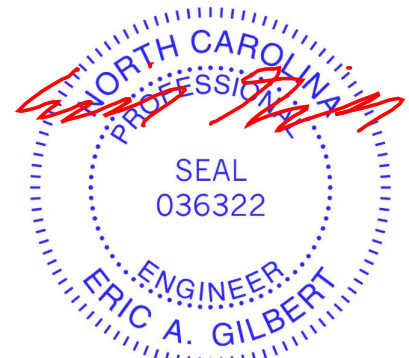

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss V7	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692495
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,



8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:52 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



4x4 =

Scale = 1:19.2

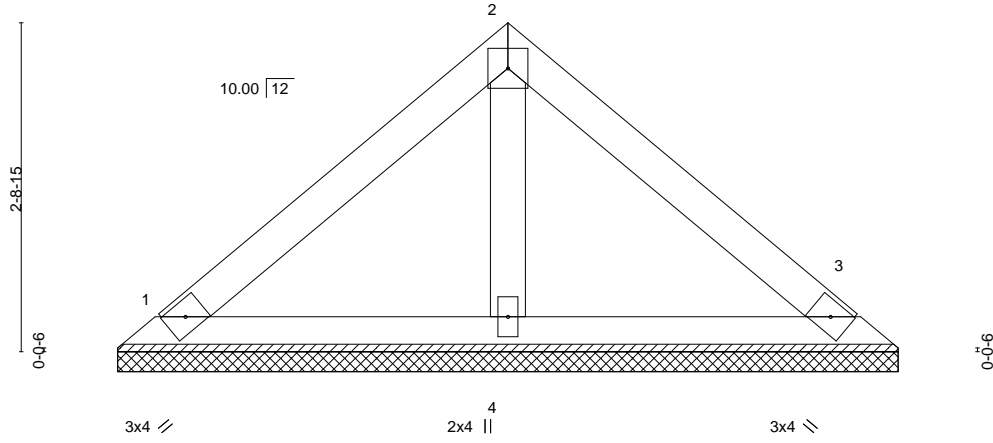

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.12	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 24 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-6-2, 3=6-6-2, 4=6-6-2
Max Horz 1=-58(LC 8)
Max Uplift 1=-20(LC 13), 3=-25(LC 13)
Max Grav 1=134(LC 1), 3=134(LC 1), 4=195(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

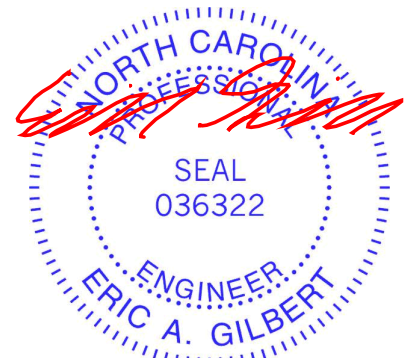

February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss V8	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692496
-------------------	-------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:53 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

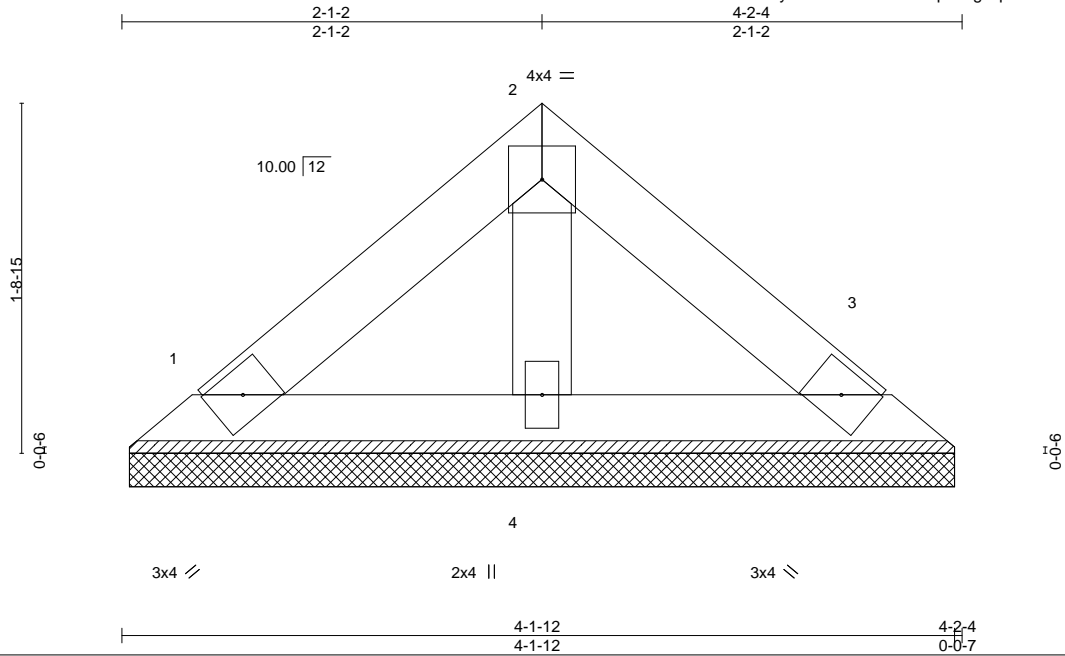

Scale = 1:11.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 14 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-2-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-1-5, 3=4-1-5, 4=4-1-5
Max Horz 1=34(LC 8)
Max Uplift 1=12(LC 13), 3=15(LC 13)
Max Grav 1=78(LC 1), 3=78(LC 1), 4=114(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-0868	Truss V9	Truss Type Valley	Qty 1	Ply 1	Lot 29 Woodbridge South 163692497
-------------------	-------------	----------------------	----------	----------	--------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:54 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

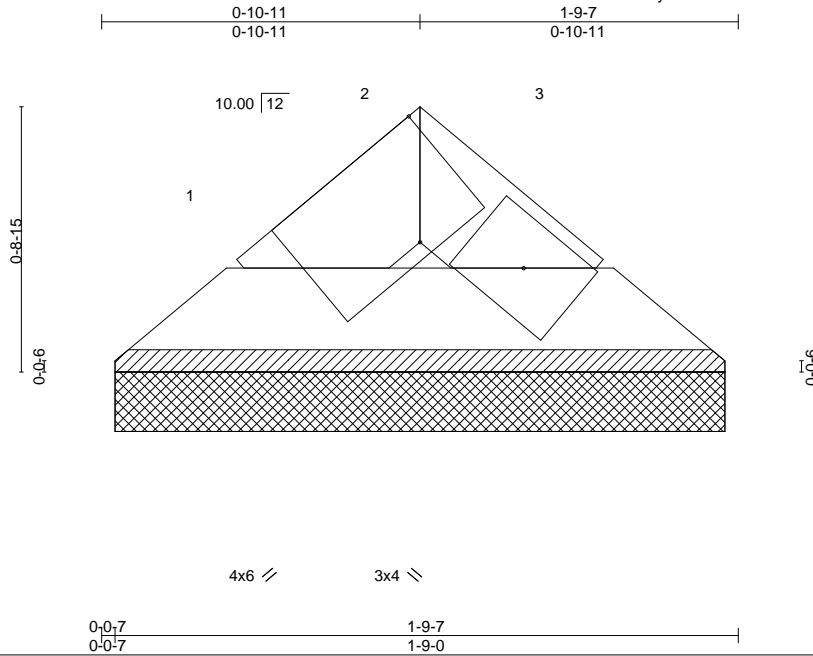

Scale = 1:6.5

Plate Offsets (X,Y)-- [1:0-2-7,Edge]										
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.00	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P							
								Weight: 5 lb	FT = 20%	


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-9-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=1-8-8, 3=1-8-8
 Max Horz 1=10(LC 9)
 Max Uplift 1=2(LC 12), 3=2(LC 13)
 Max Grav 1=39(LC 1), 3=39(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




Job J0224-0868	Truss VC1	Truss Type Valley	Qty 2	Ply 1	Lot 29 Woodbridge South Job Reference (optional)	163692498
-------------------	--------------	----------------------	----------	----------	---	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:55 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

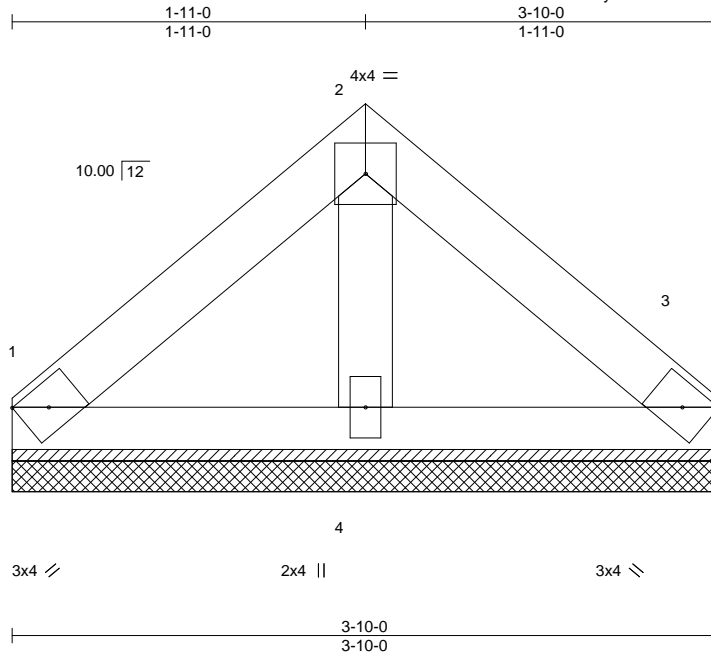

Scale = 1:12.5

Plate Offsets (X,Y)-- [1:0-1-14,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.04	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 15 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=3-10-0, 3=3-10-0, 4=3-10-0
 Max Horz 1=-38(LC 8)
 Max Uplift 1=-14(LC 13), 3=-16(LC 13)
 Max Grav 1=84(LC 1), 3=84(LC 1), 4=116(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-0868	Truss VC2	Truss Type Valley	Qty 2	Ply 1	Lot 29 Woodbridge South 163692499
-------------------	--------------	----------------------	----------	----------	--------------------------------------

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Feb 16 13:11:56 2024 Page 1

ID:?e2f6D20Mb87TBwFO5hPsSyEJ4d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:7.4

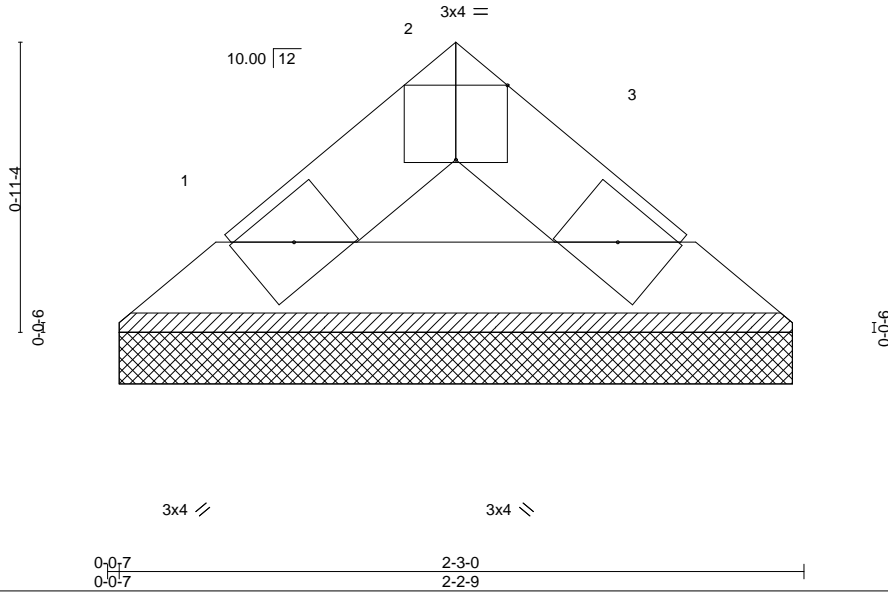


Plate Offsets (X,Y)-- [2:0-2-0,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.01	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 6 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-3-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=2-2-2, 3=2-2-2
 Max Horz 1=14(LC 9)
 Max Uplift 1=3(LC 12), 3=3(LC 13)
 Max Grav 1=58(LC 1), 3=58(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.




February 19, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION

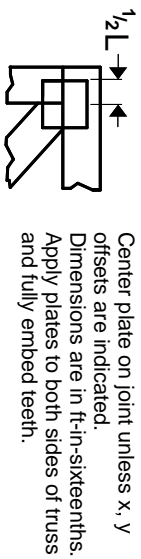

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

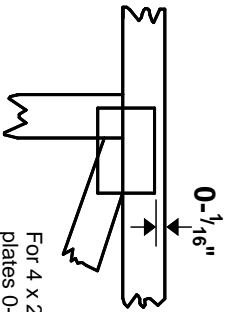

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



1 TOP CHORDS
2 Joint ID
3 typ.

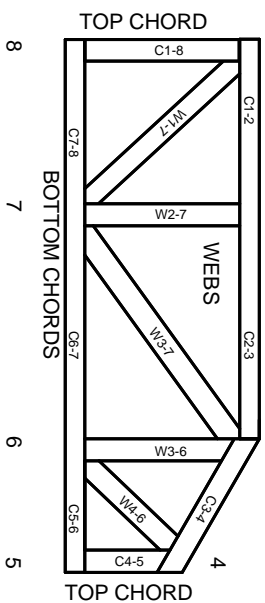

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023