NC Registered Firm # F-1519	
ECS Southeast, LLC 6151 Raeford Road, Suite A Fayetteville, NC 28304 9104013288 9103230539	LETTER OF TRANSMITTAL
February 08, 2024	RE: Liberty Meadows Lot 65
Precision Custom Homes	ECS Job # 33:6442-U
Raeford, NC 28376 ATTN: Shaun Gardner	Permits: Location: 15 Rush Lane Cameron, NC 28326
<u>X</u> Field Reports	L For your use X As requested
CC: Precision Custom Homes - Allen Peterson	Precision Custom Homes - Lauren Ceruti
ENCL: Field Report # 1 2/6/2024	Aaron Kyle Adair
Jack Cowsert, P.E.	CMT Senior Project Coordinator
Office Manager	

Disclaimer

^{1.} This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

^{2.} The information in this report relates only to the activities performed on the report date.

^{3.} Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

^{4.} Incomplete or non-conforming work will be reported for future resolution.


^{5.} The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.

ECs	ECS Southeast, LLC 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone]		FIELD REPORT			
Project	(910) 323-0539 [Fax]		Project No. Report No. Day & Date Weather	33:6442-U 1 Tuesday 2/6/2 53 °/ Sunny	2024	
Location	Cameron, NC		On-Site Time	1.50		
Client Contractor	Precision Custom Homes Precision Custom Homes		Lab Time Travel Time* Total	0.00 <u>0.00</u> 1.50		
			Re Obs Time	0.00		
Remarks						
Trip Charges*	Tolls/Parking*	Mileage*	Time of	Arrival	Departure	
Chargeable Ite	ems			12:15P	1:45P	

An ECS representative arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method (ASTM STP-299) for monolithic slab foundation. The footings have not been excavated. Please see the attached sketch for location details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity of 2,000 psf.

ECS will return, as requested, to perform additional services.

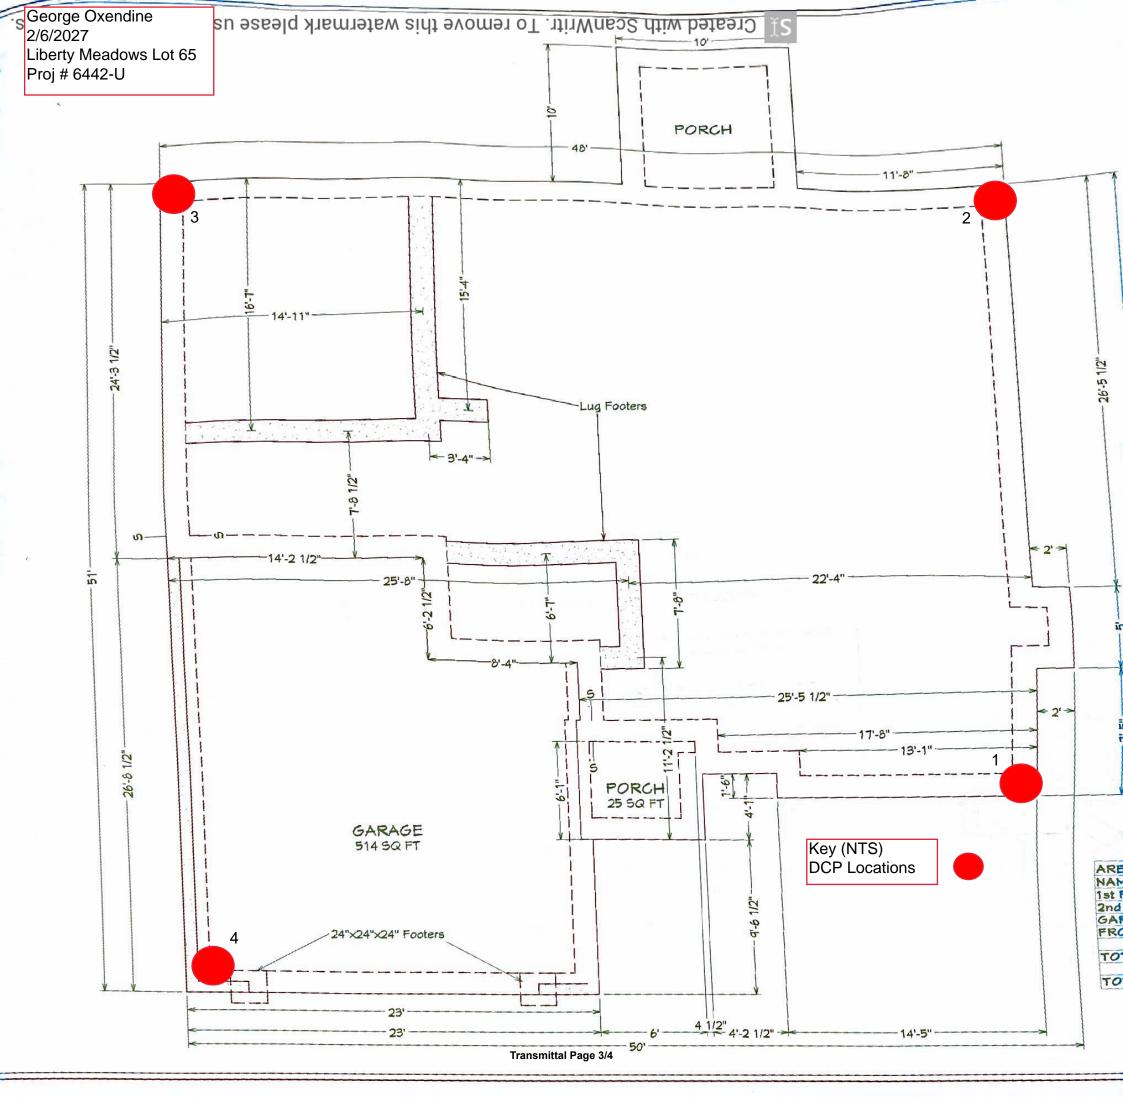



Report of Spread Footing - Foundation Observations

Project: Liberty Meadows Lot 65

Location: 15 Rush Lane

Cameron - Moore - NC - 28326

Contractor: Precision Custom Homes

Project No.: 33:6442-U

Day/Date: 2/6/2024

Footing Number	Location	Size (W x H x L)		Footing Bottom Elevation			Descriptions	Required Blow Counts	Desim
		Design	Actual	Design **	Depth of Undercut (in)	Description of Steel Placed	Description of Subgrade Material	# of Blows / Increment	Design Bearing Pressure
1 S.E. Corner							(0)/-1 Orange Clay Sand(-2)/-	6	
	XX XX N	N/A N/A	:	3 Orange Clay	(0)9,11,10(-1)8,8,8(-2) 17,18,20(-3)11,13,17	2000			
		er x x x N/A N/A Clay Sand Gray clay			(0)/-1 Orange	6			
2	N.E. Corner		Grav clay Sand	(0)5,8,8(-1)10,8,12(-2) 20,22,20(-3)13,11,15	2000				
3 N.W. Co		W. Corner x x x X/A				(0)/-1 Orange Clay Sand(-2)/-	6		
	N.W. Corner		N/A	N/A	35Gray clay	(0)13,15,15(-1)11,19,19 (-2)6,8,9(-3)9,8,9	2000		
4	S.W. Corner	хх	хх	N/A	N/A		(0)/-1 Orange Clay Sand(-2)/- 3Gray Tan Sand	6 (0)11,12,15(-1)9,11,11(- 2)7,8,7(-3)8,9,9	2000

** SGE: Subgrade Elevation to be determined by surveyor.

By: George Pate Oxendine Jr.

ECS Southeast, LLC

WO: 76242