

Harnett County Department of Public Health

PERMIT # SFD 2401-0071

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 161 Golden Leaf Farms Rd Angier

SUBDIVISION Tobacco Road LOT # 76

Name: (owner) Drees Homes

System Installer: Full Circle

Basement with plumbing: Garage Number of Bedrooms 4


Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: 25% Reduction System Type III (G) EZ Flow Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

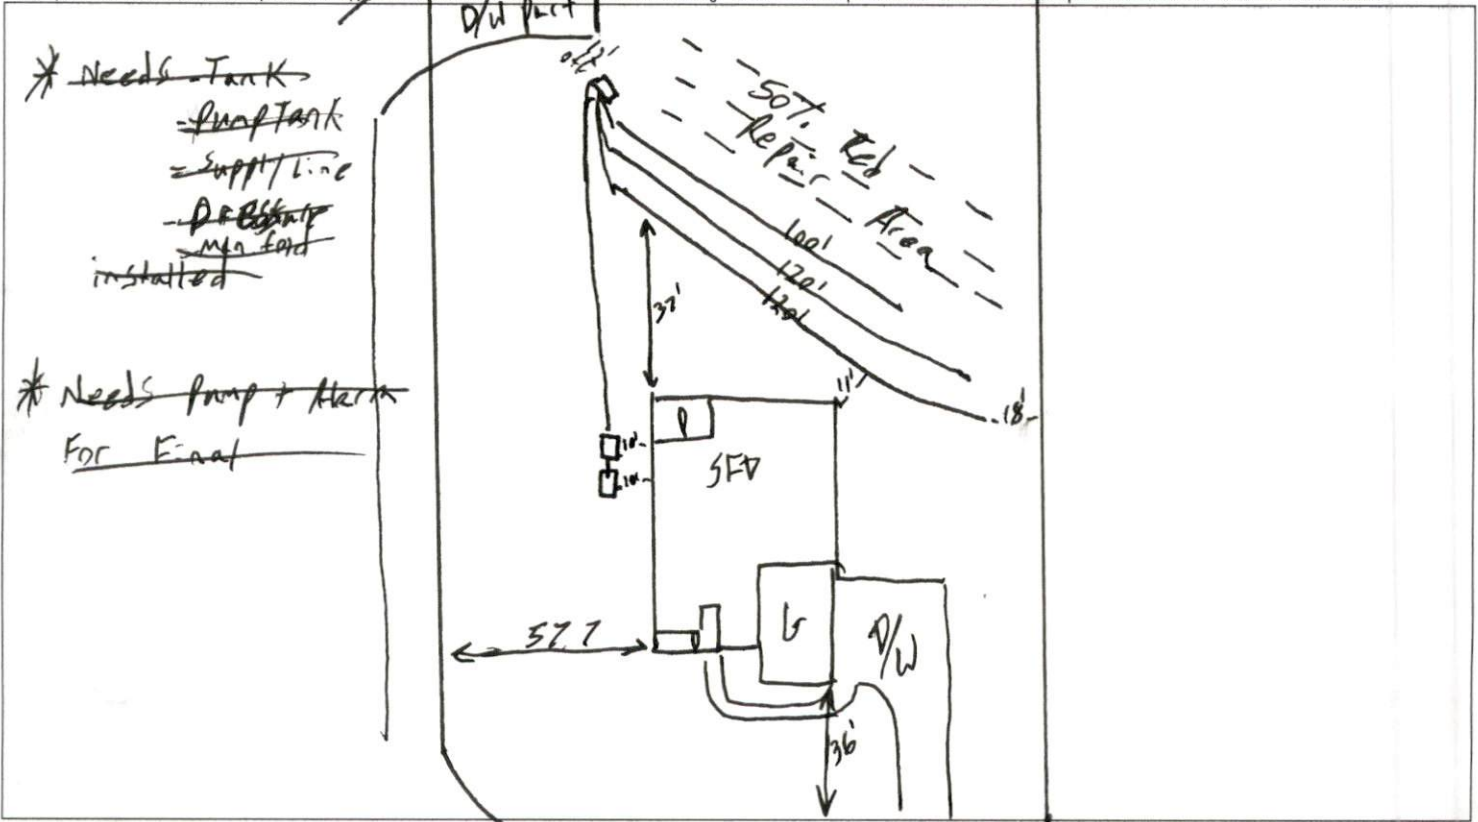

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% Reduction Type III (G) EZ Flow
 Subsurface No. of exact length of each ditch 1 340' feet
 Drainage Field ditches _____ of each ditch _____ feet
 French Drain Required: _____ Linear feet
 Septic Tank: 1,000 gallons width of ditches 3' feet
 Pump Tank: 1,000 gallons depth of ditches 21'' inches

Authorized State Agent [Signature] Date 5-30-24