



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature Bob Lewis
Bob Lewis


LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1) PLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

CITY / CO.	BROADWAY / HARNETT
ADDRESS	740 MCLEOD RD
MODEL	FLOOR NI-40 JOISTS
DATE REV.	03/29/24
DRAWN BY	Bob Lewis
SALES REP.	Bob Lewis

BUILDER	AMERICA'S HOME PLACE
JOB NAME	MEZA 14124001
PLAN	WYNFIELD
SEAL DATE	3.8.24
QUOTE #	Quote #
JOB #	J0324-1579

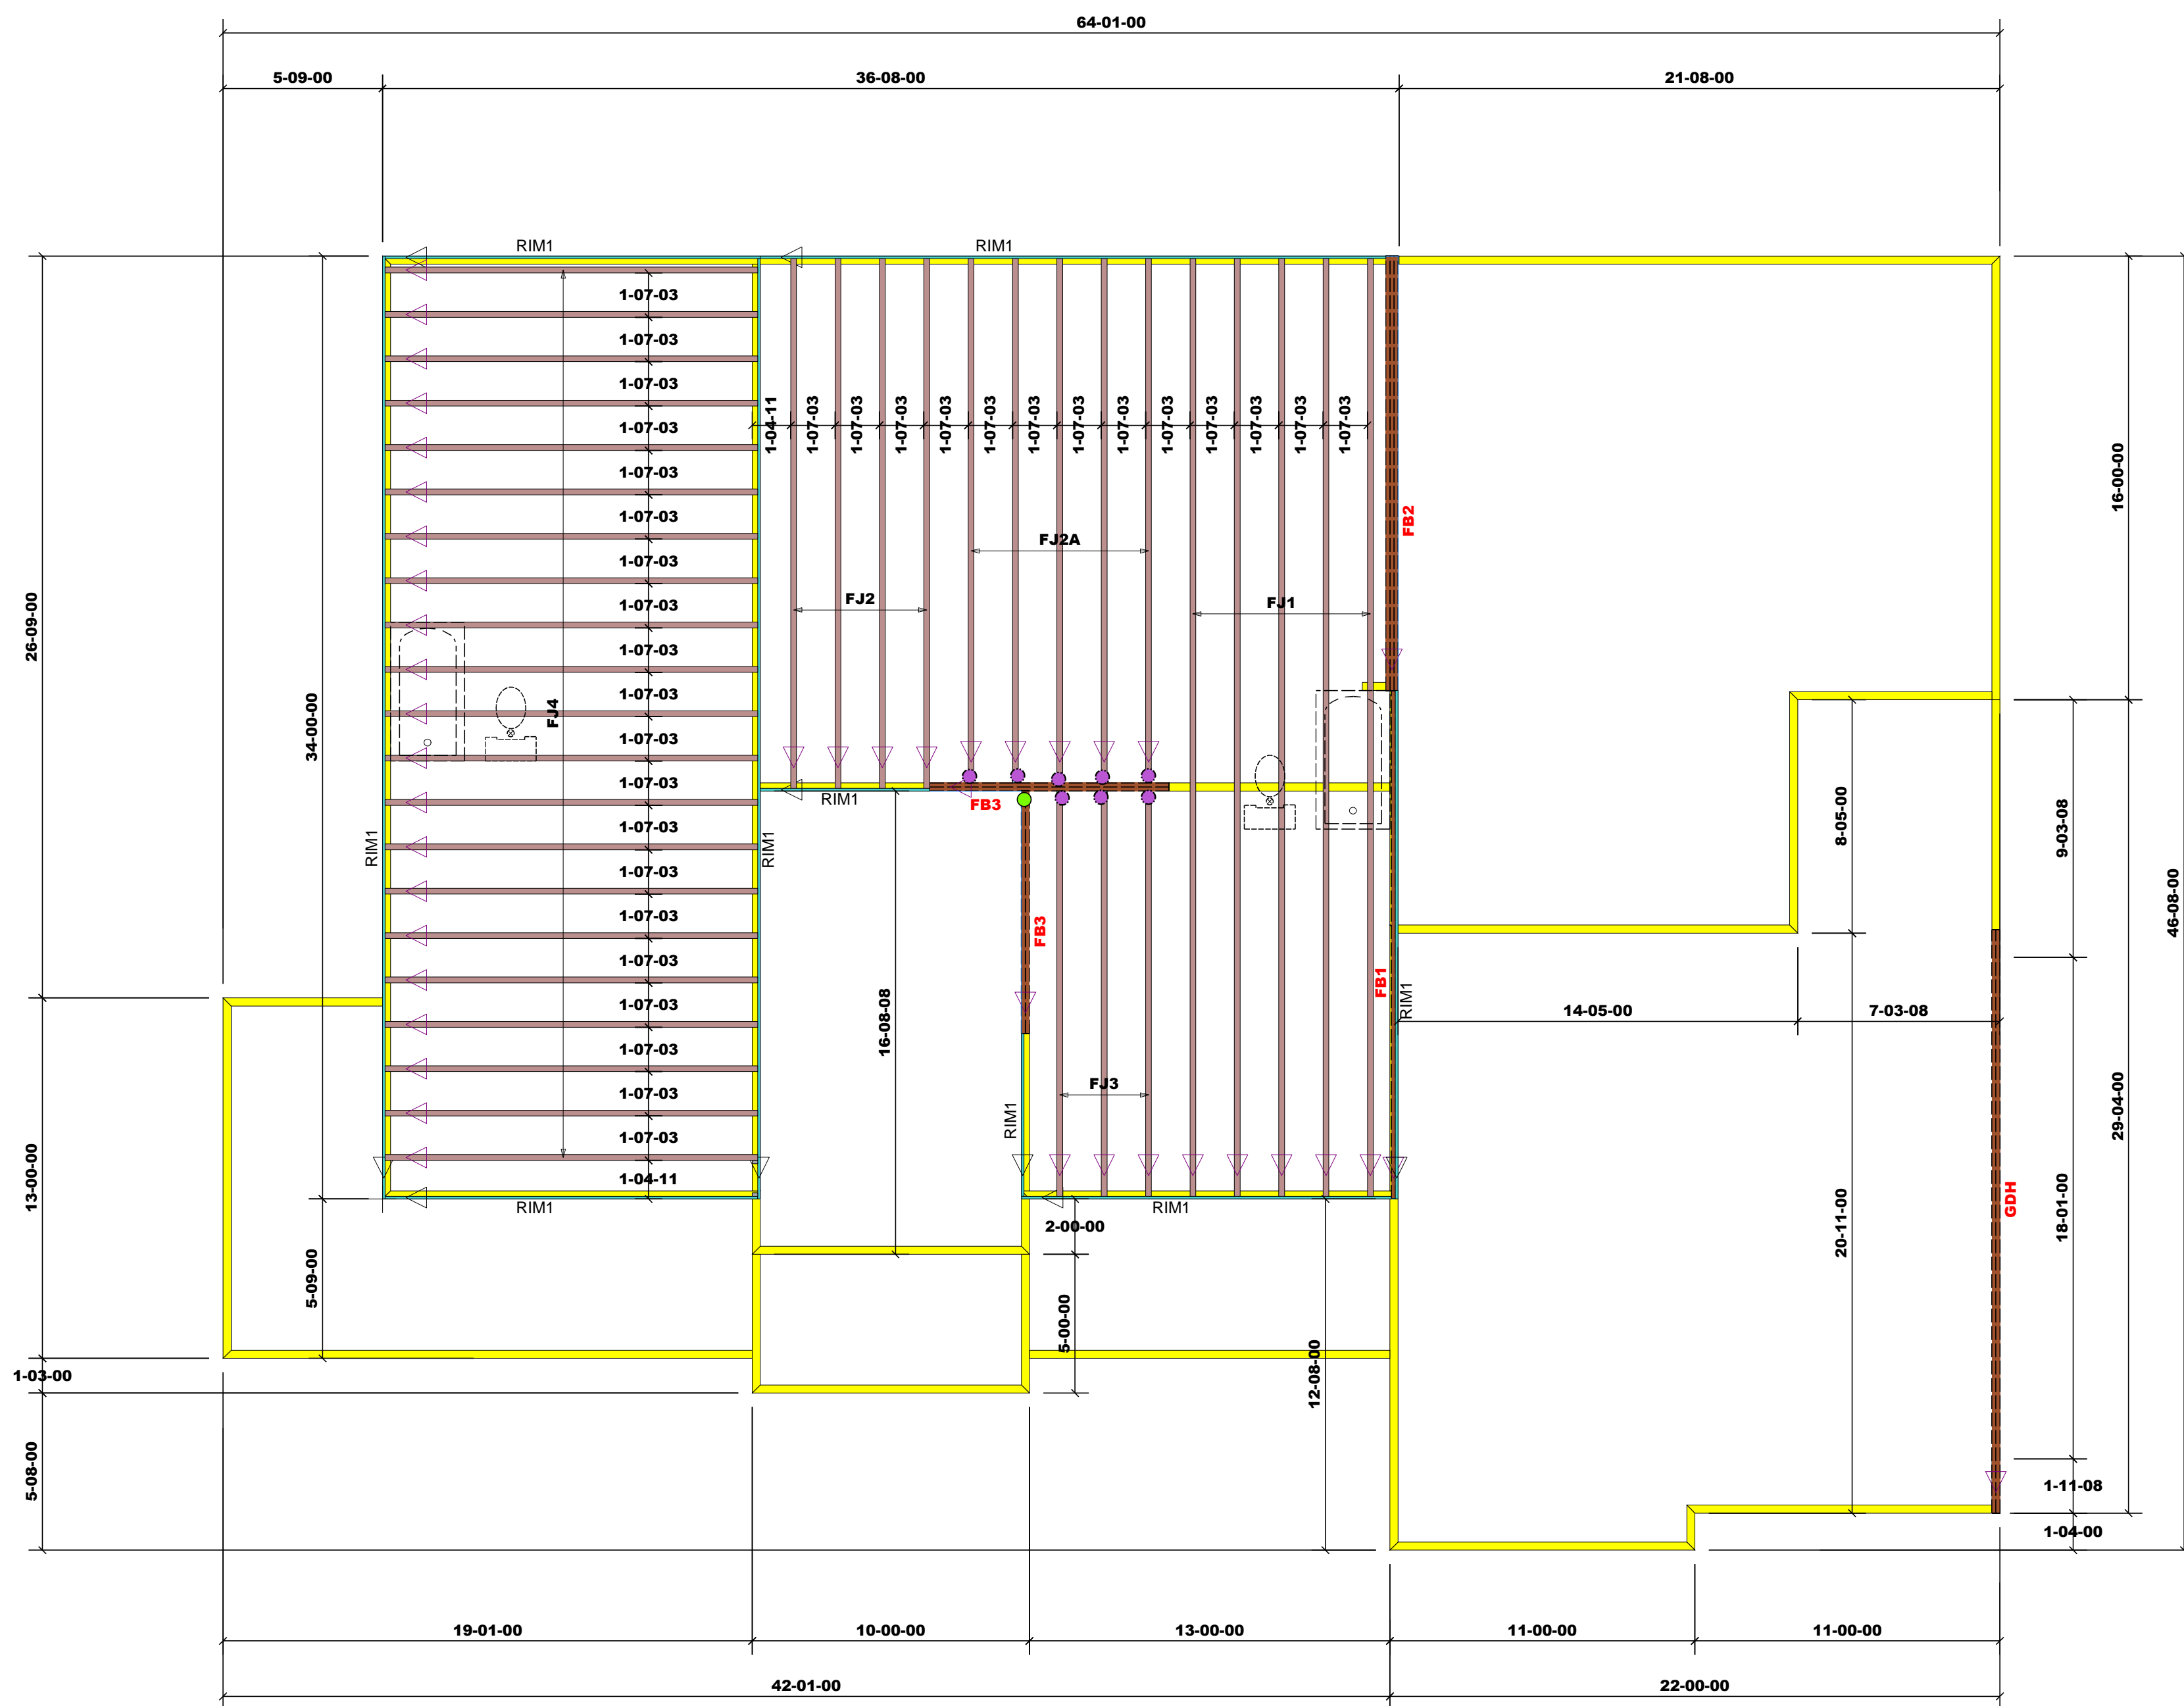

Roof Area = 3605.36 sq.ft.
 Ridge Line = 89.11 ft.
 Hip Line = 92.71 ft.
 Horiz. OH = 216.58 ft.
 Raked OH = 158.54 ft.
 Decking = 124 sheets

	IHF25112	USP	8	NA	10d/3"	10d/3"
--	----------	-----	---	----	--------	--------

LVL BEAMS BY OTHERS

PlotID	Length	Product	Plies	Net Qty	Fab Type
FB1	19-00-00	1.75 X 11.875 Kerto-S LVL 2.0E	1	1	FF
FB2	16-00-00	1.75 X 11.875 Kerto-S LVL 2.0E	3	3	FF
FB3	9-00-00	1.75 X 11.875 Kerto-S LVL 2.0E	2	4	FF
GDH	22-00-00	1.75 X 18 Kerto-S LVL 2.0E	2	2	FF

P.E.T. NI-40 JOISTS

PlotID	Length	Product	Plies	Net Qty	Fab Type
FJ1	33-09-12	11 7/8" NI-40x	1	5	MFD
FJ2	19-01-04	11 7/8" NI-40x	1	4	MFD
FJ2A	18-10-14	11 7/8" NI-40x	1	5	MFD
FJ3	14-07-06	11 7/8" NI-40x	1	3	MFD
FJ4	13-05-04	11 7/8" NI-40x	1	21	MFD

RIMBOARD

PlotID	Length	Product	Plies	Net Qty	Fab Type
RIM1	12-00-00	1 1/8" x 11 7/8" Rim Board	1	15	FF

Truss Placement Plan
SCALE: NTS

= Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com