

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0124-0289
Weaver Homes/Lot 10 West Pointe III

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I63721969 thru I63721999

My license renewal date for the state of North Carolina is December 31, 2024.

North Carolina COA: C-0844



February 20, 2024

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

| | | | | | |
|-------------------|-------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss A2 | Truss Type COMMON | Qty 5 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721970 |
|-------------------|-------------|----------------------|----------|----------|--|



Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:47 2024 Page 1

ID:BoL?hgXglYpwwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:59.5

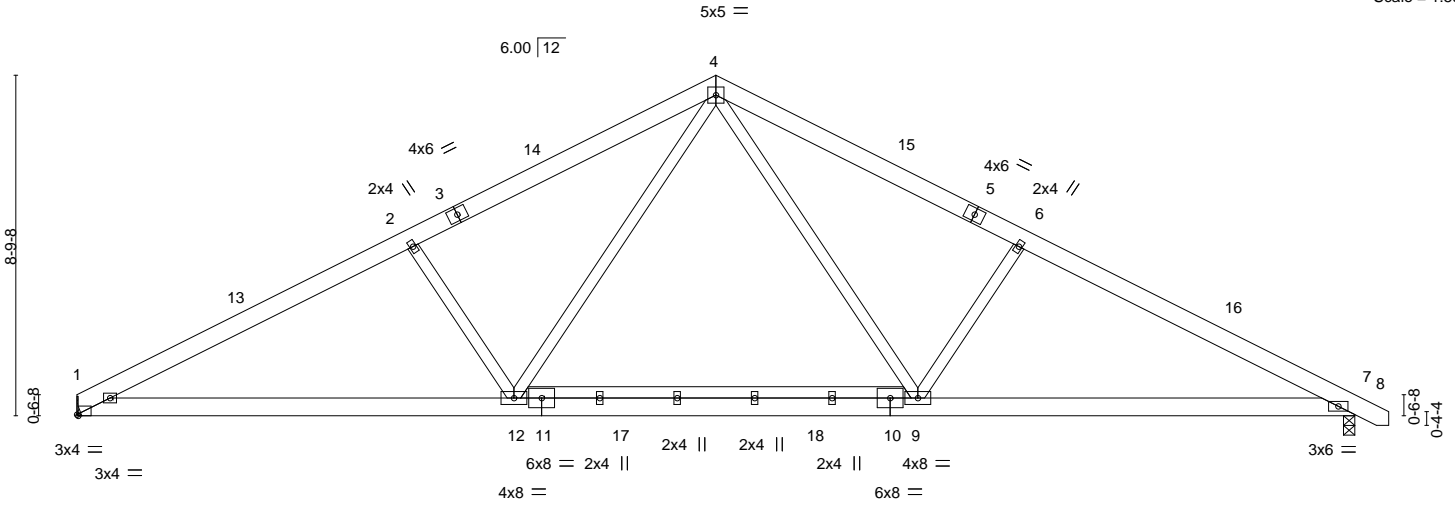


| | | | | | | |
|--------------------------------------|----------------------|-------|-------------|--------------|------------|-------------------------|
| Plate Offsets (X,Y)-- [1:0-0-6,Edge] | | | | | | |
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl L/d |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.33 | Vert(LL) | -0.21 9-12 | >999 360 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.49 | Vert(CT) | -0.28 9-12 | >999 240 |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.24 | Horz(CT) | 0.05 7 | n/a n/a |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.05 1-12 | >999 240 |
| | | | | | | Weight: 223 lb FT = 20% |

| | | | |
|----------------|-------------|-----------------|---|
| LUMBER- | | BRACING- | |
| TOP CHORD | 2x6 SP No.1 | TOP CHORD | Structural wood sheathing directly applied or 4-8-4 oc purlins. |
| BOT CHORD | 2x6 SP No.1 | BOT CHORD | Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS | 2x4 SP No.2 | | |

REACTIONS. (size) 1=Mechanical, 7=0-3-8
 Max Horz 1=-113(LC 8)
 Max Uplift 1=-79(LC 12), 7=-91(LC 13)
 Max Grav 1=1311(LC 1), 7=1364(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-2297/531, 2-4=-2064/545, 4-6=-2055/529, 6-7=-2283/512
 BOT CHORD 1-12=-347/2015, 9-12=-110/1324, 7-9=-344/1965
 WEBS 4-9=-142/850, 6-9=-495/297, 4-12=-145/865, 2-12=-509/305

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-12 to 4-5-9, Interior(1) 4-5-9 to 16-6-0, Exterior(2) 16-6-0 to 20-10-13, Interior(1) 20-10-13 to 33-8-10 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7.

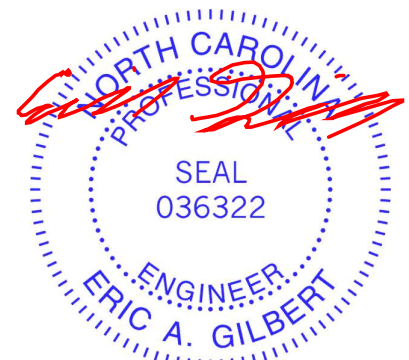

February 20, 2024

| | |
|--|---|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MITEK Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|---|


| | | | | | |
|-------------------|-------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss A3 | Truss Type COMMON | Qty 2 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721971 |
|-------------------|-------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:48 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Job Reference (optional)

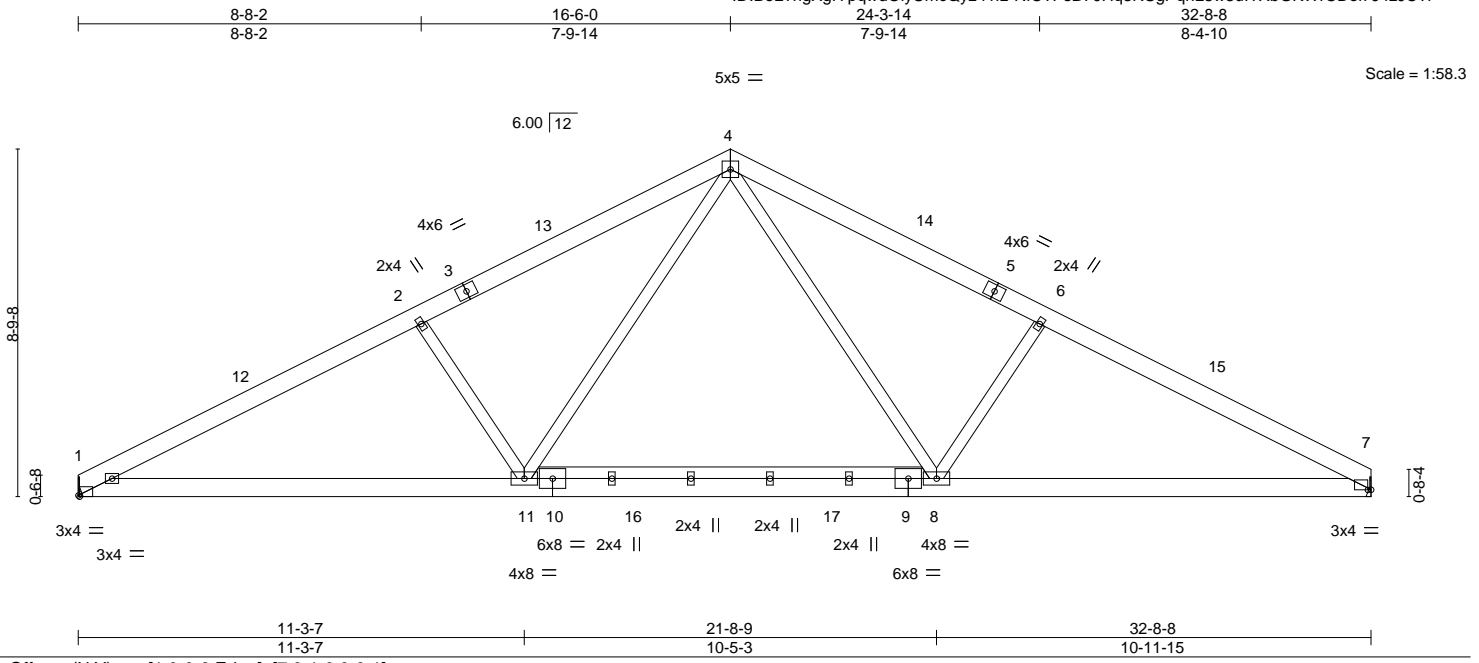

| | | | | | |
|---|-----------------------|-------------|----------------------------------|----------------|-------------|
| Plate Offsets (X,Y)-- [1:0-0-6,Edge], [7:0-1-0,0-0-1] | | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.33 | Vert(LL) -0.20 8-11 >999 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.48 | Vert(CT) -0.28 8-11 >999 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.24 | Horz(CT) 0.05 7 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | Wind(LL) 0.05 1-11 >999 240 | Weight: 220 lb | FT = 20% |


| | |
|-----------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-8-9 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.2 | |

REACTIONS. (size) 1=Mechanical, 7=Mechanical
 Max Horz 1=-108(LC 8)
 Max Uplift 1=-79(LC 12), 7=-78(LC 13)
 Max Grav 1=1303(LC 1), 7=1303(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-2280/528, 2-4=-2048/543, 4-6=-2021/538, 6-7=-2242/521
 BOT CHORD 1-11=-354/1997, 8-11=-116/1306, 7-8=-347/1920
 WEBS 4-8=-139/822, 6-8=-473/295, 4-11=-145/866, 2-11=-509/305

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-12 to 4-5-9, Interior(1) 4-5-9 to 16-6-0, Exterior(2) 16-6-0 to 20-10-13, Interior(1) 20-10-13 to 32-7-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7.

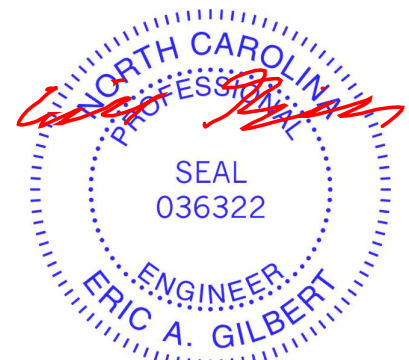

February 20, 2024

| | |
|--|---|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MITEK Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|---|


| | | | | | |
|-------------------|-------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss A4 | Truss Type COMMON | Qty 4 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721972 |
|-------------------|-------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:50 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)

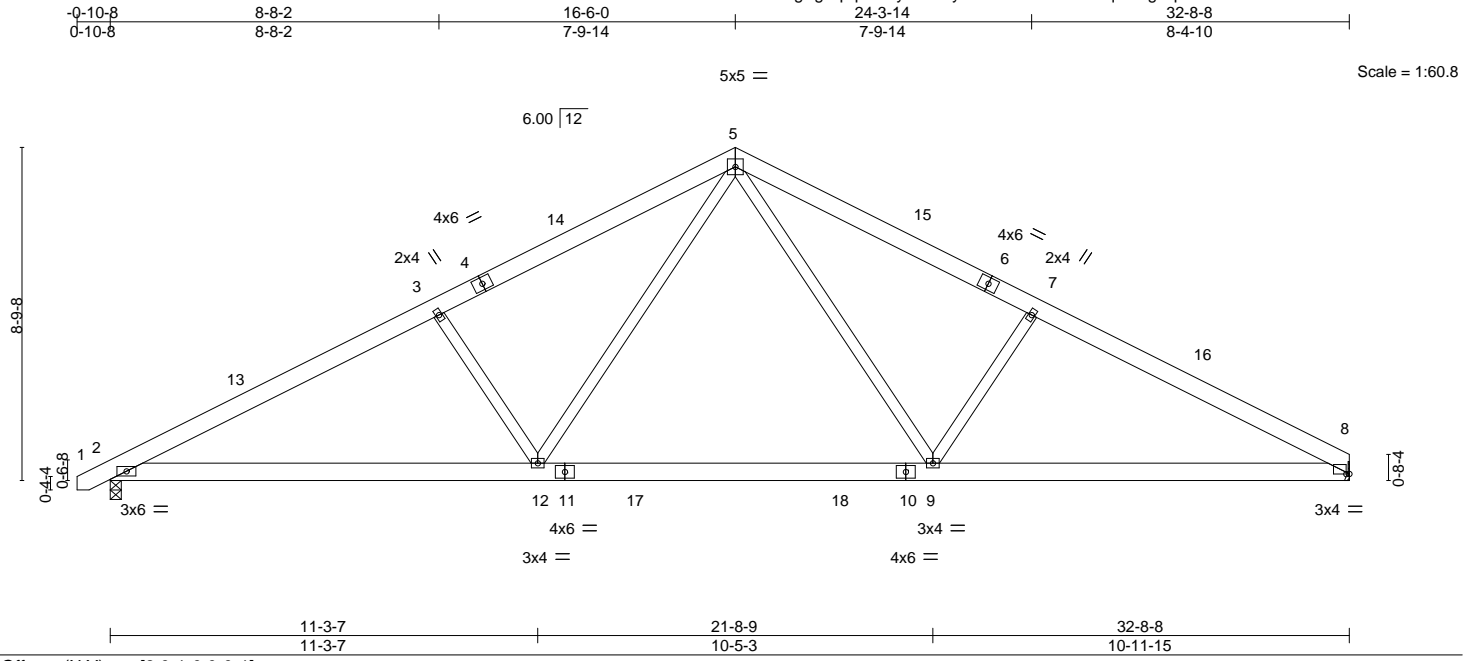

| | | | | | |
|-----------------------|-----------------------|-------------|----------------------------------|----------------|-------------|
| Plate Offsets (X,Y)-- | [8:0-1-0,0-0-1] | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.31 | Vert(LL) -0.22 9-12 >999 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.49 | Vert(CT) -0.29 9-12 >999 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.23 | Horz(CT) 0.05 8 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | Wind(LL) 0.05 2-12 >999 240 | Weight: 207 lb | FT = 20% |

| | |
|-----------------------|--|
| LUMBER- | BRACING- |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 4-9-10 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.2 | |


REACTIONS. (size) 2=0-3-8, 8=Mechanical
 Max Horz 2=113(LC 9)
 Max Uplift 2=91(LC 12), 8=78(LC 13)
 Max Grav 2=1352(LC 1), 8=1299(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2261/507, 3-5=-2051/524, 5-7=-2034/536, 7-8=-2238/519
 BOT CHORD 2-12=-347/1992, 9-12=-113/1312, 8-9=-341/1925
 WEBS 5-9=-137/833, 7-9=-473/294, 5-12=-141/861, 3-12=-495/297

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 16-6-0, Exterior(2) 16-6-0 to 20-10-13, Interior(1) 20-10-13 to 32-7-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.



February 20, 2024

| | |
|--|--|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p>  <p>A MITEK Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|--|

| | | | | | | |
|------------|-------|----------------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721974 |
| J0124-0289 | B1 | COMMON SUPPORTED GAB | 1 | 1 | Job Reference (optional) | |

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:52 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



5x5 =

Scale = 1:39.3

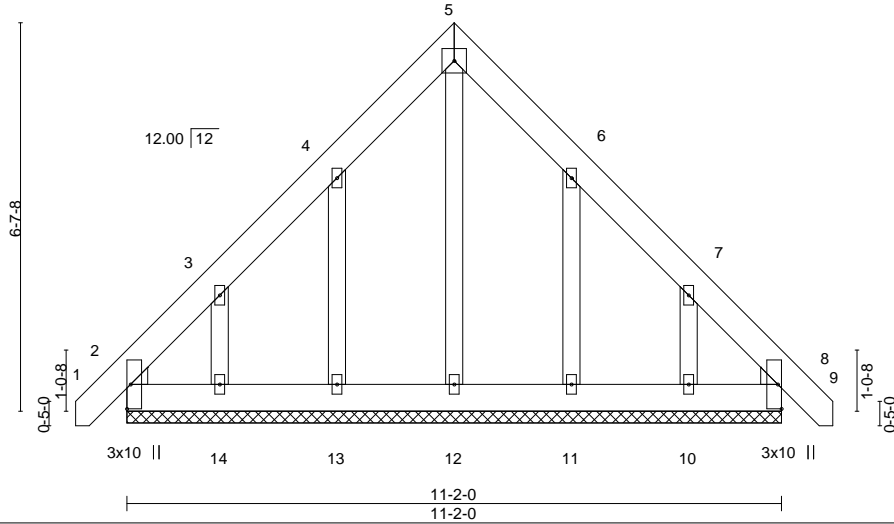

| | | | | | | | | | |
|----------------------|----------------------|-------|-------------|--------------|----------|--------|-----|---------------|-------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.03 | Vert(LL) | -0.00 | 8 | n/r | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.02 | Vert(CT) | -0.00 | 8 | n/r | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.06 | Horz(CT) | 0.00 | 8 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | | | | | Weight: 95 lb | FT = 20% |


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 11-2-0.
 (lb) - Max Horz 2=190(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 8 except 13=130(LC 12), 14=189(LC 12), 11=127(LC 13), 10=185(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-9-2 to 3-6-13, Exterior(2) 3-6-13 to 5-7-0, Corner(3) 5-7-0 to 9-11-13, Exterior(2) 9-11-13 to 11-11-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8 except (jt=lb) 13=130, 14=189, 11=127, 10=185.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

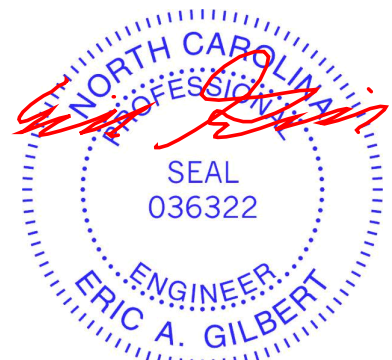

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




| | | | | | |
|-------------------|-------------|-----------------------------|----------|----------|--|
| Job J0124-0289 | Truss B2 | Truss Type COMMON GIRDER | Qty 1 | Ply 2 | Weaver Homes/Lot 10 West Pointe III 163721975 |
|-------------------|-------------|-----------------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:54 2024 Page 1

ID:BoL?hgXglYppwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

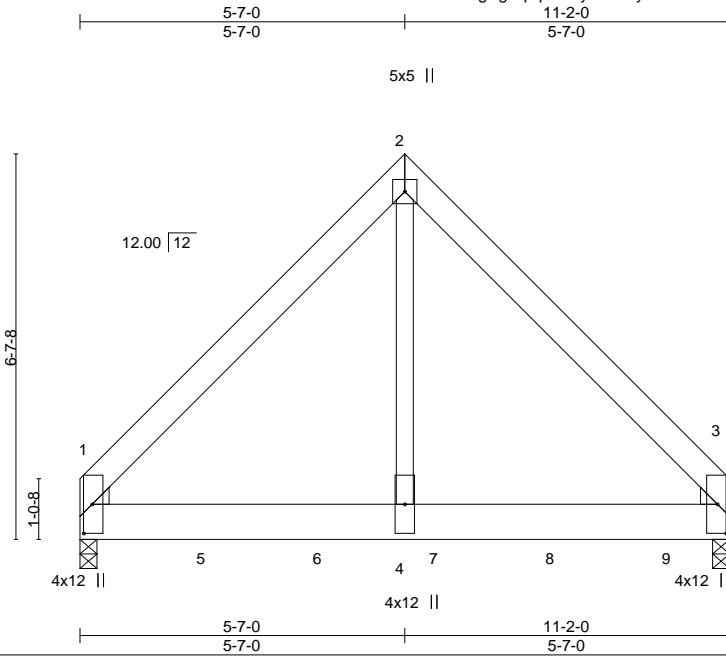

Scale = 1:39.6

| | | | | | |
|-----------------------|------------------------------------|-------------|----------------------------------|----------------|-------------|
| Plate Offsets (X,Y)-- | [1:0-6-0,0-1-12], [3:0-6-0,0-1-12] | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.40 | Vert(LL) -0.03 3-4 >999 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.60 | Vert(CT) -0.06 3-4 >999 240 | | |
| BCLL 0.0 * | Rep Stress Incr NO | WB 0.52 | Horz(CT) 0.01 3 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | Wind(LL) 0.02 3-4 >999 240 | Weight: 165 lb | FT = 20% |

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x8 SP No.1
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2 , Right: 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 3=0-3-8
Max Horz 1=-144(LC 23)
Max Uplift 1=-301(LC 9), 3=-265(LC 8)
Max Grav 1=4586(LC 1), 3=3979(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-3212/267, 2-3=-3207/266
BOT CHORD 1-4=-137/2118, 3-4=-137/2118
WEBS 2-4=-239/4237

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-6-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=301, 3=265.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1293 lb down and 88 lb up at 0-1-12, 1283 lb down and 98 lb up at 2-2-0, 1279 lb down and 98 lb up at 4-2-0, 1279 lb down and 98 lb up at 6-2-0, and 1279 lb down and 98 lb up at 8-2-0, and 1281 lb down and 96 lb up at 10-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

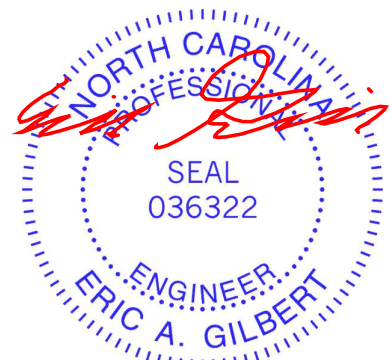

February 20,2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

| | | | | | |
|-------------------|-------------|-----------------------------|----------|-----------------|--|
| Job J0124-0289 | Truss B2 | Truss Type COMMON GIRDER | Qty 1 | Ply 2 | Weaver Homes/Lot 10 West Pointe III I63721975 Job Reference (optional) |
|-------------------|-------------|-----------------------------|----------|-----------------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:54 2024 Page 2
ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-2=-60, 2-3=-60, 1-3=-20

Concentrated Loads (lb)

Vert: 1=-1293(F) 5=-1283(F) 6=-1279(F) 7=-1279(F) 8=-1279(F) 9=-1281(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721977 |
| J0124-0289 | C2 | COMMON | 3 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:56 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:27.6

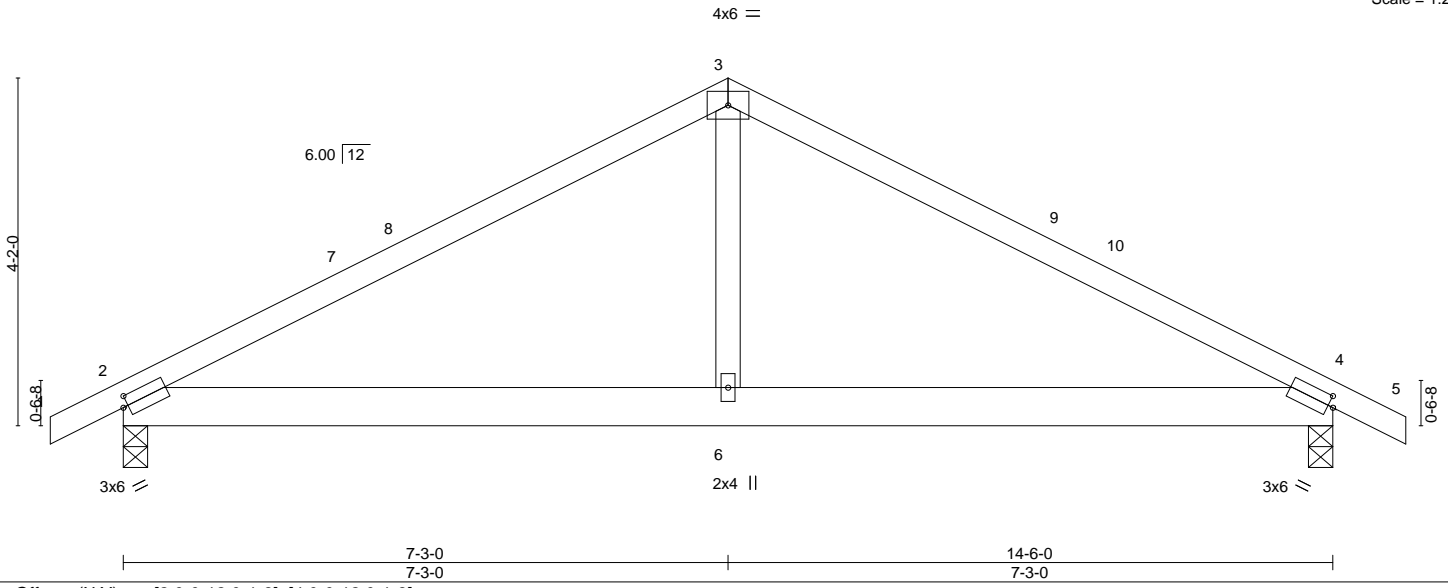

| | |
|-----------------------|------------------------------------|
| Plate Offsets (X,Y)-- | [2:0-0-12,0-1-8], [4:0-0-12,0-1-8] |
|-----------------------|------------------------------------|

| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
|---------------|----------------------|----------|-----------------------------|---------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.44 | in (loc) l/defl L/d | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.24 | Vert(LL) -0.02 2-6 >999 360 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.08 | Vert(CT) -0.05 2-6 >999 240 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Horz(CT) 0.01 4 n/a n/a | | |
| | Code IRC2015/TPI2014 | | Wind(LL) 0.02 2-6 >999 240 | Weight: 66 lb | FT = 20% |

| LUMBER- | BRACING- |
|-----------------------|---|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.2 | |

REACTIONS. (size) 2=0-3-8, 4=0-3-8
 Max Horz 2=-53(LC 10)
 Max Uplift 2=-48(LC 12), 4=-48(LC 13)
 Max Grav 2=630(LC 1), 4=630(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-803/237, 3-4=-803/237
 BOT CHORD 2-6=-75/617, 4-6=-75/617
 WEBS 3-6=0/366

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 7-3-0, Exterior(2) 7-3-0 to 11-7-13, Interior(1) 11-7-13 to 15-4-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.




February 20,2024

| | | | | | | |
|-------------------|-------------|-----------------------------|----------|----------|---|-----------|
| Job J0124-0289 | Truss C3 | Truss Type COMMON GIRDER | Qty 1 | Ply 2 | Weaver Homes/Lot 10 West Pointe III Job Reference (optional) | 163721978 |
|-------------------|-------------|-----------------------------|----------|----------|---|-----------|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:57 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

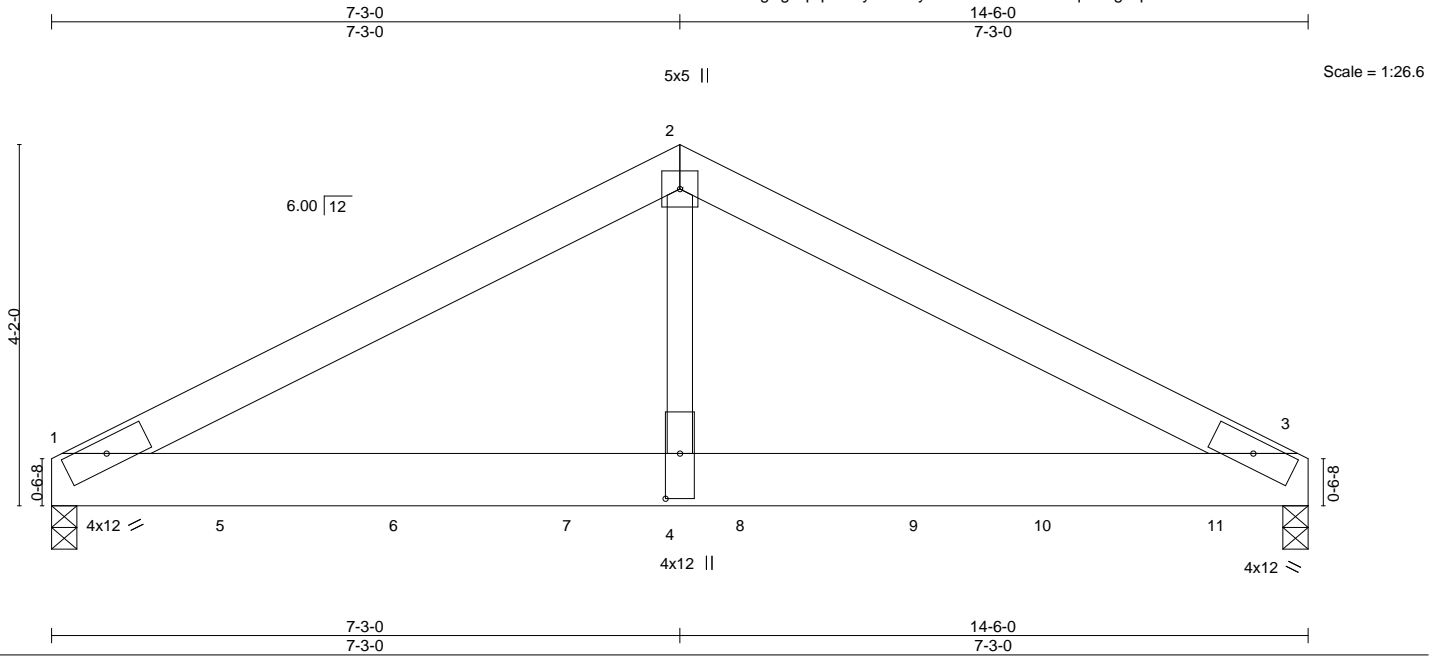

| | | | | | | | | | |
|------------------------|----------------------|-------|-------------|--------------|----------|--------|------|----------------|-------------|
| Plate Offsets (X, Y)-- | [4:0-6-4,0-2-0] | | | | | | | | |
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.36 | Vert(LL) | -0.08 | 3-4 | >999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.61 | Vert(CT) | -0.16 | 3-4 | >999 | | |
| BCLL 0.0 * | Rep Stress Incr | NO | WB 0.72 | Horz(CT) | 0.02 | 3 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.06 | 3-4 | >999 | | |
| | | | | | | | | Weight: 173 lb | FT = 20% |


| | |
|-----------------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x6 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-10-10 oc purlins. |
| BOT CHORD 2x8 SP 2400F 2.0E | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.2 | |

REACTIONS. (size) 1=0-3-8, 3=0-3-8
 Max Horz 1=-47(LC 25)
 Max Uplift 1=-324(LC 8), 3=-382(LC 9)
 Max Grav 1=4670(LC 1), 3=5490(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-7127/503, 2-3=-7121/502
 BOT CHORD 1-4=-396/6308, 3-4=-396/6308
 WEBS 2-4=-316/5855

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-7-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=324, 3=382.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1291 lb down and 99 lb up at 2-0-12, 1291 lb down and 99 lb up at 4-0-12, 1291 lb down and 99 lb up at 6-0-12, 1291 lb down and 99 lb up at 8-0-12, 1291 lb down and 99 lb up at 10-0-12, and 1283 lb down and 99 lb up at 11-6-0, and 1285 lb down and 98 lb up at 13-6-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-3=-60, 1-3=-20

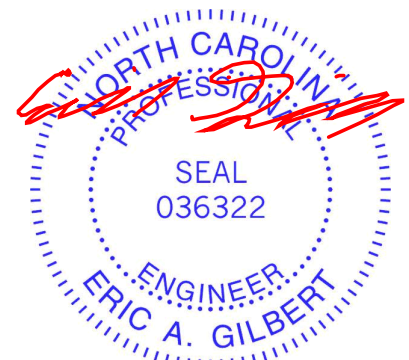

Continued on page 2

| | |
|--|---|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY TRENCO A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|---|

| | | | | | |
|-------------------|-------------|-----------------------------|----------|-----------------|--|
| Job J0124-0289 | Truss C3 | Truss Type COMMON GIRDER | Qty 1 | Ply 2 | Weaver Homes/Lot 10 West Pointe III 163721978 Job Reference (optional) |
|-------------------|-------------|-----------------------------|----------|-----------------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:57 2024 Page 2
ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

Concentrated Loads (lb)

Vert: 5=-1291(B) 6=-1291(B) 7=-1291(B) 8=-1291(B) 9=-1291(B) 10=-1283(B) 11=-1285(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721979 |
| J0124-0289 | D1 | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:41:58 2024 Page 1

ID:BoL?hgXglYpawdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



8x8 ≡

Scale = 1:45.0

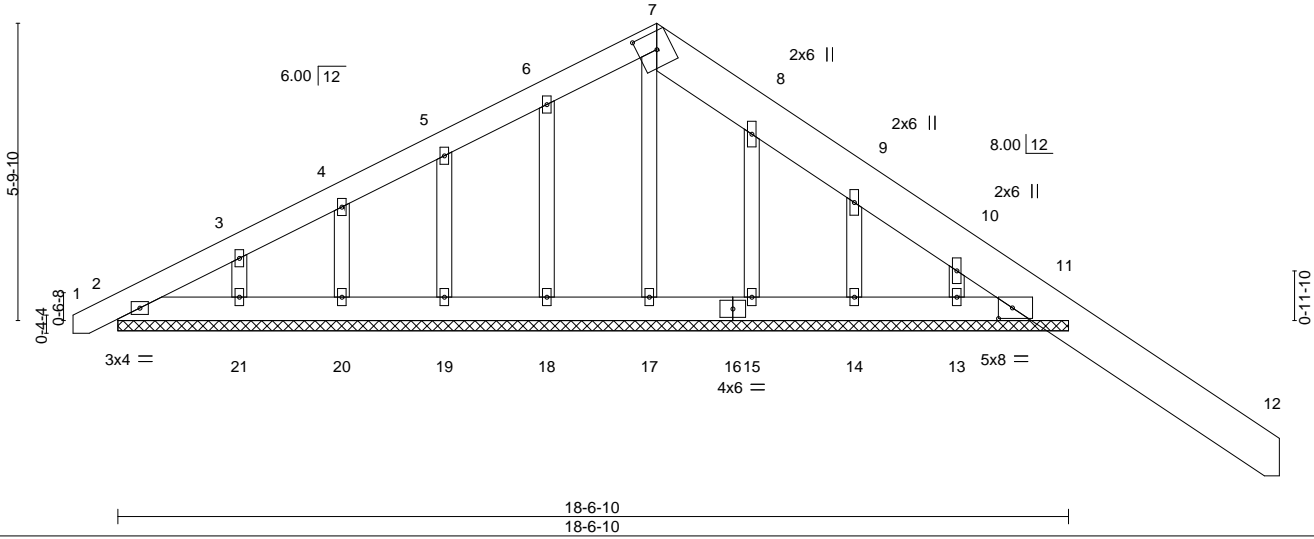

| | |
|-----------------------|-----------------------------------|
| Plate Offsets (X,Y)-- | [7:0-4-6,0-4-0], [11:0-3-4,0-2-8] |
|-----------------------|-----------------------------------|


| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|----------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.24 | Vert(LL) | -0.03 | 12 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.09 | Vert(CT) | -0.06 | 12 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.09 | Horz(CT) | 0.00 | 11 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | | | | | | | |
| | | | | | | | | | Weight: 160 lb | FT = 20% |

| LUMBER- | BRACING- |
|--|---|
| TOP CHORD 2x6 SP No.1 *Except* 7-12: 2x10 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: |
| OTHERS 2x4 SP No.2 | 6-0-0 oc bracing: 11-13. |

REACTIONS. All bearings 18-6-10.
 (lb) - Max Horz 2--215(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 18, 19, 20, 21, 15 except 11--489(LC 13), 14--121(LC 13), 13--420(LC 1)
 Max Grav All reactions 250 lb or less at joint(s) 2, 17, 18, 19, 20, 21, 15, 14 except 11--877(LC 1), 13--311(LC 13)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 10-11--323/382
 WEBS 10-13--511/351

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 18, 19, 20, 21, 15 except (jt=lb) 11=489, 14=121, 13=420.

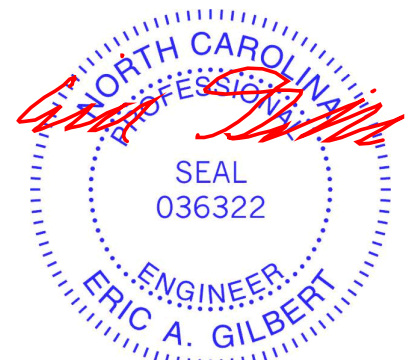

February 20, 2024

| | |
|--|---|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|---|

| | | | | | |
|-------------------|-------------|----------------------------|----------|----------|--|
| Job J0124-0289 | Truss D2 | Truss Type ROOF SPECIAL | Qty 6 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721980 |
|-------------------|-------------|----------------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:00 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:47.5


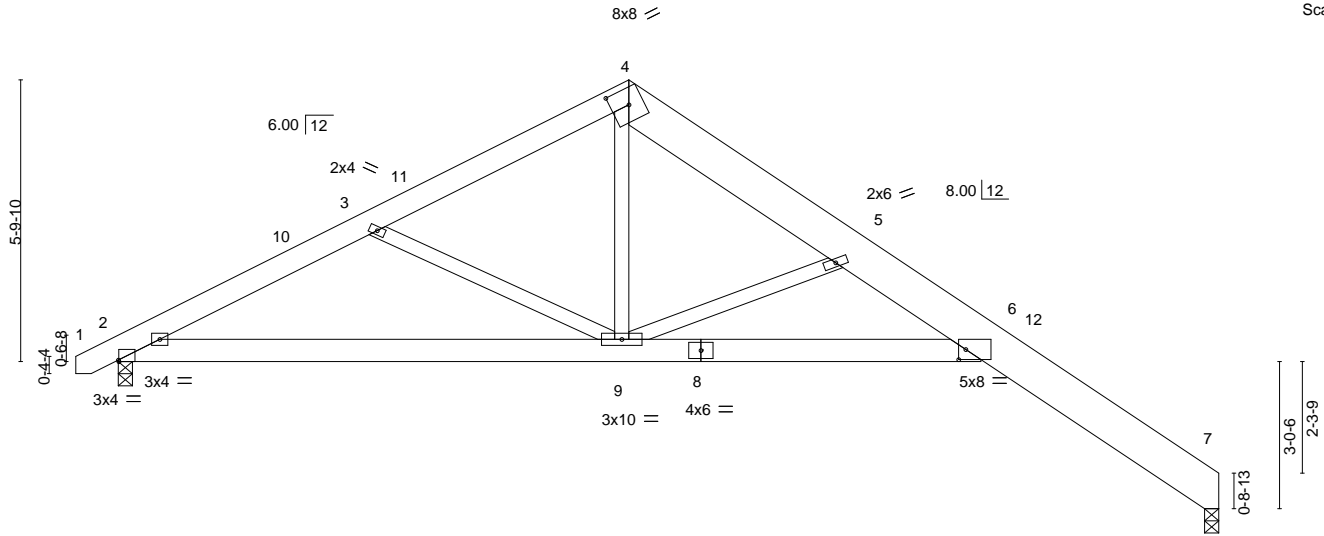


Plate Offsets (X, Y)-- [2:0-0-2,Edge], [4:0-4-6,0-4-0], [6:0-1-12,0-2-8]

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|------|----------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.50 | Vert(LL) | -0.20 | 6-9 | >999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.39 | Vert(CT) | -0.40 | 6-9 | >677 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.52 | Horz(CT) | 0.26 | 7 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.13 | 6 | >999 | | |
| | | | | | | | | Weight: 153 lb | FT = 20% |

| LUMBER- | BRACING- |
|--------------------------------|---|
| TOP CHORD 2x6 SP No.1 *Except* | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| 4-7: 2x10 SP 2400F 2.0E | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| BOT CHORD 2x6 SP No.1 | |
| WEBS 2x4 SP No.2 | |

REACTIONS. (size) 7=0-3-8, 2=0-3-8
 Max Horz 2=176(LC 11)
 Max Uplift 7=57(LC 13), 2=58(LC 12)
 Max Grav 7=909(LC 1), 2=949(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1528/386, 3-4=-1206/274, 4-5=-1286/301, 5-6=-2001/430, 6-7=-452/169
 BOT CHORD 2-9=-189/1315, 6-9=-273/2152
 WEBS 3-9=-349/230, 4-9=-109/874, 5-9=-1256/333

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 3-8-3, Interior(1) 3-8-3 to 10-6-3, Exterior(2) 10-6-3 to 15-1-11, Interior(1) 15-1-11 to 22-6-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2.



February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|-------------------|-------------|------------------------------------|----------|----------|---|-----------|
| Job J0124-0289 | Truss G1 | Truss Type COMMON SUPPORTED GAB | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III Job Reference (optional) | 163721981 |
|-------------------|-------------|------------------------------------|----------|----------|---|-----------|

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:01 2024 Page 1

ID:41DHdZG_ibjTUL8rQmgmdpz4zzJ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



4x4 =

Scale = 1:41.1

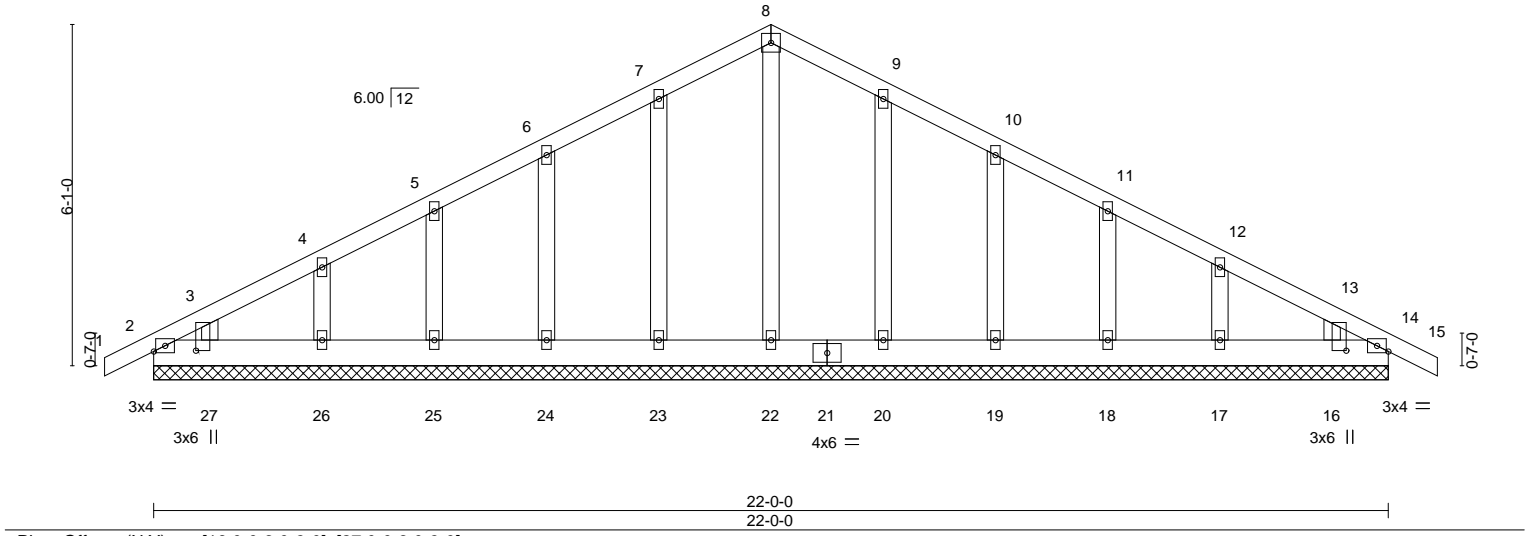

| | |
|-----------------------|------------------------------------|
| Plate Offsets (X,Y)-- | [16:0-0-3,0-9-0], [27:0-0-3,0-9-0] |
|-----------------------|------------------------------------|

| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
|---------------|----------------------|----------|---------------------------|----------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.04 | in (loc) l/defl L/d | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.02 | Vert(LL) -0.00 14 n/r 120 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.06 | Vert(CT) -0.00 15 n/r 120 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Horz(CT) 0.00 14 n/a n/a | | |
| | Code IRC2015/TPI2014 | | | Weight: 134 lb | FT = 20% |

| LUMBER- | BRACING- |
|-----------------------|---|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x6 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| OTHERS 2x4 SP No.2 | |

REACTIONS. All bearings 22-0-0.
 (lb) - Max Horz 2=120(LC 17)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 23, 24, 25, 26, 27, 20, 19, 18, 17, 16, 14
 Max Grav All reactions 250 lb or less at joint(s) 2, 22, 23, 24, 25, 26, 27, 20, 19, 18, 17, 16, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 23, 24, 25, 26, 27, 20, 19, 18, 17, 16, 14.




| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721982 |
| J0124-0289 | G2 | Common | 6 | 1 | | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:02 2024 Page 1

ID:41DHdZG_ibjTUL8rQmgmdpz4zzJ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:39.6

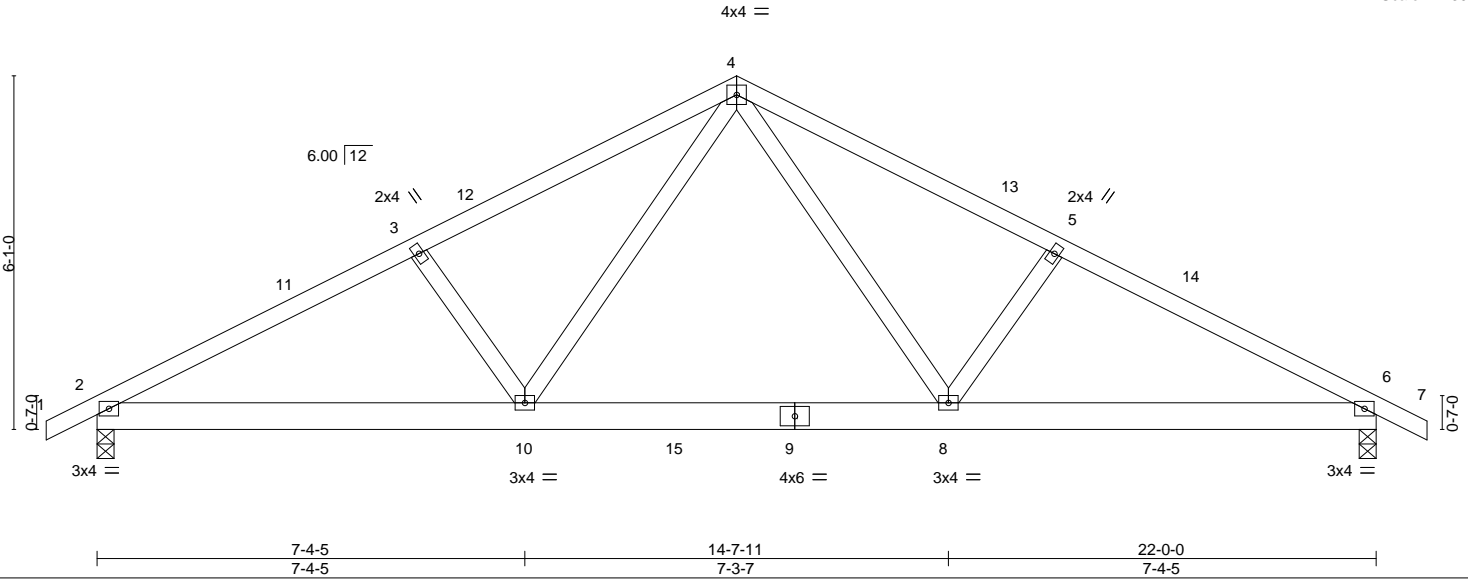

| | | | | | | | | | |
|----------------------|----------------------|-------|-------------|--------------|------------|--------|-----|----------------|-------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.28 | Vert(LL) | -0.05 8-10 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.24 | Vert(CT) | -0.10 8-10 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.12 | Horz(CT) | 0.02 6 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.03 8-10 | >999 | 240 | Weight: 120 lb | FT = 20% |


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 6=0-3-8
 Max Horz 2=-77(LC 10)
 Max Uplift 2=-66(LC 12), 6=-66(LC 13)
 Max Grav 2=930(LC 1), 6=930(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1464/353, 3-4=-1284/366, 4-5=-1284/366, 5-6=-1464/353
 BOT CHORD 2-10=-228/1223, 8-10=-70/829, 6-8=-236/1223
 WEBS 4-8=-98/488, 5-8=-284/207, 4-10=-98/489, 3-10=-284/207

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 11-0-0, Exterior(2) 11-0-0 to 15-4-13, Interior(1) 15-4-13 to 22-10-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.

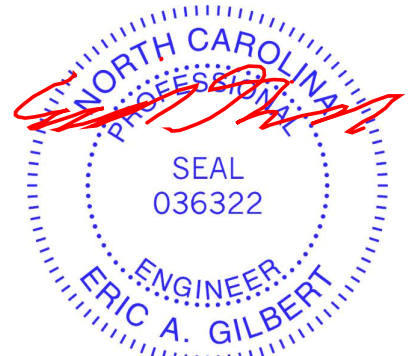

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|-------------------|-------------|---------------------|----------|----------|--|
| Job J0124-0289 | Truss M1 | Truss Type GABLE | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721983 |
|-------------------|-------------|---------------------|----------|----------|--|


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:03 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:17.0

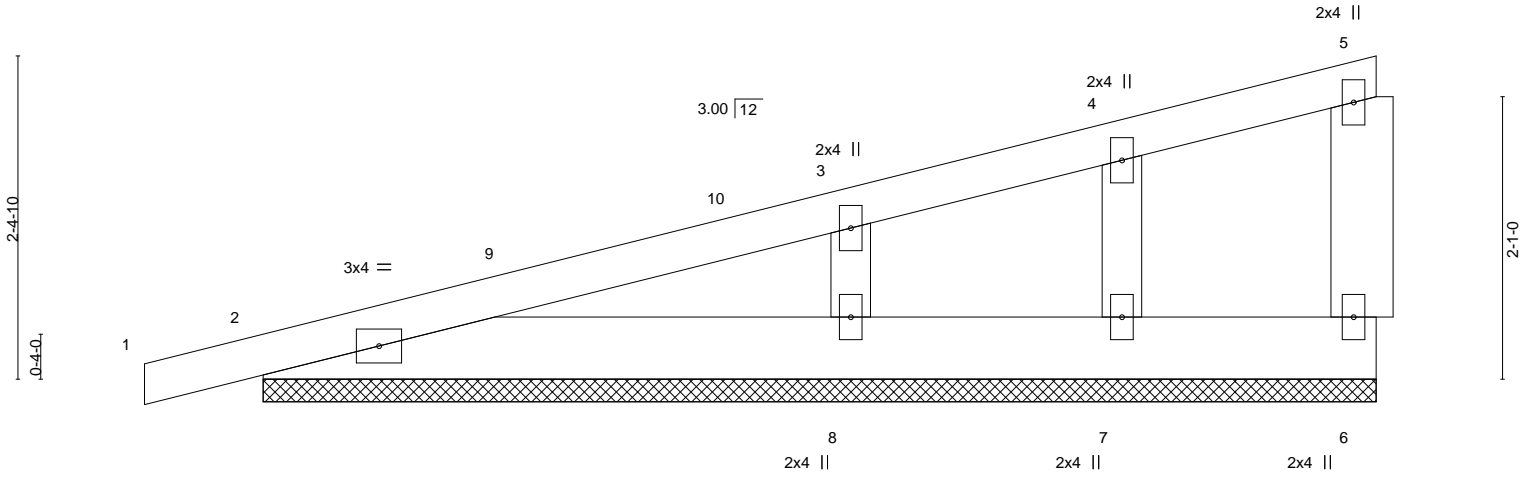

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP | |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|--------|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.16 | Vert(LL) | -0.00 | 1 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.05 | Vert(CT) | 0.00 | 1 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.04 | Horz(CT) | 0.00 | | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | | Weight: 40 lb | FT = 20% |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 8-2-8.
 (lb) - Max Horz 2=109(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 6, 2, 7 except 8=107(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 6, 2, 7 except 8=344(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-8=-255/218

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 8-1-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 7 except (jt=lb) 8=107.



February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721984 |
| J0124-0289 | M2 | MONOPICH | 5 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:04 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:17.5

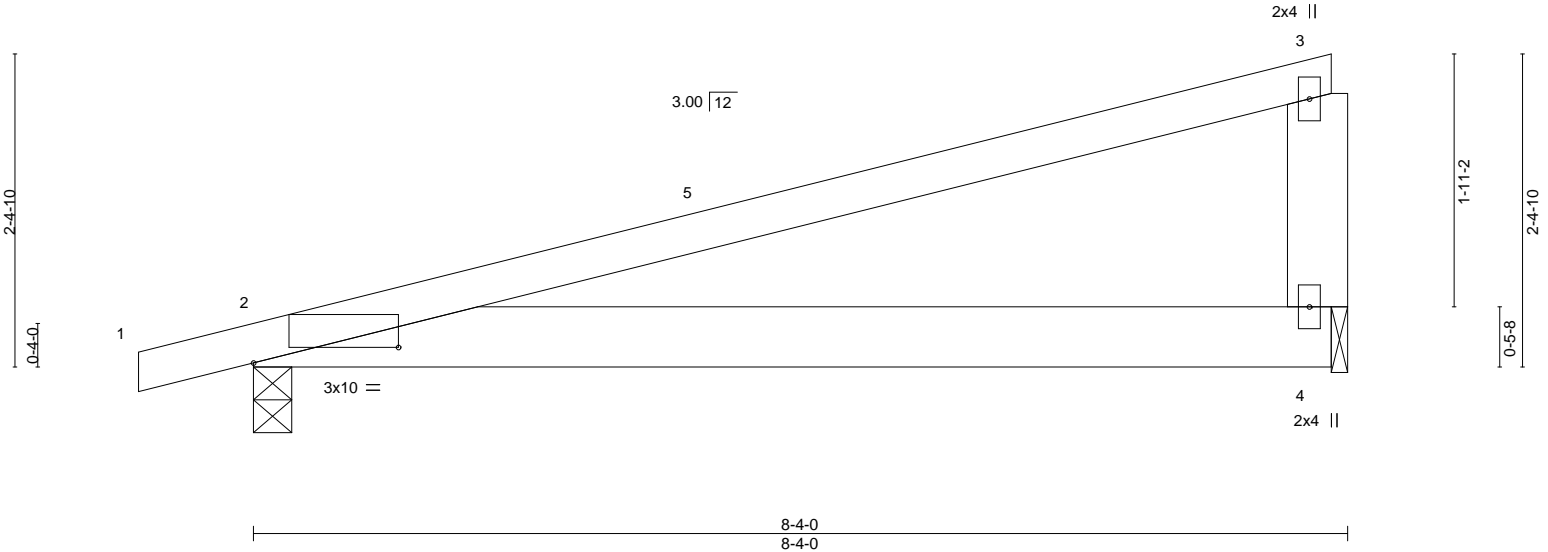

| | | | | | | | | | | |
|-----------------------|----------------------|-------|-------------|--------------|-------|-------|--------|-----|---------------|-------------|
| Plate Offsets (X,Y)-- | [2:1-1-4,0-1-7] | | | | | | | | | |
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.95 | Vert(LL) | -0.05 | 2-4 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.26 | Vert(CT) | -0.11 | 2-4 | >880 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.00 | Horz(CT) | 0.00 | | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | Wind(LL) | 0.00 | 2 | **** | 240 | Weight: 37 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-1-8
Max Horz 2=77(LC 8)
Max Uplift 2=66(LC 8), 4=41(LC 12)
Max Grav 2=384(LC 1), 4=314(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 8-1-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|--------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721985 |
| J0124-0289 | M3 | ROOF SPECIAL | 6 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:05 2024 Page 1

ID:BoL?hgXglYppwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:17.1

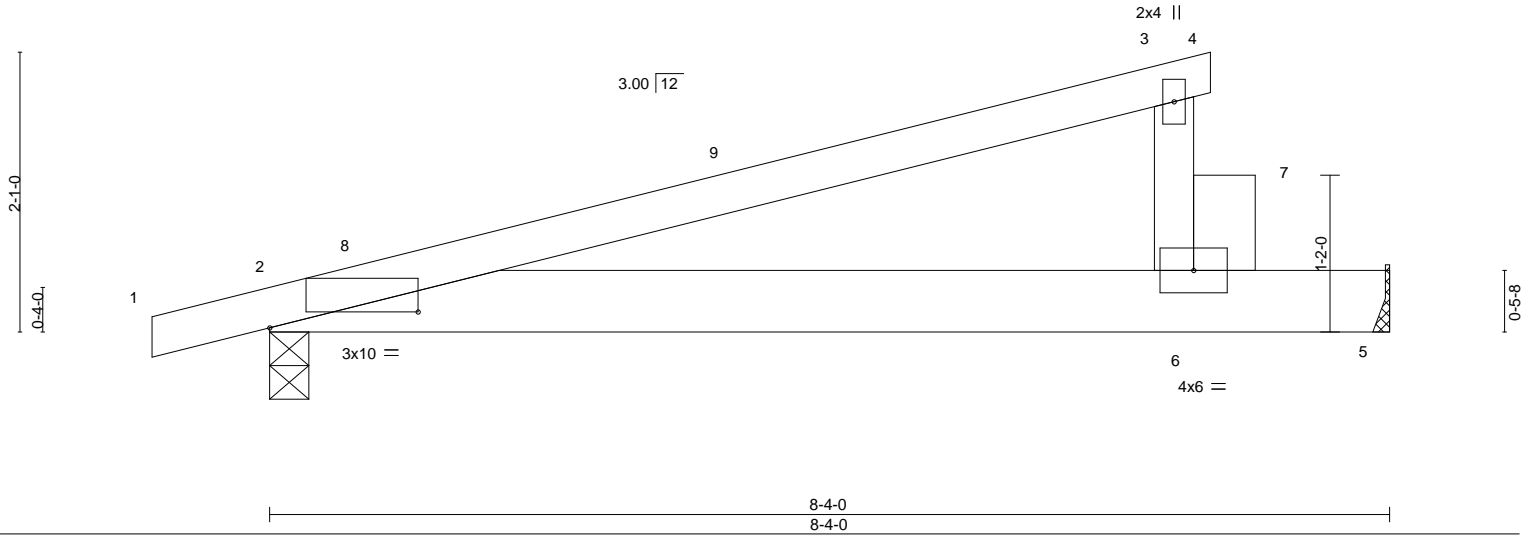

| | | | | | | | | | |
|-----------------------|----------------------|-------|-------------|--------------|-----------|--------|-----|---------------|-------------|
| Plate Offsets (X,Y)-- | [2:1-1-4,0-1-7] | | | | | | | | |
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.71 | Vert(LL) | -0.11 2-6 | >884 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.86 | Vert(CT) | -0.26 2-6 | >373 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | NO | WB 0.00 | Horz(CT) | 0.00 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | Wind(LL) | 0.17 2-6 | >569 | 240 | Weight: 35 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2 *Except*
6-7: 2x6 SP No.1

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-8-6 oc bracing.

REACTIONS. (size) 2=0-3-8, 5=Mechanical
Max Horz 2=68(LC 8)
Max Uplift 2=-75(LC 8), 5=-58(LC 12)
Max Grav 2=468(LC 1), 5=656(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 7-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 500 lb down and 265 lb up at 7-1-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-20, 2-5=-20
Concentrated Loads (lb)
Vert: 6=-500

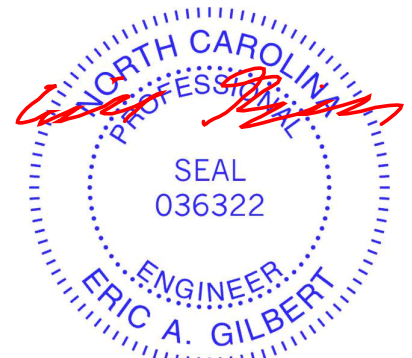

February 20,2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721986 |
| J0124-0289 | M4 | GABLE | 1 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:06 2024 Page 1

ID:BoL?hgXglYppwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:17.1

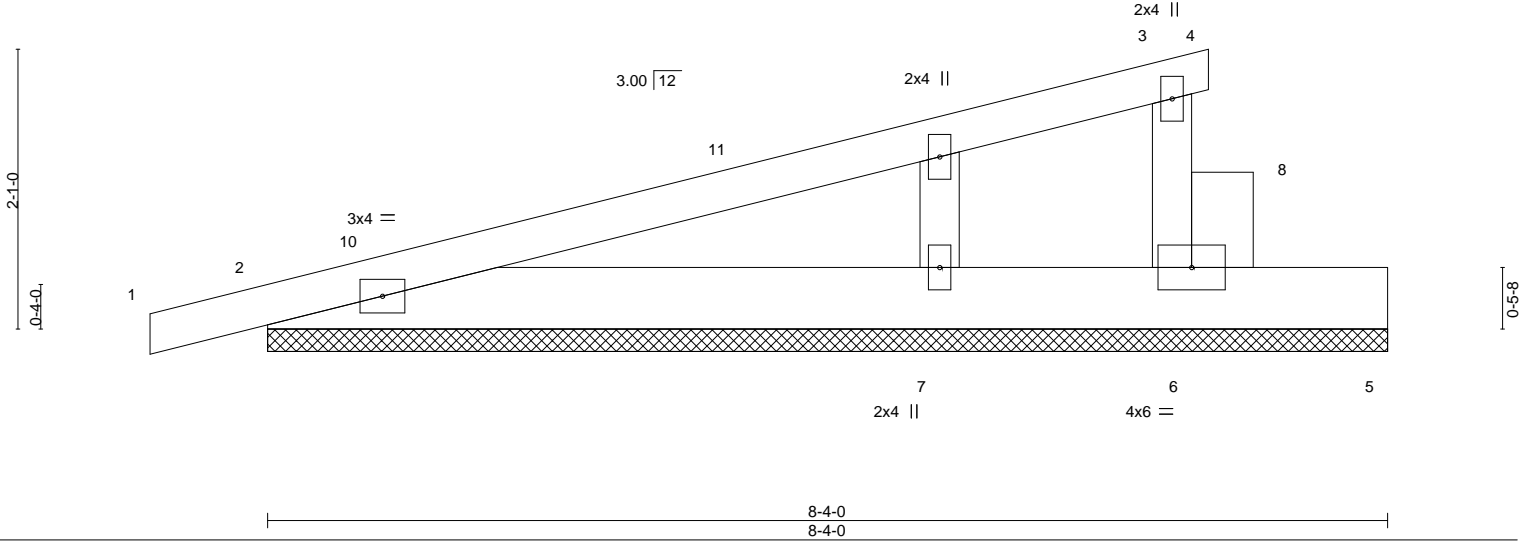

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.66 | Vert(LL) | -0.01 | 4 | n/r | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.06 | Vert(CT) | 0.01 | 4 | n/r | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.00 | Horz(CT) | 0.00 | 6 | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-P | | | | | Weight: 37 lb | FT = 20% |
| | Code IRC2015/TPI2014 | | | | | | | |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 6-8: 2x6 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 6=8-4-0, 2=8-4-0, 7=8-4-0
 Max Horz 2=96(LC 8)
 Max Uplift 6=-109(LC 12), 2=-133(LC 8)
 Max Grav 6=235(LC 1), 2=303(LC 1), 7=181(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 7-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=109, 2=133.

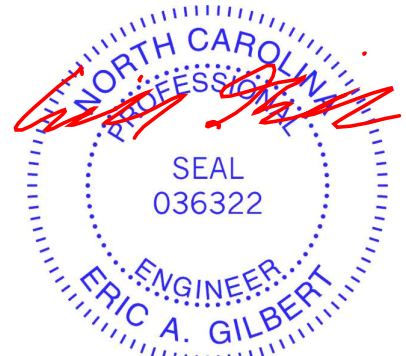

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III |
| J0124-0289 | M5 | GABLE | 1 | 1 | 163721987 |
| | | | | | Job Reference (optional) |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:07 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

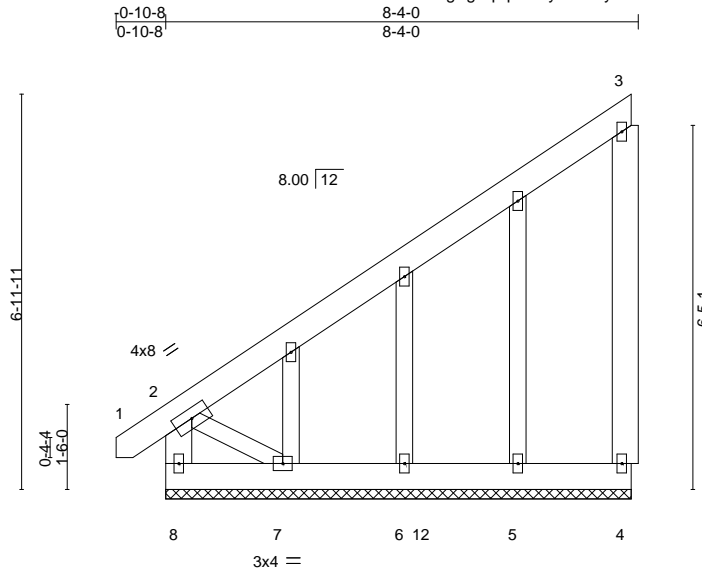

Scale = 1:40.6

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.40 | Vert(LL) | -0.02 | 1 | n/r | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.02 | Vert(CT) | 0.01 | 1 | n/r | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.06 | Horz(CT) | -0.00 | 4 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | Weight: 79 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1 *Except*
 2-7: 2x4 SP No.2
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 8-2-8.
 (lb) - Max Horz 8=271(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) except 4=-206(LC 12), 7=-142(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 5, 6, 7 except 4=311(LC 19), 8=311(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-301/227, 2-8=-298/0
 BOT CHORD 7-8=-302/225
 WEBS 2-7=-265/356

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 206 lb uplift at joint 4 and 142 lb uplift at joint 7.



February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III |
| J0124-0289 | M6 | MONOPICH | 6 | 1 | 163721988 |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:08 2024 Page 1

ID:BoL?hgXglYpawdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:41.9

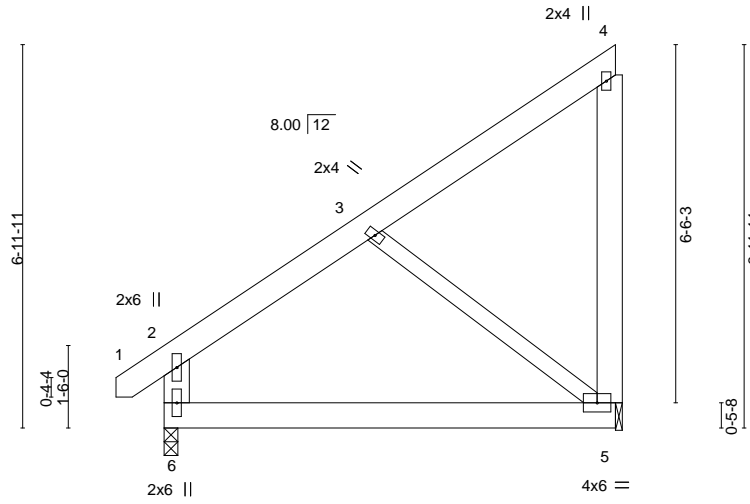

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.09 | Vert(LL) | -0.03 5-6 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.18 | Vert(CT) | -0.06 5-6 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.16 | Horz(CT) | -0.00 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.07 5-6 | >999 | 240 | Weight: 69 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x6 SP No.1 *Except*
 3-5: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 6=0-3-0, 5=0-1-8
 Max Horz 6=178(LC 12)
 Max Uplift 6=-27(LC 9), 5=-143(LC 9)
 Max Grav 6=376(LC 1), 5=310(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-268/39, 2-6=-290/86
 BOT CHORD 5-6=-250/259
 WEBS 3-5=-313/285

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-12 to 3-7-11, Interior(1) 3-7-11 to 8-1-0 zone; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 6 and 143 lb uplift at joint 5.

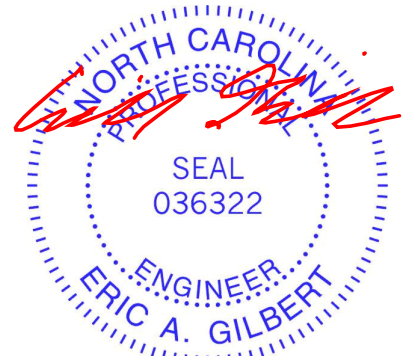

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721989 |
| J0124-0289 | P1 | GABLE | 1 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:09 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:23.4

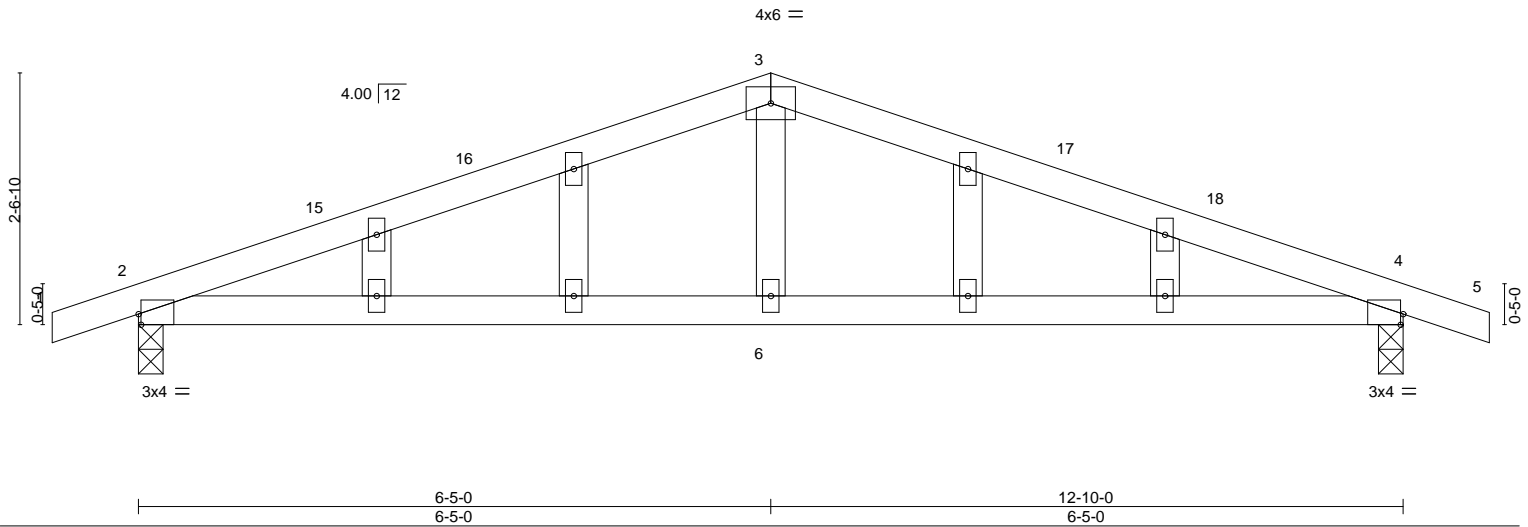


| | | | | | |
|------------------------|--------------------------------|-------------|----------------------------------|---------------|-------------|
| Plate Offsets (X, Y)-- | [2:0-0-5,Edge], [4:0-0-5,Edge] | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.44 | Vert(LL) 0.11 4-6 >999 240 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.34 | Vert(CT) -0.09 2-6 >999 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.07 | Horz(CT) 0.01 4 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | Weight: 51 lb | FT = 20% |

| | |
|-----------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-9-9 oc purlins. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 6-6-10 oc bracing. |
| WEBS 2x4 SP No.2 | |
| OTHERS 2x4 SP No.2 | |

REACTIONS. (size) 2=0-3-0, 4=0-3-0
 Max Horz 2=-49(LC 17)
 Max Uplift 2=-309(LC 8), 4=-309(LC 9)
 Max Grav 2=563(LC 1), 4=563(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-910/965, 3-4=-910/965
 BOT CHORD 2-6=-828/799, 4-6=-828/799
 WEBS 3-6=-383/303

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 6-5-0, Exterior(2) 6-5-0 to 10-9-13, Interior(1) 10-9-13 to 13-8-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 309 lb uplift at joint 2 and 309 lb uplift at joint 4.

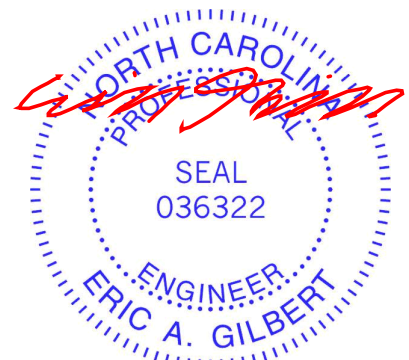


February 20, 2024

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721990 |
| J0124-0289 | P2 | COMMON | 2 | 1 | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:10 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:23.4

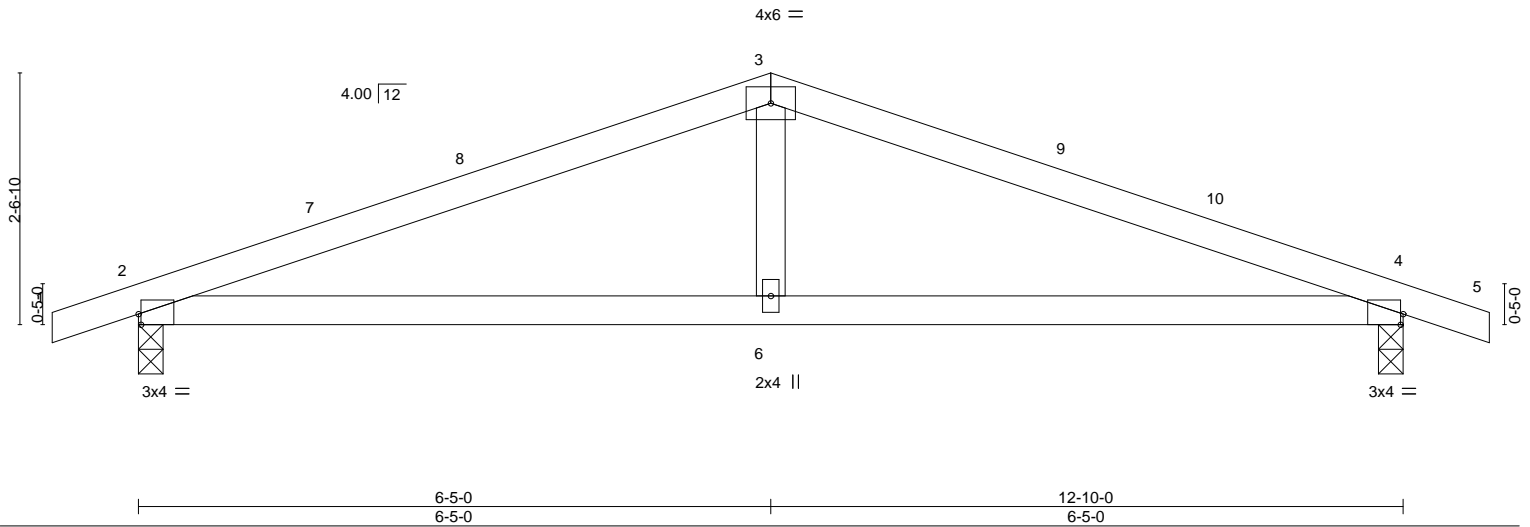


| | | | | | |
|------------------------|--------------------------------|-------------|----------------------------------|---------------|-------------|
| Plate Offsets (X, Y)-- | [2:0-0-5,Edge], [4:0-0-5,Edge] | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.44 | Vert(LL) 0.11 4-6 >999 240 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.34 | Vert(CT) -0.09 2-6 >999 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.07 | Horz(CT) 0.01 4 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | Weight: 45 lb | FT = 20% |

| | |
|-----------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-9-9 oc purlins. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 6-6-10 oc bracing. |
| WEBS 2x4 SP No.2 | |


REACTIONS. (size) 2=0-3-0, 4=0-3-0
 Max Horz 2=-29(LC 13)
 Max Uplift 2=-217(LC 8), 4=-217(LC 9)
 Max Grav 2=563(LC 1), 4=563(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-910/965, 3-4=-910/965
 BOT CHORD 2-6=-828/799, 4-6=-828/799
 WEBS 3-6=-383/303

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 6-5-0, Exterior(2) 6-5-0 to 10-9-13, Interior(1) 10-9-13 to 13-8-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 217 lb uplift at joint 2 and 217 lb uplift at joint 4.

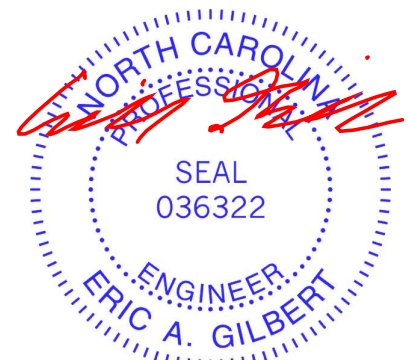

February 20, 2024

| | |
|--|--|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p>  <p>A MITEK Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|--|

| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721991 |
| J0124-0289 | P3 | COMMON | 3 | 1 | | |
| | | | | | Job Reference (optional) | |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:11 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:22.5

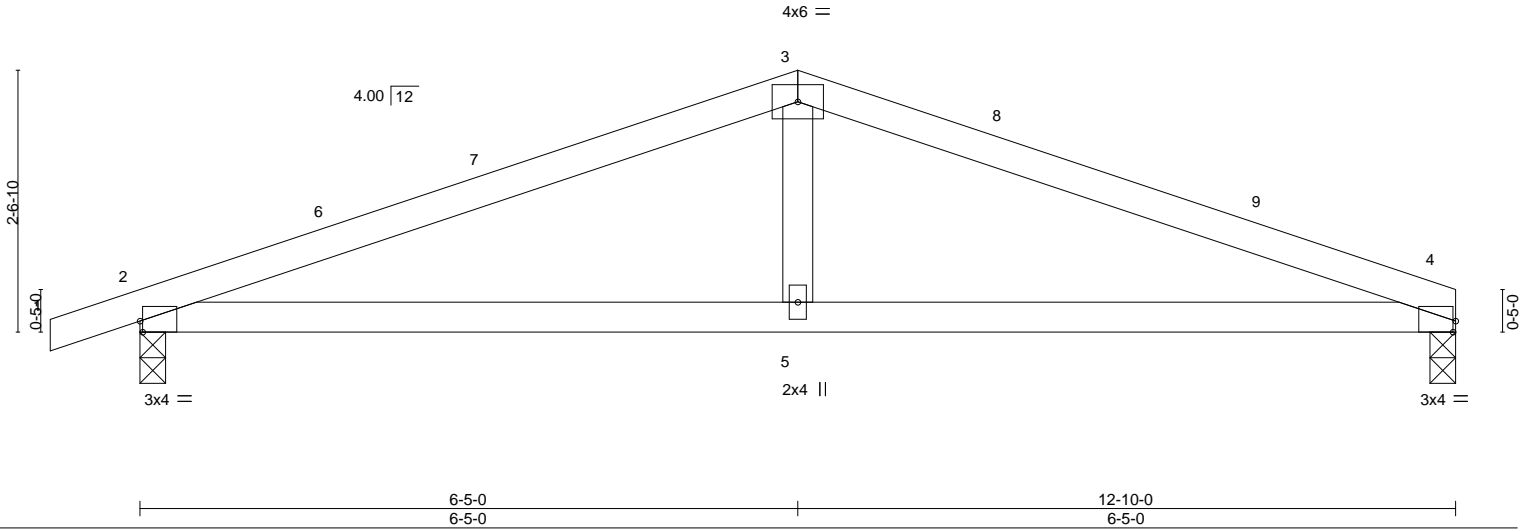

| | |
|------------------------|--------------------------------|
| Plate Offsets (X, Y)-- | [2:0-0-5,Edge], [4:0-0-5,Edge] |
|------------------------|--------------------------------|

| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
|---------------|----------------------|----------|-----------------------------|---------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.48 | in (loc) l/defl L/d | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.35 | Vert(LL) 0.11 4-5 >999 240 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.07 | Vert(CT) -0.09 4-5 >999 240 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Horz(CT) 0.01 4 n/a n/a | | |
| | Code IRC2015/TPI2014 | | | Weight: 44 lb | FT = 20% |

| LUMBER- | BRACING- |
|-----------------------|--|
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 5-7-10 oc purlins. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 6-4-14 oc bracing. |
| WEBS 2x4 SP No.2 | |

REACTIONS. (size) 4=0-3-0, 2=0-3-0
 Max Horz 2=32(LC 12)
 Max Uplift 4=-179(LC 9), 2=-217(LC 8)
 Max Grav 4=501(LC 1), 2=566(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-918/984, 3-4=-916/993
 BOT CHORD 2-5=-866/807, 4-5=-866/807
 WEBS 3-5=-386/305

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 6-5-0, Exterior(2) 6-5-0 to 10-9-13, Interior(1) 10-9-13 to 12-8-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 4 and 217 lb uplift at joint 2.




February 20, 2024

| | | | | | |
|-------------------|---------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss VB-1 | Truss Type VALLEY | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721992 |
|-------------------|---------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:12 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



4x4 =

Scale = 1:31.0

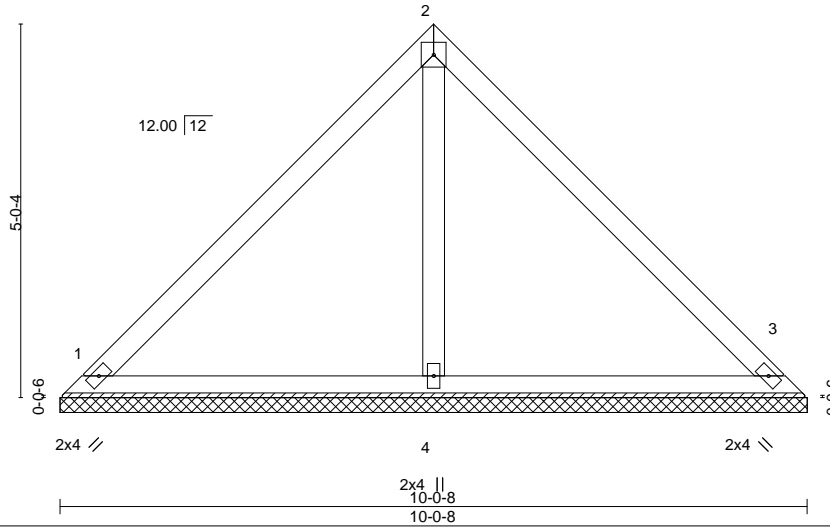

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.24 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.16 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.07 | Horz(CT) | 0.00 | 3 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | | | | | Weight: 41 lb | FT = 20% |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=10-0-8, 3=10-0-8, 4=10-0-8
 Max Horz 1=-112(LC 8)
 Max Uplift 1=-28(LC 13), 3=-28(LC 13)
 Max Grav 1=212(LC 1), 3=212(LC 1), 4=324(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 1 and 28 lb uplift at joint 3.

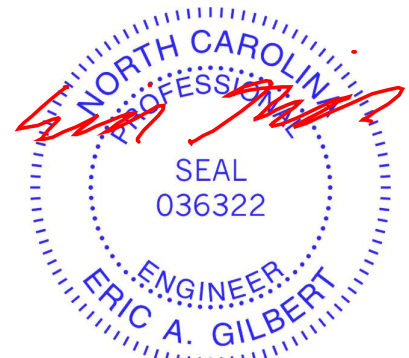

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)





818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|-------------------|---------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss VB-2 | Truss Type VALLEY | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721993 |
|-------------------|---------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:13 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

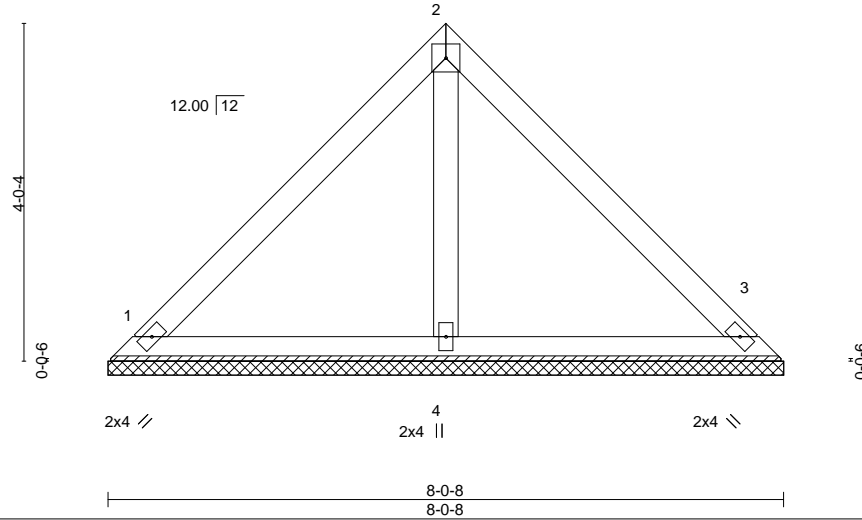

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.23 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.10 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.03 | Horz(CT) | 0.00 | 3 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | Weight: 32 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=8-0-8, 3=8-0-8, 4=8-0-8
Max Horz 1=-88(LC 8)
Max Uplift 1=-32(LC 13), 3=-32(LC 13)
Max Grav 1=179(LC 1), 3=179(LC 1), 4=230(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 32 lb uplift at joint 1 and 32 lb uplift at joint 3.



February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

| | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III |
| J0124-0289 | VB-3 | VALLEY | 1 | 1 | 163721994 |

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:13 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



4x4 =

Scale = 1:21.3

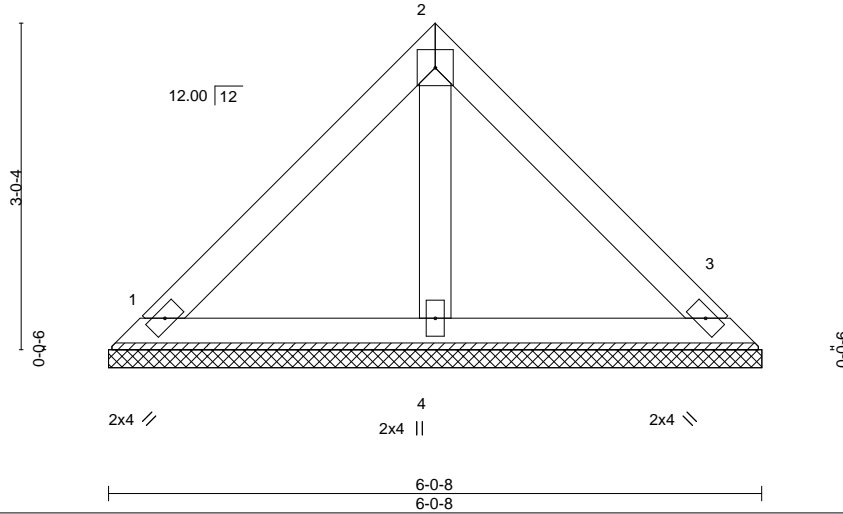

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP | |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|--------|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.12 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.05 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.02 | Horz(CT) | 0.00 | 3 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | | Weight: 24 lb | FT = 20% |

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-0-8, 3=6-0-8, 4=6-0-8
Max Horz 1=64(LC 9)
Max Uplift 1=23(LC 13), 3=23(LC 13)
Max Grav 1=130(LC 1), 3=130(LC 1), 4=167(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 1 and 23 lb uplift at joint 3.

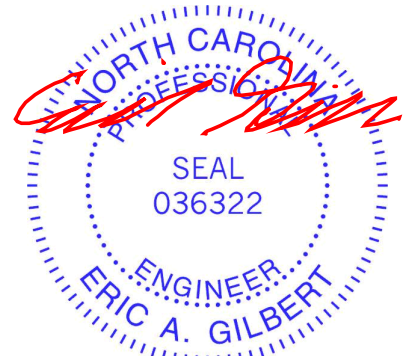

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

| | | | | | |
|-------------------|---------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss VB-4 | Truss Type VALLEY | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721995 |
|-------------------|---------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:14 2024 Page 1

ID:BoL?hgXglYppwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

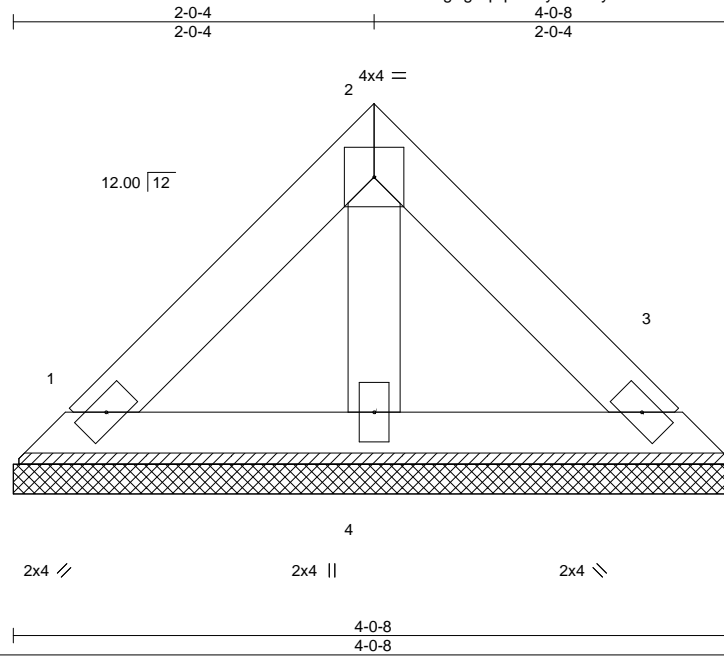

Scale = 1:12.9

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.04 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.02 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.01 | Horz(CT) | 0.00 | 3 | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | Weight: 15 lb | FT = 20% |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-0-8, 3=4-0-8, 4=4-0-8
 Max Horz 1=-40(LC 8)
 Max Uplift 1=-14(LC 13), 3=-14(LC 13)
 Max Grav 1=81(LC 1), 3=81(LC 1), 4=104(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 1 and 14 lb uplift at joint 3.

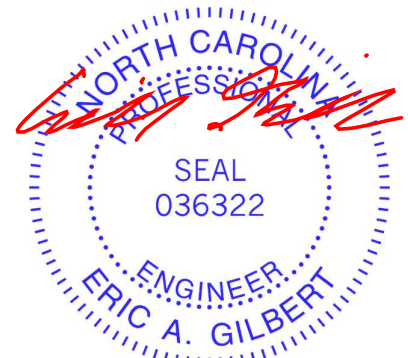

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|-------------------|---------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss VB-5 | Truss Type VALLEY | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721996 |
|-------------------|---------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:15 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

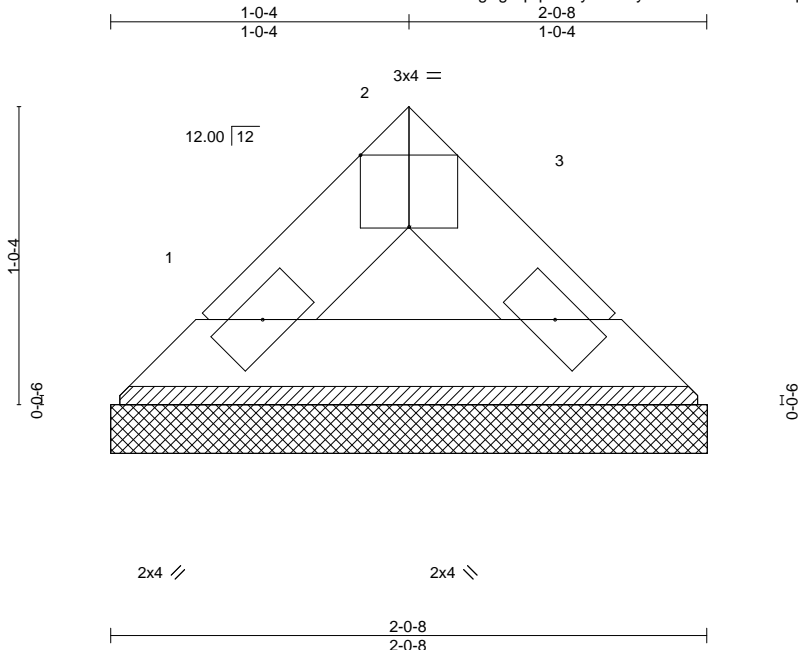

Scale = 1:7.9


| | | | | | |
|-----------------------|-----------------------|-------------|----------------------------------|---------------|-------------|
| Plate Offsets (X,Y)-- | [2:0-2-0,Edge] | | | | |
| LOADING (psf) | SPACING- 2-0-0 | CSI. | DEFL. in (loc) l/defl L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.01 | Vert(LL) n/a - n/a 999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.01 | Vert(CT) n/a - n/a 999 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.00 | Horz(CT) 0.00 3 n/a n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-P | | Weight: 6 lb | FT = 20% |

| | |
|-----------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 2-0-8 oc purlins. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |

REACTIONS. (size) 1=2-0-8, 3=2-0-8
 Max Horz 1=-16(LC 8)
 Max Uplift 1=-2(LC 12), 3=-2(LC 12)
 Max Grav 1=54(LC 1), 3=54(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 1 and 2 lb uplift at joint 3.

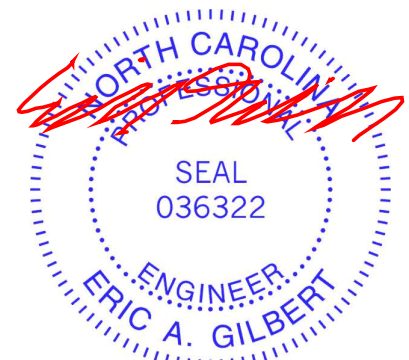

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932


| | | | | | |
|-------------------|---------------|----------------------|----------|----------|--|
| Job J0124-0289 | Truss VC-1 | Truss Type VALLEY | Qty 1 | Ply 1 | Weaver Homes/Lot 10 West Pointe III 163721997 |
|-------------------|---------------|----------------------|----------|----------|--|

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:16 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)

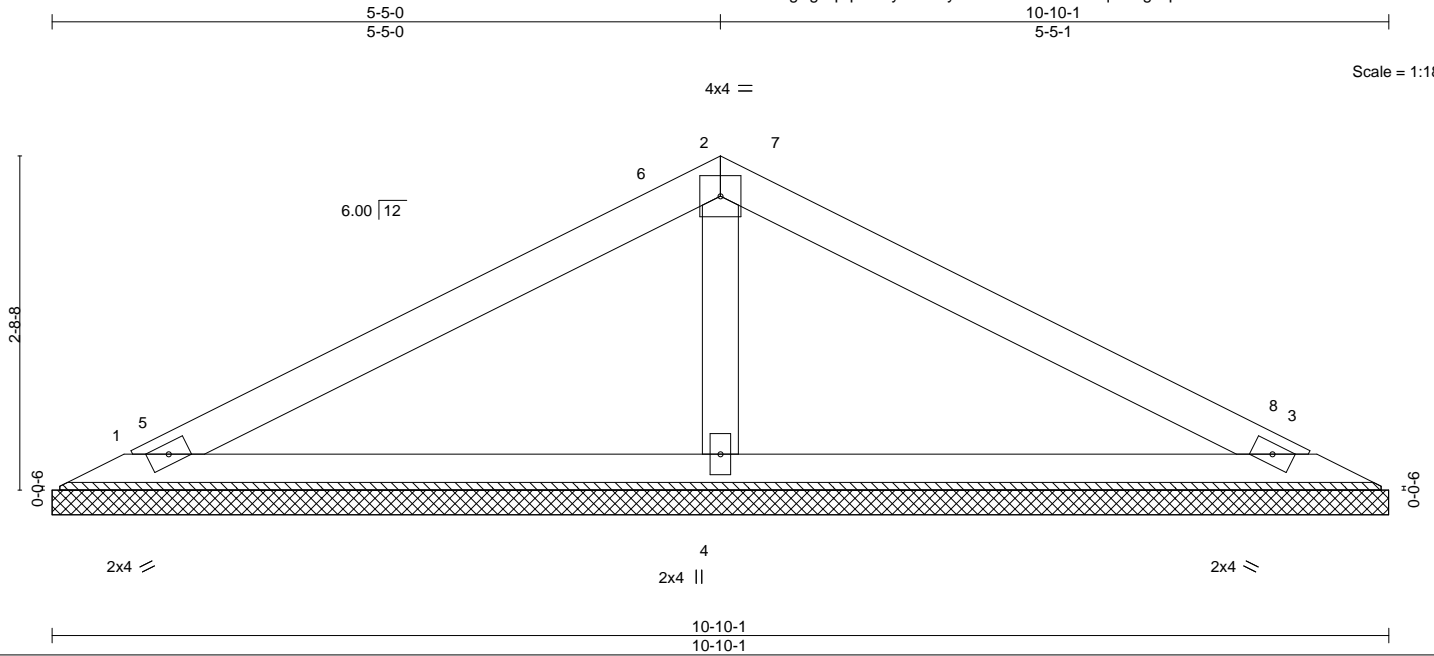

Scale = 1:18.7

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.24 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.17 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.04 | Horz(CT) | 0.00 | 3 | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | | | | | Weight: 35 lb | FT = 20% |
| | Code IRC2015/TPI2014 | | | | | | | |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=10-10-1, 3=10-10-1, 4=10-10-1
 Max Horz 1=31(LC 9)
 Max Uplift 1=23(LC 12), 3=29(LC 13)
 Max Grav 1=176(LC 23), 3=176(LC 24), 4=413(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-273/182

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-7-13 to 5-0-10, Interior(1) 5-0-10 to 5-5-0, Exterior(2) 5-5-0 to 9-9-13, Interior(1) 9-9-13 to 10-2-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 1 and 29 lb uplift at joint 3.

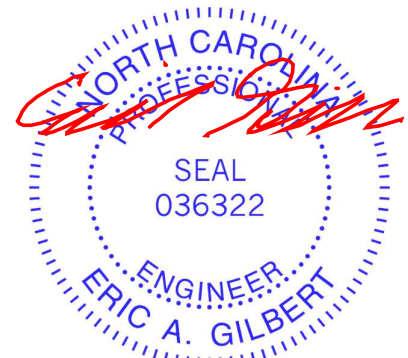

February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

| | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III |
| J0124-0289 | VC-2 | VALLEY | 1 | 1 | 163721998 |
| | | | | | Job Reference (optional) |


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:17 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:13.2

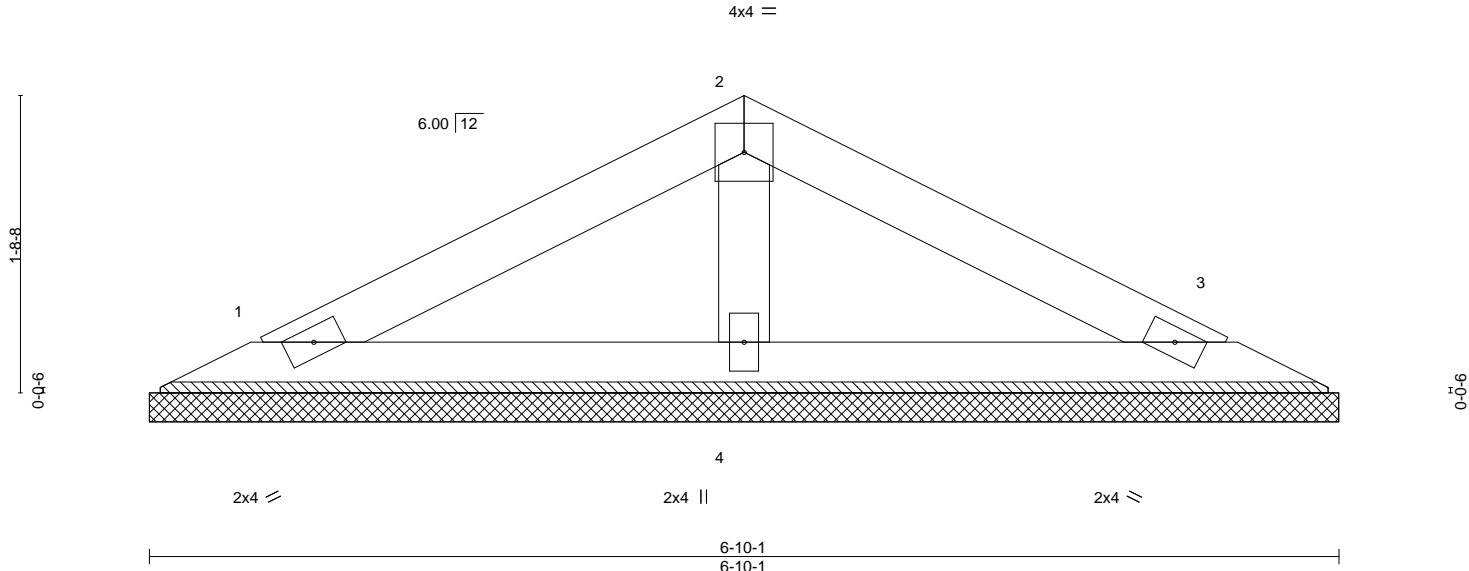

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | 2-0-0 | TC 0.10 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.06 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.02 | Horz(CT) | 0.00 | 3 | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-P | | | | | Weight: 21 lb | FT = 20% |
| | Code IRC2015/TPI2014 | | | | | | | |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-10-1, 3=6-10-1, 4=6-10-1
 Max Horz 1=-18(LC 10)
 Max Uplift 1=-18(LC 12), 3=-21(LC 13)
 Max Grav 1=113(LC 1), 3=113(LC 1), 4=217(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 1 and 21 lb uplift at joint 3.

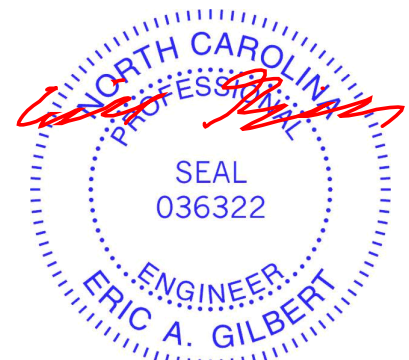

February 20, 2024

| | |
|--|---|
| <p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p> | <p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p> |
|--|---|


| | | | | | | |
|------------|-------|------------|-----|-----|-------------------------------------|-----------|
| Job | Truss | Truss Type | Qty | Ply | Weaver Homes/Lot 10 West Pointe III | 163721999 |
| J0124-0289 | VC-3 | VALLEY | 1 | 1 | | |

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 19 13:42:18 2024 Page 1

ID:BoL?hgXglYpqwdOiyUmcQyz41fz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)

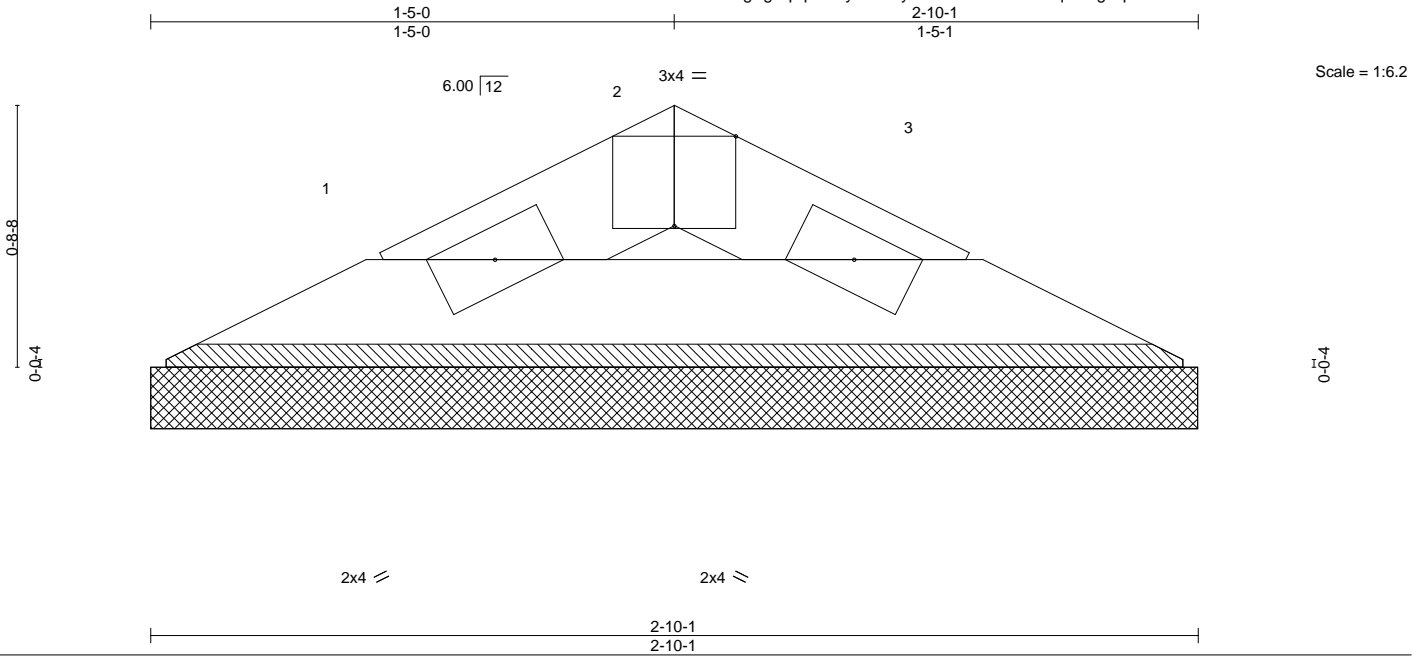

| Plate Offsets (X,Y)-- [2:0-2-0,Edge] | | | | | | PLATES | GRIP |
|--------------------------------------|----------------------|-------|-------------|--------------|----------|--------|-----------------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.01 | Vert(LL) | n/a | - | n/a 999 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.02 | Vert(CT) | n/a | - | n/a 999 |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.00 | Horz(CT) | 0.00 | 3 | n/a n/a |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | |
| | | | | | | | Weight: 7 lb FT = 20% |


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-10-1 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=2-10-1, 3=2-10-1
 Max Horz 1=5(LC 9)
 Max Uplift 1=4(LC 12), 3=4(LC 13)
 Max Grav 1=63(LC 1), 3=63(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 1 and 4 lb uplift at joint 3.

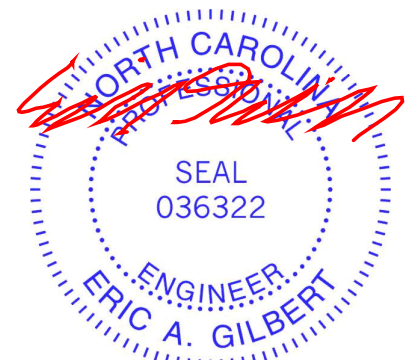


February 20, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

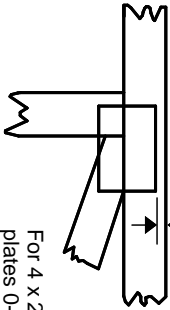

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

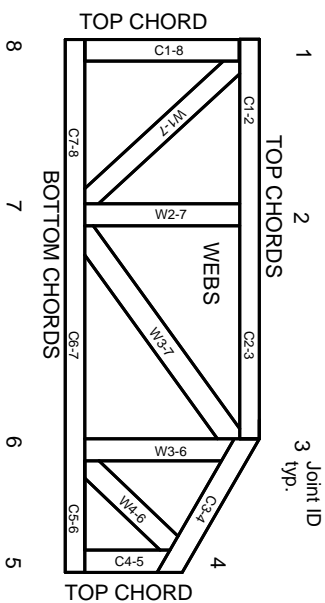

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023