

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.
 ○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

All Headers Are Considered 2X10 Beams Unless Otherwise Noted

All Walls Shown Are Considered Load Bearing

Roof Area = 2991.65 sq.ft.
 Ridge Line = 90.51 ft.
 Hip Line = 65.27 ft.
 Horiz. OH = 192.83 ft.
 Raked OH = 153.56 ft.
 Decking = 103 sheets

Dimension Notes
 1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
 2. All interior wall dimensions are to face of stud unless noted otherwise
 3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

Hatch Legend

- 5' 3-1/2" Walls
- Second Floor Walls
- Vaulted Ceiling
- Drop Beam
- Flush Beam

Connector Information				Nail Information		
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
■	HUS26	USP	16	NA	16d/3-1/2"	16d/3-1/2"
■	THD26-2	USP	5	NA	16d/3-1/2"	10d/3"

1 Truss Placement Plan
 Scale: 1/4"=1'

▲ = Denotes Left End of Truss
 (Reference Engineered Truss Drawing)

LOAD CHART FOR JACK STUDS
 (BASED ON TABLES R502.5(1) & (2))
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/ROOF

END REACTOR (UP TO) HEADERS/ROOF	END REACTOR (UP TO) HEADERS/ROOF	END REACTOR (UP TO) HEADERS/ROOF
1700	2550	3400
3400	5100	6800
5100	7650	10200
6800	10200	13600
8500	12750	17000
10200	15300	
11900		
13600		
15300		

BUILDER	New Home, Inc.	CITY / CO.	Lillington / Harnett
JOB NAME	Lot 147 Duncan's Creek	ADDRESS	868 Duncan Creek Road
PLAN	The Guilford - French Country "B"	MODEL	Roof
SEAL DATE	10/31/23	DATE REV.	02/26/24
QUOTE #		DRAWN BY	Jonathan Landry
JOB #	J0224-1107	SALES REP.	Johnnie Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BC3-B1 and BC3-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Jonathan Landry
 Jonathan Landry

comTECH
ROOF & FLOOR TRUSSES & BEAMS
 Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

Trenco
818 Soundside Rd
Edenton, NC 27932


Re: J0224-1107
Lot 147 Duncan's Creek

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I63860231 thru I63860265

My license renewal date for the state of North Carolina is December 31, 2024.

North Carolina COA: C-0844

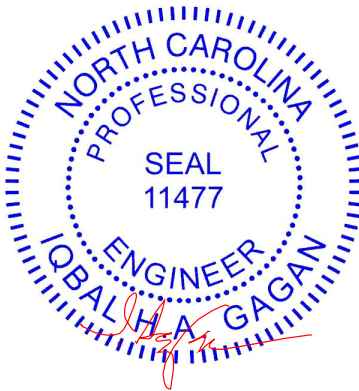

February 27, 2024

Gagan, Iqbal


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0224-1107	Truss A01-GR	Truss Type HIP GIRDER	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860231
-------------------	-----------------	--------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:28 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwrcDoi7J4zJC?f



Scale = 1:78.0


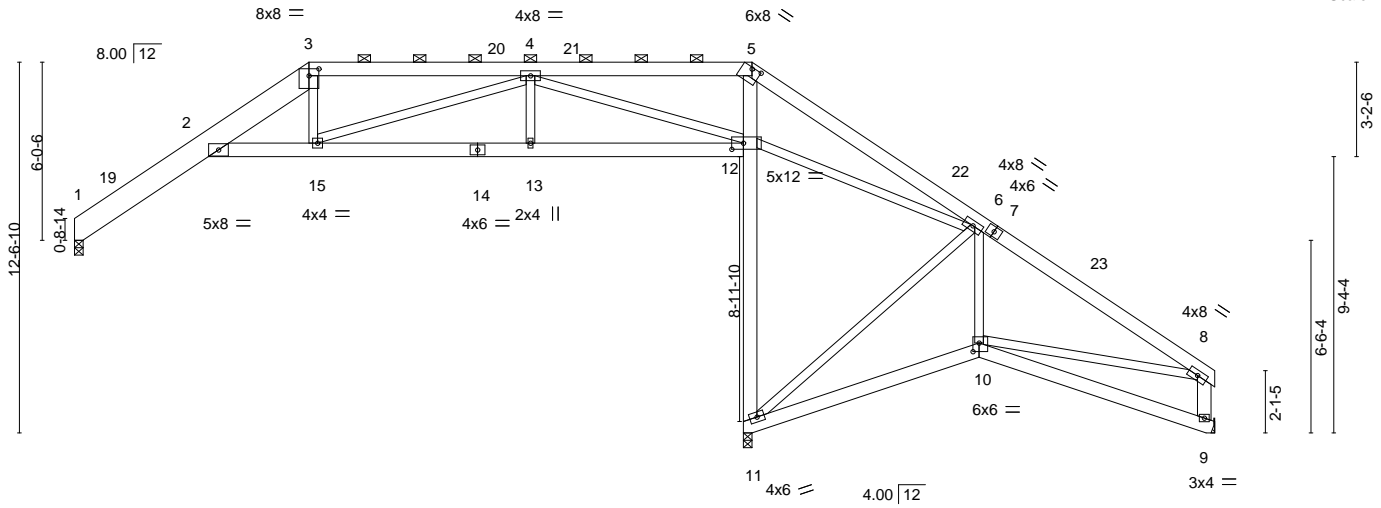


Plate Offsets (X, Y)--	[3:0-4-0,0-2-13], [5:0-4-0,0-0-10], [10:0-2-8,0-3-8], [12:0-4-12,0-2-8]
------------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	Vert(LL)	-0.09	18	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.25	Vert(CT)	-0.17	18	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.48	Horz(CT)	0.11	11	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-AS	Wind(LL)	0.10	18	>999		
	Code IRC2015/TPI2014						Weight: 608 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 8-9: 2x6 SP No.1	

REACTIONS. (size) 1=0-3-8, 11=0-3-8, 9=Mechanical
 Max Horz 1=-320(LC 8)
 Max Uplift 1=-134(LC 12), 11=-89(LC 9), 9=-271(LC 13)
 Max Grav 1=794(LC 23), 11=1921(LC 1), 9=528(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-639/476, 2-3=-1464/542, 3-4=-1452/555, 4-5=-164/1156, 5-6=-256/1529,
 6-8=-729/466, 8-9=-596/371
 BOT CHORD 2-15=-398/1445, 13-15=-313/960, 12-13=-313/960, 11-12=-1717/437, 5-12=-1233/410,
 10-11=-291/510
 WEBS 4-15=-87/703, 4-13=0/286, 4-12=-2172/663, 6-12=-1234/566, 6-11=-626/358,
 6-10=-23/431, 8-10=-197/283

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-6, Interior(1) 4-6-6 to 7-11-4, Exterior(2) 7-11-4 to 14-1-15, Interior(1) 14-1-15 to 22-11-4, Exterior(2) 22-11-4 to 29-1-15, Interior(1) 29-1-15 to 38-3-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 1, 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 1=134, 9=271.

Continued on page 2



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932


Job J0224-1107	Truss A01-GR	Truss Type HIP GIRDER	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	I63860231
-------------------	-----------------	--------------------------	----------	-----------------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:28 2024 Page 2
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

NOTES-

- 11) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

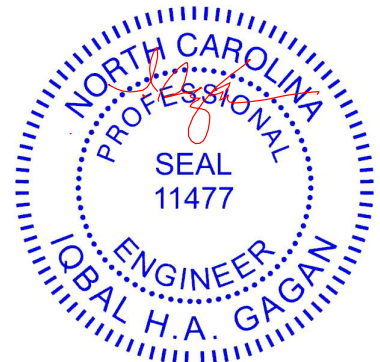

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-1107	Truss A01GE	Truss Type Roof Special Supported Gable	Qty 2	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860232
-------------------	----------------	--	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:26 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

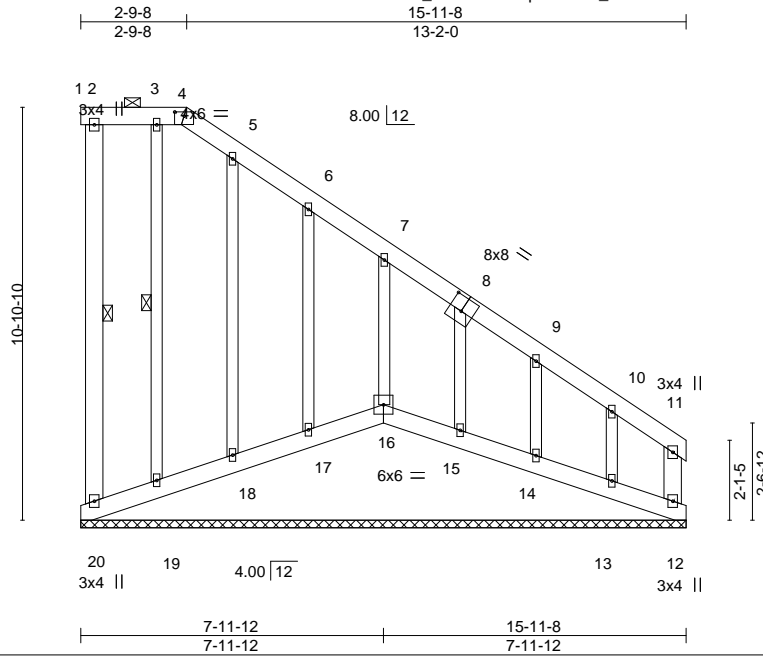

Scale = 1:60.7

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.10	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.01	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.15	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-R	Horz(CT) 0.01 15 n/a n/a		
	Code IRC2015/TPI2014			Weight: 163 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-4.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 16-17,15-16.
WEBS 2x6 SP No.1	WEBS 1 Row at midpt 2-20, 3-19
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 15-11-8.
 (lb) - Max Horz 1=535(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 20, 1, 12, 19 except 16=147(LC 13), 17=154(LC 13), 15=126(LC 13), 14=128(LC 13), 13=121(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 20, 1, 12, 16, 19, 18, 17, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=423/535, 2-3=422/534, 3-4=422/534, 4-5=447/554, 5-6=441/549, 6-7=352/438, 7-8=267/331

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are 2x4 MT20 unless otherwise indicated.
 - 6) Gable requires continuous bottom chord bearing.
 - 7) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 8) Gable studs spaced at 2-0-0 oc.
 - 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 11) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 20, 1, 12, 19 except (jt=lb) 16=147, 17=154, 15=126, 14=128, 13=121.
 - 13) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 20, 12, 16, 19, 18, 17, 15, 14, 13.
 - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860233
J0224-1107	A02	HIP GIRDER	1	1		
Comtech, Inc. Fayetteville, NC - 28314,						8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:29 2024 Page 1
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f						
						Job Reference (optional)

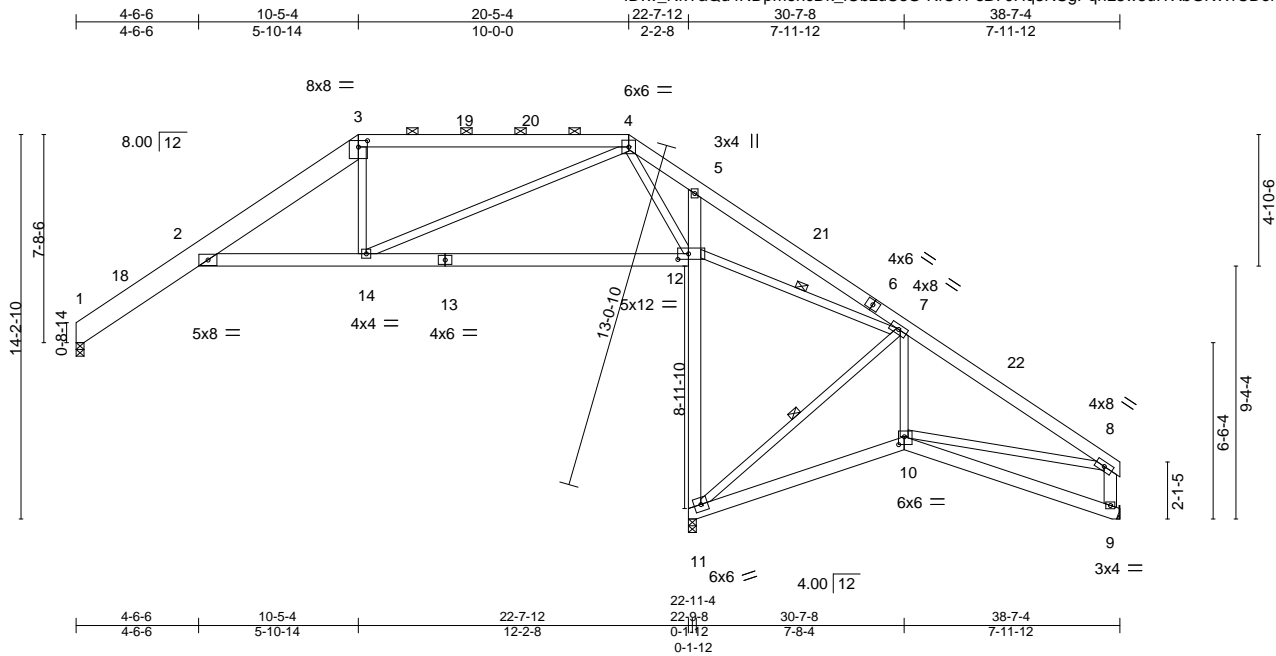

Scale = 1:85.2

Plate Offsets (X,Y)--	[3:0-4-0,0-2-13], [10:0-2-8,0-3-8], [12:0-4-12,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.51	Vert(LL) -0.18 14-17 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.56	Vert(CT) -0.36 14-17 >748 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.67	Horz(CT) 0.22 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.21 14-17 >999 240	Weight: 310 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 8-9: 2x6 SP No.1	WEBS 1 Row at midpt 7-12, 7-11

REACTIONS. (size) 1=0-3-8, 11=0-3-8, 9=Mechanical
 Max Horz 1=-373(LC 8)
 Max Uplift 1=-145(LC 12), 11=-62(LC 12), 9=-266(LC 13)
 Max Grav 1=818(LC 23), 11=1855(LC 1), 9=547(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-669/476, 2-3=-1121/426, 3-4=-1038/501, 4-5=-231/1238, 5-7=-176/1301,
 7-8=-735/457, 8-9=-591/375

BOT CHORD 2-14=-276/1043, 12-14=-567/335, 11-12=-1613/414, 5-12=-480/268, 10-11=-282/518

WEBS 4-14=-245/1232, 4-12=-1722/490, 7-12=-1153/504, 7-11=-637/348, 7-10=-21/437,
 8-10=-208/323

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-6, Interior(1) 4-6-6 to 10-5-4, Exterior(2) 10-5-4 to 16-7-15, Interior(1) 16-7-15 to 20-5-4, Exterior(2) 20-5-4 to 26-7-15, Interior(1) 26-7-15 to 38-3-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 1, 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 1=145, 9=266.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general information regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss A03-GR	Truss Type PIGGYBACK BASE GIRDE	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860234
-------------------	-----------------	------------------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:31 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

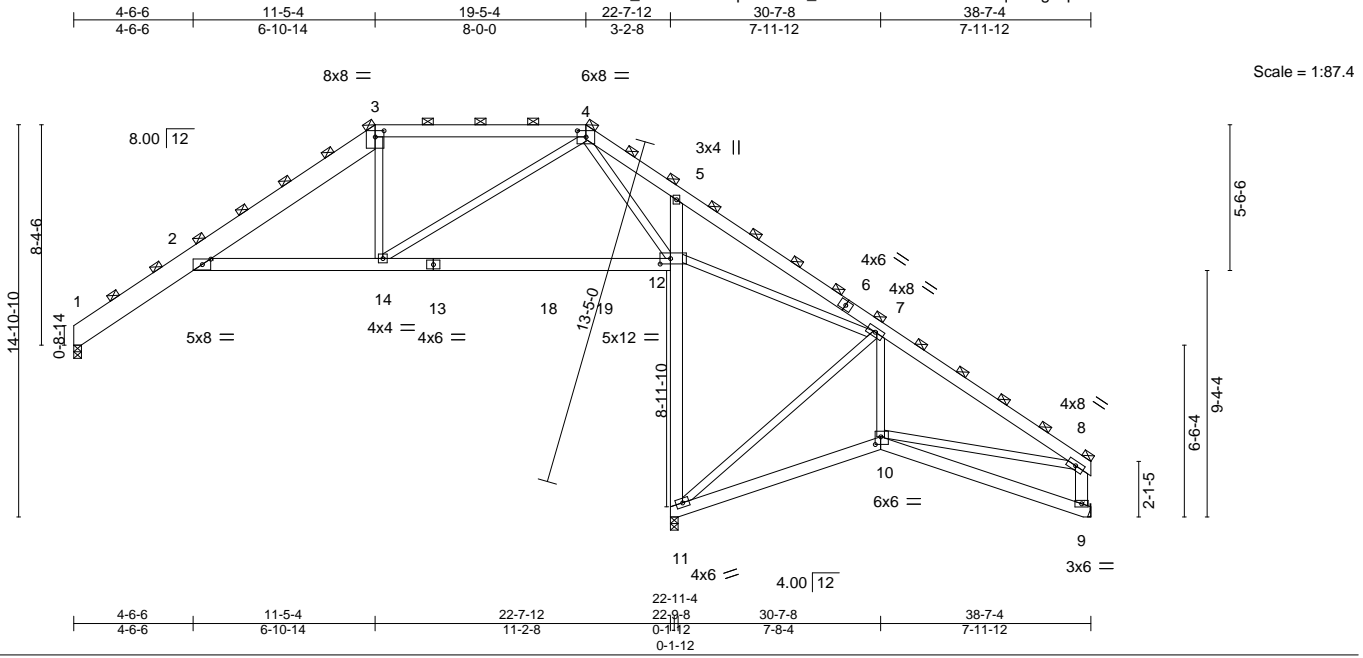


Plate Offsets (X, Y)--	[2:0-3-14,0-2-8], [3:0-4-0,0-2-13], [4:0-4-0,0-2-13], [10:0-2-8,0-3-8], [12:0-4-12,0-2-8]
------------------------	---

LOADING (psf)	SPACING-	5-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.57	Vert(LL)	-0.25 14-17	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.68	Vert(CT)	-0.51 14-17	>539	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.63	Horz(CT)	0.30 9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.28 14-17	>966	240	Weight: 627 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals (Switched from sheeted: Spacing > 2-8-0).
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 9-10.
WEBS 2x4 SP No.2 *Except* 8-9: 2x6 SP No.1	

REACTIONS. (size) 1=0-3-8, 11=0-3-8, 9=Mechanical
Max Horiz 1=-986(LC 4)
Max Uplift 1=-361(LC 8), 11=-215(LC 8), 9=-658(LC 9)
Max Grav 1=2015(LC 19), 11=4680(LC 1), 9=1342(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1400/995, 2-3=-2337/325, 3-4=-2104/492, 4-5=-562/3356, 5-7=-484/3531,
7-8=-1635/1129, 8-9=-1254/804
BOT CHORD 2-14=-553/2302, 12-14=-548/809, 11-12=-4103/279, 5-12=-1110/612, 10-11=-703/1199,
9-10=-168/395
WEBS 3-14=-566/491, 4-14=-422/2623, 4-12=-4504/976, 7-12=-2635/740, 7-10=-48/1078,
8-10=-510/765, 7-11=-1464/858


- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 1, 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=361, 11=215, 9=658.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-1107	Truss A04	Truss Type ROOF SPECIAL	Qty 2	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860235
-------------------	--------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:32 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

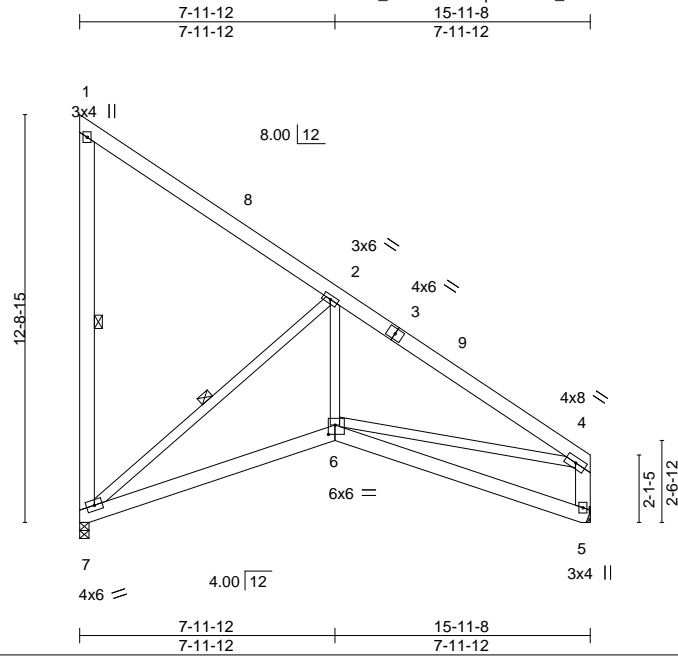

Scale = 1:72.0


Plate Offsets (X,Y)--	[6:0-2-8,0-3-8]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.03	6-7	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	-0.07	6-7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.03	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.01	6	>999		
								Weight: 148 lb	FT = 20%

LUMBER-	BRACING-	
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.	
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.	
WEBS 2x4 SP No.2 *Except* 1-7,4-5: 2x6 SP No.1	WEBS 1 Row at midpt 1-7, 2-7	

REACTIONS. (size) 5=Mechanical, 7=0-3-8
 Max Horz 7=-448(LC 13)
 Max Uplift 7=-351(LC 13)
 Max Grav 5=620(LC 1), 7=723(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-7=-286/228, 2-4=-892/0, 4-5=-589/69
 BOT CHORD 6-7=0/704
 WEBS 2-7=-935/285, 2-6=0/558, 4-6=0/509

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 15-8-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=351.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

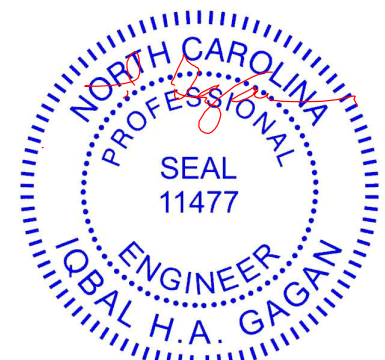

February 27, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job J0224-1107	Truss A05	Truss Type ROOF SPECIAL	Qty 2	Ply 1	Lot 147 Duncan's Creek 163860236
-------------------	--------------	----------------------------	----------	----------	-------------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:33 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:72.0

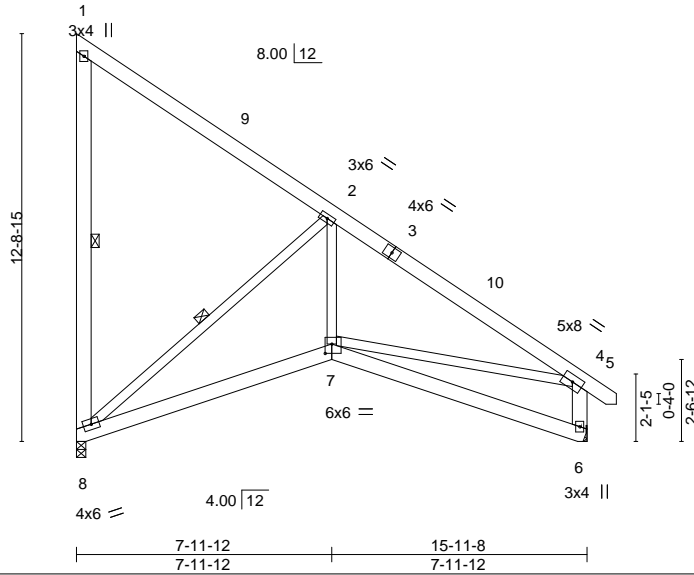


Plate Offsets (X,Y)--	[7:0-2-8,0-3-8]
-----------------------	-----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.24	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.19	Vert(LL) -0.03 7-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.44	Vert(CT) -0.07 7-8 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.03 6 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) -0.01 7 >999 240	Weight: 150 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-8,4-6: 2x6 SP No.1	WEBS 1 Row at midpt 1-8, 2-8

REACTIONS. (size) 6=Mechanical, 8=0-3-8
 Max Horz 8=-471(LC 13)
 Max Uplift 8=-352(LC 13)
 Max Grav 6=681(LC 1), 8=722(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-8=-288/229, 2-4=-890/0, 4-6=-656/136
 BOT CHORD 7-8=0/697, 6-7=-82/271
 WEBS 2-8=-946/263, 2-7=0/559, 4-7=-47/516

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 16-8-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=352.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860237
J0224-1107	A06	PIGGYBACK BASE	3	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:34 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)

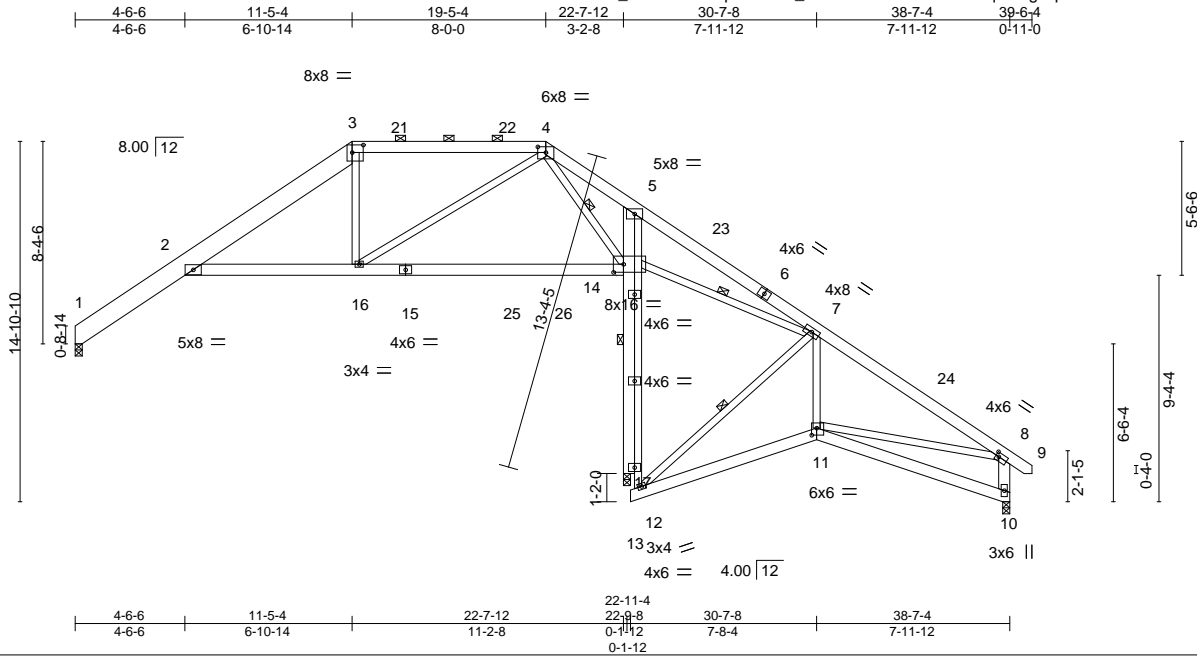

Scale: 1/8"=1'


Plate Offsets (X,Y)--	[3:0-5-8,0-3-12], [4:0-4-0,0-2-13], [8:0-1-8,0-2-0], [11:0-2-8,0-3-8], [14:0-5-0,0-4-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.82	Vert(LL)	-0.21	16-20	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.57	Vert(CT)	-0.43	16-20	>651		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.37	Horz(CT)	0.26	17	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.24	16-20	>999	Weight: 330 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 8-10: 2x6 SP No.1	WEBS 1 Row at midpt 5-12, 4-14, 7-14, 7-12
OTHERS 2x6 SP No.1	

REACTIONS.	(size) 1=0-3-8, 17=0-3-8, 10=0-3-8 Max Horz 1=-411(LC 8) Max Uplift 1=-142(LC 12), 17=-92(LC 12), 10=-310(LC 13) Max Grav 1=770(LC 23), 17=2013(LC 1), 10=530(LC 20)
-------------------	---

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-685/494, 2-3=-877/369, 3-4=-794/451, 4-5=-234/1632, 5-7=-227/1603, 7-8=-553/496, 8-10=-594/463
BOT CHORD	2-16=-197/889, 14-16=-647/412, 11-12=-283/391, 10-11=-120/289
WEBS	12-17=-110/337, 14-17=-1781/438, 5-14=-526/365, 3-16=-263/217, 4-16=-193/1181, 4-14=-1987/392, 7-14=-1268/557, 7-11=-27/399, 7-12=-535/346

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-6, Interior(1) 4-6-6 to 11-5-4, Exterior(2) 11-5-4 to 17-7-15, Interior(1) 17-7-15 to 19-5-4, Exterior(2) 19-5-4 to 25-7-15, Interior(1) 25-7-15 to 39-4-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Bearing at joint(s) 1, 17, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17 except (jt=lb) 1=142, 10=310.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

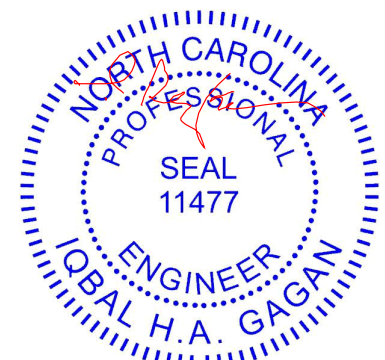

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job J0224-1107	Truss A06-GR	Truss Type PIGGYBACK BASE	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860238
-------------------	-----------------	------------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:36 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

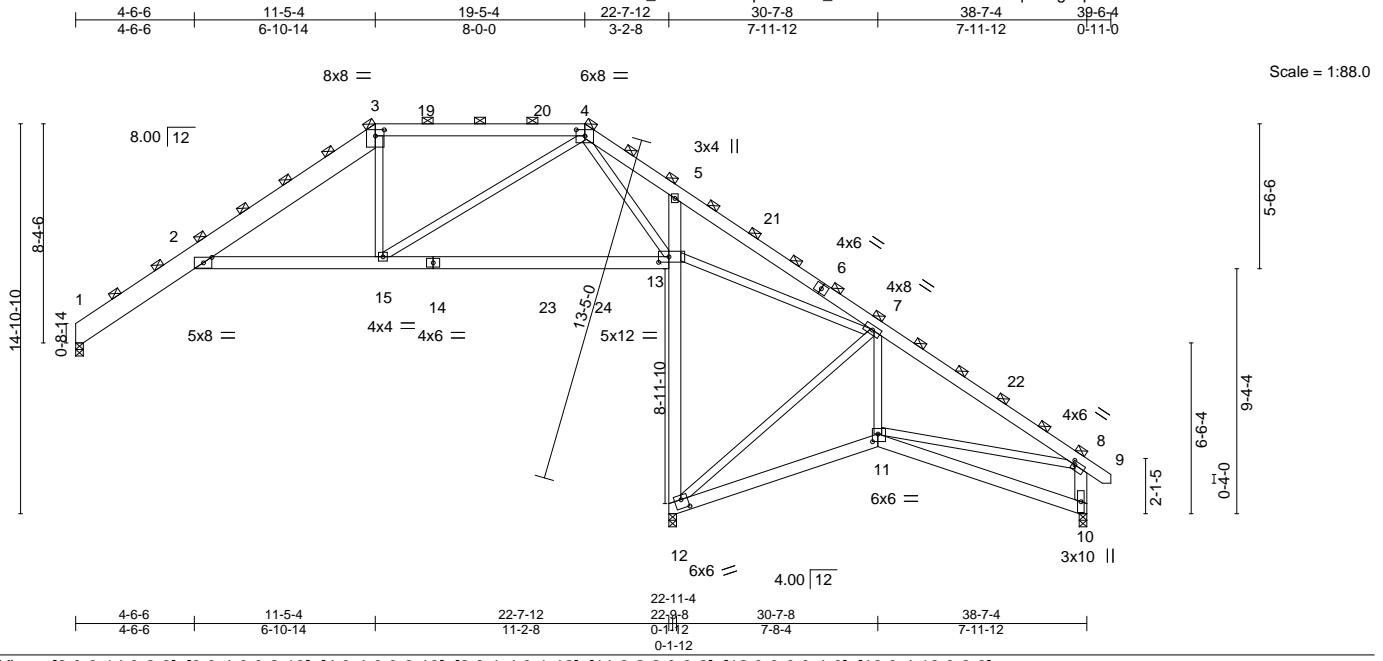


Plate Offsets (X, Y)--	[2:0-3-14,0-2-8], [3:0-4-0,0-2-13], [4:0-4-0,0-2-13], [8:0-1-4,0-1-12], [11:0-2-8,0-3-8], [12:0-3-0,0-4-0], [13:0-4-12,0-2-8]
------------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	5-0-0	TC 0.57	Vert(LL)	-0.25 15-18	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.68	Vert(CT)	-0.51 15-18	>539	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.74	Horz(CT)	0.30 10	n/a	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Wind(LL)	0.28 15-18	>978	240		
	Code IRC2015/TPI2014						Weight: 632 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals (Switched from sheeted: Spacing > 2-8-0).
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 10-11.
WEBS 2x4 SP No.2 *Except* 8-10: 2x6 SP No.1	

REACTIONS. (size) 1=0-3-8, 12=0-3-8, 10=0-3-8
 Max Horz 1=-1028(LC 8)
 Max Uplift 1=-370(LC 12), 12=-181(LC 12), 10=-761(LC 13)
 Max Grav 1=2015(LC 23), 12=4684(LC 1), 10=1515(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1757/1248, 2-3=-2338/969, 3-4=-2117/1161, 4-5=-524/3383, 5-7=-445/3560,
 7-8=-1856/1232, 8-10=-1706/1229
 BOT CHORD 2-15=-522/2350, 13-15=-1274/961, 12-13=-4109/1011, 5-13=-1361/845, 11-12=-697/1227,
 10-11=-312/703
 WEBS 3-15=-566/496, 4-15=-441/2636, 4-13=-4498/967, 7-13=-3118/1341, 7-11=-70/1100,
 8-11=-424/641, 7-12=-1505/851

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-6, Interior(1) 4-6-6 to 11-5-4, Exterior(2) 11-5-4 to 17-7-15, Interior(1) 17-7-15 to 19-5-4, Exterior(2) 19-5-4 to 25-7-15, Interior(1) 25-7-15 to 39-4-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 1, 12, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=370, 12=181, 10=761.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)


TRENCO ENGINEERING BY
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek
J0224-1107	A07	ROOF SPECIAL	2	1	63860239
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:37 2024 Page 1

ID:w_NkYaQd4RDpmohcDK_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

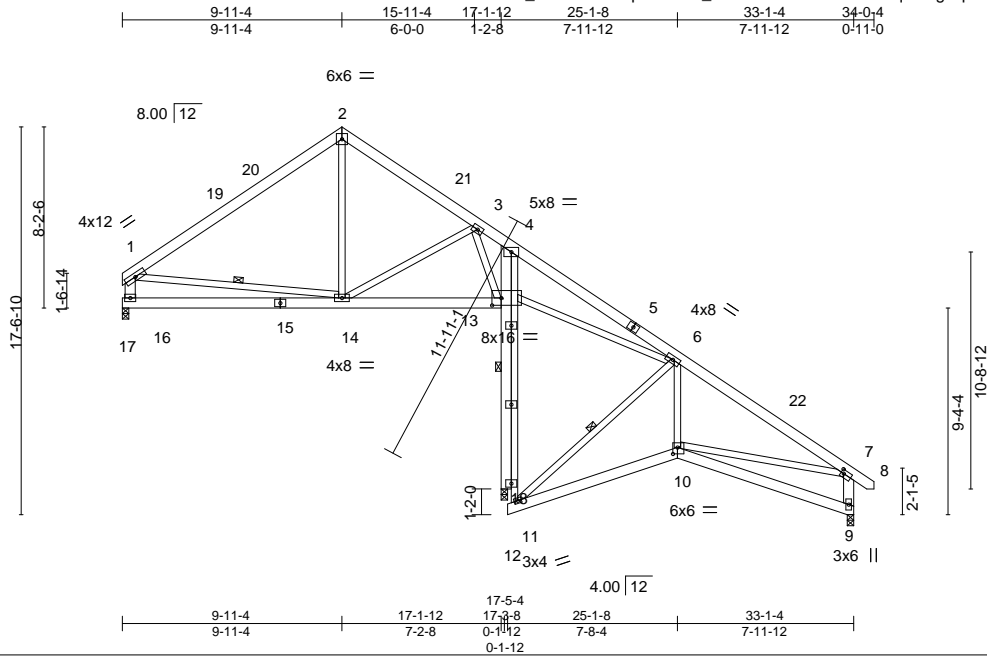

Scale = 1:104.3

Plate Offsets (X,Y)--	[7:0-1-8,0-2-0], [10:0-2-8,0-3-8], [13:0-5-0,0-4-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.32	Vert(LL) -0.04 14-16 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.22	Vert(CT) -0.07 14-16 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.44	Horz(CT) 0.02 18 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.02 10 >999 240	Weight: 306 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except*	WEBS 1 Row at midpt 4-11, 1-14, 6-11
1-16,7-9: 2x6 SP No.1	
OTHERS 2x6 SP No.1	

REACTIONS. (size) 9=0-3-8, 16=0-3-8, 18=0-3-8
 Max Horz 16=-511(LC 13)
 Max Uplift 9=-261(LC 13), 16=-119(LC 12), 18=-158(LC 13)
 Max Grav 9=651(LC 20), 16=636(LC 1), 18=1437(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-615/286, 2-3=-633/317, 3-4=-118/287, 4-6=-4/319, 6-7=-930/525, 1-16=-620/328, 7-9=-774/507
 BOT CHORD 14-16=-261/645, 13-14=-386/408, 10-11=-235/663, 9-10=-126/306
 WEBS 11-18=-104/490, 13-18=-1031/232, 4-13=-528/318, 3-14=0/449, 6-13=-425/369, 6-11=-911/316, 6-10=-12/513, 7-10=-114/348, 3-13=-662/68

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 4-9-1, Interior(1) 4-9-1 to 9-11-4, Exterior(2) 9-11-4 to 14-4-1, Interior(1) 14-4-1 to 33-10-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 4x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 9, 18 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=261, 16=119, 18=158.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss A08	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860240
-------------------	--------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:39 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwrcD0i7J4zJC?f

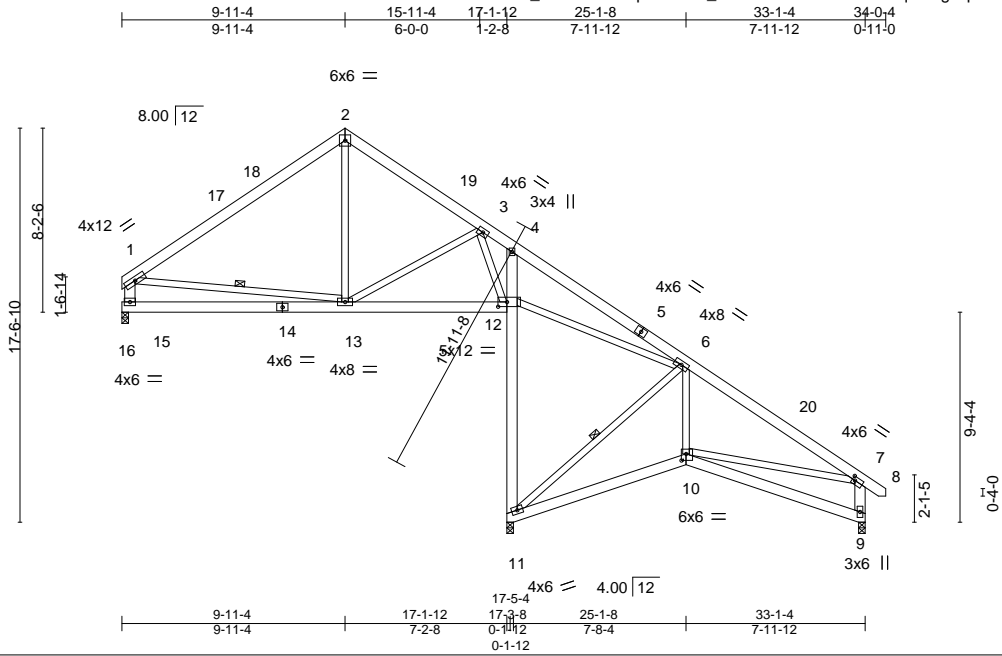

Scale = 1:102.6

Plate Offsets (X,Y)-- [7:0-1-8,0-2-0], [10:0-2-8,0-3-8], [12:0-4-12,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.32	Vert(LL)	-0.04	13-15	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(CT)	-0.08	13-15	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.51	Horz(CT)	-0.03	11	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Wind(LL)	0.02	10	>999		
	Code IRC2015/TPI2014						Weight: 292 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-15,7-9: 2x6 SP No.1	WEBS 1 Row at midpt 1-13, 6-11

REACTIONS. (size) 11=0-3-8, 9=0-3-8, 15=0-3-8
 Max Horz 15=-511(LC 13)
 Max Uplift 11=-143(LC 13), 9=-269(LC 13), 15=-121(LC 12)
 Max Grav 11=1374(LC 1), 9=702(LC 20), 15=652(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-640/295, 2-3=-659/326, 3-4=-139/252, 4-6=-7/289, 6-7=-1043/552, 1-15=-636/334, 7-9=-829/521
 BOT CHORD 13-15=-260/649, 12-13=-302/387, 11-12=-989/213, 4-12=-476/246, 10-11=-265/760, 9-10=-128/313
 WEBS 3-13=-8/393, 6-12=-462/360, 6-11=-933/328, 6-10=-23/536, 7-10=-135/434, 3-12=-644/134

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 4-9-1, Interior(1) 4-9-1 to 9-11-4, Exterior(2) 9-11-4 to 14-4-1, Interior(1) 14-4-1 to 33-10-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 11, 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=143, 9=269, 15=121.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss A09	Truss Type ROOF SPECIAL	Qty 3	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860241
-------------------	--------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:40 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

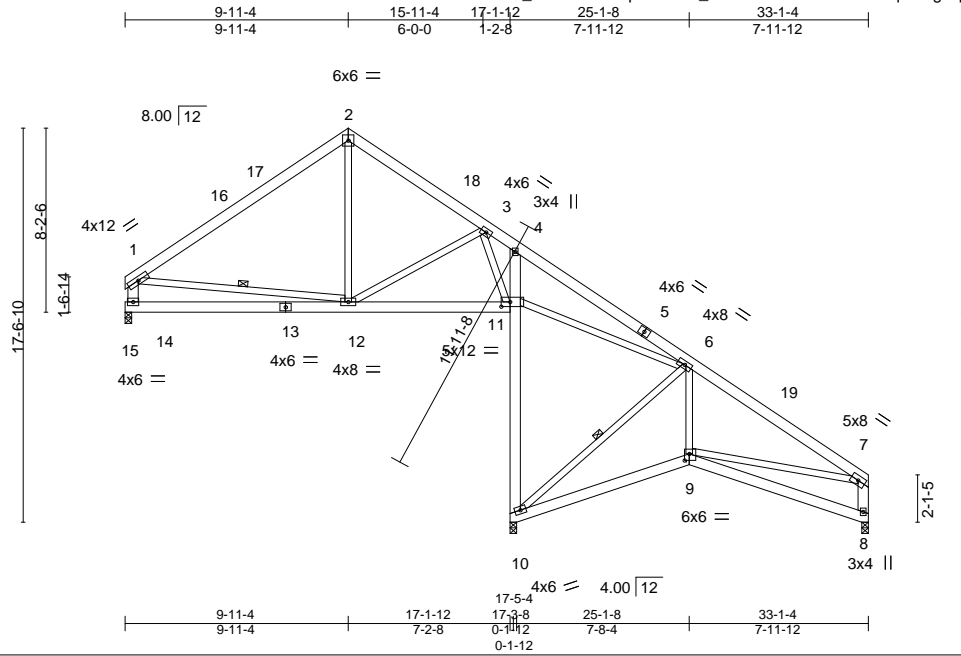

Scale = 1:102.6

Plate Offsets (X,Y)--	[9:0-2-8,0-3-8], [11:0-4-12,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.32	Vert(LL) -0.04 12-14 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.21	Vert(CT) -0.08 12-14 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.51	Horz(CT) -0.03 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.02 9 >999 240	Weight: 290 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-14,7-8: 2x6 SP No.1	WEBS 1 Row at midpt 1-12, 6-10

REACTIONS. (size) 10=0-3-8, 8=0-3-8, 14=0-3-8
 Max Horz 14=-488(LC 13)
 Max Uplift 10=-159(LC 13), 8=-233(LC 13), 14=-120(LC 12)
 Max Grav 10=1377(LC 1), 8=640(LC 20), 14=652(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-636/292, 2-3=-656/320, 4-6=-9/294, 6-7=-1020/511, 1-14=-634/333, 7-8=-741/415
BOT CHORD	12-14=-271/639, 11-12=-285/352, 10-11=-988/226, 4-11=-468/240, 9-10=-291/757, 8-9=-124/252
WEBS	3-12=-11/391, 6-11=-453/337, 6-10=-929/361, 6-9=-33/534, 7-9=-166/482, 3-11=-651/148

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 4-9-1, Interior(1) 4-9-1 to 9-11-4, Exterior(2) 9-11-4 to 14-4-1, Interior(1) 14-4-1 to 32-10-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 10, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=159, 8=233, 14=120.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

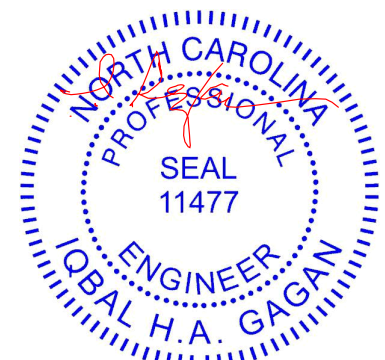

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek
J0224-1107	A10	Hip	1	1	163860242
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:41 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWfCDoi7J4zJC?f

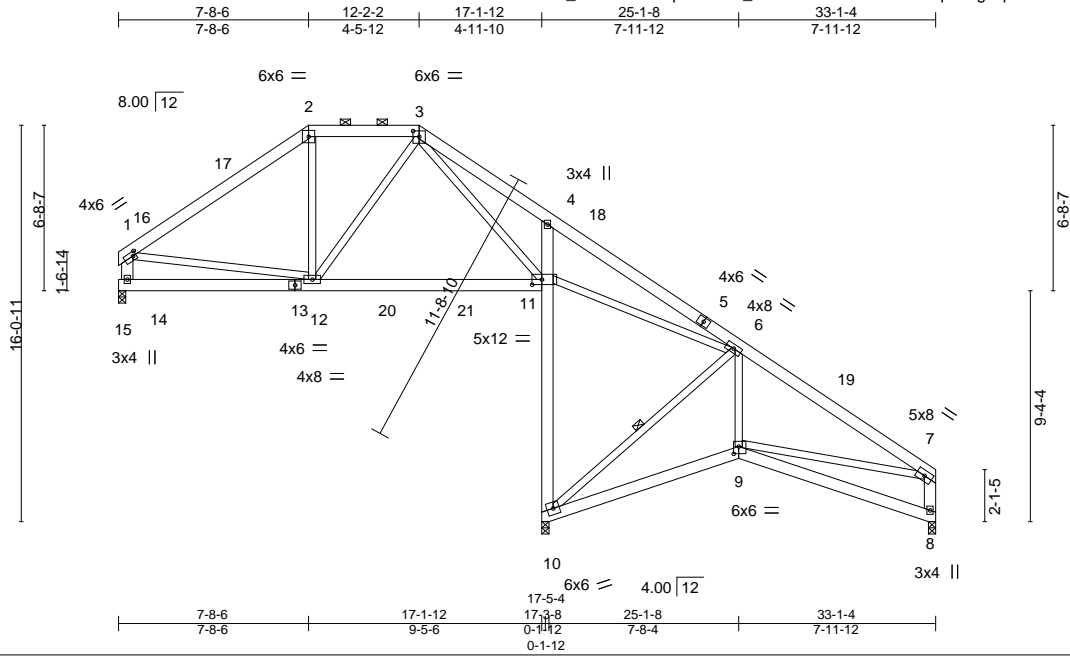

Scale = 1:93.3

Plate Offsets (X,Y)--	[1:0-1-8,0-2-0], [3:0-3-0,0-2-12], [9:0-2-8,0-3-8], [11:0-4-12,0-2-8]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.05 11-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	-0.10 11-12	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.63	Horz(CT)	-0.03 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.02 9	>999	240	Weight: 290 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-14,7-8: 2x6 SP No.1	WEBS 1 Row at midpt 6-10

REACTIONS. (size) 10=0-3-8, 14=0-3-8, 8=0-3-8
 Max Horz 14=465(LC 13)
 Max Uplift 10=161(LC 13), 14=106(LC 12), 8=225(LC 13)
 Max Grav 10=1354(LC 1), 14=662(LC 1), 8=644(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-692/325, 2-3=-606/378, 3-4=-230/294, 6-7=-1013/499, 1-14=-602/328, 7-8=-739/410
BOT CHORD	12-14=-251/471, 11-12=-209/495, 10-11=-953/310, 4-11=-625/415, 9-10=-280/751, 8-9=-124/253
WEBS	3-12=-53/316, 3-11=-579/88, 6-11=-457/363, 6-10=-923/346, 6-9=-29/541, 1-12=-59/324, 7-9=-152/476

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 4-9-1, Interior(1) 4-9-1 to 7-8-6, Exterior(2) 7-8-6 to 18-4-13, Interior(1) 18-4-13 to 32-10-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 10, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=161, 14=106, 8=225.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860243
J0224-1107	A11	Hip	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MITek Industries, Inc. Mon Feb 26 12:41:43 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCdoi7J4zJC?f

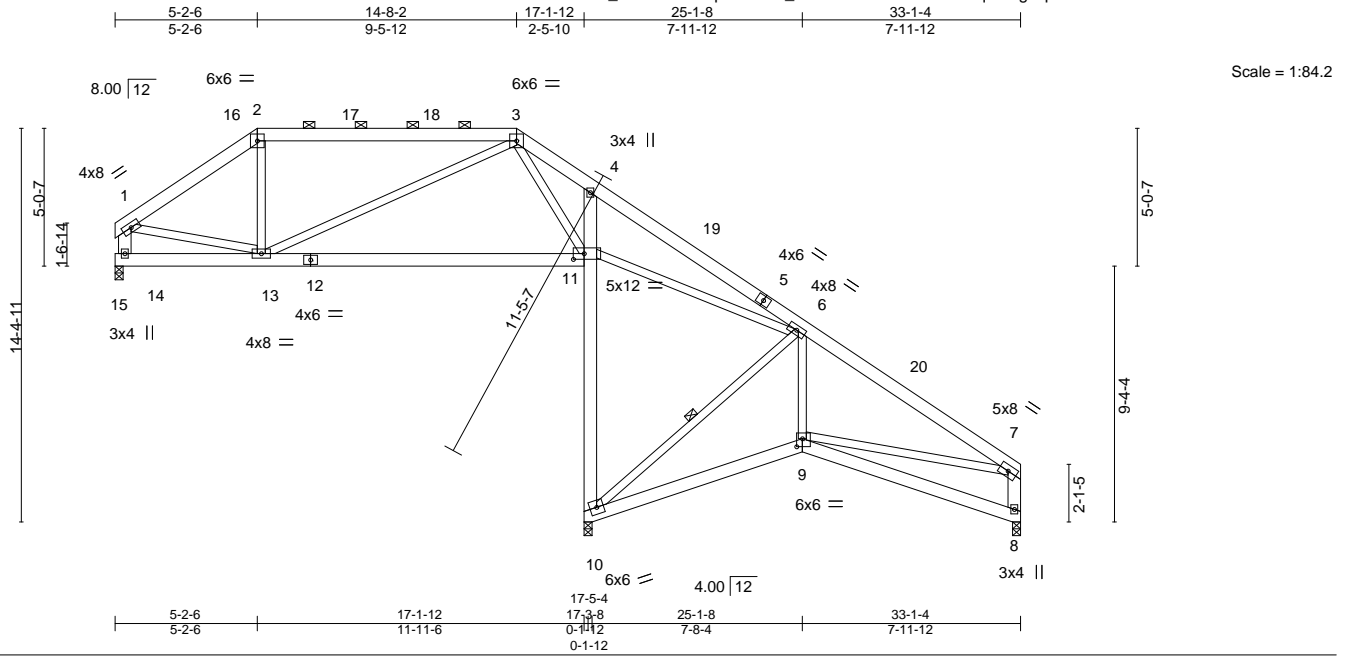


Plate Offsets (X,Y)--	[9:0-2-8,0-3-8], [11:0-4-12,0-2-8]
-----------------------	------------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.38	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.31	Vert(LL) -0.10 11-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.51	Vert(CT) -0.21 11-13 >983 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) -0.03 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.02 9 >999 240	Weight: 281 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-14,7-8: 2x6 SP No.1	WEBS 1 Row at midpt 6-10

REACTIONS. (size) 10=0-3-8, 14=0-3-8, 8=0-3-8
 Max Horz 14=439(LC 13)
 Max Uplift 10=117(LC 13), 14=101(LC 9), 8=237(LC 13)
 Max Grav 10=1369(LC 1), 14=671(LC 23), 8=641(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	BOT CHORD	WEBS
1-2=-782/368, 2-3=-606/390, 4-6=-20/252, 6-7=-1018/528, 1-14=-644/315, 7-8=-740/422	13-14=-326/389, 11-13=-259/403, 10-11=-971/291, 4-11=-453/237, 9-10=-306/757, 8-9=-124/250	3-13=-19/352, 3-11=-735/275, 6-11=-458/306, 6-10=-934/378, 6-9=-39/536, 1-13=-125/571, 7-9=-187/483

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 4-9-1, Interior(1) 4-9-1 to 5-2-6, Exterior(2) 5-2-6 to 11-5-1, Interior(1) 11-5-1 to 14-8-2, Exterior(2) 14-8-2 to 20-10-13, Interior(1) 20-10-13 to 32-10-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 10, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=117, 14=101, 8=237.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

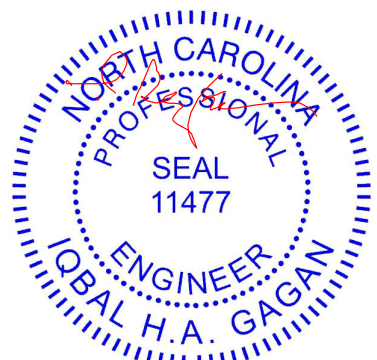

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)

TRENCO ENGINEERING BY A MITek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss A12-GR	Truss Type HIP GIRDER	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860244
-------------------	-----------------	--------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:44 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

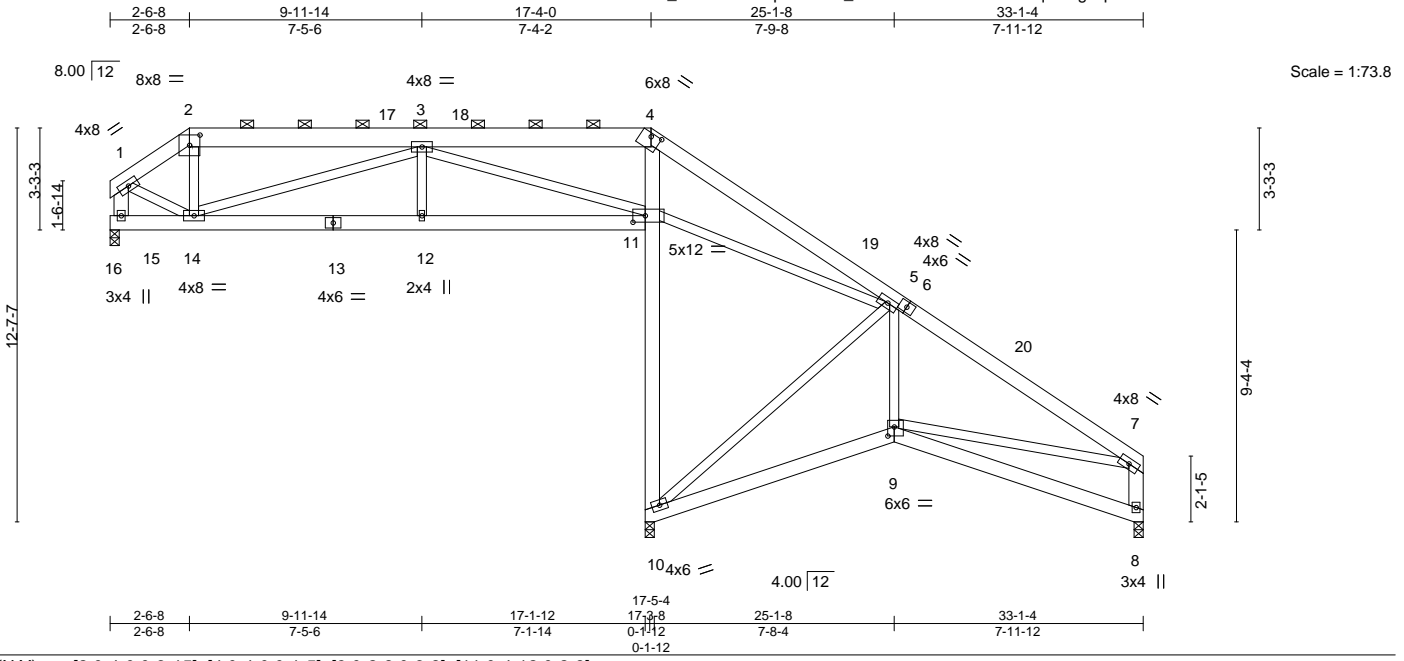


Plate Offsets (X,Y)--	[2:0-4-0,0-3-15], [4:0-4-0,0-1-5], [9:0-2-8,0-3-8], [11:0-4-12,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.14	Vert(LL) -0.02 12 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.10	Vert(CT) -0.03 9-10 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.35	Horz(CT) -0.01 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.02 12 >999 240	Weight: 572 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 2-4: 2x8 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-4.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except* 1-15,7-8: 2x6 SP No.1	

REACTIONS. (size) 10=0-3-8, 15=0-3-8, 8=0-3-8
 Max Horz 15=409(LC 13)
 Max Uplift 10=131(LC 8), 15=138(LC 9), 8=240(LC 13)
 Max Grav 10=1422(LC 1), 15=652(LC 23), 8=630(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-625/299, 2-3=-527/308, 4-5=0/453, 5-7=-1000/508, 1-15=-657/292, 7-8=-729/412
 BOT CHORD 14-15=-398/427, 12-14=-333/998, 11-12=-333/998, 10-11=-1053/298, 4-11=-641/292,
 9-10=-305/743, 8-9=-125/250
 WEBS 3-14=-503/300, 3-12=0/301, 3-11=-1201/435, 5-11=-570/378, 5-10=-912/379,
 5-9=-33/523, 1-14=-219/595, 7-9=-199/470

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-4 to 8-9-3, Interior(1) 8-9-3 to 17-4-0, Exterior(2) 17-4-0 to 23-6-11, Interior(1) 23-6-11 to 32-10-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 10, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=131, 15=138, 8=240.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss B1	Truss Type ATTIC	Qty 3	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860245
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:46 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

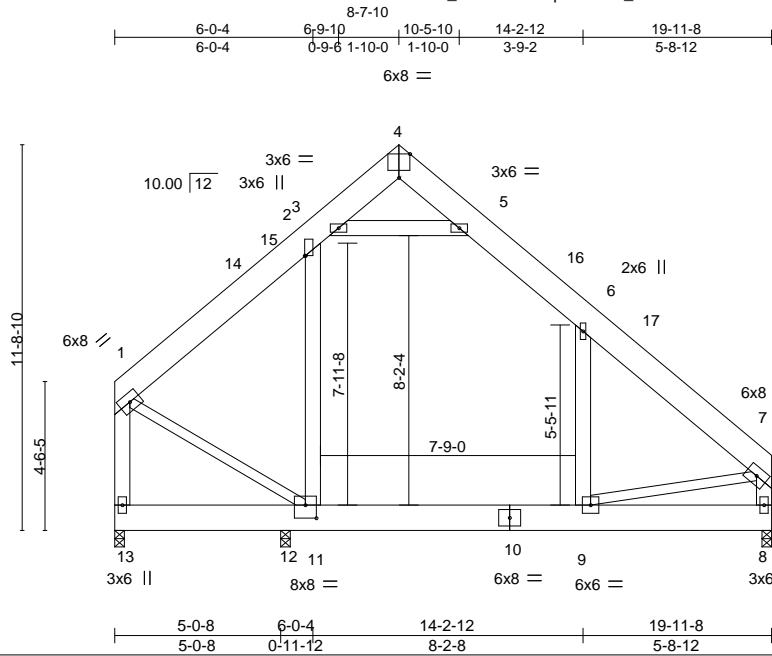

Scale = 1:70.0

Plate Offsets (X,Y)--	[2:0-0,1,0-0-4], [4:0-4-0,Edge], [11:0-4-0,0-4-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.24	Vert(LL) -0.04 9-11 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(CT) -0.08 9-11 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.23	Horz(CT) 0.00 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.03 9 >999 240	Weight: 253 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except* 1-11,7-9: 2x4 SP No.2	

REACTIONS.	(size) 13=0-3-8, 8=0-3-8, 12=0-3-8
	Max Horz 13=-292(LC 8)
	Max Uplift 13=-168(LC 13), 8=-4(LC 13), 12=-437(LC 11)
	Max Grav 13=1530(LC 21), 8=1307(LC 21), 12=402(LC 8)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1344/224, 2-3=-838/291, 5-6=-980/275, 6-7=-1275/86, 1-13=-1551/252, 7-8=-1187/136
BOT CHORD	12-13=-253/288, 11-12=-253/288, 9-11=0/810, 8-9=-83/279
WEBS	2-11=-193/525, 6-9=-52/372, 3-5=-1173/414, 1-11=-74/1169, 7-9=0/628

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 8-7-10, Exterior(2) 8-7-10 to 13-0-6, Interior(1) 13-0-6 to 19-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s), 2-3, 5-6, 3-5; Wall dead load (5.0psf) on member(s), 2-11, 6-9
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room, 9-11
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 13=168, 12=437.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Attic room checked for L/360 deflection.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek
J0224-1107	B1SG	ATTIC STRUCTURAL GAB	1	1	163860246
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MITek Industries, Inc. Mon Feb 26 12:41:47 2024 Page 1



8x8 =

Scale = 1:71.0

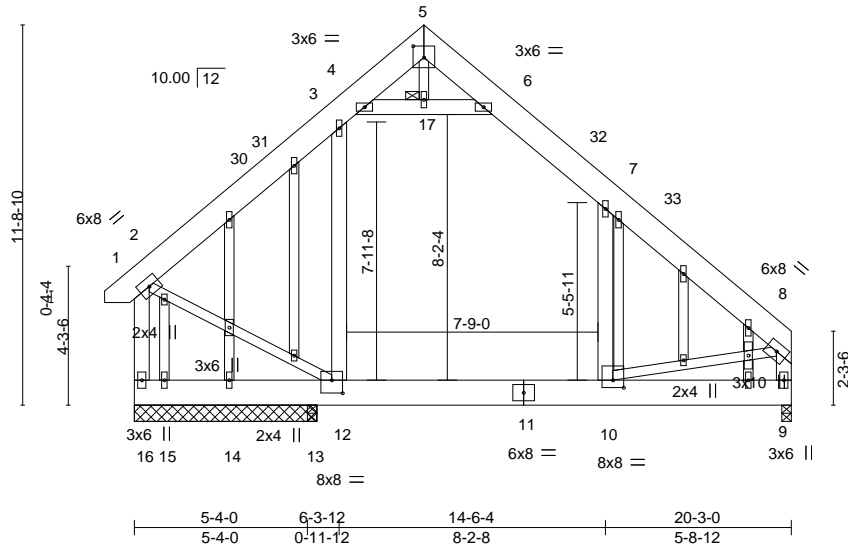


Plate Offsets (X,Y)--	[5:0-4-0,0-4-4], [10:0-4-0,0-2-12], [12:0-4-0,0-4-12]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	-0.04	10-12	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.35	Vert(CT)	-0.08	10-12	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.03	10	>999		
								Weight: 294 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except*	JOINTS 1 Brace at Jt(s): 17
5-17,2-12,8-10: 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. All bearings 5-7-8 except (jt=length) 9=0-3-8, 13=0-3-8.
 (lb) - Max Horz 16=284(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 9, 15 except 16=-221(LC 13), 14=-456(LC 20), 13=-385(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 14, 15 except 16=1535(LC 21), 9=1296(LC 21), 13=501(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1339/234, 3-4=-838/293, 6-7=-969/276, 7-8=-1260/88, 2-16=-1498/289,
 8-9=-1174/138
 BOT CHORD 15-16=-263/281, 14-15=-263/281, 13-14=-263/281, 12-13=-263/281, 10-12=0/788,
 9-10=-83/278
 WEBS 3-12=-212/510, 7-10=-54/361, 4-17=-1103/422, 6-17=-1103/422, 2-12=-76/1113,
 8-10=0/607

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-6-5 to 3-10-8, Interior(1) 3-10-8 to 8-11-2, Exterior(2) 8-11-2 to 13-3-14, Interior(1) 13-3-14 to 20-0-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x6 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Ceiling dead load (10.0 psf) on member(s). 3-4, 6-7, 4-17, 6-17; Wall dead load (5.0psf) on member(s).3-12, 7-10
 - 9) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 15 except (jt=lb) 16=221, 14=456, 13=385.
 - 11) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 12) Attic room checked for L/360 deflection.

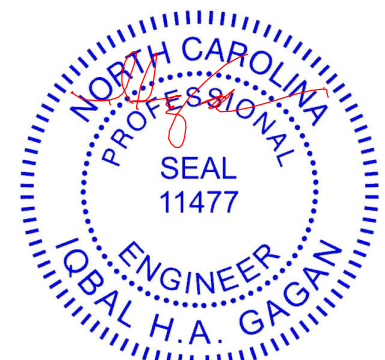

February 27, 2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MITek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss B2	Truss Type ATTIC	Qty 1	Ply 1	Lot 147 Duncan's Creek 163860247
Comtech, Inc. Fayetteville, NC - 28314,					Job Reference (optional)

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:48 2024 Page 1
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

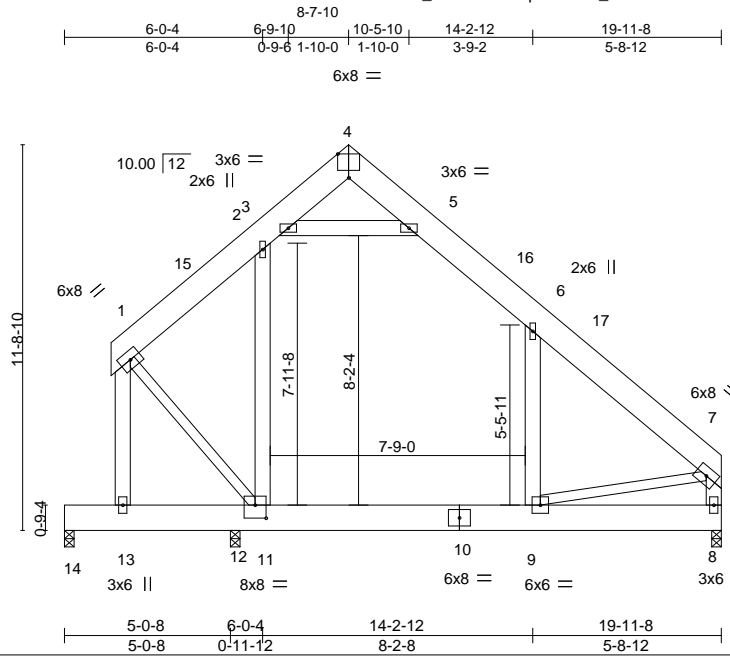

Scale = 1:70.0


Plate Offsets (X,Y)--	[4:0-4-0,Edge], [11:0-4-0,0-4-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.25	Vert(LL) -0.05 9-11 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.42	Vert(CT) -0.10 9-11 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.23	Horz(CT) 0.00 8 n/a n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-AS	Wind(LL) 0.04 9 >999 240	Weight: 248 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except* 1-11,7-9: 2x4 SP No.2	

REACTIONS. (size) 14=0-3-8, 8=0-3-8, 12=0-3-8
 Max Horz 14=-290(LC 8)
 Max Uplift 14=-101(LC 13)
 Max Grav 14=883(LC 21), 8=1095(LC 21), 12=676(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-912/186, 2-3=-741/267, 5-6=-725/238, 6-7=-994/36, 1-13=-1411/226, 7-8=-915/93
 BOT CHORD 13-14=-251/290, 12-13=-230/286, 11-12=-230/286, 9-11=0/649, 8-9=-86/286
 WEBS 6-9=-121/321, 3-5=-935/340, 1-11=-75/1102, 7-9=0/454

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 1-9-4 to 6-3-5, Interior(1) 6-3-5 to 8-7-10, Exterior(2) 8-7-10 to 13-0-6, Interior(1) 13-0-6 to 19-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (10.0 psf) on member(s). 2-3, 5-6, 3-5; Wall dead load (5.0psf) on member(s). 2-11, 6-9
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 9-11
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=101.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Attic room checked for L/360 deflection.

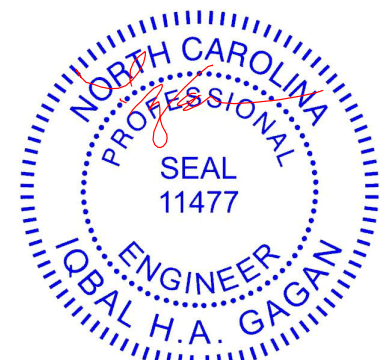

February 27, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY TRENCO A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job J0224-1107	Truss B3	Truss Type ATTIC	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860248
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:49 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

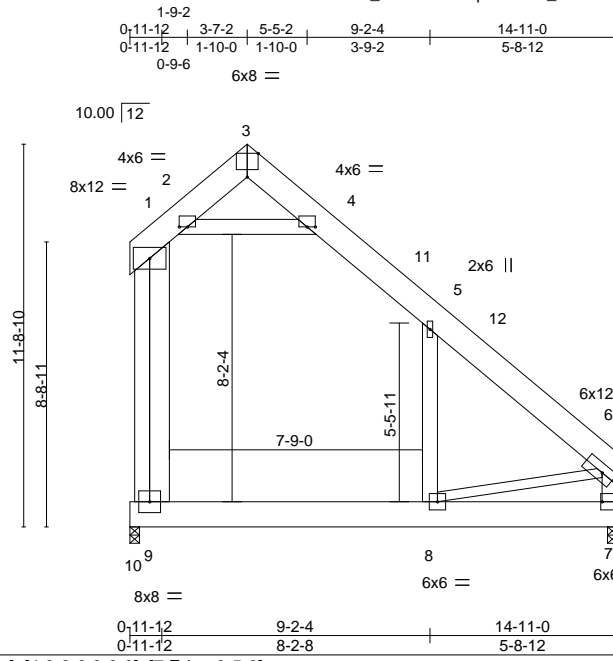

Scale = 1:70.5

Plate Offsets (X,Y)--	[2:0-3-0,0-0-0], [3:0-4-0,Edge], [4:0-3-0,0-0-0], [7:Edge,0-5-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.20	8-9	>825	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.80	Vert(CT)	-0.41	8-9	>411		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.20	8-9	>832		
								Weight: 214 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except*	
1-9: 2x8 SP No.1, 6-8: 2x4 SP No.2	
OTHERS 2x6 SP No.1	

REACTIONS. (size) 7=0-3-8, 9=0-3-8
 Max Horz 9=333(LC 13)
 Max Grav 7=812(LC 21), 9=1324(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-373/141, 2-3=-971/351, 3-4=-515/227, 5-6=-425/89, 6-7=-445/0
 BOT CHORD 8-9=-335/351, 7-8=-142/504
 WEBS 1-9=-668/121, 5-8=-251/313, 2-4=-226/879, 6-8=-850/512

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-7-4 to 7-11-14, Interior(1) 7-11-14 to 14-8-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (10.0 psf) on member(s). 1-2, 4-5, 2-4; Wall dead load (5.0psf) on member(s).1-9, 5-8
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 8-9
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Attic room checked for L/360 deflection.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss B4	Truss Type ATTIC	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860249
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:51 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

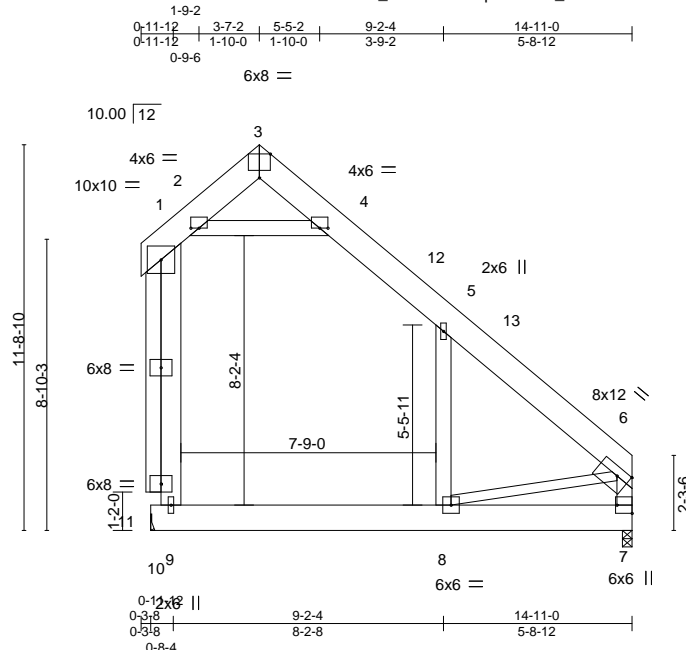

Scale = 1:70.0

Plate Offsets (X,Y)-- [2:0-3-0,0-0-0], [3:0-4-0,Edge], [4:0-3-0,0-0-0], [6:0-4-8,0-3-0], [7:Edge,0-5-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.24	8-9	>726	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.89	Vert(CT)	-0.48	8-9	>358		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.23	8-9	>748		
								Weight: 212 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x10 SP No.1	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x10 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except*	
OTHERS 1-9: 2x8 SP No.1, 6-8: 2x4 SP No.2	
2x6 SP No.1	

REACTIONS. (size) 10=Mechanical, 7=0-3-8
 Max Horz 10=-333(LC 13)
 Max Grav 10=1269(LC 21), 7=835(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-368/138, 2-3=-1019/360, 3-4=-538/232, 5-6=-416/103, 6-7=-441/0
 BOT CHORD 9-10=-335/351, 8-9=-358/358, 7-8=-145/530
 WEBS 1-9=-681/200, 5-8=-225/315, 2-4=-241/947, 6-8=-901/521

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-7-4 to 7-11-14, Interior(1) 7-11-14 to 14-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (10.0 psf) on member(s). 1-2, 4-5, 2-4; Wall dead load (5.0psf) on member(s).1-9, 5-8
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 8-9
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Attic room checked for L/360 deflection.




February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860250
J0224-1107	C1	COMMON	5	1		
Comtech, Inc. Fayetteville, NC - 28314,						Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:52 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

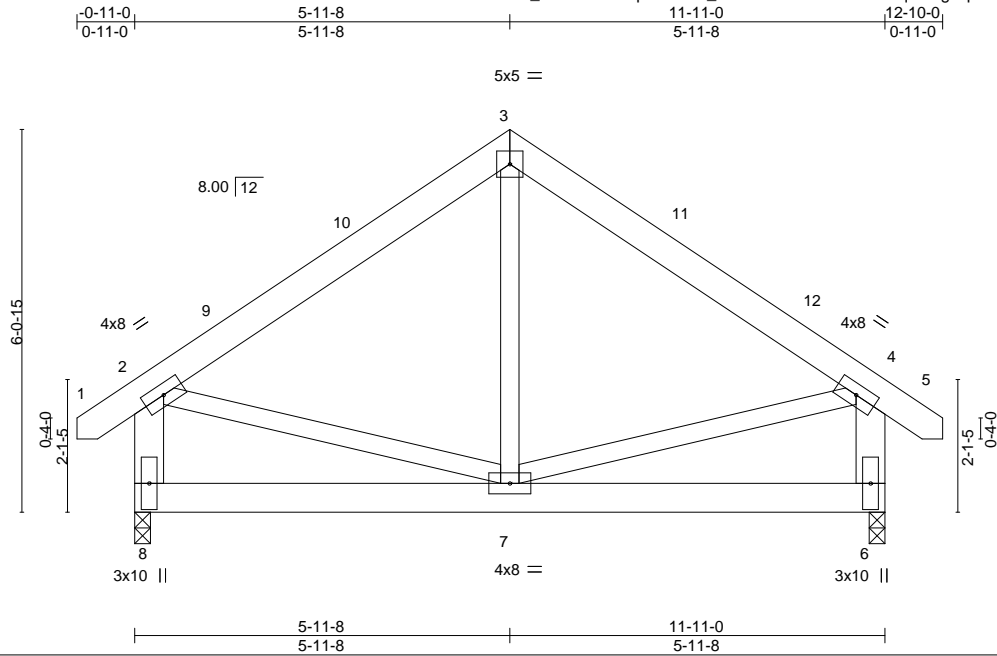

Scale = 1:36.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.12	Vert(LL)	0.02	7-8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	-0.01	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.17	Horz(CT)	-0.00	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS					Weight: 98 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2 *Except*
2-8,4-6: 2x6 SP No.1

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-0, 6=0-3-0
Max Horz 8=-143(LC 10)
Max Uplift 8=-131(LC 9), 6=-131(LC 8)
Max Grav 8=517(LC 1), 6=517(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-412/568, 3-4=-412/568, 2-8=-481/569, 4-6=-481/569
WEBS 3-7=-343/164

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 5-11-8, Exterior(2) 5-11-8 to 10-4-5, Interior(1) 10-4-5 to 12-8-1 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=131, 6=131.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-1107	Truss C1-GR	Truss Type Common Girder	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860251
-------------------	----------------	-----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:54 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

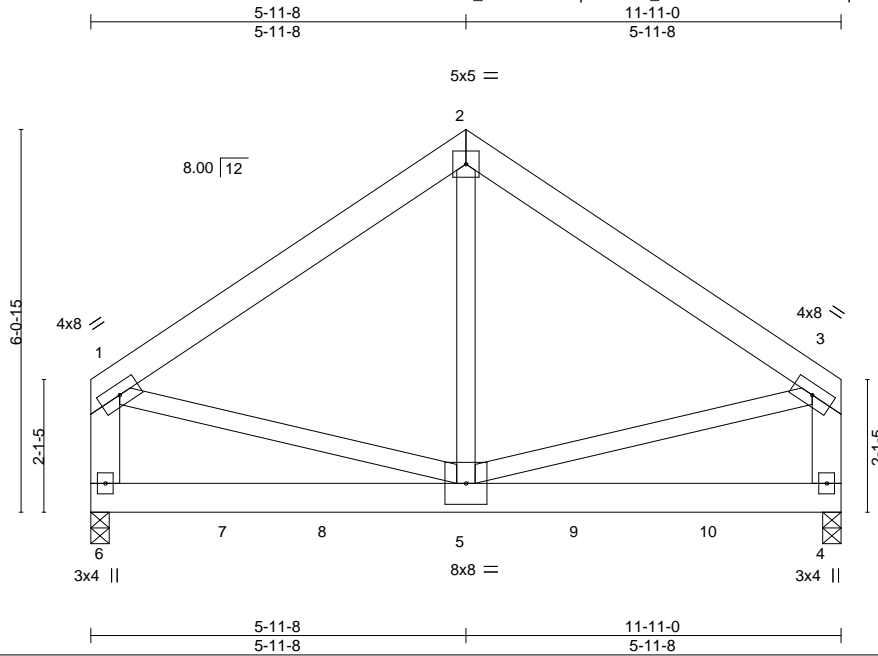

Scale = 1:36.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	0.03 5-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.05 5-6	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.17	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 187 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 1-6,3-4: 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8, 4=0-3-8
 Max Horz 6=122(LC 5)
 Max Uplift 6=-685(LC 8), 4=-680(LC 9)
 Max Grav 6=1876(LC 1), 4=1834(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-1630/636, 2-3=-1630/636, 1-6=-1334/502, 3-4=-1341/503
 BOT CHORD 5-6=-229/375, 4-5=-118/264
 WEBS 2-5=-550/1399, 1-5=-403/1098, 3-5=-411/1123

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=685, 4=680.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 566 lb down and 253 lb up at 2-2-4, 566 lb down and 253 lb up at 3-9-4, 572 lb down and 245 lb up at 5-9-4, and 566 lb down and 257 lb up at 7-9-4, and 558 lb down and 260 lb up at 9-10-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-3=-60, 4-6=-20
 Concentrated Loads (lb)
 Vert: 5=-572 7=-560(F) 8=-560(F) 9=-565 10=-536

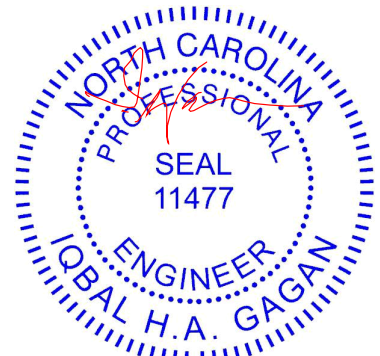

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss C1GE	Truss Type GABLE	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860252
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:53 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



5x5 =

Scale = 1:37.1

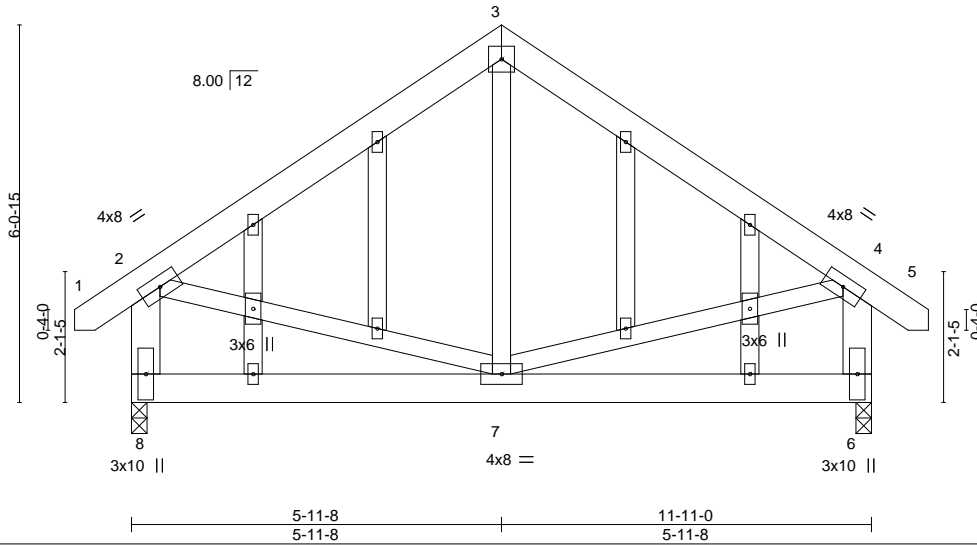

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15		TC 0.13	Vert(LL) 0.02	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15		BC 0.11	Vert(CT) -0.01	7-8	>999	240		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.17	Horz(CT) -0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS						
								Weight: 114 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 2-8,4-6: 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-0, 6=0-3-0
 Max Horz 8=-179(LC 10)
 Max Uplift 8=-188(LC 12), 6=-188(LC 13)
 Max Grav 8=517(LC 1), 6=517(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-412/579, 3-4=-412/579, 2-8=-481/579, 4-6=-481/579
 WEBS 3-7=-340/163

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=188, 6=188.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860253
J0224-1107	D1	COMMON	5	1		

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:55 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

Job Reference (optional)



Scale = 1:33.8

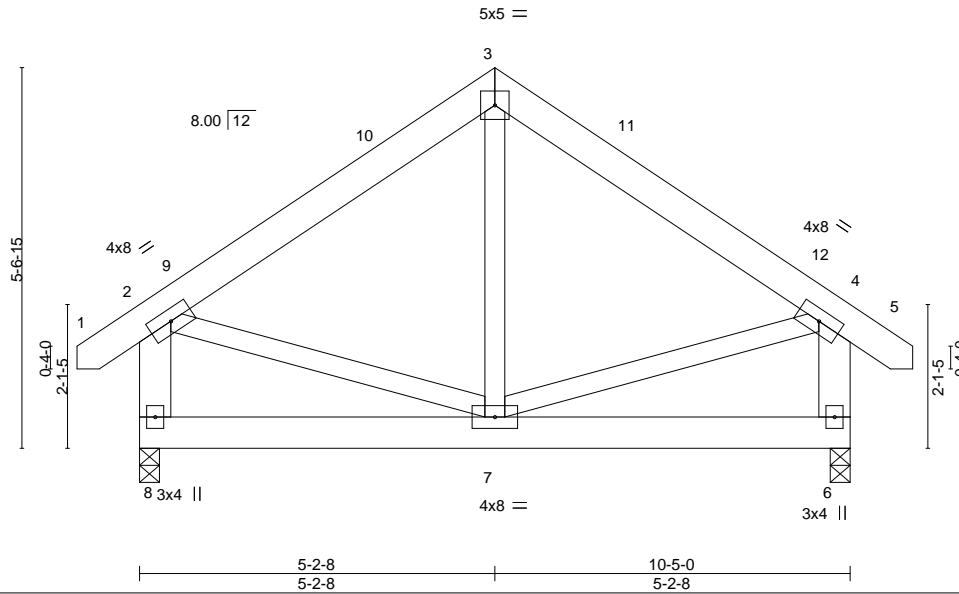

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00 6-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.01 6-7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00 6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.00 7	>999	240		
								Weight: 87 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 2-8,4-6: 2x6 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-8, 6=0-3-8
 Max Horz 8=-127(LC 10)
 Max Uplift 8=-80(LC 12), 6=-80(LC 13)
 Max Grav 8=457(LC 1), 6=457(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-373/202, 3-4=-373/202, 2-8=-459/292, 4-6=-459/292

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 5-2-8, Exterior(2) 5-2-8 to 9-7-5, Interior(1) 9-7-5 to 11-2-1 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss D1-GR	Truss Type Common Girder	Qty 1	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860254
-------------------	----------------	-----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:58 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

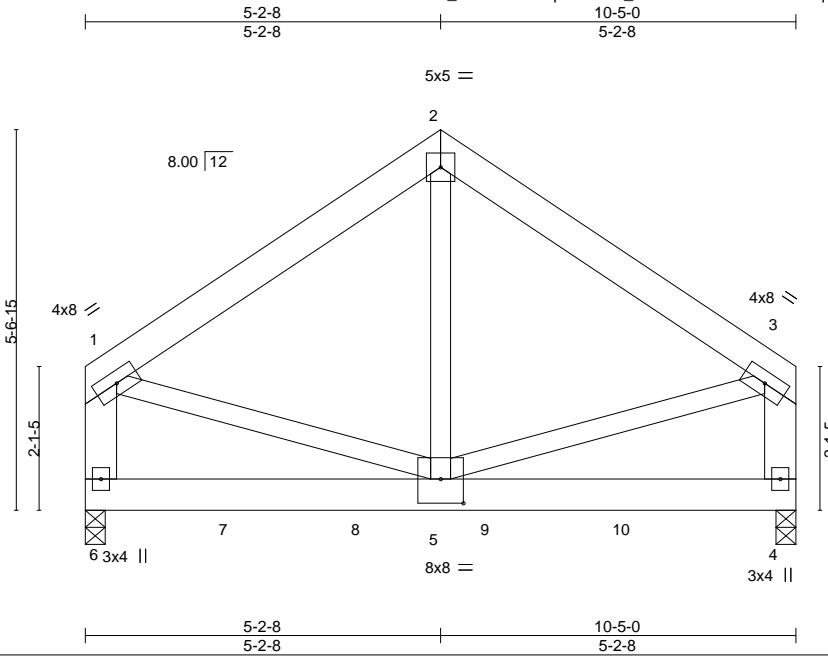

Scale = 1:33.8

Plate Offsets (X,Y)--	[5:0-4-0,0-4-4]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.12	Vert(LL) -0.02 4-5 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.34	Vert(CT) -0.04 4-5 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.17	Horz(CT) 0.00 4 n/a n/a		
BCDL 10.0	Code IRC2015/TP12014	Matrix-MS	Wind(LL) 0.02 5-6 >999 240	Weight: 165 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-6,3-4: 2x6 SP No.1	

REACTIONS.	(size) 6=0-3-8, 4=0-3-8
	Max Horz 6=-106(LC 4)
	Max Uplift 6=-711(LC 8), 4=-303(LC 9)
	Max Grav 6=1671(LC 33), 4=2369(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1586/649, 2-3=-1587/648, 1-6=-1353/529, 3-4=-1332/556
WEBS	2-5=-598/1416, 1-5=-434/1206, 3-5=-523/1152

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=711, 4=303.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 472 lb down and 291 lb up at 2-1-8, 487 lb down and 286 lb up at 4-0-12, 1197 lb down and 708 lb up at 5-11-8, and 600 lb down at 7-10-12, and 607 lb down at 10-2-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-3=-60, 4-6=-20
Concentrated Loads (lb)
Vert: 4=-607(F) 7=-402(F) 8=-454(F) 9=-1130(F) 10=-600(F)



Job J0224-1107	Truss D1GE	Truss Type GABLE	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860255
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:41:57 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



5x5 =

Scale = 1:34.2

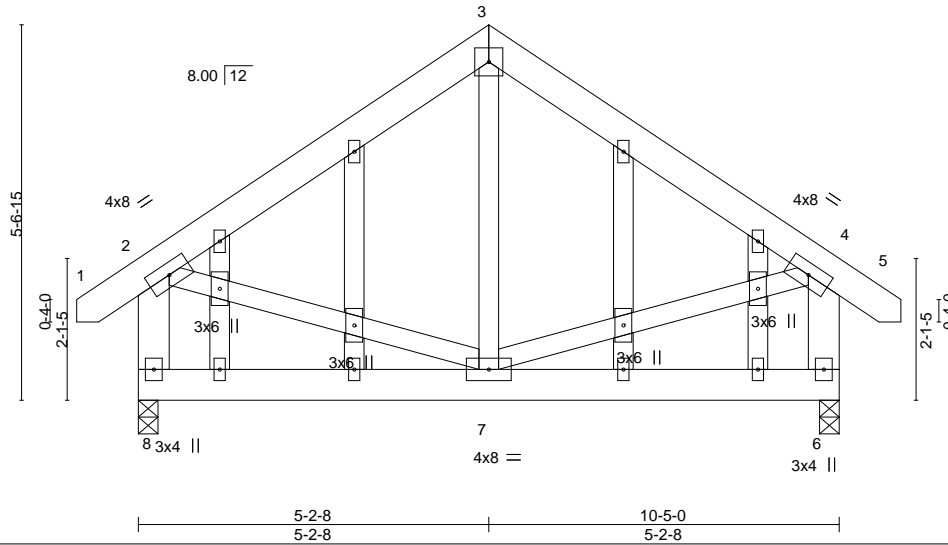

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	6-7	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.01	6-7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-AS	Wind(LL)	0.00	7	>999		
								Weight: 102 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 2-8,4-6: 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-8, 6=0-3-8
 Max Horz 8=-159(LC 10)
 Max Uplift 8=-166(LC 12), 6=-166(LC 13)
 Max Grav 8=457(LC 1), 6=457(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-373/208, 3-4=-373/208, 2-8=-459/298, 4-6=-459/297

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=166, 6=166.
 - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



Job J0224-1107	Truss G1GE	Truss Type COMMON STRUCTURAL GA	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860256
-------------------	---------------	------------------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:00 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



6x6 =

Scale = 1:53.4

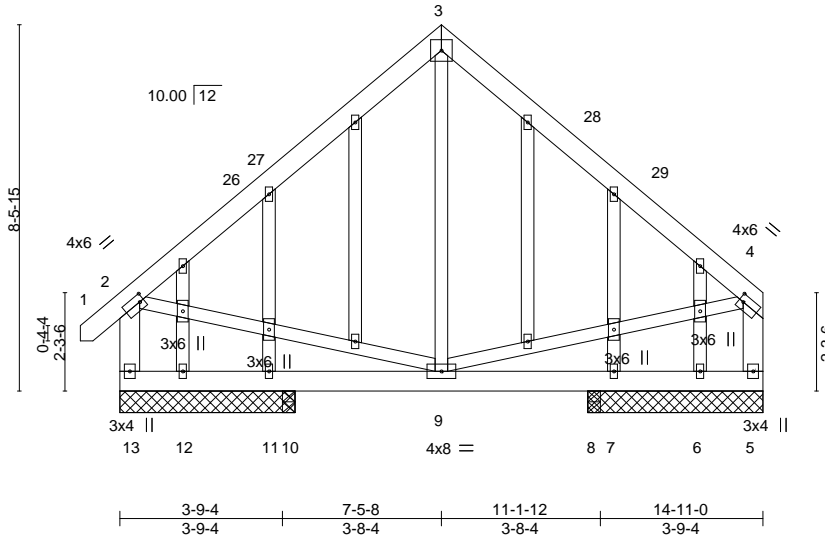


Plate Offsets (X,Y)--	[2:0-1-4,0-2-0], [4:0-1-4,0-2-0]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) -0.00 9 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.11	Vert(CT) -0.01 9 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) -0.00 5 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.00 9 >999 240	Weight: 158 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2 *Except*	
OTHERS 2-13,4-5: 2x6 SP No.1	
2x4 SP No.2	

REACTIONS. All bearings 4-0-12 except (jt=length) 10=0-3-8, 8=0-3-8.
 (lb) - Max Horz 13=210(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 11, 12, 7, 6 except 13=-175(LC 12), 5=-163(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 12, 7, 6, 10, 8 except 13=559(LC 1), 5=491(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-476/303, 3-4=-468/296, 2-13=-574/375, 4-5=-516/307
 BOT CHORD 12-13=-290/314, 11-12=-290/314, 10-11=-290/314, 9-10=-290/314

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-4 to 3-7-9, Interior(1) 3-7-9 to 7-5-8, Exterior(2) 7-5-8 to 11-10-5, Interior(1) 11-10-5 to 14-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 12, 7, 6 except (jt=lb) 13=175, 5=163.
 - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss M1	Truss Type MONOPITCH	Qty 4	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	I63860257
-------------------	-------------	-------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:01 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

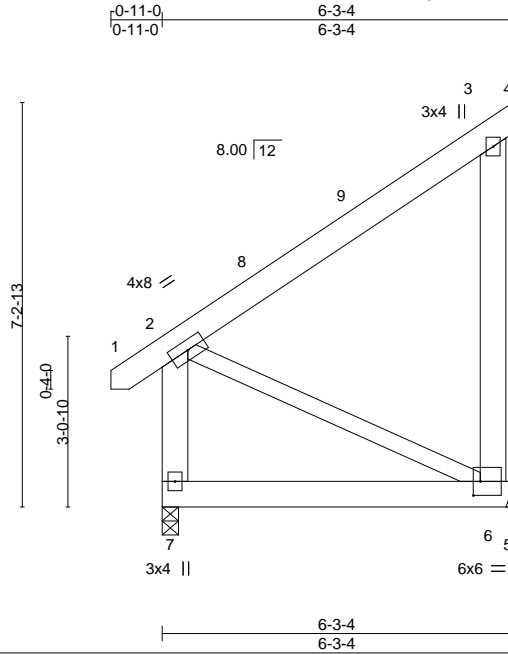

Scale = 1:41.2

Plate Offsets (X,Y)--	[6:0-1-8,0-3-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.23	Vert(LL) -0.01 6-7 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.12	Vert(CT) -0.03 6-7 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.22	Horz(CT) -0.00 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.00 7 **** 240	Weight: 64 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1 *Except*
2-6: 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 7=0-3-8, 6=Mechanical
Max Horz 7=216(LC 9)
Max Uplift 6=202(LC 12)
Max Grav 7=291(LC 1), 6=331(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-6=-299/262
BOT CHORD 6-7=-376/320
WEBS 2-6=-354/416

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 6-3-4 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=202.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

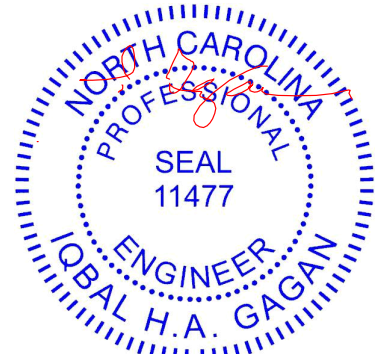

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek
J0224-1107	M1GE	GABLE	1	1	163860258
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:02 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

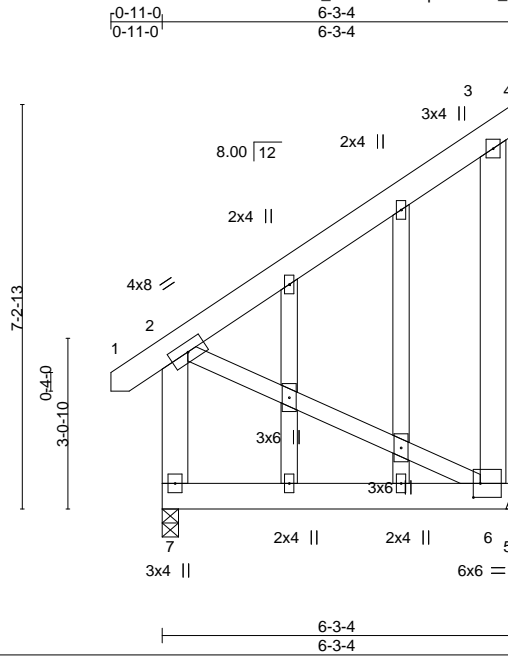

Scale = 1:41.2

Plate Offsets (X,Y)--	[6:0-1-8,0-3-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.23	Vert(LL) -0.01 6-7 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.12	Vert(CT) -0.03 6-7 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.22	Horz(CT) -0.00 6 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-AS	Wind(LL) 0.00 7 **** 240	Weight: 76 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied, excepting end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied.
WEBS 2x6 SP No.1 *Except*	
2-6: 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. (size) 7=0-3-8, 6=Mechanical
 Max Horz 7=254(LC 9)
 Max Uplift 6=323(LC 12)
 Max Grav 7=291(LC 1), 6=349(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-6=-299/280
 BOT CHORD 6-7=-394/320
 WEBS 2-6=-354/436

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable studs spaced at 2-0-0 oc.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=323.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163860259
J0224-1107	M2	HALF HIP	4	1		
					Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:03 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

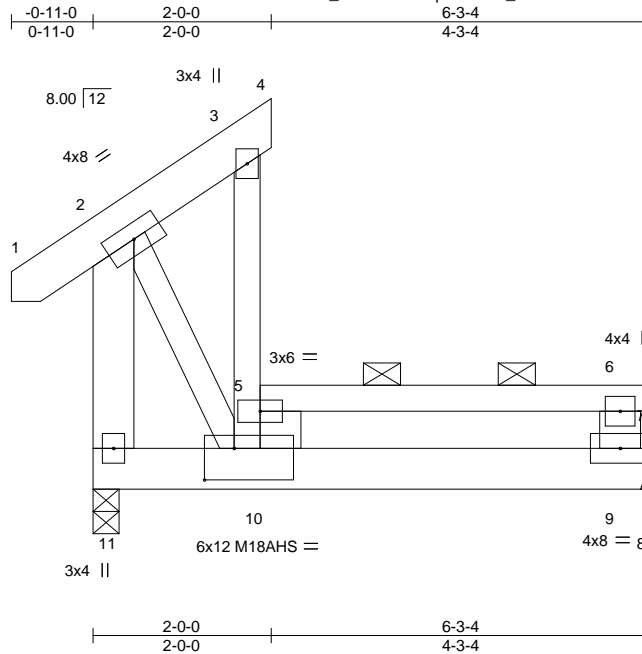

Scale = 1:25.9

Plate Offsets (X,Y)--	[10:0-4-0,0-4-4]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.54	Vert(LL)	-0.02	10	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.60	Vert(CT)	-0.04	9-10	>999	240	M18AHS	186/179
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.06	Horz(CT)	-0.00	9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.06	9-10	>999	240		
				Weight: 46 lb		FT = 20%				

LUMBER-
TOP CHORD 2x6 SP No.1 *Except*
5-7: 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1 *Except*
3-10,2-10: 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-10, 5-7. Except:
6-0-0 oc bracing: 3-5
BOT CHORD Rigid ceiling directly applied or 7-10-10 oc bracing.

REACTIONS. (size) 9=Mechanical, 11=0-3-8
Max Horz 11=169(LC 13)
Max Uplift 9=-160(LC 13), 11=-135(LC 9)
Max Grav 9=385(LC 1), 11=663(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 5-10=-613/515, 5-6=-820/760, 6-9=-184/255
BOT CHORD 10-11=-341/311, 9-10=-760/820
WEBS 2-10=-220/326

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 2-0-0, Interior(1) 1-8-12 to 6-3-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=160, 11=135.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-3=-60, 3-4=-20, 5-6=-60, 6-7=-60, 8-11=-20

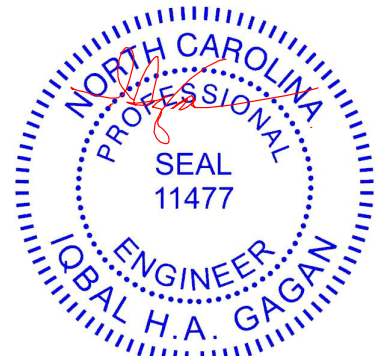

February 27, 2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	I63860259
J0224-1107	M2	HALF HIP	4	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:03 2024 Page 2
 ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard
 Concentrated Loads (lb)
 Vert: 5=-500(F)



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss M2-GR	Truss Type HALF HIP	Qty 2	Ply 2	Lot 147 Duncan's Creek Job Reference (optional)	163860260
-------------------	----------------	------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:04 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

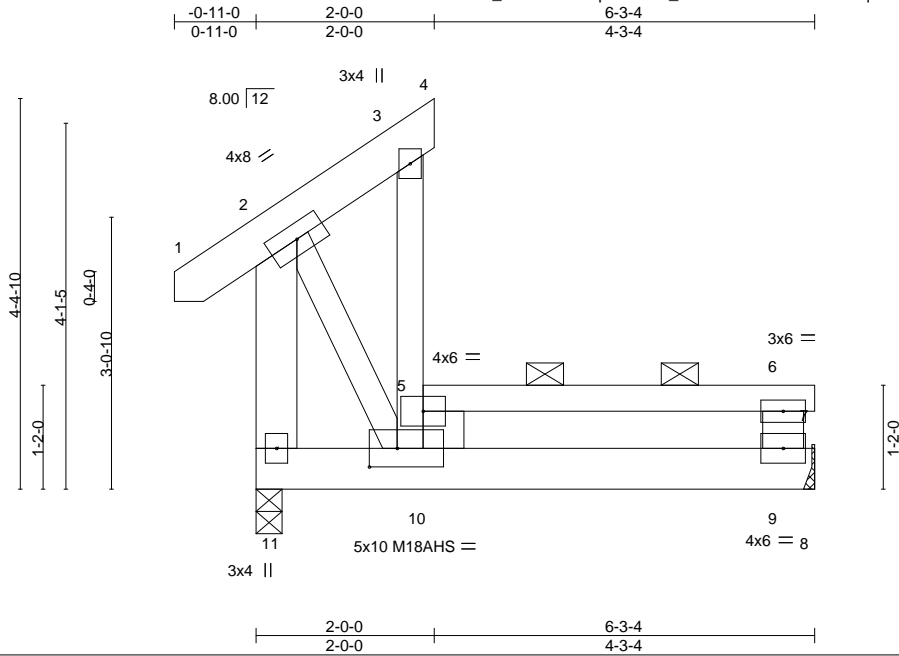


Plate Offsets (X,Y)--	[10:0-3-12,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.59	Vert(LL) -0.02 10 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.50	Vert(CT) -0.04 9-10 >999 240	M18AHS	186/179
BCLL 0.0 *	Rep Stress Incr NO	WB 0.01	Horz(CT) 0.00 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.03 10 >999 240	Weight: 92 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 5-7: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-10, 5-7.
BOT CHORD 2x6 SP No.1	Exception: 10-0-0 oc bracing: 3-5
WEBS 2x6 SP No.1 *Except* 3-10,2-10: 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 9=Mechanical, 11=0-3-8
 Max Horz 11=169(LC 9)
 Max Uplift 9=-379(LC 9), 11=-246(LC 5)
 Max Grav 9=1444(LC 16), 11=1184(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 5-10=-1017/258, 5-6=-1532/480, 6-9=-1097/292, 2-11=-273/26
 BOT CHORD 9-10=-480/1532

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-8-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x6 - 2 rows staggered at 0-2-0 oc, 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=379, 11=246.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard



February 27, 2024

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	I63860260
J0224-1107	M2-GR	HALF HIP	2	2	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:04 2024 Page 2
 ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-2=-60, 2-3=-60, 3-4=-20, 5-6=-360(F=-300), 6-7=-360(F=-300), 8-11=-20
- Concentrated Loads (lb)
 - Vert: 5=-500(F)

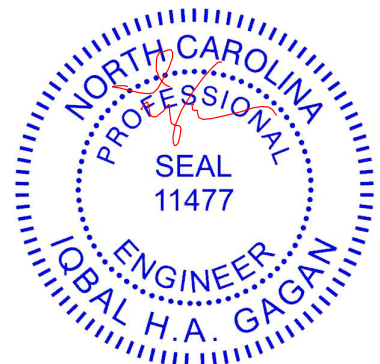

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss PB1	Truss Type Piggyback	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860261
-------------------	--------------	-------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:05 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f
6-6-10 5-1-4 8-0-0 1-5-6



Scale: 3/4"=1'

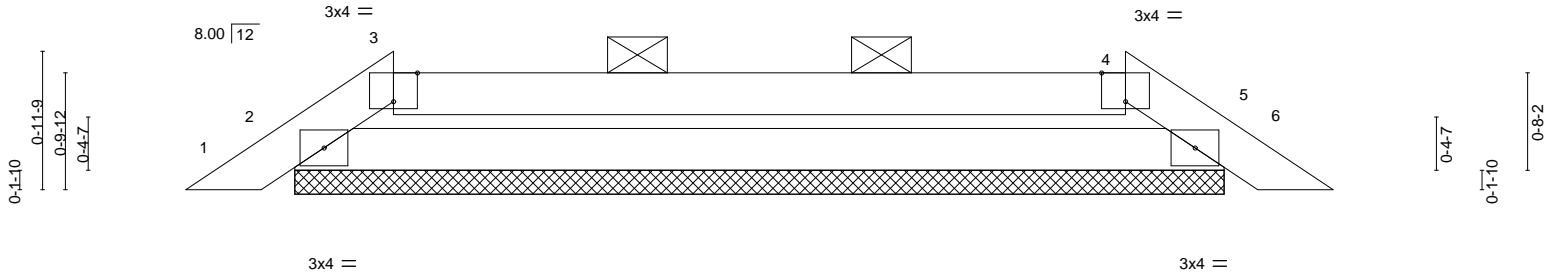


Plate Offsets (X, Y)--	[3:0-2-0,Edge], [4:0-2-0,Edge]
------------------------	--------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.00	6	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.29	Vert(CT)	0.00	6	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 22 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-5-5 oc bracing.

REACTIONS. (size) 2=6-5-12, 5=6-5-12
 Max Horz 2=23(LC 11)
 Max Uplift 2=-57(LC 9), 5=-57(LC 8)
 Max Grav 2=289(LC 1), 5=289(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-521/522, 3-4=-494/486, 4-5=-521/523
 BOT CHORD 2-5=-440/494

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
 - 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss PB2	Truss Type Piggyback	Qty 4	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860262
-------------------	--------------	-------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:06 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

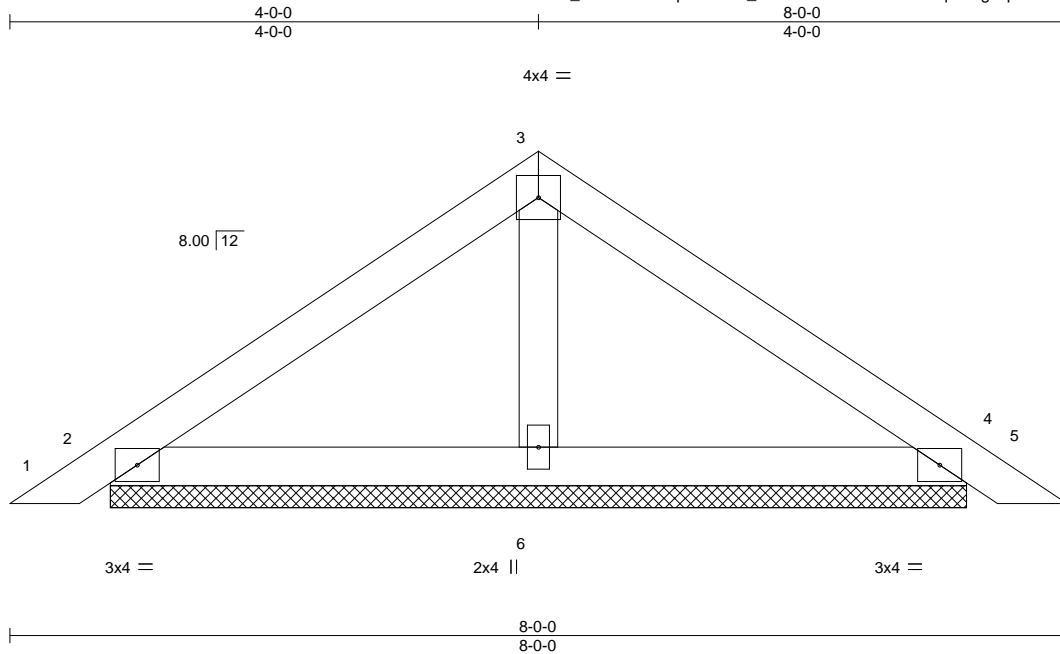

Scale = 1:17.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	0.00	5	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	0.01	5	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 27 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=6-5-12, 4=6-5-12, 6=6-5-12
 Max Horz 2=80(LC 11)
 Max Uplift 2=-55(LC 12), 4=-63(LC 13)
 Max Grav 2=173(LC 1), 4=174(LC 20), 6=232(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

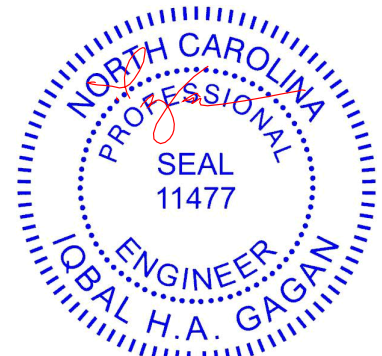

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss VC1	Truss Type VALLEY	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860263
-------------------	--------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,



8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:07 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



4x4 =

Scale = 1:18.4

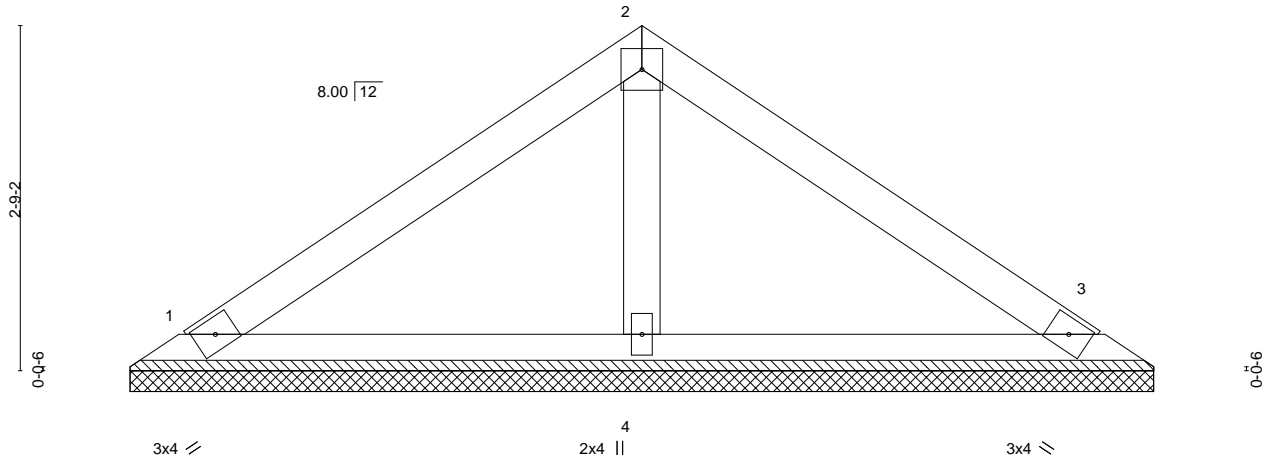

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 28 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=8-2-5, 3=8-2-5, 4=8-2-5
Max Horz 1=78(LC 11)
Max Uplift 1=-48(LC 12), 3=-55(LC 13), 4=-4(LC 12)
Max Grav 1=159(LC 1), 3=161(LC 20), 4=266(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- 6) Non Standard bearing condition. Review required.

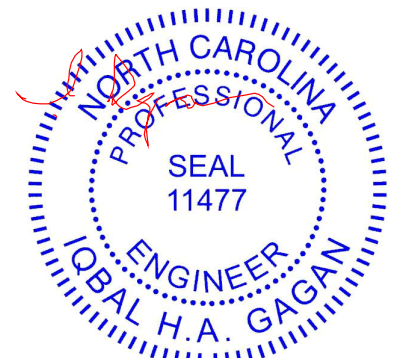

February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0224-1107	Truss VC2	Truss Type VALLEY	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860264
-------------------	--------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:08 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

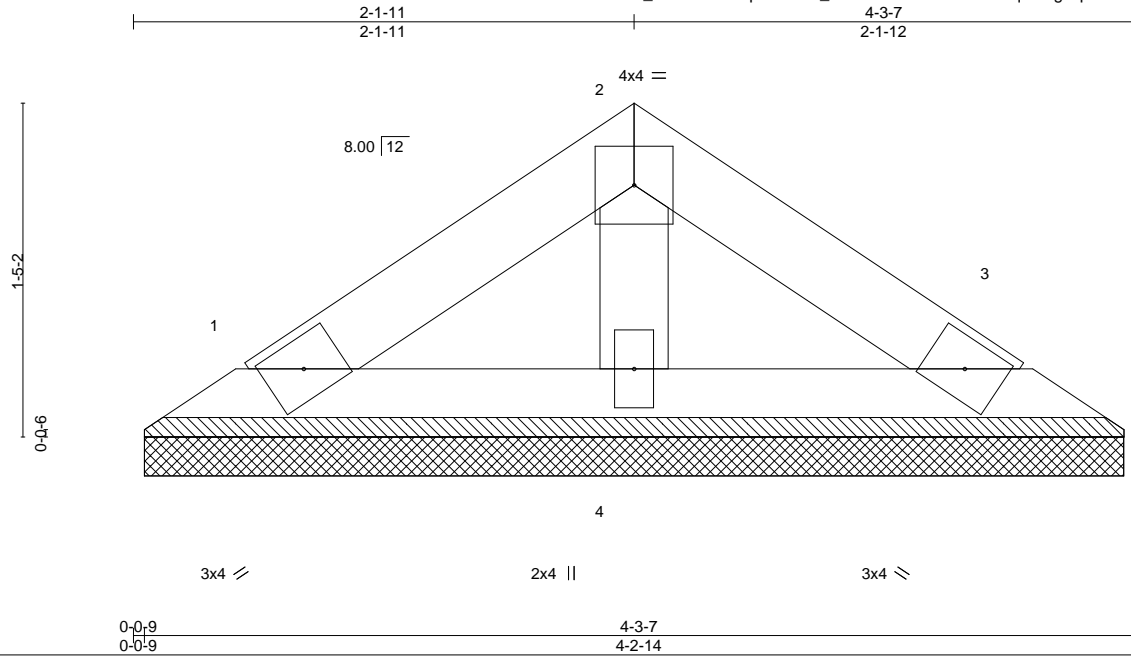

Scale = 1:9.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 13 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-3-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-2-5, 3=4-2-5, 4=4-2-5
 Max Horz 1=35(LC 9)
 Max Uplift 1=21(LC 12), 3=25(LC 13), 4=2(LC 12)
 Max Grav 1=72(LC 1), 3=73(LC 20), 4=120(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
 - 6) Non Standard bearing condition. Review required.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0224-1107	Truss VD1	Truss Type VALLEY	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163860265
-------------------	--------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 12:42:09 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



4x4 =

Scale = 1:15.6

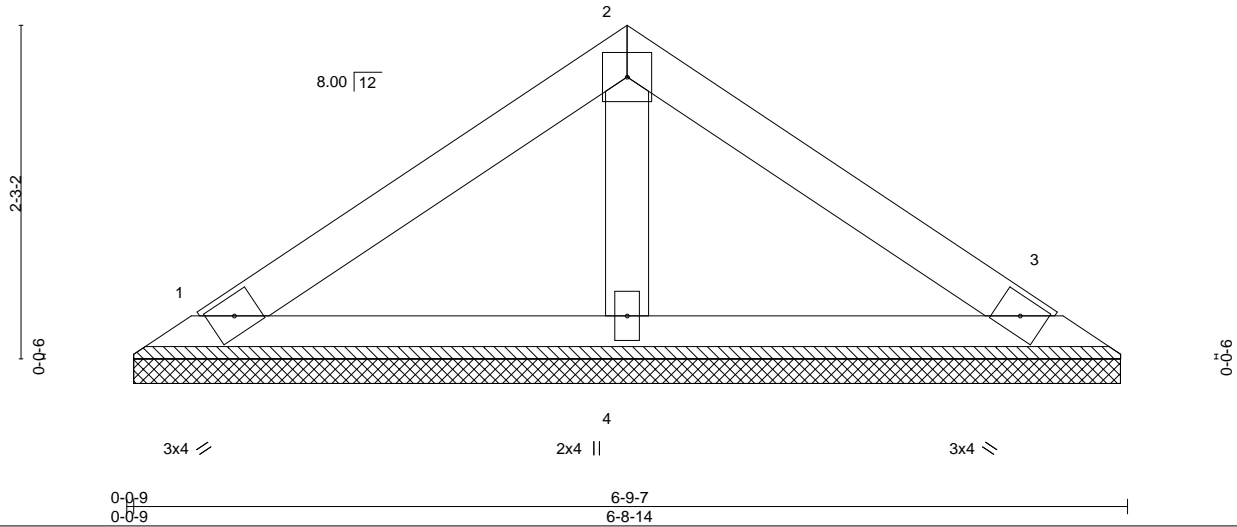

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 23 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-8-5, 3=6-8-5, 4=6-8-5
 Max Horz 1=62(LC 11)
 Max Uplift 1=38(LC 12), 3=-44(LC 13), 4=-3(LC 12)
 Max Grav 1=126(LC 1), 3=128(LC 20), 4=212(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- 6) Non Standard bearing condition. Review required.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Symbols


PLATE LOCATION AND ORIENTATION

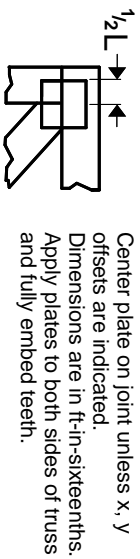

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

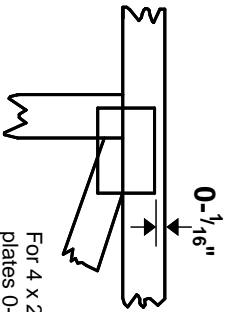

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

* Plate location details available in MITek software or upon request.

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

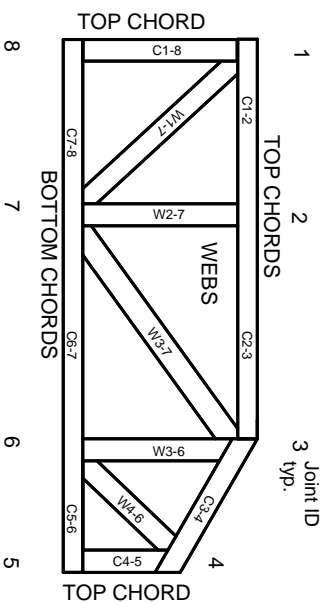

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek


ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

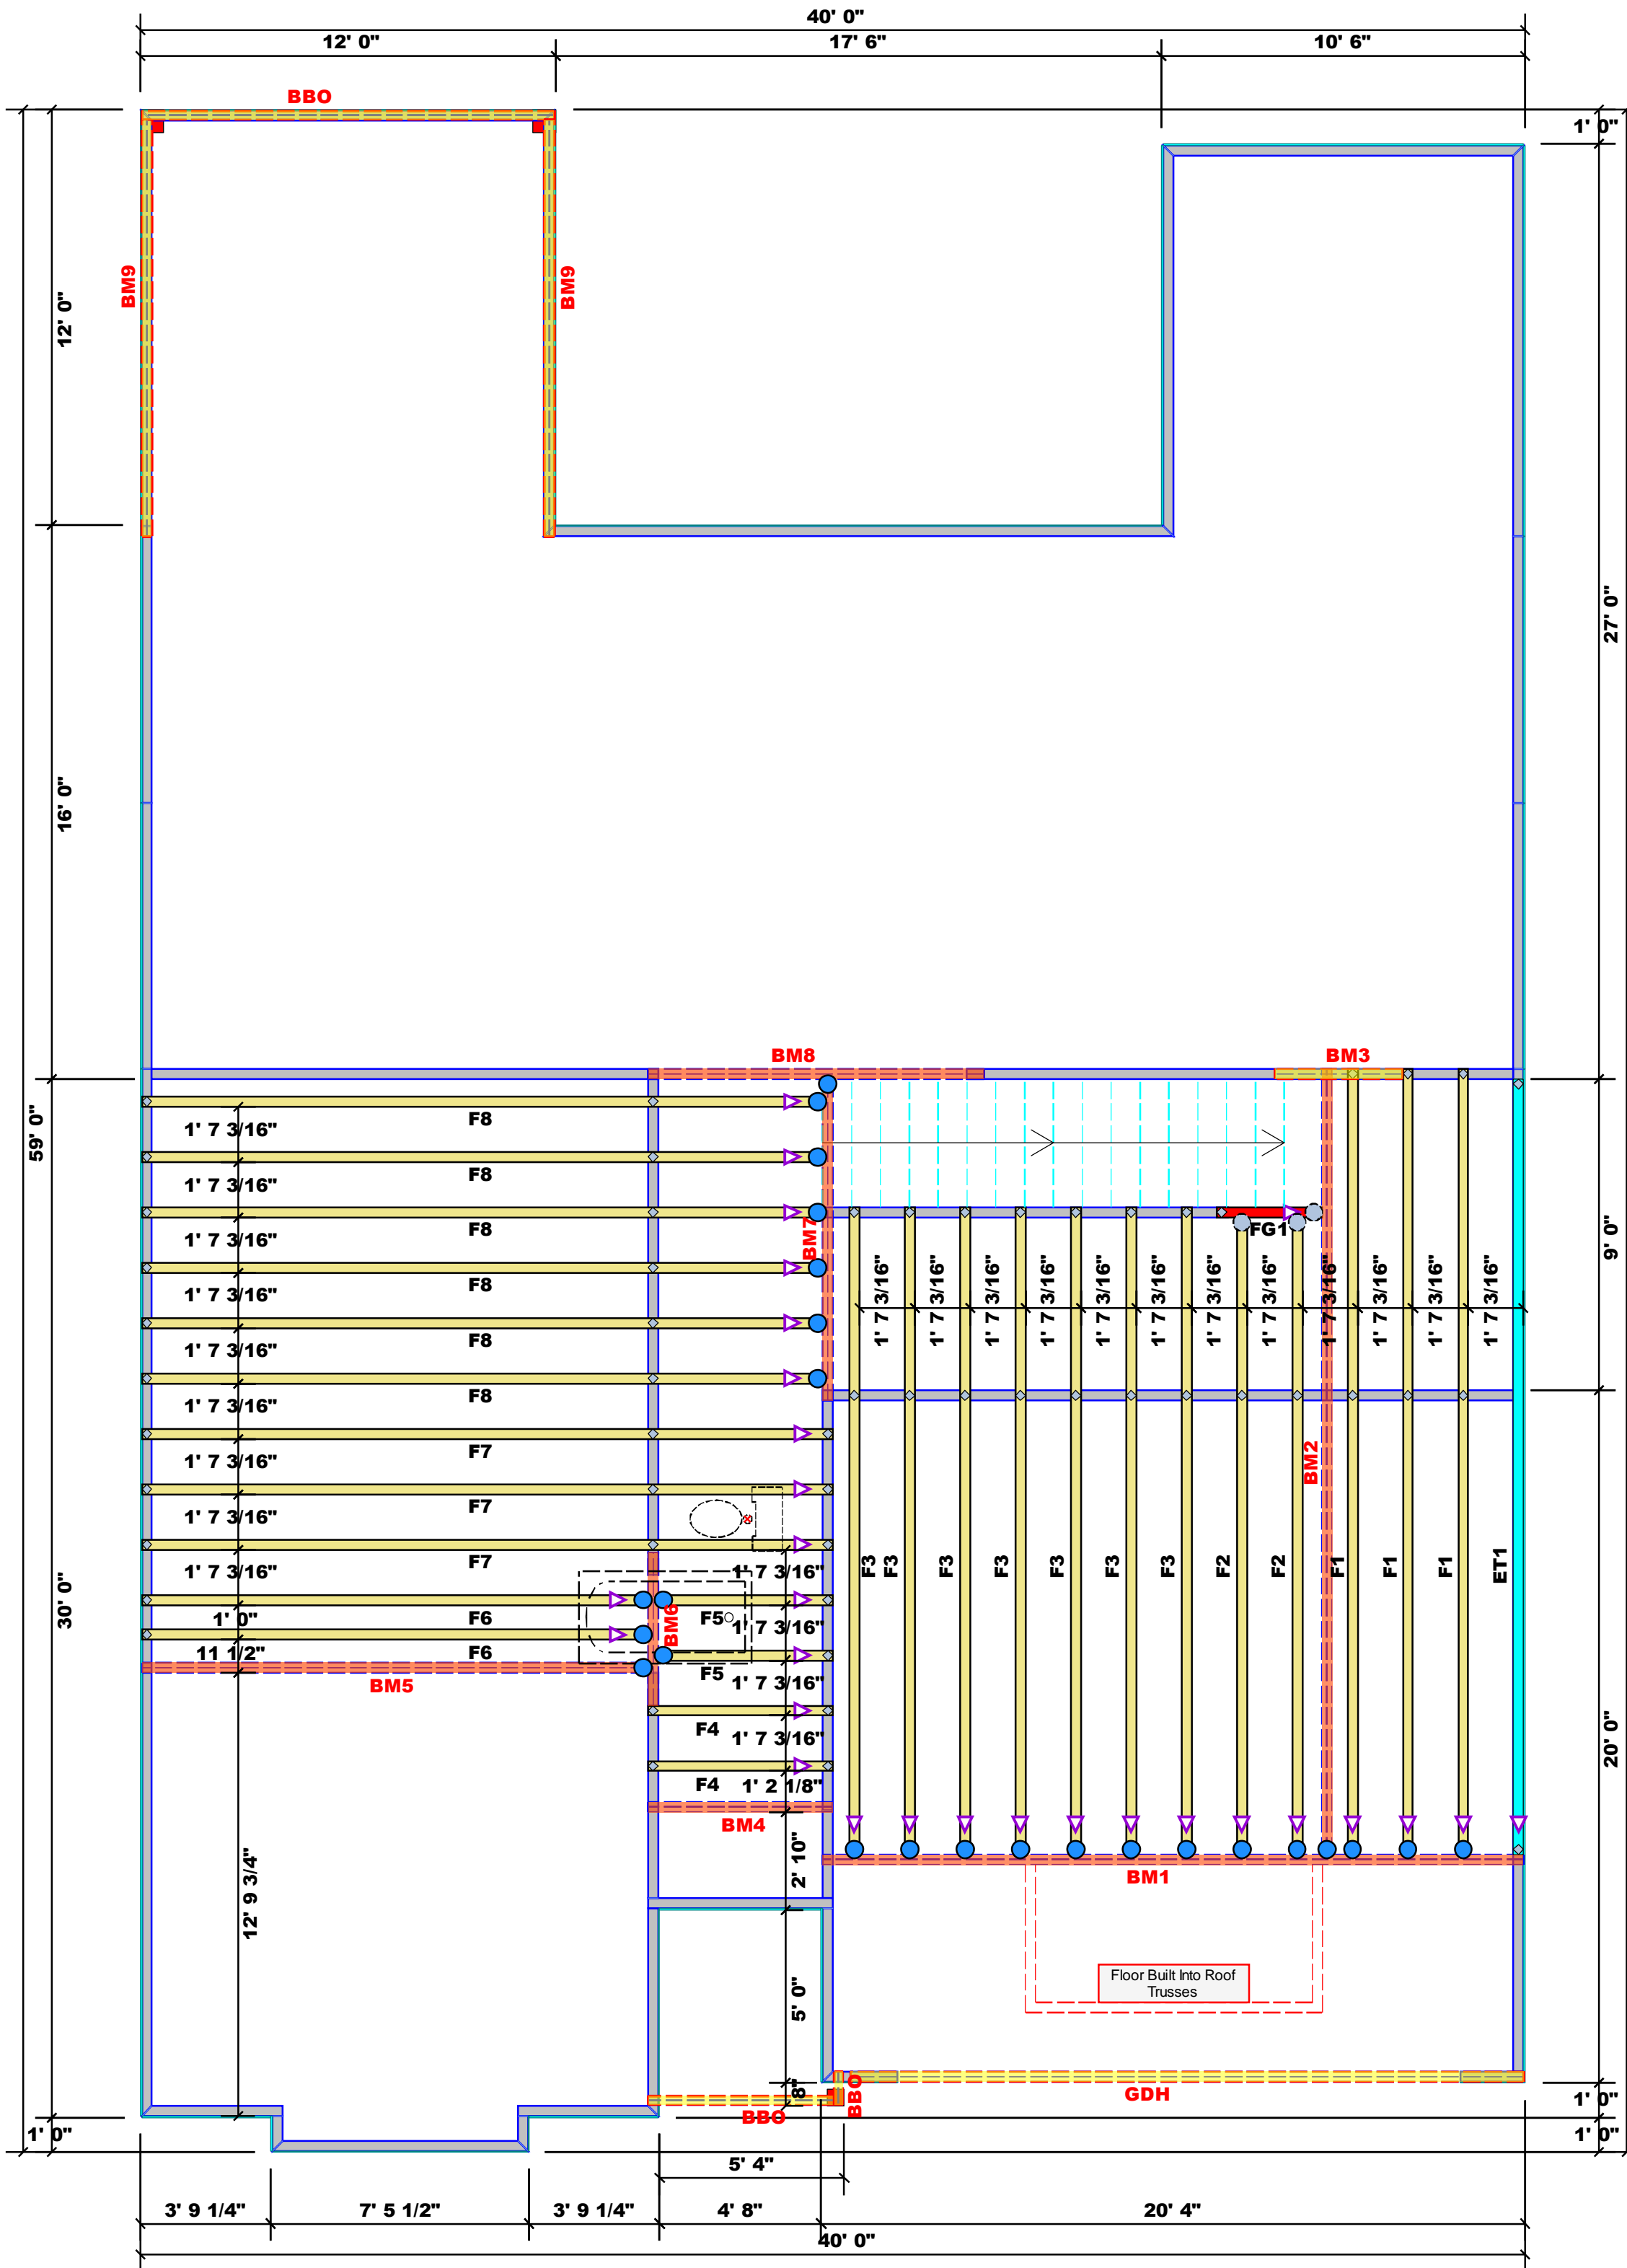

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.
 -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

All Headers Are Considered 2X10 Beams Unless Otherwise Noted

All Walls Shown Are Considered Load Bearing

Plumbing Drop Notes
 1. Plumbing drop locations shown are NOT exact.
 2. Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
 3. Adjust spacing as needed not to exceed 24" oc.

Dimension Notes
 1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
 2. All interior wall dimensions are to face of stud unless noted otherwise
 3. All exterior wall to truss dimensions are to face of stud unless noted otherwise

Hatch Legend
 Blue hatched: 5' 3-1/2" Walls
 Red hatched: Second Floor Walls
 Yellow hatched: Vaulted Ceiling
 Yellow: Drop Beam
 Orange: Flush Beam

Connector Information				Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header / Truss
●	HUS410	USP	25	NA	16d/3-1/2" / 16d/3-1/2"
○	MSH422	USP	3	Varies	10d/3" / 10d/3"

Products				
PlotID	Length	Product	Plies	Net Qty
BM1	21' 0"	1-3/4"x 23-7/8" LVL Kerto-S	2	2
BM2	23' 0"	1-3/4"x 14" LVL Kerto-S	2	2
BM3	4' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2
BM4	6' 0"	1-3/4"x 14" LVL Kerto-S	2	2
BM5	15' 0"	1-3/4"x 14" LVL Kerto-S	2	2
BM6	5' 0"	1-3/4"x 14" LVL Kerto-S	2	2
BM7	10' 0"	1-3/4"x 14" LVL Kerto-S	2	2
BM8	10' 0"	1-3/4"x 14" LVL Kerto-S	2	2
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

1 Truss Placement Plan
 Scale: 1/4"=1'

▲ = Denotes Left End of Truss (Reference Engineered Truss Drawing)

LOAD CHART FOR JACK STUDS
 (BASED ON TABLES R502.5(1) & (2))
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/BOARDS

END REACTOR (UP TO)	END REACTOR (UP TO)	END REACTOR (UP TO)
NO. OF HEADERS	NO. OF HEADERS	NO. OF HEADERS
1700	2550	3400
3400	5100	6800
5100	7650	10200
6800	10200	13600
8500	12750	17000
10200	15300	
11900		
13600		
15300		

BUILDER	New Home, Inc.	CITY / CO.	Lillington / Harnett
JOB NAME	Lot 147 Duncan's Creek	ADDRESS	868 Duncan Creek Road
PLAN	The Guilford - French Country "B"	MODEL	Floor
SEAL DATE	10/31/23	DATE REV.	02/26/24
QUOTE #		DRAWN BY	Jonathan Landry
JOB #	J0224-1108	SALES REP.	Johnnie Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BC3-B1 and BC3-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Jonathan Landry
 Jonathan Landry

comTECH
ROOF & FLOOR TRUSSES & BEAMS
 Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0224-1108
Lot 147 Duncan's Creek

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I63861381 thru I63861390

My license renewal date for the state of North Carolina is December 31, 2024.

North Carolina COA: C-0844



February 27, 2024

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


Job J0224-1108	Truss ET1	Truss Type GABLE	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163861381
-------------------	--------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:21 2024 Page 1
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

0-1-8

Scale = 1:37.4

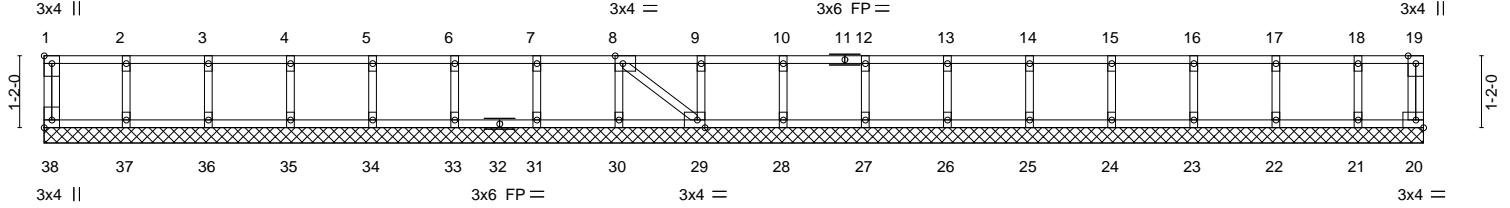

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-8-0	20-0-0	21-4-0	22-4-12
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-0-12

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [8:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	20	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 96 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	


REACTIONS. All bearings 22-4-12.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.



February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861382
J0224-1108	F1	Floor	3	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:23 2024 Page 1
 ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

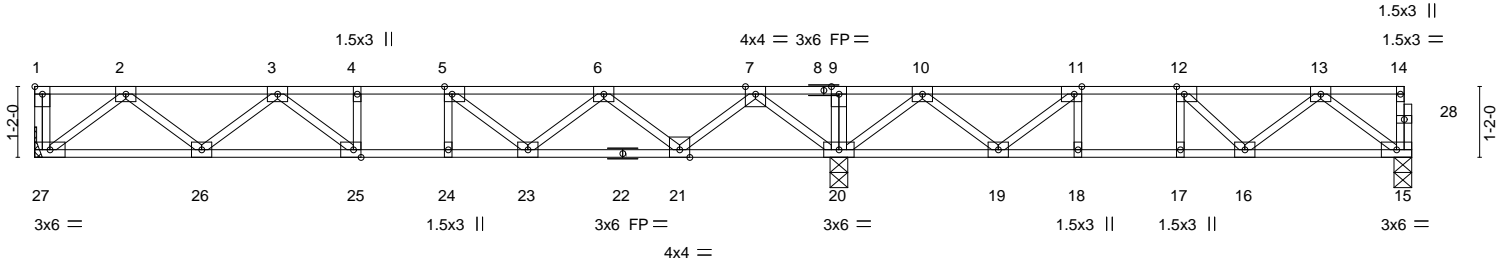


Plate Offsets (X, Y)--	[1:Edge,0-1-8], [5:0-1-8,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [25:0-1-8,Edge]
------------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.38	Vert(LL)	-0.08	24	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.50	Vert(CT)	-0.10	24	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.42	Horz(CT)	0.02	15	n/a		
BCDL 5.0	Code IRC2015/TP12014		Matrix-S						

Weight: 115 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 27=Mechanical, 20=0-3-8, 15=0-3-8
 Max Grav 27=641(LC 10), 20=1483(LC 1), 15=439(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1217/0, 3-4=-1775/0, 4-5=-1775/0, 5-6=-1508/0, 6-7=-607/84, 7-9=0/1357, 9-10=0/1357, 10-11=-461/502, 11-12=-846/202, 12-13=-727/51
 BOT CHORD 26-27=0/779, 25-26=0/1622, 24-25=0/1775, 23-24=0/1775, 21-23=0/1221, 20-21=-354/0, 19-20=-745/100, 18-19=-202/846, 17-18=-202/846, 16-17=-202/846, 15-16=0/524
 WEBS 2-27=-978/0, 2-26=0/569, 3-26=-527/0, 3-25=-77/318, 7-20=-1258/0, 7-21=0/873, 6-21=-839/0, 6-23=0/425, 5-23=-476/0, 10-20=-952/0, 10-19=0/608, 11-19=-695/0, 13-15=-654/0, 13-16=-92/265

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861383
J0224-1108	F2	Floor	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:24 2024 Page 1
 ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f



Scale = 1:30.3

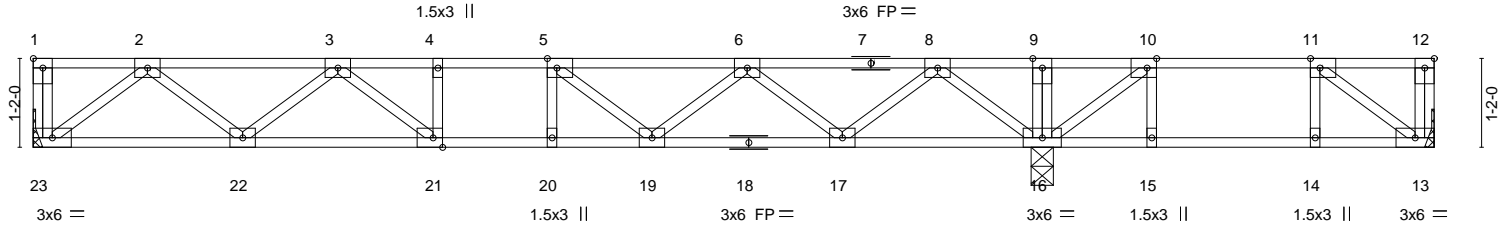

	13-3-0	18-4-12
	13-3-0	5-1-12
Plate Offsets (X,Y)--	[1:Edge,0-1-8], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [21:0-1-8,Edge]	

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.35	Vert(LL)	-0.08	20	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.43	Vert(CT)	-0.10	20	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.30	Horz(CT)	0.02	13	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 94 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 23=Mechanical, 13=Mechanical, 16=0-3-8
 Max Uplift 13=18(LC 3)
 Max Grav 23=551(LC 10), 13=197(LC 4), 16=912(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1065/0, 3-4=-1637/0, 4-5=-1637/0, 5-6=-1497/0, 6-8=-876/0, 8-9=0/439, 9-10=0/439
 BOT CHORD 22-23=0/673, 21-22=0/1440, 20-21=0/1637, 19-20=0/1637, 17-19=0/1320, 16-17=0/406
 WEBS 2-23=-844/0, 2-22=0/511, 3-22=-488/0, 3-21=0/375, 8-16=-938/0, 8-17=0/625, 6-17=-592/0, 6-19=0/274, 5-19=-296/0, 10-16=-540/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 18 lb uplift at joint 13.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.



February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861384
J0224-1108	F3	Floor	7	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:25 2024 Page 1
 ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

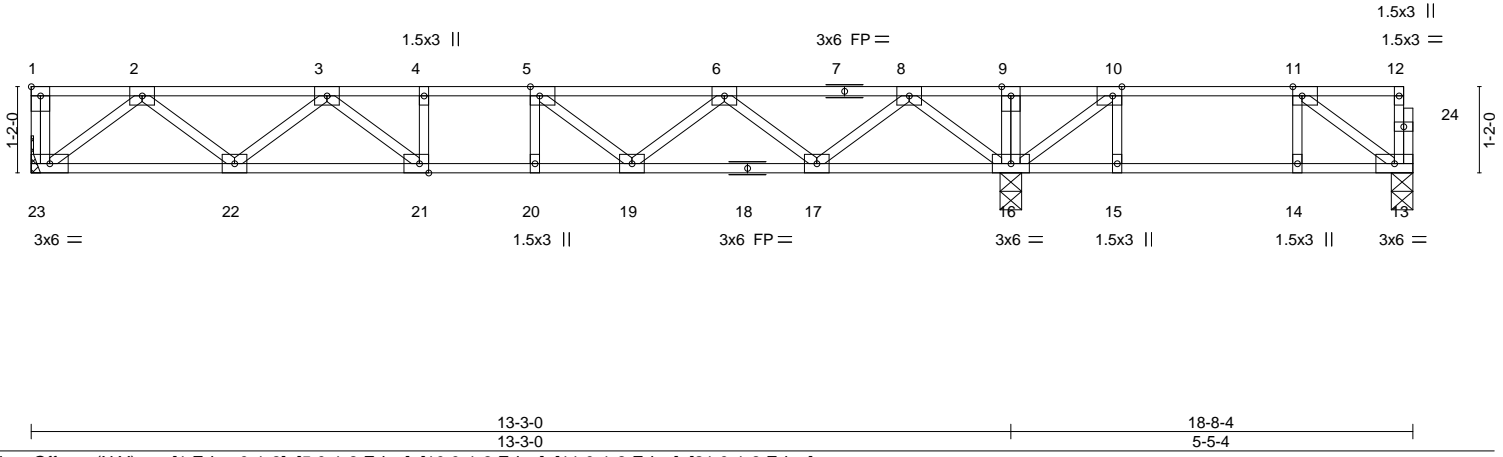




Plate Offsets (X, Y)--	[1:Edge,0-1-8], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [21:0-1-8,Edge]				
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.36	Vert(LL) -0.08 20 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.44	Vert(CT) -0.11 20 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.29	Horz(CT) 0.02 13 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 94 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	


REACTIONS. (size) 23=Mechanical, 16=0-3-8, 13=0-3-8
 Max Uplift 13=2(LC 3)
 Max Grav 23=554(LC 10), 16=908(LC 9), 13=208(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1074/0, 3-4=-1658/0, 4-5=-1658/0, 5-6=-1525/0, 6-8=-913/0, 8-9=0/396, 9-10=0/396
 BOT CHORD 22-23=0/678, 21-22=0/1454, 20-21=0/1658, 19-20=0/1658, 17-19=0/1353, 16-17=0/448
 WEBS 2-23=-850/0, 2-22=0/516, 3-22=-495/0, 3-21=0/383, 8-16=-934/0, 8-17=0/619, 6-17=-587/0, 6-19=0/271, 5-19=-292/0, 10-16=-544/0, 11-13=-263/116

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 13.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.

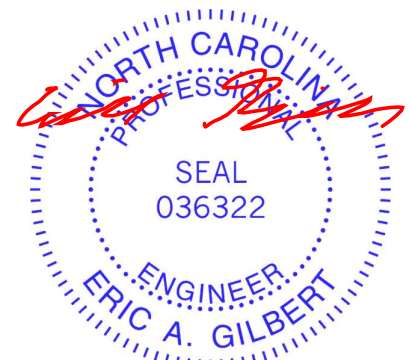

February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861385
J0224-1108	F4	Floor	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:26 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

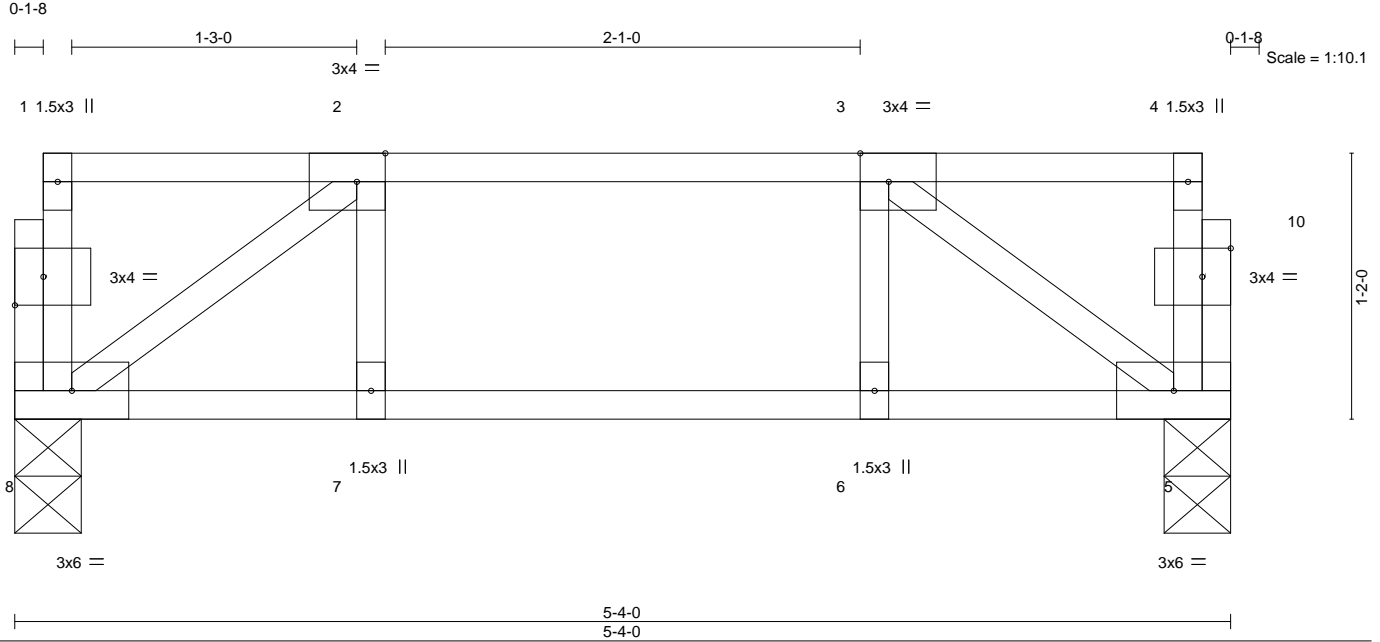


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,0-1-8], [10:0-1-8,0-1-8]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.16	Vert(LL)	-0.01	7	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.11	Vert(CT)	-0.01	7	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	5	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 28 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-4-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 8=0-3-8, 5=0-3-8
Max Grav 8=273(LC 1), 5=273(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-311/0
BOT CHORD 7-8=0/311, 6-7=0/311, 5-6=0/311
WEBS 2-8=-381/0, 3-5=-381/0

NOTES-
1) Unbalanced floor live loads have been considered for this design.
2) Plates checked for a plus or minus 1 degree rotation about its center.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

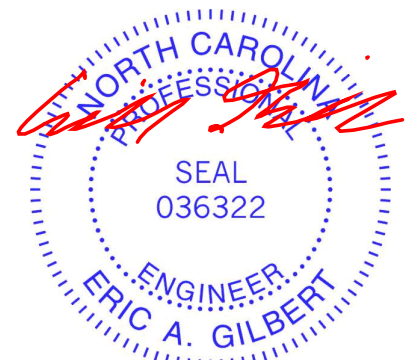


February 27, 2024

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861386
J0224-1108	F5	Floor	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:27 2024 Page 1

ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

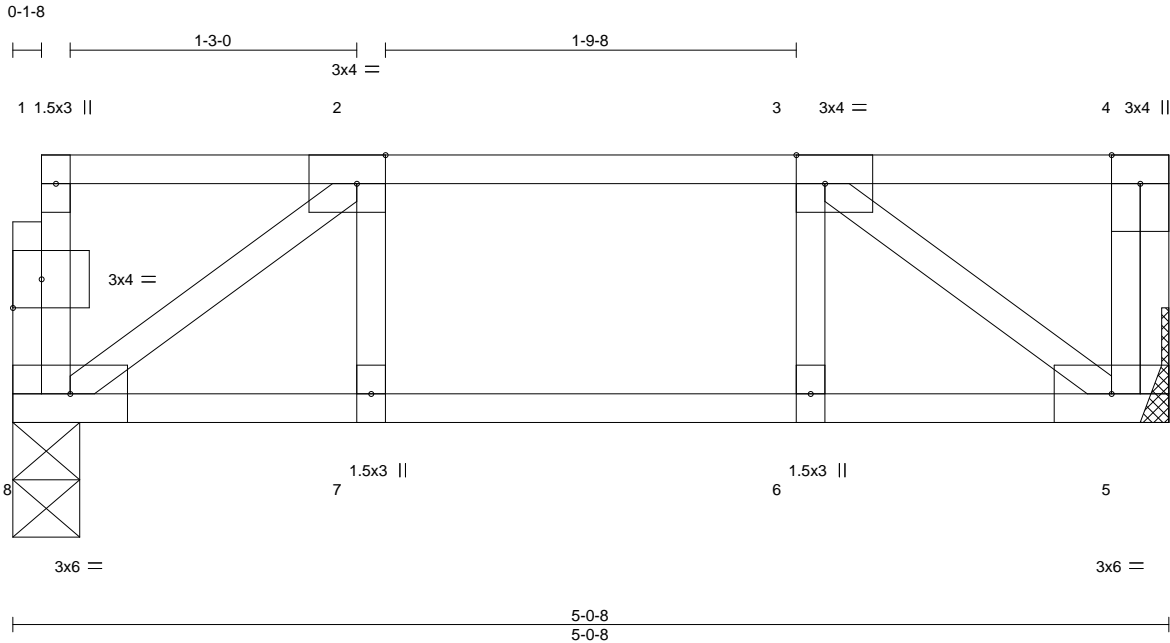

Scale = 1:10.0

Plate Offsets (X,Y)--	[2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.13	Vert(LL) -0.01 6 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.10	Vert(CT) -0.01 6 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.08	Horz(CT) 0.00 5 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 27 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-0-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	


REACTIONS. (size) 8=0-3-8, 5=Mechanical
Max Grav 8=257(LC 1), 5=264(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-282/0
BOT CHORD 7-8=0/282, 6-7=0/282, 5-6=0/282
WEBS 2-8=-344/0, 3-5=-348/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p>  <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job	Truss	Truss Type	Qty	Ply	Lot 147 Duncan's Creek	163861387
J0224-1108	F6	Floor	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:28 2024 Page 1


ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

1-3-0

1-4-8

0-1-8

Scale = 1:24.3

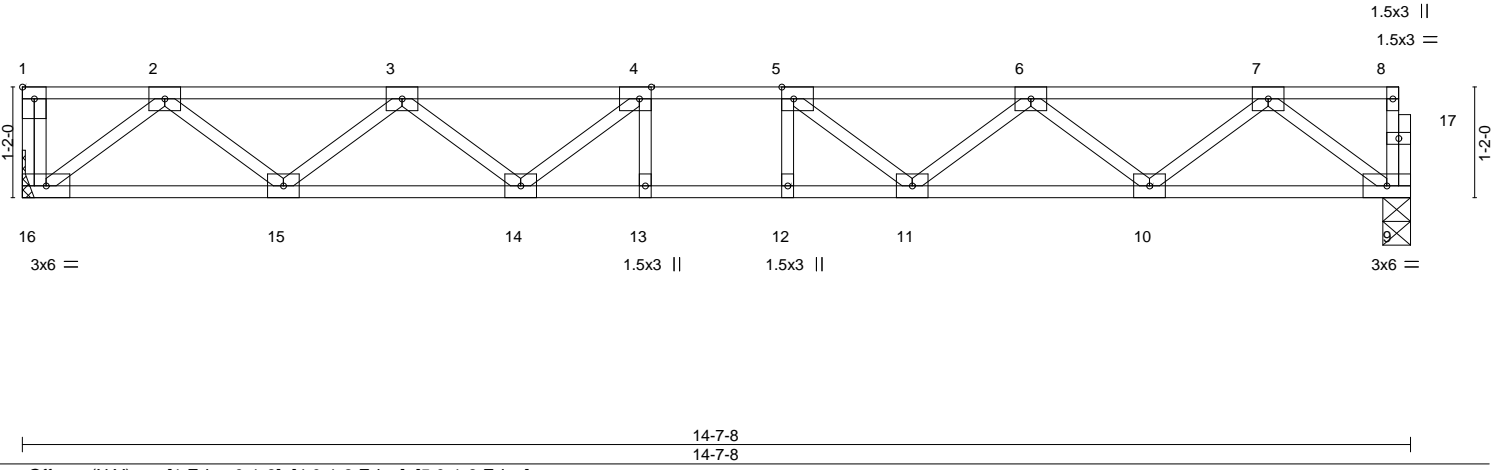


LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.31	in (loc)	l/defl	L/d		MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.63	Vert(LL)	-0.13 12-13	>999	480		
BCLL	0.0	Rep Stress Incr	YES	WB	0.39	Vert(CT)	-0.18 12-13	>962	360		
BCDL	5.0	Code IRC2015/TPI2014		Matrix-S		Horz(CT)	0.04 9	n/a	n/a		
										Weight: 74 lb	FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		

REACTIONS. (size) 16=Mechanical, 9=0-3-8
Max Grav 16=791(LC 1), 9=784(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1599/0, 3-4=-2462/0, 4-5=-2719/0, 5-6=-2462/0, 6-7=-1599/0
BOT CHORD 15-16=0/971, 14-15=0/2193, 13-14=0/2719, 12-13=0/2719, 11-12=0/2719, 10-11=0/2193, 9-10=0/970
WEBS 2-16=-1218/0, 2-15=0/818, 3-15=-773/0, 3-14=0/406, 7-9=-1214/0, 7-10=0/819, 6-10=-774/0, 6-11=0/406, 5-11=-484/0, 4-14=-484/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.

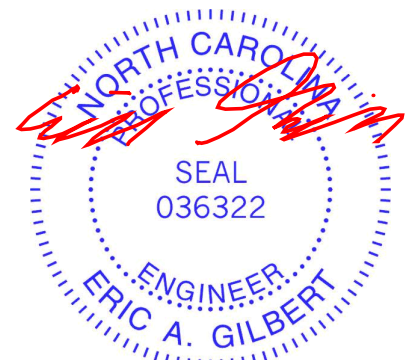


February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-1108	Truss F7	Truss Type Floor	Qty 3	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163861388
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:29 2024 Page 1
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f

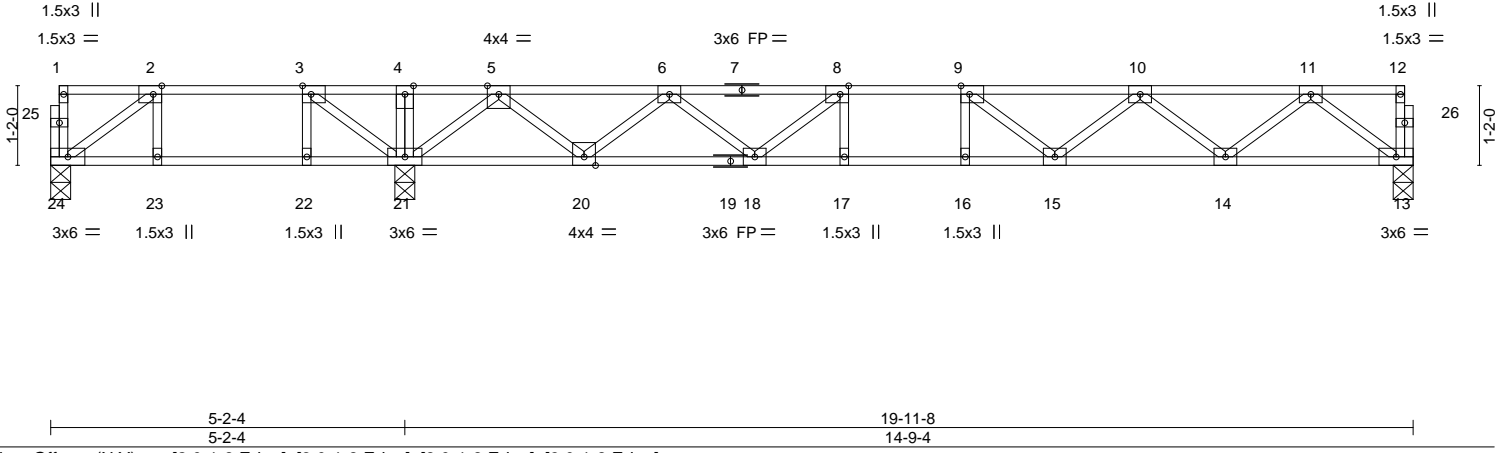

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.50	Vert(LL)	-0.13	16	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.71	Vert(CT)	-0.18	16	>963	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.04	13	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 100 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 23-24,22-23,21-22.

REACTIONS. (size) 24=0-3-8, 21=0-3-8, 13=0-3-8
Max Uplift 24=40(LC 4)
Max Grav 24=237(LC 3), 21=1243(LC 8), 13=763(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=0/635, 4-5=0/635, 5-6=1227/0, 6-8=2210/0, 8-9=2564/0, 9-10=2359/0, 10-11=1547/0
BOT CHORD 20-21=0/539, 18-20=0/1875, 17-18=0/2564, 16-17=0/2564, 15-16=0/2564, 14-15=0/2120, 13-14=0/941
WEBS 2-24=272/241, 3-21=738/0, 11-13=1178/0, 11-14=0/788, 10-14=746/0, 10-15=0/367, 9-15=425/11, 5-21=1324/0, 5-20=0/909, 6-20=859/0, 6-18=0/469, 8-18=578/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 40 lb uplift at joint 24.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



February 27, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)





818 Soundside Road
Edenton, NC 27932


Job J0224-1108	Truss F8	Truss Type Floor	Qty 6	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163861389
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:30 2024 Page 1
ID:w_NkYaQd4RDpmohcDk_iObzuUsG-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?f



Scale = 1:32.8

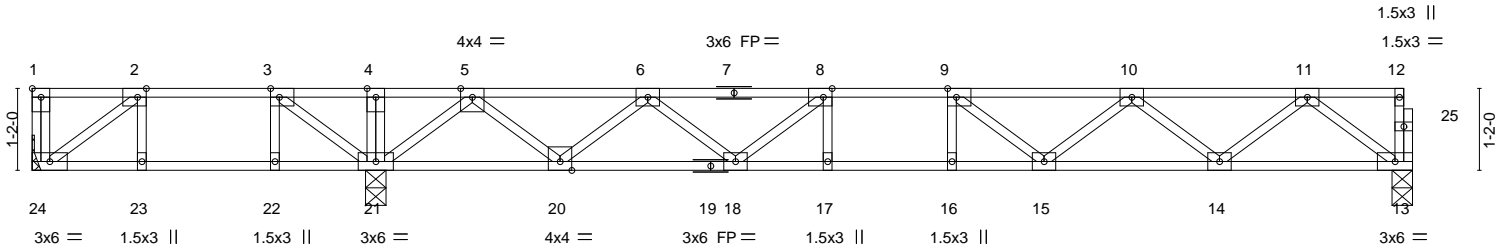

	4-10-12	19-8-0
	4-10-12	14-9-4
Plate Offsets (X, Y)--	[1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [8:0-1-8,Edge], [9:0-1-8,Edge]	


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.50	Vert(LL)	-0.13	16	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.72	Vert(CT)	-0.18	16	>968	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.44	Horz(CT)	0.03	13	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 99 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 23-24,22-23,21-22.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 24=Mechanical, 21=0-3-8, 13=0-3-8
 Max Uplift 24=68(LC 4)
 Max Grav 24=221(LC 3), 21=1257(LC 8), 13=758(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=0/713, 4-5=0/713, 5-6=1159/0, 6-8=-2157/0, 8-9=-2522/0, 9-10=-2330/0, 10-11=-1532/0
 BOT CHORD 20-21=0/464, 18-20=0/1813, 17-18=0/2522, 16-17=0/2522, 15-16=0/2522, 14-15=0/2099, 13-14=0/933
 WEBS 2-24=228/297, 3-21=-751/0, 11-13=-1168/0, 11-14=0/779, 10-14=-738/0, 10-15=0/358, 9-15=-411/18, 5-21=-1333/0, 5-20=0/918, 6-20=-867/0, 6-18=0/473, 8-18=-585/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 68 lb uplift at joint 24.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.

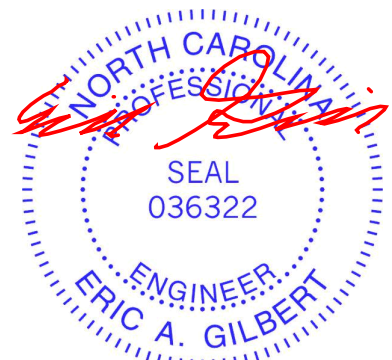


February 27, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MITek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0224-1108	Truss FG1	Truss Type FLOOR GIRDER	Qty 1	Ply 1	Lot 147 Duncan's Creek Job Reference (optional)	163861390
-------------------	--------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Mon Feb 26 13:11:31 2024 Page 1

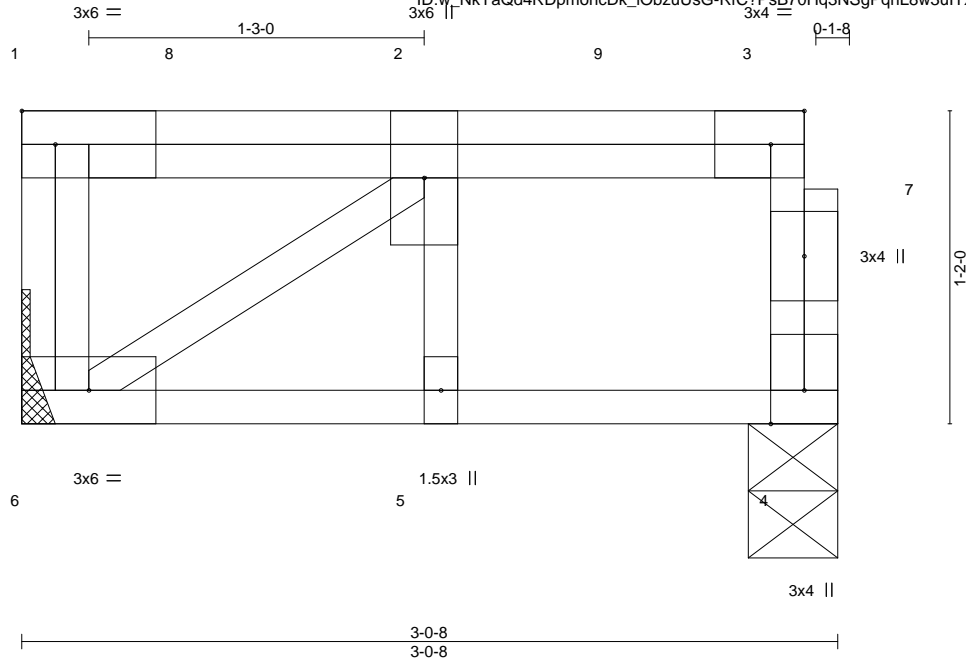

Scale = 1:8.6

Plate Offsets (X,Y)--	[3:0-1-8,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.22	Vert(LL)	-0.02	5	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.18	Vert(CT)	-0.03	5	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.01	Horz(CT)	0.00	4	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 21 lb	FT = 20%F, 11%E

LUMBER-	BRACING-	
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 3-0-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)		

REACTIONS. (size) 4=0-4-0, 6=Mechanical
Max Grav 4=275(LC 1), 6=283(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 183 lb down and 87 lb up at 0-8-8, and 129 lb down and 86 lb up at 2-3-11 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)
Vert: 4-6=-10, 1-3=-100


Concentrated Loads (lb)
Vert: 8=-128(F) 9=-129(F)




February 27, 2024

Symbols


PLATE LOCATION AND ORIENTATION

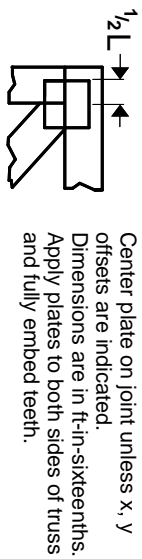

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

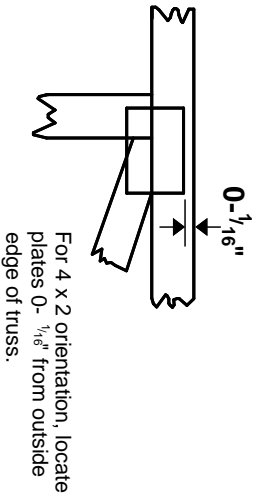

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

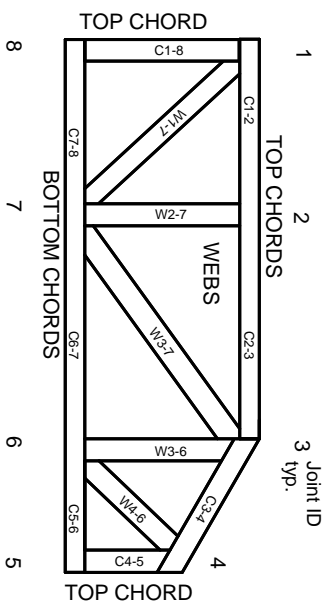

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023