

RE: MP24
 DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: MP24
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.6
 Wind Code: ASCE 7-10 Wind Speed: 120 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 12 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I59163116	A01AG	6/26/2023
2	I59163117	A02	6/26/2023
3	I59163118	A02A	6/26/2023
4	I59163119	A03	6/26/2023
5	I59163120	A04V	6/26/2023
6	I59163121	A05AV	6/26/2023
7	I59163122	A05V	6/26/2023
8	I59163123	A06AVG	6/26/2023
9	I59163124	B01G	6/26/2023
10	I59163125	B02GR	6/26/2023
11	I59163126	P01G	6/26/2023
12	I59163127	P02	6/26/2023

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource-Apex,NC.
 Truss Design Engineer's Name: Gilbert, Eric
 My license renewal date for the state of North Carolina is December 31, 2024.
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



June 26, 2023

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE
MP24	A01AG	GABLE	1	1	I59163116
					Job Reference (optional)

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:17 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-0-8-0	15-8-2	21-0-0	26-3-14	41-8-8
0-8-0	15-8-2	5-3-14	5-3-14	15-4-10

Scale = 1:72.6

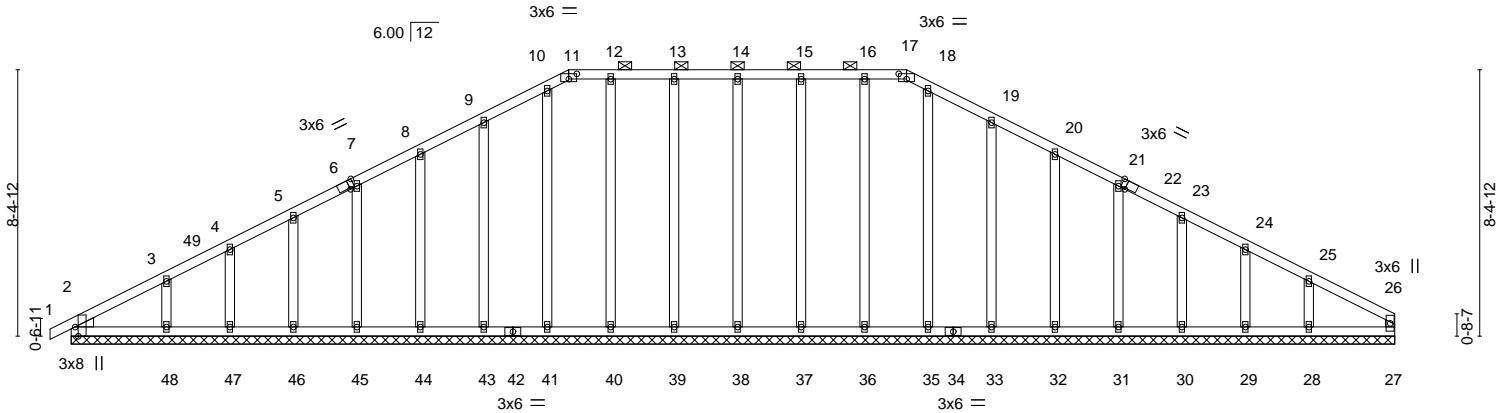


Plate Offsets (X,Y)--	[2:0-3-8,Edge], [6:0-1-13,Edge], [11:0-3-0,0-2-0], [17:0-3-0,0-2-0], [22:0-1-13,Edge]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.16	Horz(CT)	0.01	27	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 284 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 11-17.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. All bearings 41-8-8.
 (lb) - Max Horz 2=121(LC 16)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 38, 39, 40, 43, 44, 45, 46, 47, 48, 37, 36, 33, 32, 31, 30, 29, 28
 Max Grav All reactions 250 lb or less at joint(s) 27, 2, 38, 39, 40, 41, 43, 44, 45, 46, 47, 48, 37, 36, 35, 33, 32, 31, 30, 29, 28

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-0 to 4-1-10, Exterior(2) 4-1-10 to 15-8-2, Corner(3) 15-8-2 to 20-5-12, Exterior(2) 20-5-12 to 26-3-14, Corner(3) 26-3-14 to 31-0-0, Exterior(2) 31-0-0 to 41-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 38, 39, 40, 43, 44, 45, 46, 47, 48, 37, 36, 33, 32, 31, 30, 29, 28.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

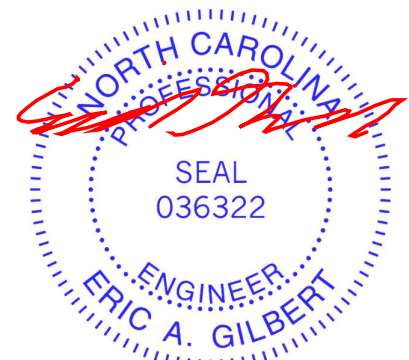

June 26, 2023

Job MP24	Truss A02	Truss Type COMMON	Qty 4	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163117
-------------	--------------	----------------------	----------	----------	--

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:19 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



5x6 =

Scale = 1:74.1

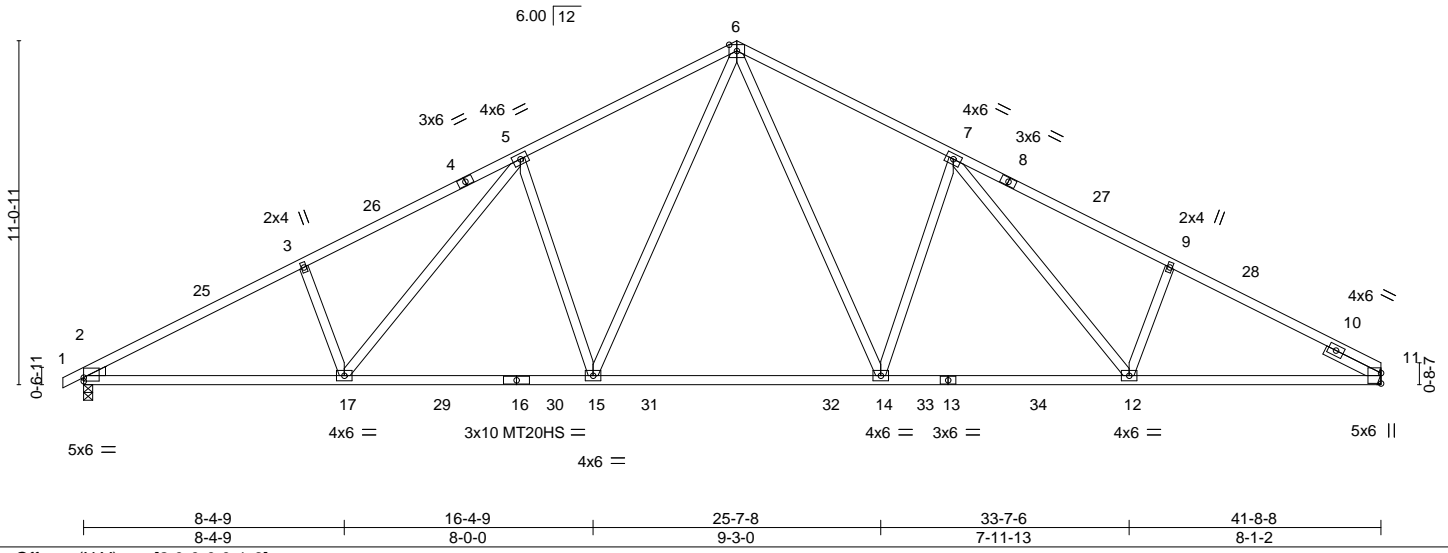



Plate Offsets (X,Y)--	[2:0-0,0,1-6]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.97	Vert(LL) -0.33 14-15 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.85	Vert(CT) -0.61 14-15 >827 240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr YES	WB 0.76	Horz(CT) 0.15 11 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.10 15-17 >999 240	Weight: 230 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 8-11: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	
SLIDER Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 11=Mechanical
 Max Horz 2=151(LC 12)
 Max Uplift 2=25(LC 12), 11=12(LC 13)
 Max Grav 2=1709(LC 1), 11=1668(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-3068/235, 3-5=-2946/290, 5-6=-2417/308, 6-7=-2406/306, 7-9=-2848/297,
 9-11=-2940/243
 BOT CHORD 2-17=-135/2661, 15-17=-82/2259, 14-15=0/1698, 12-14=-67/2239, 11-12=-136/2557
 WEBS 3-17=-344/179, 5-17=-103/581, 5-15=-673/200, 6-15=-94/988, 6-14=-92/964,
 7-14=-646/200, 7-12=-106/492, 9-12=-287/176

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-11-8, Interior(1) 27-11-8 to 41-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 11.
 - 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

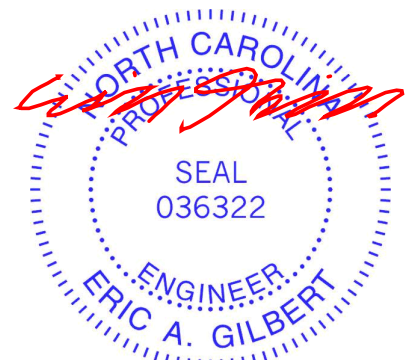


June 26, 2023

Job MP24	Truss A03	Truss Type COMMON	Qty 5	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163119
-------------	--------------	----------------------	----------	----------	--

Builders FirstSource, Apex, NC

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-NQRDedu51ZDhazGHUTsT_UadO3ummHGwz7UNSBz2QDm
8.630 s Mar 9 2023 MTEK Industries, Inc. Mon Jun 26 11:55:41 2023 Page 1

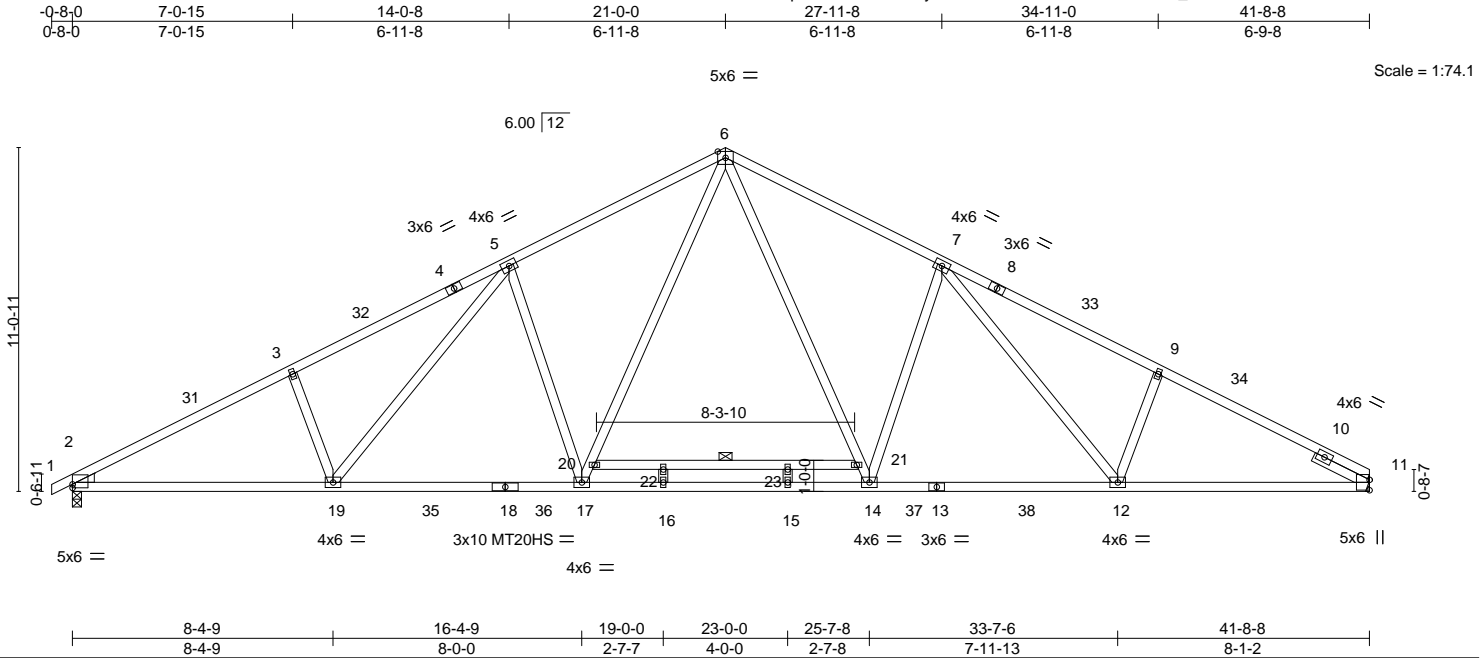

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.97	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.94	Vert(LL) -0.45 15-16 >999 360	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.99	Vert(CT) -0.69 15-16 >722 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.16 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.10 17-19 >999 240	Weight: 244 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 1-4: 2x4 SP No.1, 8-11: 2x4 SP SS	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 20-21
WEDGE Left: 2x4 SP No.3	
SLIDER Right 2x4 SP No.3 1-11-12	

REACTIONS. (lb/size) 2=1709/0-3-8 (min. 0-2-1), 11=1668/Mechanical
 Max Horz 2=151(LC 12)
 Max Uplift 2=-25(LC 12), 11=-12(LC 13)
 Max Grav 2=1732(LC 2), 11=1701(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-31=-3160/215, 3-31=-3065/235, 3-32=-3037/256, 4-32=-2966/271, 4-5=-2896/289,
 5-6=-2508/309, 6-7=-2497/307, 7-8=-2795/297, 8-33=-2871/278, 9-33=-2921/263,
 9-34=-2945/242, 10-34=-3030/225, 10-11=-1009/0
 BOT CHORD 2-19=-134/2742, 19-35=-83/2341, 18-35=-83/2341, 18-36=-83/2341, 17-36=-83/2341,
 16-17=0/1827, 15-16=0/1827, 14-15=0/1827, 14-37=-68/2320, 13-37=-68/2320,
 13-38=-68/2320, 12-38=-68/2320, 11-12=-136/2634
 WEBS 3-19=-343/180, 5-19=-101/585, 5-17=-673/199, 17-20=-101/962, 6-20=-94/1033,
 6-21=-93/1008, 14-21=-99/937, 7-14=-646/199, 7-12=-104/496, 9-12=-286/177

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-11-8, Interior(1) 27-11-8 to 41-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 2 and 12 lb uplift at joint 11.
 - 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 10) N/A



Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE	159163119
MP24	A03	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC

ID:VULCYJU7zpRLimSP7MPFXTyf?ft-NQRDedu51ZDhazGHUTsT_UadO3ummHGwz7UNSBz2QDm 8.630 s Mar 9 2023 MiTek Industries, Inc. Mon Jun 26 11:55:41 2023 Page 2

NOTES-

- 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-60, 6-11=-60, 24-27=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-50, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 24-27=-40, 20-21=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=47, 2-31=25, 6-31=14, 6-7=25, 7-11=14, 24-27=-12
Horz: 1-2=-59, 2-31=-37, 6-31=-26, 6-7=37, 7-11=26
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=9, 2-5=14, 5-6=25, 6-34=14, 11-34=25, 24-27=-12
Horz: 1-2=-21, 2-5=-26, 5-6=-37, 6-34=26, 11-34=37
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-12, 2-6=-33, 6-11=-33, 24-27=-20
Horz: 1-2=-8, 2-6=13, 6-11=-13
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-28, 2-6=-33, 6-11=-33, 24-27=-20
Horz: 1-2=8, 2-6=13, 6-11=-13
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=9, 2-6=-2, 6-11=9, 24-27=-12
Horz: 1-2=-21, 2-6=-10, 6-11=21
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=4, 2-6=9, 6-11=-2, 24-27=-12
Horz: 1-2=-16, 2-6=-21, 6-11=10
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-15, 2-6=-20, 6-11=-9, 24-27=-20
Horz: 1-2=-5, 2-6=-0, 6-11=11
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-9, 6-11=-20, 24-27=-20
Horz: 1-2=-16, 2-6=-11, 6-11=0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=17, 2-32=22, 6-32=11, 6-11=3, 24-27=-12
Horz: 1-2=-29, 2-32=-34, 6-32=-23, 6-11=15
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-2, 2-6=3, 6-33=11, 11-33=22, 24-27=-12
Horz: 1-2=-10, 2-6=-15, 6-33=23, 11-33=34
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=7, 2-6=11, 6-11=3, 24-27=-12
Horz: 1-2=-19, 2-6=-23, 6-11=15
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-2, 2-6=3, 6-11=11, 24-27=-12
Horz: 1-2=-10, 2-6=-15, 6-11=23
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=9, 2-32=4, 6-32=-6, 6-11=-15, 24-27=-20
Horz: 1-2=-29, 2-32=-24, 6-32=-14, 6-11=5
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-10, 2-6=-15, 6-33=-6, 11-33=4, 24-27=-20
Horz: 1-2=-10, 2-6=-5, 6-33=14, 11-33=24
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 24-35=-20, 35-36=-60, 36-37=-20, 37-38=-60, 27-38=-20, 20-21=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-46, 2-6=-50, 6-11=-42, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
Horz: 1-2=-4, 2-6=-0, 6-11=8

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE	159163119
MP24	A03	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC

8.630 s Mar 9 2023 MiTek Industries, Inc. Mon Jun 26 11:55:41 2023 Page 3
 ID:VULCYJU7zpRLimSP7MPFXTyf?FT-NQRDedu51ZDhazGHUTsT_UadO3ummHGwz7UNSBz2QDm

LOAD CASE(S)

- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-38, 2-6=-42, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
 Horz: 1-2=-12, 2-6=-8, 6-11=0
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-28, 2-32=-32, 6-32=-40, 6-11=-46, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
 Horz: 1-2=-22, 2-32=-18, 6-32=-10, 6-11=4
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-43, 2-6=-46, 6-33=-40, 11-33=-32, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
 Horz: 1-2=-7, 2-6=-4, 6-33=10, 11-33=18
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 6-11=-20, 24-27=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 6-11=-60, 24-27=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-50, 6-11=-20, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job MP24	Truss A04V	Truss Type SPECIAL	Qty 1	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163120
-------------	---------------	-----------------------	----------	----------	--

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:24 2023 Page 1

ID:VULCYJU7zRpRLimSP7MPFxFyTf?FT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



5x6 =

Scale = 1:77.5

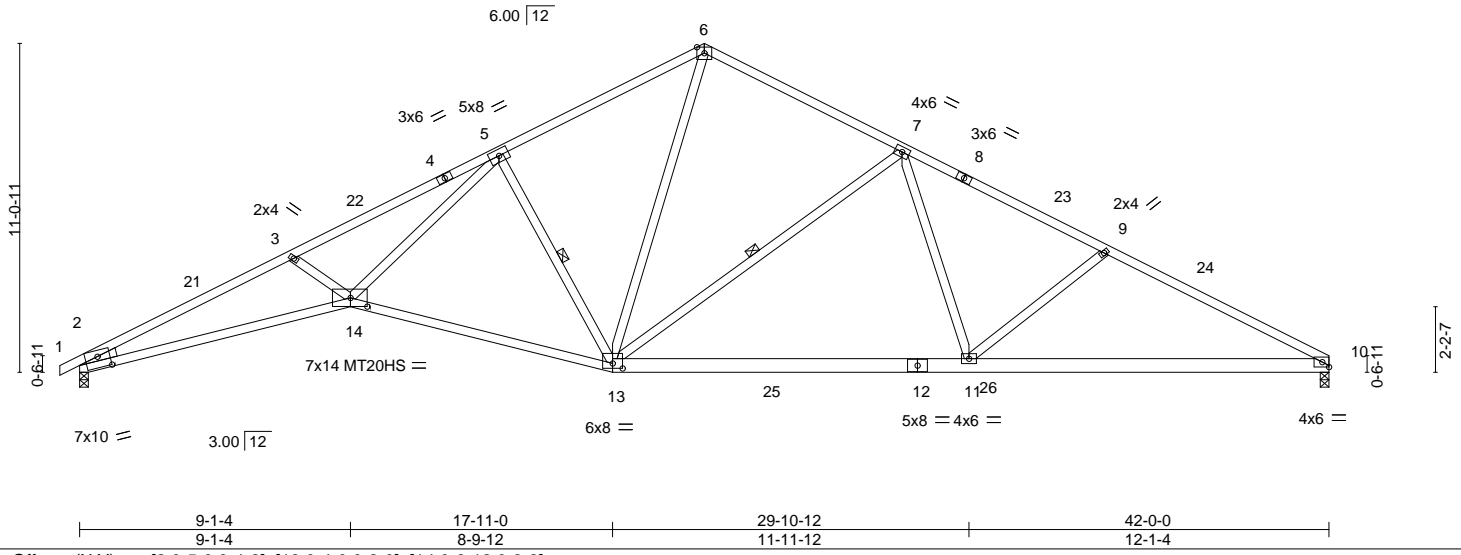


Plate Offsets (X,Y)--	[2:0-5-0,0-4-8], [13:0-4-0,0-2-0], [14:0-6-12,0-3-8]
-----------------------	--


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.93	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.86	Vert(LL) -0.44 11-13 >999 360	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.70	Vert(CT) -0.94 13-14 >537 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.35 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.23 13-14 >999 240	Weight: 236 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP SS *Except* 8-10: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x6 SP No.2 *Except* 2-14: 2x4 SP SS, 13-14: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-14: 2x4 SP No.2	WEBS 1 Row at midpt 5-13, 7-13
WEDGE Left: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=149(LC 16)
 Max Uplift 2=-24(LC 12), 10=-13(LC 13)
 Max Grav 2=1720(LC 1), 10=1680(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-5379/348, 3-5=-5101/327, 5-6=-2199/287, 6-7=-1766/270, 7-9=-2728/239,
 9-10=-3079/265
 BOT CHORD 2-14=-262/4846, 13-14=-115/2602, 11-13=-55/2193, 10-11=-148/2671
 WEBS 3-14=-264/184, 5-14=-77/2862, 5-13=-1377/219, 6-13=-115/1379, 7-13=-896/139,
 7-11=0/671, 9-11=-410/186

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-7-12, Interior(1) 27-7-12 to 42-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

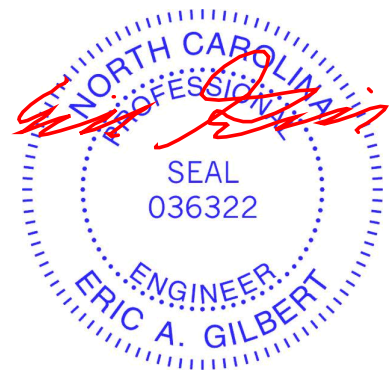


Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE
MP24	A05AV	SPECIAL	1	1	159163121

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:26 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFxFy?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

-0-8-0	7-2-5	14-1-3	18-4-2	23-7-14	27-7-12	34-5-4	42-0-0	42-8-0
0-8-0	7-2-5	6-10-13	4-2-15	5-3-12	3-11-14	6-9-8	7-6-12	0-8-0

Scale = 1:75.8

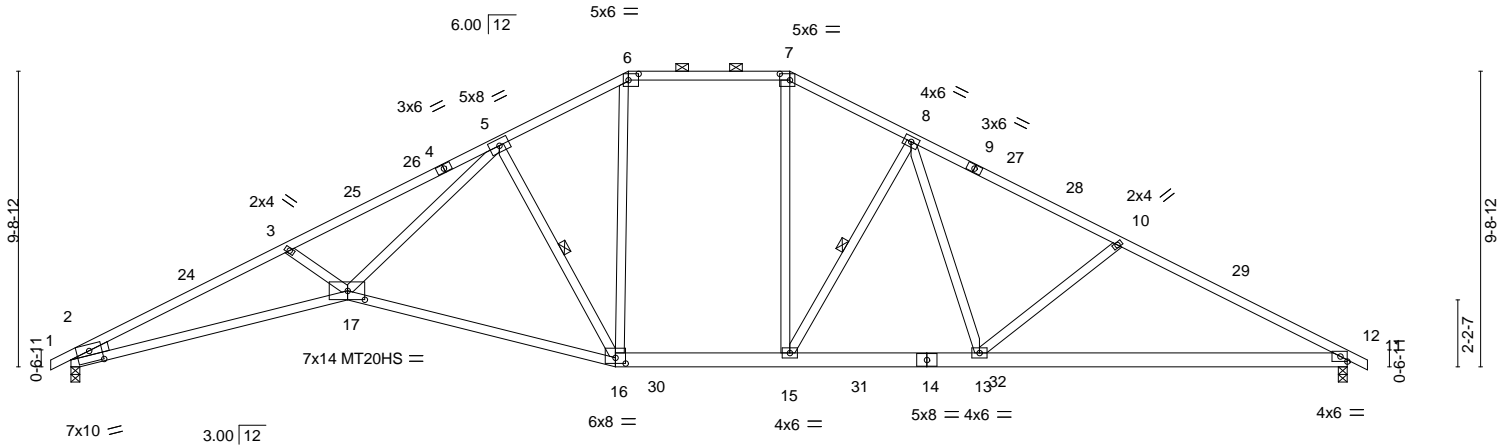

9-1-4	17-11-0	23-7-14	29-10-12	42-0-0
9-1-4	8-9-12	5-8-14	6-2-14	12-1-4

Plate Offsets (X,Y)-- [2:0-5-0,0-4-8], [6:0-4-0,0-2-8], [7:0-4-0,0-2-8], [16:0-4-0,0-2-4], [17:0-6-12,0-3-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 1.00	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.95	Vert(LL) -0.58 16-17 >875 360	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.71	Vert(CT) -1.10 16-17 >458 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.35 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.31 16-17 >999 240	Weight: 241 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 *Except* 1-4,9-12: 2x4 SP SS, 6-7: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-6-4 max.): 6-7.
BOT CHORD 2x6 SP No.2 *Except* 2-17: 2x4 SP SS, 16-17: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 13-15.
WEBS 2x4 SP No.3 *Except* 5-17: 2x4 SP No.2	WEBS 1 Row at midpt 5-16, 8-15
WEDGE Left: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 11=0-3-8
 Max Horz 2=134(LC 12)
 Max Uplift 2=-15(LC 12), 11=-15(LC 13)
 Max Grav 2=1720(LC 1), 11=1720(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-5388/427, 3-5=-5102/409, 5-6=-2190/315, 7-8=-2133/319, 8-10=-2709/279, 10-11=-3069/299, 6-7=-1857/302
BOT CHORD	2-17=-326/4856, 16-17=-140/2587, 15-16=-19/1857, 13-15=-86/2183, 11-13=-190/2665
WEBS	3-17=-269/190, 5-17=-117/2875, 5-16=-1312/220, 6-16=-50/712, 8-15=-802/163, 8-13=-41/631, 10-13=-431/186, 7-15=-51/741

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 18-4-2, Exterior(2) 18-4-2 to 30-5-5, Interior(1) 30-5-5 to 42-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 11.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

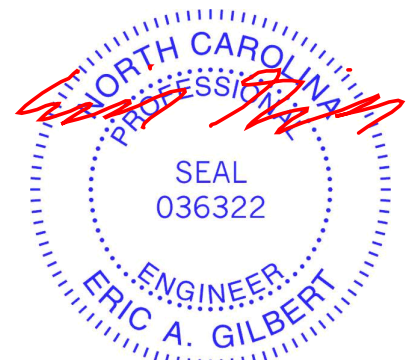

June 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job MP24	Truss A05V	Truss Type SPECIAL	Qty 7	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE I59163122
-------------	---------------	-----------------------	----------	----------	--

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:27 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:77.9

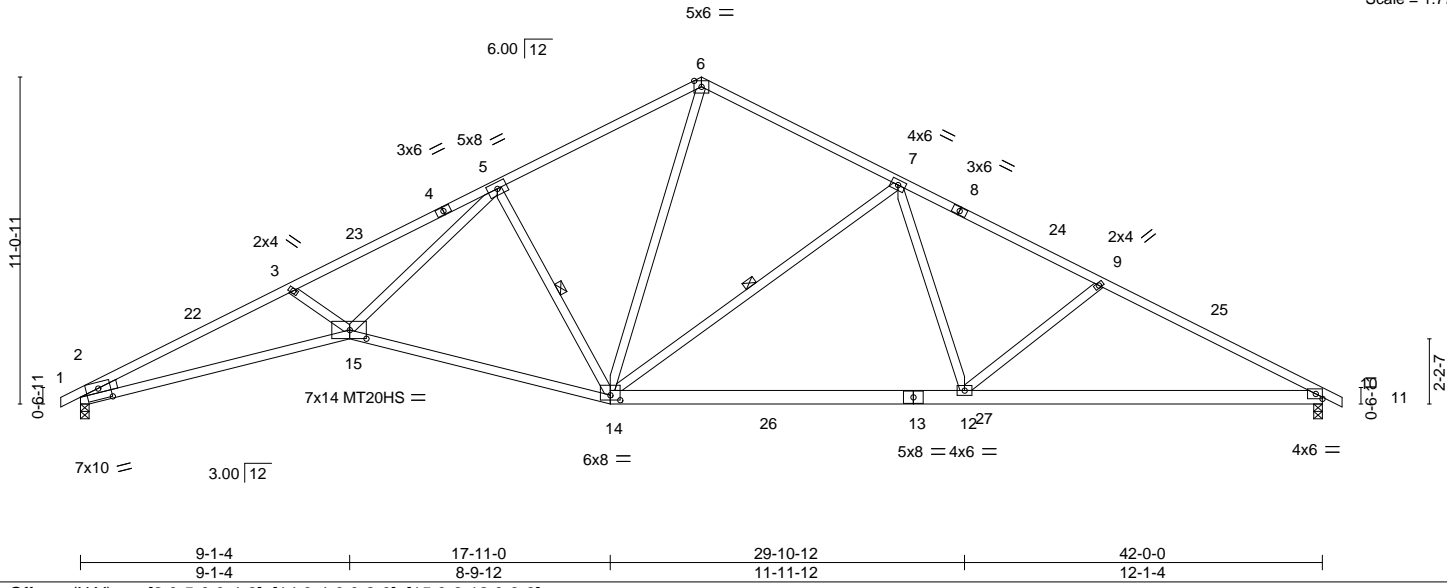


Plate Offsets (X,Y)--	[2:0-5-0,0-4-8], [14:0-4-0,0-2-0], [15:0-6-12,0-3-8]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.93	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.86	Vert(LL) -0.43 12-14 >999 360	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.70	Vert(CT) -0.93 14-15 >542 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.35 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.23 14-15 >999 240	Weight: 237 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP SS	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x6 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
2-15: 2x4 SP SS, 14-15: 2x4 SP No.1	WEBS 1 Row at midpt 5-14, 7-14
WEBS 2x4 SP No.3 *Except*	
5-15: 2x4 SP No.2	
WEDGE Left: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=145(LC 16)
 Max Uplift 2=24(LC 12), 10=24(LC 13)
 Max Grav 2=1720(LC 1), 10=1720(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-5378/342, 3-5=-5100/318, 5-6=-2199/287, 6-7=-1766/268, 7-9=-2726/231, 9-10=-3077/255
 BOT CHORD 2-15=-228/4845, 14-15=-93/2601, 12-14=-47/2191, 10-12=-122/2670
 WEBS 3-15=-264/185, 5-15=-69/2861, 5-14=-1377/212, 6-14=-113/1377, 7-14=-893/139, 7-12=0/671, 9-12=-412/186

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-7-12, Interior(1) 27-7-12 to 42-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE
MP24	A06AVG	GABLE	1	1	159163123
Job Reference (optional)					


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:29 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-0-8-0	16-4-2	21-8-0	26-11-14	42-8-0	43-4-0
0-8-0	15-8-2	5-3-14	5-3-14	15-8-2	0-8-0

Scale = 1:78.3

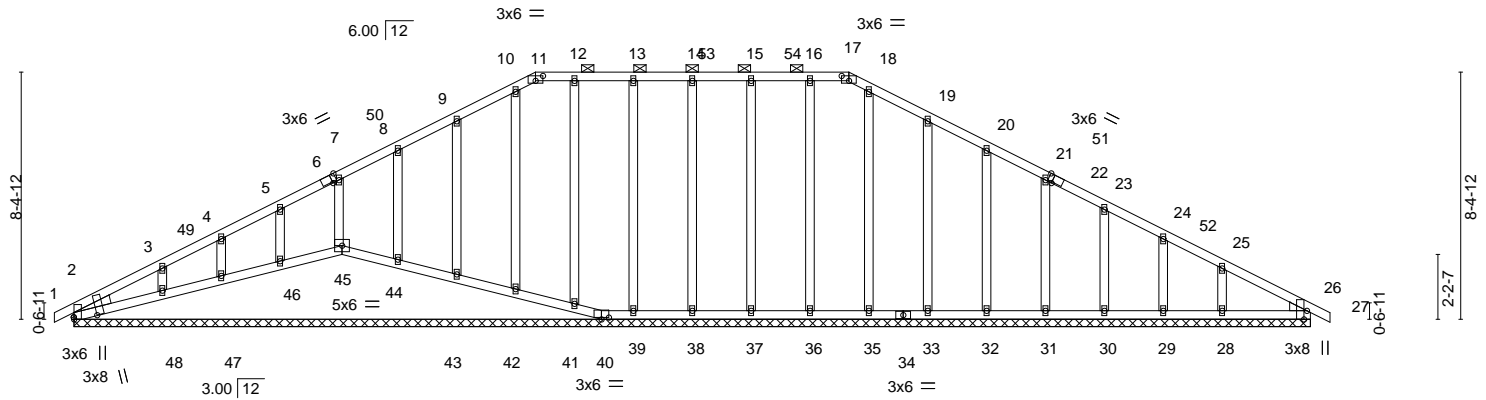

-0-8-0	9-9-4	18-7-0	42-8-0	43-4-0
0-8-0	9-1-4	8-9-12	24-1-0	0-8-0
Plate Offsets (X,Y)-- [2:0-1-8,0-9-8], [2:0-0-14,Edge], [6:0-1-13,Edge], [11:0-3-0,0-2-0], [17:0-3-0,0-2-0], [22:0-1-13,Edge], [26:0-3-8,Edge], [40:0-3-0,0-12]				

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.00	27	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	27	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.01	26	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-S						
								Weight: 275 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-17.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 42-0-0.
(lb) - Max Horz 2=123(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 45, 40, 2, 38, 39, 41, 43, 44, 46, 47, 48, 37, 36, 33, 32, 31, 30, 29, 28
Max Grav All reactions 250 lb or less at joint(s) 45, 40, 2, 26, 38, 39, 41, 42, 43, 44, 46, 47, 48, 37, 36, 35, 33, 32, 31, 30, 29, 28

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 15-8-2, Exterior(2) 15-8-2 to 22-5-9, Interior(1) 22-5-9 to 26-3-14, Exterior(2) 26-3-14 to 33-0-0, Interior(1) 33-0-0 to 42-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are 2x4 MT20 unless otherwise indicated.
 - 6) Gable requires continuous bottom chord bearing.
 - 7) Gable studs spaced at 2-0-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 45, 40, 2, 38, 39, 41, 43, 44, 46, 47, 48, 37, 36, 33, 32, 31, 30, 29, 28.
 - 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

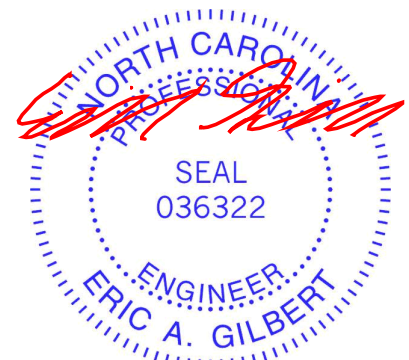


June 26, 2023

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE
MP24	B01G	GABLE	1	1	I59163124

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:31 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



4x6 ||

Scale = 1:46.1

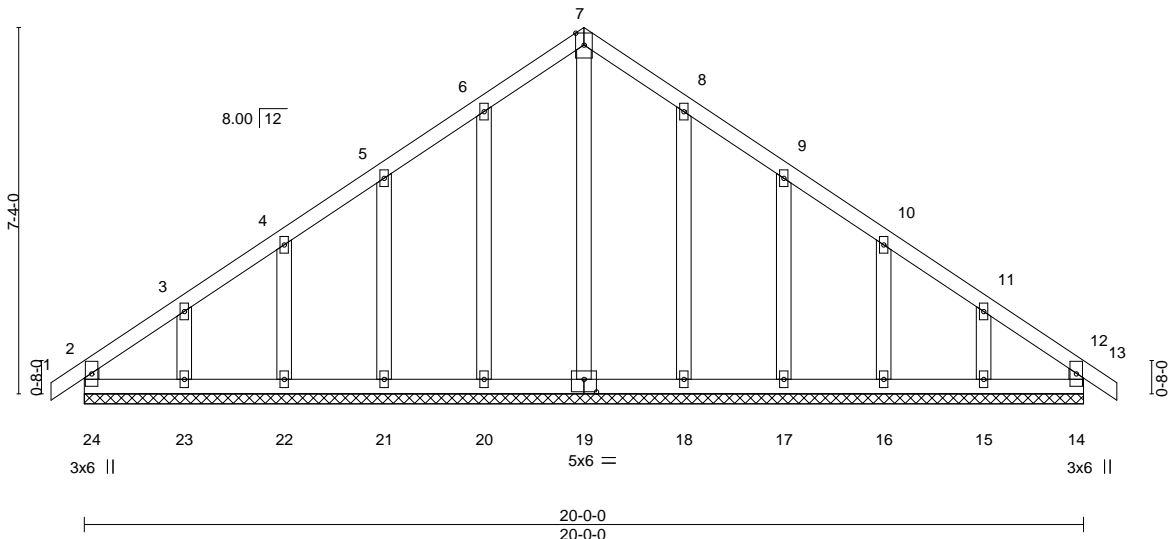


Plate Offsets (X,Y)--	[19:0-3-0,0-3-0]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	12	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	12	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.13	Horz(CT)	0.00	14	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						

Weight: 120 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 20-0-0.
 (lb) - Max Horz 24=167(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 24, 14, 20, 21, 22, 23, 18, 17, 16, 15
 Max Grav All reactions 250 lb or less at joint(s) 24, 14, 19, 20, 21, 22, 23, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-0 to 4-0-0, Exterior(2) 4-0-0 to 10-0-0, Corner(3) 10-0-0 to 14-9-10, Exterior(2) 14-9-10 to 20-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 14, 20, 21, 22, 23, 18, 17, 16, 15.



June 26, 2023

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPH Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job MP24	Truss B02GR	Truss Type COMMON	Qty 1	Ply 3	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163125
-------------	----------------	----------------------	----------	----------	--

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:32 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

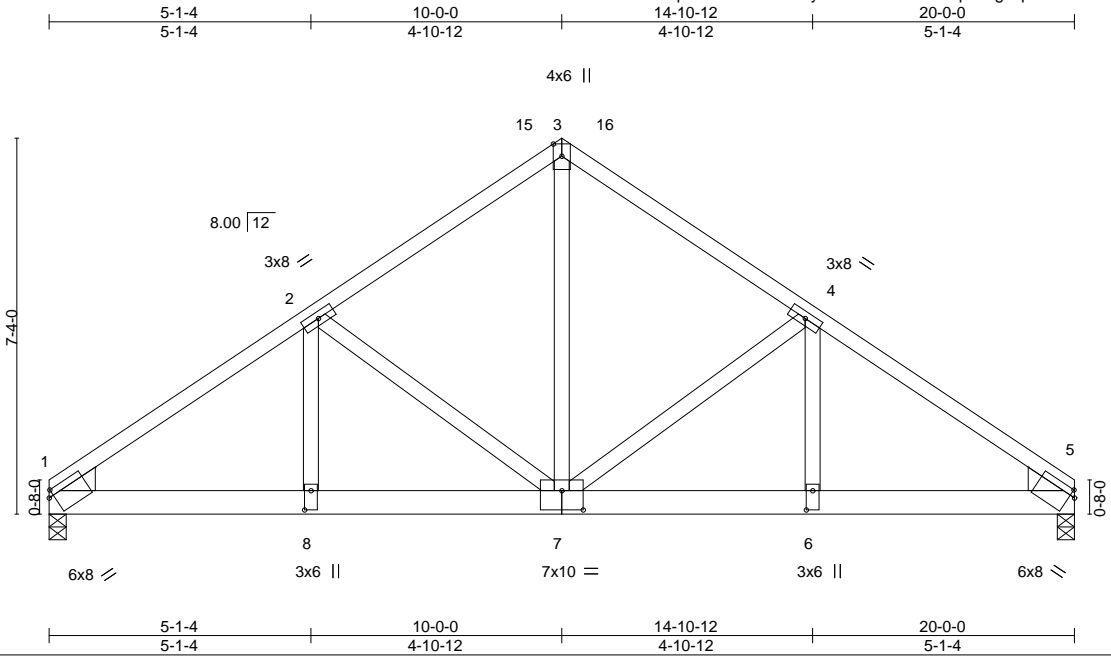


Plate Offsets (X,Y)-- [1:0-1-3,0-1-8], [5:0-1-3,0-1-8], [6:0-4-8,0-1-8], [7:0-5-0,0-4-8], [8:0-4-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.50	Vert(LL)	-0.10	7-8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.50	Vert(CT)	-0.21	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.74	Horz(CT)	0.05	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.09	7-8	>999		
								Weight: 369 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP DSS
WEBS 2x4 SP No.3 *Except*
3-7: 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


WEDGE
Left: 2x6 SP No.2 , Right: 2x6 SP No.2

REACTIONS. (size) 1=0-4-0, 5=0-4-0
Max Horz 1=-143(LC 4)
Max Uplift 1=-1045(LC 8), 5=-1045(LC 9)
Max Grav 1=9350(LC 1), 5=9350(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-12112/1357, 2-3=-8513/1004, 3-4=-8513/1004, 4-5=-12112/1358
BOT CHORD 1-8=-1180/9986, 7-8=-1180/9986, 6-7=-1061/9986, 5-6=-1061/9986
WEBS 3-7=-1028/9039, 4-7=-3698/537, 4-6=-420/3967, 2-7=-3698/536, 2-8=-419/3967

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=1045, 5=1045.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-5=-60, 9-12=-875(F=-855)

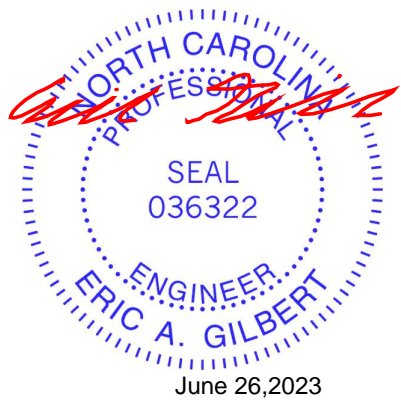

Job MP24	Truss P01G	Truss Type GABLE	Qty 2	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163126
-------------	---------------	---------------------	----------	----------	--

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:33 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:11.1

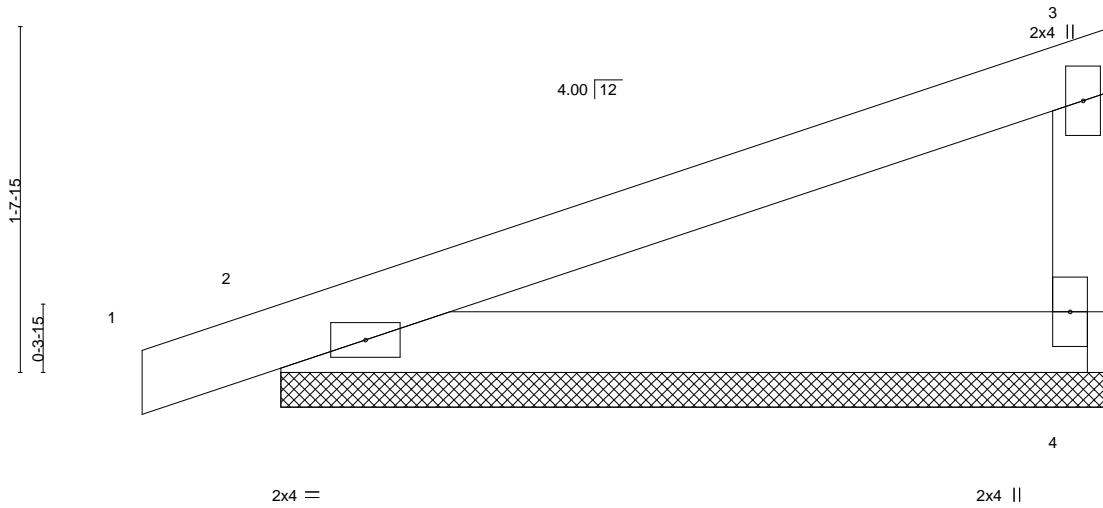

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	-0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	0.01	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 15 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-0-0, 4=4-0-0
 Max Horz 2=52(LC 9)
 Max Uplift 2=39(LC 8), 4=21(LC 12)
 Max Grav 2=198(LC 1), 4=151(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

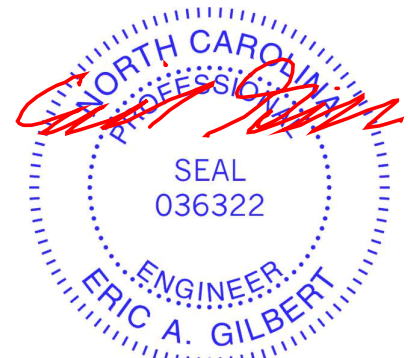

June 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932


Job MP24	Truss P02	Truss Type MONO TRUSS	Qty 8	Ply 1	DRHORTON/WILMINGTON; LOT 24 MCKAY PLACE 159163127
-------------	--------------	--------------------------	----------	----------	--

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Fri Jun 23 16:53:34 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f
4-0-0
4-0-0

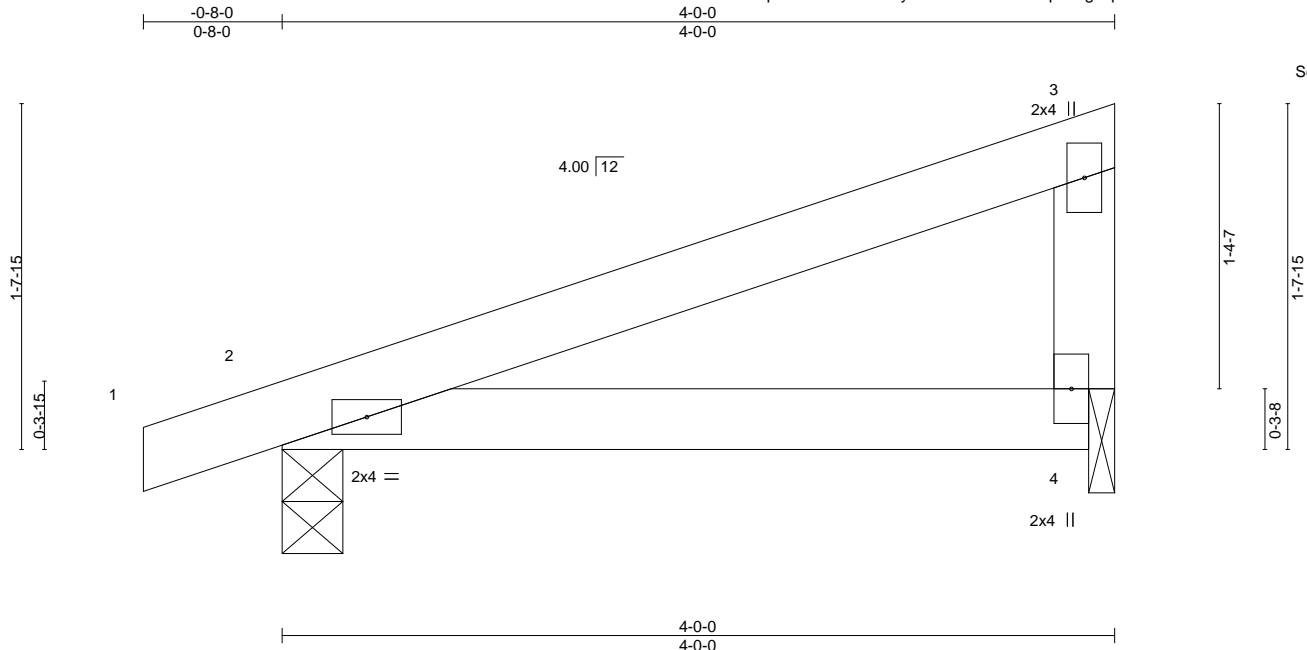


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0 Plate Grip DOL 1.15	TC 0.19	Vert(LL) -0.01	4-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) -0.02	4-7	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MP	Wind(LL) 0.01	4-7	>999	240	Weight: 15 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 4=0-1-8
 Max Horz 2=52(LC 11)
 Max Uplift 2=39(LC 8), 4=21(LC 12)
 Max Grav 2=198(LC 1), 4=151(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

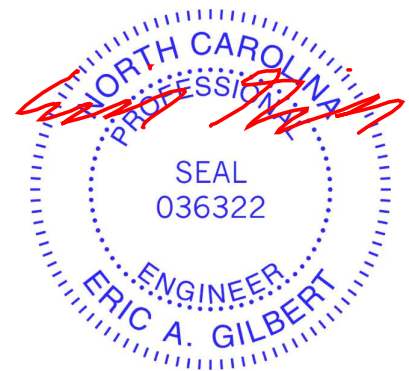

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ \" from outside edge of truss.



* Plate location details available in MITek software or upon request.

PLATE SIZE


4 X 4
The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



1 TOP CHORDS
2 Joint ID typ.

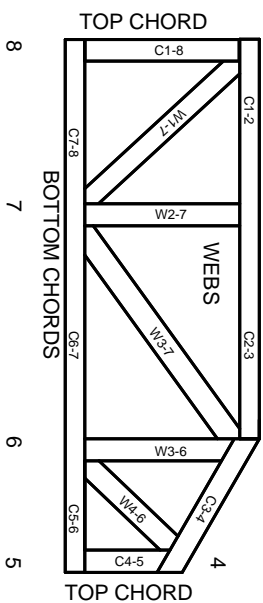

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023