SHINGLE ROOF 1 × 5 FASICA

ELEVATION NOTES.

GRADE ELEVATIONS SHOUN DO NOT NECESSARILY REFER TO THIS OR ANY OTHER LOT. THEY ARE
FOR DIAGRAMMATIC PURPOSES ONLY AND MAY VARY. BUILDER IS RESPONSIBLE FOR ADAPTING THIS PLA
TO BUIT THE EXISTING TOPOGRAPHY OF THE SITE.

ROOF VENTILATION TO BE DETERMINED BY BUILDER AS PER CODE.

ALL EGRESS OR RESCUE WINDOWS FROM SLEEPING ROOMS MUST HAVE A MIN. NET CLEAR OPENING OF 4.0 SQ FT. THE MIN NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 22", THE MIN NET CLEAR OPENING WIDTH SHALL BE 20",

EACH EGREŚŚ WINDOW FROM ŚLEEPING ROOMŚ MUŚT HAVE A ŚILL HGHT OF NO MORE THAN 44" FROM THE FLOOR. ALL WINDOW SIZEŚ ARE NOMINAL AND ARE TO BE VERIFED WITH MANUFACTURER FOR AVAILABILITY AND CONFORMITY TO STATE AND LOCAL CODE REQUIREMENTS.

PORCHES, BALCONIES, OR RAISED FLOOR SURFACES LOCATED MORE THAN 30" ABOVE THE FLOOR OR GRADE BELOU SHALL HAVE GUARDRAILS NOT LESS THAN 32" IN HEIGHT.

ASSUME NO RESPONSIBILITY FOR ANY DISTANCES AFTER START OF CONSTRUCTION.
CONTRACTOR (BUILDER SHALL CONSULT WITH HOME OWNER ON ALL INTERIOR AND BOTERIOR MOLDINGS, TRIMS, COLORS, SHIGHES, CABINET LAYOUTS, AND HANDRACTORS BEFORE CONSTRUCTION BEGINS.
ALL BEAMS AND FRAMING MEMBERS ARE SIZED BY OTHERS.

1.1 This plan has been drawn to comply with the 2018 NC Building Code

1.2 Minimum Design Loads for Building and Other Structures ASCE 1-9B 2 Roof Dead Load 115 PSF 3 Roof Live Load 20 PSF

4 Typical Floor Dead Load 10 PSF 5 Floor Live Loads

Floor Live Loads
5.1 Rooms other than sleeping rooms 40 PSF
5.2 Sleeping Rooms 30 PSF
5.3 Stairs 40 PSF
5.4 Decks 40 PSF

5.5 Exterior Balconies 60 PSF

Wind Loads

6.1 Ultimate Design Wind Speeds 15 MPH

6.2 Wind Importance Factor, IW 1.00 6.3 Exposure B

6.4 Walls (Component and Cladding) 25 PSF


6.5 Roofs (Component and Cladding) 6.5.1 Roof Slopes 2.25/12 to 7/12 34.8 PSF 6.5.2 Roof Slopes 7/12 to 12/12 21 PSF

It is the sole responsibility of the Contractor and/or Builder to conform to all standards, provisions, requirements, nathods of construction and uses of naterials provided in buildings and/or structures as required by NC Uniform Building Code, Local Agenciand in accordance utilty good engineering practices. Verify all climensions prior to construction.



FRONT ELEVATION

SCALE: 1'= 1/4"

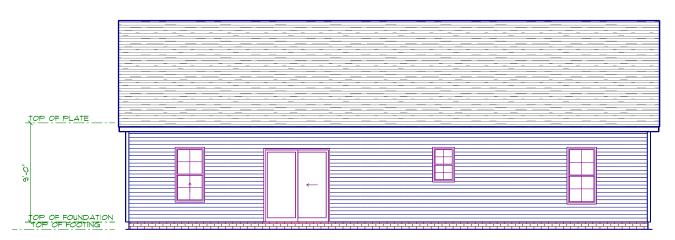

REAR ELEVATION

SCALE: 1'= 1/4"

DRO

HOMES

THE CARTER RIGHT FRONT PORCH

FRONT & REAR ELEVATIONS

TOP OF PLATE TOP OF FOUNDATION LEFT ELEVATION SCALE: 1'= 1/4"



RIGHT ELEVATION

9CALE: 1'= 1/4"

Diane Rives Designs 6205 Mockingoind Lane 9anford, N.C. 21332 919-110-0353 golfwoman@charter.net

Dlane R 6205 Nd 6205 Nd 6205 Nd 919-710golfwom

SCALE: 1'= 1/4"

DRAWN BY:

CRH HOMES

THE CARTER RIGHT FRONT PORCH

FLOOR PLAN

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED

FRAMING LUMBER SHALL BE SYP 72 GRADE AND/OR SPRUCE PINE FIR 11 AND/OR 72, KLIN DRIED.

WHERE PRE-ENGINEERED JOISTS ARE USED, JOIST MANUFACTURER SHALL PROVIDE SHOP DRAUNGS, WHICH BEAR SEAL OF A N.C. ENGINEER.

STUDS AND JOISTS SHALL NOT BE CUIT TO INSTALL PLUMBING OR WIRING WITHOUT ADDMS METAL OR WOOD SIDE PAINELS TO STRENGTHEN THE METHER TO ITS ORIGINAL CAPACITY.

ALL MALTIPLE METHERS WITH 2 ROUS OF IGN MALLS STAGGERED 32" OC AN USE 3-160 NAILS 2" IN AT EACH END. DOUBLE ALL STUDS WIDER ROOF POST DOWNS UNO NAIL FLOOR JOISTS TO SILL PLATE WITH SCI TOE NAILS.


ALL EXPOSED FRAMING ON PORCHES AND DECKS SHALL BE PRESSURE TREATED. PROVIDE WATERPROCPING AND DRAINS AS REQUIRED.

ALL FRAMING TO BE 16" OC UNO. WALL FRAMING DIMENSIONS ARE BASED ON 2 X 4 STUDS UNO. DOUBLE \$100S ENDS FUNDS INDER ALL HEADERS.

LYL'S AND TUI'S TO BE SIZED BY OTHERS

EXTERIOR WALLS IN LIVING AREAS ARE 2 × 4

OPENING SCHEDULE						
SIZE	COUNT	LIBRARY NAME	R.O. WIDTH	R.O. HEIGHT		
2'-0" x 3'-0"	2	Window\Single Hung	24"	36"		
2'-8" x 5'-0"	3	Window\Single Hung	32"	60-1/2"		
2'-8" x 5'-0" Dbl	3	Window\Single Hung	64"	60-1/2"		

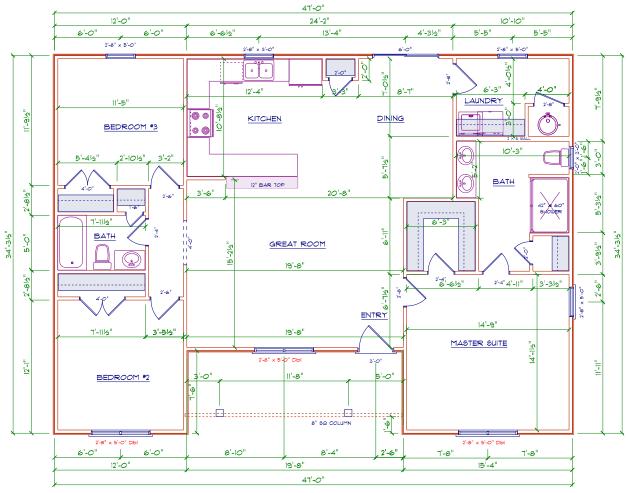

FLOOR PLAN

SCALE: 1'= 1/4"

AREA SCHEDULE				
NAME	AREA			
Heated	1464.2 sq ft.			
Covered Front Porch	114.4 sq ft.			

FOUNDATION NOTES: ALL FOOTINGS SHALL BEAR ON ORIGINAL UNDISTURBED SOIL. THE 28 DAY COMPRESSIVE STRENGTH OF ALL FOOTINGS IS 3000 PSI

PROVIDE WATER PROOFING AND PERIMETER DRAINS AS REQUIRED.


FOUNDATION CONCRETE MIX TO HAVE 1-1/2" MAX AGGREGATE SIZE, CONCRETE FILL MIX TO HAVE 1/2" MAX AGGREGATE SIZE.


FOOTING WIDTHS ARE BASED ON A LOAD-BEARING SOIL CAPACITY OF 2000 PSI.

PROVIDE 6 MIL POLY VAPOR BARRIER TO COVER GROUND SURFACE IN CRAWL SPACE


ALL ANCHOR BOLTS TO BE $12^{\prime\prime}$ LONG, $1/2^{\prime\prime}$ DIA. A36 UNO ANCHOR BOLTS SHALL BE SPACE AT A MAX OF 6' OC AND NO MORE THAN 1' FROM EA CORNER.

Termite Soil Treatment: Treat entire slab area soil or crawl space surface before vapor barrier is installed and slab is poured with a state approved termiticide. Termiticide should be applied by a licensed and certified pest control professional by the state of North Carolina.

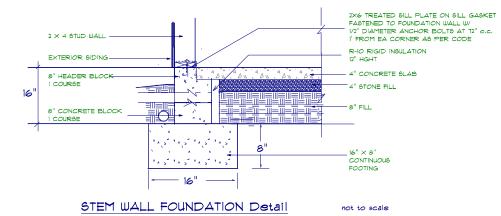

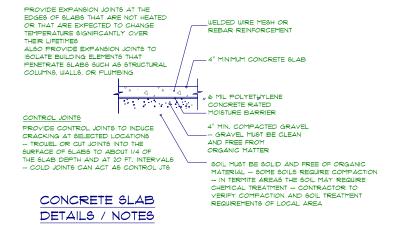


FOUNDATION NUTS, BOLTS, WASHERS 6'-0, OC 1'-0 FROM EACH CORNER

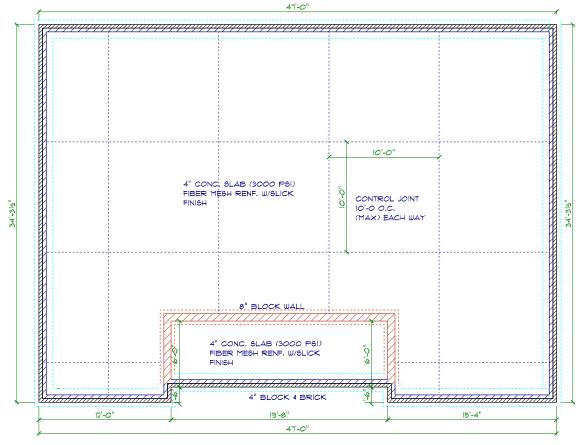

FOUNDATION PLAN

SCALE: 1'= 1/4"




TYPICAL THICKENED SLAB

DRD

CARTER

WALL FOUND

ELECTRICAL LEGEND					
ELECTRICAL	COUNT	SYMBOL			
ceiling fan	2				
10" led	2	0			
7" led	10				
foyer light	1	0			
dinning room light	1	0.0 0.00 0 0			
coach light	1				
exterior over head light	2	0			
flood light	2	\$\Pi\$			
vanity bar light	3	000			
wall sconce		00			
pendant light		Φ			

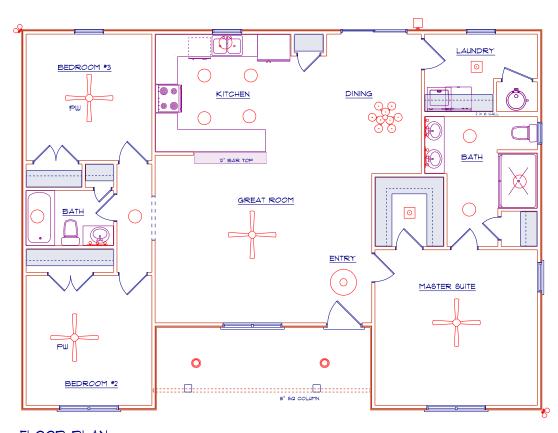


CRH HOMES

THE CARTER RIGHT FRONT PORCH

ELECTRICAL LAYOUT

FLOOR PLAN

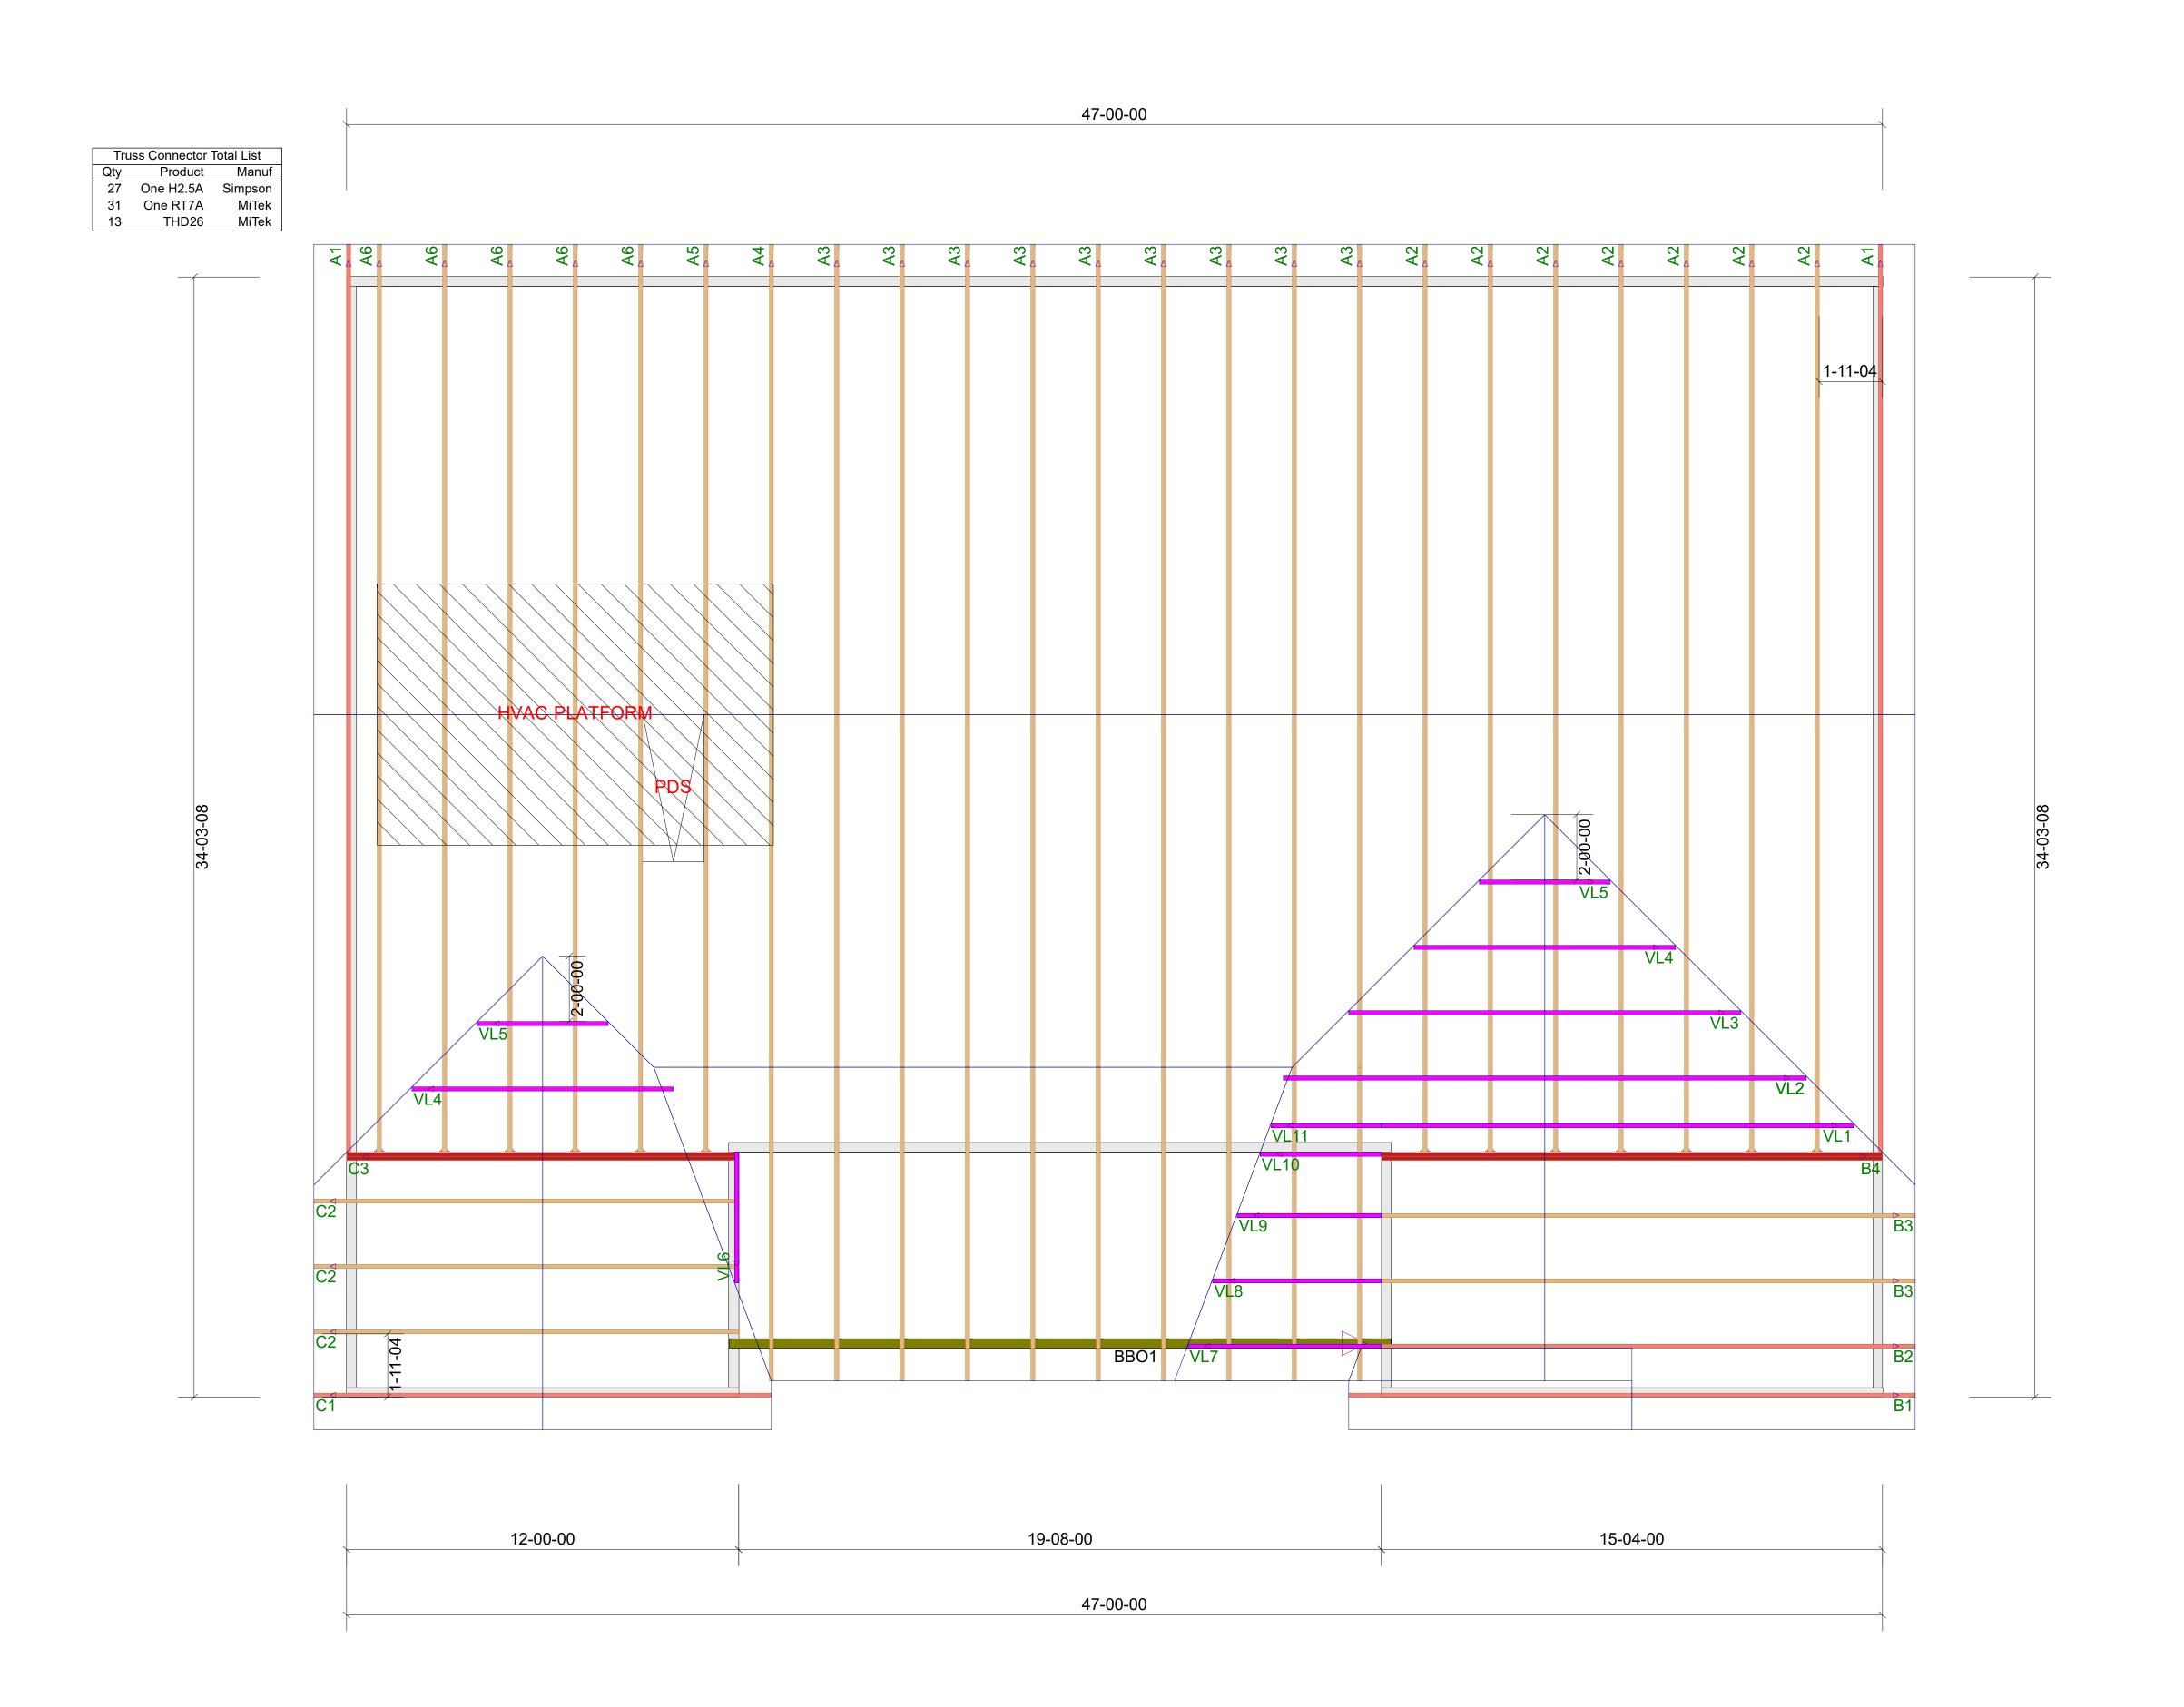



F TRUSS PLACEMENT PLAN

CRH Homes

REVISIONS		
DATE	BY	
08-10-22	TK	

PROJECT NUMBER

22080073

SHEET NUMBER

1 1 1 1

ROOF TRUSS FRAMING

DRAWING SCALE: NTS