

Job	Truss	Truss Type	Qty	Ply	LOT 36 PROVIDENCE CREEK   122 PROVIDENCE CREEK DRIVE FUQUAY-VARINA, NC	165199087
24-1269-R01	R05A	Piggyback Base	7	1	Job Reference (optional)	

Atlantic Building Components & Services, Inc., Moncks Corner, SC - 29461,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Apr 26 13:41:56 2024 Page 1

ID:av29u\_vm2cwLXF0Wc5ybywV6X0-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?F

-0-10-8	8-10-5	17-5-3	26-0-0	32-0-0	39-9-12	45-11-5	50-8-8
0-10-8	8-10-5	8-6-13	8-6-13	6-0-0	7-9-12	6-1-9	4-9-3

REPAIR:  
2-0-0 LONG SPLIT IN BOTTOM CHORD STARTING AT JOINT (19) RUNNING RIGHT.

Scale = 1:93.0

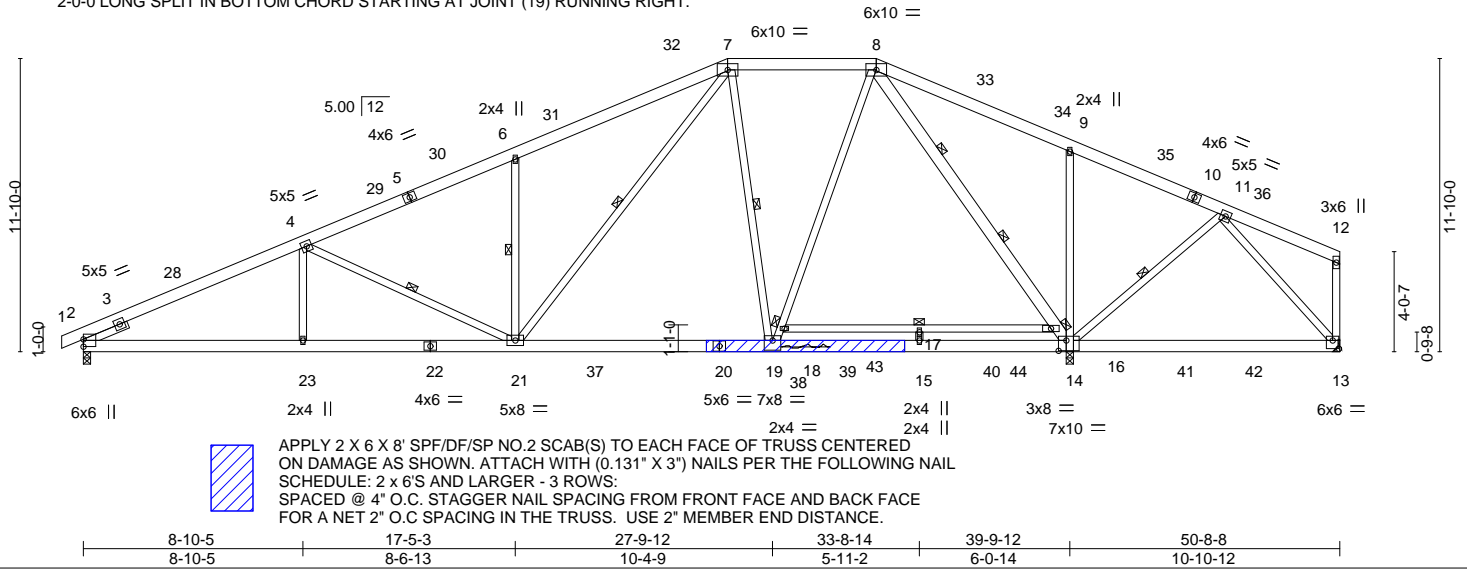


Plate Offsets (X,Y)-- [13:0-3-0,0-4-0], [14:0-3-12,0-5-0], [19:0-4-0,0-4-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 20.0	Plate Grip DOL 1.15		TC 0.63	Vert(LL) -0.48	17-18	>999	240	MT20	244/190
Snow (Pf) 20.0	Lumber DOL 1.15		BC 0.84	Vert(CT) -0.69	17-18	>697	180		
TCDL 10.0	Rep Stress Incr YES		WB 0.99	Horz(CT) 0.06	14	n/a	n/a		
BCLL 0.0 *	Code IRC2021/TPI2014		Matrix-AS						
BCDL 10.0								Weight: 422 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.2  
 BOT CHORD 2x6 SP No.2 \*Except\*  
 2-22,14-20: 2x6 SP DSS, 16-18: 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\*  
 8-14: 2x6 SP DSS  
 SLIDER Left 2x4 SP No.3 1-11-0

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied. Except:  
 10-0-0 oc bracing: 16-18  
 WEBS 1 Row at midpt 4-21, 6-21, 7-21, 7-19, 11-14  
 2 Rows at 1/3 pts 8-16

**REACTIONS.**

(size) 2=0-3-8, 13=Mechanical, 14=0-3-8  
 Max Horz 2=177(LC 18)  
 Max Uplift 2=-208(LC 14), 13=-411(LC 56), 14=-133(LC 14)  
 Max Grav 2=1712(LC 39), 13=72(LC 14), 14=4222(LC 45)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-3104/345, 4-6=-2551/271, 6-7=-2617/412, 7-8=-1264/226, 8-9=-5/1214, 9-11=-68/1221  
 BOT CHORD 2-23=-398/2773, 21-23=-398/2773, 19-21=0/1360, 15-19=0/475, 14-15=0/475, 13-14=-461/88, 17-18=-33/275, 16-17=-33/275  
 WEBS 4-23=0/297, 4-21=-668/210, 6-21=-927/279, 7-21=-362/1751, 7-19=-960/270, 18-19=-129/1738, 8-18=-90/1737, 8-16=-2940/163, 14-16=-2857/130, 9-14=-783/237, 11-14=-779/158, 11-13=-79/756, 15-17=-389/0

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=120mph (3-second gust) Vasd=95mph; TCCL=5.0psf; BCDL=5.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 3-11-2, Interior(1) 3-11-2 to 19-2-9 to 38-9-7, Interior(1) 38-9-7 to 45-9-2, Exterior(2E) 45-9-2 to 50-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide metal plate or equivalent at bearing(s) 14 to support reaction shown.



April 30, 2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	LOT 36 PROVIDENCE CREEK   122 PROVIDENCE CREEK DRIVE FUQUA I65199087
24-1269-R01	R05A	Piggyback Base	7	1	Job Reference (optional)

Atlantic Building Components & Services, Inc., Moncks Corner, SC - 29461,

8.430 s Jan 6 2022 MiTek Industries, Inc. Fri Apr 26 13:41:56 2024 Page 2  
ID:av29u\_vm2cwLlXF0Wc5ybwyV6X0-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

- NOTES-**
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 208 lb uplift at joint 2, 411 lb uplift at joint 13 and 133 lb uplift at joint 14.
  - 13) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION

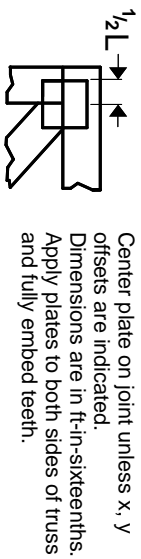

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

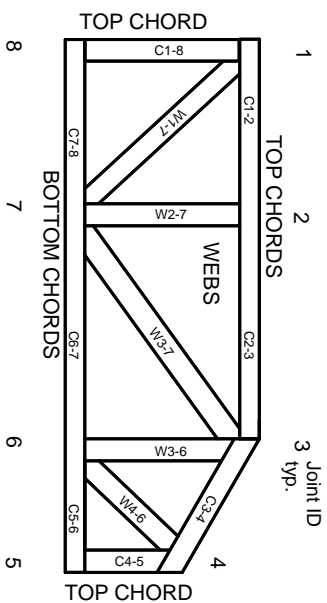

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

**MITek**

ENGINEERING BY  
**TRENGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.