COLEMAN

HARRINGTON PLACE LOT 0014



PLAN ID 060121.1201

110 VILLAGE TRAIL SUITE 215 WOODSTOCK, GA. 30188

DRAWING INDEX

A0.0	COVER SHEET
A1.1	FRONT ELEVATIONS
A2.1	SIDE & REAR ELEVATIONS
A3.1	SLAB FOUNDATION
A5.1	FIRST FLOOR PLANS & DETAILS
A5.2	SECOND FLOOR PLANS & DETAILS
A6.1	ROOF PLANS
A7.2-A7.3	ELECTRICAL PLANS

AREA TABULATION			
FIRST FLOOR	838		
SECOND FLOOR	1215		
TOTAL	2053		
GARAGE	438		
FRONT PORCH (COVERED)	84		
REAR PATIO (COVERED)	120		

GOVERNMENTAL CODES & STANDARDS

HOME TO BE BUILT TO CONFORM TO ALL APPLICABLE LOCAL CODES, PRACTICES AND STANDARDS

BUILDING CODE ANALYSIS / DESIGN CRITERIA


HOME TO BE BUILT TO MEET OR EXCEED ALL LOCAL CODES AND DESIGN CRITERIA

PLAN REVISIONS					
DATE	BY	REVISION	PAGE #		
10/30/2021	AW	Prototype walk revisions - see revision sheet	ALL		
4/1/2022	AW	Final walk revisions - see revision sheet	A5.2, A5.2, A7.3		
11/1/2022	AW	PCR #4985 Change 2x6 wall in laundry to 2-2x4s - takes 1.5" out of hall/linen	A5.2, A7.3		
12/1/2022	AW	PCR #5030 Added 8" in depth to kitchen (pantry & around island) - reduced Dining/Study 8" in depth	A3.1, A5.1, A7.2, A8.1		
9/21/2023	BB	REMOVED SHOWER AND TUB SIZES FROM ALL AFFECTED PAGES	A3.1, A5.1, A7.3		

ALL NON-MASONRY RETURNS TO BE HORIZONTAL SIDING

SEE SHEET D3 OF SDH TYPICAL DETAILS FOR SOFFIT DETAILS PER SOFFIT MATERIAL

HARRINGTON PLACE LOT 0014

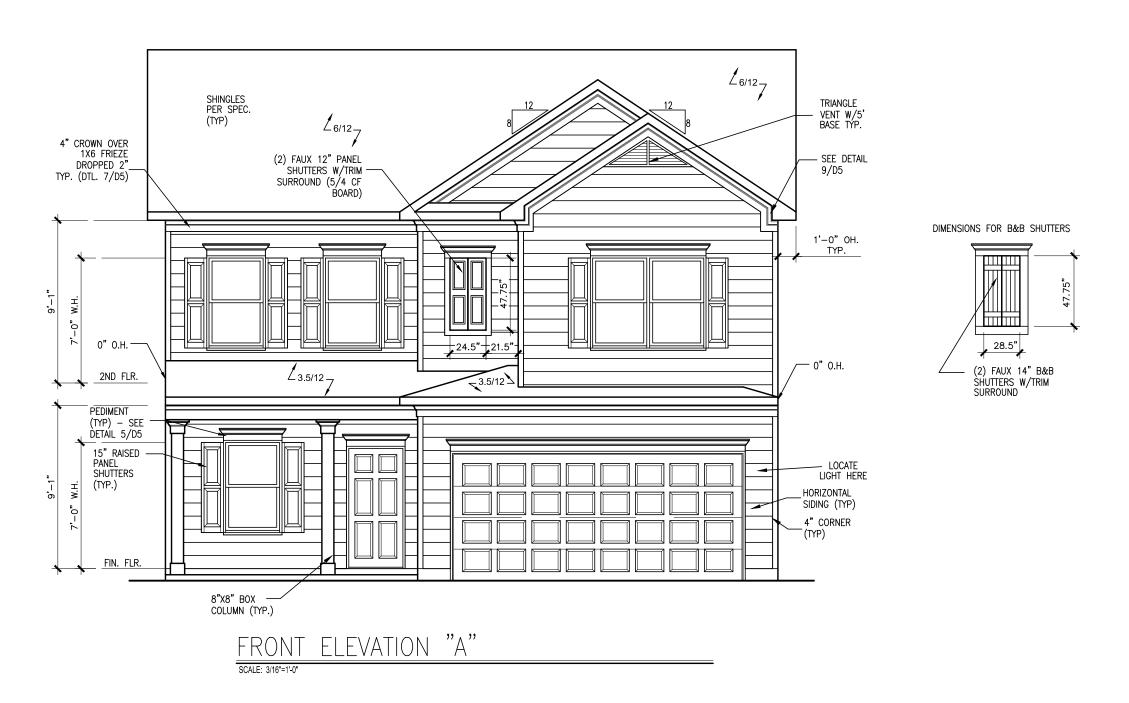



SMITH DOUGLAS HOMES GUALITY I INTEGRITY I VALUE


ELEVATIONS FRONT ELEVATION COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH DOUGLAS HOMES.




SHINGLES PER SPEC. (TYP) AND FIR LEFT ELEVATION "A" SOME 189-19"

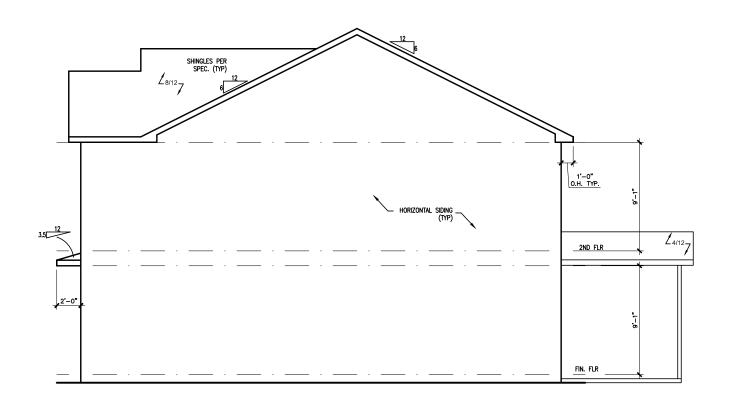

RIGHT ELEVATION "A"

HARRINGTON PLACE LOT 0014

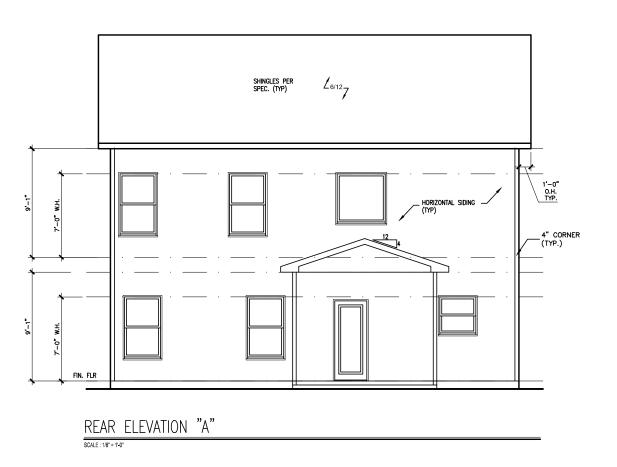



REAR SMITH DOUGLAS HOMES

AN

QUALITY I INTEGRITY I VALUE

ELEVATIONS
SIDES AND RE
SIDES AND RE
COLEMAN
COLEMAN

SMITH DOUGLAS HOMES
expressly reserves it's
property rights in these
plans and drawings.

12'-0" DROP 4" BELOW HOUSE SLAB PROVIDE ELECTRICAL CONDUIT TO ISLAND 18'-5½" **(WH)** | DROP 4" BELOW HOUSE SLAB START AT THIS CORNER TO LAY OUT PLATES DROP 4" BELOW HOUSE SLAB 16' X 7' OHGD (R.O. 16'-3" X 7'-1 1/2") 1'-10½" 1'-10½" 16'-3" SLAB PLAN SCALE : 1/8" = 1'-0"

HARRINGTON PLACE LOT 0014

*RADON VENT PROVIDED PER LOCAL CODE

REFER TO DETAIL 3/D1
FOR BRICK LEDGE
DETAIL WHEN BRICK
VENEER IS CHOSEN




SMITH DOUGLAS HOMES


FOUNDATION PLAN
SLAB PLAN
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without writte consent from SMITH DOUGLAS HOMES.




HARRINGTON PLACE LOT 0014






SMITH DOUGLAS HOMES
110 VILLAGE TRAIL
SUITE 115
WOODSTOCK, GA 30188
www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans are not related drawings are not to be reproduced without writte consent from SMITH DOUGLAS HOMES.




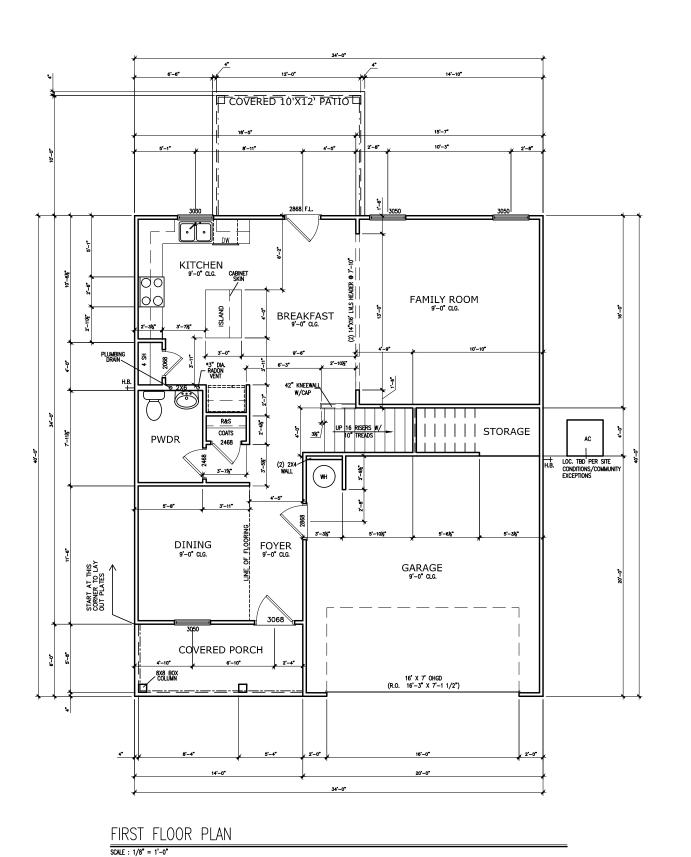

*RADON VENT PROVIDED

PER LOCAL CODE

HARRINGTON PLACE LOT 0014

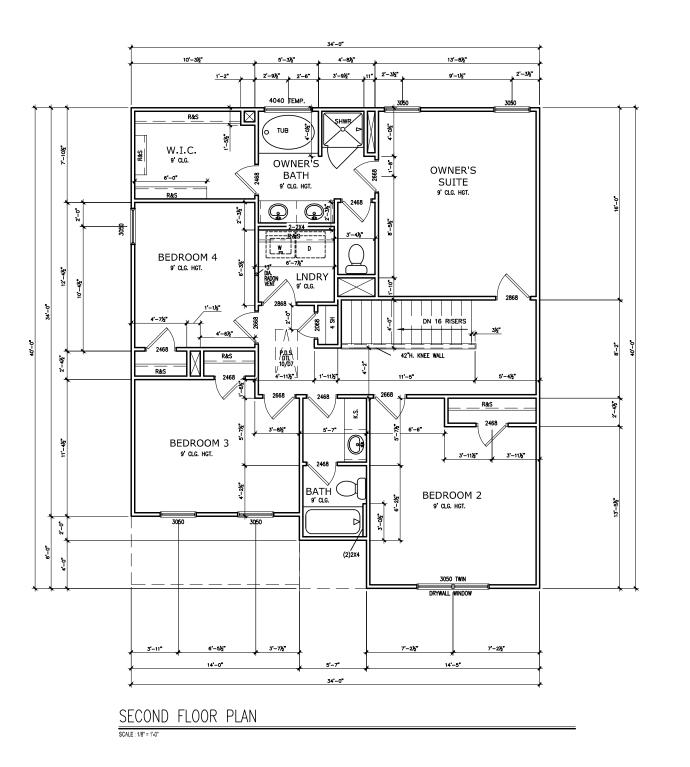



SMITH DOUGLAS HOMES

FLOOR PLAN SECOND FLOOR COLEMAN


SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans are not related trawings are not to be reproduced without writt consent from SMITH DOUGLAS HOMES.

*RADON VENT PROVIDED PER LOCAL CODE


REFER TO MANUFACTURER'S SPECS. FOR DRAIN LOCATIONS ON DETAIL SHEETS D12, D12.1, & D12.2

© SMITH DOUGLAS HOMES 2021



4/12 **←** 4/12 1'-0" RIDGE VENTS 8'X8' HVAC PLATFORM < 8/12 8/12 ROOF PLAN "A" SCALE : 1/8" = 1'-0"

HARRINGTON PLACE LOT 0014



SMITH DOUGLAS HOMES

SMITH DOUGLAS HOMES
110 VILLAGE TRAIL
SUITE 115
WOODSTOCK, GA 30188
www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be

PLAN ID:

PAGE NO:

AW

DATE: 3/22/24

FACADE OPT:

A

PLELEV:

A

PAGE NO:

A6.1

COVERED 10'X12' PATIO **FAMILY** ROOM BREAKFAST KITCHEN STORAGE ELECTRICAL PROVIDED AS NEEDED GARAGE FOYER DINING COVERED PORCH


FIRST FLOOR ELECTRICAL PLAN

SCALE : 1/8" = 1'-0"

HARRINGTON PLACE LOT 0014

ELECTRICAL LEGEND				
\$	SWITCH		TV	
\$3	3 WAY SWITCH	ф	120V RECEPTACLE	
\$4	4 WAY SWITCH	P	120V SWITCHED RECEPTACLE	
Ø	CEILING FIXTURE	Φ	220V RECEPTACLE	
-ф _к	KEYLESS	P _{GFCI}	GFCI OUTLET	
ΗØ	WALL MOUNT FIXTURE	PAFCI	ARCH FAULT CIRCUIT	
0	CEILING FIXTURE	† _{GL}	GAS LINE	
•	FLEX CONDUIT	† _{wL}	WATER LINE	
СН	CHIMES	¥	HOSE BIBB	
₽H	TELEPHONE	8	FLOOD LIGHT	
SD/Cd ₩	SMOKE DETECTOR & CARBON MONOXIDE		1x4 LUMINOUS FIXTURE	
SO	SECURITY OUTLET		2511112	
	GARAGE DOOR OPENER		CEILING FAN	
	EXHAUST FAN		ELECTRICAL WIRING	
<u> </u>	FAN/LIGHT		CEILING FIXTURE	
ELECTRICAL PLANS TO FOLLOW ALL LOCAL CODES				
APPROX. FIXTURE HGTS (MEASURED FROM BOTTOM OF FIXTURE)				
BREAKFAST/DINING ROOM 63" ABOVE FINISHED FLOOR				
KITCHEN PENDANT LIGHTS 33" ABOVE COUNTER TOP				
TWO STORY FOYER FIXTURE 96" ABOVE FINISHED FLOOR				
CEILI	NG FAN	96" ABO	VE FINISHED FLOOR	
FLOO	D LIGHT	10' MAX.	. ABOVE FIN. FLOOR	

NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER



SMITH DOUGLAS HOME

ELECTRICAL PLAN FIRST FLOOR COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related



W.I.C. OWNER'S BATH BEDROOM 4 BEDROOM 3 BEDROOM 2 BEDROOM 2

SECOND FLOOR ELECTRICAL PLAN

SCALE : 1/8" = 1'-0"

HARRINGTON PLACE LOT 0014

ELECTRICAL LEGEND				
\$	SWITCH		TV	
\$3	3 WAY SWITCH	φ	120V RECEPTACLE	
\$4	4 WAY SWITCH	•	120V SWITCHED RECEPTACLE	
Ø	CEILING FIXTURE	•	220V RECEPTACLE	
-ф _к	KEYLESS	P _{GFCI}	GFCI OUTLET	
ΗØ	WALL MOUNT FIXTURE	PAFCI	ARCH FAULT CIRCUIT	
0	CEILING FIXTURE	† _{GL}	GAS LINE	
•	FLEX CONDUIT	† _{wL}	WATER LINE	
СН	CHIMES	¥	HOSE BIBB	
₽H	TELEPHONE	B	FLOOD LIGHT	
SD/Cd ₩	SMOKE DETECTOR & CARBON MONOXIDE		1x4 LUMINOUS FIXTURE	
SO	SECURITY OUTLET			
	GARAGE DOOR OPENER		CEILING FAN	
	EXHAUST FAN		ELECTRICAL WIRING	
0	FAN/LIGHT		CEILING FIXTURE	
ELECTRICAL PLANS TO FOLLOW ALL LOCAL CODES				
APPROX. FIXTURE HGTS (MEASURED FROM BOTTOM OF FIXTURE)				
BREAKFAST/DINING ROOM 63" ABOVE FINISHED FLOOR				
KITCH	HEN PENDANT LIGHTS	33" ABOVE COUNTER TOP		
TWO STORY FOYER FIXTURE 96" A			VE FINISHED FLOOR	
CEILI	NG FAN	96" ABOVE FINISHED FLOOR		
FLOO	D LIGHT	10' MAX	. ABOVE FIN. FLOOR	

NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER




SOND FLOOR

COLEMAN

SMITH DOUGLAS HOMES
110 VILLAGE TRAIL
SUITE 115
WOODSTOCK, GA 30188
www.smithdouglas.com

SMITH DOUGLAS HOMES
expressly reserves it's
property rights in these
plans and drawings.
These plans and related
drawings are not to be
reproduced without written
consent from SMITH
DDUIGLAS HOMES



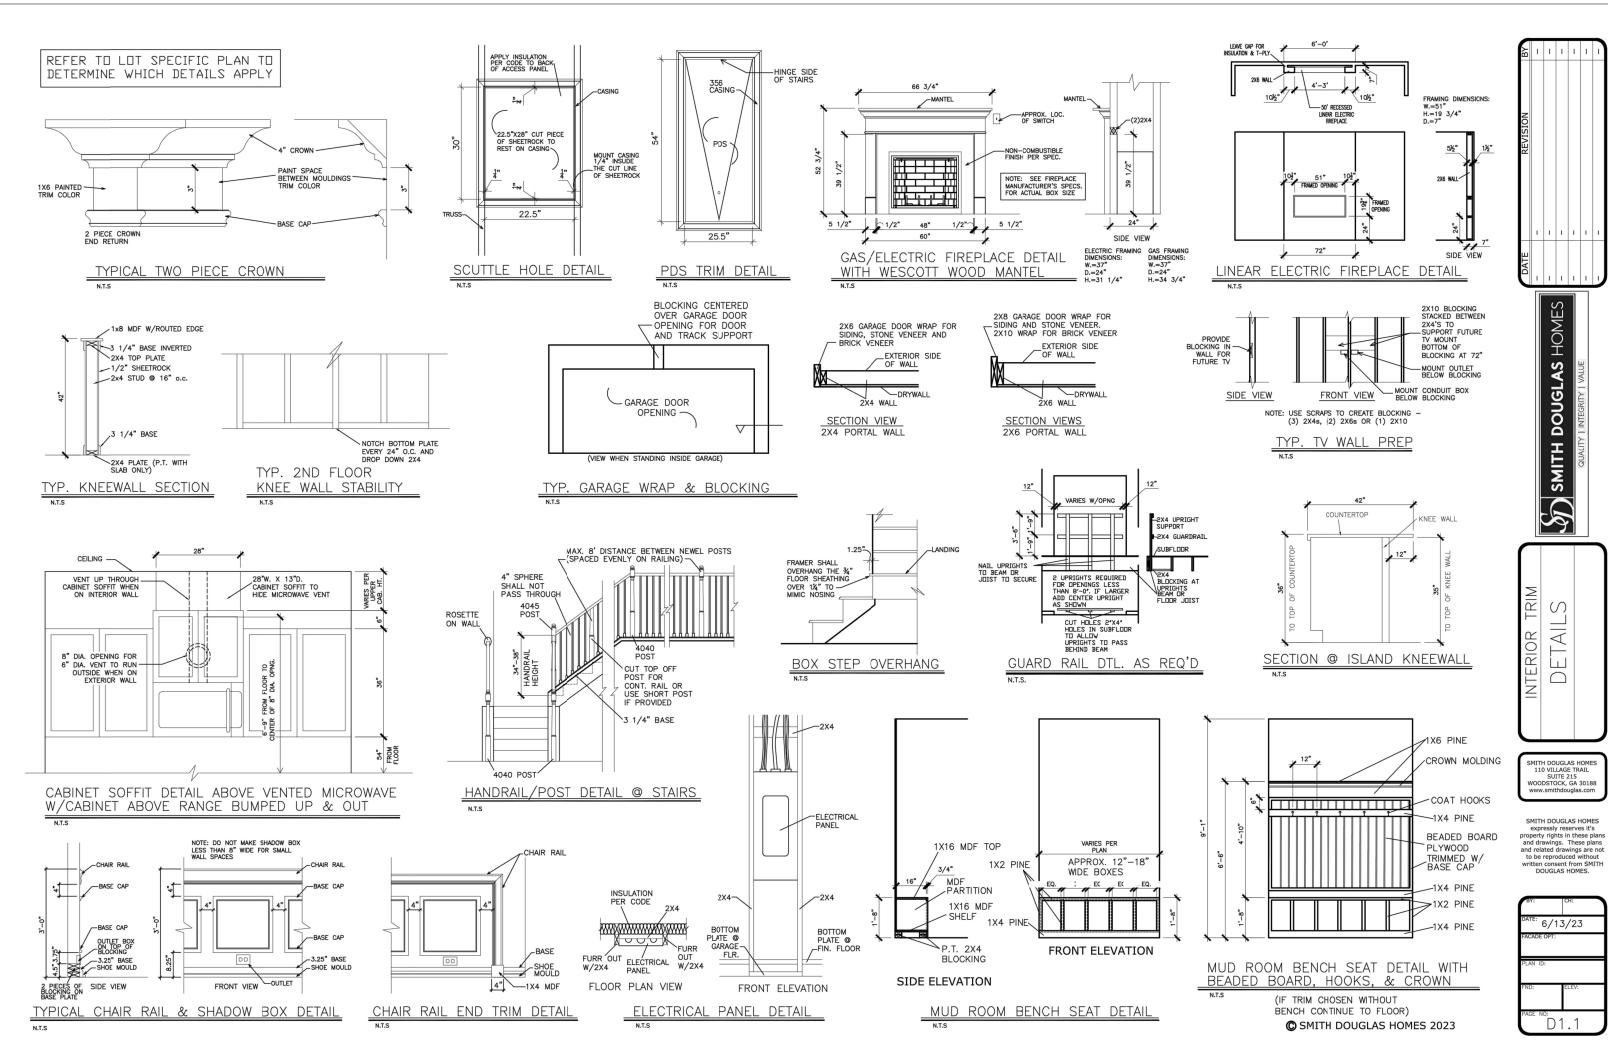

CONNECTION SPECIFICATIONS (TYP. U.N.O.)

DESCRIPTION OF BLDG. ELEMENT	3"x0.l31" NAIL5	3"x0.120" NAILS
JOIST TO SOLE PLATE	(3) TOENAILS	(3) TOENAILS*
SOLE PL. TO JOIST/RIM OR BLK'G	NAILS @ 4" o.c.	NAILS @ 4" o.c.
STUD TO PLATE	(4) TOENAILS/ (3)END NAILS	(4) TOENAILS/ (4)END NAILS*
RIM TO TOP PLATE	TOENAILS @ 6" O.C.	TOENAILS @ 4" O.C.*
BLK'G. BTWN, JOISTS TO TOP PL.	(3) TOENAILS EA. END	(3) TOENAILS EA. END*
DOUBLE STUD	NAILS @ 16" o.c.	NAILS @ 16" o.c.
DOUBLE TOP PLATE	NAILS @ 12" o.c.	NAILS @ 8" o.c.
DOUBLE TOP PLATE LAP SPLICE	(12) NAILS IN LAPPED AREA (24" MIN.)	(15) NAILS IN LAPPED AREA (24" MIN.)
TOP PLATE LAP @ CORNERS & INTERSECTING WALLS	(3) NAILS	(3) NAILS
RAFTER/TRUSS TO TOP PLATE	(4) TOENAILS +	(4) TOENAILS +
	(I) SIMPSON H2.5T	(I) SIMPSON H2.5T
GAB, END TRUSS TO DBL, TOP PL.	TOENAILS @ 8" o.c.	TOENAILS @ 6" o.c.
R.T. w/ HEEL HT. 9 ¼" TO 12"	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE
	w/ TOENAILS @ 6" O.C.	w/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. 12" TO 16"	2xI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE	2xI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE
	w/ TOENAILS @ 6" O.C.	w/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. UP TO 24"	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT
	FASTEN W/ NAILS @ 6" O.C.	FASTEN W/ NAILS @ 6" O.C.*
R.T. w/ HEEL HT. 24" TO 46"	LAP WALL SHTG. W/DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT	LAP WALL SHTG, W/DBL, TOP PL. \$ INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT
	TOP OF HEEL	TOP OF HEEL*
WALL TO FOUNDATION	MALL SHTG. LAP W/ SILL PL. & FASTENED PER SHEAR WALL FASTENING SPEC.	

* 2½"x0.113 IS AN ACCEPTABLE ALTERNATIVE TO A 3"x0.120", SAME SPACING OR NUMBER OF NAILS. ONLY ACCEPTABLE WHERE * ARE SHOWN)

ADDITIONAL NOTES FOR TRUSS \$ I-JOIST MANUFACTURER

ROOF TRUSS AND ENGINEERED JOISTS SHALL BE DESIGNED TO MEET THE DEFLECTION CRITERIA BELOW UNLESS NOTED OTHERWISE ON PLAN MULHERN & KULP CANNOT BE HELD RESPONSIBLE FOR ANY STRUCTURAL ISSUES RELATED TO ANY BUILDING COMPONENT IF COMPONENT SHOP DRAWINGS ARE NOT SUBMITTED TO M&K FOR REVIEW PRIOR TO FABRICATION, DELIVERY, OR INSTALLATION.

TRUSSES/LIGISTS SHALL BE DESIGNED SO THAT DIFFERENTIAL DEFLECTION BETWEEN ADJACEN PARALLEL TRUSSES/JOISTS OR GIRDER TRUSSES/FLUSI BEAMS DO NOT EXCEED THE FOLLOWING

- A. ROOF TRUSSES: I/4" DEAD LOAD
- ATTIC TRUSSES, & I-JOISTS: 1/8" DEAD LOAD

ABSOLUTE DEAD LOAD DEFECTION OF ATTIC TRUSSES WHEN AD IACENT TO ELOOR ERAMING BY OTHERS SHALL BE LIMITED TO 3/16". (NOT DIFFERENTIAL DEFLECTION)

VENEER LINTEL SCHEDULE

SPAN (MAX)	HEIGHT OF VENEER ABOVE LINTEL	STEEL ANGLE SIZE	
3'-0"	20 FT. MAX	L3"x3"x¼"	
	3 FT. MAX	L3"x3"x/4"	
6'-0"	I2 FT. MAX	L4"x3"x¼"	
	20 FT. MAX	L5"x3½"x5%"	
8'-0"	3 FT, MAX	L4"x4"x½" *	
0-0	I2 FT. MAX	L5"x3½"x5%"	
	I6 FT. MAX	L6"x3½"x¾"	
9'-6"	I2 FT. MAX	L6"x3½"x5%"	

. LINIELS: AALL SUPPORT 2 %" - 3 ½" VENEER W 40 psf MAXIMU 5' SHALL HAVE 4" MIN. BEARING 5' SHALL HAVE 8" MIN. BEARING 5' SHALL NOT BE FASTENED BACK TO HEADER.

- 'SHALL BE FASTENED BACK TO MOOD HEADER IN WALL @48°O.C. w/ ½" DIA. x 3 ½" DIA DA SCREYS IN 2" LONG VERTICALLY SLOTTED HOLES X. VENEER H. APPLIES TO ANY PORTION OF BRICK OVER THE OPENINS.
- LL LINTELS SHALL BE LONG LEG VERTICAL. HEN SUPPORTING VENEER < 3" WIDE THE EXTERIOR TOE OF THE HORIZONTAL LEG
- MAY BE CUT IN THE FIELD TO BE 3 ¼" WIDE OVER THE BEARING LENGTH ONLY. THIS TO ALLOW FOR MORTAR JOINT FINISHING. TRUCTURAL PLANS FOR ANY LINTEL CONDITION NOT ENCOMPASSED BY THE
- AKAMETERS. FN VENEER IAF I 4x3x½".

GENERAL STRUCTURAL NOTES

FOUNDATION

- DESIGN IS BASED ON 2018 NCSBC-RESIDENTIAL CODE \$ 2018 IRC WITH SOUTH CAROLINA AMENDMENTS
- FOOTING DESIGN 2,000 PSF NET ALLOWABLE SOIL BEARING PRESSURE IS ASSUMED. BUILDER/CONTRACTOR MUST VERIFY.
- FASTEN 2x4/6 SILL PLATES TO CONC FND WITH A MINIMUM OF 2 ANCHORS PER PLATE, 12" MAX. FROM PLATE ENDS - UTILIZING I/2" DIA. ANCHOR BOLTS @ 6'-0" O.C.7" MIN. EMBEDMENT
- FA4 ANCHOR STRAPS @ 6'-0" O.C ● EASTEN 2xIO SILL PLATES TO PRECAST BSMT WALLS WITH A MINIMUM
- OF 2 ANCHORS PER PLATE, 12" MAX. FROM PLATE ENDS UTILIZING: • I/2" DIA, BOLTS @ 2'-0" O.C
- ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT W/ PERIMETER FOUNDATION SHALL BE PRESERVATIVE TREATED SOUTHERN PINE #2.
- BUILDER TO VERIFY CORROSION-RESISTANCE COMPATIBILITY OF HARDWARE & FASTENERS IN CONTACT W/ PRESERVATIVE-TREATED WOOD, CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.
- FOUNDATION WALLS & FOOTINGS SHALL BE PLAIN CONCRETE, U.N.O.
- CONCRETE DESIGN BASED ON ACI 318. CONCRETE SHALL ATTAIN THE FOLLOWING MIN. COMPRESSIVE STRENGTHS IN 28 DAYS, U.N.O.:
- 3,500 psi: GARAGE & EXTERIOR SLABS ON GRADE = 60,000 psi
- BASEMENT FOUNDATION WALL DESIGN BASED ON:
 - . 8' OR 9' HEIGHT (AS NOTED ON PLANS) TALLER WALLS MUST BE ENGINEERED
- BASEMENT WALL DESIGN IS BASED ON 30 OR 45 PCF BACKFILL SOIL TYPE CLASSIFICATIONS:
 - 30 PCF TYPE (GW, GP, SW, SP) 45 PCF TYPE (GM, GC, SM, SM-SC, ML)
- IMPORTANT IF 60 PCF SOIL TYPE (SC, ML-CL, OR CL) IS UTILIZED FOR BACKFILL. CONTACT MULHERN & KULP FOR FURTHER EVALUATION OF FOUNDATION DESIGN
- BASEMENT WAI LS SHALL BE BRACED, PRIOR TO BACKFILLING, BY ADEQUATE TEMPORARY BRACING OR INSTALL 1st FLOOR DECK.
- ALL CONCRETE EXPOSED TO THE WEATHER SHALL NOT HAVE LESS THAN 5% OR MORE THAN 7% AIR ENTRAINMENT.
- ALL FOOTINGS SHALL BEAR BELOW FROST LINE (TYP.) OR 12" MIN IN REGIONS WHERE CODE FROST DEPTH IS NOT APPLICABLE. CONSULT SOILS REPORT OR BUILDING DEPT. FOR MINIMUM DEPTH BELOW
- FOOTINGS AND SLABS ON GRADE SHALL BEAR ON VIRGIN SOIL OR 95% COMPACTED FILL.
- PROVIDE CONTROL JOINTS AT ALL INSIDE CORNERS OF SLAB EDGES, AND OTHER LOCATIONS WHERE SLAB CRACKS ARE LIKELY TO DEVELOP.
- . JOINTS SHALL BE LOCATED @ 10'-0" O.C. (RECOMMENDED) OR 15'-0" O.C. (MAXIMUM)
- JOINT GRID PATTERN SHALL BE AS CLOSE TO SQUARES AS POSSIBLE (I:I RATIO), WITH A MAXIMUM OF I:I.5 RATIO · CONTROL JOINTS SHALL NOT BE INSTALLED IN STRUCTURAL
- PICAL REINFORGEMENT DETAILS: PROVIDE 3" MIN. CLEAR COVER WHERE CAST AGAINST FARTH LI/2" MIN CLEAR COVER AGAINST FORMS. LAP ALL REBAR 48 BAR DIAMETERS MIN. (24) FOR #4 BARS) & BEND BARS AND LAP AT CORNERS PROVIDE 6" HOOK INTO SUPPORTING FOOTINGS WHEN FOOTINGS INTERSECT
- DIMENSIONS BY OTHERS, BUILDER TO VERIEY

LEGEND

R.T. NINDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

GRADE

OF. NDICATES TRUSS OVERFRAMING @ 24" O.C. (TYP. U.N.O.)

FJ. 🔪 INDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING) LOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L IO PSF DEAD LOAD AT THESE LOCATIONS

- INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- - INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

_ATERAL/WALL BRACING & WALL SHEATHING SPECIFICATIONS

THIS MODEL HAS BEEN DESIGNED TO RESIST LATERAL FORCES RESULTING FROM:

DMPH WIND IN 2018 NCSBC:RO \$ 120MPH WIND IN 2018 IRC

(120 MPH WIND SPEED IN ASCE T WIND MAP PER IRC R301211) EXP. B, RISK CAT. 2 & SEISMIC CAT. A/B.

THE DESIGN WAS COMPLETED PER 2015 \$ 2018 IBO SECTION (609) & ASCE 7, AS PERMITTED BY R30113 OF THE 2018 NGSBC:RC & 2018 IRC. ACCORDINGLY THIS MODEL, AS DOCUMENTED AND DETAILED HEREWITHIN, IS ADEQUATE TO RESIST THE CODE REQUIRED LATERAL FORCES

DESIGN WIND UPLIFT LOADS HAVE BEEN CALCULATED UTILIZING ASCE 7 (ACCEPTED ENGINEERING PRACTICE) AS ALLOWED PER 2018 NCSBC:RC & 2018 IRC SECTION R802.II.I.I. THIS MODEL HAS BEEN DETAILED WHERE REQUIRED 8 ENGINEERED TO RESIST THE WIND UPLIET LOAD PATH PER SECTIONS R602.3.5¢ R802.II.

EXT. WALL SHEATHING SPECIFICATION

- 7/16" OSB OR 15/32" PLYWOOD: FASTEN SHEATHING W/ 2 3 "x0.II3 NAILS @ 6" O.C. AT EDGES ¢ @ 12" O.C. IN THE PANEL FIELD. (TYP, U.N.O.)
- ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUDS) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT ALL UNSUPPORTED PANEL EDGES & EDGE
- ALL EXT. WALLS SHALL BE CONTINUOUSLY SHEATHED AND ARE CONSIDERED SHEAR WALLS.
- ALT, STAPLE CONNECTION SPEC: 1 3/4" 16 GA STAPLES (1/6" CROWN) @ 3" O.C. AT EDGES \$ @ 6" O.C IN FIELD

3" O.C. EDGE NAILING

AT DESIGNATED AREAS - FASTEN PANEL EDGES OF WOOD STRUCTURAL WALL SHEATHING TO FRAMING W 2 3 × 0.113 NAILS @ 3" O.C. AND 12" O.C. IN THE PANEL FIELD NO STAPLE ALTERNATIVE AVAILABLE AT THIS SPEC. ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUD) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR - 2X HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT UNSUPPORTED PANEL EDGES AND 3" O.C. FDGE FASTENING.

NOTES

- SFF CONNECTION SPECIFICATIONS CHART FOR STANDARD SHEAR TRANSFER DETAILING. IF ADDITIONAL CAPACITY IS REQUIRED BY DESIGN, IT WILL BE SPECIFICALLY NOTED ON PLAN.
- DESIGN ASSUMES 16" O.C MAX. STUD SPACING, U.N.O
- ALL STRUCTURAL PANELS ARE TO BE DIRECTLY APPLIED TO STUD FRAMING.
- PRE-MANUFACTURED PANELIZED WALLS FASTEN TOGETHER END STUDS OF WALL PANELS SHEATHED W/ OSB OR PLYWOOD W/ 3" x 0.120 NAILS @ 4" O.C. (THRU ONE SIDE ONLY)

INDICATES EXTENT OF INT. OSB SHEARWALL, AND/OR 3" O.C. EDGE NAILING

NDICATES HOLDOWN

FLOOR FRAMING

- I- IDISTS SHALL BE DESIGNED BY MANUE TO MEET OR EXCEED. L/480 LIVE LOAD DEFLECTION CRITERIA. (EXCLUDES STONE/MARBLE OR WET BED CONSTRUCTED FLOORS - CONTACT M&K FOR EXCLUDED FLOOR DESIGNS)
- PER THE GUIDELINES OF THE TILE COUNCIL OF NORTH AMERICA (TCNA HANDBOOK), IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO VERIFY THAT THE FINISHES TO BE INSTALLED MATCH THE DESIGN CRITERIA NOTED ABOVE (UNDER "DESIGN
- FLOOR SYSTEMS & SHEATHING HAVE BEEN DESIGNED TO SUPPORT ADDITIONAL DEAD LOAD FROM CERAMIC TILE (EXCLUDING MARBLE OR STONE). HOWEVER, IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO PROVIDE PROPER UNDERLAYMENT, UNCOUPLING MEMBRANE AND MORTAR/GROUT PER THE ASSEMBLY DESIGNATIONS IN THE TONA HANDBOOK (TILE COUNCIL OF NORTH AMERICA).
- AT I-JOIST FLOORS, PROVIDE I" MIN. OSB RIM BOARD.
- METAL HANGERS SHALL BE SPECIFIED BY MANUFACTURER, U.N.O. • I-JOIST SHOP DWGS, SHALL BE SUBMITTED TO ARCH, & ENG. FOR
- REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY. FLOOR SHEATHING SHALL BE 23/32" A.P.A. RATED 'STURD-I-FLOOR' 24" O.C, EXPOSURE I (OR APPROVED EQUAL) WITH TONGUE AND GROOVE EDGES. FASTEN TO FRAMING MEMBERS W GLUE AND
- 2 ½" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES \$ @ 12"o.c. FIELD.
- 2 3 × 0.120 NAILS @ 4" O.C. @ PANEL EDGES & @ 8" O.C. FIELD - 2 3 × 0.113 NAILS @ 3 O.C. @ PANEL EDGES & @ 6 O.C. IN FIELD

ROOF FRAMING

- ROOF SHEATHING SHALL BE 7/16" A.P.A. RATED SHEATHING 24/16 EXPOSURE I (OR APPROVED EQUAL). FASTEN TO FRAMING MEMBERS
- w/ 2 1 x 0.131 NAILS @ 6"o.c. @ PANEL EDGES & @ 12" O.C. FIELD. - w/ 2 3" x 0.120" NAILS @ 4"a.c. @ PANEL EDGES & @ 8" O.C. FIELD. - W/2 🐉 x 0.113" NAILS @ 3"o.c. @ PANEL EDGES & @ 6" O.C. FIELD.
- WITHIN 48" OF ALL ROOF EDGES, RIDGES, & HIPS FASTEN ROOF SHEATHING FIELDS PER EDGE NAILING SPEC.
- FASTEN EACH ROOF TRUSS TO TOP PLATE W/ USP RTTA CLIP (OR APPROVED EQUAL) @ ALL BEARING POINTS. PROVIDE (2) RTTA CLIPS AT 2-PLY GIRDER TRUSSES, (3) RTTA CLIPS AT 3-PLY GIRDER TRUSSES & ROOF BEAMS - AT ALL BEARING POINTS
- METAL HANGERS SHALL BE SPECIFIED BY THE MANUFACTURER, U.N.O.
- ROOF TRUSS SHOP DWGS. SHALL BE SUBMITTED TO ARCH & ENG. FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY ERECT AND INSTALL ROOF TRUSSES PER WTCA & TPI'S BCSI I "GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES."
- SUPPORT SHORT SPAN ROOF TRUSSES w/2x4 LEDGER FASTENED TO FRAMING W/(2) 3" x 0.120" NAILS @ 16" O.C. (UP TO 7' SPAN).

MEANS & METHODS NOTES

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FINISHED AND ALL PLAN, DETAIL, AND NOTE SPECIFICATIONS HAVE BEEN COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE THE ERECTION PROCEDURES AND SEQUENCE TO INSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION, THIS INCLUDES, BUT IS NOT LIMITED TO, THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, AND TIE-DOWNS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING AND BRACING REQUIRED TO STABILIZE AND PROTECT EXISTING AND ADJACENT STRUCTURES AND SYSTEMS DURING COURSE OF DEMOLITION AND CONSTRUCTION OF

STRUCTURAL DESIGN AND SPECIFICATIONS ASSUME THAT ALL SUPPORTING AND NON-SUPPORTING ELEMENTS IN CONTACT WITH FLOOR FRAMING ARE LEVEL, INCLUDING, BUT NOT LIMITED TO; FOUNDATIONS SLABS ON GRADE BEAMS WALLS AND NON-BEARING ELEMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIF LEVELNESS AND MAKE ADJUSTMENTS AS NECESSARY, INCLUDING CONSIDERATION OF THOSE AREAS THAT MAY CONTRACTUAL, INDUSTRY, OR WARRANTY TOLERANCES.

GENERAL STRUCTURAL NOTES

- DESIGN IS BASED ON 2018 NCSBC-RESIDENTIAL CODE \$ 2018 IRC WITH SOUTH CAROLINA AMENDMENTS
- WOOD FRAME ENGINEERING IS BASED ON NDS. "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" - LATEST EDITION.

• DESIGN LOADS ROOF

LIVE = 20 PSF DEAD = 7 PSF T.C., 10 PSF B.C LOAD DURATION FACTOR = 1.25

FLOOR LIVE = 40 PSF (30 PSF @ SLEEPING AREAS) DEAD = 10 PSF (I-JOISTS)

> 2,000 PSF ASSUMED ALLOWABLE BEARING PRESSURE (TO BE VERIFIED BY BUILDER)

ADD'L IO PSF @ CERAMIC TILE IN BATHS & LAUND.

GENERAL FRAMING

- CONNECTIONS TABLE (IRC TABLE R6023(I)) OR ON PLANS ALL NAILS SPECIFIED ARE MIN DIAMETER AND LENGTH REQUIRED FOR CONNECTION, ALL HANGER NAILS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS FOR MAX CHARTED CAPACITY. NOTE: HANGERS USE COMMON NAIL DIAMETERS NOT TYPICAL FRAMING GUN NAILS.
- EXT. & INT. BEARING WALLS SHALL BE 2x4 OR 2x6 (AS SHOWN ON PLANS) @ 16" O.C. SPF/SP "STUD" GRADE LUMBER, OR BETTER, U.N.O. WALLS OVER 12' TALL SHALL BE PER PLAN.
- ALL INTERIOR BEARING WALLS ARE ASSUMED TO BE SHEATHED W GYP WALL BOARD (ONE SIDE MIN.) OR PROVIDE MID HT. BLOCKING.
- ALL HEADERS, BEAMS & OTHER STRUCTURAL MEMBERS SHALL BE SPRUCE-PINE-FIR #2 (SPF) OR SOUTHERN PINE #2 (SP) LUMBER, OR BETTER. SUPPORT ALL HEADERS/ BEAMS W/ (1)2x JACK STUD & (1)2x
- THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE NUMBER OF JACK STUDS REQUIRED, U.N.O., ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED
- WITH 2x 'STUD' GRADE MEMBERS SPACED @ 24" O.C. (MAX., U.N.O.) • HEADERS IN NON-LOAD BEARING WALLS SHALL BE: (I)2x4/6 FLAT @ OPENINGS UP TO 4', (2)2x4/6 FLAT UP TO 8'.
- ALL FRAMING LUMBER SHALL BE DRIED TO 15% MC (KD-15). • ENGINEERED LUMBER BEAMS TO MEET OR EXCEED THE FOLLOWING:
- 'LVL' Fb=2600 psi; Fv=285 psi; E=2.0xl0^6 psi • ENGINEERED LUMBER POSTS TO MEET OR EXCEED THE FOLLOWING:
- 'LVL' Fb=2400 psi; FcII=2500 psi; E=I.8xI0^6 psi FOR 2 & 3 PLY BEAMS OF FOUAL 13/4" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 3"XO.120" NAILS @ 8" O/C OR 2 ROWS IMP WS35 SCREWS (OR 3K" TRUSSLOK SCREWS) @ 16" O/C, USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER.

 APPLY FASTENING AT BOTH FACES FOR 3-PLY CONDITION. LOCATE TOP & BOTTOM NAILS/SCREWS 2" FROM EDGE. SOLID 3 ½" OR 5 ¼"

BEAMS ARE ACCEPTABLE, USE 2 ROWS OF NAILS FOR 2x6 & 2x8

- FOR 4 PLY BEAMS OF FOUAL 13/11 MAX WIDTH FASTEN PLIES TOGETHER WITH 3 ROWS OF USP MG6 SCREWS (OR 6 3/4 TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER. APPLY FASTENING AT BOTH FACES (ONE SIDE ONLY FOR TRUSSLOK SCREWS). LOCATE TOP AND BOTTOM SCREWS 2" FROM EDGE, A SOLID 7" BEAM IS ACCEPTABLE.
- PROVIDE SOLID BLOCKING IN FLOOR SYSTEM UNDER ALL POSTS CONTINUOUS TO FND./BEARING. BLOCKING TO MATCH POST ABOVE.
- ◆ ALL EXTERIOR 4x4 WOOD POSTS SHALL HAVE USP BCS22-4 CAP & PA44E BASE, U.N.O.
- CORROSION NOTES
 - BUILDER RESPONSIBLE TO DETERMINE CORROSION-RESISTANCE REQUIREMENTS AND COMPATIBILITY OF HARDWARE FASTENERS AND CONNECTORS FOR ENVIRONMENTAL EXPOSURE AND IN CONTACT W PRESERVATIVE-TREATED WOOD OF ACTUAL FINAL CONDITIONS AND SOURCED MATERIALS. CONTACT LUMBER & HARDWARE SUPPLIERS TO GOORD.
- ALL FASTENERS AND CONNECTORS EXPOSED TO SALT WATER (WITHIN 300' OF SALT WATER SHORELINE, INCLUDING VENTED SPACES) SHALL BE STAINLESS STEEL.

Harrington

_ot 14

MULHERN+KUL
RESIDENTIAL STRUCTURAL ENGINEERI C-3825



lulhern+Kulp project numbe 256-21006

SMK M.JF ssue date: 10-21-202

REVISIONS


initial: JPP


SMITH DOUGL HOMES


STRUCTURAL NOTES 豆 MODI


I WIND ZONE CAROLINA EMAN 120 MPH NORTH C

GENERAL

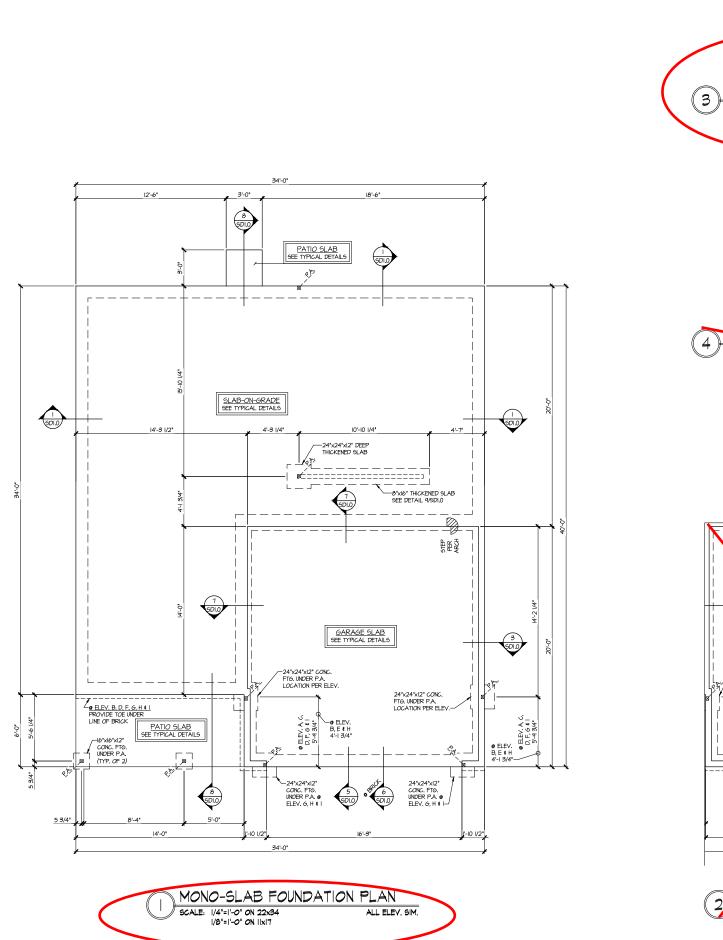

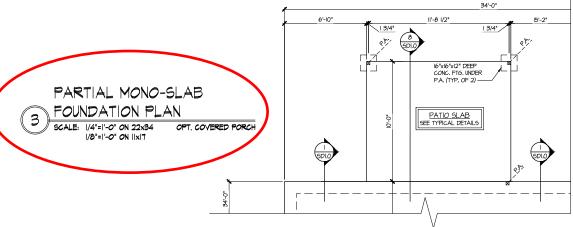

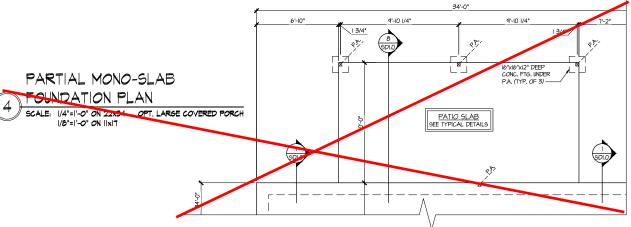

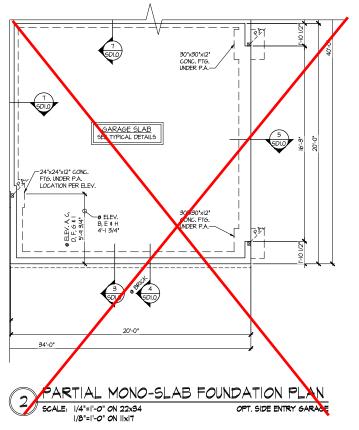

Harrington Lot 14

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

R.T. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF, MANUF. (TYP. U.N.O.)

OF. INDICATES TRUSS OVERFRAMING © 24" O.C. (TYP. U.N.O.)

F.J. NDICATES I4" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

D.J. INDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• INTERIOR BEARING WALL

• ==== BEARING WALL ABOVE (B.W.A.)

• --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINERANS 1905 Bredside Perkvey, Suite 1905 - Algen 1978-77-4974 - stanformingscent NC License # C-3825

Aulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:


initial: JPP

SMITH DOUGLAS HOMES

COLEMAN MODEI Foundation

120 MPH WIND ZONE NORTH CAROLINA

MONO-SLAB

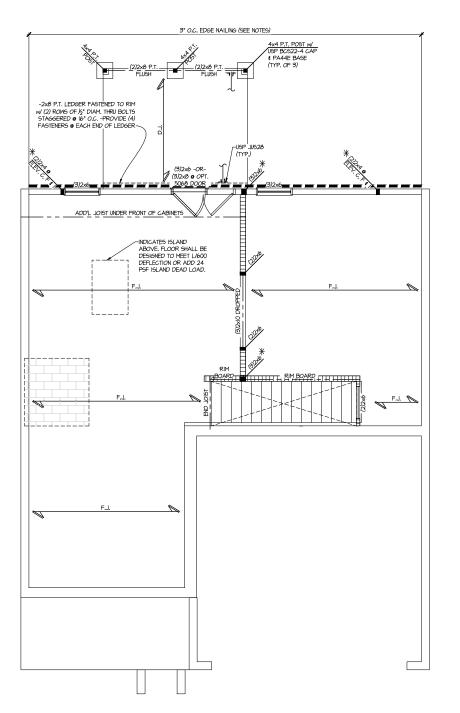

IST FLOOR FRAMING PLAN

ALL ELEV. SIM.


SCALE: 1/4"=1'-0" ON 22x34

1/8"=1'-0" ON 11x17

PARTIAL IST FLOOR FRAMING PLAN

SCALE: 1/4"=1"-0" ON 122/34

1/8"=1"-0" ON 11x17 OPT. EXT. DECK OPT. LARGE COVERED DECK SI

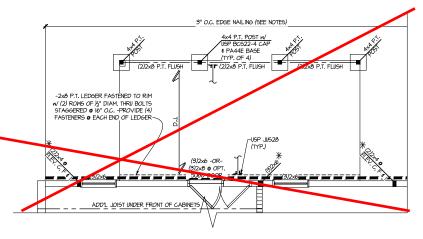

Harrington Lot 14

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF.
MANUF. (TYP. UN.O.)

OF INDICATES TRUSS OVERFRAMING @
24" O.C. (TYP. UN.O.)

F-J NDICATES 14" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR

SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• INTERIOR BEARING WALL

• □===□ BEARING WALL ABOVE (B.W.A.) • --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENGINEERING

RESIDENTIAL STRUCTURAL ENGINEERING

PAGIT WILL STRUCTURAL ENGINEERING

Y

Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: 12/10/21 MIRRORED PLANS ADDED JPP


SMITH DOUGLAS HOMES

FLOOR FRAMING PLAN COLEMAN MODEL

120 MPH WIND ZONE NORTH CAROLINA

 $\mathop{\rm SI}_{\rm T}$

S2.0

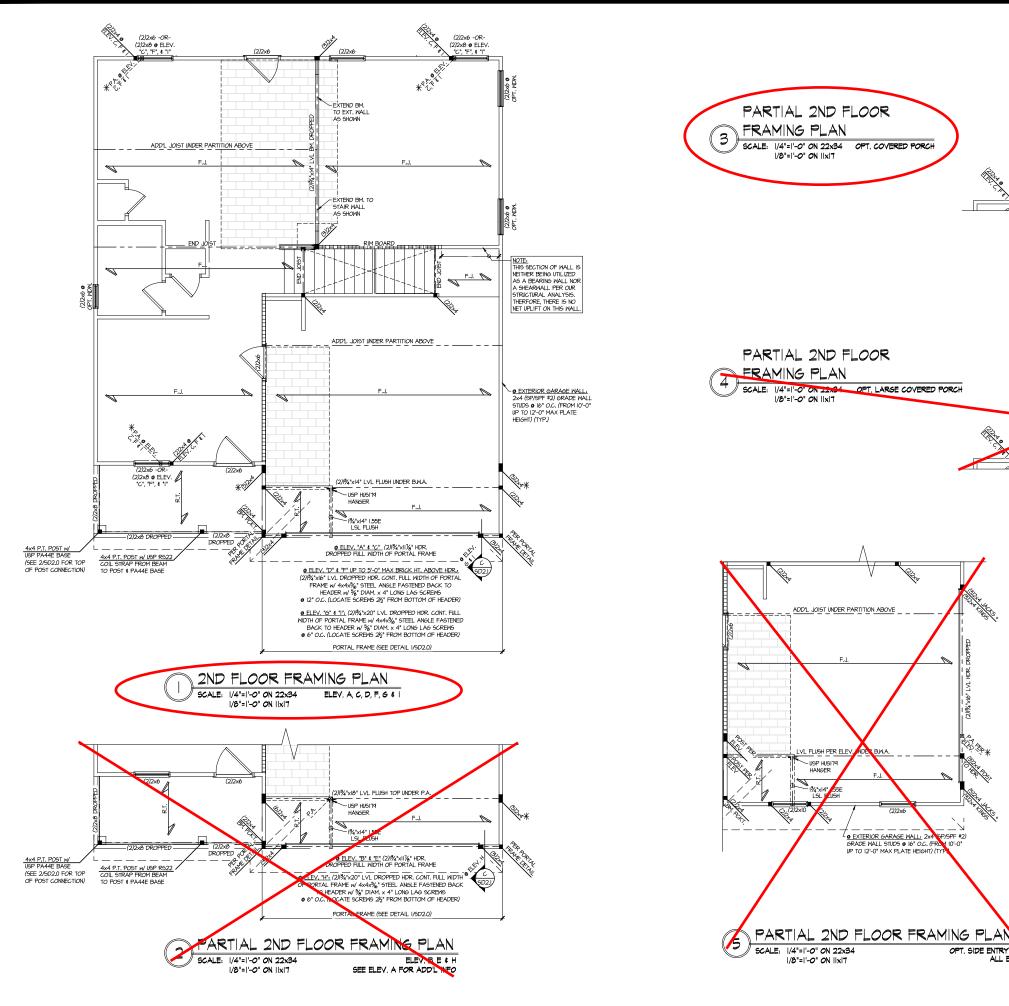


4x4 P.T. POST w/ USP PA44E BASE @ SLAB -OR-BC522-4 BASE @ DECK (TYP, OF 2) (SEE 2/SD2.0 FOR TOP OF POST CONNECTION) PARTIAL 2ND FLOOR FRAMING PLAN SCALE: I/4"=1'-0" ON 22x34 OPT. COVERED PORCH 1/8"=1'-0" ON 11x17 (2)2x6 -OR-(2)2x8 • ELEV. "C", "F", \$ "I"

PARTIAL 2ND FLOOR FRAMING PLAN SCALE: 1/4"=1'-0" ON 22x34 OPT. LARGE COVERED PORCH 1/8"=1'-0" ON 11x17

DEXTERIOR GARAGE WALL: 2x4 (6P/SPF #2)
GRADE WALL STUDS D 16" O.C. (FROM 10'-0'
UP TO 12'-0" MAX PLATE HEIGHT) (TYP)

OPT. SIDE ENTRY GANAGE ALL ELEV. SIM.

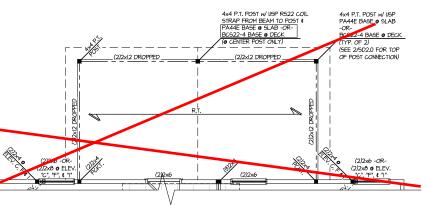

Harrington Lot 14

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

OF. INDICATES TRUSS OVERFRAMING @ 24" O.C. (TYP. U.N.O.)

F.J. NDICATES I4" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

D.J. INDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• INTERIOR BEARING WALL

• □=== BEARING WALL ABOVE (B.W.A.)

• ---- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID

BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINEERINS 1905 Bredside Perkvey, Suite 195 - Algha 1976-77-4874 - mediamisapasan NC License # C-3825



Aulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

initial: JPP


SMITH DOUGLAS HOMES

PLAN MODEL FRAMING COLEMAN FLOOR

2ND

120 MPH WIND ZONE NORTH CAROLINA

S3.0

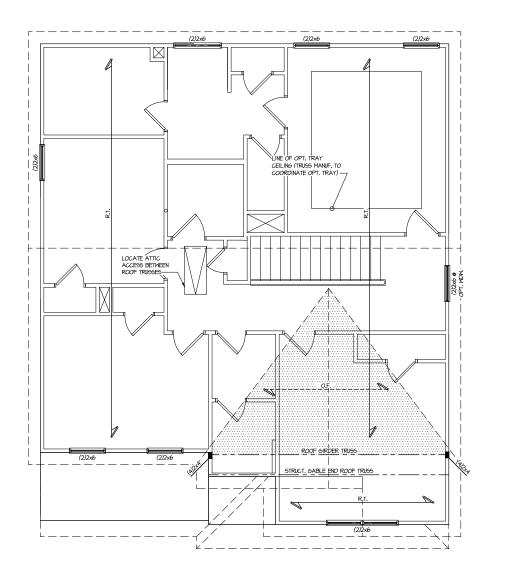



8/1/23

MULHERNHAL ENGINERING
RESIDENTIAL STRUCTURAL ENGINERING
RESIDENTIAL STRUCTURAL ENGINERING
RESIDENTIAL STRUCTURAL ENGINEERING
RESIDENTIAL ENGINEERING



Mulhern+Kulp project number:

256-21006

SMK MJF issue date: 10-21-202

initial: JPP

SMITH DOUGLAS HOMES

COLEMAN MODEL ROOF FRAMING PLAN

120 MPH WIND ZONE NORTH CAROLINA

Harrington

Lot 14

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

REFER TO SO.0 FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

• INTERIOR BEARING WALL

• □===□ BEARING WALL ABOVE (B.W.A.)

• --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

LEGEND

RT. INDICATES ROOF TRUSSES © 24" O.C. PER ROOF.
MANUF. (TYP. UN.O.)

OF INDICATES TRUSS OVERFRAMING ©
24" O.C. (TYP. UN.O.)


F.J. NDICATES 14" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER


D.J. INDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.


JOIST MANUFACTURER SHALL DESIGN FLOOR

SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

S4.0

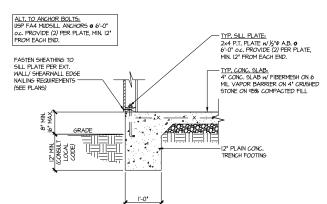

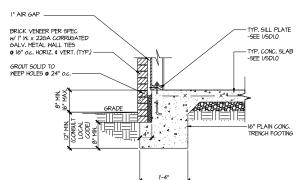

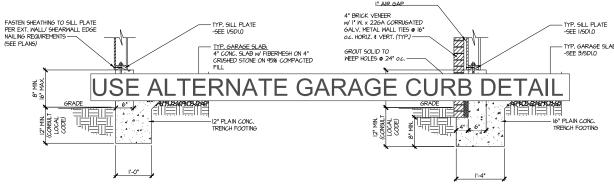


OPT. BRICK (SEE ARCH FOR LOCATIONS)







TYPICAL SLAB ON GRADE GARAGE 4 PERIMETER FOOTING w/ BRICK VENEER




TYPICAL SLAB ON GRADE

PERIMETER FOOTING



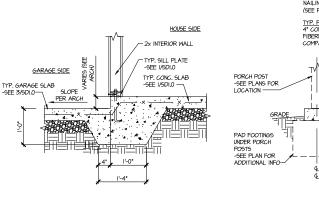

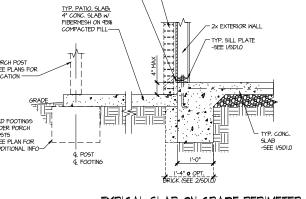


TYPICAL SLAB ON GRADE GARAGE (5) ENTRY @ PERIMETER FOOTING









TYPICAL THICKENED SLAB @ (9) INTERIOR BEARING WALL

> Harrington Lot 14

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS 1955 Bredside Perkvay, Suite 1955 • Alpha 1978-77-4974 • mathemicapaem NC License # C-3825

Aulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

REVISIONS: initial: JPP

SMITH DOUGLAS HOMES

MODEL FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

SD1.0







3625 Brookside Parkway, Suite 165, Alpharetta, GA 30022 ► p 770-777-0074 ► *mulhernkulp.com*

August 18, 2023

Jody Hunt

Director of Product Development

SMITH DOUGLAS HOMES


110 Village Trail, Suite 215 Woodstock, GA 30188


ALTERNATE GARAGE CURB DETAIL

Smith Douglas Homes

Current Structural Plans prepared by Mulhern & Kulp

Smith Douglas Homes shown below. The foundation details shown below call for a 4" wide curb with a maximum of 8" stem wall height; these are an acceptable alternative to the 6" wide curb at the garage per M&K foundation details 3 & 4 on sheet SD-1.0 at 2x4 garage Pursuant to your request, we have prepared this letter to address the "Alternate Garage Curb Details", prepared by Mulhern & Kulp for wall locations.

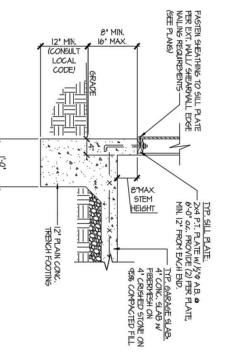

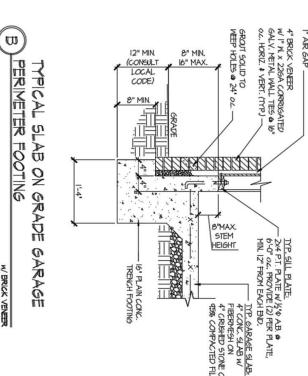


PERIMETER FOOTING TYPICAL SLAB ON GRADE GARAGE

Please feel free to call if you have any questions


MULHERN & KULP STRUCTURAL ENGINEERING, INC.

NC License # C-3825

Shaun M. Kreidel, P.E. Project Manager + Atlanta Office Directo

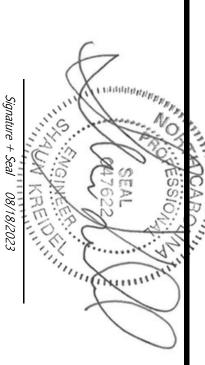

P:|Client Files|256 - Smith Douglas Homes|2023|23000 - 2023 Client Admin|2023-08-17 - 4in Garage Curb Letter|Alternate Garage Curb Detail - Letter - NC.docx

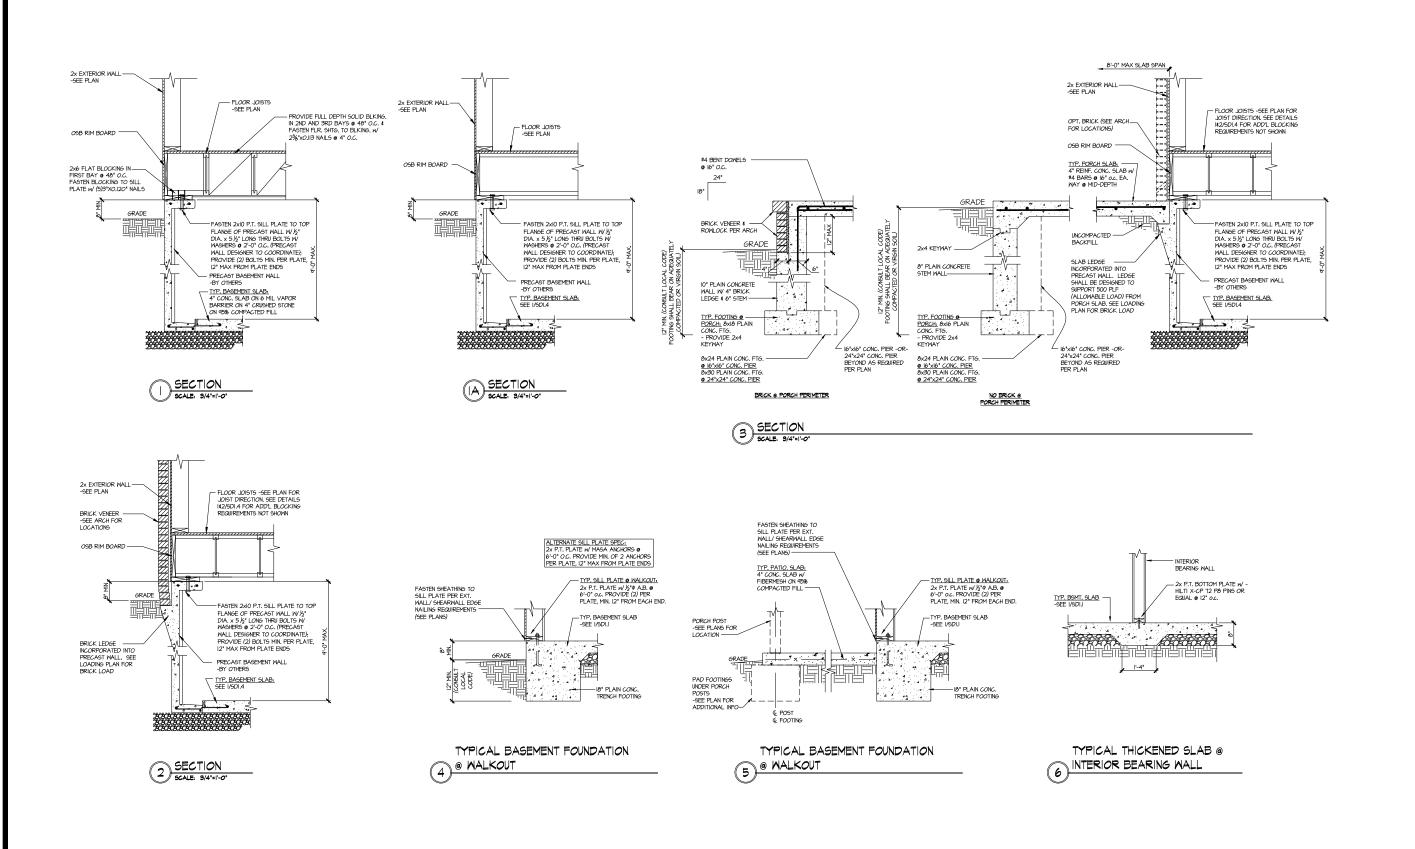

8/1/23

MULHERN+KULP
RESIDENTIAL STREETURAL ENGINEERINS 1905 Bredicite Perkvey, Suite 1905 • Alpha 1978-77-4974 • mediamicajarent NC License # C-3825

Aulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES


MODEL FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

Harrington

Lot 14

SD1

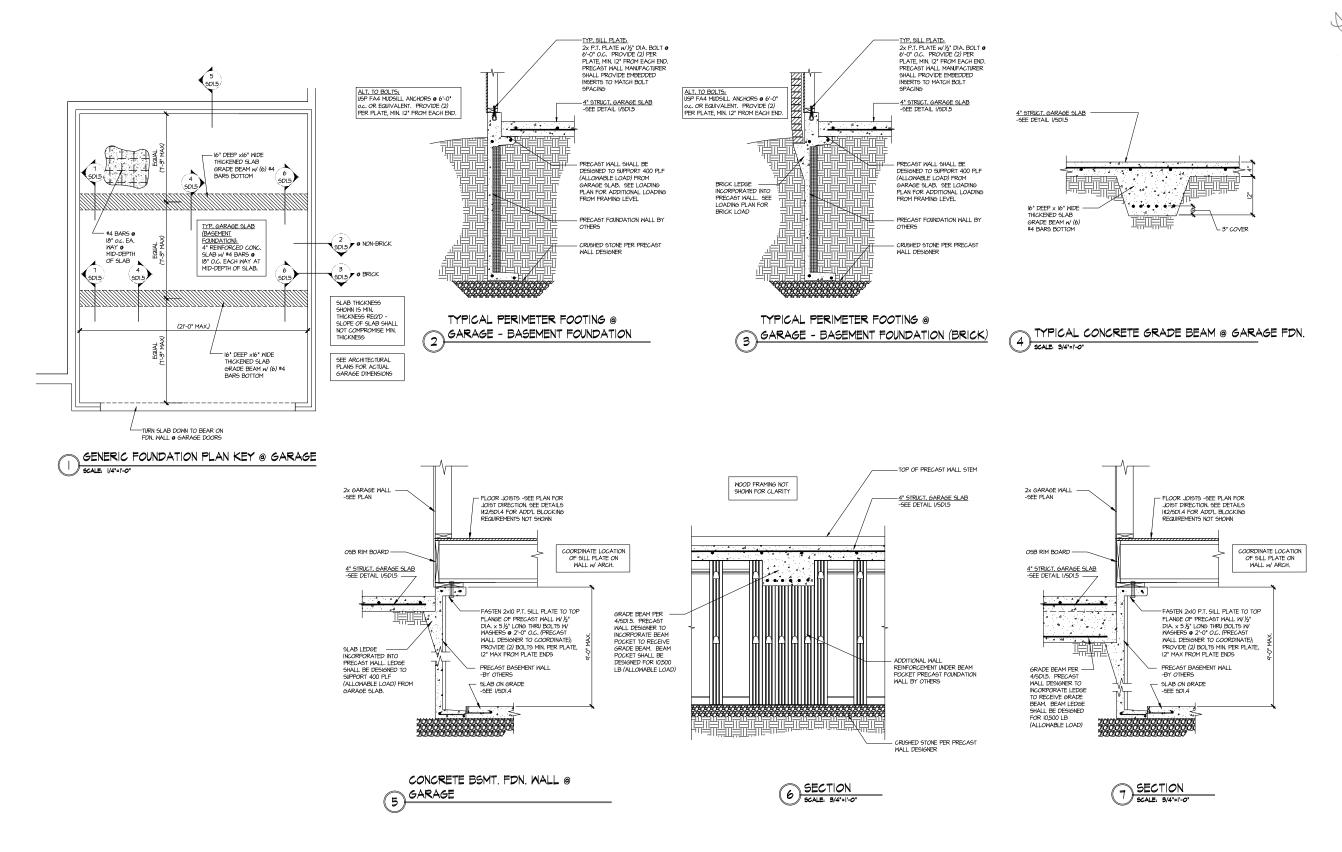

Harrington Lot 14

8/1/23

MULHERN+KULP
RESIDENTIAL STREETURAL ENGINEERINS

1905 Bredicide Perkvey, Suite 1905 • Alpha 1978-77-4974 • mediamicajarent NC License # C-3825

Aulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:


initial: JPP

SMITH DOUGLAS HOMES


MODEL FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

SD1

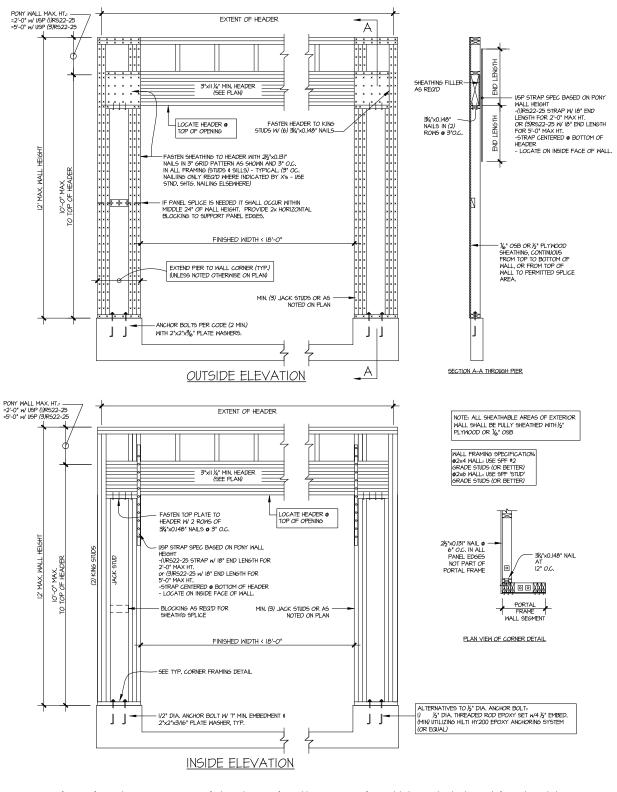

GARAGE PORTAL FRAME BRACING ELEVATION BOTH SIDES OF GARAGE DOOR 120 MPH WIND SPEED (ULT) SCALE: N.T.S.

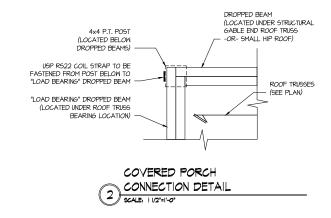

8/1/23

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINEERING 1905 Beautide Patwey, Sale 1805 - Alphen \$776-77-4874 - transcriptorer NC License # C-3825

Mulhern+Kulp project number

256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES


MODEL


FRAMING DETAILS COLEMAN

120 MPH WIND ZONE NORTH CAROLINA

Harrington Lot 14

SD2.0

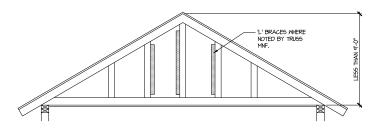

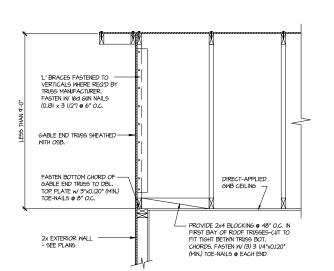

TYPICAL GABLE END BRACING DETAIL SCALE: NONE REQUE & GABLE END TRUSS BRACE GABLE END TRUSSES PER ABOVE DETAIL WHEN GABLE HEIGHT IS LESS THAN 9-0'. L' BRACES REQUIRED WHERE NOTED BY TRUSS MANUFACTURER.

STRONG-BACK @ MID-HEIGHT FOR DIAG. BRACES - 2x4 VERT. - FASTEN W (4) 3"x0.120" (MIN.) TO EACH GABLE TRUSS VERTICAL 2x4 BLOCKING W (4) 3"x0.120" (MIN.) TOE-NAILS EACH END @ EACH DIAGONAL BRACE 2x4 HORIZ. - FASTEN
W 3 1/4"x0.120" (MIN.) 6
8" O.C. TO 2x6
VERTICAL -2 3/8"x0.II3" NAIL5 @

> TYPICAL GABLE END BRACING DETAIL SCALE, NONE REQUE 6 64BLE END TRUSS REQ'D & GABLE END TRUSS HEIGHT BETW'N 9'-0" TO 14'-0"


-(4) 3"x0.120 (MIN.) TOENAILS

(MIN. 4'-6")

GABLE END TRUSS SHEATHED WITH OSB.

FASTEN BOTTOM CHORD OF — GABLE END TRUSS TO DBL. TOP PLATE w/ 3"x0.120" (MIN.) TOE-NAILS & 8" O.C.

2x EXTERIOR WALL -SEE PLANS FOR SPECIFICATIONS

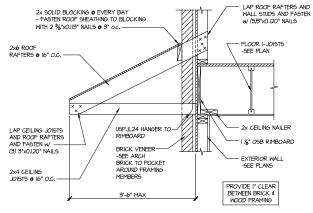

DETAIL @ PENT ROOF

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS.

NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

> Harrington Lot 14

8/1/23

MULHERN + KULP

RESIDENTIAL STRUCTURAL ENSINEERING

SES BRICKLES - CANADAM SA SES

\$776-777-674 - Inchinate prose

NC License # C-3825

Mulhern+Kulp project number 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP


SMITH DOUGLAS HOMES

COLEMAN MODEL FRAMING DETAILS

120 MPH WIND ZONE NORTH CAROLINA

SD2.

72406684 14 HARRINGTON PLACE

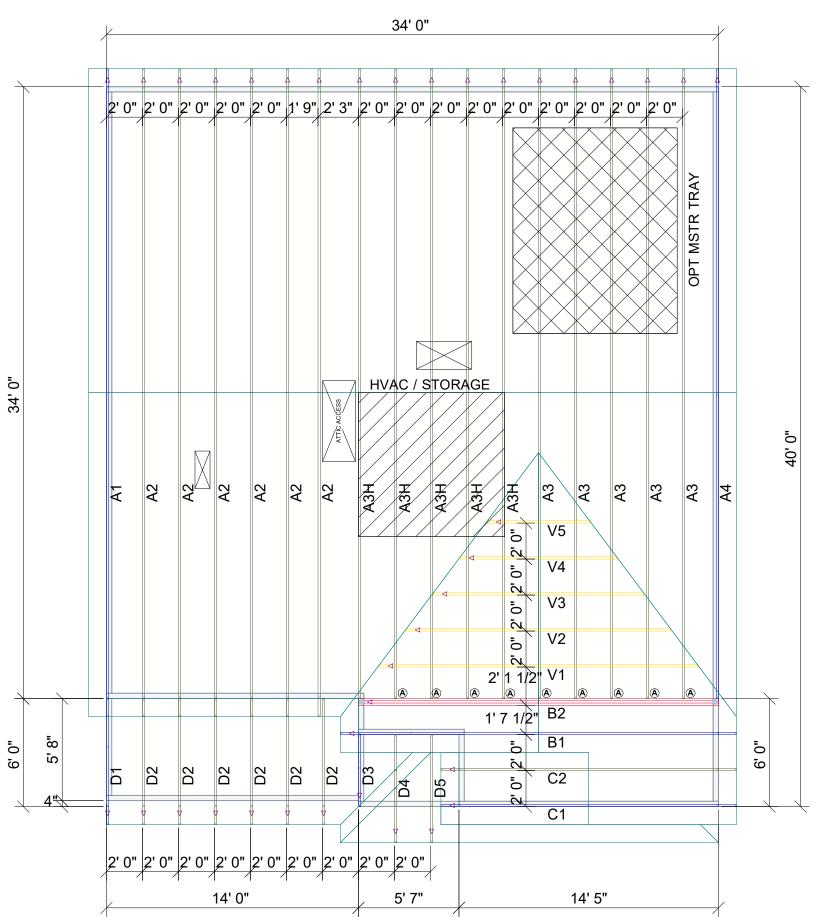


Roof Hanger List					
MARK	TYPE	DESCRIPTION	QTY		
A	HUS26	FACE MOUNT HANGER	9		

COLEMAN ADG NO TRAY

PLACEMENT PLAN

SCALE: N.T.S

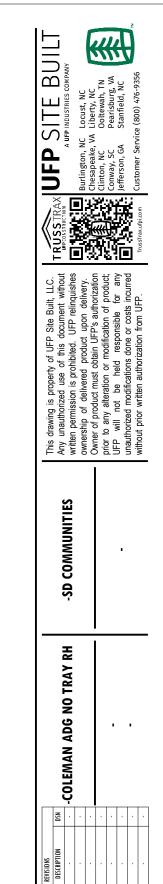

DESIGNER -THATHCOCK
LAYOUT DATE -03.24.2022
ARCH DATE STRUC DATE -

JOB #: -22032047

COLEMAN 10x12 PORCH


TLANTIC, LLC VALLEY LINES: 0 ROOF AREA: 162.33 ft²_RIDGE LINE: 11 ft

 Δ Indicates Left End of Truss

COLEMAN 10 X 12 PORCH SD COMMUNITIES

A1 1 1/8" RIMBOARD BAND

1 1/8" RIMBOARD BAND

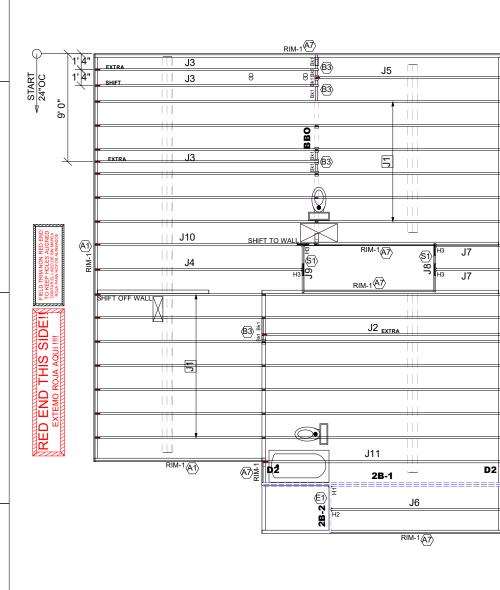

	Products				
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	34' 0"	14" TJI® 110	1	13	MFD
J2	20' 0"	14" TJI® 110	1	1	MFD
J3	19' 0"	14" TJI® 110	1	3	MFD
J4	18' 0"	14" TJI® 110	1	1	MFD
J5	16' 0"	14" TJI® 110	1	1	MFD
J6	15' 0"	14" TJI® 110	1	1	MFD
J7	6' 0"	14" TJI® 110	1	2	MFD
J8	5' 0"	14" TJI® 110	1	1	MFD
J9	4' 0"	14" TJI® 110	1	1	MFD
J10	19' 0"	14" TJI® 210	1	1	MFD
J11	20' 0"	14" TJI® 360	1	1	MFD
2B-1	20' 0"	1 3/4" x 14" 2.0E Microllam® LVL	2	2	MFD
2B-2	4' 0"	1 3/4" x 14" 2.0E Microllam® LVL	1	1	MFD
RIM-1	16' 0"	1 1/8" x 14" TJ® Rim Board	1	10	FF
Bk1	2' 0"	14" TJI® 110	1	8	MFD

Connector Summary					
PlotID Qty Manuf Product					
H1	1	MiTek	HUS179		
H2	1	USP	IHFL1714		
H3	4	USP	TFL1714		

GENERAL NOTES:

1.) TOP CHORD OF JOISTS ARE PAINTED RED

AT NUMBERED END. PLACE PAINTED END AS NOTED ON PLAN.
2.) FOLLOW SPECIAL SPACING AND LOCATION DIMENSIONS FOR EXTRAS OR SHIFTED JOISTS AS SHOWN ON PLAN.
3.) ALL INTERIOR WALL PLATES MUST BE LEVEL.

WITH OUTSIDE WALL TOP PLATES.
4.) DO NOT STACK CONSTRUCTION LOADS ON

UN-BRACED JOISTS. 5.) PROVIDE SOLID SUPPORT BELOW ALL BEAM AND HEADER BEARING POINTS IN WALL AND

AND HEADER BEARING POINTS IN WALL AND JOIST SPACES CONTINUOUS DOWN TO THE FOUNDATION.

6.) LOCATE CRIPPLE STUDS IN JOIST SPACE DIRECTLY BELOW HEADER JACKS AT ALL FIRST FLOOR EXTERIOR DOOR LOCATIONS.

7.) INSTALL NAILS IN ALL HOLES PROVIDED IN JOIST HANGERS EXCEPT AT BOTTOM CHORD STALL FACE A DAY OF CHILEN THE MANCEP.

SEAT. PLACE A DAB OF GLUE IN THE HANGER SEAT BEFORE SETTING JOISTS. 8.) IMPORTANT NOTE! NO STRUCTURAL ANALYSIS OF CONVENTIONAL HEADERS HAS BEEN CONDUCTED IF NOT NOTED. THEY ARE CONSIDERED TO BE ADEQUATE TO SUPPORT

THE APPLIED LOADS. FRAMER NOTE

ALL DIMENSIONS TO CENTERLINE UNLESS OTHERWISE NOTED

DENOTES DUCT HOLE RUNS

Avoid Plumbing Drops

FRAMER NOTE GLUE AND NAIL PLYWOOD

SUBFLOOR TO BEAMS AND GIRDERS AT 6" O/C WHERE NO WALL IS ABOVE. 2. FILL HANGER SEAT WITH GLUE BEFORE SETTING JOIST IN HANGER. FILL ROUND HOLES WITH

PLAN LEGEND

1B-, 2B-

*INDICATES BEAM ABOVE TOP PLATE (FLUSH WITH FLOOR SYSTEM)

H-, 1H-, GDHINDICATES BEAM BELOW TOP PLATE (DROPPED BELOW FLOOR SYSTEM)

PLUMBING, ALIGN W/WALL OR SUPPORT FURNITURE

FIELD TRIM NON RED END TO KEEP HOLES ALIGNED CONTAR EL LADO DE SIN MARCA **ROJA PARA HOYOS ALINEADOS**

FIELD LOCATE PLUMBING DROPS/CAN **LIGHTS, ETC... PRIOR TO JOIST SECUREMENT TO**

AVOID INTERFERENCE CRITICAL !!

INSTALL 2X4 SQUASH BLOCKS IN FLOOR TRUSS SPACE BELOW ALL EXTERIOR DOOR HEADER JACKS. CUT 1/16" TALLER THAN TRUSS.

FIELD VERIFY DIMENSIONS TO **JOISTS LOCATED UNDER WALLS!!**

2ND FLOOR LAYOUT

2ND FLOOR PLACEMENT PLAN



UFP

Douglas Homes Smith

2nd Coleman

DESIGNER PB2 LAYOUT DATE 3/1/2024 ARCH DATE 12/2/2021 **STRUC DATE** 8/30/2023

JOB #: 2030067F2

SCALE: 1/8"=1'