

RE: J0524-3015
 Lot 10 Jones Creek

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: J0524-3015
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):


Design Code: IRC2018/TPI2014 Design Program: MiTek 20/20 8.4
 Wind Code: ASCE 7-16 Wind Speed: 130 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 18 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I65721079	A1-GE	5/21/2024
2	I65721080	A2	5/21/2024
3	I65721081	A3	5/21/2024
4	I65721082	A4	5/21/2024
5	I65721083	A6	5/21/2024
6	I65721084	A7-GE	5/21/2024
7	I65721085	B1-GE	5/21/2024
8	I65721086	B2	5/21/2024
9	I65721087	D1-GE	5/21/2024
10	I65721088	D2	5/21/2024
11	I65721089	D3	5/21/2024
12	I65721090	E1-GE	5/21/2024
13	I65721091	E2	5/21/2024
14	I65721092	E3	5/21/2024
15	I65721093	E4	5/21/2024
16	I65721094	VD-1	5/21/2024
17	I65721095	VD-2	5/21/2024
18	I65721096	VD-3	5/21/2024

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.
 Truss Design Engineer's Name: Gilbert, Eric
 My license renewal date for the state of North Carolina is December 31, 2024.
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

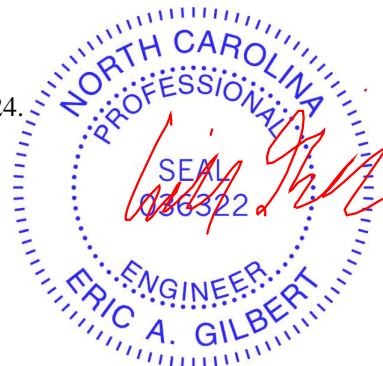


Job J0524-3015	Truss A1-GE	Truss Type GABLE	Qty 1	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721079
-------------------	----------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:31 2024 Page 1

ID:2GNsYO62BI49KgBFP3SmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwrcDoi7J4zJC?f



Scale = 1:92.6


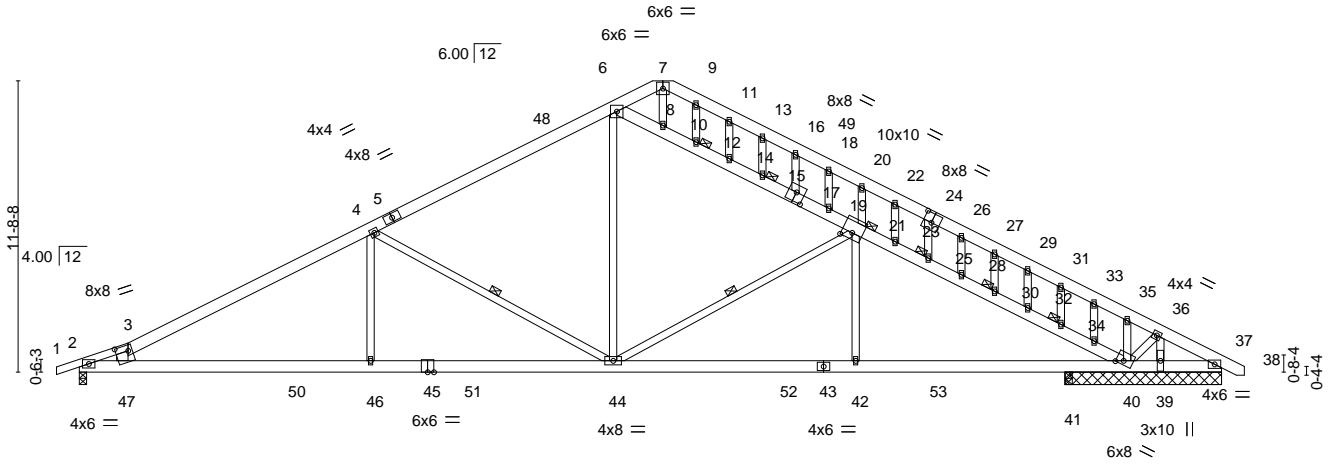


Plate Offsets (X, Y)-- [3:0-6-0,0-2-12], [15:0-4-0,0-4-8], [19:0-5-0,0-3-0], [24:0-4-0,0-4-8], [40:0-3-9,0-1-15]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.92	Vert(LL)	-0.31	46-47	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.68	Vert(CT)	-0.56	46-47	>849		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.77	Horz(CT)	0.11	39	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.25	46-47	>999	Weight: 386 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x6 SP No.1 *Except* 2-45: 2x6 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 3-47: 2x6 SP No.1	WEBS 1 Row at midpt 4-44, 19-44
OTHERS 2x4 SP No.2	JOINTS 1 Brace at Jt(s): 19, 10, 14, 23, 28, 32

REACTIONS. All bearings 0-3-8 except (jt=length) 37=6-3-8, 39=6-3-8.
 (lb) - Max Horz 2=-235(LC 17)
 Max Uplift All uplift 100 lb or less at joint(s) 41 except 2=-384(LC 12), 37=-198(LC 2), 39=-681(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) except 2=2001(LC 2), 37=302(LC 13), 39=1874(LC 2), 41=664(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-3368/335, 3-4=-3642/627, 4-6=-2390/450, 6-7=-499/263, 7-9=-470/230,
 9-11=-465/198, 11-13=-480/175, 13-16=-505/160, 16-18=-495/124, 18-20=-559/142,
 20-22=-481/19, 22-24=-545/73, 24-26=-540/0, 26-27=-570/32, 27-29=-580/0,
 29-31=-599/0, 31-33=-615/0, 33-35=-588/0, 35-36=-520/0, 36-37=-599/507,
 6-8=-1844/519, 8-10=-1706/486, 10-12=-1747/503, 12-14=-1765/510, 14-15=-1762/510,
 15-17=-1809/530, 17-19=-1767/505, 19-21=-2543/549, 21-23=-2508/510,
 23-25=-2539/545, 25-28=-2539/523, 28-30=-2558/538, 30-32=-2572/543,
 32-34=-2586/549, 34-40=-2658/571
 BOT CHORD 2-47=-530/3075, 46-47=-637/3217, 44-46=-637/3217, 42-44=-284/2745, 41-42=-284/2745,
 40-41=-284/2745, 39-40=-442/550, 37-39=-442/550
 WEBS 3-47=-548/357, 4-46=0/753, 4-44=-1352/468, 6-44=-142/1425, 19-42=0/549,
 19-44=-882/341, 7-8=-159/309, 35-40=-342/236, 36-39=-1359/548, 36-40=-473/1287,
 19-20=-410/381

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; Gable Roof; Common Truss; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 1-11-8, Interior(1) 1-11-8 to 23-5-8, Exterior(2R) 23-5-8 to 27-10-5, Interior(1) 27-10-5 to 46-8-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 1-4-0 oc.
- Continued on page 2
 This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

TRENCO
 ENGINEERING BY
 A MITEK AFFILIATE
 818 Soundside Road
 Edenton, NC 27932

Job J0524-3015	Truss A1-GE	Truss Type GABLE	Qty 1	Ply 1	Lot 10 Jones Creek Job Reference (optional)	I65721079
-------------------	----------------	---------------------	----------	----------	--	-----------

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:31 2024 Page 2
ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

NOTES-

- 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 41 except (jt=lb) 2=384, 37=198, 39=681.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0524-3015	Truss A2	Truss Type Common	Qty 6	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721080
-------------------	-------------	----------------------	----------	----------	--	-----------


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:31 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:80.4

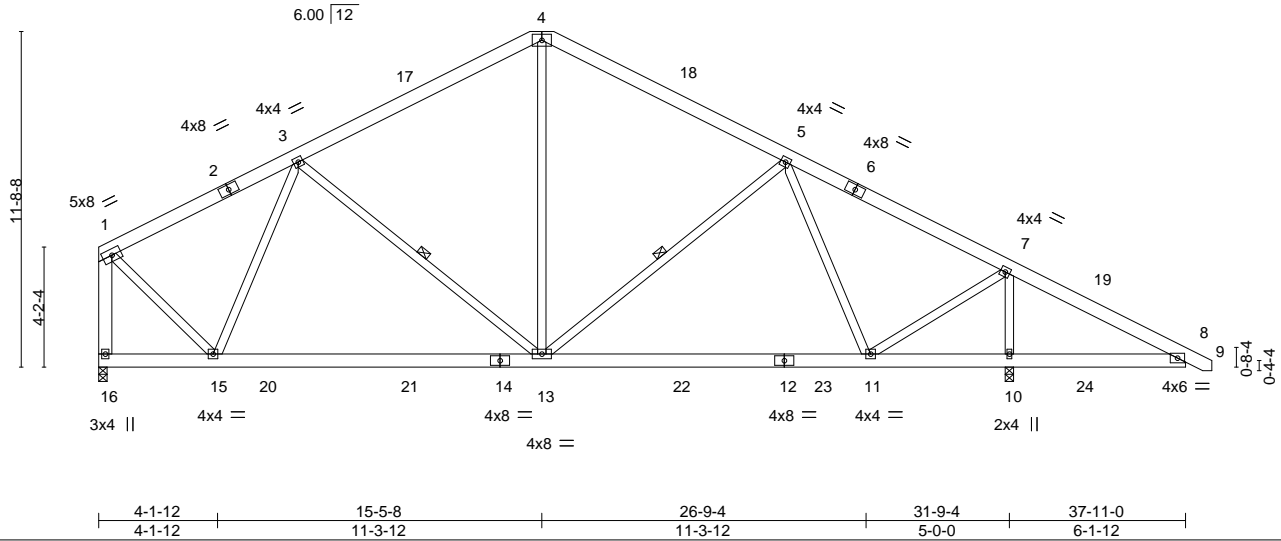


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL) -0.17	11-13	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.57	Vert(CT) -0.26	11-13	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.62	Horz(CT) 0.02	10	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL) 0.02	11-13	>999		
							Weight: 288 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-16: 2x6 SP No.1	WEBS 1 Row at midpt 3-13, 5-13

REACTIONS. (size) 16=0-3-8, 10=0-3-8
 Max Horz 16=-220(LC 13)
 Max Uplift 16=-69(LC 12), 10=-132(LC 13)
 Max Grav 16=1435(LC 2), 10=2103(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-1073/177, 3-4=-1247/307, 4-5=-1247/281, 5-7=-1089/78, 7-8=-610/604,
 1-16=-1479/217
 BOT CHORD 13-15=-54/1166, 11-13=0/1067, 10-11=-454/596, 8-10=-454/596
 WEBS 3-15=-551/195, 4-13=-1/655, 5-11=-612/391, 7-11=-362/1590, 1-15=-86/1262,
 7-10=-1942/650

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 15-5-8, Exterior(2R) 15-5-8 to 19-10-5, Interior(1) 19-10-5 to 38-8-2 zone; cantilever right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16 except (jt=lb) 10=132.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

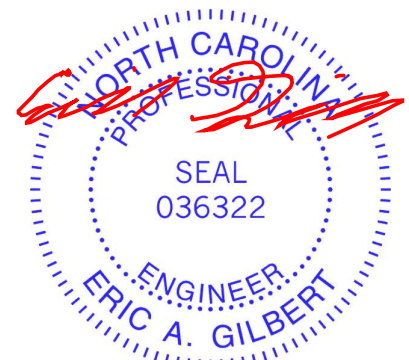

May 21, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job J0524-3015	Truss A3	Truss Type Common	Qty 3	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721081
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:32 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f



Scale = 1:80.4


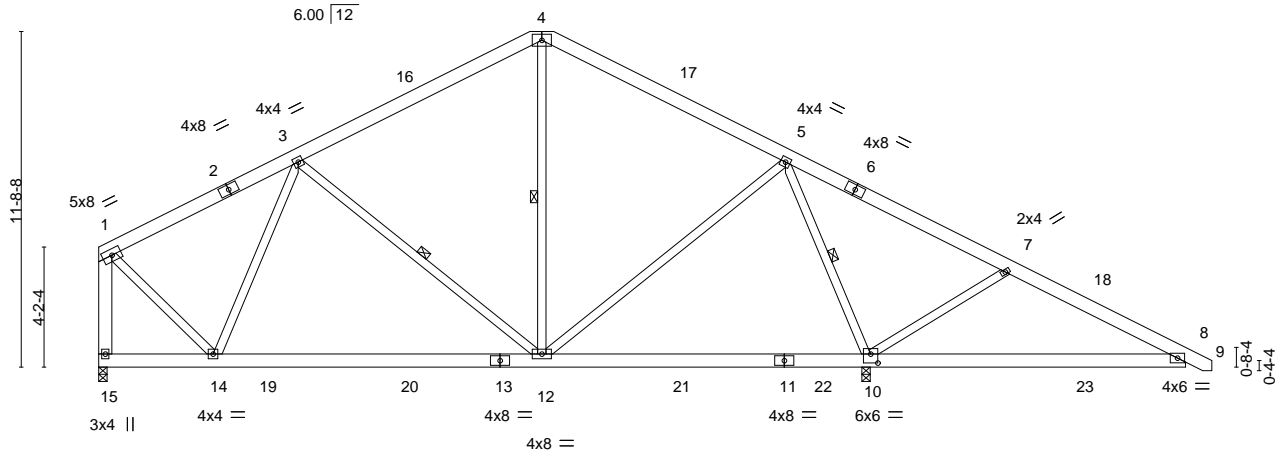


Plate Offsets (X, Y)--	[10:0-3-0,0-3-12]
------------------------	-------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.40	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.52	Vert(LL) -0.15 12-14 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.93	Vert(CT) -0.24 12-14 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 10 n/a n/a		
	Code IRC2018/TPI2014		Wind(LL) -0.11 10-12 >999 240	Weight: 284 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except:
WEBS 2x4 SP No.2 *Except* 1-15: 2x6 SP No.1	WEBS 1 Row at midpt 3-12, 4-12, 5-10

REACTIONS.
(size) 15=0-3-8, 10=0-3-8
Max Horz 15=-220(LC 13)
Max Uplift 15=-72(LC 12), 10=-157(LC 13)
Max Grav 15=1053(LC 27), 10=2490(LC 2)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-792/70, 3-4=-695/140, 4-5=-678/163, 5-7=-1016/1127, 7-8=-859/701, 1-15=-1105/64
BOT CHORD 12-14=-56/827, 10-12=-298/745, 8-10=-533/793
WEBS 3-14=-308/119, 3-12=-316/302, 4-12=-117/295, 5-12=-433/917, 5-10=-1860/978, 7-10=-496/380, 1-14=0/917

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-2-12 to 4-7-9, Interior(1) 4-7-9 to 15-5-8, Exterior(2R) 15-5-8 to 19-10-5, Interior(1) 19-10-5 to 38-8-2 zone; cantilever right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15 except (jt=lb) 10=157.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

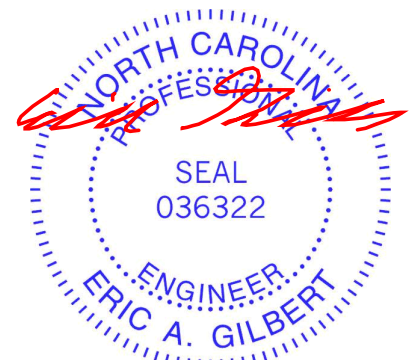

May 21, 2024


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TP1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0524-3015	Truss A4	Truss Type COMMON	Qty 1	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721082
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:32 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



5x5 =

Scale = 1:69.0

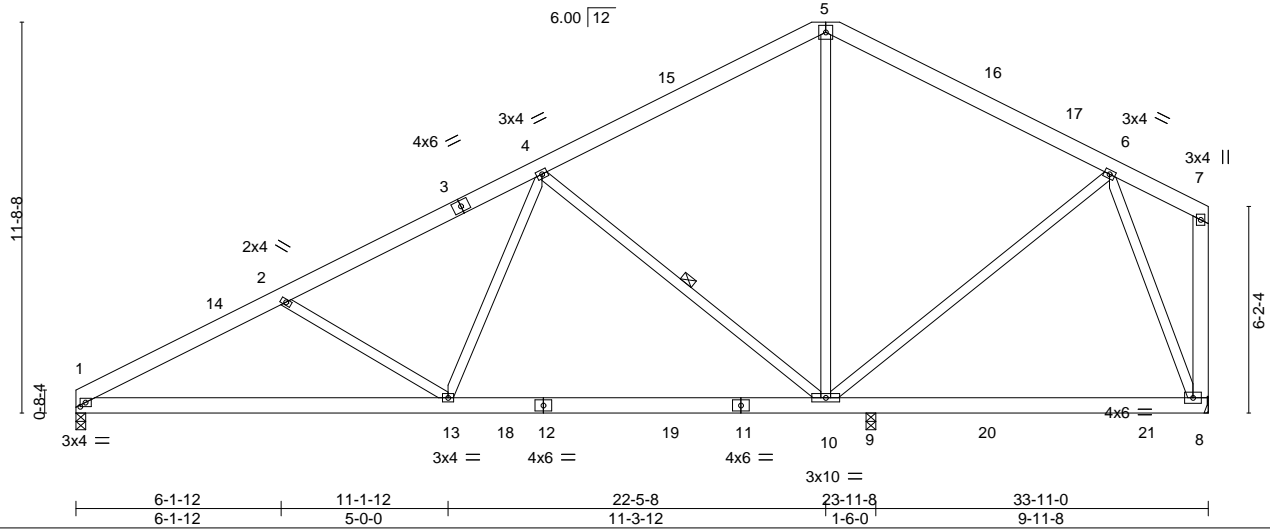


Plate Offsets (X,Y)--	[1:0-1-14,0-1-8]
-----------------------	------------------

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.28	Vert(LL) -0.21 10-13 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.63	Vert(CT) -0.34 10-13 >847 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 1.00	Horz(CT) 0.04 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S	Wind(LL) 0.07 10-13 >999 240	Weight: 259 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 5-0-15 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 7-8: 2x6 SP No.1	WEBS 1 Row at midpt 4-10

REACTIONS. (size) 1=0-3-8, 8=Mechanical, 9=0-3-8
 Max Horz 1=257(LC 12)
 Max Uplift 1=94(LC 12), 8=89(LC 13)
 Max Grav 1=1313(LC 19), 8=1102(LC 2), 9=732(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-2242/475, 2-4=-1969/393, 4-5=-823/331, 5-6=-821/332
 BOT CHORD 1-13=-542/1997, 10-13=-363/1447, 9-10=-129/371, 8-9=-129/371
 WEBS 2-13=-372/248, 4-13=0/788, 4-10=-1033/305, 5-10=-21/284, 6-10=-18/400,
 6-8=-1020/391

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 22-5-8, Exterior(2R) 22-5-8 to 26-10-5, Interior(1) 26-10-5 to 33-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 21, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job J0524-3015	Truss A6	Truss Type COMMON	Qty 11	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721083
-------------------	-------------	----------------------	-----------	----------	--	-----------


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:33 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:75.2

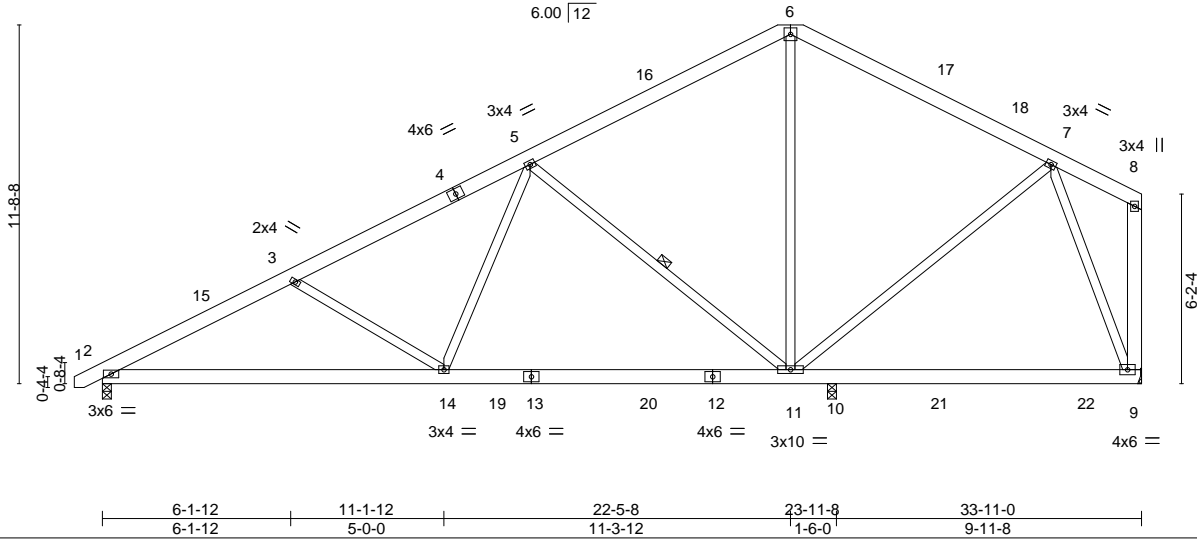

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.21 11-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.63	Vert(CT)	-0.34 11-14	>845	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 1.00	Horz(CT)	0.04 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.07 11-14	>999	240		
								Weight: 261 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2 *Except*
 8-9: 2x6 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-1-2 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 5-11

REACTIONS. (size) 2=0-3-8, 9=Mechanical, 10=0-3-8
 Max Horz 2=261(LC 12)
 Max Uplift 2=-107(LC 12), 9=-89(LC 13)
 Max Grav 2=1357(LC 19), 9=1103(LC 2), 10=730(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2239/460, 3-5=-1967/385, 5-6=-824/330, 6-7=-821/331
 BOT CHORD 2-14=-537/1994, 11-14=-363/1446, 10-11=-128/371, 9-10=-128/371
 WEBS 3-14=-368/233, 5-14=0/785, 5-11=-1031/306, 6-11=-20/285, 7-11=-17/400,
 7-9=-1020/391

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 22-5-8, Exterior(2R) 22-5-8 to 26-10-5, Interior(1) 26-10-5 to 33-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9 except (jt=lb) 2=107.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

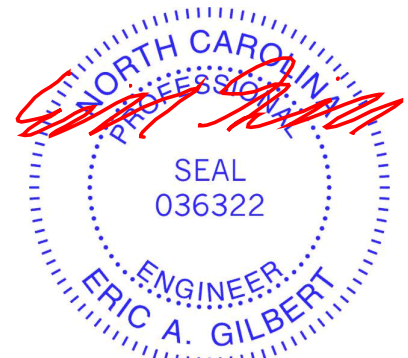

May 21, 2024


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 10 Jones Creek	165721084
J0524-3015	A7-GE	GABLE	1	1		
Comtech, Inc. Fayetteville, NC - 28314,						Job Reference (optional)

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:34 2024 Page 1
 ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwrcDoi7J4zJC?f

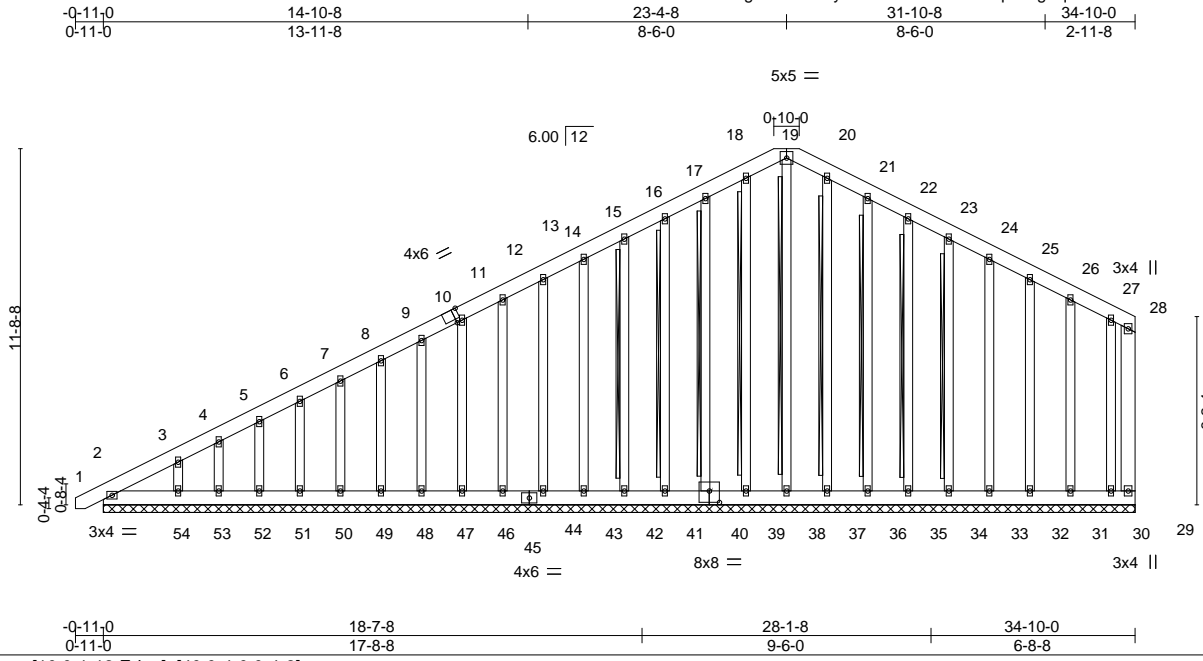

Scale = 1:75.7


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.01	Vert(LL) -0.00 1 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.10	Vert(CT) 0.00 1 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 29 n/a n/a		
	Code IRC2018/TPI2014			Weight: 422 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.1	WEBS T-Brace: 2x4 SPF No.2 - 19-38, 18-39, 17-40, 16-41, 15-42, 20-37, 21-36, 22-35, 23-34
OTHERS 2x4 SP No.2	Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance. Brace must cover 90% of web length.

REACTIONS. All bearings 33-11-0.
 (lb) - Max Horz 2=393(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 29, 39, 40, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 36, 35, 34, 33, 32, 31, 30 except 54=106(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 2, 29, 38, 39, 40, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 54, 37, 36, 35, 34, 33, 32, 31, 30

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-412/119, 3-4=-338/93, 4-5=-306/95, 5-6=-271/95, 15-16=-73/250, 16-17=-87/292, 17-18=-101/331, 18-19=-103/337, 19-20=-103/337, 20-21=-101/331, 21-22=-87/291

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; Gable Roof; Common Truss; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-9-2 to 3-9-8, Exterior(2N) 3-9-8 to 22-5-8, Corner(3R) 22-5-8 to 26-10-5, Exterior(2N) 26-10-5 to 33-8-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 1-4-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 29, 39, 40, 41, 42, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 36, 35, 34, 33, 32, 31, 30 except (jt=lb) 54=106.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - 12) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

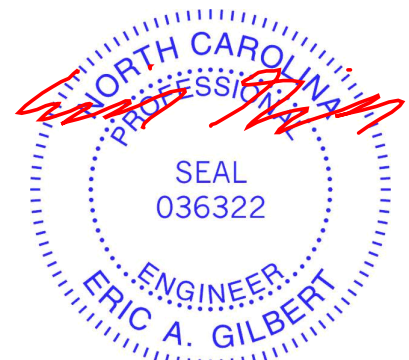


May 21, 2024

Job	Truss	Truss Type	Qty	Ply	Lot 10 Jones Creek	165721085
J0524-3015	B1-GE	GABLE	1	1		
Comtech, Inc. Fayetteville, NC - 28314,						Job Reference (optional)

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:35 2024 Page 1
 ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

-0-11-0	22-4-8	42-10-0	43-9-0
0-11-0	21-5-8	20-5-8	0-11-0

Scale = 1:74.3

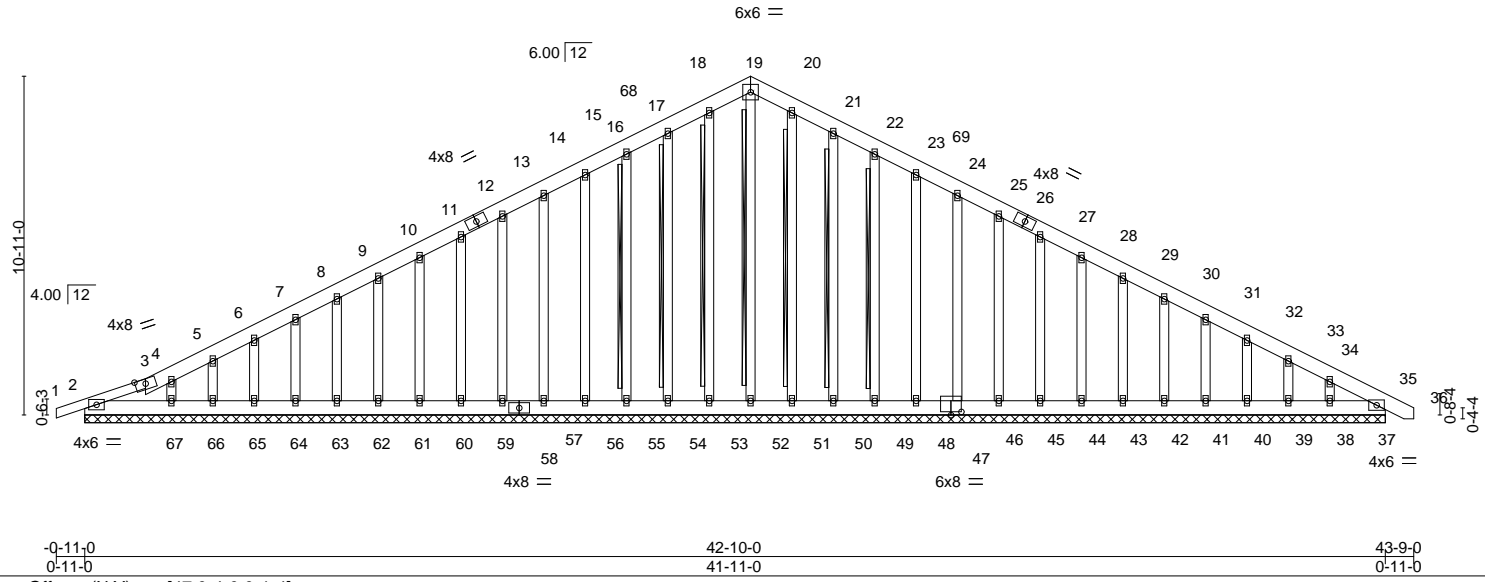

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	0.00	35	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	0.00	35	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.01	35	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						
								Weight: 434 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.1 *Except*
 1-3: 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS T-Brace: 2x4 SPF No.2 - 19-52, 18-53, 17-54, 16-55, 20-51, 21-50, 22-49
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS. All bearings 41-11-0.
 (lb) - Max Horz 2--215(LC 17)
 Max Uplift All uplift 100 lb or less at joint(s) 54, 55, 56, 57, 59, 60, 61, 62, 63, 64, 65, 66, 67, 50, 49, 2, 48, 46, 45, 44, 43, 42, 41, 40, 39, 38, 37
 Max Grav All reactions 250 lb or less at joint(s) 35, 52, 53, 54, 55, 56, 57, 59, 60, 61, 62, 63, 64, 65, 66, 67, 51, 50, 49, 2, 48, 46, 45, 44, 43, 42, 41, 40, 39, 38, 37

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-273/76, 3-4=-264/83, 15-16=-104/279, 16-17=-119/315, 17-18=-133/349, 18-19=-133/351, 19-20=-133/339, 20-21=-133/325, 21-22=-119/290, 22-23=-104/255

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; Gable Roof; Common Truss; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-11-0 to 1-11-8, Exterior(2N) 1-11-8 to 21-5-8, Corner(3R) 21-5-8 to 25-10-5, Exterior(2N) 25-10-5 to 42-8-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 1-4-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 54, 55, 56, 57, 59, 60, 61, 62, 63, 64, 65, 66, 67, 50, 49, 2, 48, 46, 45, 44, 43, 42, 41, 40, 39, 38, 37.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - 12) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

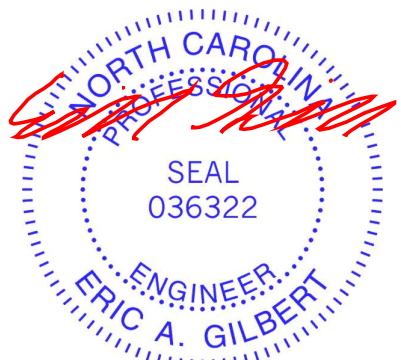


May 21, 2024

Job J0524-3015	Truss B2	Truss Type Roof Special	Qty 6	Ply 1	Lot 10 Jones Creek Job Reference (optional)	I65721086
-------------------	-------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:36 2024 Page 1
ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwrcDoi7J4zJC?f

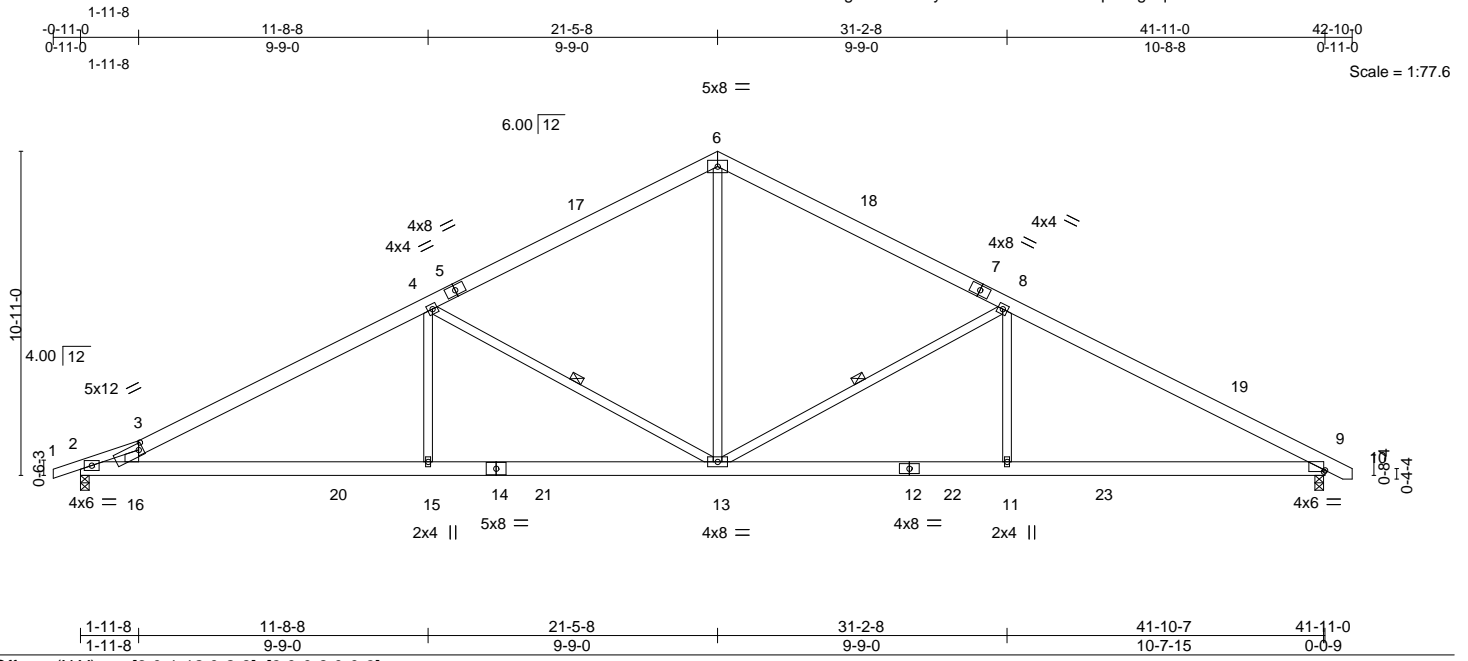

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.92	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.69	Vert(LL) -0.31 15-16 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.81	Vert(CT) -0.56 15-16 >895 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.11 9 n/a n/a		
	Code IRC2018/TPI2014		Wind(LL) 0.17 15-16 >999 240	Weight: 273 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1 *Except* 1-3: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x6 SP No.1 *Except* 2-14: 2x6 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 9-9-13 oc bracing.
WEBS 2x4 SP No.2 *Except* 3-16: 2x6 SP No.1	WEBS 1 Row at midpt 4-13, 8-13

REACTIONS.	(size) 2=0-3-8, 9=0-3-8
	Max Horz 2=139(LC 11)
	Max Uplift 2=-119(LC 12), 9=-110(LC 13)
	Max Grav 2=1998(LC 2), 9=1999(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3364/579, 3-4=-3638/869, 4-6=-2348/712, 6-8=-2346/714, 8-9=-3473/826
BOT CHORD	2-16=-531/3116, 15-16=-634/3259, 13-15=-634/3259, 11-13=-577/3005, 9-11=-577/3005
WEBS	3-16=-546/358, 4-15=0/762, 4-13=-1450/466, 6-13=-301/1574, 8-13=-1214/414, 8-11=0/679

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-11-0 to 1-11-8, Interior(1) 1-11-8 to 21-5-8, Exterior(2R) 21-5-8 to 25-10-5, Interior(1) 25-10-5 to 42-8-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=119, 9=110.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.




Job	Truss	Truss Type	Qty	Ply	Lot 10 Jones Creek	165721087
J0524-3015	D1-GE	GABLE	1	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:37 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwrcDoi7J4zJC?f



Scale = 1:68.0

Plate Offsets (X, Y)--	[9:0-4-0,0-4-8], [13:0-4-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.05	Vert(LL) -0.00 20 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00 20 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) 0.01 20 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S			
				Weight: 272 lb	FT = 20%


LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS T-Brace: 2x4 SPF No.2 - 11-31, 10-32, 12-30
Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
Brace must cover 90% of web length.

REACTIONS. All bearings 23-11-0.
(lb) - Max Horz 2=318(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 32, 33, 34, 35, 36, 37, 38, 20, 28, 27, 26, 25, 24, 23 except 2=155(LC 10), 39=180(LC 12), 22=164(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 31, 32, 33, 34, 35, 36, 37, 38, 39, 30, 20, 28, 27, 26, 25, 24, 23, 22 except 2=296(LC 12)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-425/278, 3-4=-287/215, 10-11=-155/252, 11-12=-155/252, 19-20=-357/179
BOT CHORD 2-39=-128/275, 38-39=-128/275, 37-38=-128/275, 36-37=-128/275, 35-36=-128/275, 34-35=-128/275, 33-34=-128/275, 32-33=-128/276, 31-32=-128/276, 30-31=-128/276, 28-30=-128/276, 27-28=-126/274, 26-27=-126/274, 25-26=-126/274, 24-25=-126/274, 23-24=-126/274, 22-23=-126/274, 20-22=-126/273

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; Gable Roof; Common Truss; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-9-4 to 3-7-9, Exterior(2N) 3-7-9 to 11-11-8, Corner(3R) 11-11-8 to 16-4-5, Exterior(2N) 16-4-5 to 24-8-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 32, 33, 34, 35, 36, 37, 38, 20, 28, 27, 26, 25, 24, 23 except (jt=lb) 2=155, 39=180, 22=164.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

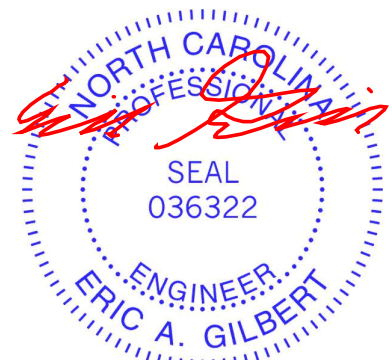

May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Job J0524-3015	Truss D2	Truss Type COMMON	Qty 5	Ply 1	Lot 10 Jones Creek 165721088
-------------------	-------------	----------------------	----------	----------	---------------------------------

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:38 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



5x5 =

Scale = 1:64.9

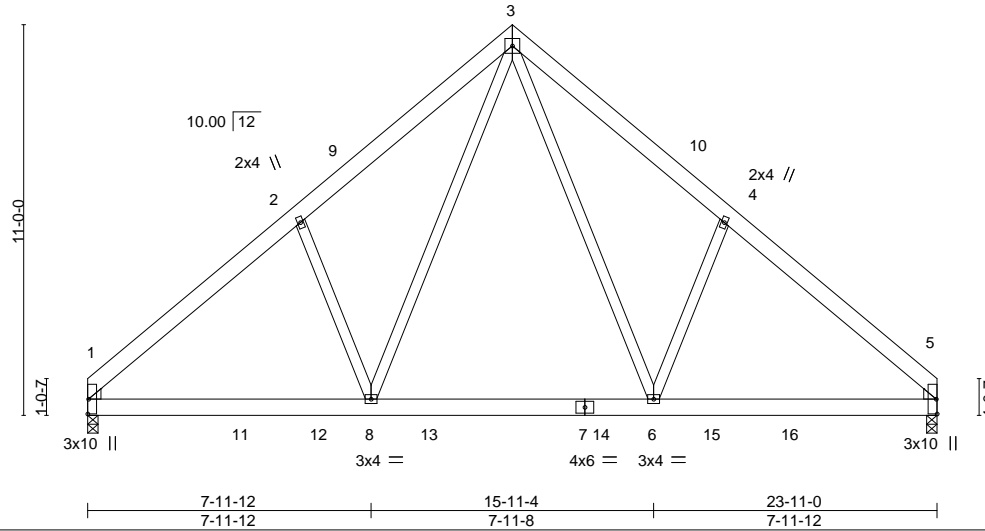

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	-0.06	6-8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT)	-0.08	6-8	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.40	Horz(CT)	0.02	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.02	1-8	>999		
								Weight: 179 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

WEDGE
 Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
 Max Horz 1=-251(LC 10)
 Max Uplift 1=-38(LC 12), 5=-38(LC 13)
 Max Grav 1=1177(LC 19), 5=1177(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1422/258, 2-3=-1326/397, 3-4=-1326/397, 4-5=-1421/258
 BOT CHORD 1-8=-99/1140, 6-8=0/762, 5-6=-82/1009
 WEBS 3-6=-184/762, 4-6=-300/287, 3-8=-184/761, 2-8=-300/287

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 11-11-8, Exterior(2R) 11-11-8 to 16-4-5, Interior(1) 16-4-5 to 23-9-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job J0524-3015	Truss D3	Truss Type COMMON GIRDER	Qty 1	Ply 2	Lot 10 Jones Creek Job Reference (optional)	165721089
-------------------	-------------	-----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:39 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f



5x8 ||

Scale = 1:64.9

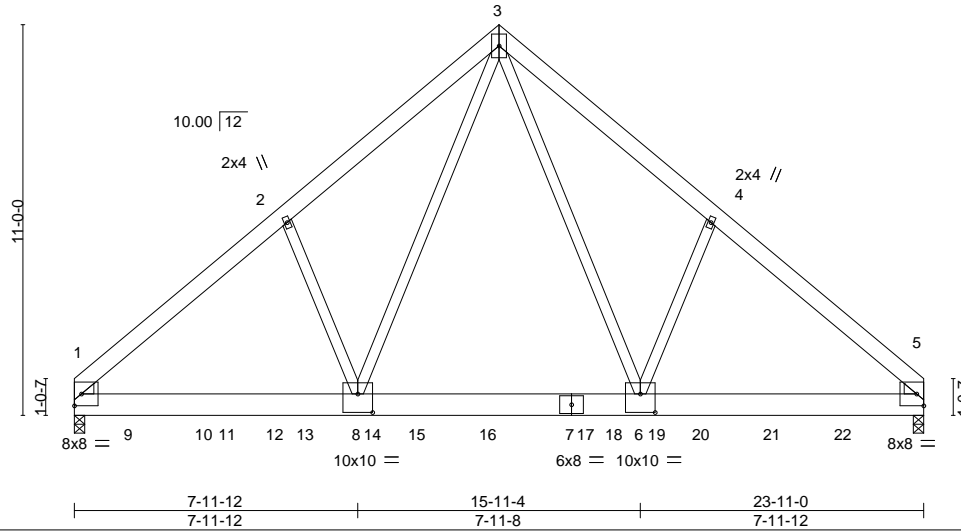


Plate Offsets (X,Y)-- [6:0-5-0,0-6-4], [8:0-5-0,0-6-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.79	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.56	Vert(LL) -0.12 1-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.63	Vert(CT) -0.21 1-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.03 5 n/a n/a		
	Code IRC2018/TPI2014		Wind(LL) 0.07 1-8 >999 240	Weight: 393 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x8 SP 2400F 2.0E
 WEBS 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-3 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
 Max Horz 1=249(LC 28)
 Max Uplift 1=610(LC 8), 5=670(LC 9)
 Max Grav 1=7133(LC 2), 5=7803(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-7992/722, 2-3=-7760/824, 3-4=-7705/820, 4-5=-7940/719
 BOT CHORD 1-8=-549/5833, 6-8=-309/4064, 5-6=-460/5790
 WEBS 3-6=-554/5016, 4-6=-307/388, 3-8=-561/5131, 2-8=-306/385

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=610, 5=670.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1068 lb down and 109 lb up at 1-6-12, 1062 lb down and 109 lb up at 3-6-12, 1040 lb down and 109 lb up at 5-6-12, 1068 lb down and 109 lb up at 7-6-12, 1052 lb down and 109 lb up at 9-6-12, 1038 lb down and 109 lb up at 11-6-12, 1041 lb down and 109 lb up at 13-6-12, 1068 lb down and 109 lb up at 15-6-12, 1068 lb down and 109 lb up at 17-6-12, 1068 lb down and 109 lb up at 19-6-12, and 1068 lb down and 109 lb up at 21-6-12, and 1081 lb down and 101 lb up at 23-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



May 21, 2024

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)



818 Soundside Road
 Edenton, NC 27932

Job J0524-3015	Truss D3	Truss Type COMMON GIRDER	Qty 1	Ply 2	Lot 10 Jones Creek I65721089 Job Reference (optional)
-------------------	-------------	-----------------------------	----------	-----------------	---

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:39 2024 Page 2
ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-60, 3-5=-60, 1-5=-20

Concentrated Loads (lb)

Vert: 5=-963(F) 9=-955(F) 10=-955(F) 12=-955(F) 14=-955(F) 15=-955(F) 16=-955(F) 17=-955(F) 19=-955(F) 20=-955(F) 21=-955(F) 22=-955(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job J0524-3015	Truss E1-GE	Truss Type GABLE	Qty 1	Ply 1	Lot 10 Jones Creek 165721090
-------------------	----------------	---------------------	----------	----------	---------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:39 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)



Scale = 1:35.5

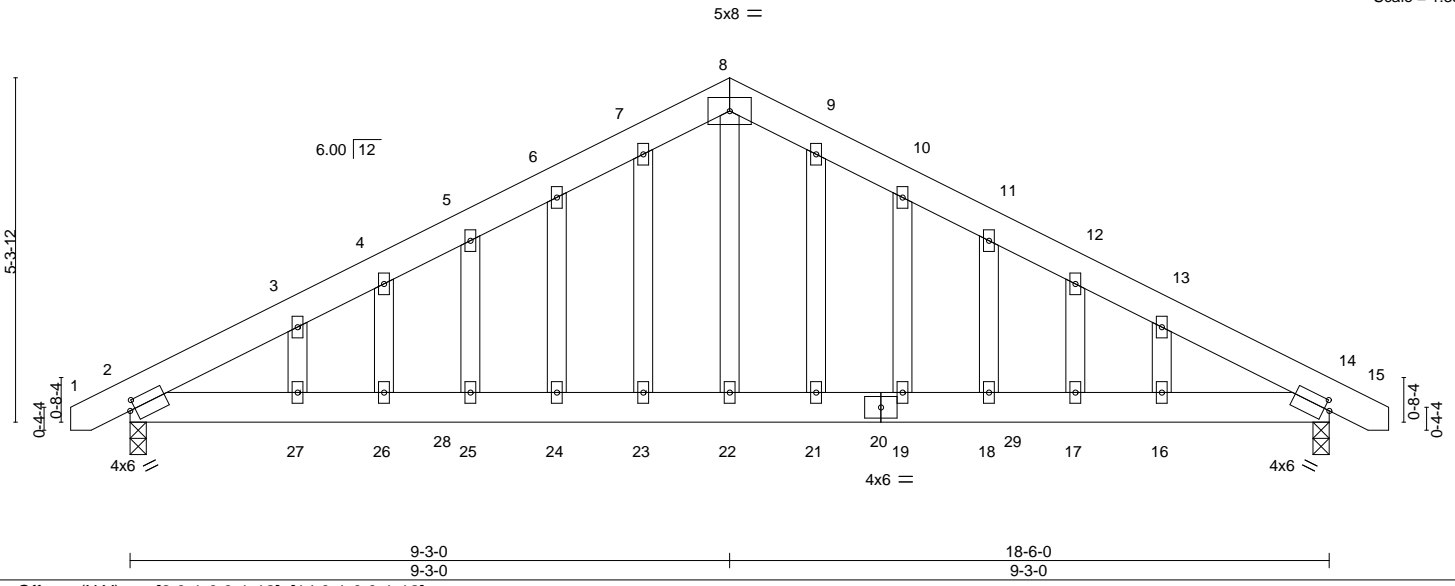



Plate Offsets (X, Y)--	[2:0-1-0,0-1-12], [14:0-1-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.34	Vert(LL) -0.07 17-18 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.37	Vert(CT) -0.11 17-18 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.29	Horz(CT) -0.02 14 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S	Wind(LL) 0.13 25-26 >999 240	Weight: 139 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-7-7 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.2	

REACTIONS. (size) 14=0-3-0, 2=0-3-0
 Max Horz 2=101(LC 16)
 Max Uplift 14=-211(LC 8), 2=-211(LC 9)
 Max Grav 14=783(LC 1), 2=783(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1032/1379, 3-4=-953/1355, 4-5=-925/1355, 5-6=-906/1362, 6-7=-892/1385,
 7-8=-865/1395, 8-9=-865/1395, 9-10=-892/1385, 10-11=-906/1362, 11-12=-925/1354,
 12-13=-953/1355, 13-14=-1032/1379
 BOT CHORD 2-27=-1078/823, 26-27=-1078/823, 25-26=-1078/823, 24-25=-1078/823, 23-24=-1078/823,
 22-23=-1078/823, 21-22=-1078/823, 19-21=-1078/823, 18-19=-1078/823,
 17-18=-1078/823, 16-17=-1078/823, 14-16=-1078/823
 WEBS 8-22=-773/434

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; Gable Roof; Common Truss; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-9-2 to 3-11-0, Exterior(2N) 3-11-0 to 9-3-0, Corner(3R) 9-3-0 to 13-7-13, Exterior(2N) 13-7-13 to 19-3-2 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=211, 2=211.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

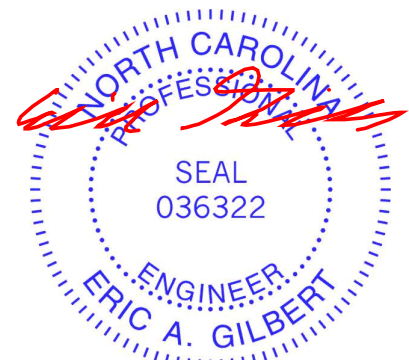

May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
 A MiTek Affiliate


818 Soundside Road
 Edenton, NC 27932

Job J0524-3015	Truss E2	Truss Type COMMON	Qty 1	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721091
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:40 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDdoi7J4zJC?f



Scale = 1:35.5

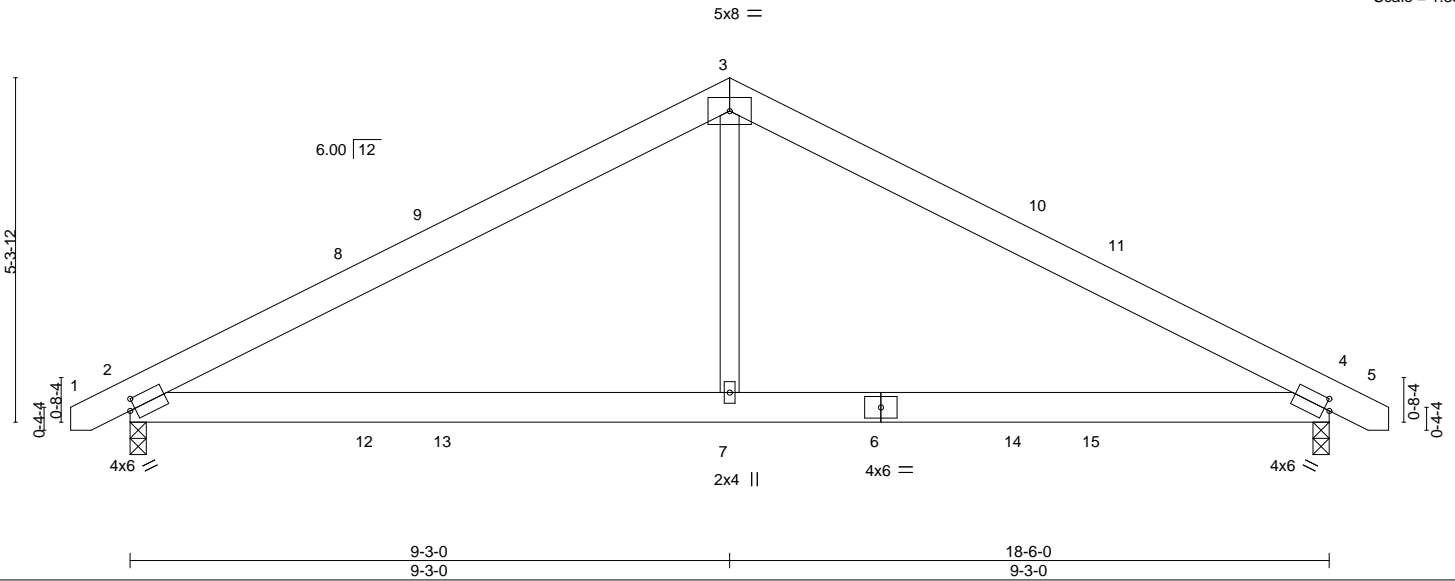


Plate Offsets (X,Y)--	[2:0-1-0,0-2-0], [4:0-1-0,0-2-0]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.41	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.33	Vert(LL) 0.14 2-7 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.27	Vert(CT) -0.09 4-7 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) -0.01 4 n/a n/a		
	Code IRC2018/TPI2014			Weight: 104 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 7-4-14 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS.
(size) 4=0-3-0, 2=0-3-0
Max Horz 2=65(LC 11)
Max Uplift 4=-165(LC 8), 2=-165(LC 9)
Max Grav 4=783(LC 1), 2=783(LC 1)

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1027/1237, 3-4=-1027/1237
BOT CHORD 2-7=-948/801, 4-7=-948/801
WEBS 3-7=-734/444

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 9-3-0, Exterior(2R) 9-3-0 to 13-7-13, Interior(1) 13-7-13 to 19-3-2 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=165, 2=165.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



May 21, 2024

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacomponents.com)</p>	<p>818 Soundside Road Edenton, NC 27932</p>
---	---

Job J0524-3015	Truss E3	Truss Type COMMON	Qty 1	Ply 1	Lot 10 Jones Creek 165721092
-------------------	-------------	----------------------	----------	----------	---------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:40 2024 Page 1

ID:2GNsYO62BI49KgBFP3SImayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Job Reference (optional)



5x8 =

Scale = 1:34.7

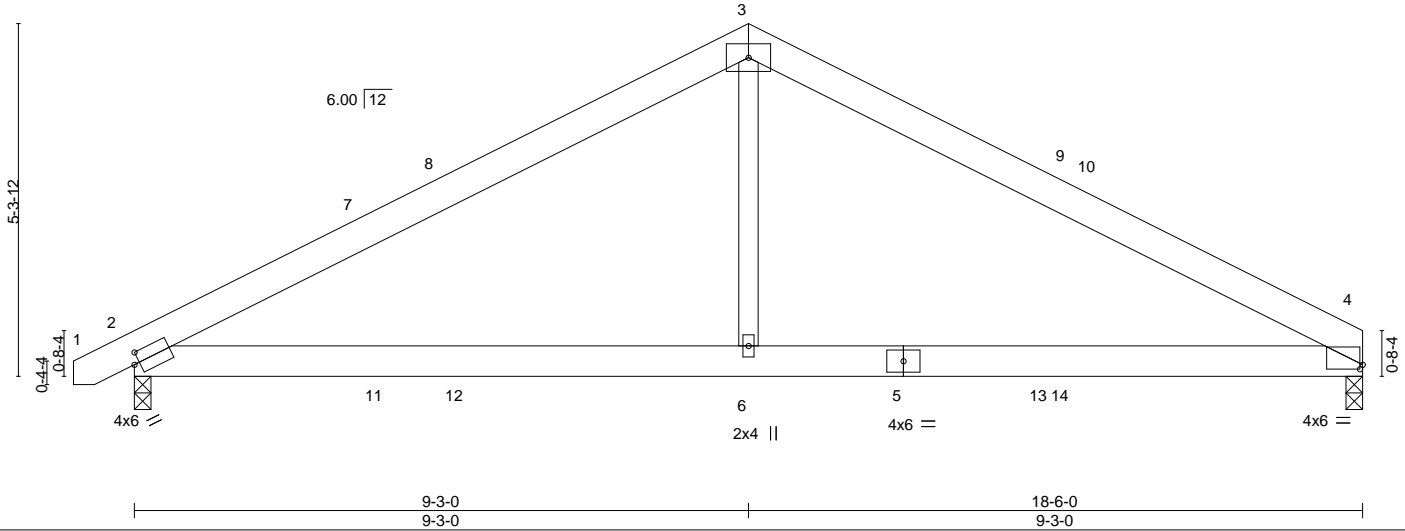


Plate Offsets (X,Y)--	[2:0-1-0,0-2-0], [4:0-0-8,0-0-13]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	0.14	4-6	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT)	-0.09	4-6	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.27	Horz(CT)	-0.01	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						
								Weight: 101 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 7-3-15 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 4=0-3-0, 2=0-3-0
 Max Horz 2=66(LC 9)
 Max Uplift 4=-160(LC 8), 2=-165(LC 9)
 Max Grav 4=729(LC 1), 2=784(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1030/1238, 3-4=-1027/1246
 BOT CHORD 2-6=-970/803, 4-6=-970/803
 WEBS 3-6=-739/446

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCdL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) -0-9-2 to 3-7-11, Interior(1) 3-7-11 to 9-3-0, Exterior(2R) 9-3-0 to 13-7-13, Interior(1) 13-7-13 to 18-4-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=160, 2=165.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



May 21, 2024

Job J0524-3015	Truss E4	Truss Type COMMON	Qty 3	Ply 1	Lot 10 Jones Creek Job Reference (optional)	165721093
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:41 2024 Page 1
ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

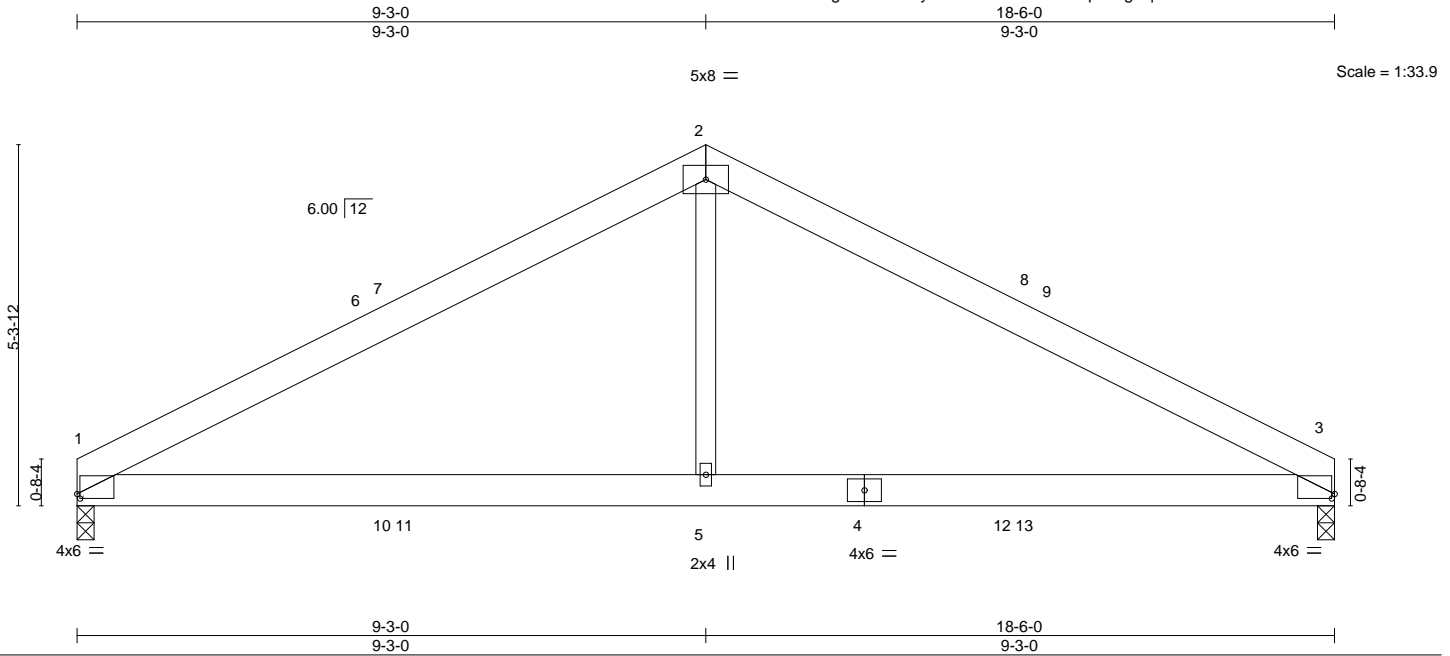



Plate Offsets (X,Y)--	[1:0-0-8,0-0-13], [3:0-0-8,0-0-13]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.44	Vert(LL) 0.14 1-5 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(CT) -0.09 3-5 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.27	Horz(CT) -0.01 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S		Weight: 99 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 7-3-15 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 1=0-3-0, 3=0-3-0
 Max Horz 1=-63(LC 8)
 Max Uplift 1=-161(LC 9), 3=-161(LC 8)
 Max Grav 1=730(LC 1), 3=730(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1029/1247, 2-3=-1029/1247
 BOT CHORD 1-5=-972/806, 3-5=-972/806
 WEBS 2-5=-738/447

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) 0-1-8 to 4-6-5, Interior(1) 4-6-5 to 9-3-0, Exterior(2R) 9-3-0 to 13-7-13, Interior(1) 13-7-13 to 18-4-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=161, 3=161.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

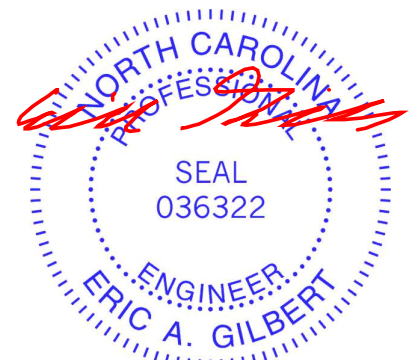


May 21, 2024

Job J0524-3015	Truss VD-2	Truss Type Valley	Qty 1	Ply 1	Lot 10 Jones Creek 165721095
-------------------	---------------	----------------------	----------	----------	---------------------------------

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:42 2024 Page 1

ID:2GNsYO62BI49KgBFP3SImayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



4x4 =

Scale = 1:20.2

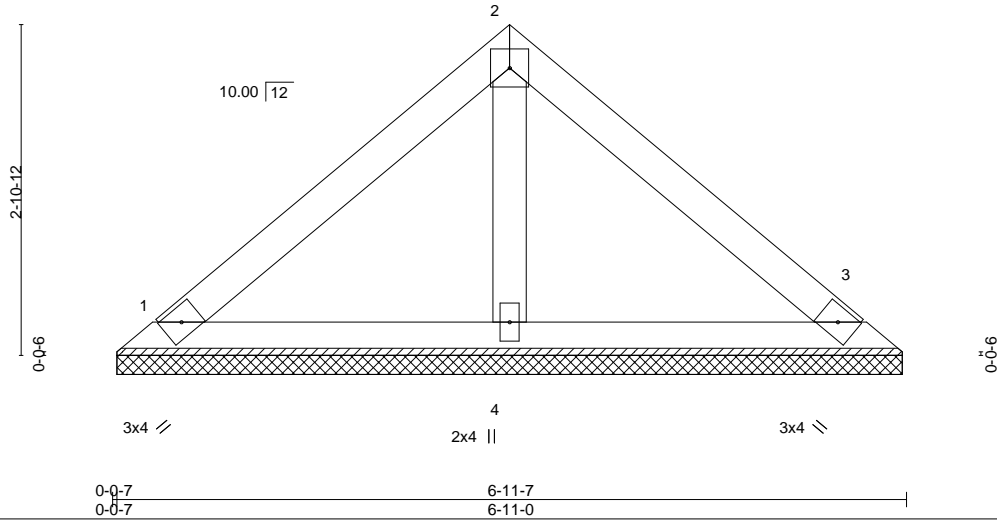

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 26 lb	FT = 20%
	Code IRC2018/TPI2014							

LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=6-10-8, 3=6-10-8, 4=6-10-8
Max Horz 1=61(LC 9)
Max Uplift 1=-21(LC 13), 3=-27(LC 13)
Max Grav 1=142(LC 1), 3=142(LC 1), 4=207(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

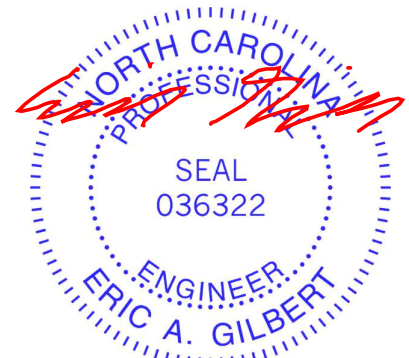

May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job J0524-3015	Truss VD-3	Truss Type Valley	Qty 1	Ply 1	Lot 10 Jones Creek 165721096
-------------------	---------------	----------------------	----------	----------	---------------------------------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Tue May 21 09:24:42 2024 Page 1

ID:2GNsYO62BI49KgBFP3SlmayOXVO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

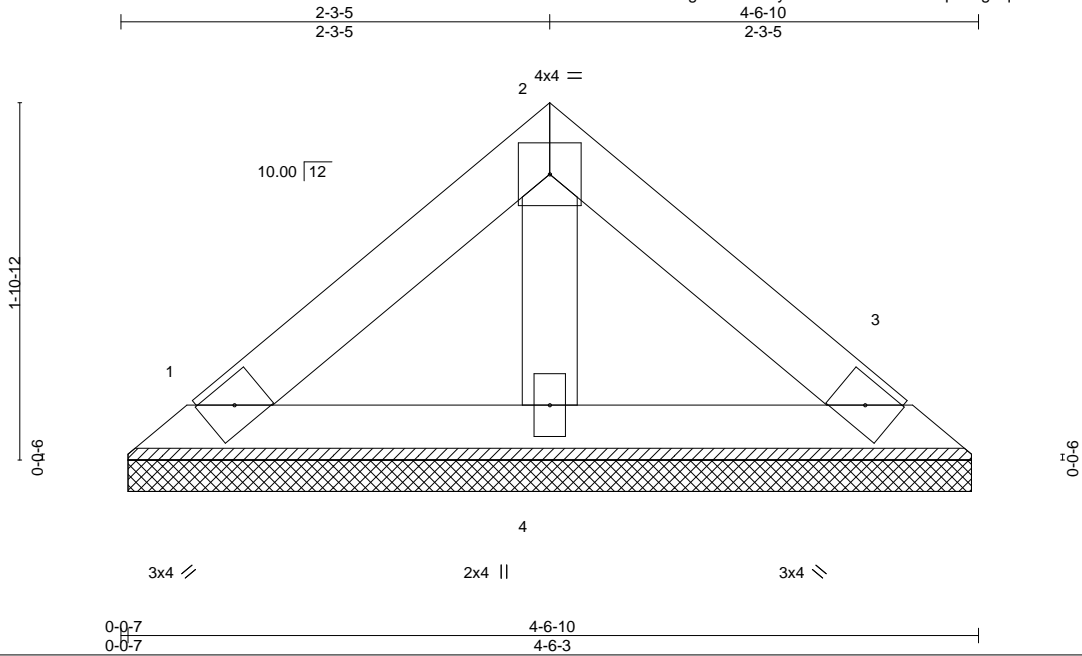

Scale = 1:12.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 16 lb	FT = 20%
	Code IRC2018/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-6-10 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-5-12, 3=4-5-12, 4=4-5-12
 Max Horz 1=37(LC 8)
 Max Uplift 1=13(LC 13), 3=16(LC 13)
 Max Grav 1=87(LC 1), 3=87(LC 1), 4=126(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



1 TOP CHORDS
2 Joint ID
3 typ.

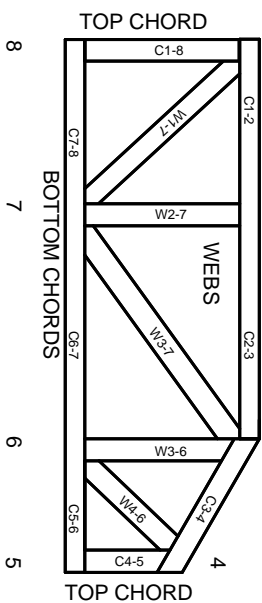

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek

ENGINEERING BY
TRENGO
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.