

# Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 45591

JOB: 24-1097-F02

JOB NAME: LOT 0.0001 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

*16 Truss Design(s)*

Trusses:

F201, F202, F203, F204, F206, F207, F208, F209, F210, F211, F212, F213, F214, F215, F216,



**2/20/2024**

**Mark Morris**

***Warning !—Verify design parameters and read notes before use.***

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job 24-1097-F02	Truss F201	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 45591</b>
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:18 2024 Page 1  
ID:Wl8rkg6BK5SaRYCYGf9\_0xywFJ5-mjujpkCgJss1XW7isxlm7OEG44swcSJYvyl\_o7ziqf

0-1-8

Scale = 1:28.7

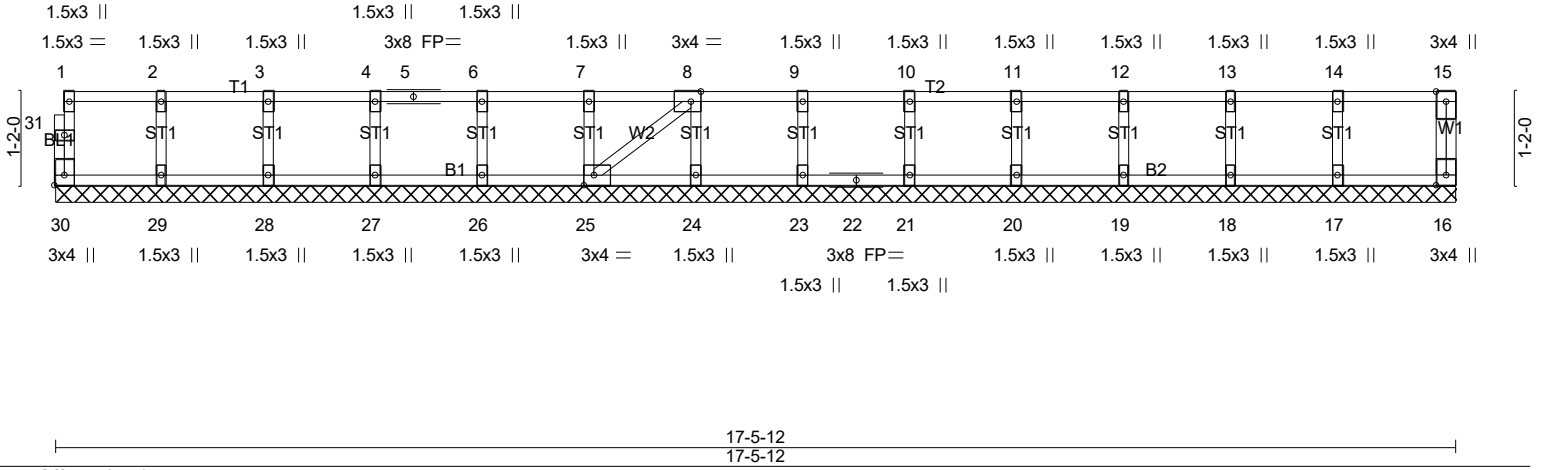


Plate Offsets (X,Y)-- [8:0-1-8,Edge], [25:0-1-8,Edge], [30:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	16	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 76 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 17-5-12.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 30, 16, 29, 28, 27, 26, 25, 24, 23, 21, 20, 19, 18, 17

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)  
1) Gable requires continuous bottom chord bearing.  
2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
3) Gable studs spaced at 1-4-0 oc.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
5) CAUTION. Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F202	Truss Type Floor	Qty 6	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 45591</b>
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:19 2024 Page 1  
ID:Wl8rkg6BK5SaRYCYGf9\_0xywFJ5-EwS514DI4A\_u9giuQeG?gbnJ\_U0yLnkh8cUYKaziqck

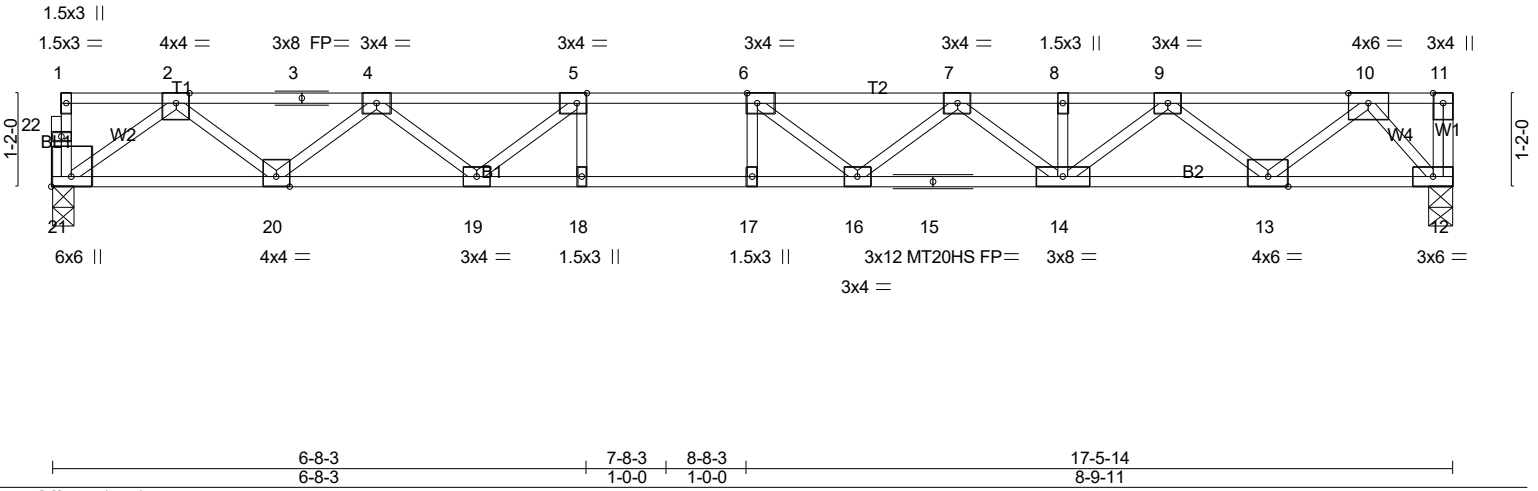


Plate Offsets (X,Y)-- [5:0-1-8,Edge], [6:0-1-8,Edge], [21:Edge,0-3-0]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.64	Vert(LL) -0.30 16-17 >697 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.79	Vert(CT) -0.41 16-17 >507 360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr YES	WB 0.53	Horz(CT) 0.06 12 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 88 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-9-2 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 21=942/0-3-6 (min. 0-1-8), 12=948/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2028/0, 3-4=-2028/0, 4-5=-3259/0, 5-6=-3830/0, 6-7=-3780/0, 7-8=-3111/0, 8-9=-3111/0, 9-10=-1700/0

BOT CHORD 20-21=0/1226, 19-20=0/2785, 18-19=0/3830, 17-18=0/3830, 16-17=0/3830, 15-16=0/3619, 14-15=0/3619, 13-14=0/2529, 12-13=0/837

WEBS 5-18=-65/292, 6-17=-260/97, 5-19=-879/0, 4-19=0/650, 4-20=-986/0, 2-20=0/1044, 2-21=-1514/0, 6-16=-424/231, 7-16=0/374, 7-14=-648/0, 9-14=0/744, 9-13=-1079/0, 10-13=0/1122, 10-12=-1256/0

- NOTES-** (5)
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard





2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F203	Truss Type FLOOR	Qty 5	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 45591</b>
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:20 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfiGO4QyyWlk-i60TEQEwrT6lnqH5\_MnECpJa?uPT4I0rNGE5s0ziqj

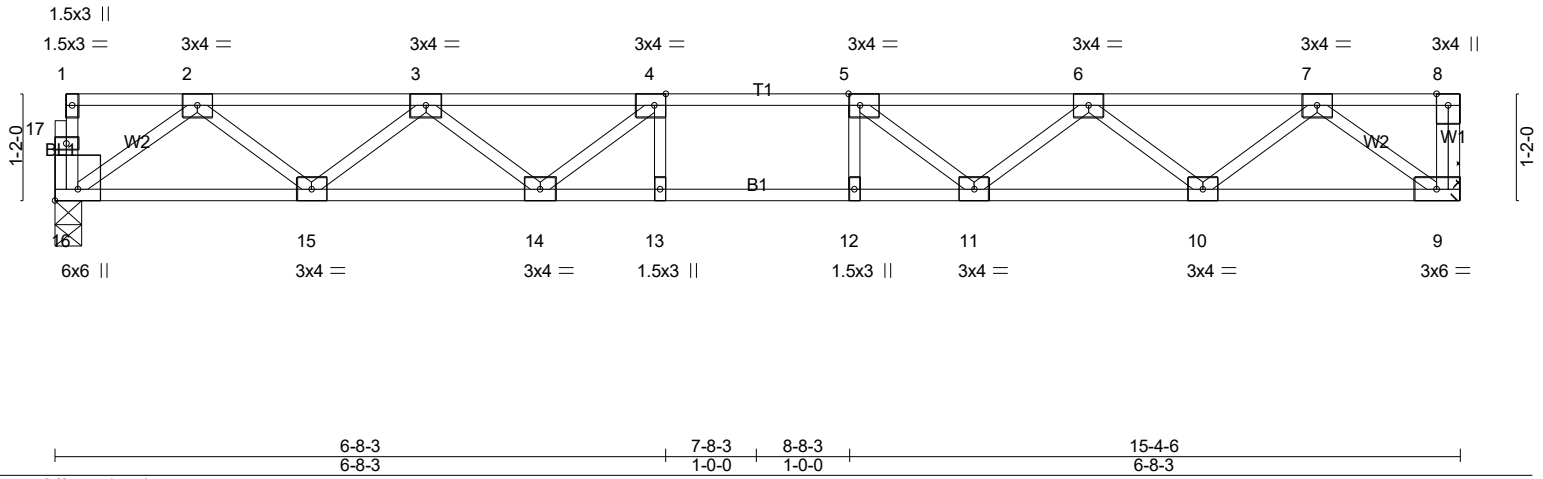

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	1-4-0	TC 0.24	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.51	Vert(LL) -0.11 11-12 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.28	Vert(CT) -0.15 12-13 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2018/TPI2014			Weight: 77 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 16=550/0-3-8 (min. 0-1-8), 9=554/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1153/0, 3-4=-1785/0, 4-5=-1990/0, 5-6=-1785/0, 6-7=-1154/0  
BOT CHORD 15-16=0/707, 14-15=0/1576, 13-14=0/1990, 12-13=0/1990, 11-12=0/1990, 10-11=0/1576, 9-10=0/708  
WEBS 4-14=-387/0, 3-14=0/314, 3-15=-550/0, 2-15=0/580, 2-16=-873/0, 5-11=-387/0, 6-11=0/314, 6-10=-550/0, 7-10=0/580, 7-9=-875/0

- NOTES-** (6)
- Unbalanced floor live loads have been considered for this design.
  - Refer to girder(s) for truss to truss connections.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard





2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F204	Truss Type Floor	Qty 5	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC
					Job Reference (optional) <b># 45591</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:21 2024 Page 1  
ID:pMqJz?gO\_6c5LWiStGO4QyyWlk-AlarSmEZcnEbO\_sHY3ITi0sIRHI2pI9\_cwzfOSzqi

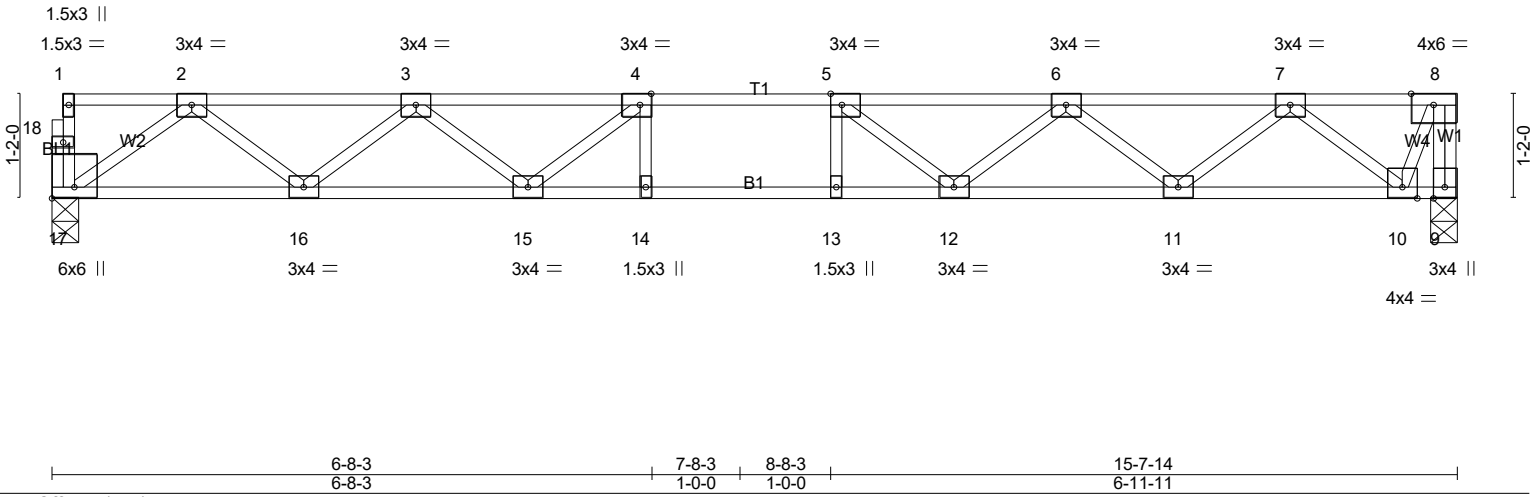

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.56	Vert(LL) -0.12 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.28	Vert(CT) -0.16 12-13 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2018/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 9=565/0-3-8 (min. 0-1-8), 17=561/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 8-9=-566/0, 2-3=-1181/0, 3-4=-1839/0, 4-5=-2067/0, 5-6=-1886/0, 6-7=-1281/0  
BOT CHORD 16-17=0/723, 15-16=0/1614, 14-15=0/2067, 13-14=0/2067, 12-13=0/2067, 11-12=0/1691, 10-11=0/851  
WEBS 4-15=-413/0, 3-15=0/330, 3-16=-565/0, 2-16=0/596, 2-17=-891/0, 5-12=-371/0, 6-12=0/305, 6-11=-533/0, 7-11=0/559, 7-10=-798/0, 8-10=0/576

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard





2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F206	Truss Type Floor	Qty 6	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 45591</b>
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:22 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfIGO4QyyWlk-eU8E6FBM5MS08RT5npilEPsoh0xYAB8qajCvxzqiqh

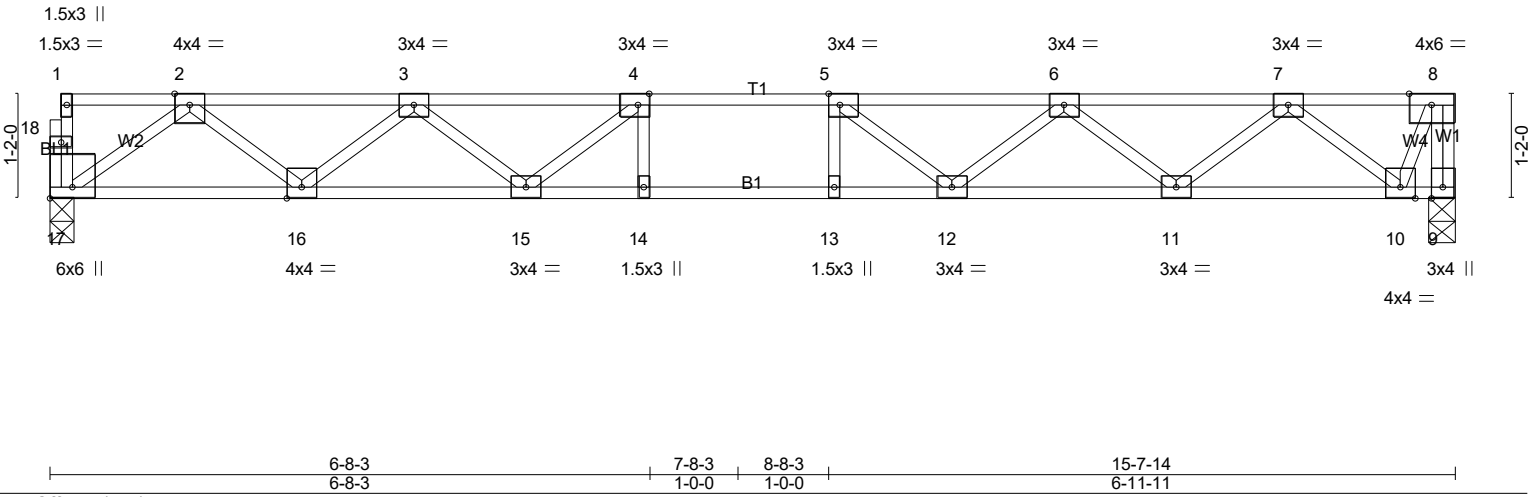

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.41	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.83	Vert(LL) -0.18 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.43	Vert(CT) -0.24 12-13 >772 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.05 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 9=847/0-3-8 (min. 0-1-8), 17=841/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 8-9=-849/0, 2-3=-1771/0, 3-4=-2758/0, 4-5=-3101/0, 5-6=-2829/0, 6-7=-1921/0, 7-8=-358/0  
BOT CHORD 16-17=0/1084, 15-16=0/2422, 14-15=0/3101, 13-14=0/3101, 12-13=0/3101, 11-12=0/2536, 10-11=0/1277  
WEBS 4-15=-620/0, 3-15=0/496, 3-16=-847/0, 2-16=0/894, 2-17=-1337/0, 5-12=-556/0, 6-12=0/457, 6-11=-800/0, 7-11=0/839, 7-10=-1197/0, 8-10=0/864

**NOTES-** (4)  
1) Unbalanced floor live loads have been considered for this design.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
3) CAUTION. Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC
24-1097-F02	F207	Floor Supported Gable	1	1	Job Reference (optional) # 45591

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:23 2024 Page 1  
 ID:pMqJz?gO\_6c5LWiSiGO4QyyWlk-6hictSGp7OVJeH0ffUkXqRx715Z5HjbH3ESITLzIqq

0-1-8

Scale = 1:25.7

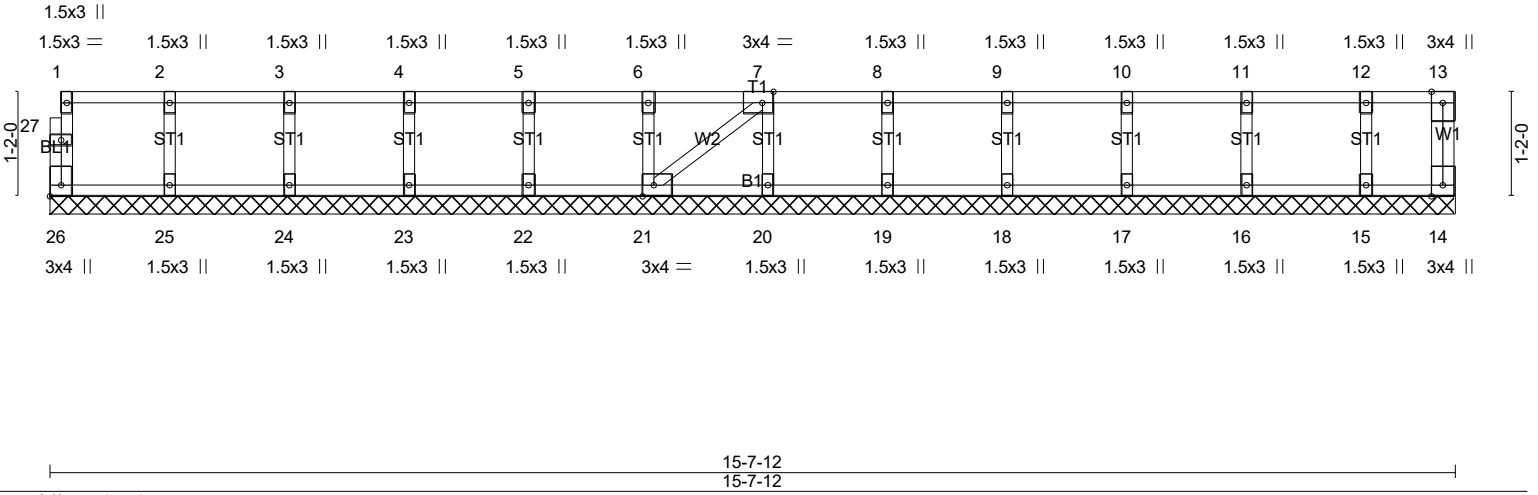


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [21:0-1-8,Edge], [26:Edge,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr YES
BCDL 5.0	Code IRC2021/TPI2014
<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d
TC 0.06	Vert(LL) n/a - n/a 999
BC 0.01	Vert(CT) n/a - n/a 999
WB 0.03	Horz(CT) 0.00 14 n/a n/a
Matrix-SH	
<b>PLATES</b>	<b>GRIP</b>
MT20	244/190
Weight: 69 lb FT = 20%F, 11%E	

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 15-7-12.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- 1) Gable requires continuous bottom chord bearing.
  - 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 3) Gable studs spaced at 1-4-0 oc.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job 24-1097-F02	Truss F208	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 45591</b>
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:24 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfiGO4QyyWlk-btG\_4oHRuidAFRbsDCrANfUImVvK0ArQluCJ?nziqf

0<sub>1</sub>-8

0<sub>1</sub>-8

Scale = 1:21.4

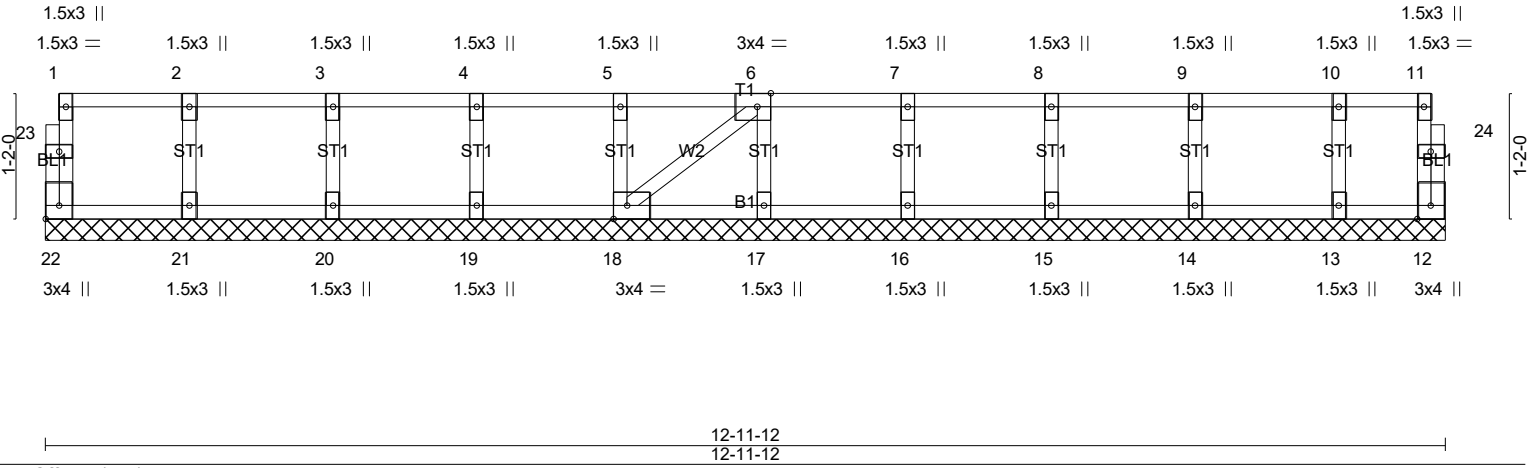


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [18:0-1-8,Edge], [22:Edge,0-1-8]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00		TC 0.06	Vert(LL) n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.01	Vert(CT) n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr YES		WB 0.03	Horz(CT) 0.00	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 58 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS.** All bearings 12-11-12.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5)
- Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



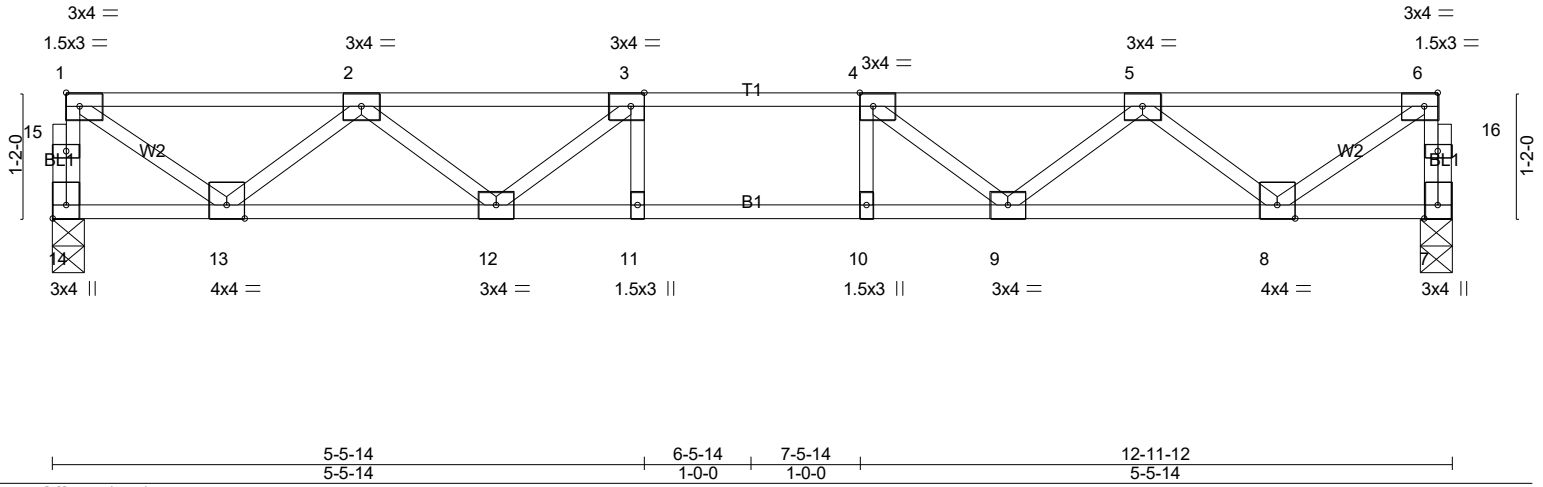

<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>		<b>GRIP</b>	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.32	Vert(LL)	-0.10 11-12 >999 480	MT20		244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.58	Vert(CT)	-0.13 9-10 >999 360				
BCLL	0.0	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.03 7 n/a n/a				
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 65 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 14=694/0-3-6 (min. 0-1-8), 7=694/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 14-15=-688/0, 1-15=-687/0, 7-16=-688/0, 6-16=-687/0, 1-2=-836/0, 2-3=-1812/0, 3-4=-2109/0, 4-5=-1812/0, 5-6=-836/0  
BOT CHORD 12-13=0/1506, 11-12=0/2109, 10-11=0/2109, 9-10=0/2109, 8-9=0/1506  
WEBS 3-12=-507/0, 2-12=0/427, 2-13=-872/0, 1-13=0/984, 4-9=-507/0, 5-9=0/427, 5-8=-872/0, 6-8=0/984



**NOTES-** (3)  
1) Unbalanced floor live loads have been considered for this design.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

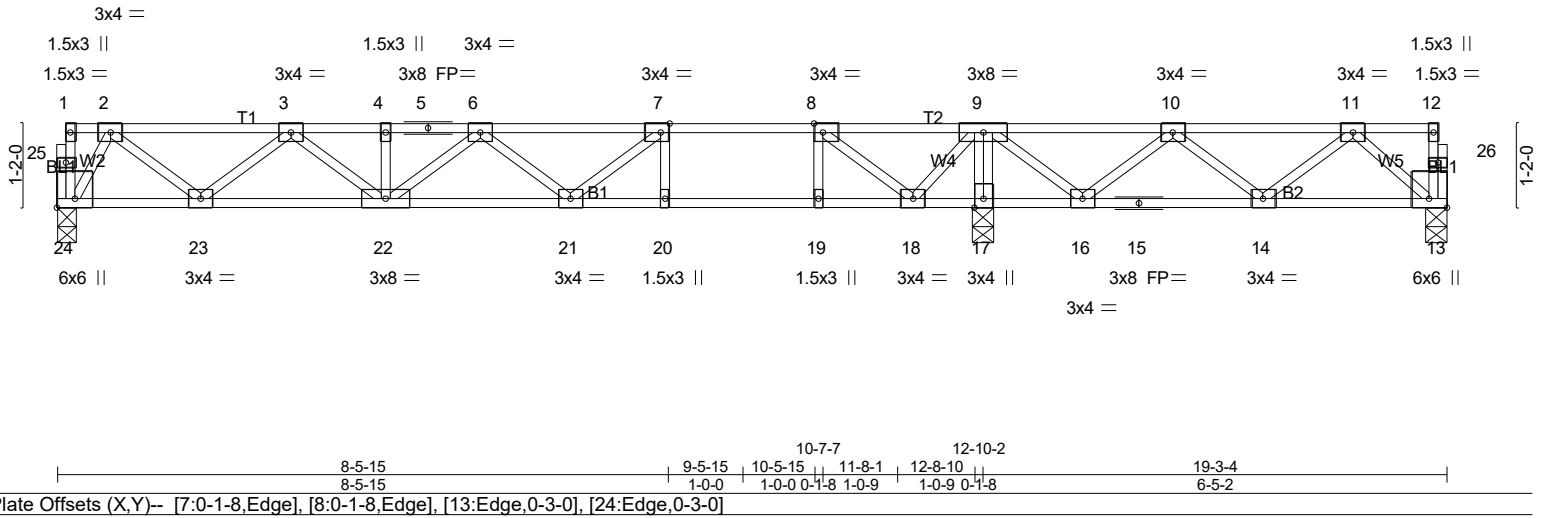

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	2-0-0	TC 0.83	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.88	Vert(LL) -0.25 20-21 >612 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.38	Vert(CT) -0.34 20-21 >451 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 13 n/a n/a		
	Code IRC2021/TPI2014				Weight: 100 lb FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP SS(flat) \*Except\*  
B2: 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 17-18,16-17.

**REACTIONS.** (lb/size) 24=697/0-3-6 (min. 0-1-8), 17=1035/0-3-8 (min. 0-1-8), 13=348/0-3-6 (min. 0-1-8)  
Max Grav 24=703(LC 3), 17=1035(LC 1), 13=376(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1058/0, 3-4=-1954/0, 4-5=-1954/0, 5-6=-1954/0, 6-7=-2133/0, 7-8=-1724/0, 8-9=-668/0, 9-10=-476/0, 10-11=-559/0  
BOT CHORD 23-24=0/442, 22-23=0/1639, 21-22=0/2254, 20-21=0/1724, 19-20=0/1724, 18-19=0/1724, 15-16=0/698, 14-15=0/698, 13-14=0/384  
WEBS 7-20=-399/0, 8-19=0/456, 9-17=-914/0, 7-21=0/562, 6-22=-383/0, 3-22=0/402, 3-23=-756/0, 2-23=0/803, 2-24=-870/0, 8-18=-1360/0, 9-18=0/775, 9-16=0/408, 10-16=-376/0, 11-13=-511/0

**NOTES-** (4)  
1) Unbalanced floor live loads have been considered for this design.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
3) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F211	Truss Type Floor	Qty 5	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC	# 45591
--------------------	---------------	---------------------	----------	----------	---	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:28 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfiGO4QyyWlk-TeVv9Kyyx7ck3udS1w6XVftS622ytS0DWAW8Yziqb

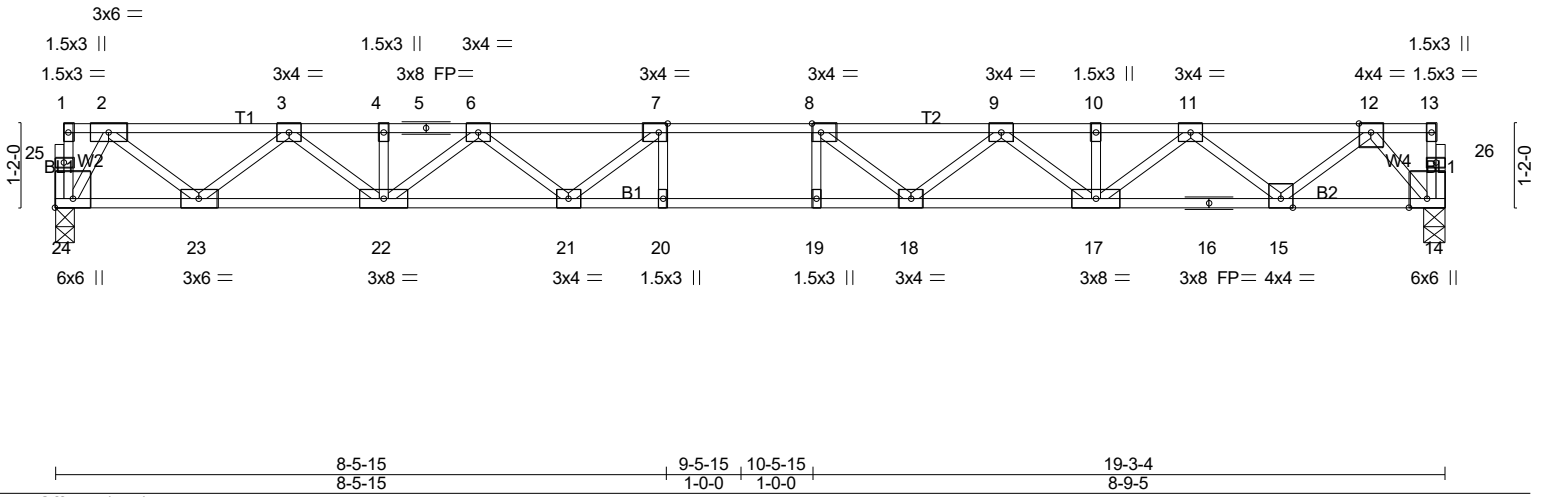



Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [24:Edge,0-3-0]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.46	Vert(LL) -0.31 19-20 >747 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.92	Vert(CT) -0.42 19-20 >542 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.50	Horz(CT) 0.07 14 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH		Weight: 98 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 19-20.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 24=831/0-3-6 (min. 0-1-8), 14=831/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1325/0, 3-4=-2720/0, 4-5=-2720/0, 5-6=-2720/0, 6-7=-3509/0, 7-8=-3788/0, 8-9=-3565/0, 9-10=-2835/0, 10-11=-2835/0, 11-12=-1502/0  
 BOT CHORD 23-24=0/513, 22-23=0/2114, 21-22=0/3233, 20-21=0/3788, 19-20=0/3788, 18-19=0/3788, 17-18=0/3324, 16-17=0/2263, 15-16=0/2263, 14-15=0/717  
 WEBS 7-21=-579/9, 6-21=0/454, 6-22=-656/0, 3-22=0/773, 3-23=-1028/0, 2-23=0/1057, 2-24=-1008/0, 8-18=-531/57, 9-18=0/423, 9-17=-624/0, 11-17=0/730, 11-15=-990/0, 12-15=0/1022, 12-14=-1096/0

**NOTES-** (3)  
 1) Unbalanced floor live loads have been considered for this design.  
 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard





2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F212	Truss Type Floor	Qty 5	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC
					<b># 45591</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:29 2024 Page 1  
ID:pMqJz?gO\_6c5LWfSiGO4QyyWlk-xr3t7VLajEFTMCTp0IRL4iB2BWOFhKiARAv4g?ziqca

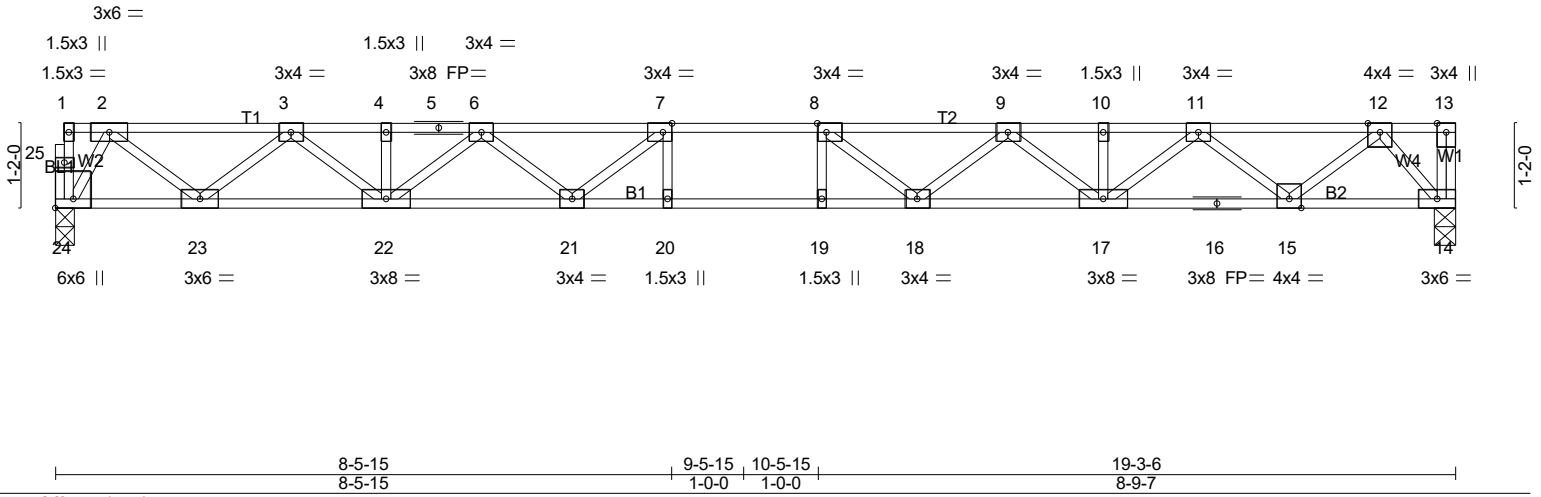

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	1-7-3	TC 0.46	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.92	Vert(LL) -0.31 19-20 >745 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.50	Vert(CT) -0.42 19-20 >541 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.07 14 n/a n/a		
	Code IRC2021/TPI2014			Weight: 99 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 19-20.

**REACTIONS.** (lb/size) 24=832/0-3-6 (min. 0-1-8), 14=837/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1326/0, 3-4=-2722/0, 4-5=-2722/0, 5-6=-2722/0, 6-7=-3512/0, 7-8=-3792/0, 8-9=-3570/0, 9-10=-2841/0, 10-11=-2841/0, 11-12=-1510/0  
BOT CHORD 23-24=0/513, 22-23=0/2116, 21-22=0/3236, 20-21=0/3792, 19-20=0/3792, 18-19=0/3792, 17-18=0/3330, 16-17=0/2270, 15-16=0/2270, 14-15=0/725  
WEBS 7-21=-581/9, 6-21=0/455, 6-22=-656/0, 3-22=0/774, 3-23=-1028/0, 2-23=0/1058, 2-24=-1008/0, 8-18=-531/59, 9-18=0/423, 9-17=-624/0, 11-17=0/730, 11-15=-989/0, 12-15=0/1022, 12-14=-1101/0

**NOTES-** (4)  
1) Unbalanced floor live loads have been considered for this design.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
3) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F213	Truss Type Floor	Qty 3	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC	# 45591
--------------------	---------------	---------------------	----------	----------	---	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:31 2024 Page 1  
ID:pMqJz?gO\_6c5LWISfIG04QyyWik-tDBdYBMqFsVBbWdC7ATp97HP7J5W9EKSvTOAltzqcY

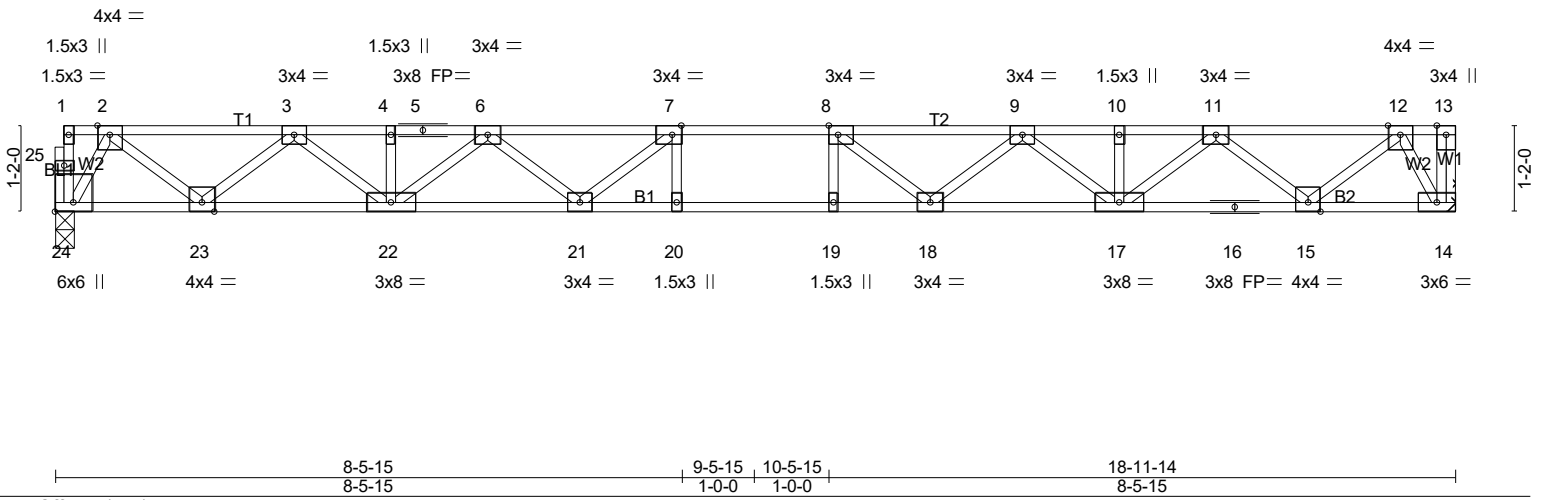



Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [24:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.43	Vert(LL)	-0.29	19-20	>785	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.87	Vert(CT)	-0.40	19-20	>569		
BCLL 0.0	Lumber DOL 1.00	WB 0.49	Horz(CT)	0.07	14	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 98 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 24=819/0-3-6 (min. 0-1-8), 14=824/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1303/0, 3-4=-2667/0, 4-5=-2667/0, 5-6=-2667/0, 6-7=-3426/0, 7-8=-3678/0, 8-9=-3426/0, 9-10=-2667/0, 10-11=-2667/0, 11-12=-1303/0  
BOT CHORD 23-24=0/505, 22-23=0/2077, 21-22=0/3168, 20-21=0/3678, 19-20=0/3678, 18-19=0/3678, 17-18=0/3168, 16-17=0/2077, 15-16=0/2077, 14-15=0/506  
WEBS 7-21=-549/27, 6-21=0/434, 6-22=-640/0, 3-22=0/753, 3-23=-1008/0, 2-23=0/1038, 2-24=-994/0, 8-18=-549/27, 9-18=0/434, 9-17=-640/0, 11-17=0/752, 11-15=-1008/0, 12-15=0/1038, 12-14=-989/0

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Refer to girder(s) for truss to truss connections.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F214	Truss Type FLOOR	Qty 1	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC	# 45591
--------------------	---------------	---------------------	----------	----------	---	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:31 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfiGO4QyyWik-tDBdYBMqFsVBbWdC7ATp97HRXJHF9JiSvTOAltziqcY



Scale = 1:11.5

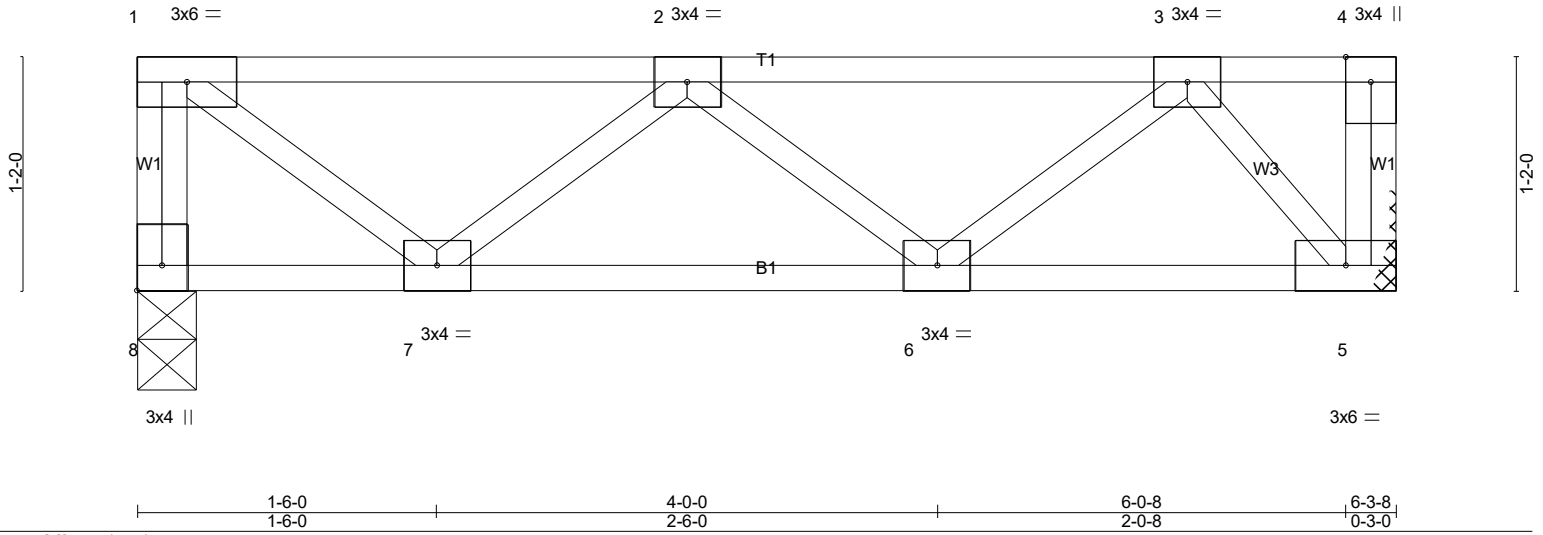


Plate Offsets (X,Y)-- [8:Edge,0-1-8]

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.28	Vert(LL)	-0.01	6	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.12	Vert(CT)	-0.01	6-7	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.00	5	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 35 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 8=332/0-3-8 (min. 0-1-8), 5=332/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-8=-327/0, 1-2=-295/0, 2-3=-422/0  
BOT CHORD 6-7=0/538, 5-6=0/275  
WEBS 1-7=0/370, 2-7=-317/0, 3-5=-416/0

**NOTES-** (3)  
1) Refer to girder(s) for truss to truss connections.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard

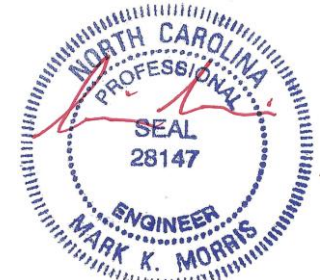


2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.





Scale = 1:35.2

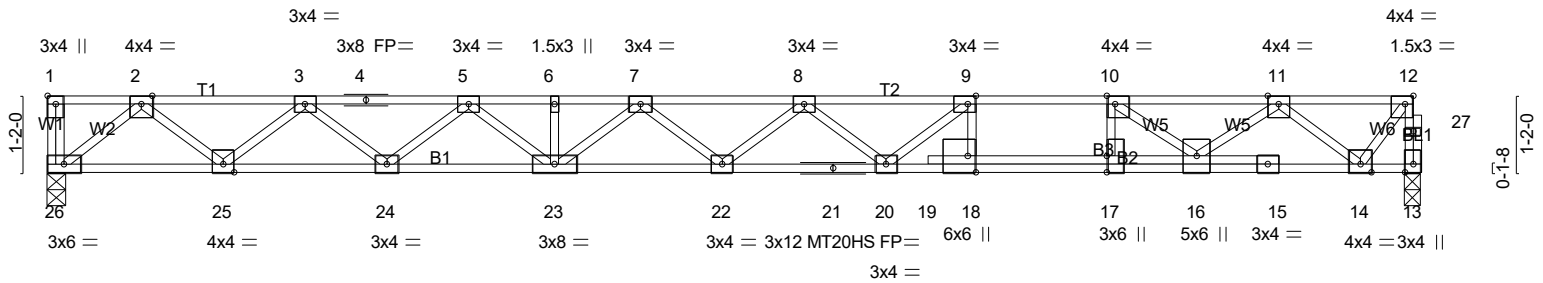

14-2-3 14-2-3	15-2-3 1-0-0	16-2-3 1-0-0
20-11-14 4-9-11		
Plate Offsets (X,Y)-- [1:Edge,0-1-8], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge], [17:0-3-0,0-0-0], [18:0-3-0,Edge]		

<b>LOADING</b> (psf)	<b>SPACING-</b>	1-6-0	<b>CSI.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.64	Vert(LL) -0.43	22	>575	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 1.00	Vert(CT) -0.60	22	>418	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT) 0.08	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					
Weight: 113 lb								FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-7-1 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 18-20.

**REACTIONS.** (lb/size) 26=856/0-3-8 (min. 0-1-8), 13=851/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 13-27=-853/0, 12-27=-851/0, 2-3=-1815/0, 3-4=-3107/0, 4-5=-3107/0, 5-6=-3947/0, 6-7=-3947/0, 7-8=-4218/0, 8-9=-4008/0, 9-10=-3550/0, 10-11=-2316/0, 11-12=-615/0  
BOT CHORD 25-26=0/1025, 24-25=0/2580, 23-24=0/3613, 22-23=0/4175, 21-22=0/4253, 20-21=0/4253, 19-20=0/3550, 18-19=0/3522, 17-18=0/3550, 16-17=0/3550, 15-16=0/1537, 14-15=0/1538  
WEBS 9-18=-545/0, 10-17=0/736, 9-20=-24/716, 8-20=-363/31, 7-23=-292/0, 5-23=0/426, 5-24=-659/0, 3-24=0/685, 3-25=-996/0, 2-25=0/1028, 2-26=-1311/0, 10-16=-1540/0, 11-16=0/987, 11-14=-1202/0, 12-14=0/969

**NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) All plates are MT20 plates unless otherwise indicated.  
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
4) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job 24-1097-F02	Truss F216	Truss Type FLOOR SUPPORTED GABL	Qty 1	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC	# 45591
--------------------	---------------	------------------------------------	----------	----------	---	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:33 2024 Page 1  
ID:pMqJz?gO\_6c5LWfSfGO4QyyWlk-qclOztO4nTlvrqnaFbWHEYMmO7wndBmlMntHqmziqcW

Scale = 1:16.8

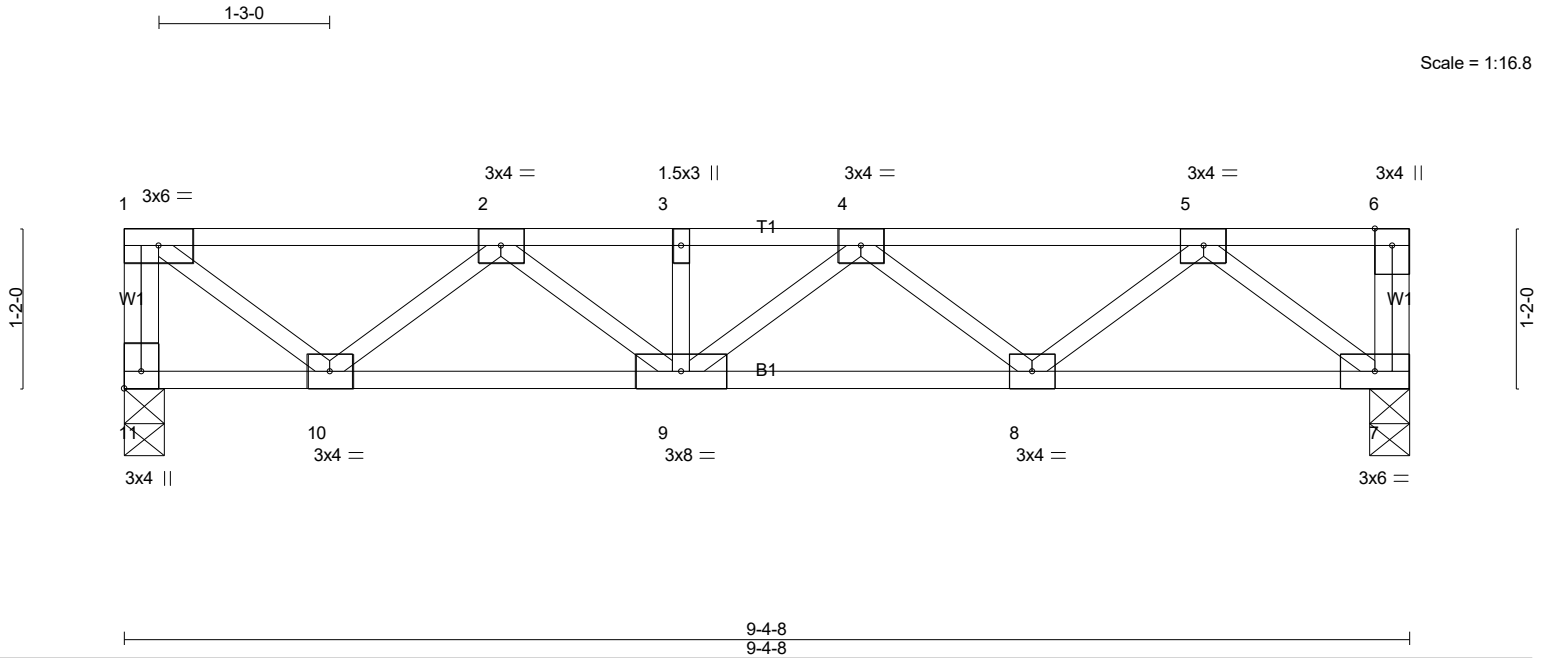


Plate Offsets (X,Y)-- [11:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.02	9	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.24	Vert(CT)	-0.03	8-9	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.31	Horz(CT)	0.01	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 51 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 10-11.

**REACTIONS.** (lb/size) 11=502/0-3-8 (min. 0-1-8), 7=502/0-3-8 (min. 0-1-8)  
Max Uplift 11=-56(LC 6), 7=-56(LC 7)  
Max Grav 11=528(LC 3), 7=528(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-11=-523/60, 1-2=-562/78, 2-3=-1072/0, 3-4=-1072/0, 4-5=-870/6  
BOT CHORD 9-10=-14/954, 8-9=0/1109, 7-8=-75/627  
WEBS 1-10=-121/723, 2-10=-648/149, 2-9=-206/315, 4-9=-253/254, 4-8=-434/199, 5-8=-153/479, 5-7=-804/118

- NOTES-** (5)  
1) Unbalanced floor live loads have been considered for this design.  
2) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 11 and 56 lb uplift at joint 7.  
3) This truss has been designed for a total drag load of 150 plf. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 0-0-0 to 9-4-8 for 150.0 plf.  
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

**LOAD CASE(S)** Standard




2/20/2024


**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1097-F02	Truss F217	Truss Type Floor	Qty 3	Ply 1	LOT 0.0001 HONEYCUTT HILLS   17 SHELBY MEADOW LANE ANGIER, NC	# 45591
--------------------	---------------	---------------------	----------	----------	---	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 21 19:33:34 2024 Page 1  
ID:pMqJz?gO\_6c5LWiSfiGO4QyyWlk-losmACPjYntIS\_Lno11Wnmvy4XC0MdfvbRdrMCzicqV



Scale = 1:19.0

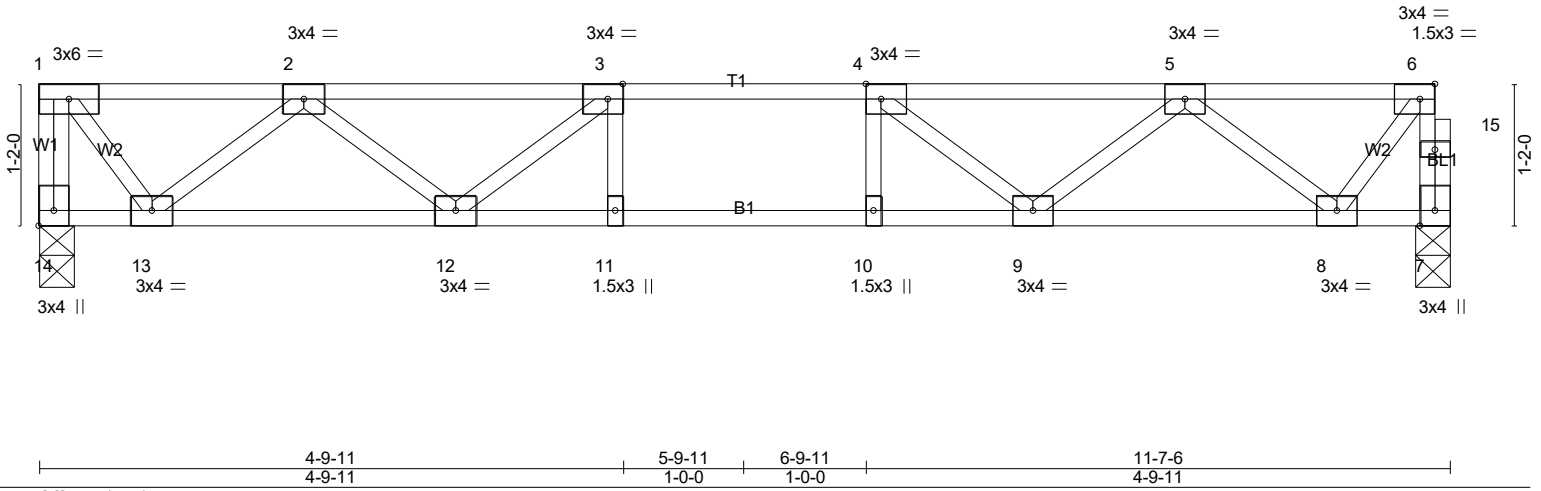

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.26	Vert(LL)	-0.08 9-10	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.50	Vert(CT)	-0.09 9-10	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.33	Horz(CT)	0.02 7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 60 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 14=625/0-3-8 (min. 0-1-8), 7=619/0-3-6 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-14=-624/0, 7-15=-619/0, 6-15=-618/0, 1-2=-424/0, 2-3=-1373/0, 3-4=-1681/0, 4-5=-1373/0, 5-6=-426/0  
BOT CHORD 12-13=0/1056, 11-12=0/1681, 10-11=0/1681, 9-10=0/1681, 8-9=0/1055  
WEBS 3-12=-476/0, 2-12=0/413, 2-13=-822/0, 1-13=0/693, 4-9=-476/0, 5-9=0/414, 5-8=-818/0, 6-8=0/669

- NOTES-** (4)  
1) Unbalanced floor live loads have been considered for this design.  
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.  
3) CAUTION, Do not erect truss backwards.

**LOAD CASE(S)** Standard



2/20/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.