

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 47335

JOB: 24-2501-F02

JOB NAME: LOT 0.0007 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

23 Truss Design(s)

Trusses:

F2-01, F2-02, F2-03, F2-04, F2-05, F2-06, F2-07, F2-08, F2-10, F2-12, F2-14, F2-15, F2-16, F2-17, F2-18, F2-19, F2-20, F2-21, F2-22, F2-23, F2-24, F2-25, F2-26



4/6/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for*

Job 24-2501-F02	Truss F2-01	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:30 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-slhTY3l20sY_vktYNRhGEUR9U?P2hzeFBnWmmMzT1oN

0-1-8

Scale = 1:11.0

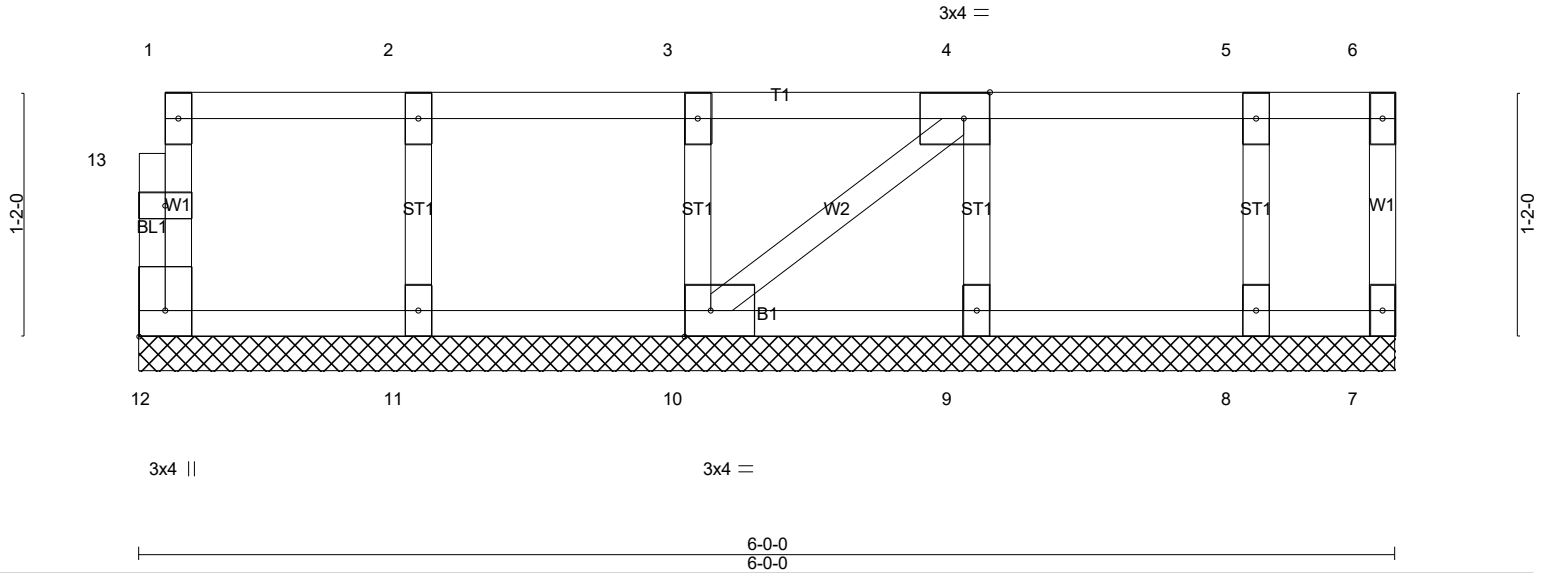


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [10:0-1-8,Edge], [12:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 7 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P			
				Weight: 29 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 6-0-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 12, 7, 11, 10, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-02	Floor Girder	1	1	Job Reference (optional) # 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:31 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-KyFrIPJgnAgrXtSkw8CVnizCfPkFQQHQQRfJlpzT1oM

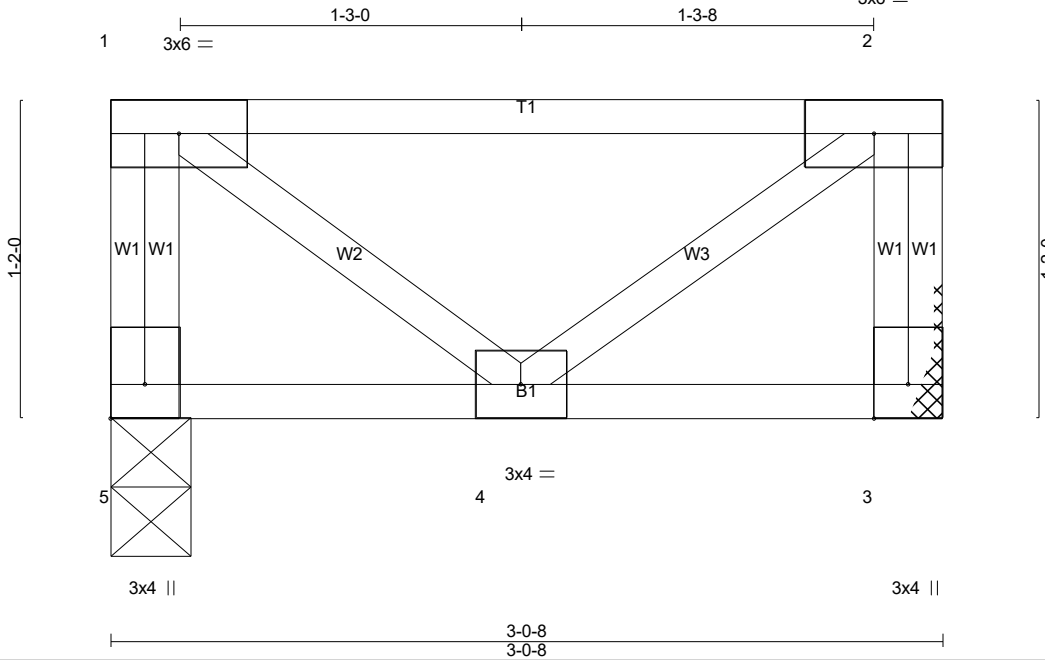

Scale = 1:8.4

Plate Offsets (X,Y)-- [5:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.54	Vert(LL)	-0.00	4	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	-0.00	4	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.01	Horz(CT)	0.00	3	n/a	n/a		
BCDL 5.0	Rep Stress Incr NO	Matrix-P							
	Code IRC2021/TPI2014							Weight: 19 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-0-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 5=154/0-3-8 (min. 0-1-8), 3=154/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (3)
1) Refer to girder(s) for truss to truss connections.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-03	Floor Supported Gable	1	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:32 2024 Page 1
 ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-p8pDyIKIXUoi811xUsjkJvWV_p4W9t7Yf5?trFzT1oL

0₁-8

Scale = 1:25.2

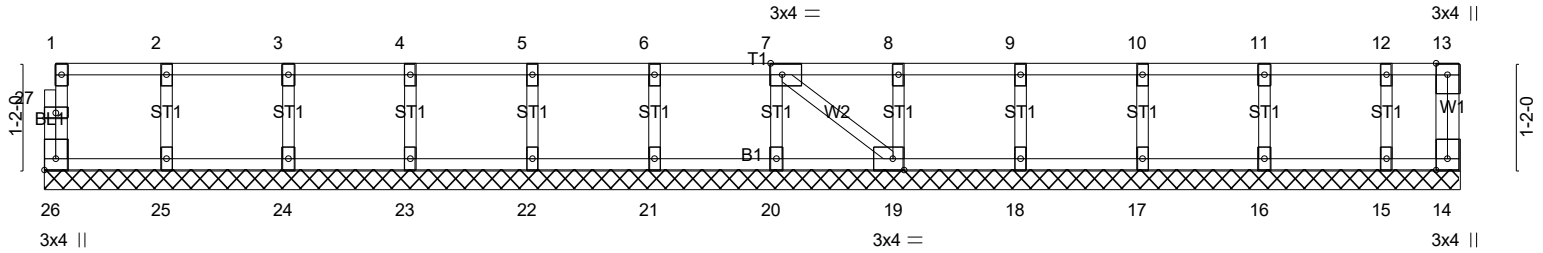


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [19:0-1-8,Edge], [26:Edge,0-1-8]
--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 68 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 15-5-8.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-04	Truss Type Floor	Qty 1	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:33 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-HKNbA5LxlnwZmBc72ZEzs72bcCHbuDkhulkQNhzt1oK


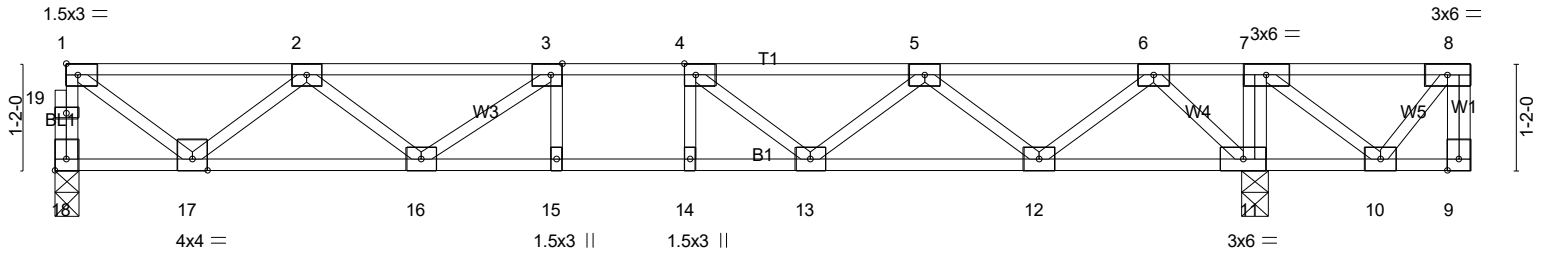


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [18:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.32	Vert(LL) -0.10 14 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.59	Vert(CT) -0.13 14 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.46	Horz(CT) 0.03 11 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 81 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12,10-11.

REACTIONS. (lb/size) 18=687/0-3-0 (min. 0-1-8), 11=980/0-3-8 (min. 0-1-8)
Max Grav 18=702(LC 3), 11=980(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 18-19=-698/0, 1-19=-697/0, 1-2=-793/0, 2-3=-1805/0, 3-4=-2177/0, 4-5=-1999/0, 5-6=-1231/0
BOT CHORD 16-17=0/1480, 15-16=0/2177, 14-15=0/2177, 13-14=0/2177, 12-13=0/1783, 11-12=-52/655
WEBS 7-11=-303/0, 1-17=0/959, 2-17=-895/0, 2-16=0/424, 3-16=-533/0, 4-13=-425/7, 5-13=0/365, 5-12=-744/0, 6-12=0/777, 6-11=-975/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-05	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 47335
--------------------	----------------	----------------------------	----------	----------	--	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:33 2024 Page 1
ID: oDuW00MhLxMOj2fwcp2akqzMG6w-HKNbA5LxlnwZmBc72ZEzs72beCP5ulDhulkQNhzt1oK



Scale = 1:11.8

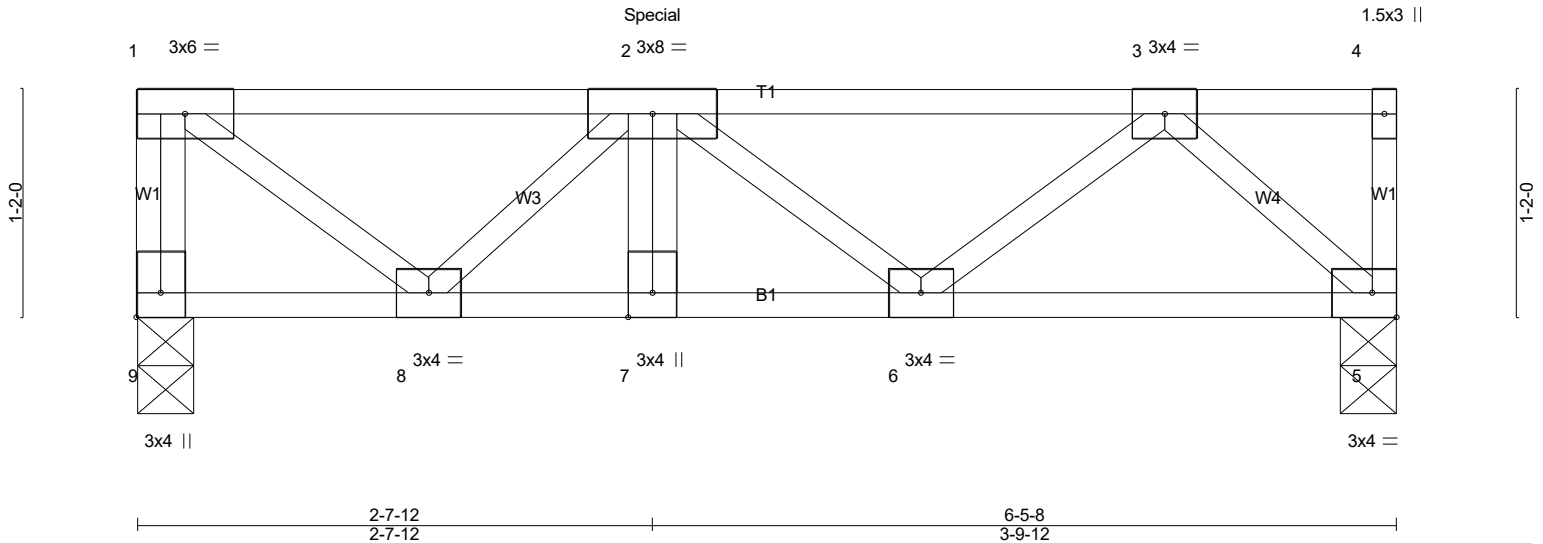


Plate Offsets (X,Y)-- [9:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.01	7	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.11	Vert(CT)	-0.01	7	>999	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.17	Horz(CT)	0.00	5	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 37 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 9=319/0-3-8 (min. 0-1-8), 5=328/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-9=-313/0, 1-2=-283/33, 2-3=-422/0
BOT CHORD 7-8=-76/502, 6-7=-76/502, 5-6=0/318
WEBS 1-8=-41/356, 2-8=-295/58, 3-5=-434/0

NOTES- (6)

- Unbalanced floor live loads have been considered for this design.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 447 lb up at 2-7-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-9=-10, 1-4=-100
Concentrated Loads (lb)
Vert: 2=43(F)




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-06	Floor	1	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:35 2024 Page 1
 ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-DjUMbnMBqPAH?VmVW9_GRxY8wh0_DM8a_L3DXRazT1oI

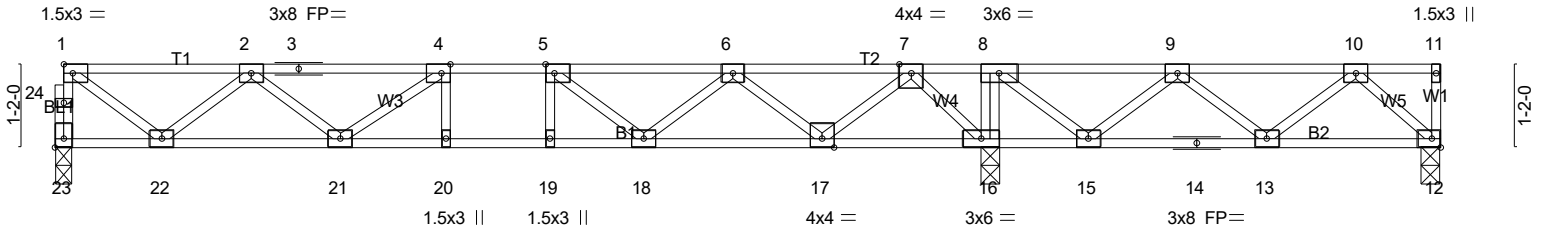

1-6-0	4-0-0	5-6-8	6-2-8	6-10-8	8-3-0	10-9-0	12-11-12	13-1-4	14-5-12	16-11-12	19-3-8	19-5-0
1-6-0	2-6-0	1-6-8	0-8-0	0-8-0	1-4-8	2-6-0	2-2-12	0-1-8	1-4-8	2-6-0	2-3-12	0-1-8
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [23:Edge,0-1-8]												

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.07	20	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.10	20	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.02	16	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 99 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 23=595/0-3-0 (min. 0-1-8), 12=111/0-3-8 (min. 0-1-8), 16=1403/0-3-8 (min. 0-1-8)
 Max Uplift 12=123(LC 3)
 Max Grav 23=603(LC 3), 12=264(LC 4), 16=1403(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 23-24=-597/0, 1-24=-596/0, 1-2=-664/0, 2-3=-1438/0, 3-4=-1438/0, 4-5=-1604/0, 5-6=-1234/0, 7-8=0/1341, 8-9=0/919, 9-10=-282/360
 BOT CHORD 21-22=0/1242, 20-21=0/1604, 19-20=0/1604, 18-19=0/1604, 17-18=0/887, 16-17=-573/0, 15-16=-1341/0, 14-15=-608/281, 13-14=-608/281
 WEBS 8-16=-631/0, 1-22=0/802, 2-22=-752/0, 2-21=0/256, 4-21=-278/0, 5-18=-514/0, 6-18=0/463, 6-17=-874/0, 7-17=0/913, 7-16=-1122/0, 8-15=0/724, 9-15=-665/0, 9-13=0/323, 10-13=-277/43, 10-12=-339/201

- NOTES-** (6)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 12.
 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard





4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-07	Floor	1	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:36 2024 Page 1
 ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-hv2ko7Npbil8dfLijhogUlG5TQKU5bq7ajz4_OzT1oH

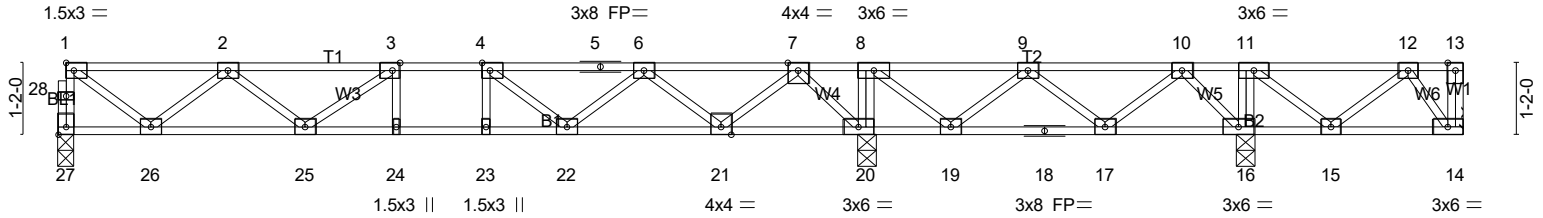

1-6-0	4-0-0	5-6-8	6-2-86-10-8	8-3-0	10-9-0	12-11-12	13-1-4	14-5-12	16-11-12	19-1-12	19-3-4	22-6-8	22-9-8
1-6-0	2-6-0	1-6-8	0-8-0 0-8-0	1-4-8	2-6-0	2-2-12	0-1-8 1-4-8		2-6-0	2-2-0	0-1-8 1-4-8	1-10-12	0-3-0

Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.07 24-25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.10 24-25	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.02 20	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
									Weight: 119 lb FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 0-3-8 except (jt=length) 27=0-3-0, 14=Mechanical.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) 14
 Max Grav All reactions 250 lb or less at joint(s) 14 except 27=602(LC 5), 20=1391(LC 3), 16=554(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 27-28=-596/0, 1-28=-595/0, 1-2=-663/0, 2-3=-1436/0, 3-4=-1601/0, 4-5=-1229/0,
 5-6=-1229/0, 7-8=0/1335, 8-9=0/903, 9-10=-155/305
 BOT CHORD 25-26=0/1240, 24-25=0/1601, 23-24=0/1601, 22-23=0/1601, 21-22=0/882, 20-21=-564/0,
 19-20=-1335/0, 18-19=-570/203, 17-18=-570/203
 WEBS 8-20=-620/0, 11-16=-312/0, 1-26=0/801, 2-26=-751/0, 2-25=0/257, 3-25=-280/0,
 4-22=-510/0, 6-22=0/462, 6-21=-873/0, 7-21=0/912, 7-20=-1124/0, 8-19=0/707,
 9-19=-648/0, 9-17=-75/345, 10-17=-302/113, 10-16=-361/288, 12-14=-288/13

NOTES- (7)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Refer to girder(s) for truss to truss connections.
 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14.
 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 6) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

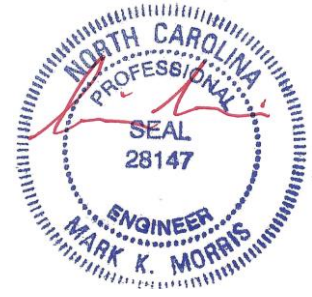

4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-08	Truss Type Floor	Qty 3	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:38 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-dIAUDpO37KYssyV4r6q8ZAmQcD?fZVBQ11SB2vzT1oF


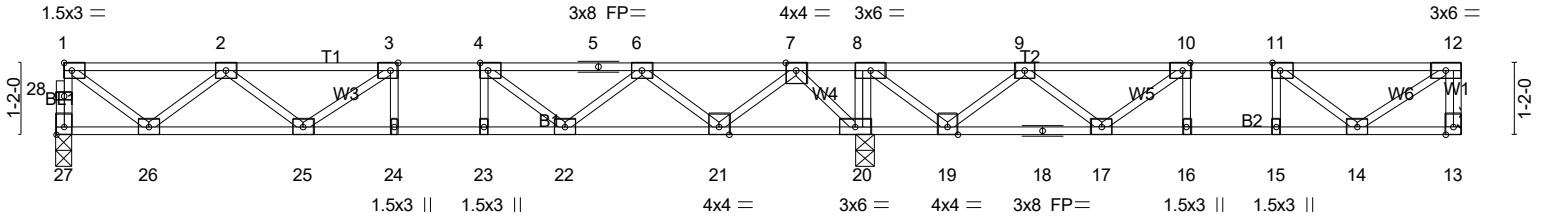



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.43	Vert(LL) -0.07	24	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.54	Vert(CT) -0.10	24	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.44	Horz(CT) 0.02	20	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 116 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 27=591/0-3-0 (min. 0-1-8), 13=370/Mechanical, 20=1512/0-3-8 (min. 0-1-8)
Max Grav 27=622(LC 10), 13=443(LC 4), 20=1512(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 27-28=-616/0, 1-28=-615/0, 12-13=-434/0, 1-2=-689/0, 2-3=-1508/0, 3-4=-1714/0,
4-5=-1380/0, 5-6=-1380/0, 6-7=-420/281, 7-8=0/1473, 8-9=0/785, 9-10=-672/315,
10-11=-863/85, 11-12=-474/6
BOT CHORD 25-26=0/1287, 24-25=0/1714, 23-24=0/1714, 22-23=0/1714, 21-22=-72/1059, 20-21=-687/0,
19-20=-1473/0, 18-19=-507/462, 17-18=-507/462, 16-17=-85/863, 15-16=-85/863,
14-15=-85/863
WEBS 8-20=-737/0, 1-26=0/832, 2-26=-779/0, 2-25=0/288, 3-25=-261/40, 4-22=-562/0,
6-22=0/483, 6-21=-891/0, 7-21=0/930, 7-20=-1090/0, 8-19=0/904, 9-19=-828/0,
9-17=0/398, 10-17=-467/0, 11-14=-496/101, 12-14=-7/570

- NOTES-** (6)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-10	Truss Type Floor	Qty 12	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	---------------------	-----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:39 2024 Page 1
ID:oDuWOOmHlXMOj2fwcp2aKqzMG6w-5UktQ8PhudgJlU63HOqLn5OlcndJilzQaGhBkaLzT1oE


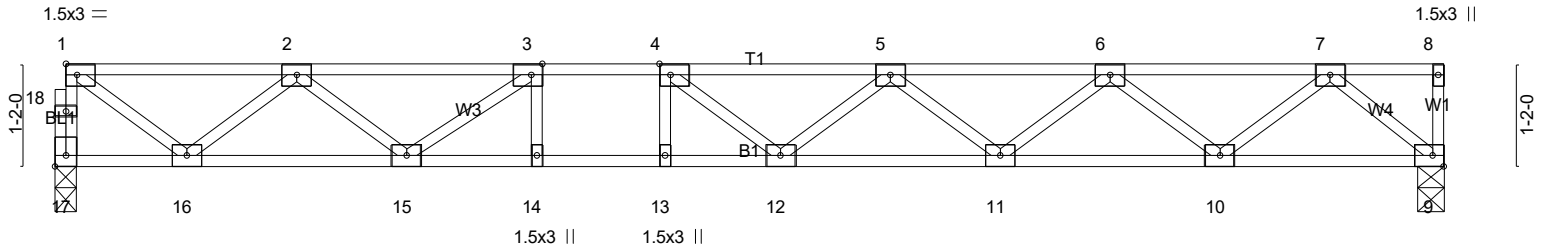


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [17:Edge,0-1-8]					
LOADING (psf)	SPACING- 1-4-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.34	Vert(LL) -0.15 12-13 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.68	Vert(CT) -0.20 12-13 >940 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.38	Horz(CT) 0.03 9 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 79 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 17=568/0-3-0 (min. 0-1-8), 9=572/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 17-18=-567/0, 1-18=-566/0, 1-2=-659/0, 2-3=-1574/0, 3-4=-2032/0, 4-5=-2106/0, 5-6=-1842/0, 6-7=-1123/0
 BOT CHORD 15-16=0/1228, 14-15=0/2032, 13-14=0/2032, 12-13=0/2032, 11-12=0/2093, 10-11=0/1580, 9-10=0/643
 WEBS 1-16=0/798, 2-16=-741/0, 2-15=0/451, 3-15=-586/0, 5-11=-326/0, 6-11=0/341, 6-10=-595/0, 7-10=0/625, 7-9=-842/0

- NOTES-** (5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-12	Floor	2	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:40 2024 Page 1
 ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-aglFeUQKfxpa6GeTyXscebrnW1f_107jVLxI7nzT1oD

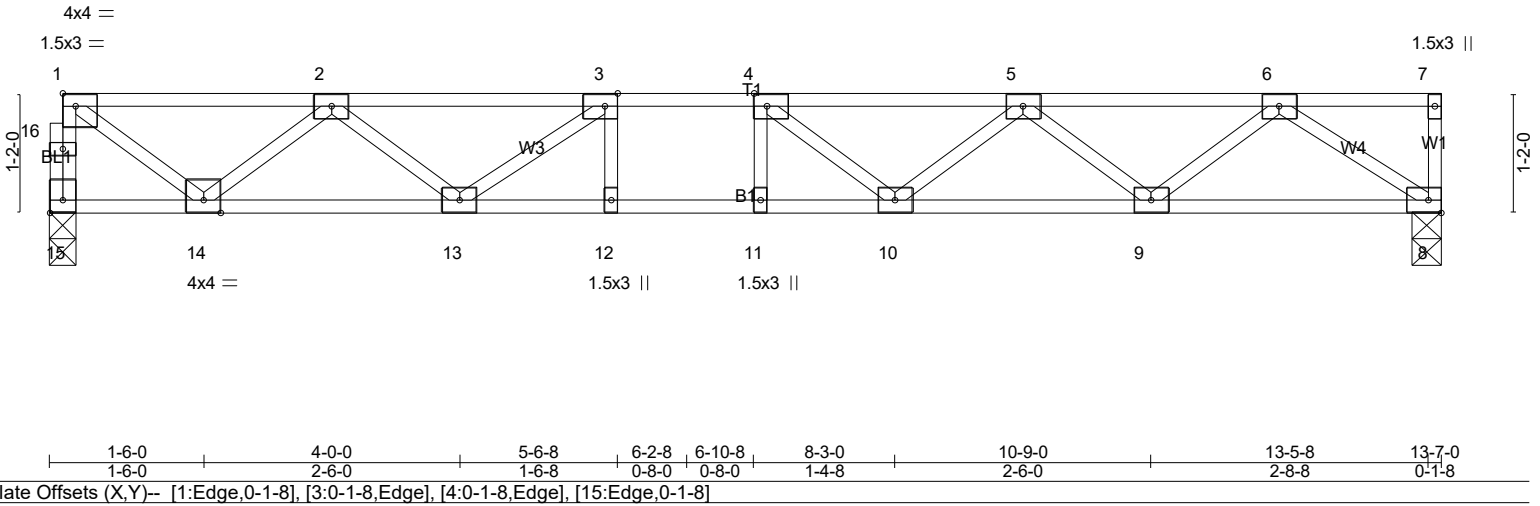

1-6-0	4-0-0	5-6-8	6-2-8	6-10-8	8-3-0	10-9-0	13-5-8	13-7-0
1-6-0	2-6-0	1-6-8	0-8-0	0-8-0	1-4-8	2-6-0	2-8-8	0-1-8
Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [15:Edge,0-1-8]								

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.34	Vert(LL) -0.11	11	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.67	Vert(CT) -0.15	10-11	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.48	Horz(CT) 0.03	8	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 15=731/0-3-0 (min. 0-1-8), 8=737/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-16=-727/0, 1-16=-726/0, 1-2=-830/0, 2-3=-1911/0, 3-4=-2344/0, 4-5=-2219/0, 5-6=-1527/0
 BOT CHORD 13-14=0/1549, 12-13=0/2344, 11-12=0/2344, 10-11=0/2344, 9-10=0/2043, 8-9=0/979
 WEBS 1-14=0/1004, 2-14=-936/0, 2-13=0/471, 3-13=-600/0, 4-10=-349/69, 5-10=0/309, 5-9=-672/0, 6-9=0/713, 6-8=-1186/0

NOTES- (5)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




4/6/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-14	Truss Type FLOOR	Qty 8	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:41 2024 Page 1
ID: oDuWOOmHxMOj2fwcp2aKqzMG6w-2tsdrqRyQFqJQDfWFNRbPoxR1amr4sj?grfEzT1oC



Scale = 1:26.2

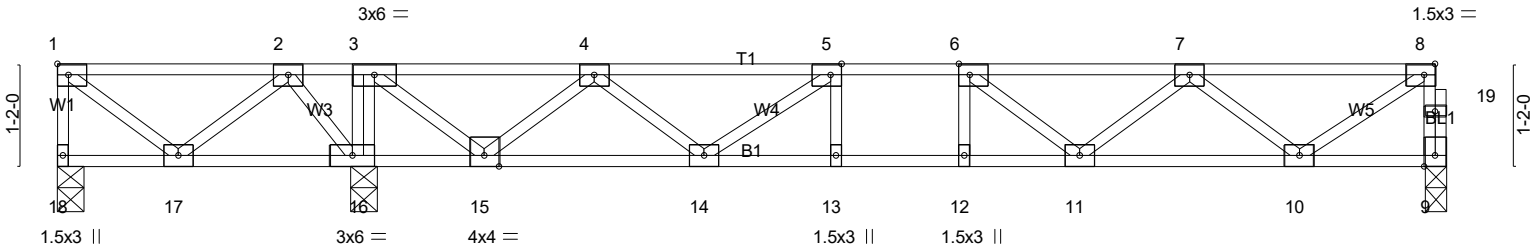

1-4-8	3-4-4	3-5-12	4-10-4	7-4-4	8-11-0	9-7-0	10-3-0	11-7-8	14-1-8	15-9-8
1-4-8	1-11-12	0-1-8	1-4-8	2-6-0	1-6-12	0-8-0	0-8-0	1-4-8	2-6-0	1-8-0

Plate Offsets (X,Y)-- [5:0-1-8,Edge], [6:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.43	Vert(LL)	-0.07 11-12	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.52	Vert(CT)	-0.09 11-12	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.50	Horz(CT)	0.01 9	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 81 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 16-17,15-16.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=-159/0-3-8 (min. 0-1-8), 9=567/0-3-0 (min. 0-1-8), 16=1302/0-3-8 (min. 0-1-8)
Max Uplift 18=-288(LC 4)
Max Grav 18=87(LC 3), 9=569(LC 4), 16=1302(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-82/292, 9-19=-562/0, 8-19=-561/0, 1-2=0/396, 2-3=0/1084, 3-4=0/326, 4-5=-906/0, 5-6=-1403/0, 6-7=-1338/0, 7-8=-679/0
BOT CHORD 16-17=-792/0, 15-16=-1084/0, 14-15=0/502, 13-14=0/1403, 12-13=0/1403, 11-12=0/1403, 10-11=0/1205
WEBS 3-16=-806/0, 1-17=-505/0, 2-17=0/515, 2-16=-642/0, 3-15=0/1045, 4-15=-957/0, 4-14=0/529, 5-14=-609/0, 7-10=-684/0, 8-10=0/790

- NOTES-** (6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=288.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-15	Floor Supported Gable	1	1	Job Reference (optional) # 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:41 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-2tsdrqRyQFxDjQdWfNrbpO1jR9dmyMsj?grfEzT1Oc

0₁1₈

Scale = 1:25.0

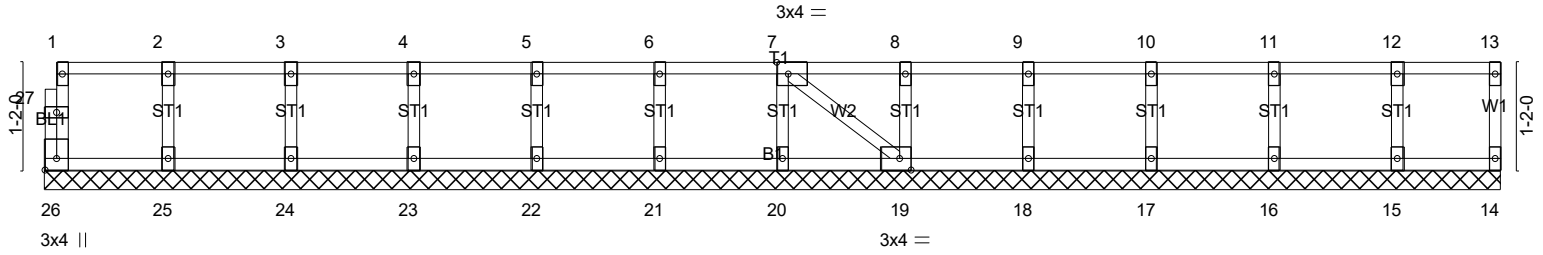

15-9-8
15-9-8

Plate Offsets (X,Y)-- [7:0-1-8,Edge], [19:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-9-8.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-16	Floor Supported Gable	1	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:42 2024 Page 1
 ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-W3P?3ARaBY3HLaos4yv4j0wBlrVrVPZ0yfQOBgzT10B

Scale = 1:29.4

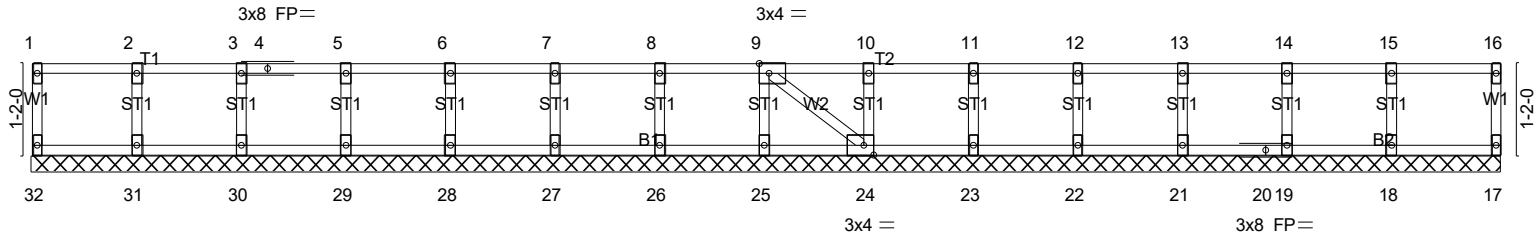

18-8-12
18-8-12

Plate Offsets (X,Y)-- [9:0-1-8,Edge], [24:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Horz(CT)	0.00	24	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 78 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 18-8-12.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 17, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21, 19, 18

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6)
 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 2) Gable requires continuous bottom chord bearing.
 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 4) Gable studs spaced at 1-4-0 oc.
 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-17	Truss Type Floor	Qty 9	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC	# 47335
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:43 2024 Page 1
ID:oDuWOOmHxMOj2fwcp2aKqzMG6w-_FzNGWSCysB8zjN2dfQJGETI4EIEEmF9BJ9yj6zT1oA



Scale = 1:31.2


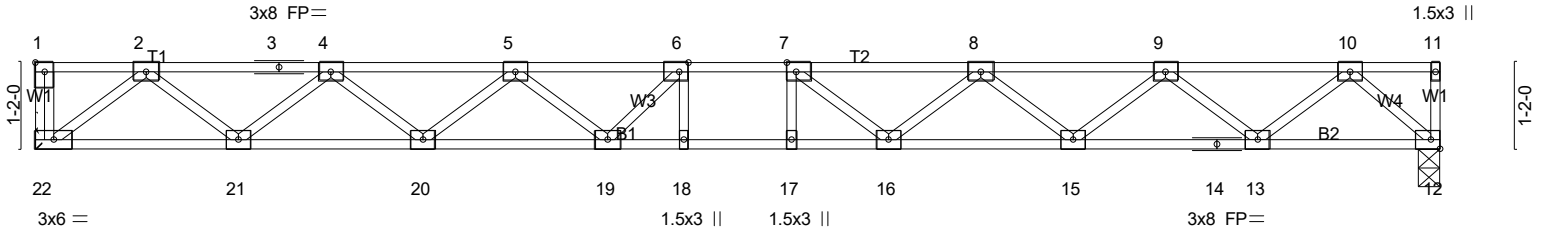


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [6:0-1-8,Edge], [7:0-1-8,Edge]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.32	Vert(LL)	-0.24	17	>926	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.64	Vert(CT)	-0.34	17-18	>673		
BCLL 0.0	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.06	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 95 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 22=691/Mechanical, 12=691/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1475/0, 3-4=-1475/0, 4-5=-2448/0, 5-6=-2979/0, 6-7=-3109/0, 7-8=-2945/0, 8-9=-2382/0, 9-10=-1368/0
BOT CHORD 21-22=0/863, 20-21=0/2064, 19-20=0/2811, 18-19=0/3109, 17-18=0/3109, 16-17=0/3109, 15-16=0/2768, 14-15=0/1976,
13-14=0/1976, 12-13=0/739
WEBS 2-22=-1083/0, 2-21=0/796, 4-21=-767/0, 4-20=0/499, 5-20=-474/0, 5-19=0/321, 6-19=-366/80, 7-16=-382/56,
8-16=0/317, 8-15=-504/0, 9-15=0/528, 9-13=-791/0, 10-13=0/819, 10-12=-994/0

NOTES- (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-18	Floor	4	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:44 2024 Page 1
 ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-SSXIUsTqjAJ?atyEBNxYoR0QCexPz5OJQzvVGZzT1o9



Scale = 1:31.1


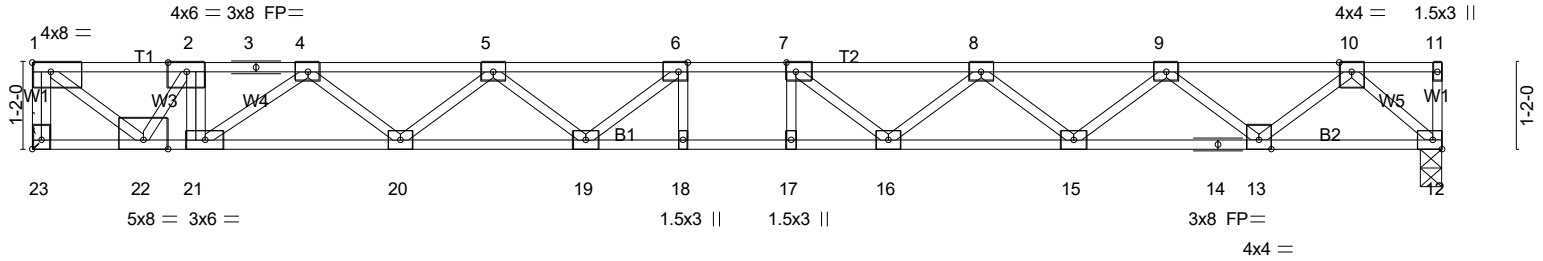


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [6:0-1-8,Edge], [7:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.55	Vert(LL)	-0.24	17-18	>924	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.96	Vert(CT)	-0.42	18	>533	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.91	Horz(CT)	0.07	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 98 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 23=1224/Mechanical, 12=757/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-23=-1215/0, 1-2=-1522/0, 2-3=-2307/0, 3-4=-2307/0, 4-5=-3246/0, 5-6=-3664/0, 6-7=-3710/0, 7-8=-3416/0,
 8-9=-2692/0, 9-10=-1521/0
 BOT CHORD 21-22=0/2307, 20-21=0/2900, 19-20=0/3572, 18-19=0/3710, 17-18=0/3710, 16-17=0/3710, 15-16=0/3152, 14-15=0/2210,
 13-14=0/2210, 12-13=0/811
 WEBS 2-21=0/424, 7-16=-551/0, 8-16=0/432, 8-15=-598/0, 9-15=0/628, 9-13=-897/0, 10-13=0/923, 10-12=-1092/0,
 1-22=0/1910, 2-22=-1395/0, 5-20=-425/0, 4-20=0/450, 4-21=-721/0

NOTES- (7)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 12-23=-7, 1-11=-67
 Concentrated Loads (lb)
 Vert: 2=-600
- Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 12-23=-7, 1-11=-67
 Concentrated Loads (lb)
 Vert: 2=-600
- 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 12-23=-7, 1-7=-67, 7-11=-13
 Concentrated Loads (lb)
 Vert: 2=-600



4/6/2024

Continued on Page 2 Design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-18	Floor	4	1	Job Reference (optional) # 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:44 2024 Page 2
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-SSXlUsTqAJ?atyEBNxYoR0QCexPz5OJQzvVGZzT1o9

LOAD CASE(S) Standard

- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 12-23=-7, 1-6=-13, 6-11=-67
 - Concentrated Loads (lb)
 - Vert: 2=-600
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 12-23=-7, 1-7=-67, 7-11=-13
 - Concentrated Loads (lb)
 - Vert: 2=-600
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 12-23=-7, 1-6=-13, 6-11=-67
 - Concentrated Loads (lb)
 - Vert: 2=-600




4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D’Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-19	Floor	2	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:46 2024 Page 1
ID:oDuW00MhLxM0j2fwcp2aKqzMG6w-OqfWuYV4EnZjqB6dJoz0us5pgSflR0wbtGOcKRzT1o7



Scale = 1:31.3

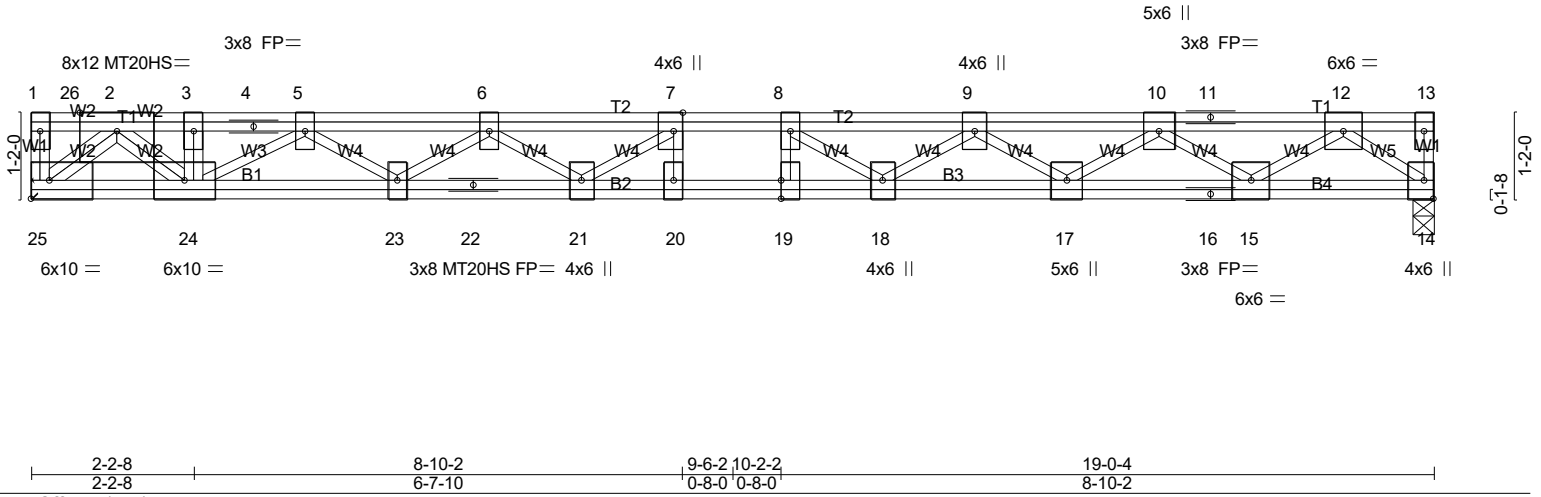


Plate Offsets (X,Y)-- [7:0-3-0,Edge], [19:0-3-0,0-0-0]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.36	Vert(LL)	-0.16	19	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.84	Vert(CT)	-0.43	20-21	>529	360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	NO	WB 0.84	Horz(CT)	0.06	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 152 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 25=3409/Mechanical, 14=957/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-25=-376/0, 2-3=-6025/0, 3-4=-6105/0, 4-5=-6105/0, 5-6=-6669/0, 6-7=-6578/0, 7-8=-6203/0, 8-9=-5446/0, 9-10=-4078/0, 10-11=-2226/0, 11-12=-2226/0
BOT CHORD 24-25=0/3409, 23-24=0/6544, 22-23=0/6775, 21-22=0/6775, 20-21=0/6203, 19-20=0/6203, 18-19=0/6203, 17-18=0/4848, 16-17=0/3274, 15-16=0/3274, 14-15=0/1159
WEBS 3-24=-2135/0, 7-20=-361/0, 8-19=0/373, 8-18=-1108/0, 9-18=0/837, 9-17=-955/0, 10-17=0/997, 10-15=-1300/0, 12-15=0/1323, 12-14=-1479/0, 2-25=-4541/0, 2-24=0/3537, 7-21=0/748, 6-21=-444/0, 5-24=-511/0

NOTES- (8)

- Unbalanced floor live loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 3x6 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-157, 3-13=-67
Concentrated Loads (lb)
Vert: 3=-2188 26=-610
- Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-157, 3-13=-67
Concentrated Loads (lb)
Vert: 3=-2188 26=-610
- 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-157, 3-8=-67, 8-13=-13



4/6/2024

Continued on Page 2 Design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-19	Floor	2	1	Job Reference (optional) # 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:46 2024 Page 2
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-OqfWuYV4EnZjqB6dJoz0us5pgSflR0wbtGOcKRzT1o7

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 3=-2188 26=-610
- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-103, 3-7=-13, 7-13=-67
Concentrated Loads (lb)
Vert: 3=-2188 26=-610
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-157, 3-8=-67, 8-13=-13
Concentrated Loads (lb)
Vert: 3=-2188 26=-610
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-25=-7, 1-3=-103, 3-7=-13, 7-13=-67
Concentrated Loads (lb)
Vert: 3=-2188 26=-610



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-20	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:47 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-s1Du6uVj?5haSLhpsVUFQ4ewOsCxAdBl6w79stzT1o6

Scale = 1:30.6

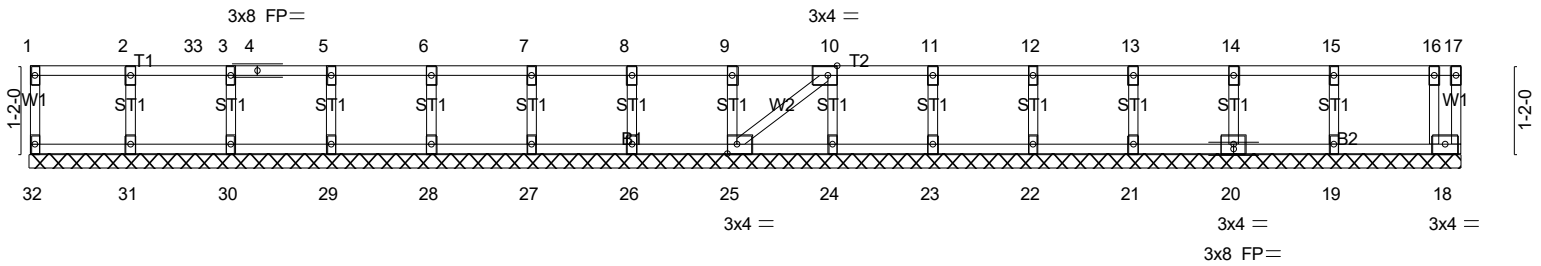


Plate Offsets (X,Y)-- [10:0-1-8,Edge], [25:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.62	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.14	Horz(CT)	0.00	18	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 81 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 19-0-4.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 18, 29, 28, 27, 26, 25, 24, 23, 22, 21, 20, 19 except
31=387(LC 1), 30=615(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-31=-372/0, 3-30=-602/0

NOTES- (7)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Load case(s) 1, 2 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 18-32=-10, 1-17=-100
Concentrated Loads (lb)
Vert: 33=-600
2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 18-32=-10, 1-17=-100
Concentrated Loads (lb)
Vert: 33=-600



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-21	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 47335
--------------------	----------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:47 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-s1Du6uVj?5haSLhpsVUFQ4e3NsC2Afw6w79stzT1o6
3x4 =

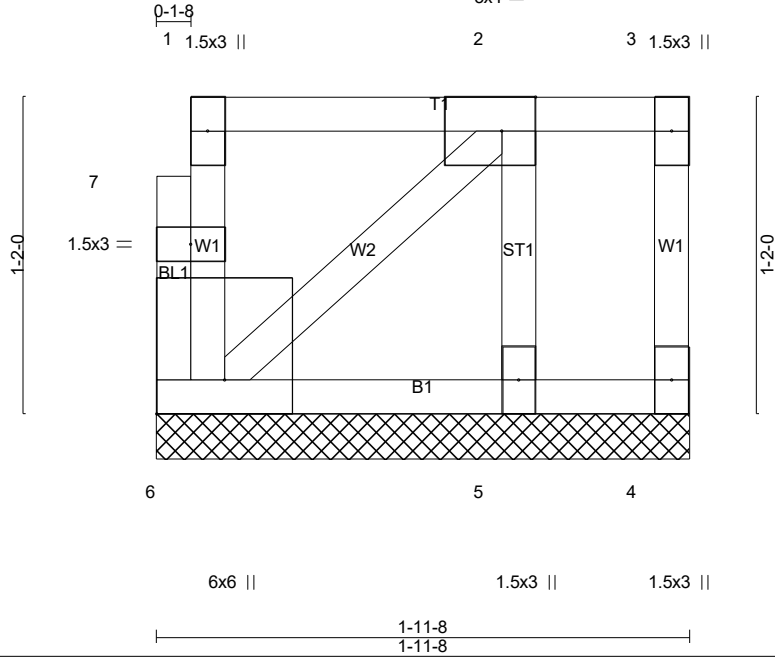


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [6:Edge,0-3-0]		CSI.		DEFL.		PLATES		GRIP	
LOADING (psf)	SPACING-	2-0-0	TC	0.05	in (loc)	l/defl	L/d	MT20	244/190
TCLL 40.0	Plate Grip DOL	1.00	BC	0.01	Vert(LL)	n/a -	n/a		
TCDL 10.0	Lumber DOL	1.00	WB	0.03	Vert(CT)	n/a -	n/a		
BCLL 0.0	Rep Stress Incr	YES	Matrix-P		Horz(CT)	0.00	n/a		
BCDL 5.0	Code IRC2021/TPI2014							Weight: 13 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 1-11-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 4=8/1-11-8 (min. 0-1-8), 6=50/1-11-8 (min. 0-1-8), 5=131/1-11-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-22	Truss Type Floor	Qty 3	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 47335
--------------------	----------------	---------------------	----------	----------	--	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:48 2024 Page 1
ID: oDuWOOMhLxMOj2fwcp2aKqzMG6w-LDnGJDWLMOpR3VG?QD?UzHA8yFOuv_euKatjPKzT1o5

0-1-8

0-3-1
Scale = 1:35.6

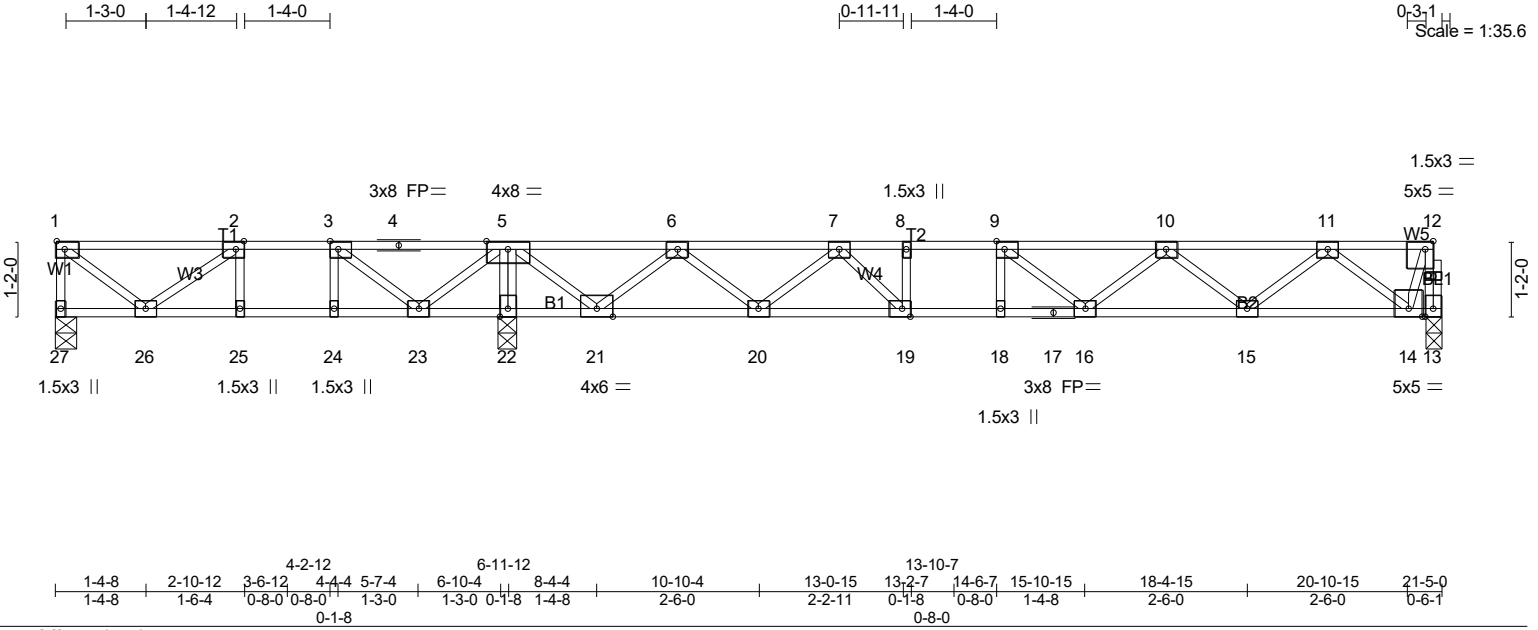


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,Edge], [12:0-1-8,Edge], [19:0-1-8,Edge]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.44	Vert(LL) -0.13 16-18 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.67	Vert(CT) -0.17 16-18 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.57	Horz(CT) 0.03 13 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 109 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=222/0-3-8 (min. 0-1-8), 13=710/0-3-0 (min. 0-1-8), 22=1403/0-3-8 (min. 0-1-8)
Max Uplift 27=-46(LC 4)
Max Grav 27=327(LC 3), 13=724(LC 7), 22=1403(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-27=-328/37, 12-13=-729/0, 1-2=-259/94, 2-3=-475/327, 3-4=-74/687, 4-5=-74/687, 6-7=-1459/0, 7-8=-2233/0, 8-9=-2233/0, 9-10=-2168/0, 10-11=-1535/0
BOT CHORD 25-26=-327/475, 24-25=-327/475, 23-24=-327/475, 22-23=-1130/0, 21-22=-1130/0, 20-21=0/961, 19-20=0/1956, 18-19=0/2233, 17-18=0/2233, 16-17=0/2233, 15-16=0/2024, 14-15=0/1020
WEBS 3-24=0/261, 8-19=-250/0, 5-22=-1348/0, 1-26=-120/330, 2-26=-266/286, 3-23=-768/0, 5-23=0/626, 5-21=0/1202, 6-21=-1111/0, 6-20=0/691, 7-20=-698/0, 7-19=0/575, 9-16=-250/129, 10-16=0/259, 10-15=-637/0, 11-15=0/669, 11-14=-1010/0, 12-14=0/712

- NOTES-** (6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 27.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-23	Floor	2	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:50 2024 Page 1
 ID:oDuW00MhLxM0j2fwcp2aKqzMG6w-Hcu1kvYbI039JoPOYe2y2iGS832qNvfBouMqTCzT1o3



Scale = 1:39.3

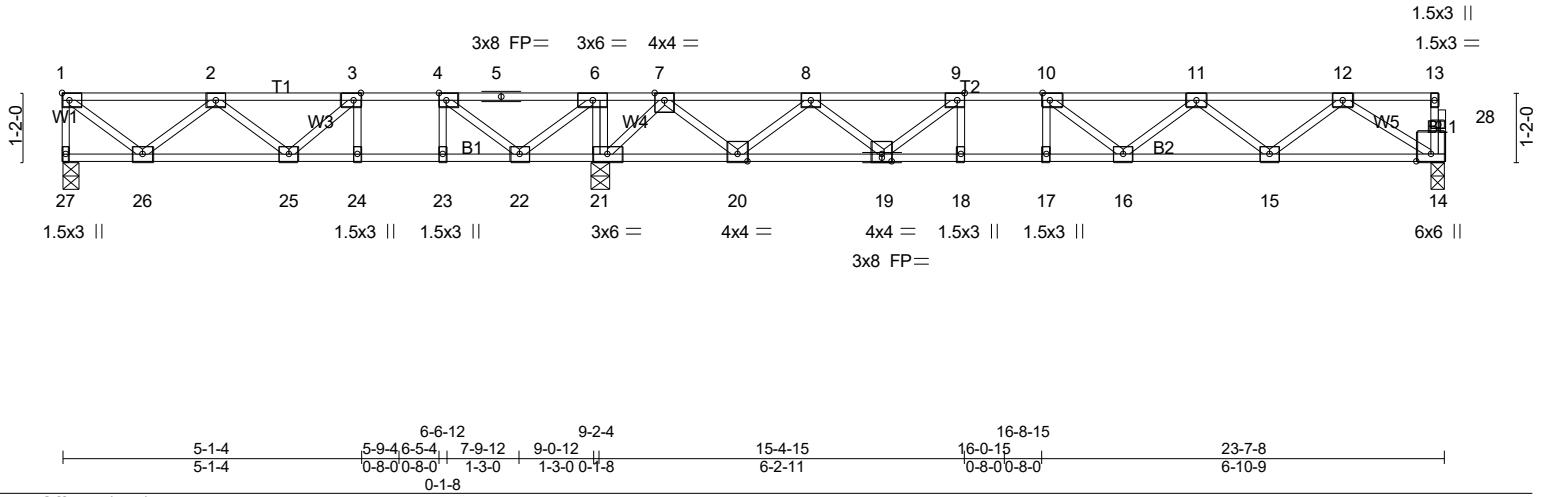


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.53	Vert(LL)	-0.12	16-17	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.70	Vert(CT)	-0.16	16-17	>999		
BCLL 0.0	Lumber DOL 1.00	WB 0.48	Horz(CT)	0.03	14	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 119 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=360/0-3-8 (min. 0-1-8), 21=1522/0-3-8 (min. 0-1-8), 14=690/0-3-0 (min. 0-1-8)
 Max Grav 27=453(LC 3), 21=1522(LC 1), 14=701(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-27=-445/2, 1-2=-438/22, 2-3=-859/198, 3-4=-763/443, 4-5=-156/835, 5-6=-156/835,
 6-7=0/1283, 7-8=-539/0, 8-9=-1664/0, 9-10=-2128/0, 10-11=-2083/0, 11-12=-1491/0
 BOT CHORD 25-26=-58/842, 24-25=-443/763, 23-24=-443/763, 22-23=-443/763, 21-22=-1283/0,
 20-21=-429/0, 19-20=0/1252, 18-19=0/2128, 17-18=0/2128, 16-17=0/2128, 15-16=0/1962,
 14-15=0/990
 WEBS 3-24=-303/0, 4-23=0/318, 6-21=-653/0, 1-26=-28/560, 2-26=-526/47, 3-25=0/406,
 4-22=-1008/0, 6-22=0/832, 9-19=-655/0, 8-19=0/565, 8-20=-958/0, 7-20=0/998,
 7-21=-1230/0, 11-15=-612/0, 12-15=0/652, 12-14=-1171/0

- NOTES-** (5)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-24	Truss Type Floor	Qty 4	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 47335
--------------------	----------------	---------------------	----------	----------	--	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:51 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-loSPyFYD3JB0wy_a5LZBbwogaTPJ6MSL1Y5N0fzT1o2



Scale = 1:22.5


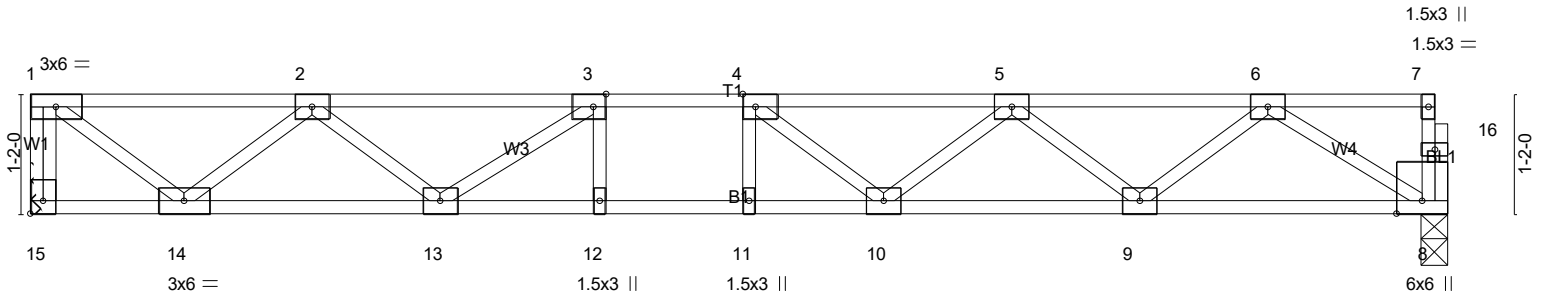


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [15:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.35	Vert(LL) -0.12	11	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.69	Vert(CT) -0.16	10-11	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.50	Horz(CT) 0.03	8	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 70 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 15=747/Mechanical, 8=741/0-3-0 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-15=-742/0, 1-2=-843/0, 2-3=-1948/0, 3-4=-2410/0, 4-5=-2287/0, 5-6=-1600/0
BOT CHORD 13-14=0/1579, 12-13=0/2410, 11-12=0/2410, 10-11=0/2410, 9-10=0/2114, 8-9=0/1053
WEBS 1-14=0/1057, 2-14=-959/0, 2-13=0/481, 3-13=-623/0, 4-10=-353/77, 5-10=0/311, 5-9=-669/0, 6-9=0/712, 6-8=-1246/0

- NOTES-** (6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-2501-F02	Truss F2-25	Truss Type Floor	Qty 5	Ply 1	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC	# 47335
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:51 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-loSPyFYD3JB0wy_a5LZBbwoheTRI6NHL1Y5N0fzT1o2

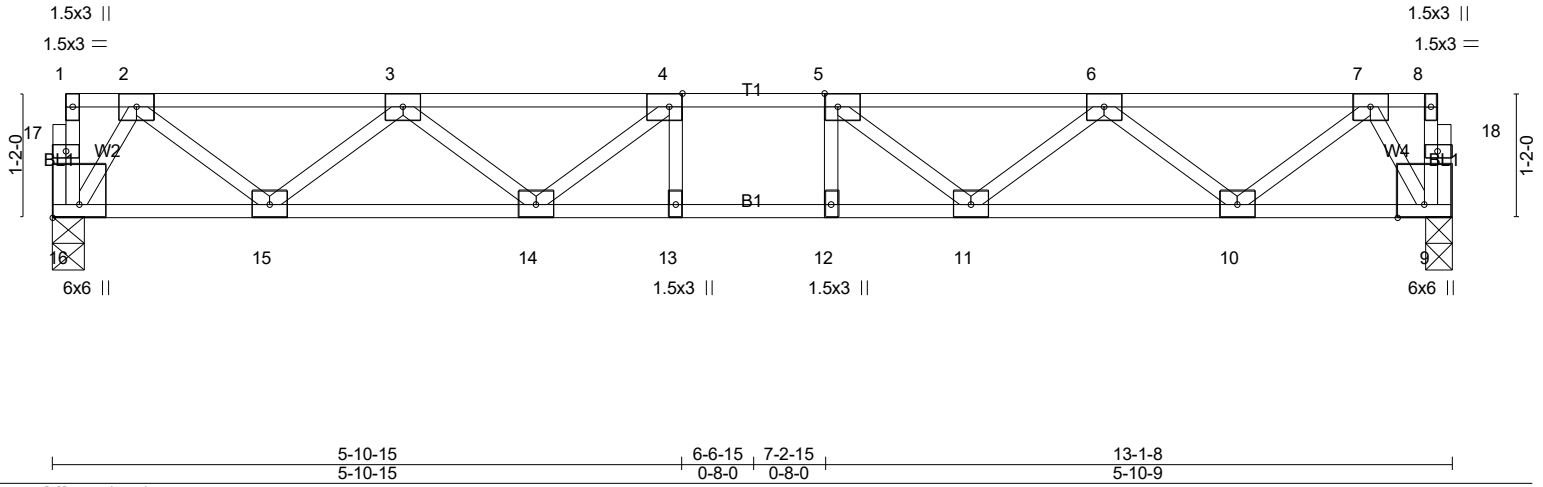



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [16:Edge,0-3-0]	
5-10-15 5-10-15	6-6-15 0-8-0
7-2-15 0-8-0	13-1-8 5-10-9

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.29	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.53	Vert(LL) -0.09 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.39	Vert(CT) -0.12 12-13 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=702/0-3-8 (min. 0-1-8), 9=702/0-3-0 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1078/0, 3-4=-1933/0, 4-5=-2183/0, 5-6=-1926/0, 6-7=-1063/0
BOT CHORD 15-16=0/459, 14-15=0/1668, 13-14=0/2183, 12-13=0/2183, 11-12=0/2183, 10-11=0/1657, 9-10=0/440
WEBS 4-14=-439/0, 3-14=0/377, 3-15=-768/0, 2-15=0/806, 2-16=-860/0, 5-11=-445/0, 6-11=0/381, 6-10=-773/0, 7-10=0/811, 7-9=-855/0

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

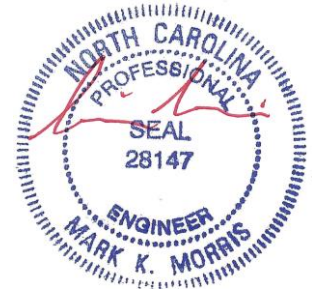

4/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0007 HONEYCUTT HILLS 135 SHELBY MEADOW LANE ANGIER, NC
24-2501-F02	F2-26	GABLE	1	1	# 47335

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Sun Apr 7 18:38:52 2024 Page 1
 ID:oDuWOOmHxMOj2fwcp2aKqzMG6w-D_0n9bZrqdJtY6Znf24Q77LwytvCrw4UFcrwY5zT1o1

0₁1-8

0₁1-8

Scale = 1:21.3


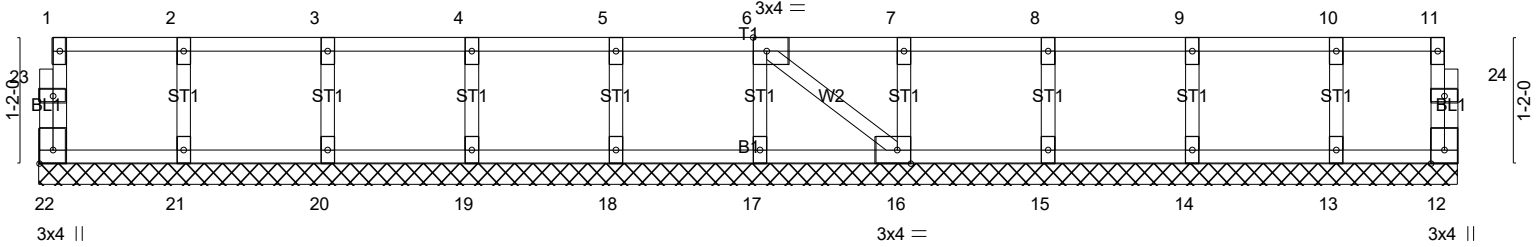


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [16:0-1-8,Edge], [22:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 58 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-1-8.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



4/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.