


Job Q-2400733-1	Truss T1	Truss Type Common	Qty 24	Ply 1	Hamilton-Roof Job Reference (optional)
--------------------	-------------	----------------------	-----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.91 S 8.72 Sep 21 2023 Print: 8.720 S Sep 21 2023 MiTek Industries, Inc. Fri Apr 05 08:33:40

Page: 1

ID:R2DnyygeOQ_BeXzCDFWRagzTquD-hUXSWAqwEQXnc28cCLEPLQ0uJ8qqpcatorE5X5zTqrQ

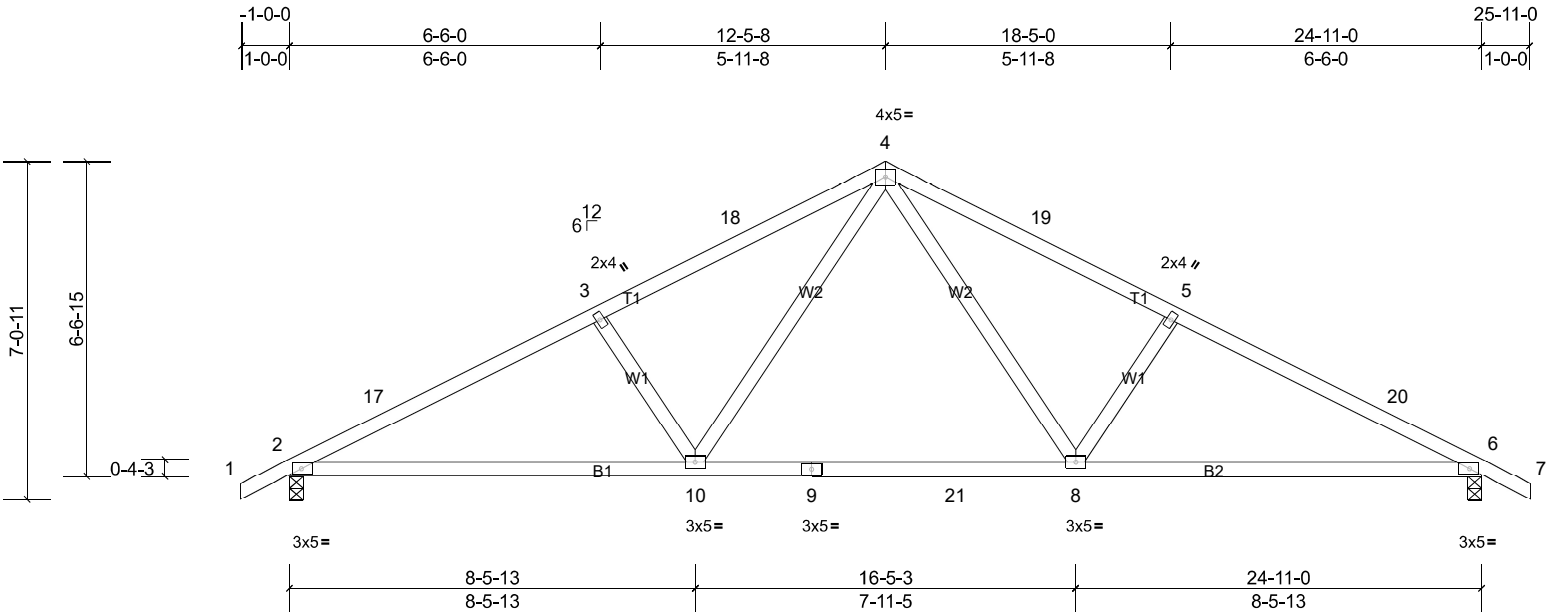

Scale = 1:48.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.39	Vert(LL)	-0.14	8-10	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.22	8-10	>999	180	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.04	6	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MS							Weight: 114 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3

BRACING

TOP CHORD
 BOT CHORD

Structural wood sheathing directly applied or 4-4-12 oc purlins.
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 2=1057/0-3-8, (min. 0-1-11), 6=1057/0-3-8, (min. 0-1-11)
 Max Horiz 2=-100 (LC 9)
 Max Uplift 2=-158 (LC 11), 6=-158 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-17=-1738/223, 3-17=-1693/251, 3-18=-1557/249, 4-18=-1465/265, 4-19=-1465/265, 5-19=-1557/249, 5-20=-1693/251, 6-20=-1738/223
 BOT CHORD 2-10=-130/1514, 9-10=-3/995, 9-21=-3/995, 8-21=-3/995, 6-8=-130/1514
 WEBS 4-8=-62/625, 5-8=-388/175, 4-10=-62/626, 3-10=-388/175

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=30ft; B=20ft; L=25ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Exterior (2) -1-0-0 to 2-0-0, Interior (1) 2-0-0 to 12-5-8, Exterior (2) 12-5-8 to 15-5-8, Interior (1) 15-5-8 to 25-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 158 lb uplift at joint 2 and 158 lb uplift at joint 6.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard


Job Q-2400733-1	Truss T1GE	Truss Type Common Supported Gable	Qty 3	Ply 1	Hamilton-Roof Job Reference (optional)
--------------------	---------------	--------------------------------------	----------	----------	---

Peak Truss Builders LLC, New Hill, user

Run: 8.91 S 8.72 Sep 21 2023 Print: 8.720 S Sep 21 2023 MiTek Industries, Inc. Fri Apr 05 08:33:41

Page: 1

ID:vFnA9jG9j62FhYOny2g7uzTquC-ettDxrsAm1nVsML_KIGtQr5K6ydiHYqAF9jCc_zTqrO

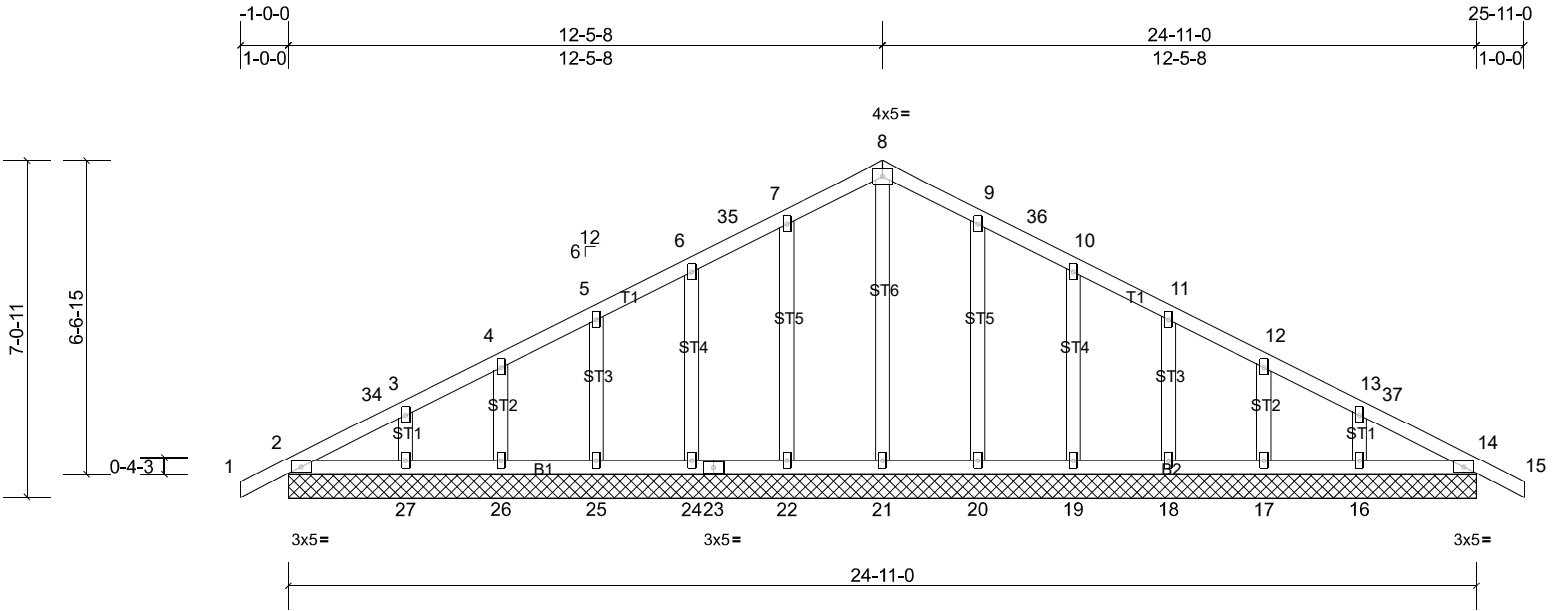

Scale = 1:48.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	31	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MS								Weight: 136 lb FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.3

BRACING
 TOP CHORD
 BOT CHORD

Structural wood sheathing directly applied or 6'-0'-0" oc purlins.
 Rigid ceiling directly applied or 10'-0'-0" oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS All bearings 24-11-0.

- (lb) - Max Horiz 2=-100 (LC 9), 28=-100 (LC 9)
- Max Uplift All uplift 100 (lb) or less at joint(s) 2, 14, 16, 17, 18, 19, 20, 22, 24, 25, 26, 27, 28, 31
- Max Grav All reactions 250 (lb) or less at joint(s) 2, 14, 16, 17, 18, 19, 20, 21, 22, 24, 25, 26, 27, 28, 31

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCCL=6.0psf; BCCL=6.0psf; h=30ft; B=20ft; L=25ft; eave=2ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Corner (3) -1-0-0 to 2-0-0, Exterior (2) 2-0-0 to 12-5-8, Corner (3) 12-5-8 to 15-5-8, Exterior (2) 15-5-8 to 25-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0"-0" tall by 2'-0"-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 22, 24, 25, 26, 27, 20, 19, 18, 17, 16, 14, 2, 14.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 14, 31.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard