

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 45907

JOB: 24-1169-F02

JOB NAME: LOT 0.0002 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

26 Truss Design(s)

Trusses:

F201, F202, F203, F204, F205, F206, F207, F208, F210, F211, F212, F213, F214, F215, F216, F217, F218, F219, F220, F222, F223, F227, F228, F229, F230, F231



2/27/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.


This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for*

Job 24-1169-F02	Truss F201	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	-------------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:53 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-DRtMq7HGVeK7KY60_0IR5RTmITSWZD_InDrET6zgdy

Scale = 1:20.5

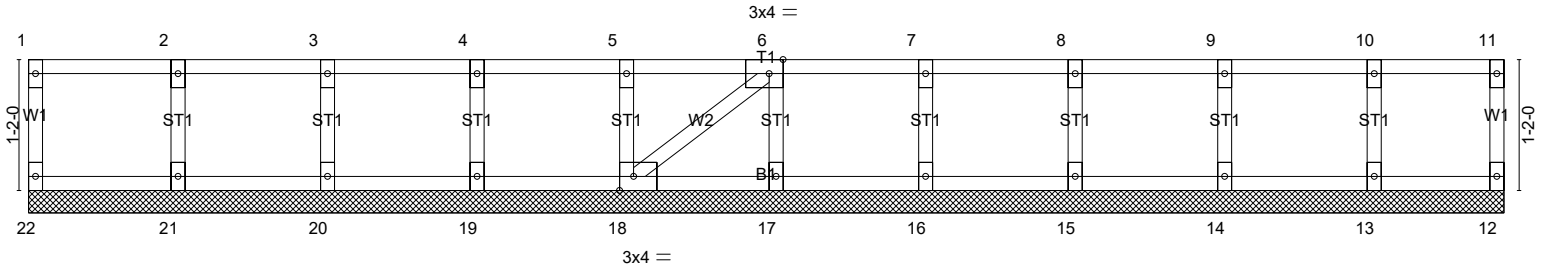

13-1-14
13-1-14

Plate Offsets (X,Y)-- [6:0-1-8,Edge], [18:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	18	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 56 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-1-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (6)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



2/27/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F202	Truss Type Floor	Qty 5	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:54 2024 Page 1

ID: oDuWOOmHxMOj2fwcp2aKqzMG6w-hdRk1TluGyS_MhhDXkGgdf?u9tfHlaMu?tbri?Yzgd5x



Scale = 1:21.7

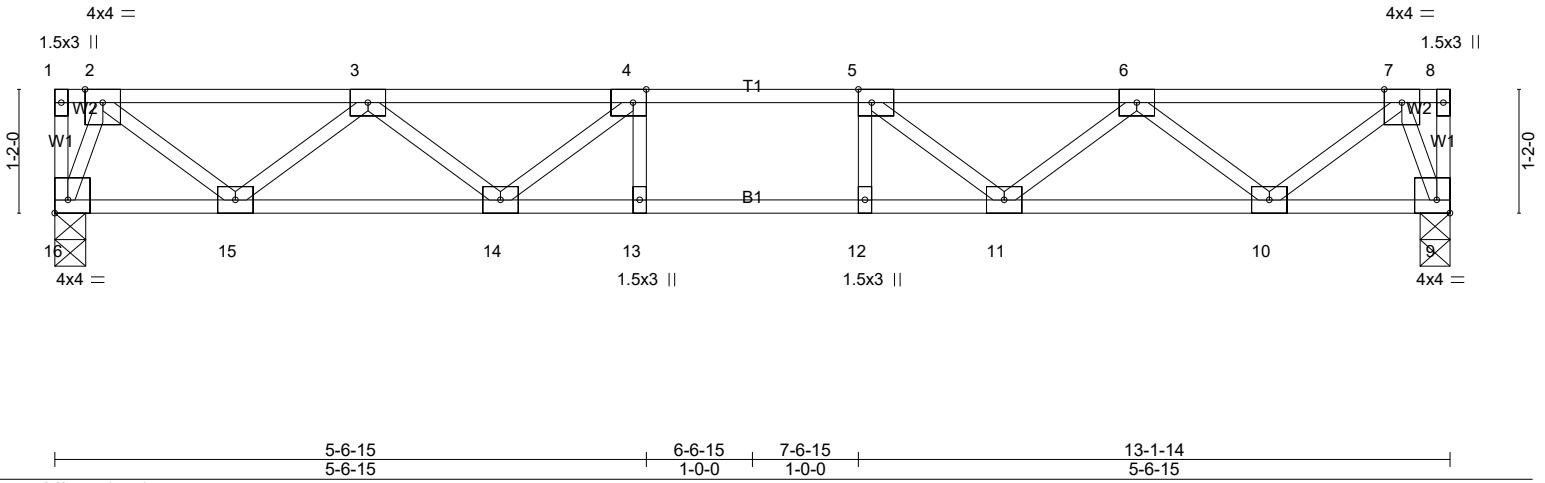


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [9:Edge,0-1-8], [16:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.31	Vert(LL)	-0.11	11-12	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.61	Vert(CT)	-0.14	11-12	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.03	9	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 66 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=717/0-3-8 (min. 0-1-8), 9=717/0-3-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-959/0, 3-4=-1908/0, 4-5=-2215/0, 5-6=-1908/0, 6-7=-959/0
BOT CHORD 15-16=0/298, 14-15=0/1592, 13-14=0/2215, 12-13=0/2215, 11-12=0/1592, 10-11=0/1592, 9-10=0/298
WEBS 4-14=-521/0, 3-14=0/436, 3-15=-825/0, 2-15=0/860, 2-16=-848/0, 5-11=-521/0, 6-11=0/436, 6-10=-825/0, 7-10=0/860, 7-9=-848/0

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



2/27/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F203	Truss Type Floor	Qty 4	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8,430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:55 2024 Page 1

ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-9p?7FoJW1Far_rGP5RrvAsY13Hw210N2EXKLY_zgd5w



Scale = 1:22.5


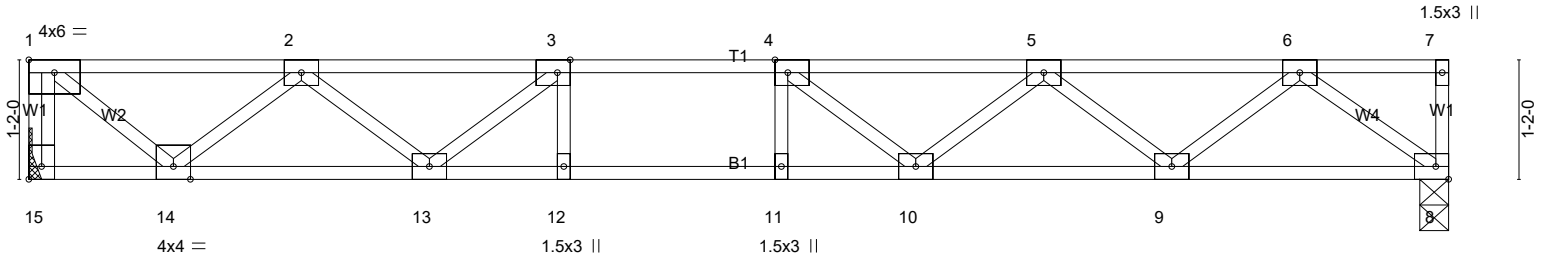


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [15:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.43	Vert(LL)	-0.16	10-11	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.83	Vert(CT)	-0.21	10-11	>795	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.03	8	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 69 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 15=752/Mechanical, 8=752/0-3-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-15=-749/0, 1-2=-797/0, 2-3=-1949/0, 3-4=-2416/0, 4-5=-2276/0, 5-6=-1510/0
BOT CHORD 13-14=0/1537, 12-13=0/2416, 11-12=0/2416, 10-11=0/2416, 9-10=0/2065, 8-9=0/926
WEBS 3-13=-688/0, 2-13=0/539, 2-14=-964/0, 1-14=0/1025, 4-10=-395/49, 5-10=0/355, 5-9=-723/0, 6-9=0/760, 6-8=-1157/0

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Refer to girder(s) for truss to truss connections.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:56 2024 Page 1
ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-d?ZV58J9oZihb?qb918i45BigGGmTqBTB4u4Rzgd5v



Scale = 1:35.6

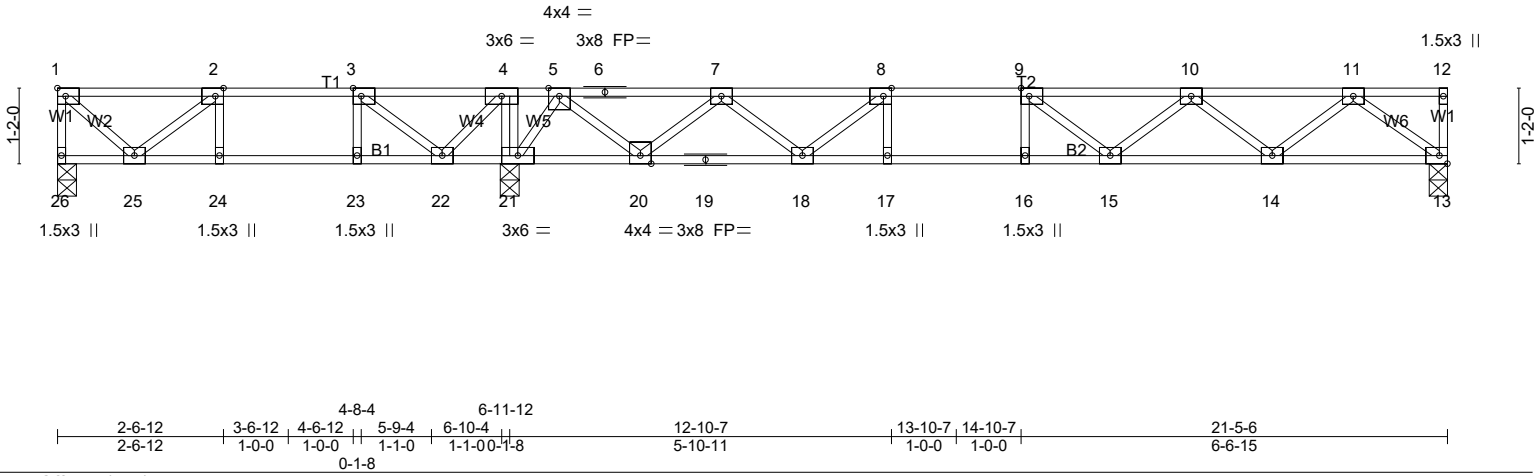


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [8:0-1-8,Edge], [9:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.44	Vert(LL)	-0.16 15-16	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.84	Vert(CT)	-0.21 15-16	>826	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.48	Horz(CT)	0.03 13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 106 lb	FT = 20%F, 11%E


LUMBER-	BRACING-	
TOP CHORD	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS		

REACTIONS. (lb/size) 26=275/0-3-8 (min. 0-1-8), 13=742/0-3-6 (min. 0-1-8), 21=1329/0-3-8 (min. 0-1-8)
Max Grav26=347(LC 3), 13=753(LC 7), 21=1329(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-26=-348/0, 1-2=-260/27, 2-3=-506/170, 3-4=-103/494, 4-5=0/822, 5-6=-820/0, 6-7=-820/0, 7-8=-1951/0,
8-9=-2423/0, 9-10=-2280/0, 10-11=-1512/0
BOT CHORD 24-25=-170/506, 23-24=-170/506, 22-23=-170/506, 21-22=-822/0, 19-20=0/1532, 18-19=0/1532, 17-18=0/2423,
16-17=0/2423, 15-16=0/2423, 14-15=0/2068, 13-14=0/927
WEBS 4-21=-468/0, 2-25=-314/183, 1-25=-36/355, 3-22=-737/0, 4-22=0/512, 8-18=-693/0, 7-18=0/585, 7-20=-961/0,
5-20=0/999, 5-21=-1066/0, 9-15=-346/52, 10-15=0/323, 10-14=-724/0, 11-14=0/761, 11-13=-1159/0

- NOTES-** (5)
 1) Unbalanced floor live loads have been considered for this design.
 2) All plates are 3x4 MT20 unless otherwise indicated.
 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

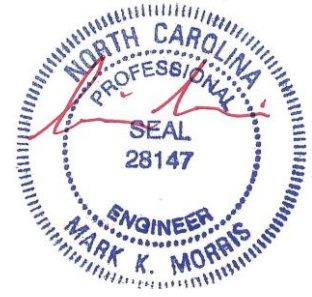

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
24-1169-F02	F205	Floor	2	1	# 45907

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:57 2024 Page 1

ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-6C7tgUKnZtqYD9PoDspNFHdJ?4dmVw3KirpSctzgd5u



Scale = 1:39.2

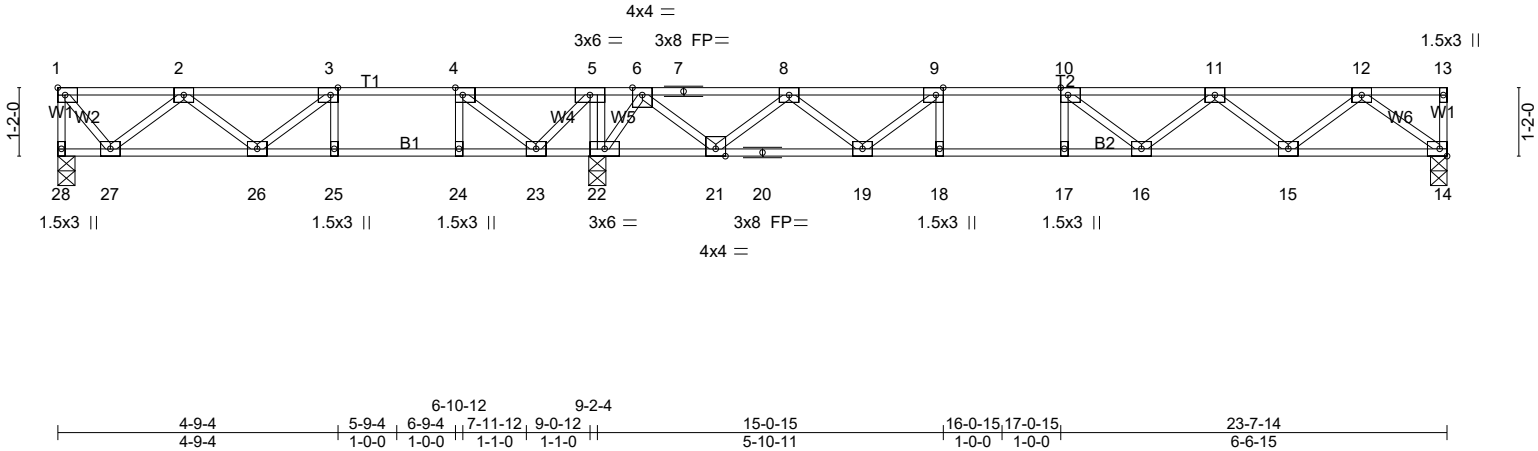


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.59	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.82	Vert(LL) -0.16 16-17 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.48	Vert(CT) -0.21 16-17 >828 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.04 14 n/a n/a		
	Code IRC2021/TPI2014			Weight: 117 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=428/0-3-8 (min. 0-1-8), 14=745/0-3-6 (min. 0-1-8), 22=1415/0-3-8 (min. 0-1-8)
 Max Grav28=494(LC 3), 14=755(LC 7), 22=1415(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-28=-485/0, 1-2=-332/0, 2-3=-957/5, 3-4=-966/195, 4-5=-343/559, 5-6=0/858,
 6-7=-846/0, 7-8=-846/0, 8-9=-1972/0, 9-10=-2438/0, 10-11=-2291/0, 11-12=-1517/0
 BOT CHORD 26-27=0/824, 25-26=-195/966, 24-25=-195/966, 23-24=-195/966, 22-23=-858/0,
 20-21=0/1555, 19-20=0/1555, 18-19=0/2438, 17-18=0/2438, 16-17=0/2438, 15-16=0/2076,
 14-15=0/930
 WEBS 4-24=0/283, 5-22=-519/0, 2-27=-641/0, 1-27=0/531, 4-23=-999/0, 5-23=0/648,
 9-19=-671/0, 8-19=0/590, 8-21=-963/0, 6-21=0/1001, 6-22=-1088/0, 10-16=-356/25,
 11-16=0/329, 11-15=-727/0, 12-15=0/764, 12-14=-1162/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F206	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	-------------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:58 2024 Page 1
ID:oDuWOOmLxMQj2fwp2aKqzMG6w-aOgFtqLPJAYPrJ_mZLcoVAAd9U9hEUGUwVZ?9Jzgd5t

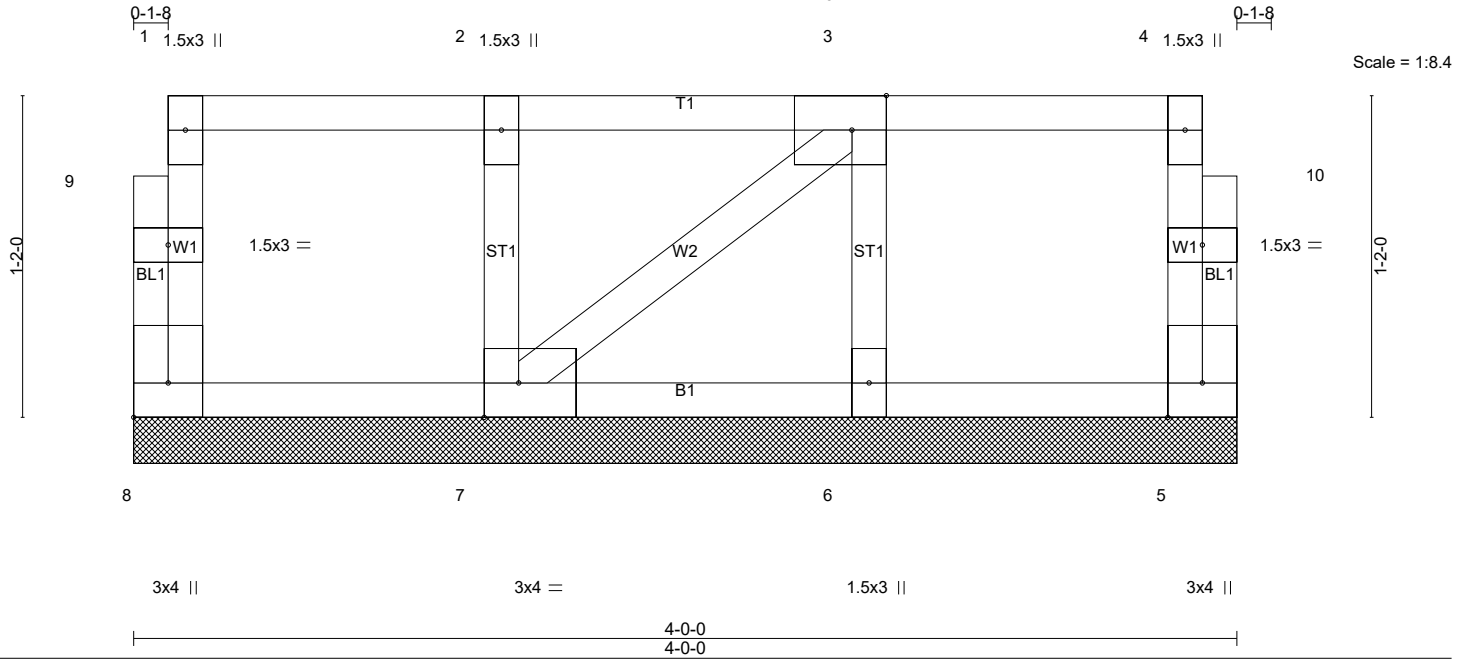


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [7:0-1-8,Edge], [8:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 21 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 4-0-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 8, 5, 7, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (5-6)
- Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F207	Truss Type Floor	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:59 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-2aEd4AM14U4GSTZAKHsrKijleuVPzxCd99IYhmzgd5s

Scale = 1:31.5

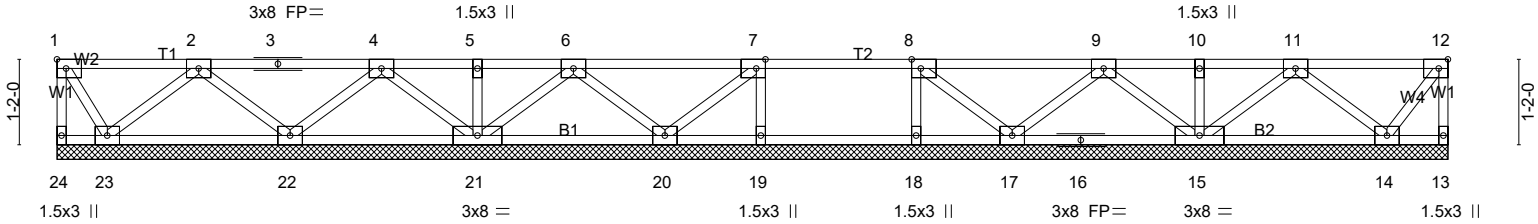

	9-8-4	10-8-4	11-8-4	19-0-4
	9-8-4	1-0-0	1-0-0	7-4-0
Plate Offsets (X,Y)--	[7:0-1-8,Edge]	[8:0-1-8,Edge]	[12:0-1-8,Edge]	

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.04	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 96 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. All bearings 19-0-4.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 24, 13, 19, 18, 20, 23, 17, 14 except 21=312(LC 1), 22=278(LC 1), 15=323(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (4-5)
- 1) All plates are 3x4 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
24-1169-F02	F208	FLOOR	5	1	Job Reference (optional) # 45907


Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:33:59 2024 Page 1

ID: oDuW00MhLxM0J2fwcp2aKqzMG6w-2aEd4AM14U4GSTZAKHsrKjbuHQzoGd99lYhmzgd5s



Scale = 1:30.9

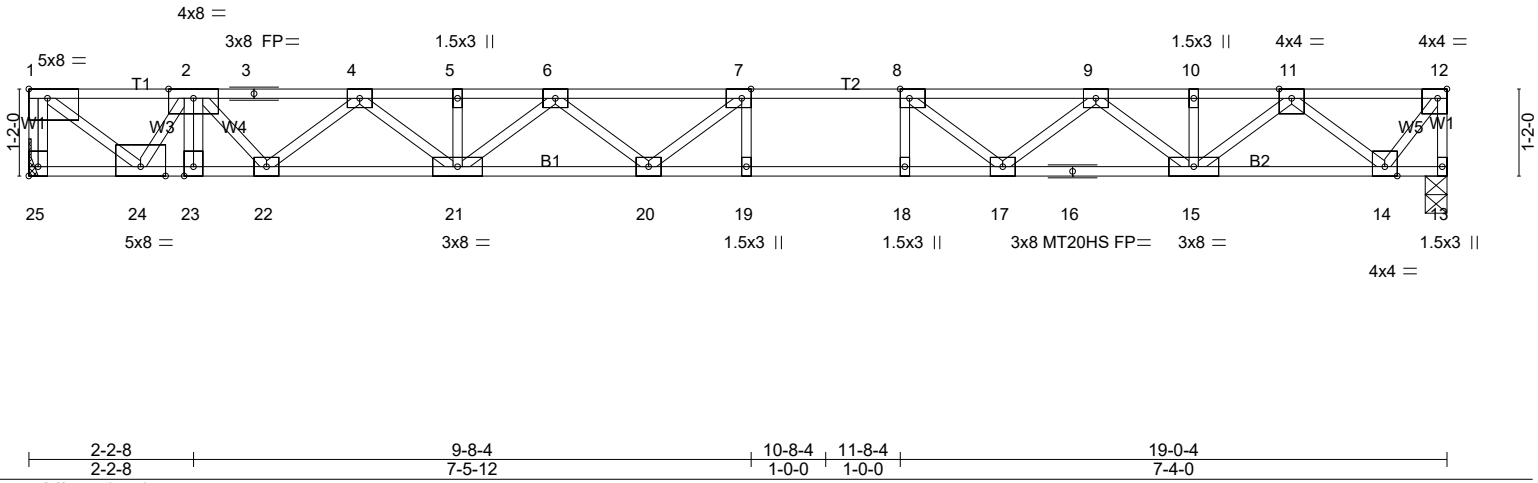

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.87	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.93	Vert(LL) -0.37 19-20 >609 480	MT20HS	187/143
BCLL 0.0	Lumber DOL 1.00	WB 0.62	Vert(CT) -0.51 19-20 >443 360		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH	Horz(CT) 0.07 13 n/a n/a		
	Code IRC2021/TPI2014			Weight: 99 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 5-5-7 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat) *Except* W2: 2x4 SP No.2(flat)	

REACTIONS. (lb/size) 25=1402/Mechanical, 13=779/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-25=-1392/0, 12-13=-774/0, 1-2=-1760/0, 2-3=-3021/0, 3-4=-3021/0, 4-5=-3715/0, 5-6=-3715/0, 6-7=-3932/0, 7-8=-3753/0, 8-9=-3153/0, 9-10=-2107/0, 10-11=-2107/0, 11-12=-531/0
BOT CHORD 23-24=0/2665, 22-23=0/2665, 21-22=0/3443, 20-21=0/3956, 19-20=0/3753, 18-19=0/3753, 17-18=0/3753, 16-17=0/2699, 15-16=0/2699, 14-15=0/1384
WEBS 7-19=-294/46, 8-18=-25/315, 1-24=0/2208, 2-24=-1601/0, 7-20=-234/450, 6-21=-309/0, 4-21=0/346, 4-22=-550/0, 2-22=0/520, 8-17=-886/0, 9-17=0/626, 9-15=-756/0, 11-15=0/922, 11-14=-1111/0, 12-14=0/893

- NOTES-** (7-8)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.
 - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 13-25=-7, 1-12=-67
 Concentrated Loads (lb)
 Vert: 2=-800

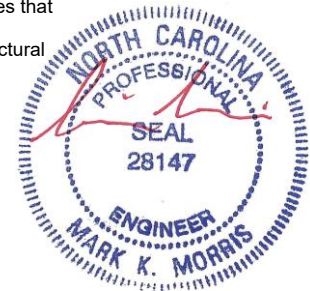

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F210	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	-------------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:01 2024 Page 1
ID:oDuWOOmHxMOj2fwcp2aKqzMG6w-_zMOVSNHc5K_imjZSiuJP7o7HhAORzwcTnflzgd5q

Scale = 1:34.5

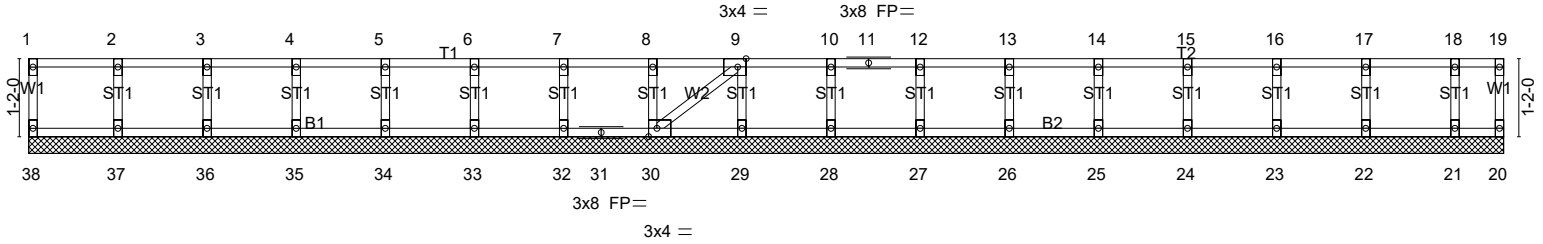


Plate Offsets (X,Y)-- [9:0-1-8,Edge], [30:0-1-8,Edge]		22-0-12		22-0-12					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	29	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 92 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 22-0-12.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 30, 29, 28, 27, 26, 25, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F211	Truss Type Floor	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:01 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-_zMOV'sNHc5K_imjZSiuJP7o4EhAgRrVwcTnflzegd5q

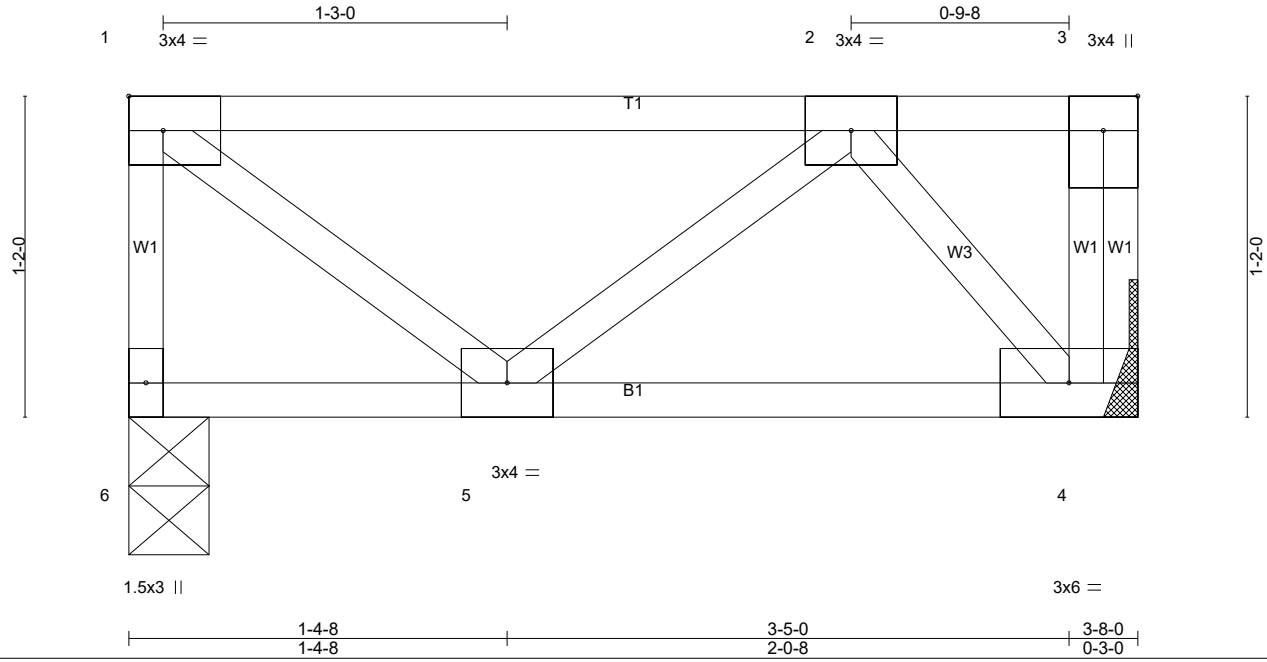

Scale = 1:8.4

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.26	in (loc) l/def L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.05	Vert(LL) -0.00 5 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.06	Vert(CT) -0.00 4-5 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 4 n/a n/a		
	Code IRC2021/TPI2014			Weight: 21 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=191/0-3-8 (min. 0-1-8), 4=191/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-271/0

NOTES- (3)
1) Refer to girder(s) for truss to truss connections.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

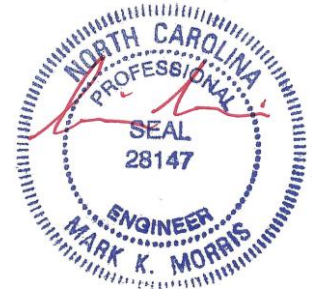

2/27/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F212	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 45907
--------------------	---------------	----------------------------	----------	----------	---	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:02 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-S9wmjCOWNPTrJwll?PPYyLLFG5UIAEX4r7XDI5zgd5p

Scale = 1:11.8

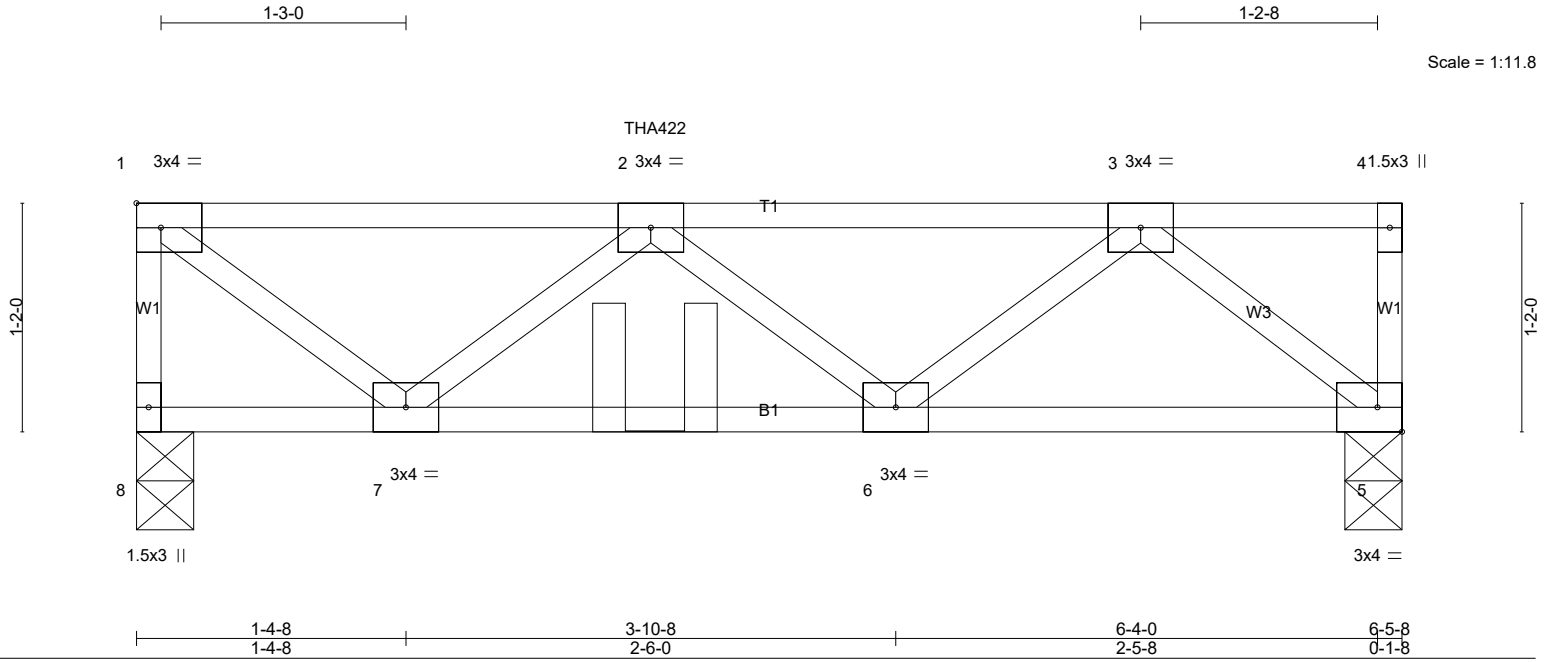

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/def L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.31	Vert(LL) -0.01 6 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.19	Vert(CT) -0.01 6-7 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.27	Horz(CT) 0.00 5 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P		Weight: 33 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 8=459/0-3-8 (min. 0-1-8), 5=424/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-8=-453/0, 1-2=-443/0, 2-3=-667/0
BOT CHORD 6-7=0/843, 5-6=0/458
WEBS 1-7=0/566, 2-7=-521/0, 3-6=0/272, 3-5=-592/0

- NOTES-** (5)
- 1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 2) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent at 2-7-12 from the left end to connect truss(es) F213 (1 ply 2x4 SP) to front face of top chord, skewed 0.0 deg.to the right, sloping 0.0 deg. down.
 - 3) Fill all nail holes where hanger is in contact with lumber.
 - 4) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-8=-10, 1-4=-100
Concentrated Loads (lb)
Vert: 2=-186(F)




2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F213	Truss Type FLOOR GIRDER	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 45907
--------------------	---------------	----------------------------	----------	----------	---	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:03 2024 Page 1
ID: oDuW00MhLxMOj2fwcp2akgzMG6w-wMU8wYPY8jibix4txZ7wnUYtMRVravlID4nGmqXzgd5o

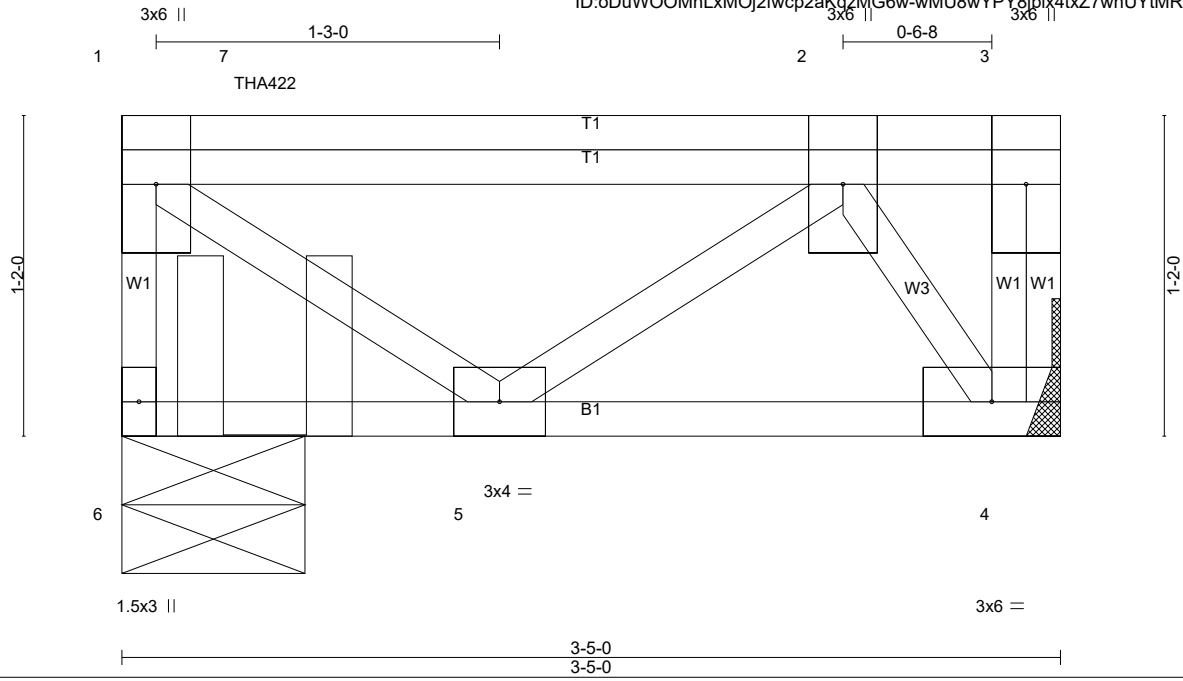

Scale = 1:8.4

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.53	Vert(LL) -0.00 5 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.09	Vert(CT) -0.00 5 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.14	Horz(CT) 0.00 4 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P		Weight: 25 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-5-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=837/0-8-0 (min. 0-1-8), 4=287/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-6=-831/0
BOT CHORD 4-5=0/353
WEBS 2-4=-627/0

- NOTES-** (6)
- 1) Refer to girder(s) for truss to truss connections.
 - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 3) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent at 0-6-4 from the left end to connect truss(es) F216 (1 ply 2x4 SP) to back face of top chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
 - 4) Fill all nail holes where hanger is in contact with lumber.
 - 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 4-6=-10, 1-3=-100
Concentrated Loads (lb)
Vert: 7=-769(B)



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F214	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	-------------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:04 2024 Page 1
ID:oDuW00MhLxMOj2fwp2aKqzMG6w-OY2W8tQAv0jZZES87qR01mQeWvC5eCjMJR0JMzgzd5n

Scale = 1:24.7

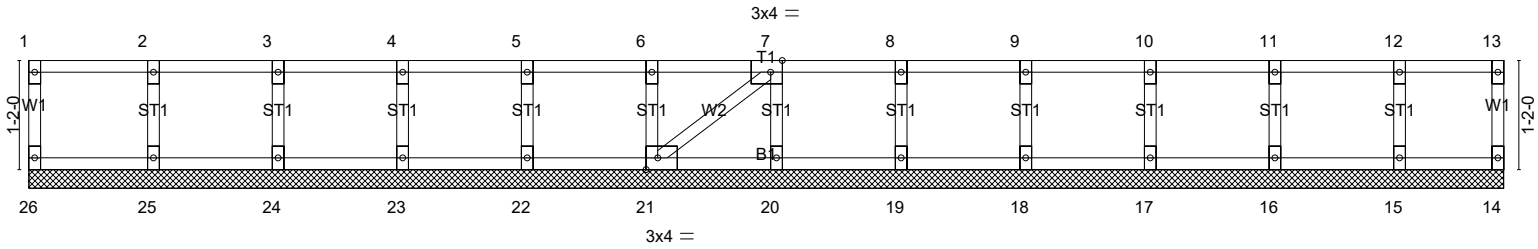


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [21:0-1-8,Edge]		15-9-6		15-9-6					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	19	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 67 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 15-9-6.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F215	Truss Type Floor	Qty 2	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:05 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-tkbuLDQogKrQAO1KhYzFazzhTJMsnXYWX5ltuPzgd5m



Scale = 1:26.1

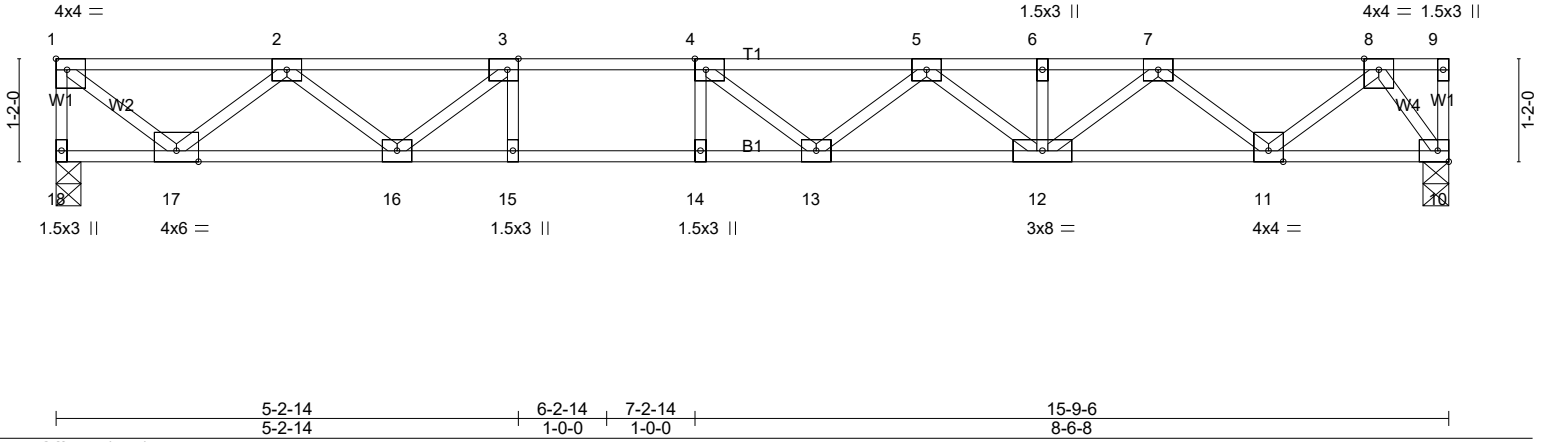


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.63	Vert(LL) -0.26 13-14 >736 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.80	Vert(CT) -0.35 13-14 >539 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.57	Horz(CT) 0.04 10 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 78 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=861/0-3-6 (min. 0-1-8), 10=861/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-860/0, 1-2=-939/0, 2-3=-2351/0, 3-4=-3060/0, 4-5=-3159/0, 5-6=-2644/0, 6-7=-2644/0, 7-8=-1396/0
BOT CHORD 16-17=0/1796, 15-16=0/3060, 14-15=0/3060, 13-14=0/3060, 12-13=0/3087, 11-12=0/2147, 10-11=0/612
WEBS 3-15=0/333, 4-14=-301/28, 3-16=-972/0, 2-16=0/722, 2-17=-1115/0, 1-17=0/1203, 4-13=-260/330, 5-13=-25/273,
5-12=-566/0, 7-12=0/635, 7-11=-977/0, 8-11=0/1020, 8-10=-1068/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

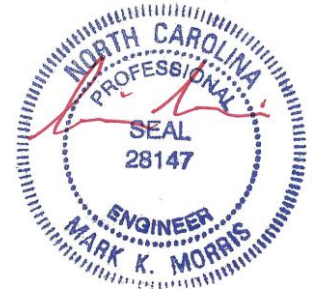

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F216	Truss Type Floor	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional) # 45907

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:06 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-Lx9HYZRQRezHoXbWEFUU6BVsvijr6_?fmIvQRszgd5f



Scale = 1:25.2


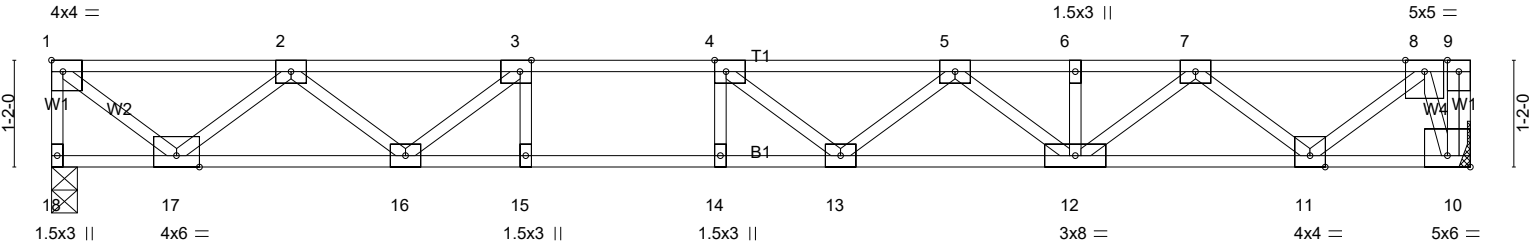


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [10:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.58	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.76	Vert(LL) -0.23 13-14 >786 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.56	Vert(CT) -0.32 13-14 >578 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.04 10 n/a n/a		
	Code IRC2021/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP SS(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 18=842/0-3-6 (min. 0-1-8), 10=842/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-840/0, 1-2=-915/0, 2-3=-2280/0, 3-4=-2946/0, 4-5=-3000/0, 5-6=-2439/0, 6-7=-2439/0, 7-8=-1142/0
BOT CHORD 16-17=0/1751, 15-16=0/2946, 14-15=0/2946, 13-14=0/2946, 12-13=0/2901, 11-12=0/1914, 10-11=0/339
WEBS 3-15=-7/312, 4-14=-280/38, 3-16=-921/0, 2-16=0/688, 2-17=-1088/0, 1-17=0/1172, 4-13=-284/278, 5-13=0/288, 5-12=-591/0, 7-12=0/670, 7-11=-1005/0, 8-11=0/1045, 8-10=-1000/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F217	Truss Type Floor	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:07 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-p7jfmvS2Cx58QhAjy?jfO25B645rSlp?PE_zlzd5k



Scale = 1:25.5

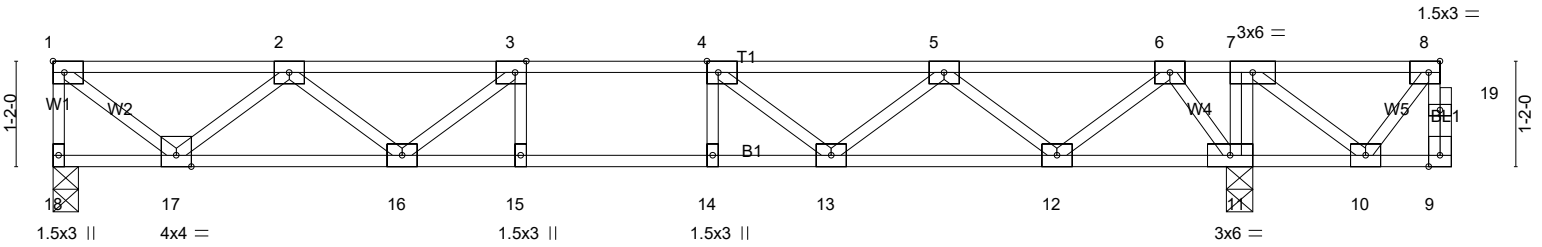


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [8:0-1-8,Edge]
--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.69	Vert(LL) -0.13 13-14 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.46	Vert(CT) -0.16 13-14 >984 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 11 n/a n/a		
	Code IRC2021/TPI2014			Weight: 79 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=701/0-3-6 (min. 0-1-8), 11=975/0-3-8 (min. 0-1-8)
Max Grav 18=715(LC 3), 11=975(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-710/0, 1-2=-759/0, 2-3=-1817/0, 3-4=-2196/0, 4-5=-1971/0, 5-6=-1104/0
BOT CHORD 16-17=0/1459, 15-16=0/2196, 14-15=0/2196, 13-14=0/2196, 12-13=0/1704, 11-12=-84/484
WEBS 7-11=-284/0, 3-16=-587/0, 2-16=0/476, 2-17=-911/0, 1-17=0/972, 4-13=-496/0, 5-13=0/421, 5-12=-802/0, 6-12=0/831, 6-11=-886/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

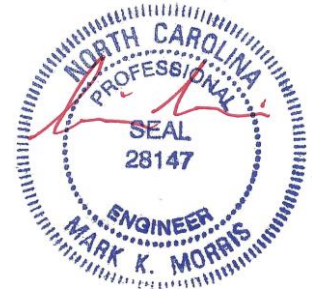

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.


Job	Truss	Truss Type	Qty	Ply	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
24-1169-F02	F218	Floor	1	1	# 45907

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:07 2024 Page 1
 ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-p7jfmvS2Cx58QhAjoy?jfO24E65VrStp?PE_zlzd5k



Scale: 3/8"=1'

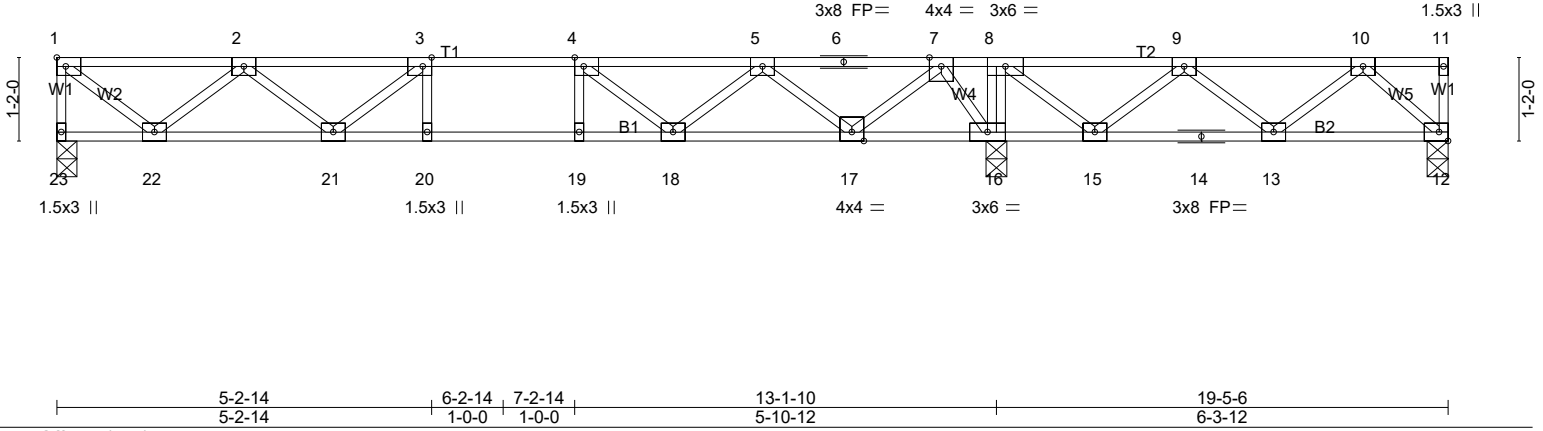

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.42	Vert(LL)	-0.09 20-21	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.60	Vert(CT)	-0.12 20-21	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.02 16	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 97 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 23=617/0-3-6 (min. 0-1-8), 12=129/0-3-8 (min. 0-1-8), 16=1380/0-3-8 (min. 0-1-8)
 Max Uplift12=-107(LC 3)
 Max Grav23=623(LC 3), 12=272(LC 4), 16=1380(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-23=-616/0, 1-2=-646/0, 2-3=-1479/0, 3-4=-1654/0, 4-5=-1223/0, 7-8=0/1317, 8-9=0/844, 9-10=-298/324
 BOT CHORD 21-22=0/1248, 20-21=0/1654, 19-20=0/1654, 18-19=0/1654, 17-18=0/829, 16-17=-815/0, 15-16=-1317/0, 14-15=-552/306, 13-14=-552/306, 12-13=-130/257
 WEBS 8-16=-615/0, 3-21=-287/0, 2-21=0/302, 2-22=-783/0, 1-22=0/828, 4-18=-568/0, 5-18=0/524, 5-17=-917/0, 7-17=0/954, 7-16=-997/0, 8-15=0/717, 9-15=-658/0, 9-13=-10/297, 10-13=-252/54, 10-12=-351/177

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 12.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

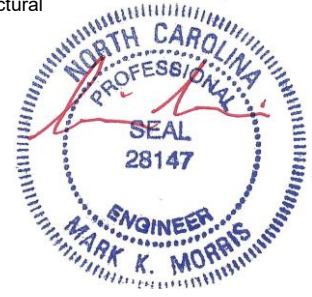

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.


Job	Truss	Truss Type	Qty	Ply	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
24-1169-F02	F219	Floor	1	1	# 45907

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:08 2024 Page 1
 ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-HJH1zFTgzFD_2rlvMgWyBcaF_WQkav7yD3_XVkgzd5j



Scale: 3/8"=1'

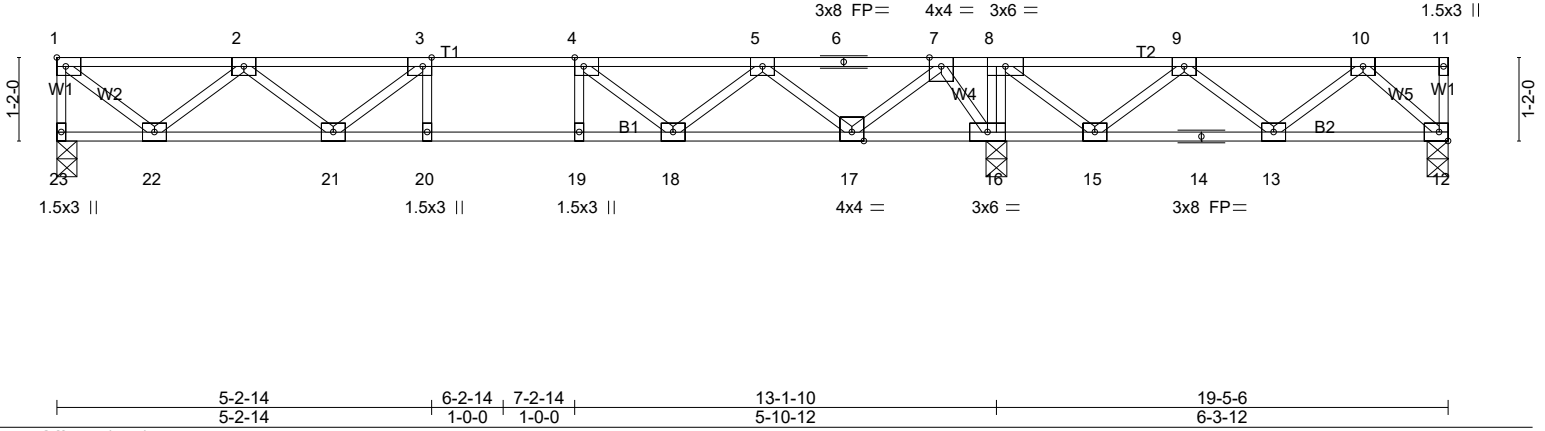

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.42	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.60	Vert(LL) -0.09 20-21 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.45	Vert(CT) -0.12 20-21 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.02 16 n/a n/a		
	Code IRC2021/TPI2014			Weight: 97 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 23=617/0-3-6 (min. 0-1-8), 12=129/0-3-8 (min. 0-1-8), 16=1380/0-3-8 (min. 0-1-8)
 Max Uplift 12=-107(LC 3)
 Max Grav 23=623(LC 3), 12=272(LC 4), 16=1380(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-23=-616/0, 1-2=-646/0, 2-3=-1479/0, 3-4=-1654/0, 4-5=-1223/0, 7-8=0/1317, 8-9=0/844, 9-10=-298/324
 BOT CHORD 21-22=0/1248, 20-21=0/1654, 19-20=0/1654, 18-19=0/1654, 17-18=0/829, 16-17=-815/0, 15-16=-1317/0, 14-15=-552/306, 13-14=-552/306, 12-13=-130/257
 WEBS 8-16=-615/0, 3-21=-287/0, 2-21=0/302, 2-22=-783/0, 1-22=0/828, 4-18=-568/0, 5-18=0/524, 5-17=-917/0, 7-17=0/954, 7-16=-997/0, 8-15=0/717, 9-15=-658/0, 9-13=-10/297, 10-13=-252/54, 10-12=-351/177

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 12.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

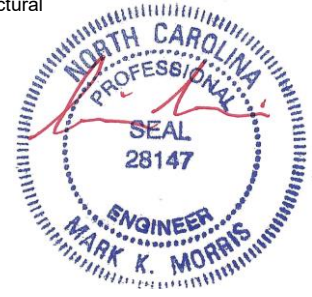

2/27/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC
24-1169-F02	F220	Floor	3	1	
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional) # 45907

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:09 2024 Page 1
 ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-IWrPBbTJkZLr?K5wN1Bkp7QqwI7JME5Sjj41Bzgd5i



Scale = 1:37.3

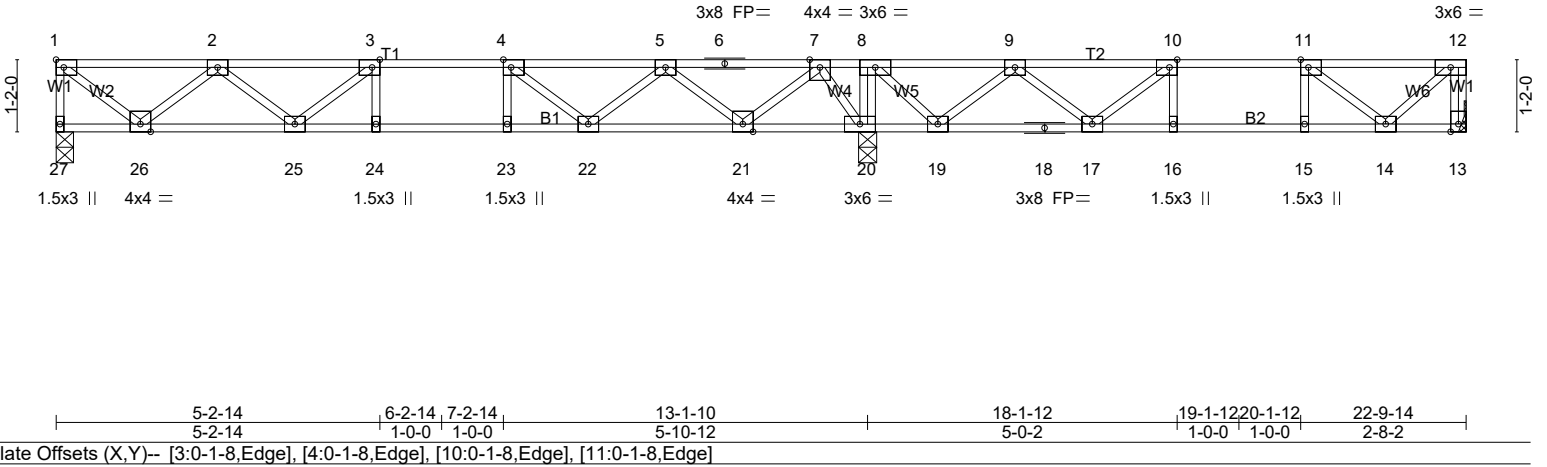

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.41	Vert(LL)	-0.10 24-25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.66	Vert(CT)	-0.13 24-25	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.46	Horz(CT)	0.02 13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 114 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=611/0-3-6 (min. 0-1-8), 13=379/Mechanical, 20=1500/0-3-8 (min. 0-1-8)
 Max Grav27=647(LC 3), 13=437(LC 4), 20=1500(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-27=-640/0, 12-13=-426/0, 1-2=-676/0, 2-3=-1568/0, 3-4=-1796/0, 4-5=-1418/0,
 5-6=-387/371, 6-7=-387/371, 7-8=0/1410, 8-9=0/828, 9-10=-599/250, 10-11=-809/32,
 11-12=-373/0
 BOT CHORD 25-26=0/1303, 24-25=0/1796, 23-24=0/1796, 22-23=0/1796, 21-22=-150/1057,
 20-21=-845/0, 19-20=-1410/0, 18-19=-433/346, 17-18=-433/346, 16-17=-32/809,
 15-16=-32/809, 14-15=-32/809
 WEBS 8-20=-709/0, 3-25=-291/57, 2-25=0/345, 2-26=-817/0, 1-26=0/865, 4-22=-643/0,
 5-22=0/549, 5-21=-935/0, 7-21=0/973, 7-20=-979/0, 10-17=-460/0, 9-17=0/446,
 9-19=-844/0, 8-19=0/820, 11-14=-557/67, 12-14=0/498

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION. Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

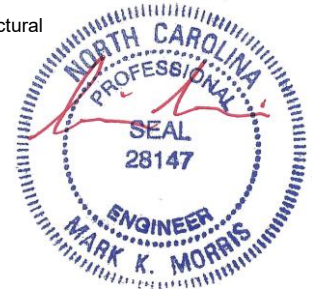

2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F222	Truss Type Floor	Qty 13	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	-----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8,430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:10 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-DiPnOxUxVsTiH9vHT5YQH1gbPK2Z2rIFhMTeadzgd5h



Scale = 1:26.2

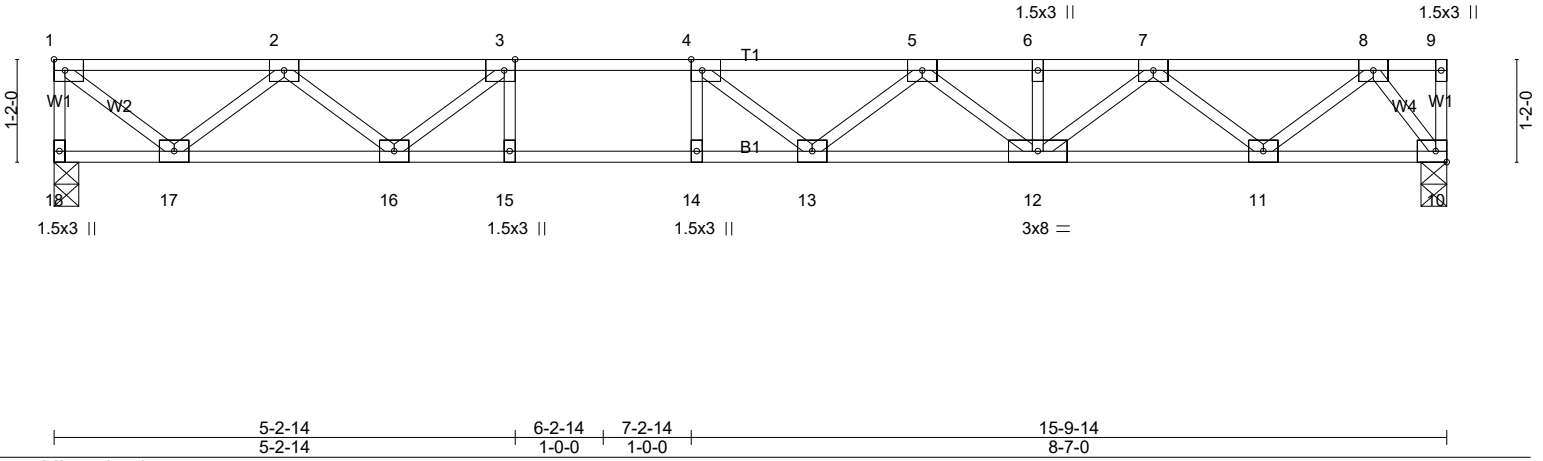


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge]		5-2-14 5-2-14		6-2-14 1-0-0		7-2-14 1-0-0		15-9-14 8-7-0	
LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.42	Vert(LL)	-0.18 13-14	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.83	Vert(CT)	-0.25 13-14	>755	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.38	Horz(CT)	0.03 10	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH					Weight: 79 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=576/0-3-6 (min. 0-1-8), 10=576/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-18=-575/0, 1-2=-628/0, 2-3=-1575/0, 3-4=-2049/0, 4-5=-2117/0, 5-6=-1779/0, 6-7=-1779/0, 7-8=-951/0
 BOT CHORD 16-17=0/1200, 15-16=0/2049, 14-15=0/2049, 13-14=0/2049, 12-13=0/2074, 11-12=0/1449, 10-11=0/430
 WEBS 3-16=-649/0, 2-16=0/488, 2-17=-746/0, 1-17=0/804, 5-12=-376/0, 7-12=0/421, 7-11=-649/0, 8-11=0/678, 8-10=-723/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F223	Truss Type Floor	Qty 2	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---


Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:11 2024 Page 1

ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-huzAcHVZGAbZvJU01o4fpECozjTanHxOw0CB63zgd5g



Scale = 1:22.5

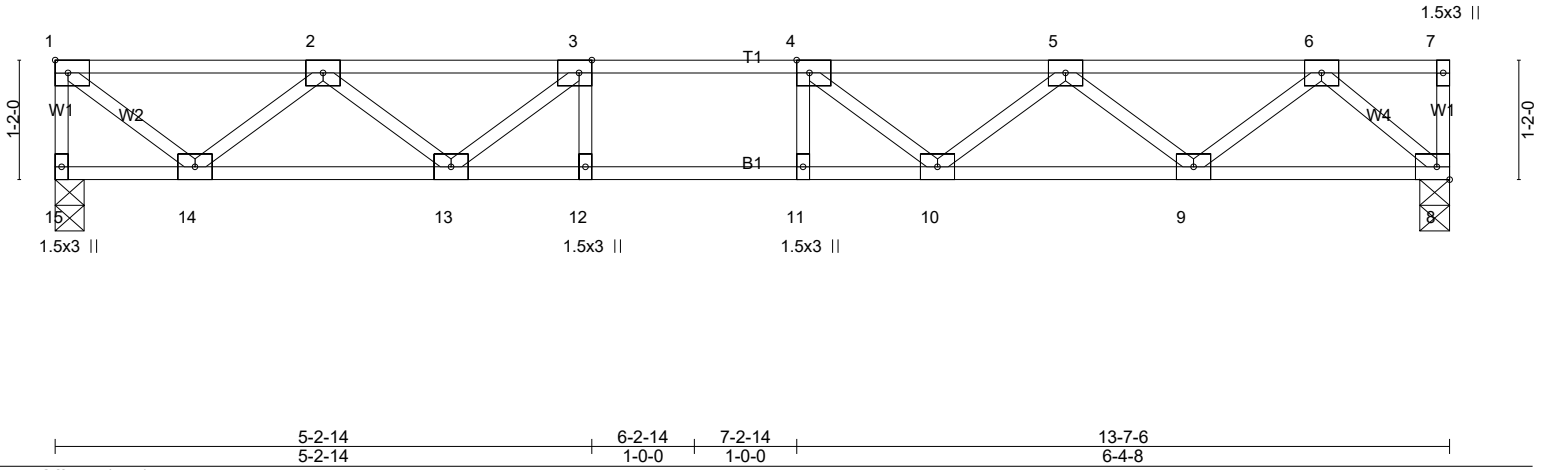

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.27	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.53	Vert(LL) -0.10 10-11 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.32	Vert(CT) -0.13 10-11 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2021/TPI2014			Weight: 67 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 15=495/0-3-6 (min. 0-1-8), 8=495/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-15=-492/0, 1-2=-528/0, 2-3=-1278/0, 3-4=-1571/0, 4-5=-1460/0, 5-6=-929/0
BOT CHORD 13-14=0/1014, 12-13=0/1571, 11-12=0/1571, 10-11=0/1571, 9-10=0/1308, 8-9=0/531
WEBS 3-13=-438/0, 2-13=0/347, 2-14=-633/0, 1-14=0/676, 4-10=-275/13, 5-9=-494/0, 6-9=0/518, 6-8=-706/0

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F227	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	-------------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8,430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:12 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-94XYpcWB0UjQWS3gbWbuMSI?V7xzWphY8gykeVzgd5f

Scale = 1:19.5

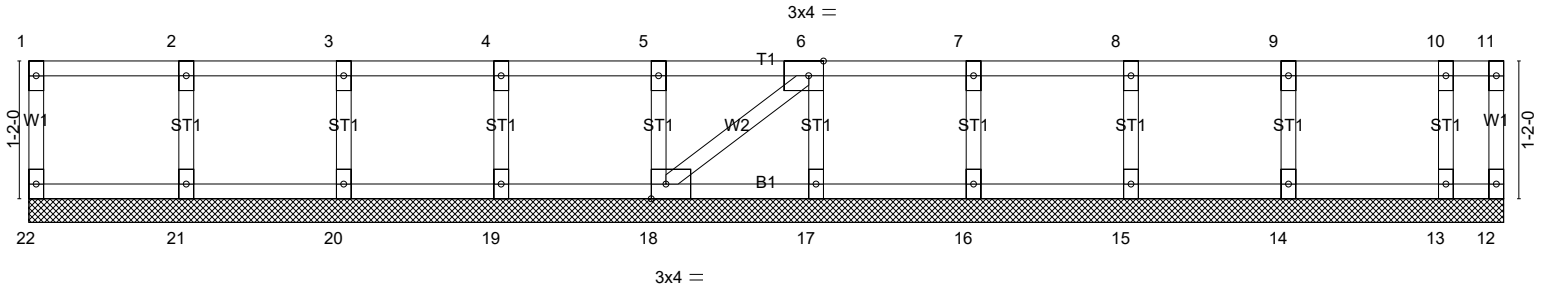


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [18:0-1-8,Edge]		12-5-14		12-5-14						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.06	Vert(LL) n/a	-	n/a	999		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.01	Vert(CT) n/a	-	n/a	999			
BCLL 0.0	Rep Stress Incr YES		WB 0.03	Horz(CT) -0.00	17	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 54 lb	FT = 20%F, 11%E

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.1(flat)	TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.1(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS. All bearings 12-5-14.
(lb) - Max Uplift All uplift 100 lb or less at joint(s) 12
Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F228	Truss Type Floor	Qty 3	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8,430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:13 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-eH4w1yXpnnrH8ces9D67uf13mX7WF85hNKhIAygzd5e

0-5-4 1-3-0

2-0-0

0-5-8

Scale = 1:32.7

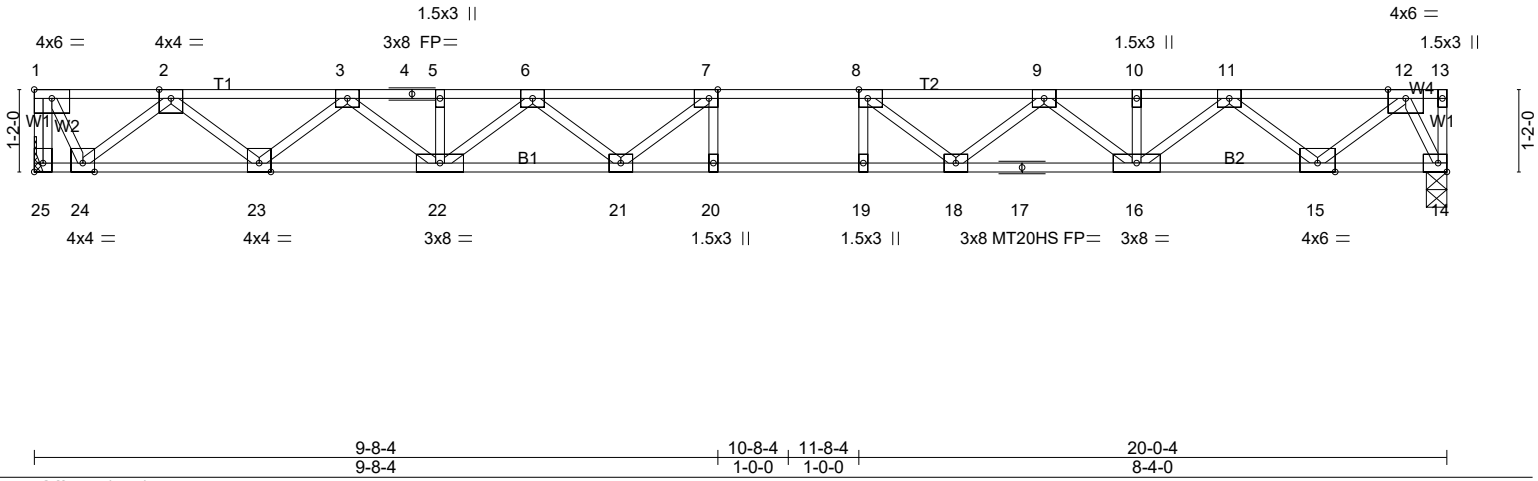


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge], [25:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3 Plate Grip DOL 1.00	TC 0.54	Vert(LL) -0.36	20	>660	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.69	Vert(CT) -0.50	20	>480	360		MT20HS	187/143
BCLL 0.0	Rep Stress Incr YES	WB 0.54	Horz(CT) 0.07	14	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH							
								Weight: 102 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP SS(flat) *Except*
B2: 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 25=872/Mechanical, 14=872/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-25=-872/0, 1-2=-442/0, 2-3=-2137/0, 3-4=-3356/0, 4-5=-3356/0, 5-6=-3356/0, 6-7=-3980/0, 7-8=-4104/0, 8-9=-3723/0, 9-10=-2828/0, 10-11=-2828/0, 11-12=-1321/0
BOT CHORD 23-24=0/1407, 22-23=0/2842, 21-22=0/3800, 20-21=0/4104, 19-20=0/4104, 18-19=0/4104, 17-18=0/3387, 16-17=0/3387, 15-16=0/2164, 14-15=0/457
WEBS 7-21=-468/166, 6-21=0/378, 6-22=-567/0, 3-22=0/657, 3-23=-917/0, 2-23=0/950, 2-24=-1256/0, 1-24=0/931, 8-18=-689/0, 9-18=0/517, 9-16=-713/0, 11-16=0/848, 11-15=-1097/0, 12-15=0/1124, 12-14=-1023/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.


Job 24-1169-F02	Truss F229	Truss Type Floor	Qty 6	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:14 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-6TeIEIXRY5z8mmD3iwdMRtqDnxRZ_dpcc_RrjOzgd5d



Scale = 1:27.1

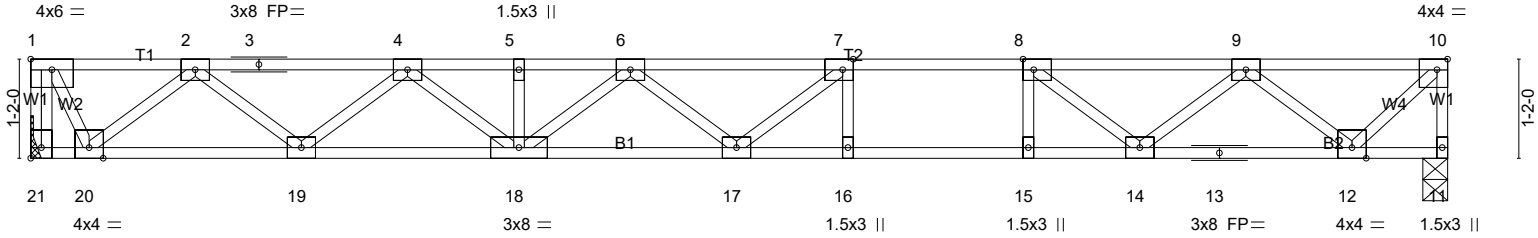

9-8-4	10-8-4	11-8-4	16-8-4
9-8-4	1-0-0	1-0-0	5-0-0

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge], [10:0-1-8,Edge], [21:Edge,0-1-8]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.59	Vert(LL)	-0.26	16-17	>760	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.77	Vert(CT)	-0.36	16-17	>554	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.44	Horz(CT)	0.04	11	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 84 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP SS(flat) *Except*
B2: 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 21=726/Mechanical, 11=726/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-21=-725/0, 10-11=-730/0, 1-2=-363/0, 2-3=-1710/0, 3-4=-1710/0, 4-5=-2559/0, 5-6=-2559/0, 6-7=-2831/0, 7-8=-2622/0, 8-9=-1921/0, 9-10=-661/0
BOT CHORD 19-20=0/1154, 18-19=0/2237, 17-18=0/2855, 16-17=0/2622, 15-16=0/2622, 14-15=0/2622, 13-14=0/1395, 12-13=0/1395
WEBS 7-16=-301/0, 8-15=0/327, 7-17=-128/410, 6-18=-377/0, 4-18=0/412, 4-19=-686/0, 2-19=0/724, 2-20=-1029/0, 1-20=0/764, 8-14=-924/0, 9-14=0/685, 9-12=-955/0, 10-12=0/926

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-1169-F02	Truss F230	Truss Type Floor	Qty 3	Ply 1	LOT 0.0002 HONEYCUTT HILLS 37 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 45907
--------------------	---------------	---------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:14 2024 Page 1
ID:oDuWOOMhLxMOJ2fwcp2aKqzMG6w-6TelEIXRY5z8mmD3iwdMRtqGNxPU_d2rc_RrjOzgd5d



Scale = 1:24.5

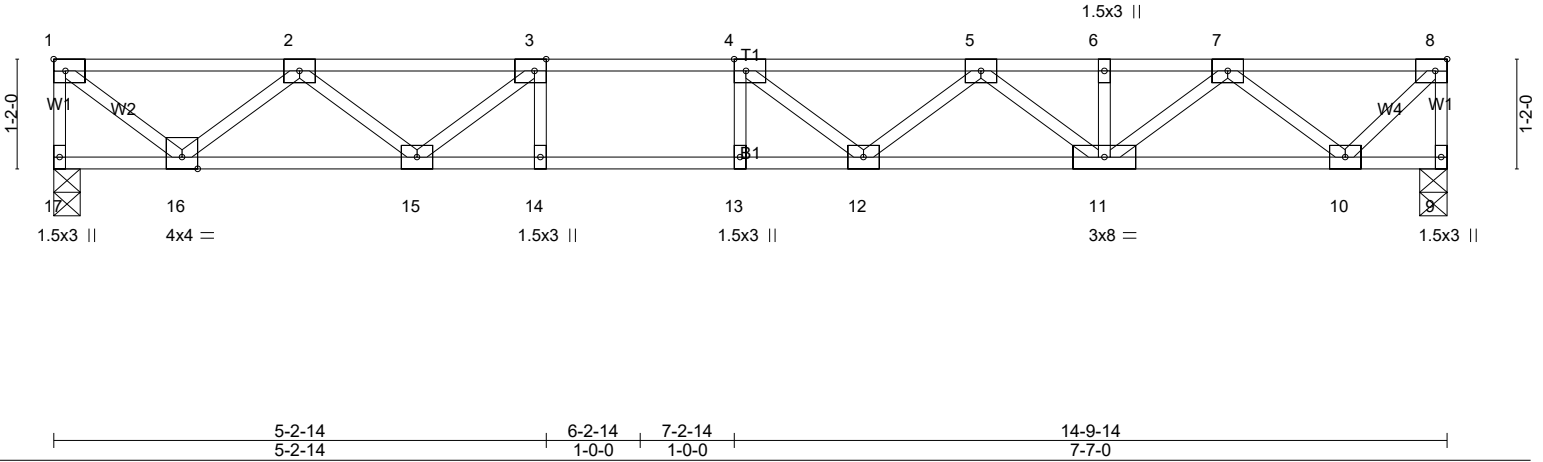


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.42	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.84	Vert(LL) -0.17 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.43	Vert(CT) -0.23 12-13 >772 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 74 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 17=646/0-3-6 (min. 0-1-8), 9=646/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-17=-645/0, 8-9=-644/0, 1-2=-699/0, 2-3=-1727/0, 3-4=-2198/0, 4-5=-2181/0, 5-6=-1669/0, 6-7=-1669/0, 7-8=-558/0
BOT CHORD 15-16=0/1338, 14-15=0/2198, 13-14=0/2198, 12-13=0/2198, 11-12=0/2067, 10-11=0/1219
WEBS 3-15=-663/0, 2-15=0/506, 2-16=-833/0, 1-16=0/895, 4-12=-261/150, 5-12=0/252, 5-11=-509/0, 7-11=0/573, 7-10=-861/0, 8-10=0/797

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Wed Feb 28 12:34:16 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-2sm3f_Zi4iDs?4MRqLfqWlwWzk4sSVq73lwynHzgd5b



Scale = 1:30.1

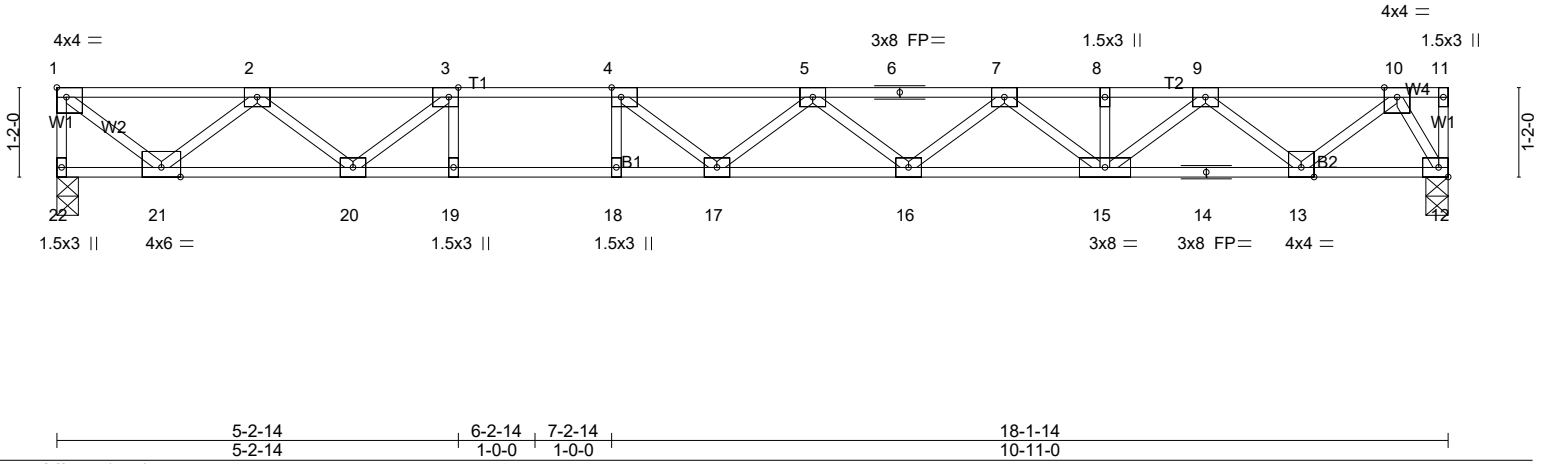


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge]					
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.80	Vert(LL) -0.35 17-18 >620 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.90	Vert(CT) -0.48 17-18 >451 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.54	Horz(CT) 0.05 12 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 90 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP SS(flat) *Except*
 B2: 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 22=793/0-3-6 (min. 0-1-8), 12=793/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-22=-795/0, 1-2=-880/0, 2-3=-2261/0, 3-4=-3062/0, 4-5=-3379/0, 5-6=-3223/0, 6-7=-3223/0, 7-8=-2533/0, 8-9=-2533/0, 9-10=-1237/0

BOT CHORD 20-21=0/1677, 19-20=0/3062, 18-19=0/3062, 17-18=0/3062, 16-17=0/3467, 15-16=0/2976, 14-15=0/1977, 13-14=0/1977, 12-13=0/476

WEBS 3-19=0/383, 4-18=-357/0, 3-20=-1056/0, 2-20=0/761, 2-21=-1037/0, 1-21=0/1127, 4-17=-84/546, 5-16=-318/0, 7-16=0/321, 7-15=-565/0, 9-15=0/710, 9-13=-963/0, 10-13=0/991, 10-12=-949/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



2/27/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.