

Harnett County Department of Public Health

Operation Permit

PERMIT # SFD2404-0095

New Installation
 Septic Tank
 Nitrification Line
 Repair
 Expansion

PROPERTY LOCATION: 330 Double barrel ST (SR 1253)

Name: (owner) Smith Douglas Homes SUBDIVISION Duncans Crossing LOT # 61

System Installer: A+R


Basement with plumbing: Garage Number of Bedrooms 3 (6 people)

Type of Water Supply: Community Public Well Distance from well _____ feet

System Type: Type III B Types V and VI Systems expire in 5 years.

(In accordance with Table V a) Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

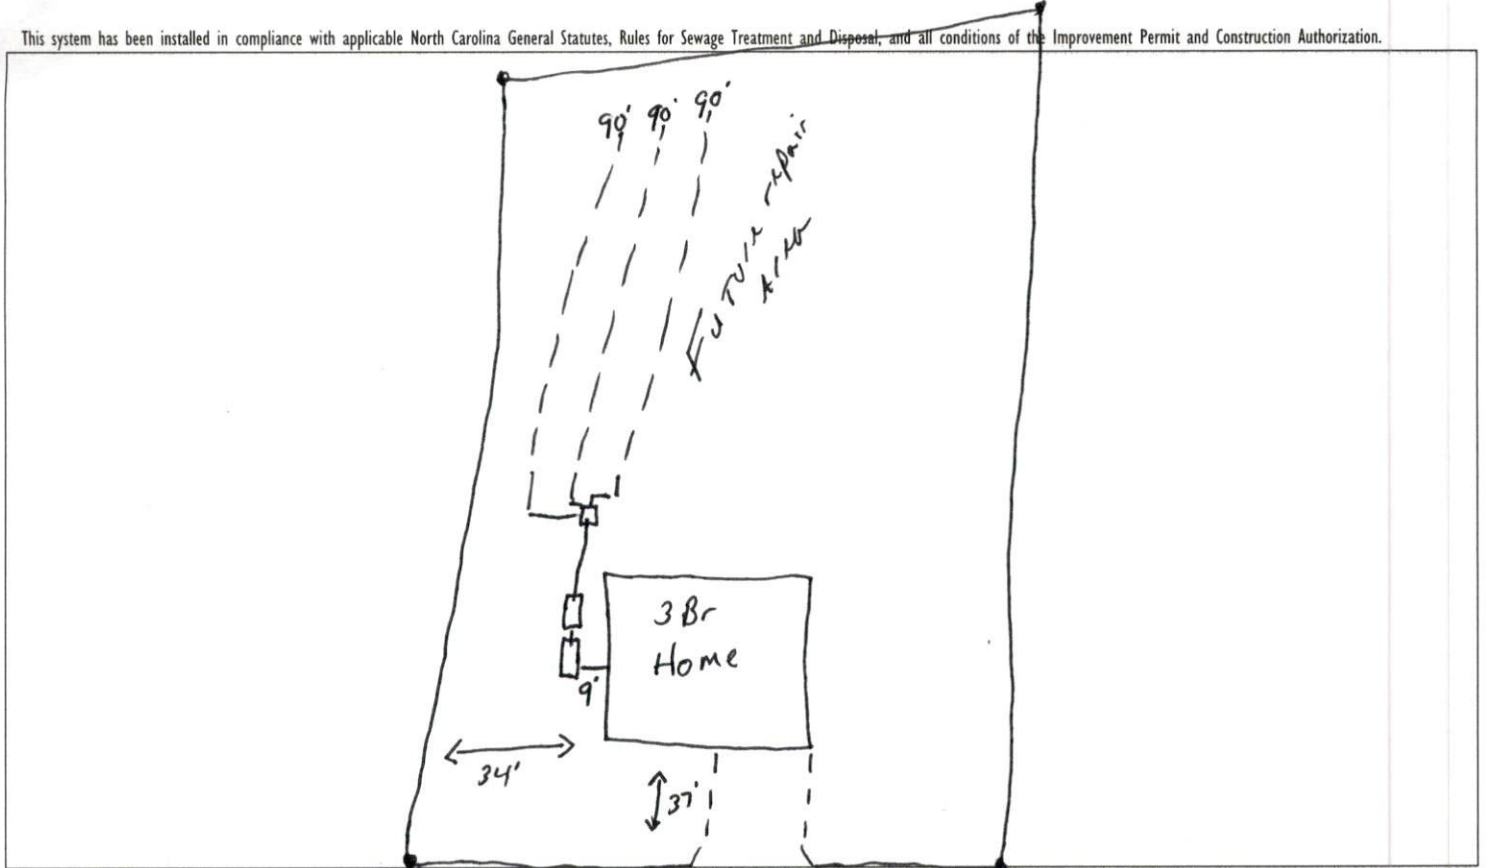

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

Manifold
 Box
 Pump
 Alarm
 H2O Line
 PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% reduction IQ4 Septic Tank: 1000 gallons Pump Tank: 1000 gallons

Subsurface No. of exact length width of depth of
 Drainage Field ditches of each ditch ditches ditches

3 90 feet 3 feet 21 inches

French Drain Required: _____ Linear feet

Authorized State Agent Mah [Signature] REHS Date 9-3-24