



Front Elevation
Scale: 1/4" = 1'0"




DATE: 1/5/2024
REVISED
DRAWING#


SCALE: 1/4"
DRAWN BY
APPROVED



Rear Elevation
Scale: 1/8" = 1'0"

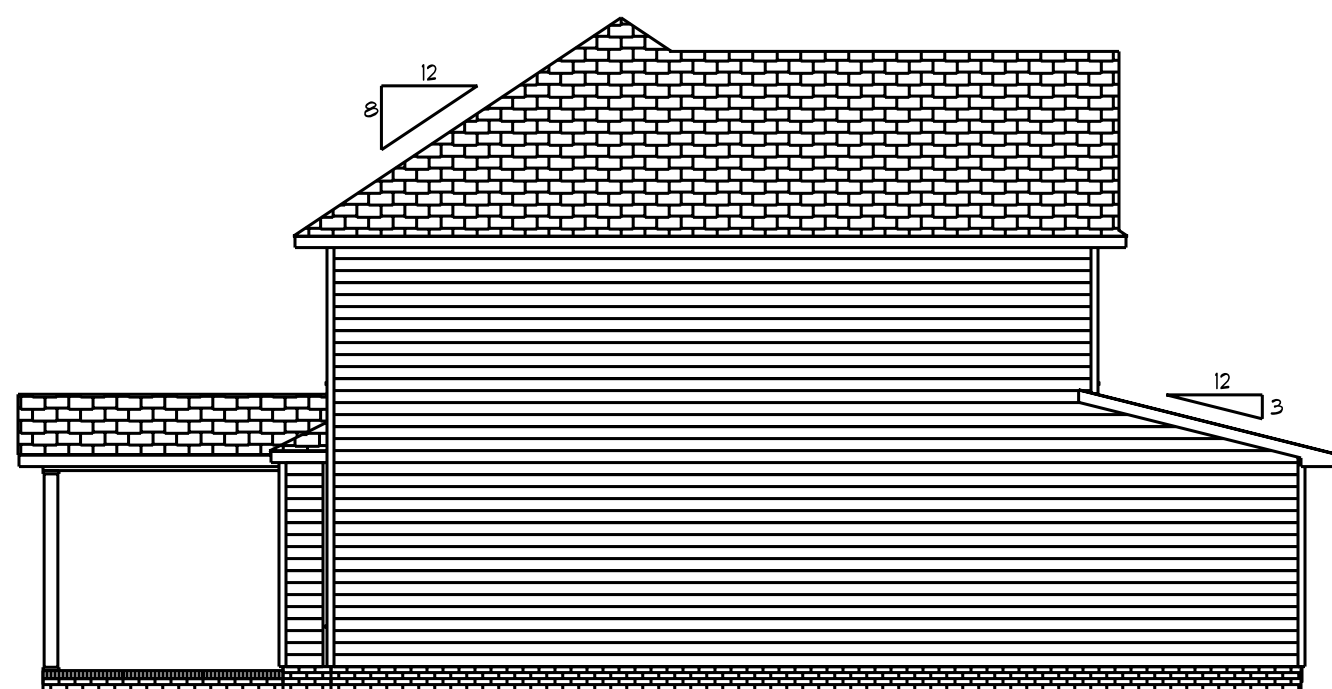


Left Elevation
Scale: 1/8" = 1'0"

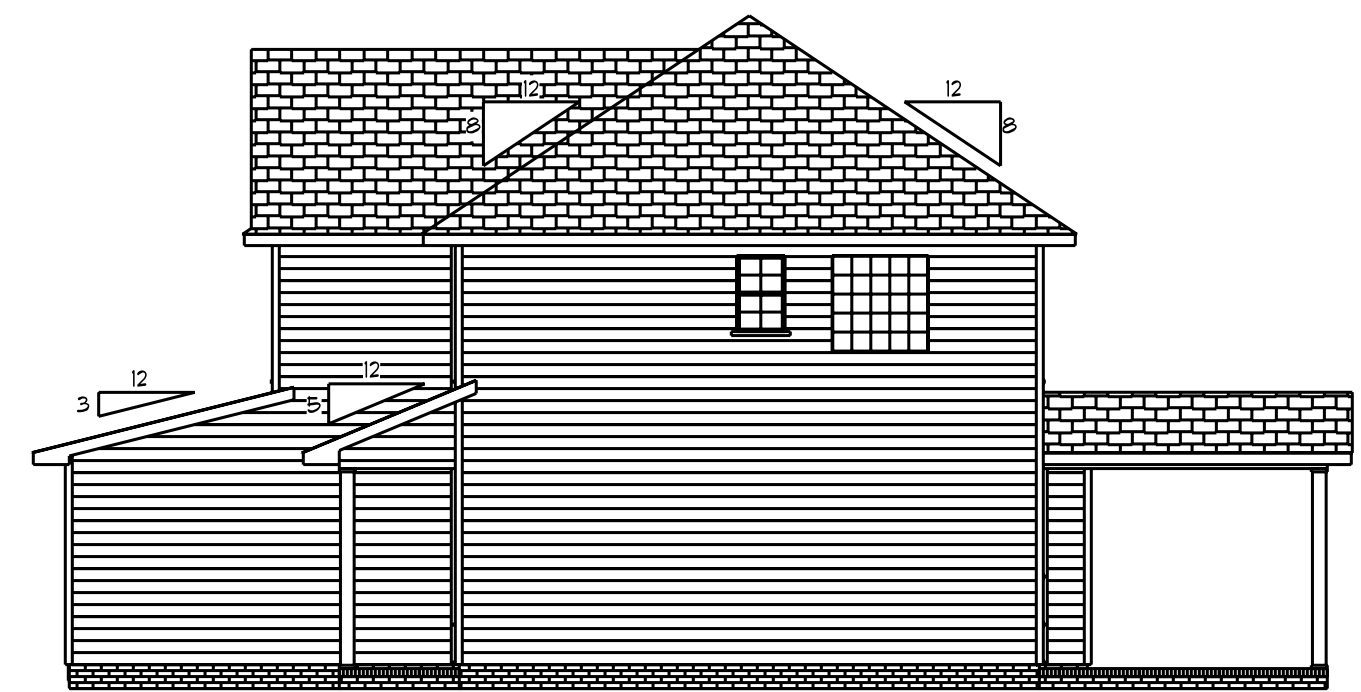

Right Elevation
Scale: 1/8" = 1'0"

Plan #13

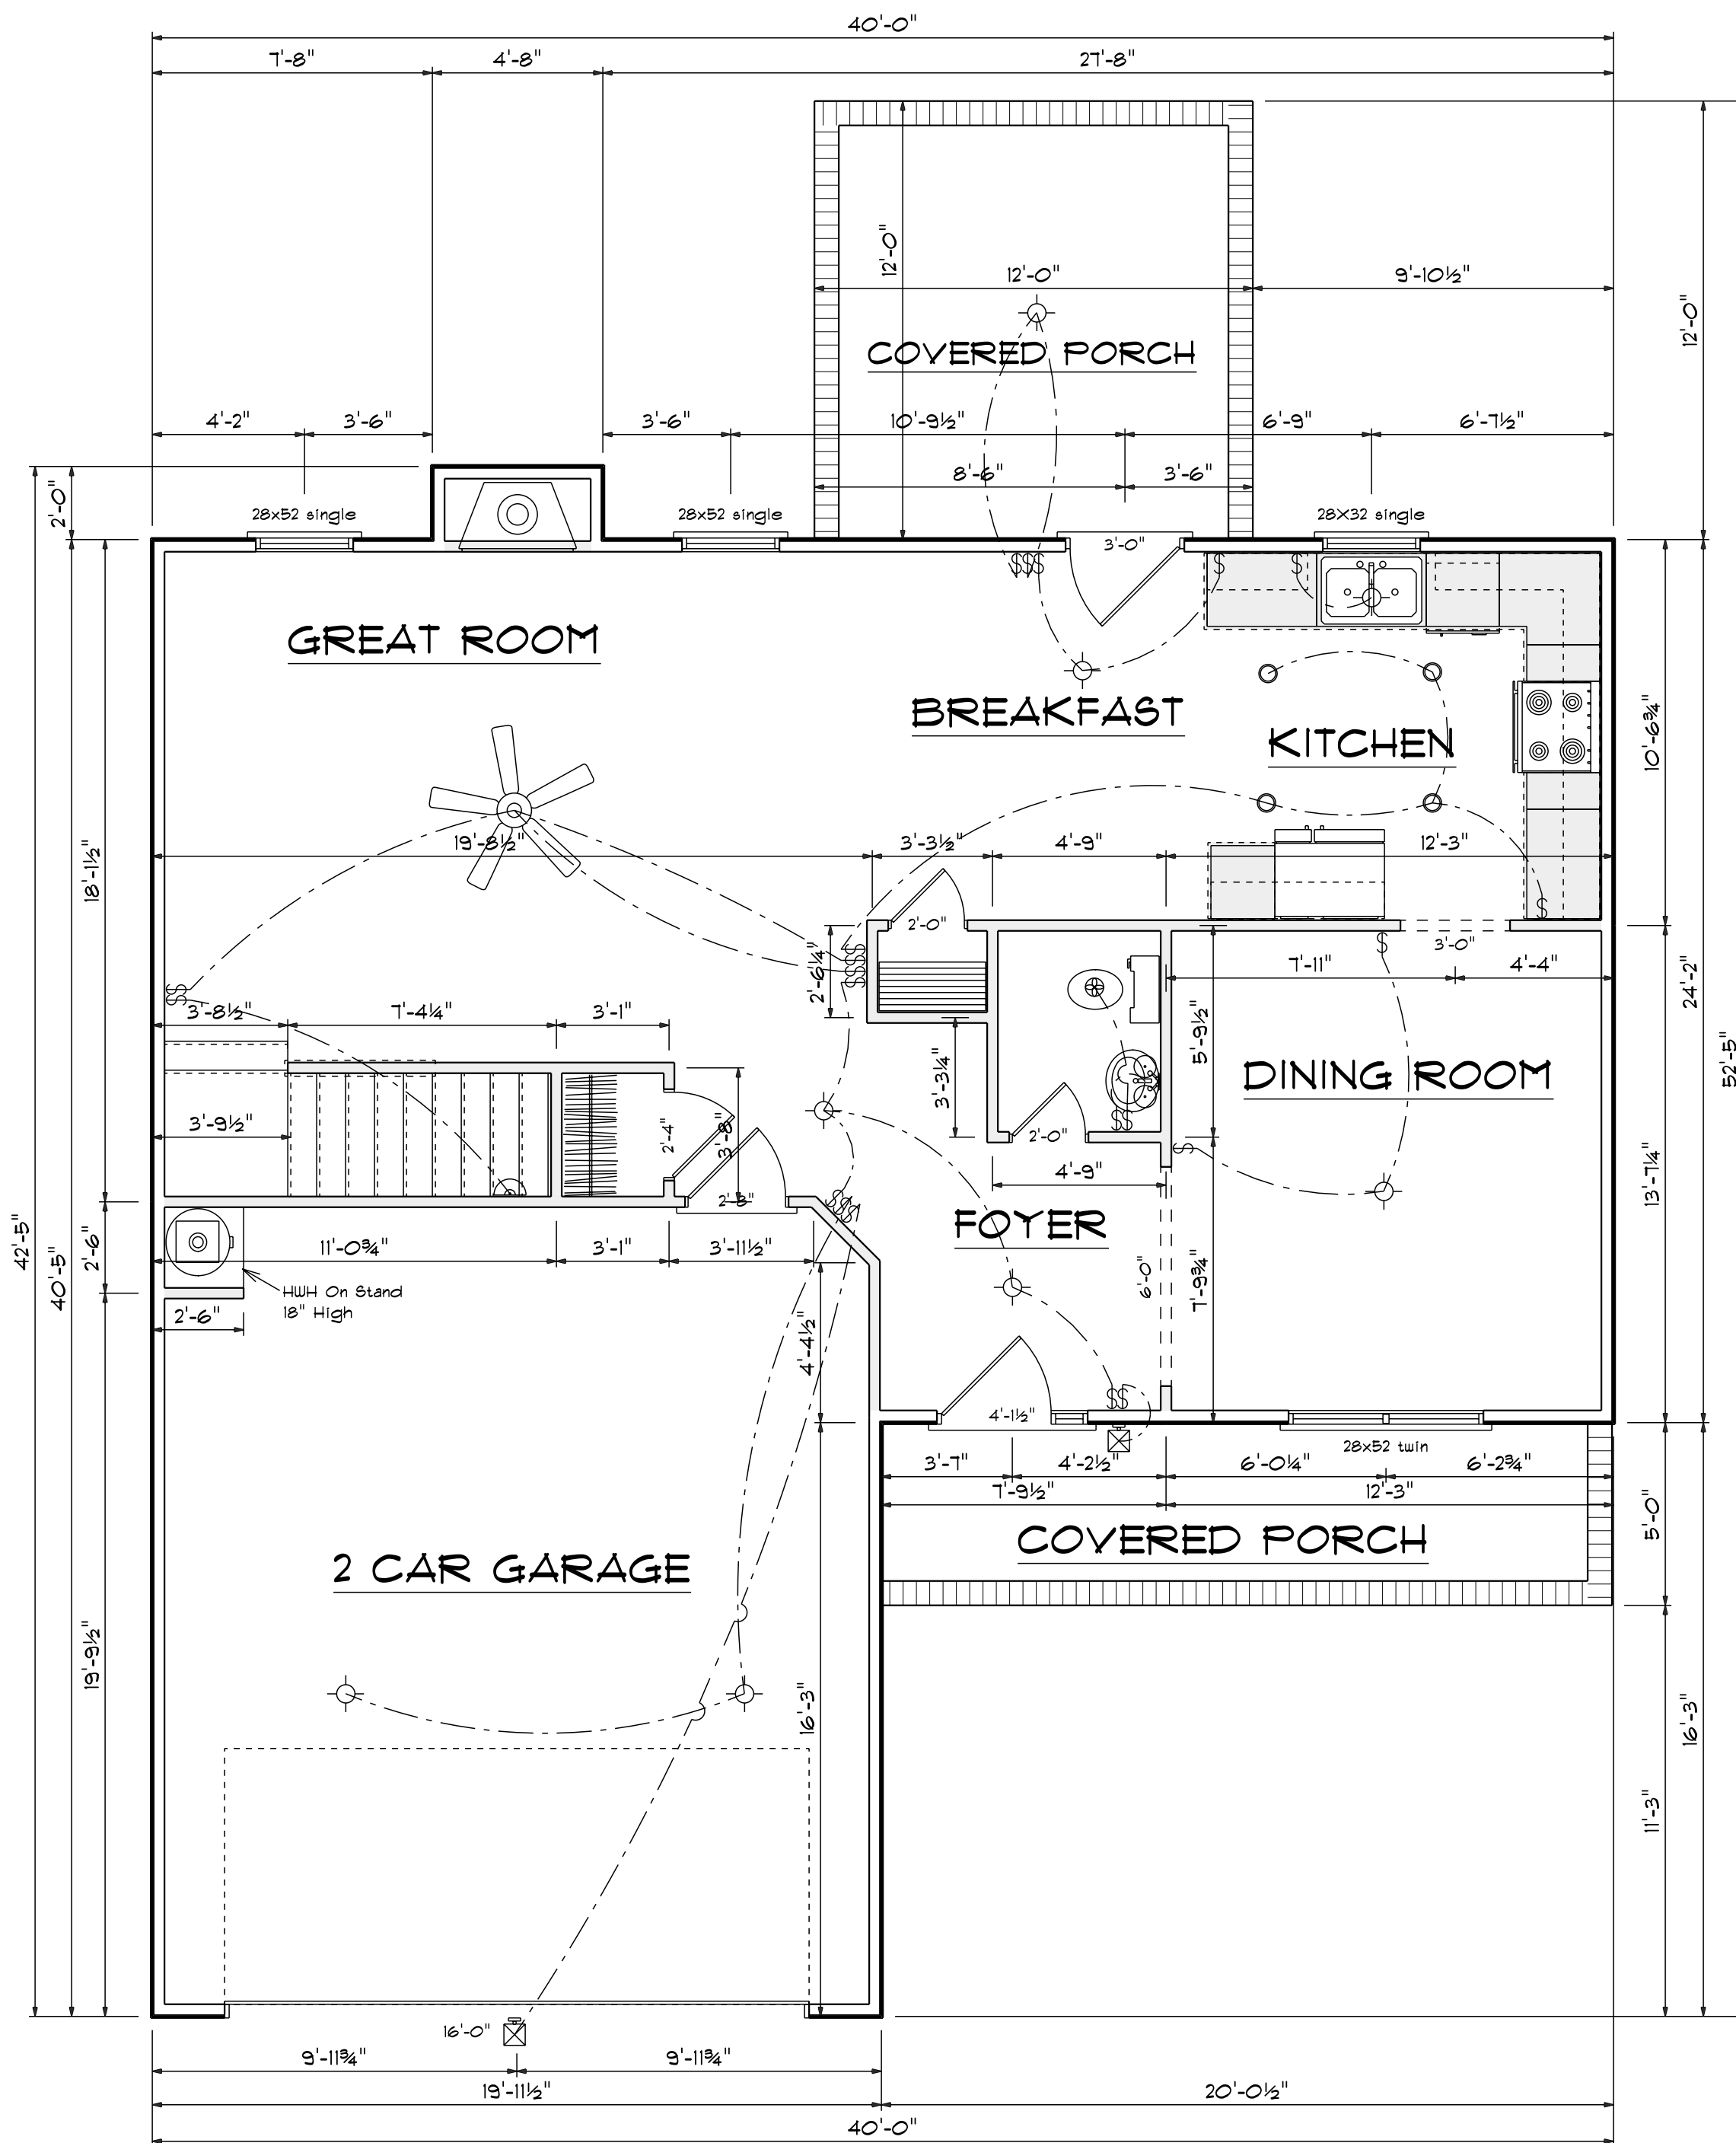

First Floor Plan

Scale: 1/4" = 1'-0"

FIRST FLOOR OPENING SCHEDULE				
PRODUCT CODE	SIZE	HINGE	REVERSED	COUNT
2-0 Door Unit	2'-0"	L	NO	2
2-4 Door Unit	2'-4"	R	NO	1
2-8 Door Unit	2'-8"	L	NO	1
28X32 single	2'-8" x 3'-2"	N	NA	1
28x52 single	2'-8" x 5'-2"	N	NA	2
28x52 twin	5'-4" x 5'-2"	NN	NA	1
50X80 LH ENTRY - 1 SL	4'-1 1/2"	L	NA	1
36X80 FRENCH 2	3'-0"	L	NO	1
192X84 - 8 PANEL GARAGE DR	16'-0"	U	NO	1

Areas

First Floor	858
Second Floor	1082
=====	
Total Heated	1940
Garage	450
Front Porch	99
Rear Porch	144

DATE: 1/5/2024

REVISED


DRAWING#

SCALE: 1/4"

DRAWN BY

APPROVED

Plan #13

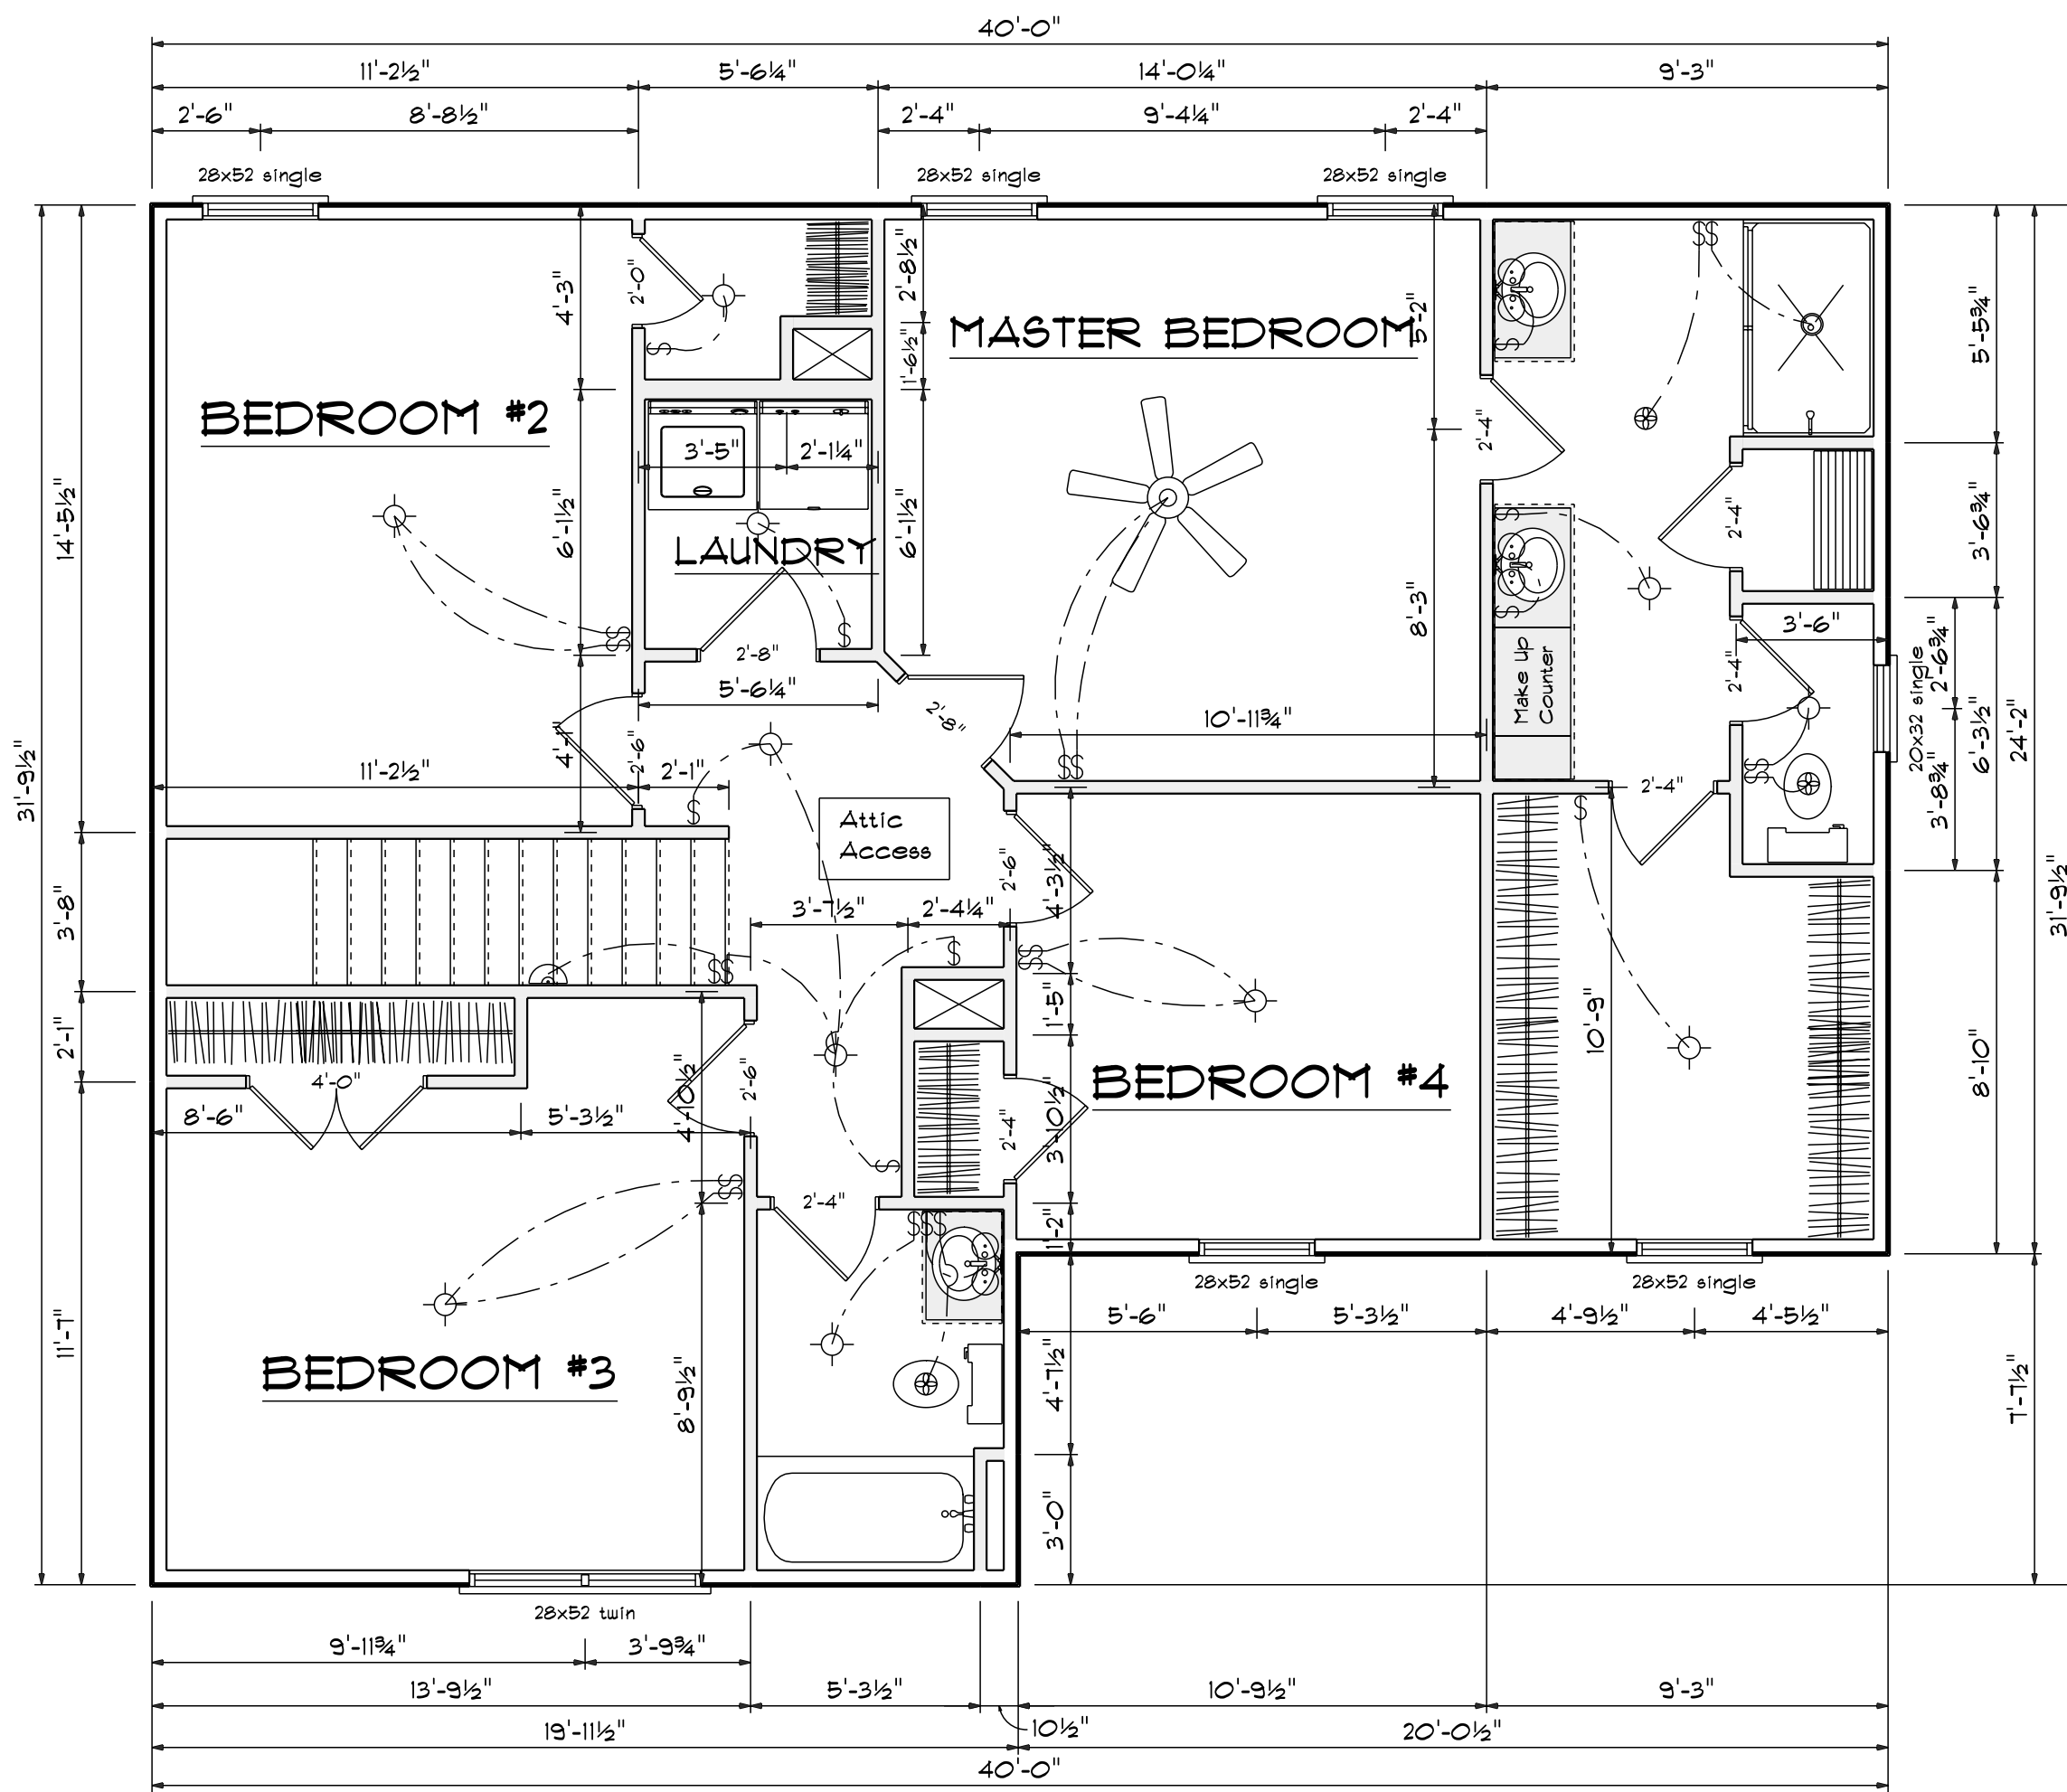




Second Floor Plan
 Scale: 1/4" = 1'-0"

SECOND FLOOR OPENING SCHEDULE				
PRODUCT CODE	SIZE	HINGE	REVERSED	COUNT
2-0 Door Unit	2'-0"	L	NO	1
2-4 Door Unit	2'-4"	L	NO	3
2-4 Door Unit	2'-4"	R	NO	3
2-6 Door Unit	2'-6"	L	NO	2
2-6 Door Unit	2'-6"	R	NO	1
2-8 Door Unit	2'-8"	L	NO	2
4-0 Doublehung Door Unit	4'-0"	LR	NO	1
20x32 single	2'-0" x 3'-2"	N	NA	1
28x52 single	2'-8" x 5'-2"	N	NA	5
28x52 twin	5'-4" x 5'-2"	NN	NA	1

DATE: 1/5/2024
 REVISED
 DRAWING#

SCALE: 1/4"
 DRAWN BY
 APPROVED


Plan #13

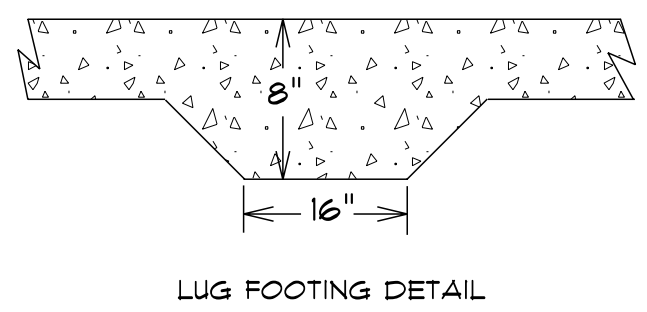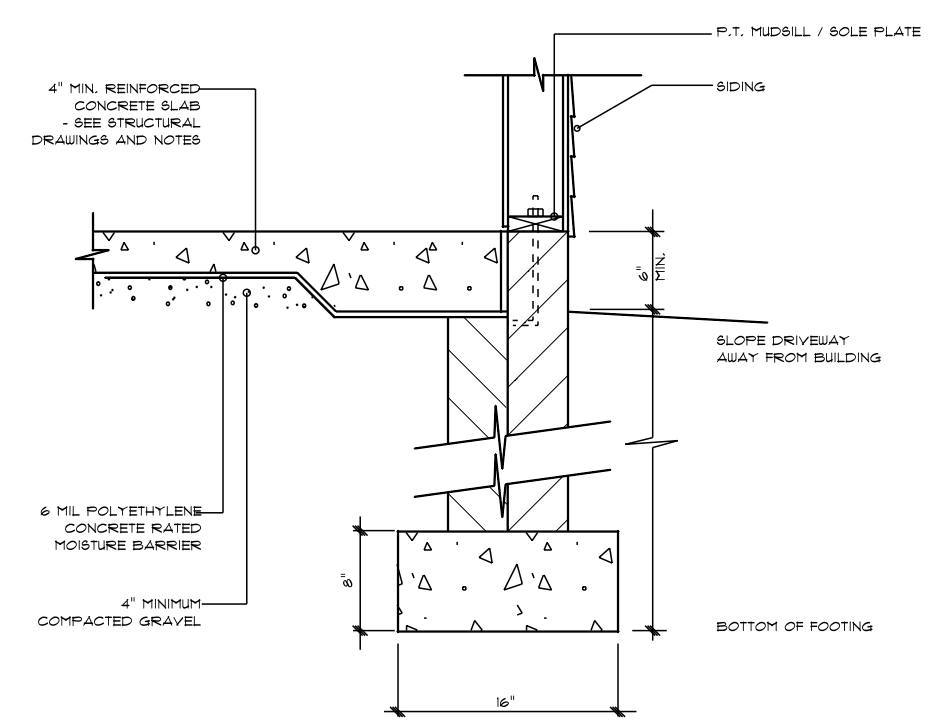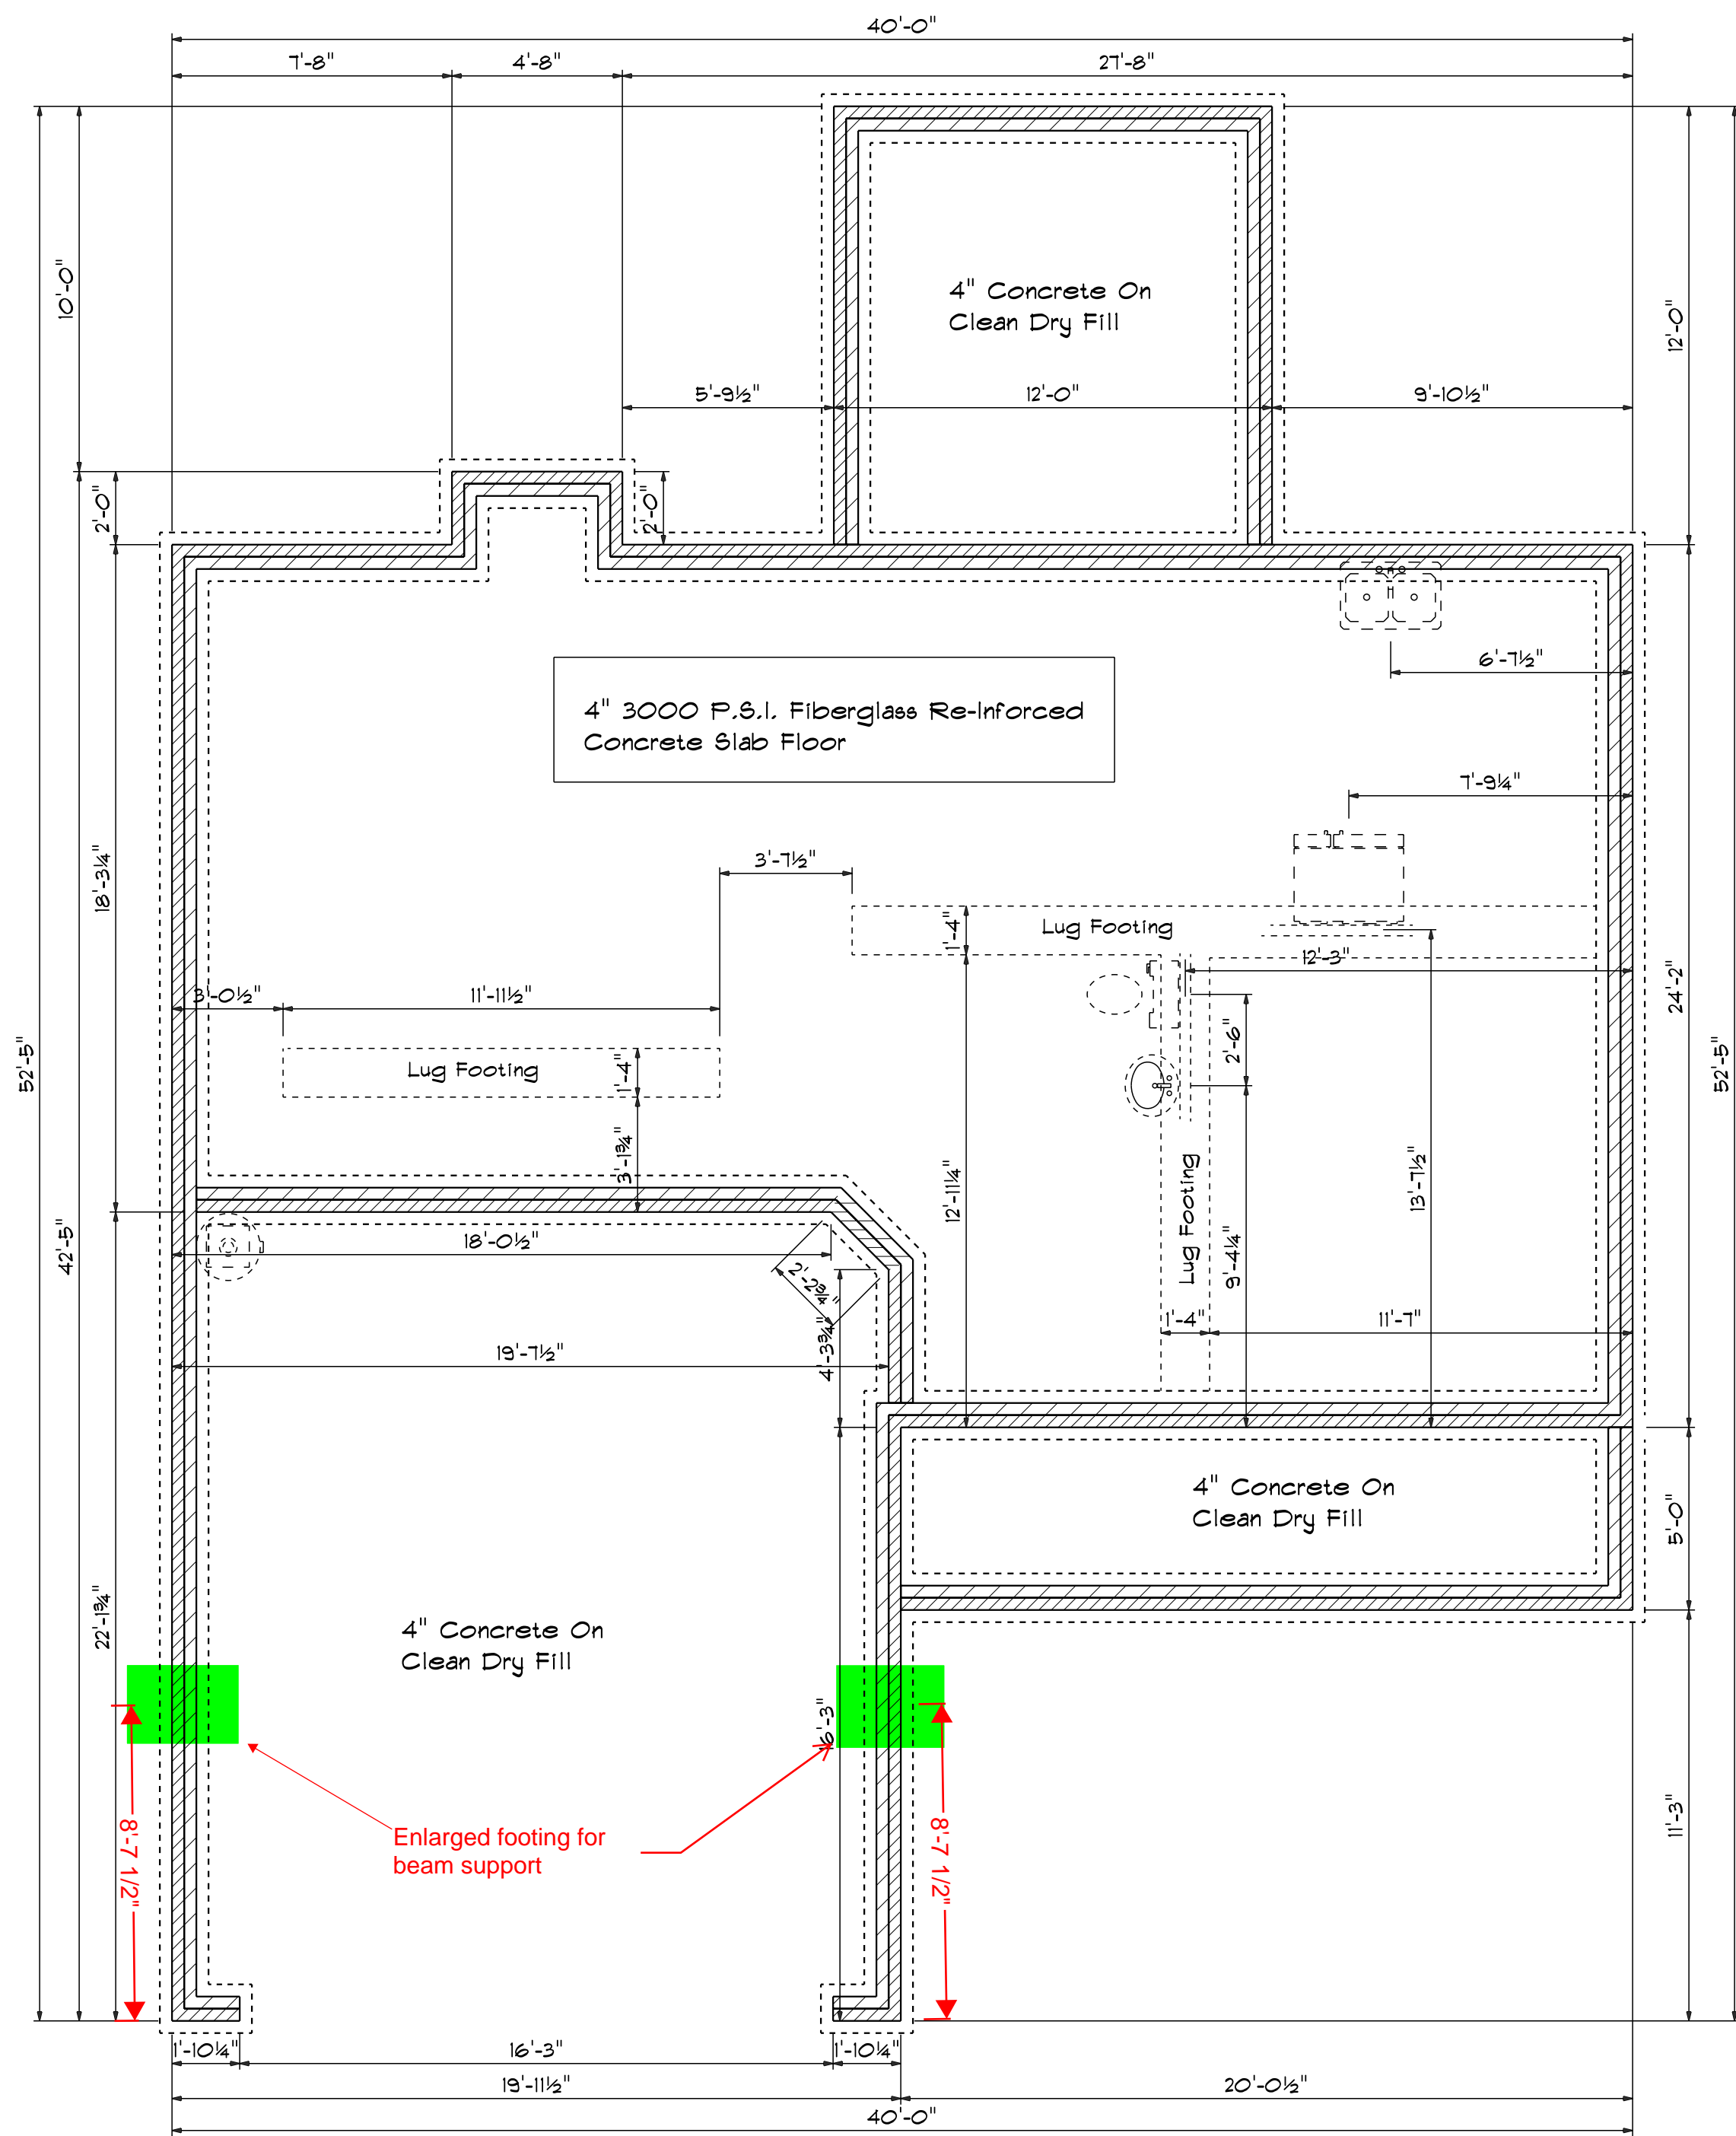


Foundation Plan
 Scale: 1/4" = 1'-0"

DATE: 1/5/2024	REVIS	DRAWING#
SCALE: 1/4"	DRAWN BY	APPROVED


Plan #13

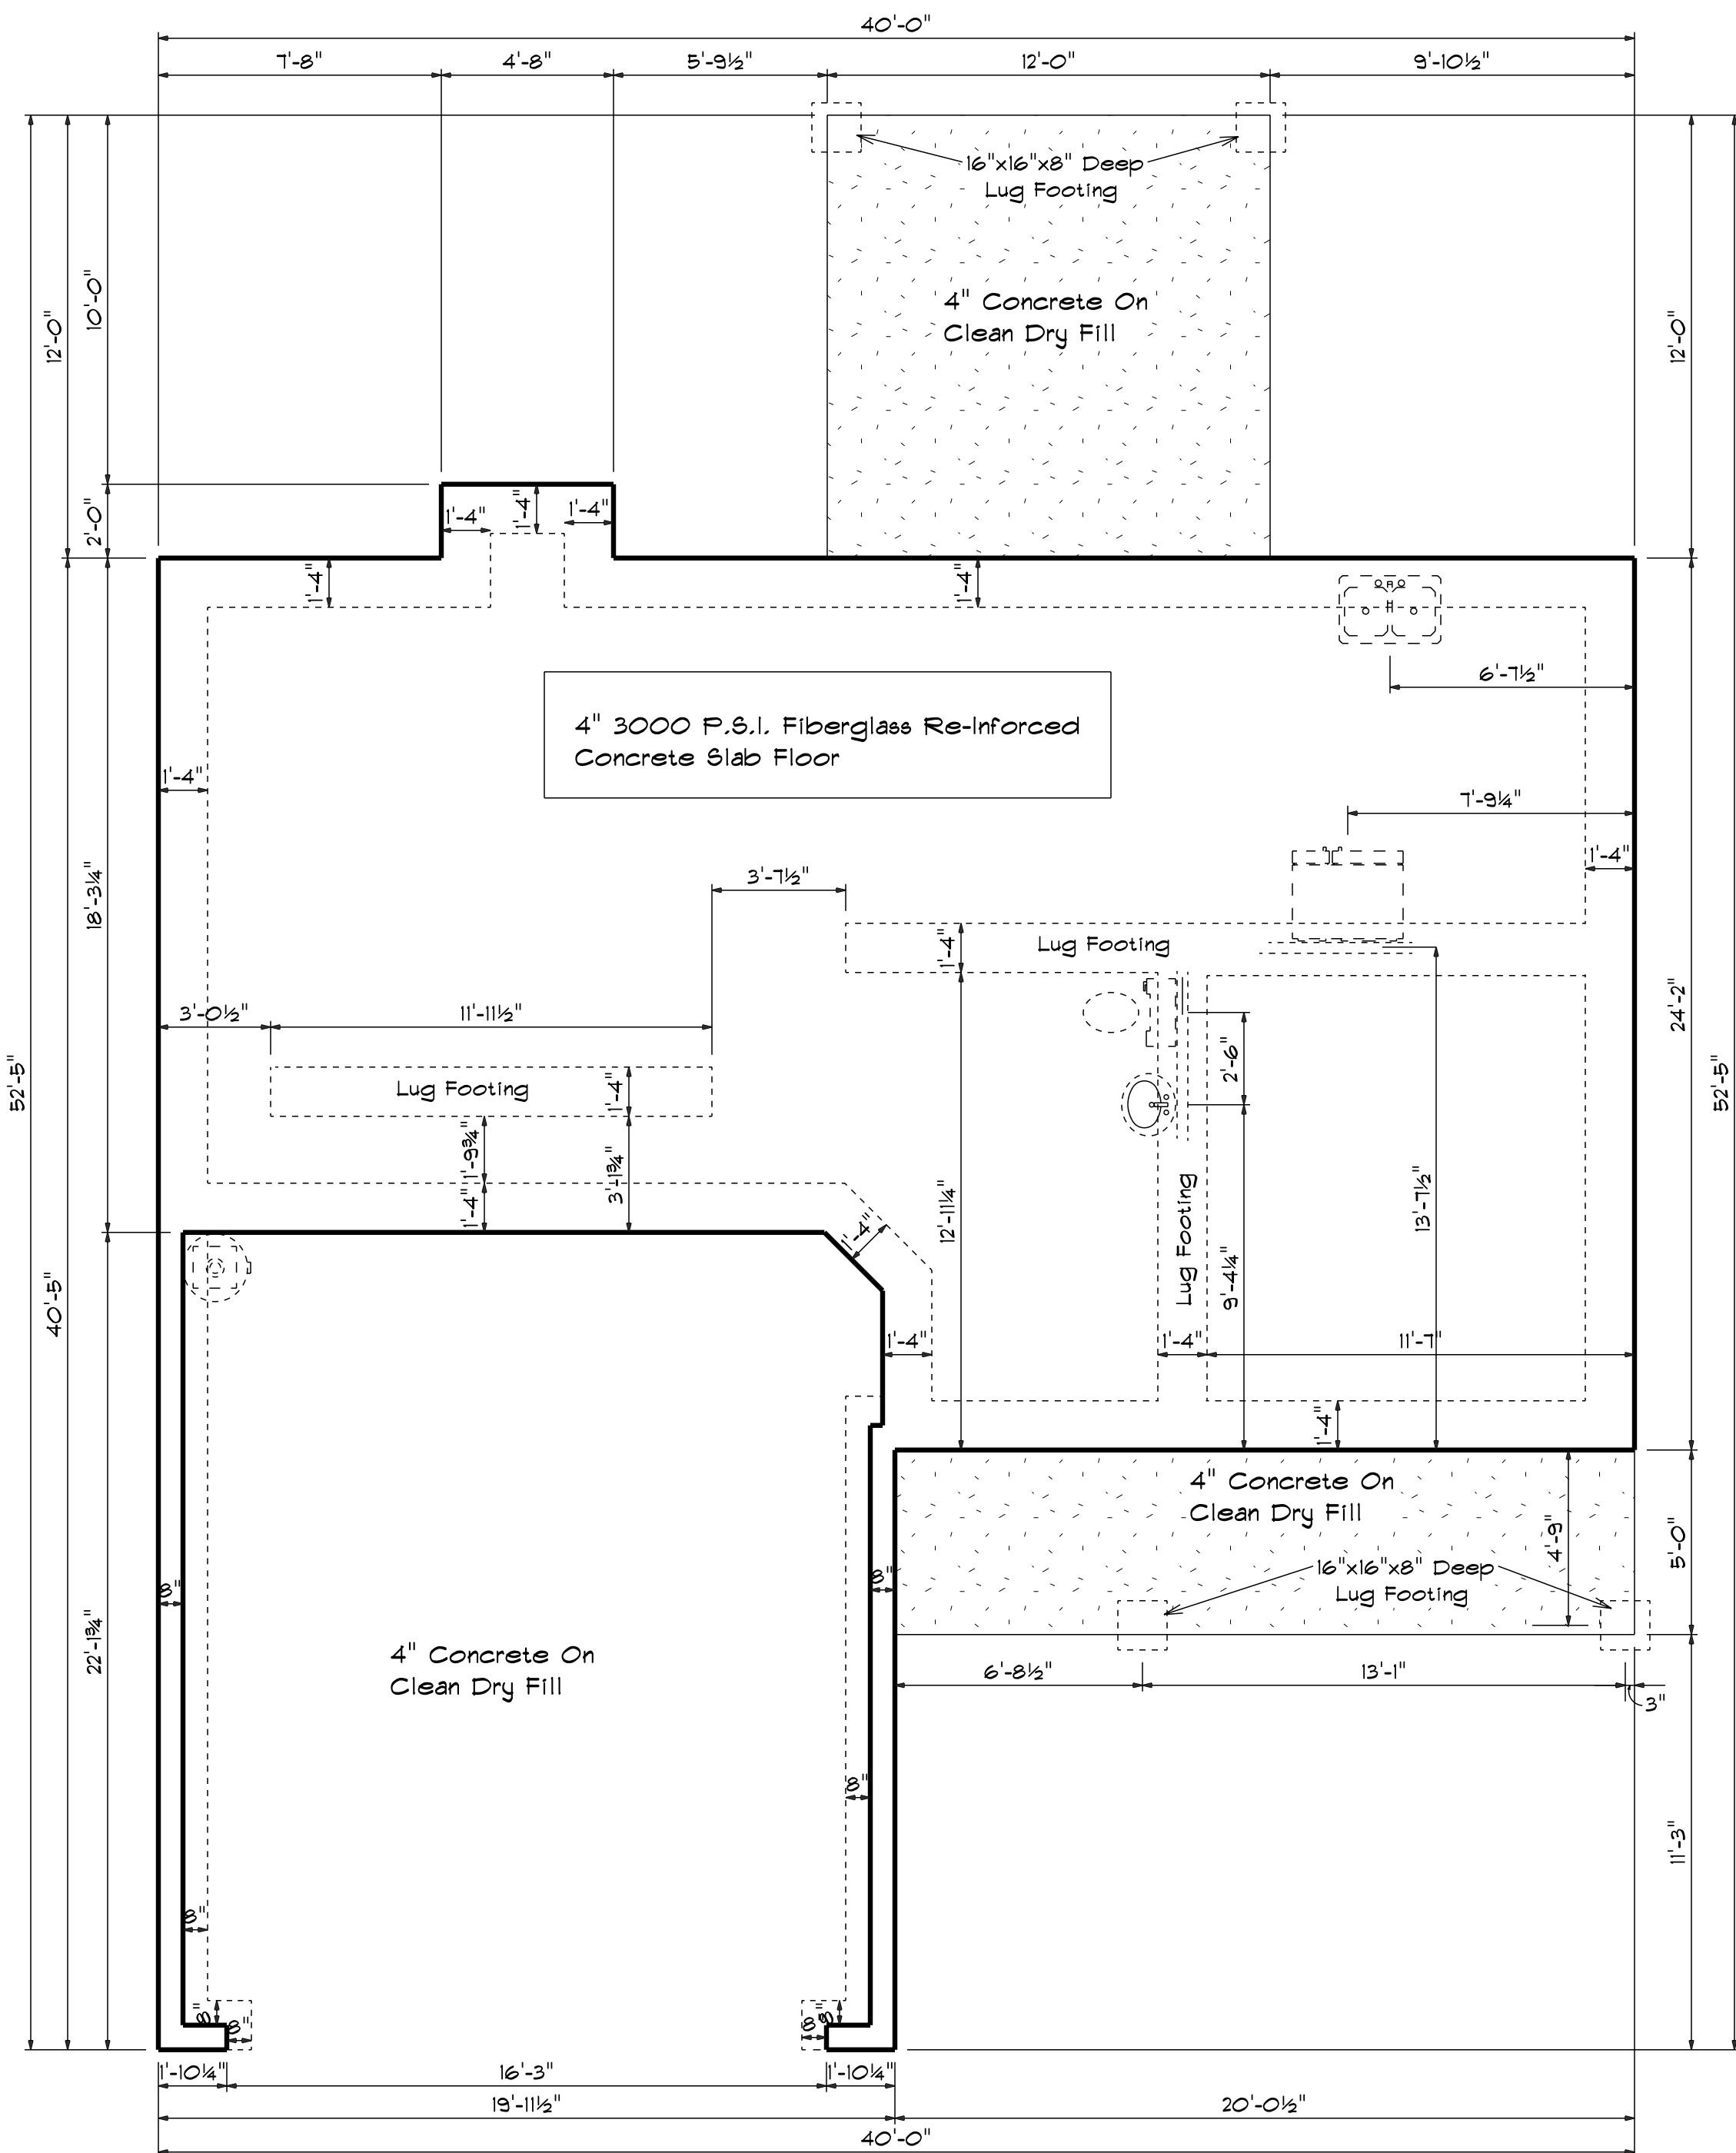

Foundation Plan
 Scale: 1/4" = 1'-0"

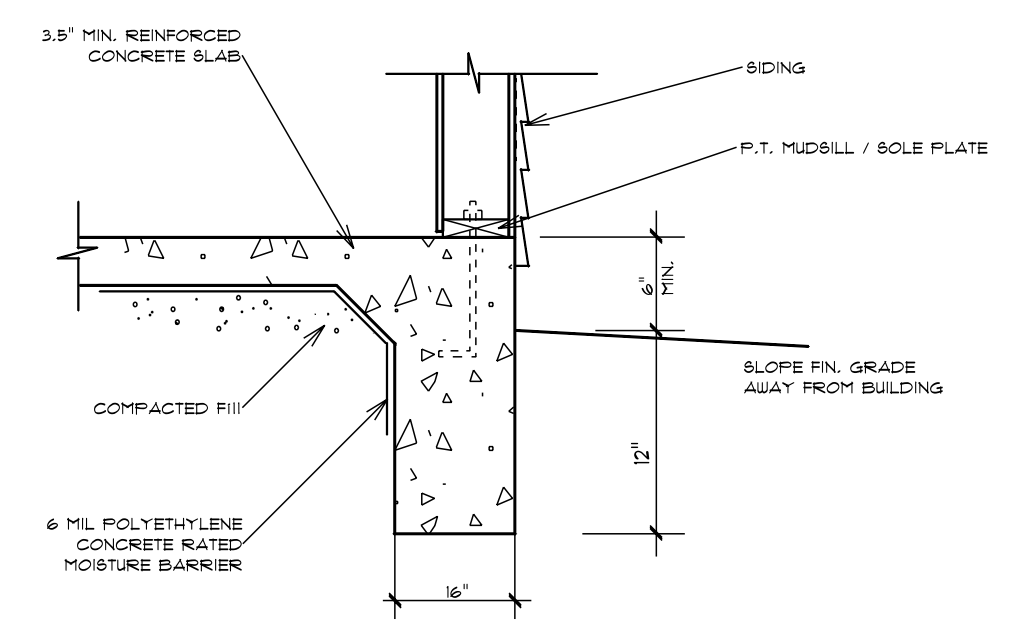

**TURN-DOWN
FOOTING DETAIL**

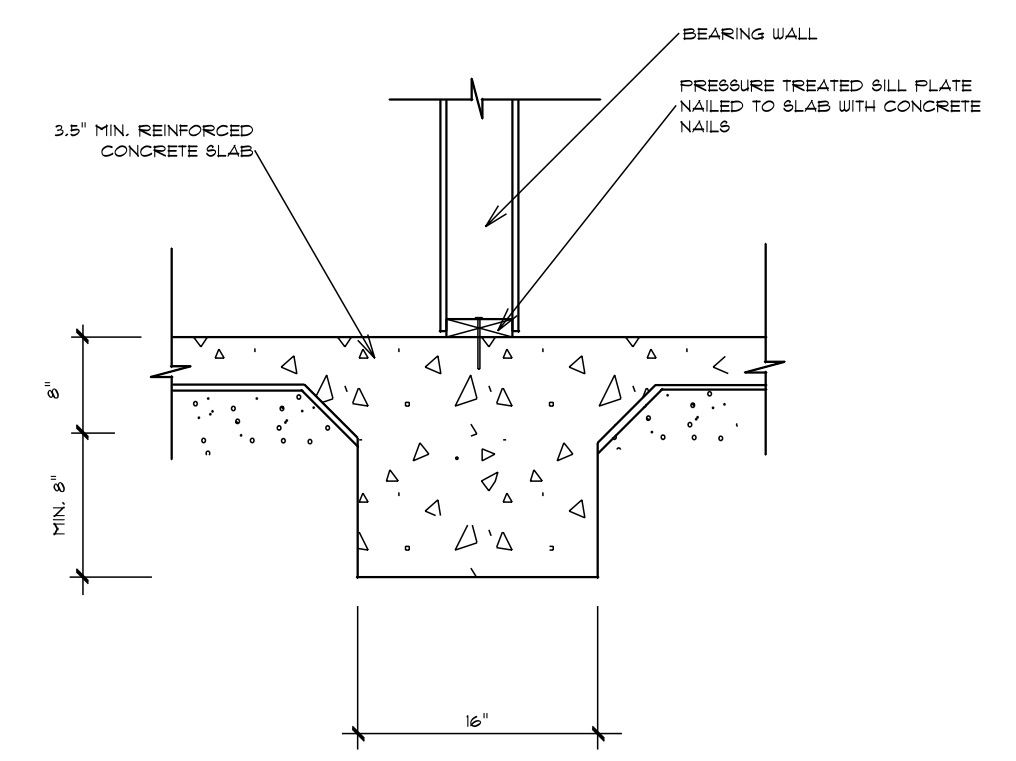


**INTEGRAL SLAB FOOTING
DETAIL AT BEARING WALL**

DATE: 1/5/2024
 REVISED
 DRAWING#

SCALE: 1/4"
 DRAWN BY
 APPROVED

Plan #13

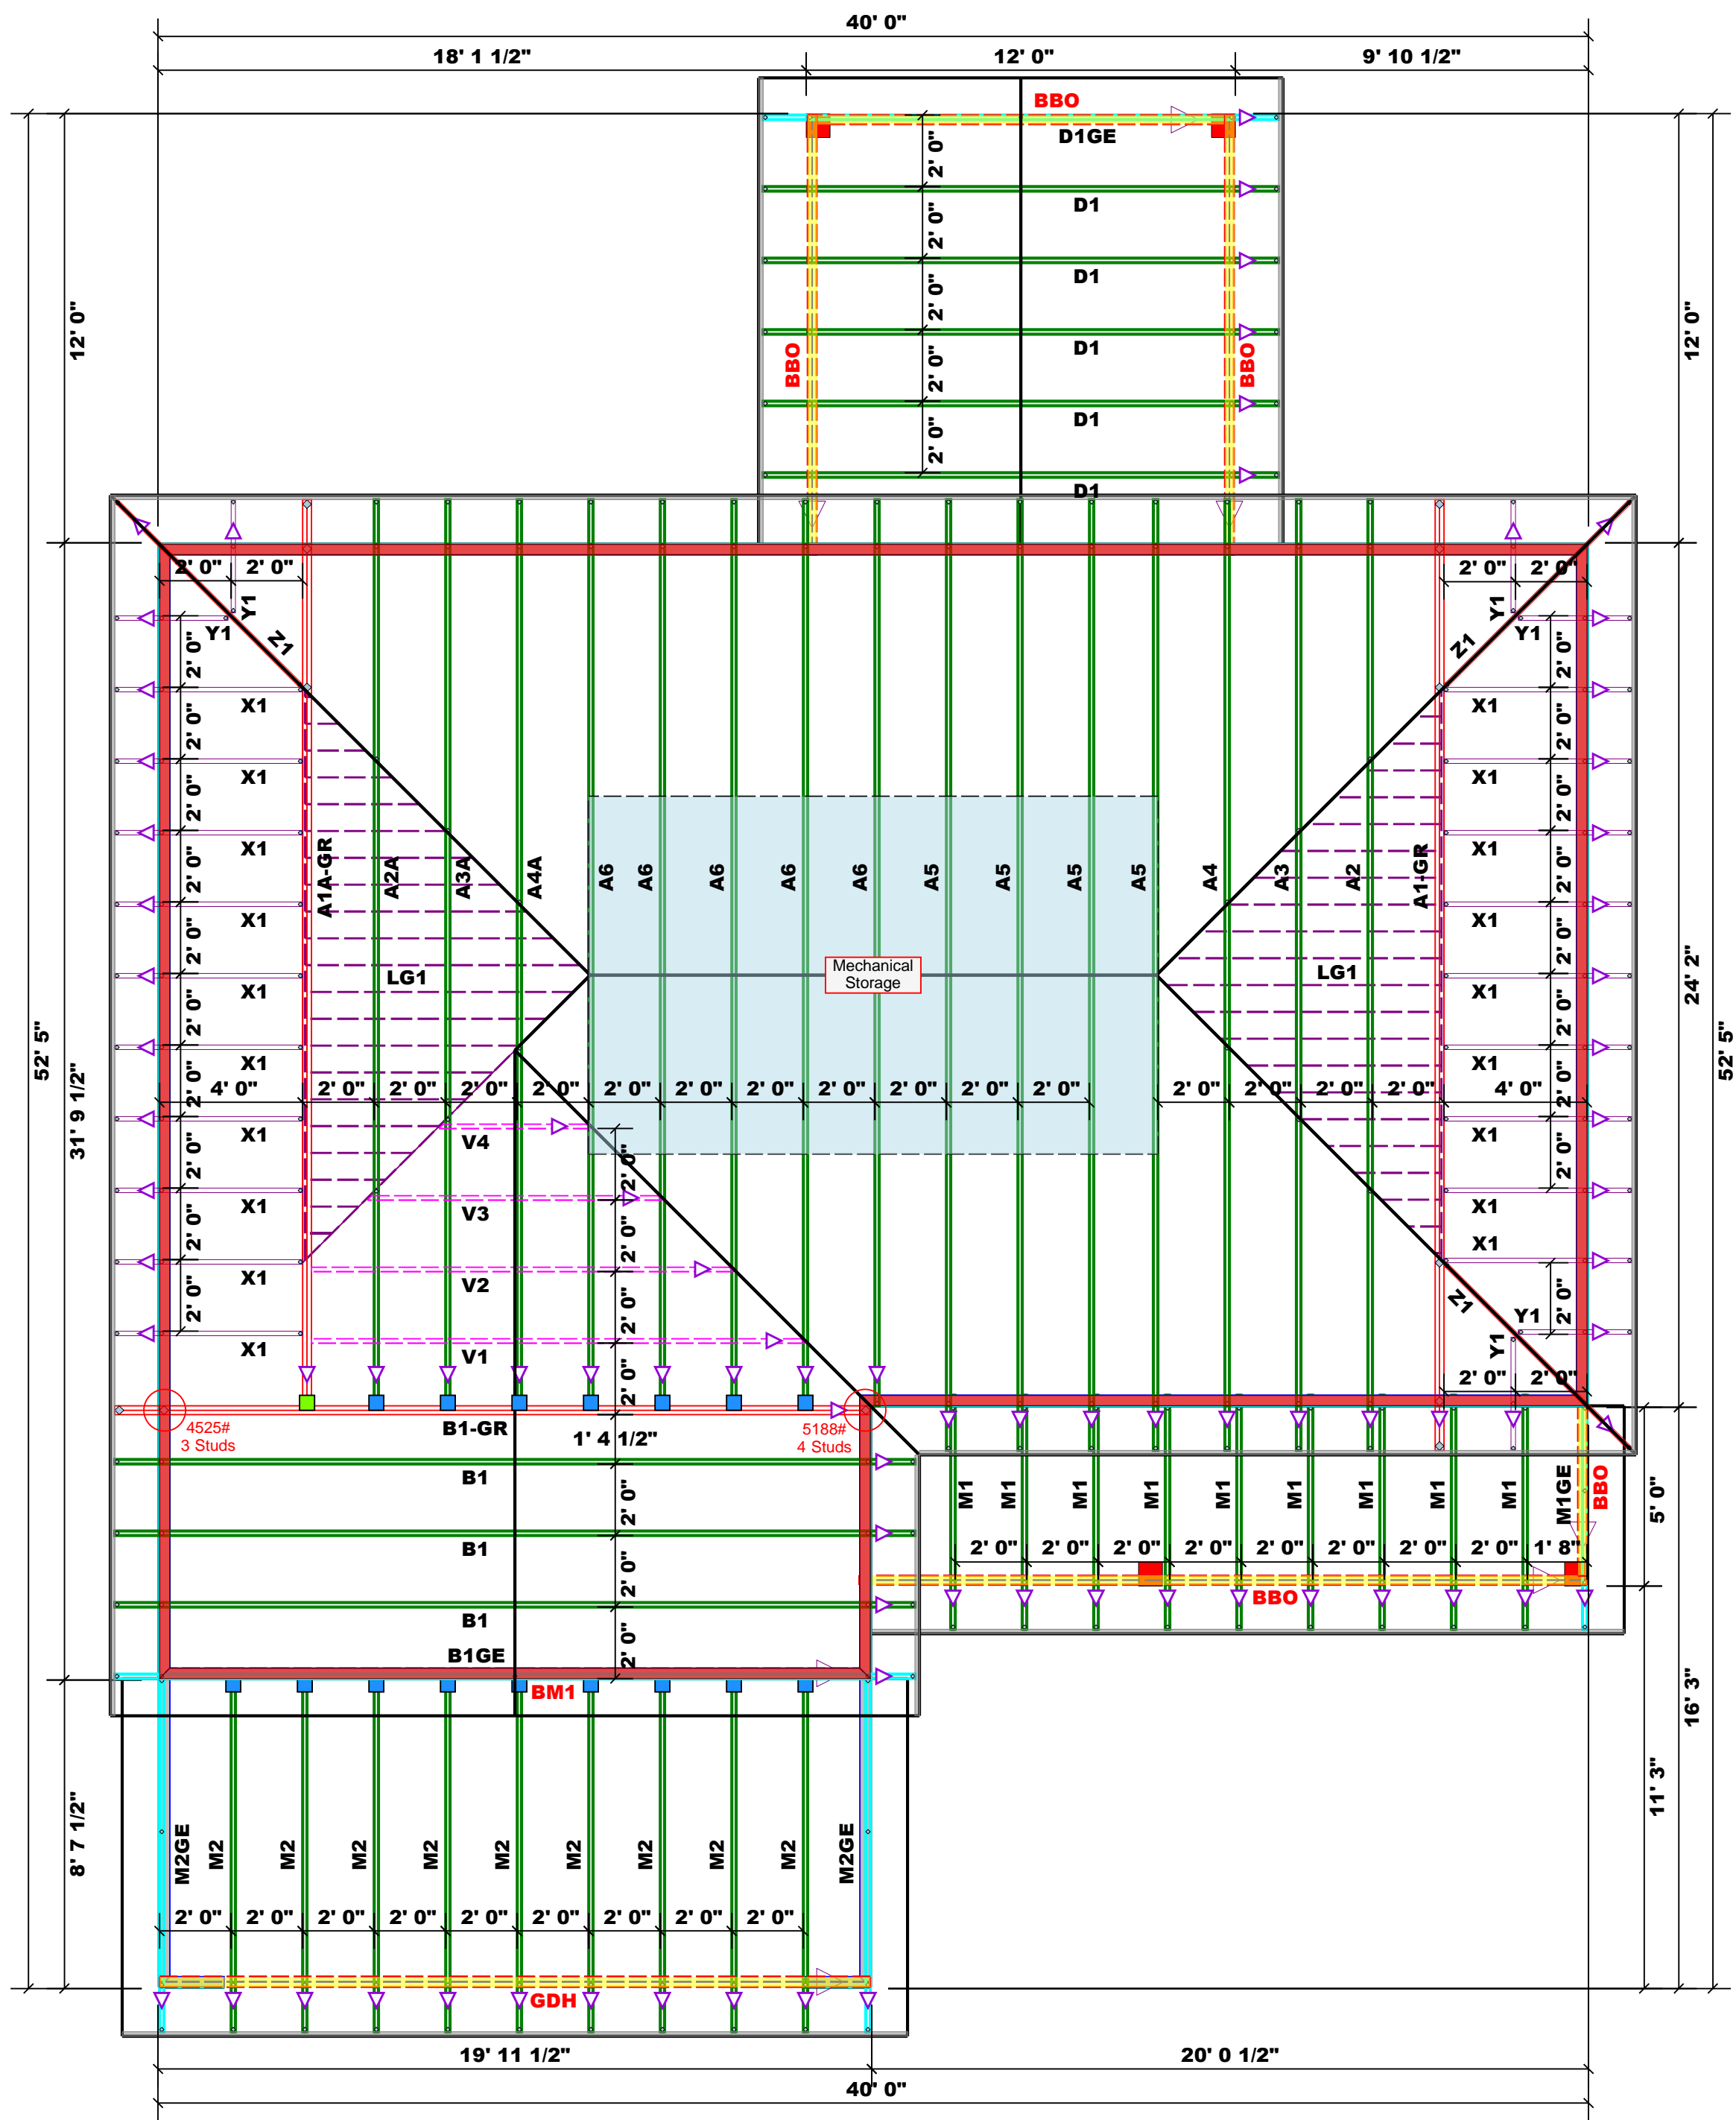

Products				
PlotID	Length	Product	Plies	Net Qty
BM1	20' 0"	1-3/4" x 23-7/8" LVL Kerto-S	2	2
GDH	20' 0"	1-3/4" x 11-7/8" LVL Kerto-S	2	2

Roof Area = 2147.83 sq.ft.
 Ridge Line = 47.48 ft.
 Hip Line = 66.22 ft.
 Horiz. OH = 203.21 ft.
 Raked OH = 82.28 ft.
 Decking = 74 sheets

1 Truss Placement Plan
 Scale: 1/4"=1'

All Walls Shown Are Considered Load Bearing

- Dimension Notes
- All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
 - All interior wall dimensions are to face of frame wall unless noted otherwise
 - All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Hatch Legend	
	Box Storage
	2nd Floor Walls
	Flush Beam
	Drop Beam

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
	HUS26	USP	16	NA	16d/3-1/2"	16d/3-1/2"
	THD26-2	USP	1	NA	16d/3-1/2"	10d/3"

= Indicates Left End of Truss
 (Reference Engineered Truss Drawing)
 Do NOT Erect Truss Backwards

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (2))
 NUMBER OF JACK STUDS REQUIRED @ EA END OF HEAD/SUPPORT

END REACTION (UP TO) 1000#	END REACTION (UP TO) 2000#	END REACTION (UP TO) 3400#
1700	2550	3400
3400	5100	6800
5100	7650	10200
6800	10200	13600
8500	12750	17000
10200	15300	
11900		
13600		
15300		

BUILDER	Wellco Contractors, Inc.	CITY / CO.	Spring Lake / Harnett
JOB NAME	Lot 5 Overhills Creek	ADDRESS	348 Caldwell Street
PLAN	Plan 13 / 2GLF	MODEL	Roof
SEAL DATE	Seal Date	DATE REV.	04/17/24
QUOTE #	Quote #	DRAWN BY	David Landry
JOB #	J0424-2238	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-1 and BCSB-3 provided with the truss delivery package or online @ sbcindustry.com


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: David Landry
 David Landry

comTECH

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

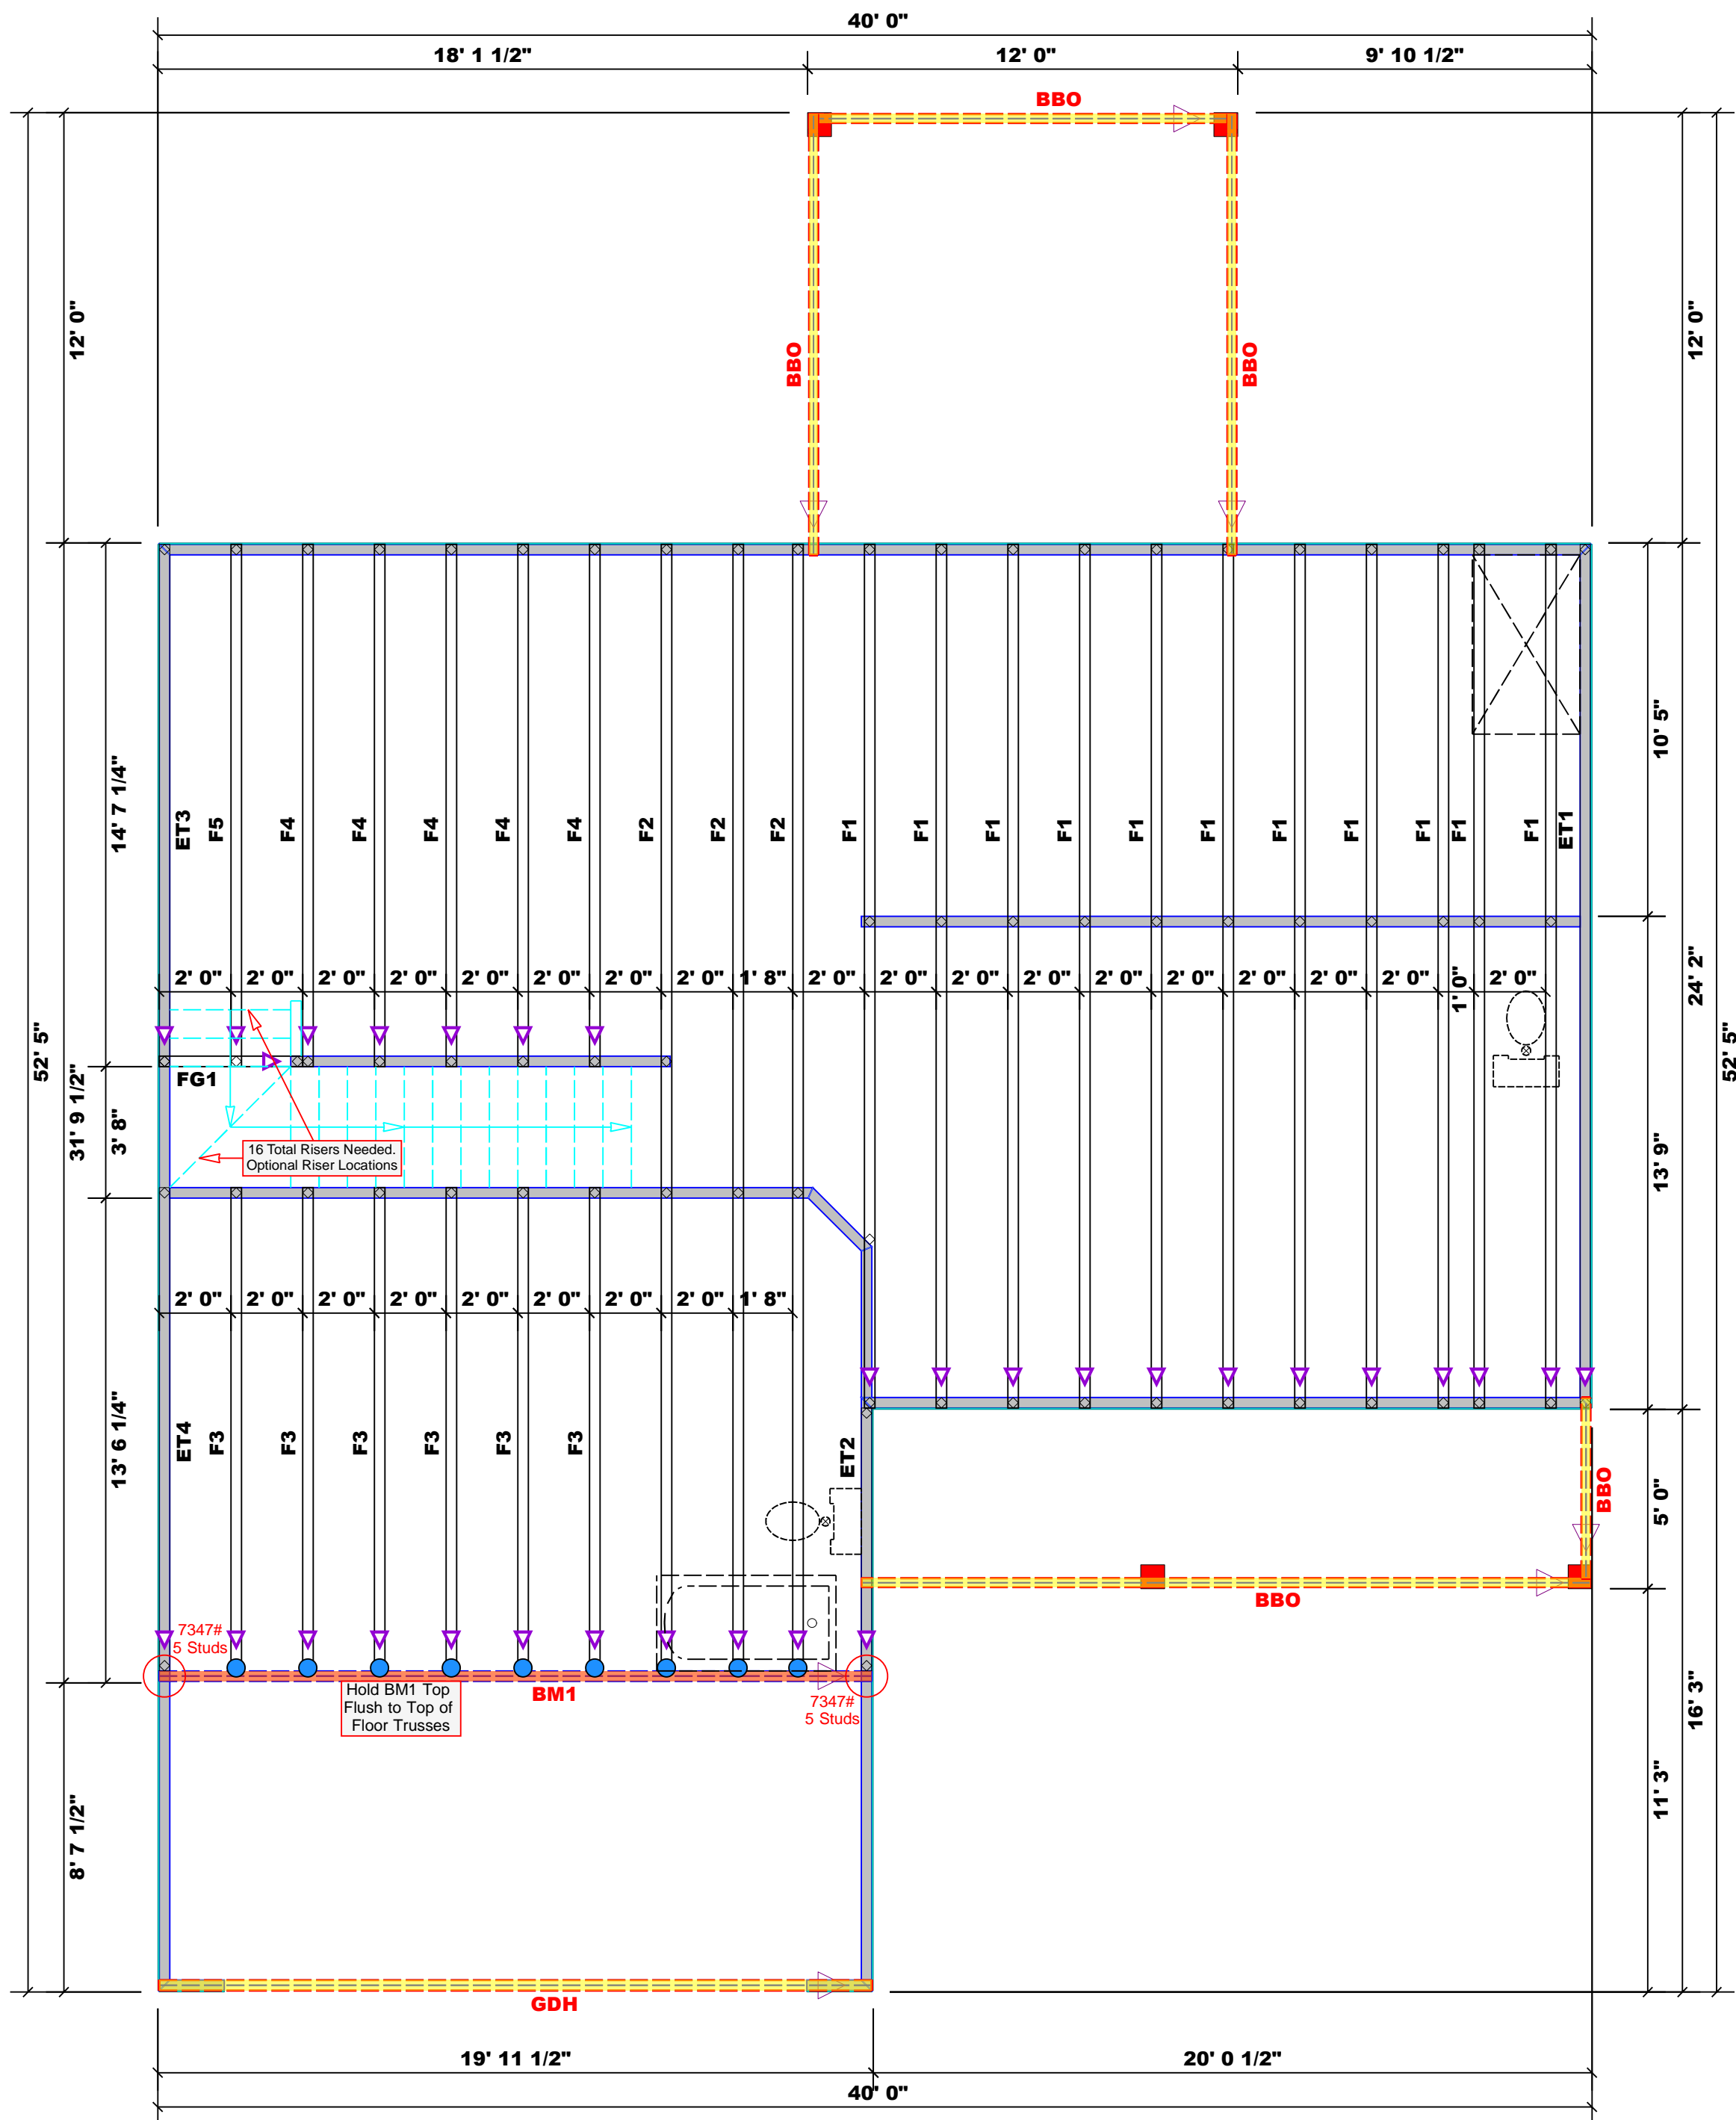

Products				
PlotID	Length	Product	Plies	Net Qty
BM1	20' 0"	1-3/4"x 23-7/8" LVL Kerto-S	2	2
GDH	20' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

Plumbing Drop Notes	
1.	Plumbing drop locations shown are NOT exact.
2.	Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
3.	Adjust spacing as needed not to exceed 24"oc.

1 Truss Placement Plan
Scale: 1/4"=1'

All Walls Shown Are Considered Load Bearing

Dimension Notes	
1.	All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
2.	All interior wall dimensions are to face of frame wall unless noted otherwise
3.	All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Hatch Legend			
	Box Storage		
	2nd Floor Walls		
	Flush Beam		
	Drop Beam		

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
	HUS410	USP	9	NA	16d/3-1/2"	16d/3-1/2"

= Indicates Left End of Truss (Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

LOAD CHART FOR JACK STUDS		
(BASED ON TABLES B502.5(1) & (2))		
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS/ROOF		
END REACTION (UP TO) 1700	END REACTION (UP TO) 2550	END REACTION (UP TO) 3400
1	1	1
3400	5100	6800
2	2	2
5100	7650	10200
3	3	3
6800	10200	13600
4	4	4
8500	12750	17000
5	5	5
10200	15300	
6		
11900		
7		
13600		
8		
15300		
9		

BUILDER	Wellco Contractors, Inc.	CITY / CO.	Spring Lake / Harnett
JOB NAME	Lot 5 Overhills Creek	ADDRESS	348 Caldwell Street
PLAN	Plan 13 / 2GLF	MODEL	Roof
SEAL DATE	Seal Date	DATE REV.	04/17/24
QUOTE #	Quote #	DRAWN BY	David Landry
JOB #	J0424-2238	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSB-1 and BCSB-3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: David Landry
David Landry

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444