

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 3705221
Sunset - Lot 15 - Fairground Farms

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource (Albermarle,NC).

Pages or sheets covered by this seal: I62301366 thru I62301389

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844



December 1,2023

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 3705221	Truss A01G	Truss Type Hip Girder	Qty 1	Ply 3	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476275
----------------	---------------	--------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:47
ID:N8N01_e?VFGd6hN7m8o7YkyST3m-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

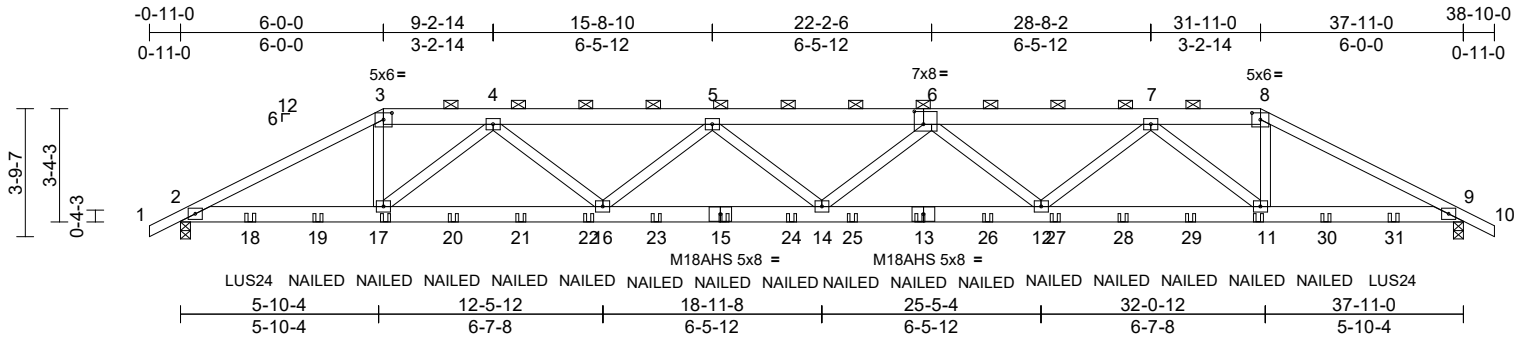

Scale = 1:68.1

Plate Offsets (X, Y): [3:0-3-0,0-2-7], [6:0-3-4,0-4-8], [8:0-3-0,0-2-7]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	-0.38	14-16	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.40	Vert(CT)	-0.58	14-16	>779	180	M18AHS	186/179
TCDL	10.0	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.11	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 685 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 6-8,6-3:2x6 SP No.2
BOT CHORD 2x6 SP DSS
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 9=0-3-8
Max Horiz 2=49 (LC 16)
Max Uplift 2=-603 (LC 9), 9=-603 (LC 8)
Max Grav 2=4364 (LC 34), 9=4364 (LC 34)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/51, 2-3=-8773/1285, 3-4=-7638/1138, 4-5=-13225/1999, 5-7=-15079/2275, 7-8=-7638/1138, 8-9=-8773/1285, 9-10=0/51
BOT CHORD 2-17=-1125/7821, 16-17=-1604/10843, 14-16=-2177/14565, 12-14=-2164/14565, 11-12=-1576/10843, 9-11=-1098/7821
WEBS 3-17=-536/3719, 8-11=-536/3719, 5-16=-1795/306, 5-14=-102/738, 6-14=-102/738, 7-12=-498/3192, 7-11=-4217/693, 4-17=-4217/693, 6-12=-1795/306, 4-16=-498/3192

NOTES
1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 4x5 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP DSS crushing capacity of 660 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 603 lb uplift at joint 9 and 603 lb uplift at joint 2.

- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 33-9-8 oc max. starting at 2-0-12 from the left end to 35-10-4 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

LOAD CASE(S) Standard
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-66, 3-8=-66, 8-10=-66, 2-9=-20
Concentrated Loads (lb)



October 19, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A01G	Truss Type Hip Girder	Qty 1	Ply 3	Sunset B - Lot 15 - Fairground Farms I61476275 Job Reference (optional)
----------------	---------------	--------------------------	----------	-----------------	---

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:47
ID:N8N01_e?VFGd6hN7m8o7YkyST3m-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 2

Vert: 13=-243 (B), 17=-243 (B), 11=-243 (B),
15=-243 (B), 18=-370 (B), 19=-250 (B), 20=-243 (B),
21=-243 (B), 22=-243 (B), 23=-243 (B), 24=-243 (B),
25=-243 (B), 26=-243 (B), 27=-243 (B), 28=-243 (B),
29=-243 (B), 30=-250 (B), 31=-370 (B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job 3705221	Truss A02	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476276
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:50

Page: 1

ID:QMVr5hNFQOW8WmmHAIJquBySSzf-RfC?PsB70Hq3NSgPqnl8w3uITXbGKwRCDoi7J4zJC7f

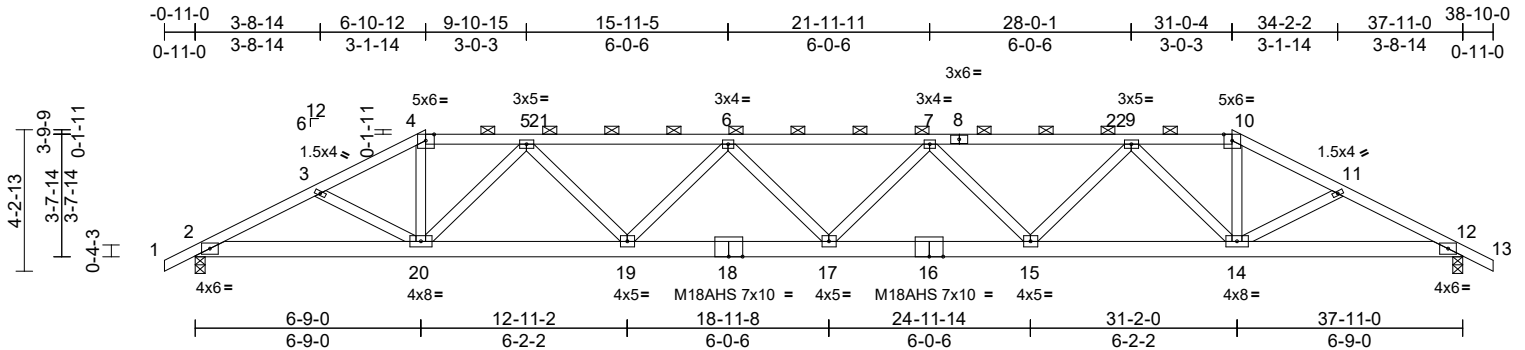


Job 3705221	Truss A04	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476278
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:51
ID:DyuGicZDUBfqaBNq4UXV3eySSvY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

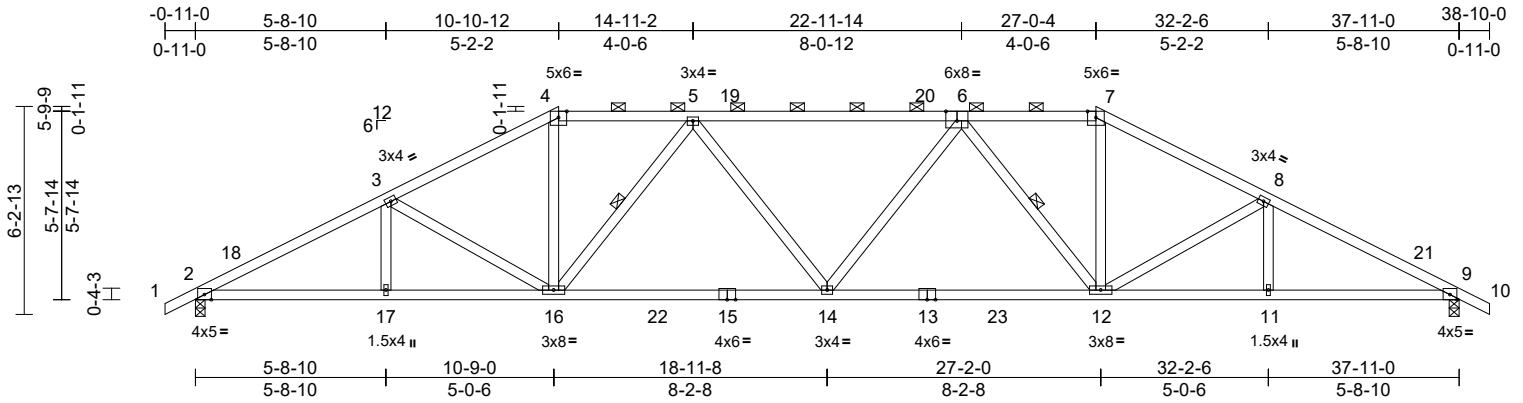

Scale = 1:69.1

Plate Offsets (X, Y): [6:0-4-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.27	14	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.95	Vert(CT)	-0.51	12-14	>885	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.19	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
												Weight: 198 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* 6-7:2x4 SP No.1, 6-4:2x4 SP 2400F 2.0E
 BOT CHORD 2x4 SP No.2 *Except* 15-13:2x4 SP No.1
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (2-9-1 max.): 4-7.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 5-16, 6-12

REACTIONS

(size) 2=0-3-8, 9=0-3-8
 Max Horiz 2=-83 (LC 17)
 Max Uplift 2=-43 (LC 12), 9=-43 (LC 13)
 Max Grav 2=1956 (LC 35), 9=1956 (LC 35)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/44, 2-3=-3431/64, 3-4=-3027/108, 4-5=-2657/108, 5-7=-3422/110, 7-8=-3027/108, 8-9=-3431/65, 9-10=0/44
 BOT CHORD 2-17=-63/2932, 16-17=-63/2932, 14-16=-105/3360, 12-14=-75/3354, 11-12=-9/2932, 9-11=-9/2932
 WEBS 3-17=0/203, 3-16=-750/130, 4-16=-6/1163, 7-12=-4/1155, 8-12=-752/131, 8-11=0/203, 5-16=-1154/150, 5-14=-12/245, 6-14=-9/248, 6-12=-1144/148

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 2 and 43 lb uplift at joint 9.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A05	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	I61476279
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:52
ID:pBoPM18KAXi0KZ22uZOI?mySSuo-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

Page: 1

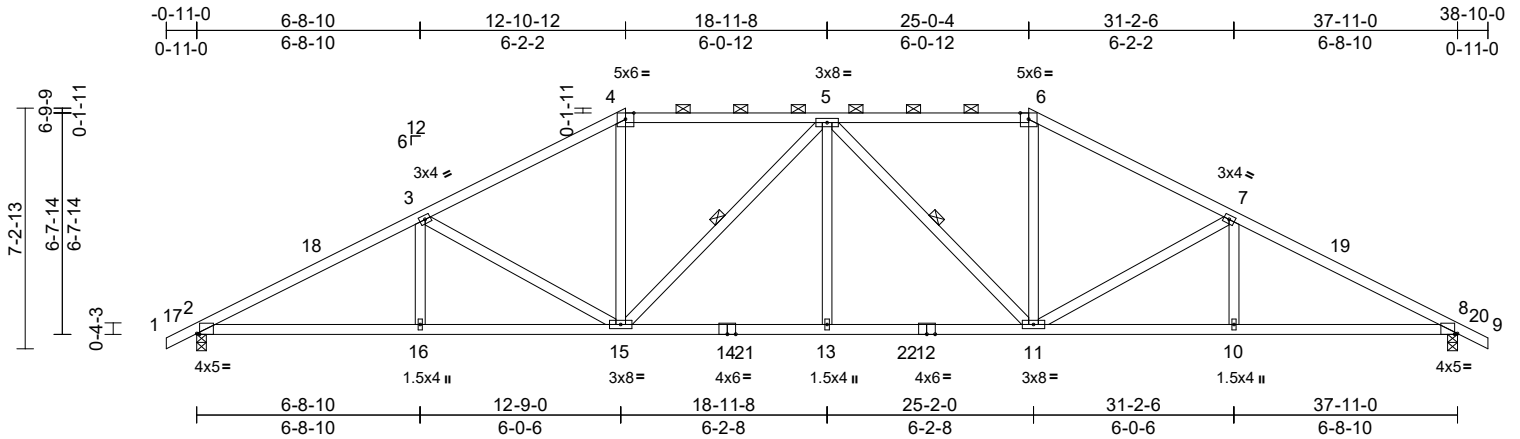

Scale = 1:69.3

Plate Offsets (X, Y): [2:0-1-0,Edge], [8:0-1-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.22	13	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.79	Vert(CT)	-0.38	13-15	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.88	Horz(CT)	0.16	8	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 202 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1 *Except* 14-12:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins (3-2-12 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 5-15, 5-11

REACTIONS

(size) 2=0-3-8, 8=0-3-8
Max Horiz 2=-97 (LC 13)
Max Uplift 2=-61 (LC 12), 8=-61 (LC 13)
Max Grav 2=2085 (LC 35), 8=2085 (LC 35)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-3712/69, 3-4=-2774/56, 4-5=-2317/78, 5-6=-2317/78, 6-7=-2774/56, 7-8=-3712/69, 8-9=0/44
BOT CHORD 2-16=-79/3169, 15-16=-79/3169, 13-15=-2/2726, 11-13=-2/2726, 10-11=0/3169, 8-10=0/3169
WEBS 3-16=0/273, 3-15=-959/147, 4-15=0/772, 5-15=-660/92, 5-13=0/300, 5-11=-660/91, 6-11=0/772, 7-11=-959/148, 7-10=0/273

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) All bearings are assumed to be SP No.1 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 2 and 61 lb uplift at joint 8.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A06	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476280
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:52
ID:7MIKXsjWm0oHUTBHIRMMySStu-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwRCDoi7J4zJC7f

Page: 1

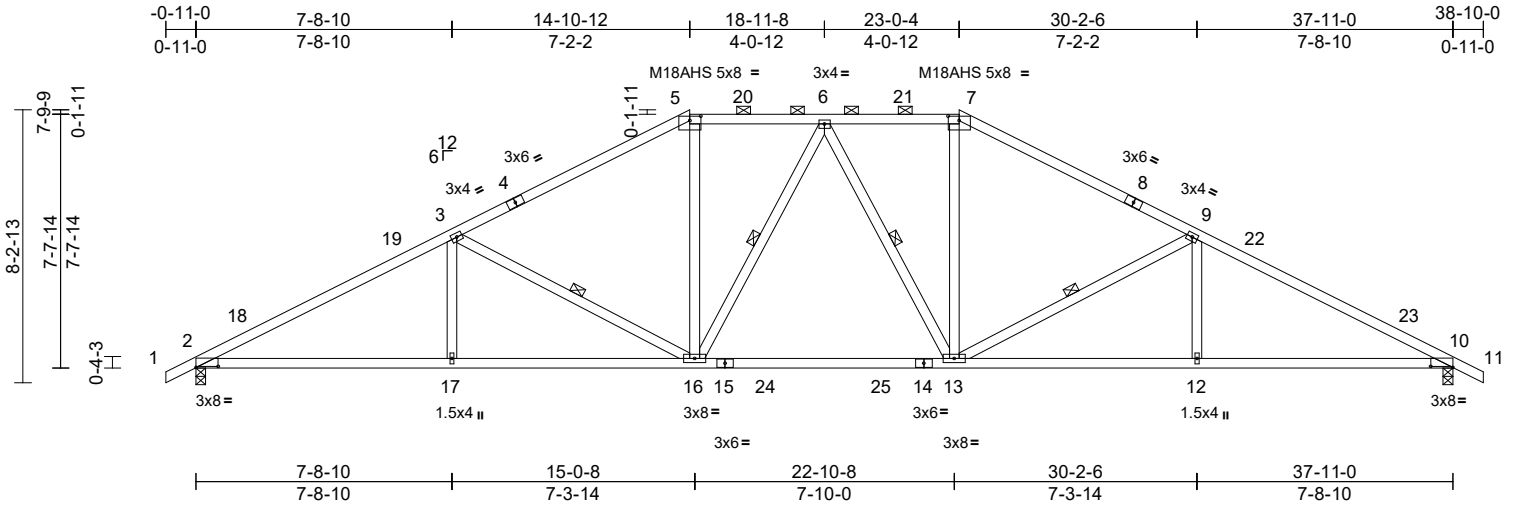

Scale = 1:69.5
Plate Offsets (X, Y): [2:0-8-0,0-0-6], [5:0-4-0,0-1-10], [7:0-4-0,0-1-10], [10:0-8-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.28	13-16	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.92	Vert(CT)	-0.47	13-16	>963	180	M18AHS	186/179
TCDL	10.0	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.17	10	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
										Weight: 201 lb	FT = 20%	

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E *Except* 5-7:2x4 SP No.2
BOT CHORD 2x4 SP No.1 *Except* 15-14:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-9-7 oc purlins, except 2-0-0 oc purlins (3-5-15 max.): 5-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 13-16.
WEBS 1 Row at midpt 3-16, 9-13, 6-16, 6-13

REACTIONS
(size) 2=0-3-8, 10=0-3-8
Max Horiz 2=-112 (LC 13)
Max Uplift 2=-76 (LC 12), 10=-76 (LC 13)
Max Grav 2=2150 (LC 35), 10=2150 (LC 35)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-3927/100, 3-5=-2833/77, 5-6=-2373/102, 6-7=-2373/102, 7-9=-2833/77, 9-10=-3927/100, 10-11=0/44
BOT CHORD 2-17=-111/3372, 16-17=-111/3372, 13-16=0/2406, 12-13=0/3372, 10-12=0/3372
WEBS 3-17=0/320, 3-16=-1149/173, 5-16=0/753, 7-13=0/753, 9-13=-1149/173, 9-12=0/320, 6-16=-335/111, 6-13=-335/111

- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.1 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 2 and 76 lb uplift at joint 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60




October 19, 2023

Job 3705221	Truss A07	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476281
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:53
ID:53sw2Y9a_yXw9aQsKILcSnySSpc-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

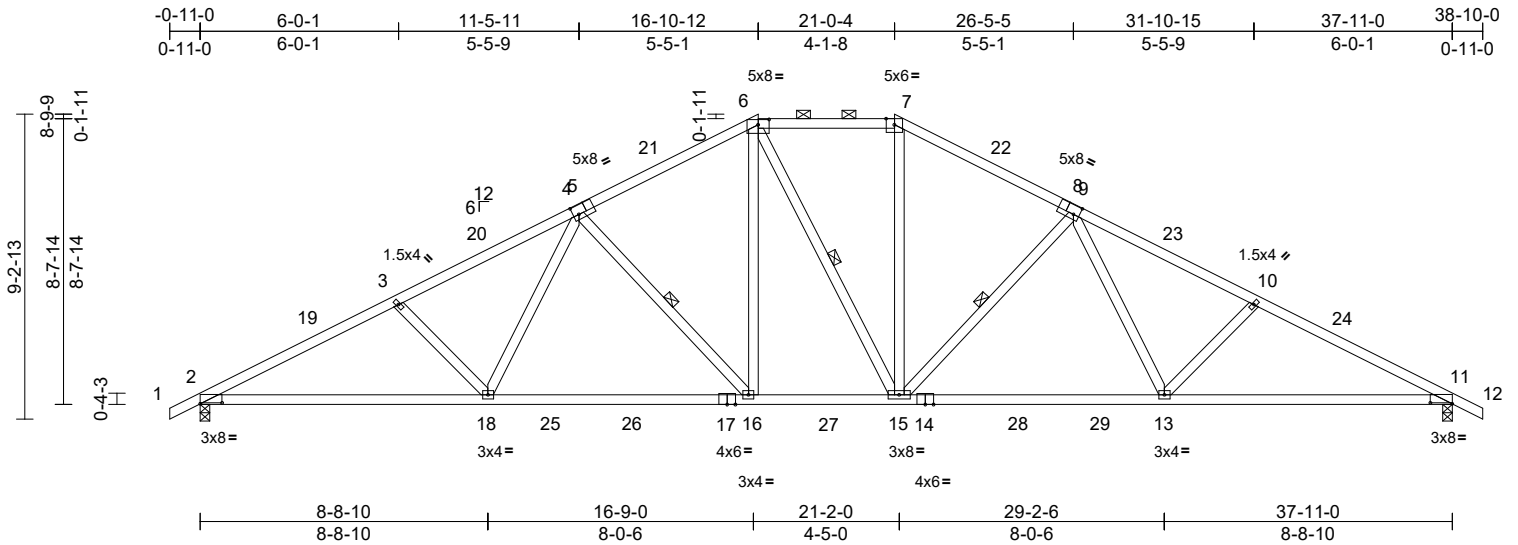

Scale = 1:69.8

Plate Offsets (X, Y): [2:0-8-0,0-0-6], [5:0-2-0,0-3-4], [6:0-4-0,0-1-15], [8:0-2-0,0-3-4], [11:0-8-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	-0.31	16-18	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.51	16-18	>885	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.18	11	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 212 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.1 *Except* 17-14:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins (3-7-7 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-15, 4-16, 9-15

REACTIONS

(size) 2=0-3-8, 11=0-3-8
Max Horiz 2=-126 (LC 17)
Max Uplift 2=-90 (LC 12), 11=-90 (LC 13)
Max Grav 2=2214 (LC 35), 11=2214 (LC 35)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-4205/151, 3-4=-3842/137, 4-6=-2813/118, 6-7=-2378/133, 7-9=-2815/118, 9-10=-3842/138, 10-11=-4204/152, 11-12=0/44
BOT CHORD 2-18=-186/3661, 16-18=-77/3053, 15-16=0/2376, 13-15=0/3053, 11-13=-61/3660
WEBS 6-16=-49/838, 6-15=-229/234, 7-15=-11/838, 3-18=-500/156, 4-18=-5/615, 4-16=-982/161, 9-15=-979/161, 9-13=-5/613, 10-13=-500/156

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) All bearings are assumed to be SP No.1 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 2 and 90 lb uplift at joint 11.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A08	Truss Type Common	Qty 6	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476282
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:53
ID:PrXPdG5yJ6hDMAfcivD7xWySSn6-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

Page: 1

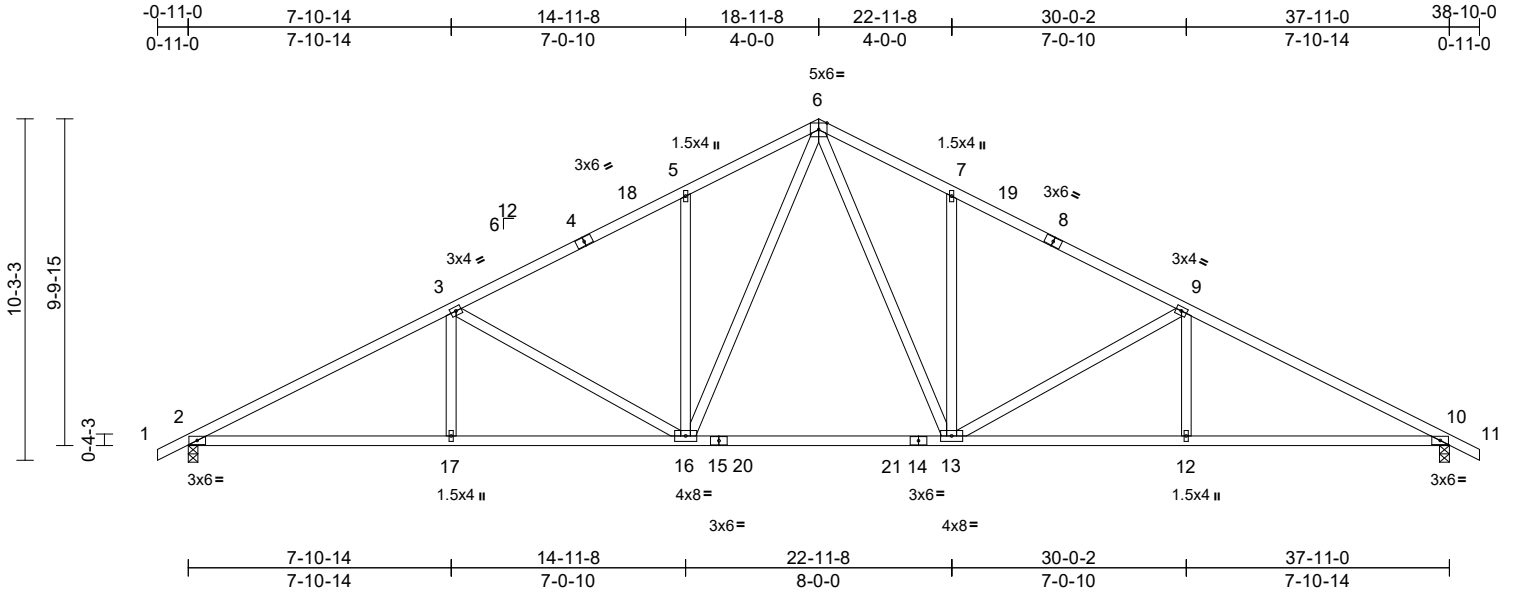

Scale = 1:69.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	-0.30	13-16	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.53	13-16	>859	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.93	Horz(CT)	0.15	10	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 208 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 4-1,8-11:2x4 SP No.1
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS (size) 2=0-3-8, 10=0-3-8
Max Horiz 2=-141 (LC 17)
Max Uplift 2=-101 (LC 12), 10=-101 (LC 13)
Max Grav 2=1692 (LC 1), 10=1692 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-3039/153, 3-5=-2316/139, 5-6=-2273/235, 6-7=-2273/235, 7-9=-2316/139, 9-10=-3039/153, 10-11=0/44
BOT CHORD 2-17=-185/2612, 16-17=-185/2612, 13-16=0/1595, 12-13=-44/2612, 10-12=-44/2612
WEBS 6-16=-169/1101, 6-13=-169/1101, 3-16=-742/163, 3-17=0/319, 5-16=-503/167, 7-13=-503/167, 9-13=-742/164, 9-12=0/319

- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 101 lb uplift at joint 2 and 101 lb uplift at joint 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf, BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MITEK COMPANY


818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A09	Truss Type Common	Qty 4	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476283
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albemarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:53
ID:sDbWCg?7Y920mCawK02eCLySSjL-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?7

Page: 1

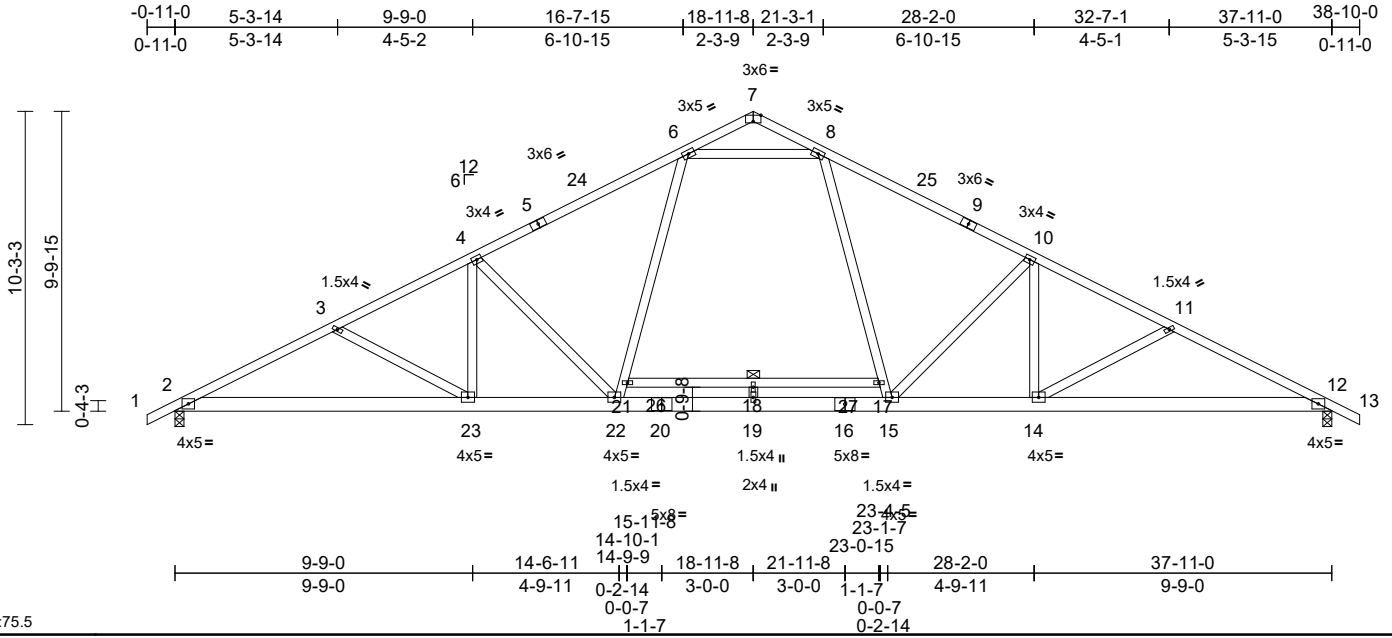

Scale = 1:75.5

Plate Offsets (X, Y): [7:0-3-0,Edge], [11:0-0-0,0-0-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	-0.33	14-15	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.49	Vert(CT)	-0.44	17	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.90	Horz(CT)	0.08	12	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 246 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP DSS *Except* 21-17:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-3-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 17-21


REACTIONS
(size) 2=0-3-8, 12=0-3-8
Max Horiz 2=-141 (LC 17)
Max Uplift 2=-50 (LC 12), 12=-50 (LC 13)
Max Grav 2=1777 (LC 1), 12=1777 (LC 1)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/51, 2-3=-3309/88, 3-4=-3012/46, 4-6=-2660/26, 6-7=-58/72, 7-8=-58/72, 8-10=-2660/26, 10-11=-3012/46, 11-12=-3308/88, 12-13=0/51
BOT CHORD 2-23=-148/2887, 22-23=-45/2653, 19-22=0/2082, 15-19=0/2082, 14-15=0/2653, 12-14=-7/2887, 18-21=-9/7, 17-18=-9/7
WEBS 10-14=-27/399, 4-23=-27/399, 21-22=0/794, 6-21=0/867, 8-17=0/867, 15-17=0/794, 6-8=-2117/119, 4-22=-855/221, 10-15=-855/222, 18-19=-251/0, 3-23=-303/118, 11-14=-303/118

- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP DSS crushing capacity of 660 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 2 and 50 lb uplift at joint 12.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

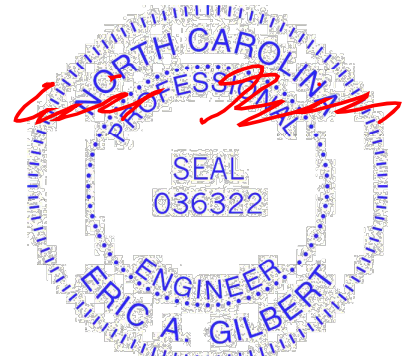

October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A10	Truss Type Common	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476284
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:54
ID:40qdRVSyuQDQwmifltx7yySSdb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRcDol7J4zJC?f

Page: 1

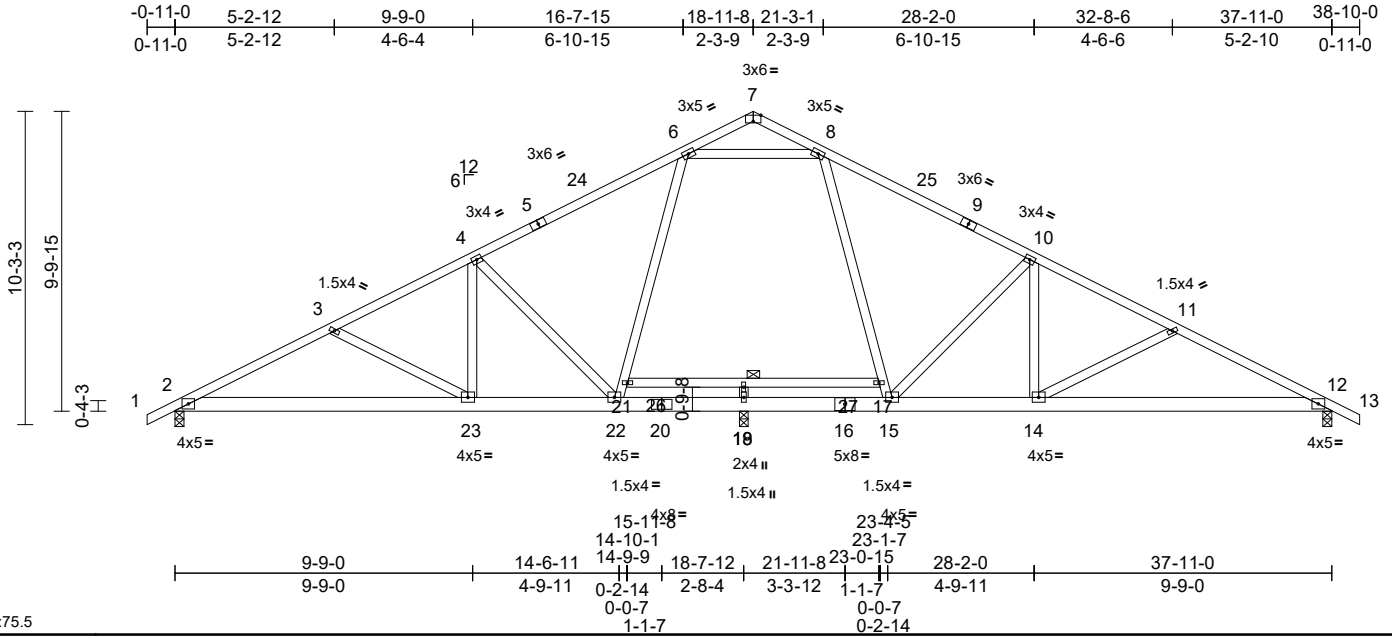

Scale = 1:75.5

Plate Offsets (X, Y): [7:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.36	14-15	>630	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.47	14-15	>490	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.05	12	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 246 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1
BOT CHORD 2x6 SP DSS *Except* 21-17:2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-4-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 17-21

REACTIONS

(size) 2=0-3-8, 12=0-3-8, 19=0-3-8
Max Horiz 2=-141 (LC 13)
Max Uplift 2=-87 (LC 12), 12=-113 (LC 13)
Max Grav 2=1337 (LC 1), 12=1378 (LC 20), 19=1086 (LC 4)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/51, 2-3=-2365/168, 3-4=-2037/124, 4-6=-1452/188, 6-7=-52/80, 7-8=-50/89, 8-10=-1469/153, 10-11=-2162/181, 11-12=-2461/226, 12-13=0/51
BOT CHORD 2-23=-221/2046, 22-23=-115/1769, 19-22=0/1146, 15-19=0/1146, 14-15=-24/1895, 12-14=-132/2127, 18-21=-6/9, 17-18=-6/9
WEBS 10-14=-3/573, 4-23=-18/582, 21-22=-7/238, 6-21=0/271, 8-17=0/276, 15-17=-10/250, 18-19=-332/0, 6-8=-1233/239, 4-22=-1013/212, 10-15=-1019/197, 3-23=-313/120, 11-14=-305/122

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP DSS crushing capacity of 660 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 2 and 113 lb uplift at joint 12.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A11	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476285
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:54
ID:oZbyopCWeXvMzGARqfCfZySSbr-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwKCoD7J4zJC?f

Page: 1

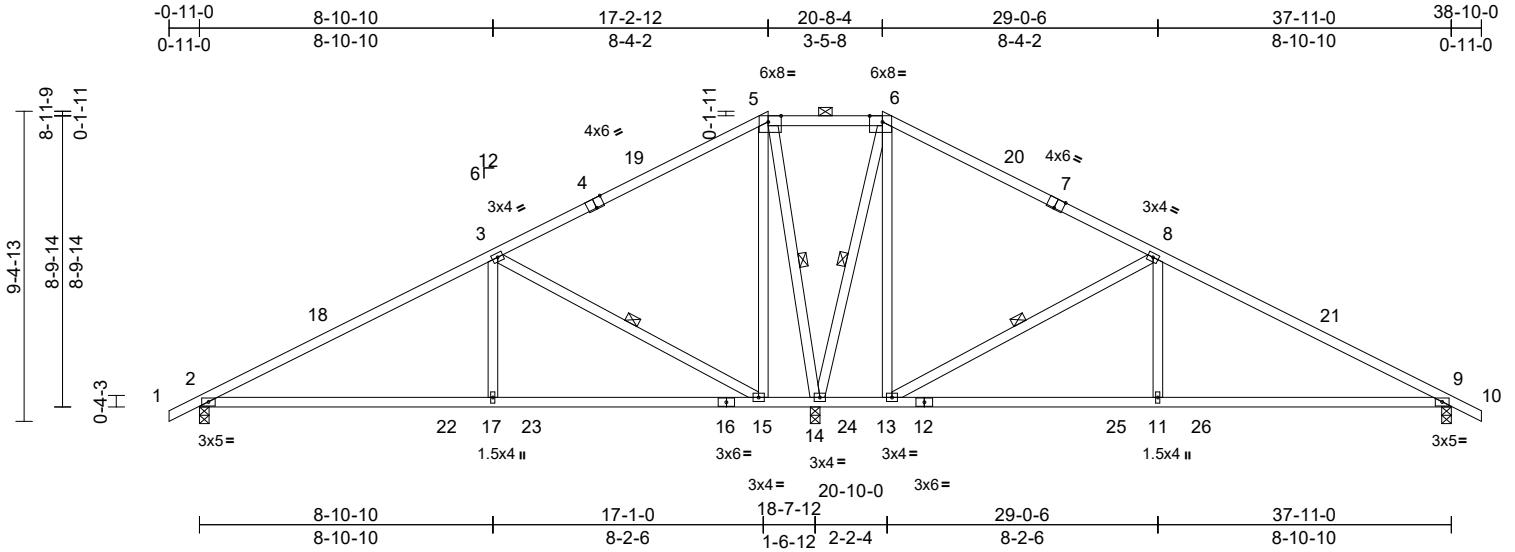

Scale = 1:69.8

Plate Offsets (X, Y): [4:0-3-0,Edge], [5:0-4-10,Edge], [6:0-4-10,Edge], [7:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.14	9-11	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.32	9-11	>724	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.04	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 211 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1 *Except* 5-6:2x4 SP No.2, 4-1,7-10:2x4 SP 2400F 2.0E
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 3-15, 8-13, 5-14, 6-14

REACTIONS

(size) 2=0-3-8, 9=0-3-8, 14=0-3-8
 Max Horiz 2=-128 (LC 13)
 Max Uplift 2=-77 (LC 12), 9=-105 (LC 13), 14=-30 (LC 12)
 Max Grav 2=754 (LC 35), 9=798 (LC 35), 14=2898 (LC 35)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/44, 2-3=-914/99, 3-5=0/750, 5-6=0/773, 6-8=0/652, 8-9=-1011/159, 9-10=0/44
 BOT CHORD 2-17=-115/710, 15-17=-115/710, 14-15=-539/162, 13-14=-446/132, 11-13=-42/792, 9-11=-42/792
 WEBS 3-17=0/386, 3-15=-1405/198, 5-15=0/702, 6-13=-5/720, 8-13=-1398/198, 8-11=0/387, 5-14=-1405/64, 6-14=-1424/44

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 2, 105 lb uplift at joint 9 and 30 lb uplift at joint 14.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
 Edenton, NC 27932

Job 3705221	Truss A12	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476286
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:55
ID:Ad56r5DK2sBVNB7tk?Lk2PySS7d-RfC?PsB70Hq3NSgPqnL8w3uTxBGKWrCDoi7J4zJC?f

Page: 1

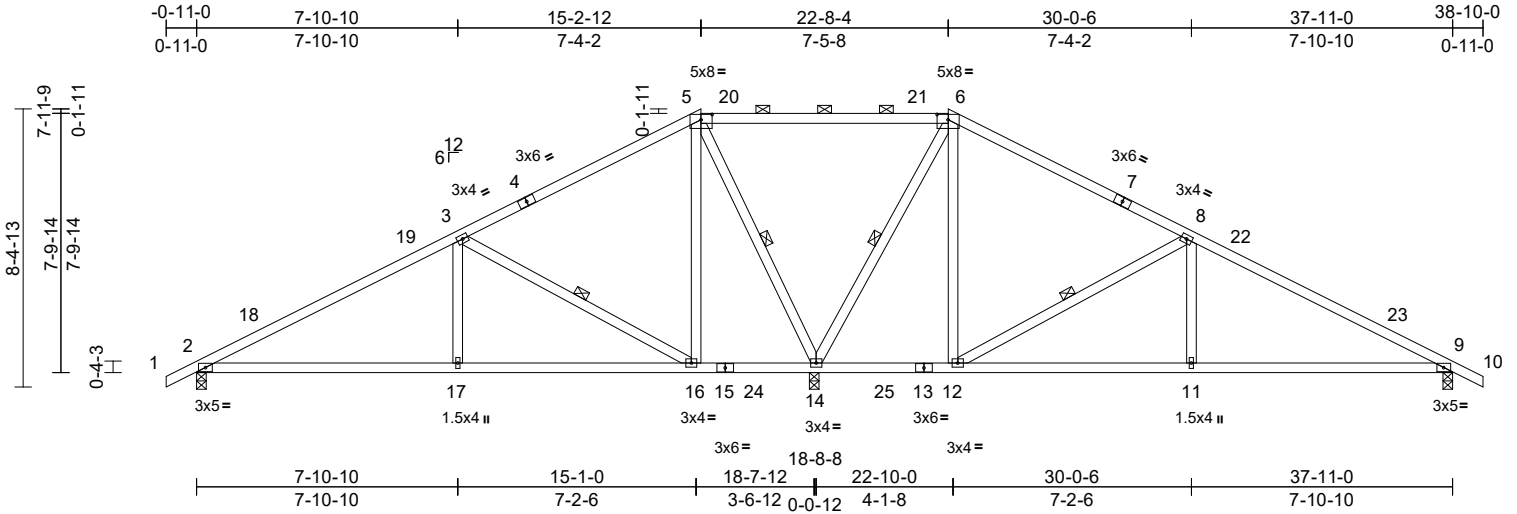

Scale = 1:69.6

Plate Offsets (X, Y): [5:0-4-0,0-1-15], [6:0-4-0,0-1-15]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.80	Vert(LL)	-0.09	9-11	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.20	9-11	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.03	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 202 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E *Except* 4-5,6-7:2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 3-16, 5-14, 6-14, 8-12

REACTIONS (size) 2=0-3-8, 9=0-3-8, 14=0-3-8
Max Horiz 2=-114 (LC 17)
Max Uplift 2=-74 (LC 12), 9=-100 (LC 13), 14=-10 (LC 12)
Max Grav 2=774 (LC 35), 9=810 (LC 35), 14=2737 (LC 35)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-950/94, 3-5=-46/561, 5-6=0/1001, 6-8=-107/480, 8-9=-1029/151, 9-10=0/44
BOT CHORD 2-17=-108/753, 16-17=-108/753, 14-16=-386/162, 12-14=-314/107, 11-12=-44/806, 9-11=-44/806
WEBS 3-17=0/341, 3-16=-1262/174, 5-16=-13/700, 5-14=-1475/85, 6-14=-1480/56, 6-12=-11/705, 8-12=-1259/173, 8-11=0/340

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 74 lb uplift at joint 2, 10 lb uplift at joint 14 and 100 lb uplift at joint 9.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A13	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476287
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:56
ID:3IKIXXI95CPIzIQ_SBS9AySS6E-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

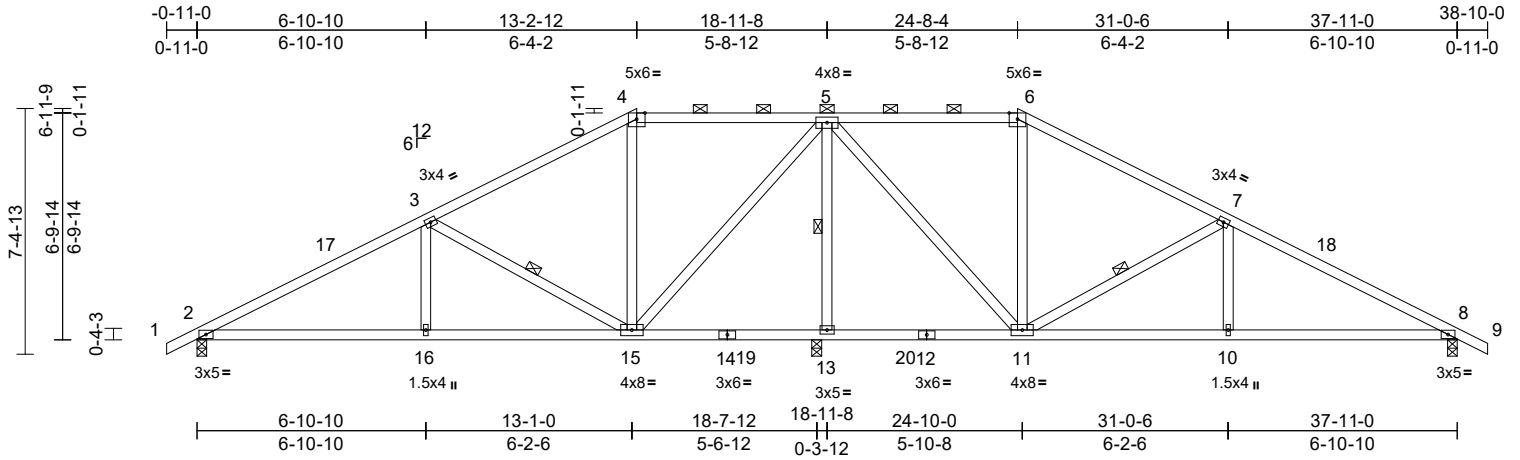

Scale = 1:69.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.08	2-16	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.16	2-16	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.03	8	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 204 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.1 *Except* 4-6:2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-12 oc purlins, except 2-0-0 oc purlins (3-1-0 max.); 4-6.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 3-15, 5-13, 7-11

REACTIONS

(size) 2=0-3-8, 8=0-3-8, 13=0-3-8
 Max Horiz 2=-100 (LC 13)
 Max Uplift 2=-76 (LC 12), 8=-95 (LC 13)
 Max Grav 2=968 (LC 35), 8=968 (LC 35), 13=2240 (LC 35)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/44, 2-3=-1333/102, 3-4=-415/87, 4-5=-240/108, 5-6=-240/146, 6-7=-415/129, 7-8=-1333/144, 8-9=0/44
 BOT CHORD 2-16=-109/1055, 15-16=-109/1055, 13-15=-737/105, 11-13=-737/105, 10-11=-46/1055, 8-10=-46/1055
 WEBS 3-16=0/290, 3-15=-1078/150, 4-15=-328/44, 5-15=-59/1286, 5-13=-2104/44, 5-11=-33/1286, 6-11=-328/37, 7-11=-1078/149, 7-10=0/290

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 2 and 95 lb uplift at joint 8.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A14	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476288
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:56
ID:Nvgqim?YR0jeWns7rNUCVPySS5K-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWvCDOI7J4zJC?f

Page: 1

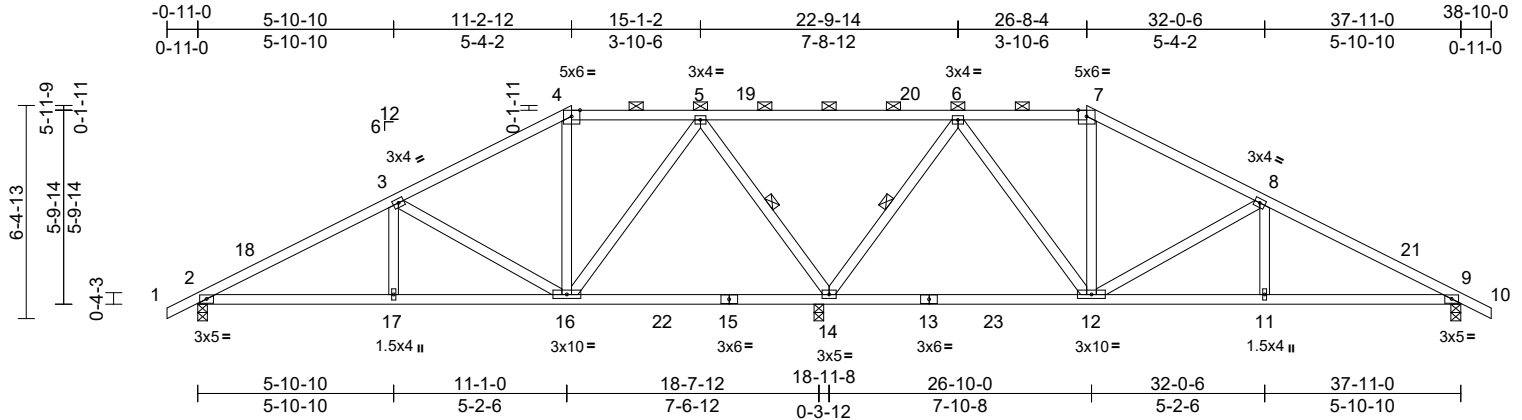

Scale = 1:69.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.06	12-14	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.48	Vert(CT)	-0.13	12-14	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.60	Horz(CT)	0.03	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 200 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 4-7:2x4 SP No.1
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-6-10 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 4-7.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 5-14, 6-14

REACTIONS (size) 2=0-3-8, 9=0-3-8, 14=0-3-8
Max Horiz 2=-86 (LC 13)
Max Uplift 2=-70 (LC 12), 9=-85 (LC 13), 14=-33 (LC 9)
Max Grav 2=928 (LC 35), 9=928 (LC 35), 14=2387 (LC 34)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-1208/93, 3-4=-479/76, 4-5=-313/94, 5-6=0/1018, 6-7=-313/123, 7-8=-479/109, 8-9=-1208/126, 9-10=0/44
BOT CHORD 2-17=-96/983, 16-17=-96/983, 14-16=-342/111, 12-14=-342/71, 11-12=-40/983, 9-11=-40/983
WEBS 3-17=0/223, 3-16=-877/131, 4-16=-191/28, 7-12=-191/27, 8-12=-877/130, 8-11=0/223, 5-16=-17/928, 5-14=-1351/107, 6-14=-1351/95, 6-12=0/928

- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 2, 33 lb uplift at joint 14 and 85 lb uplift at joint 9.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A15	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476289
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:57
ID:muQgbixTemhw2CHz4MkGQ1ySRvo-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

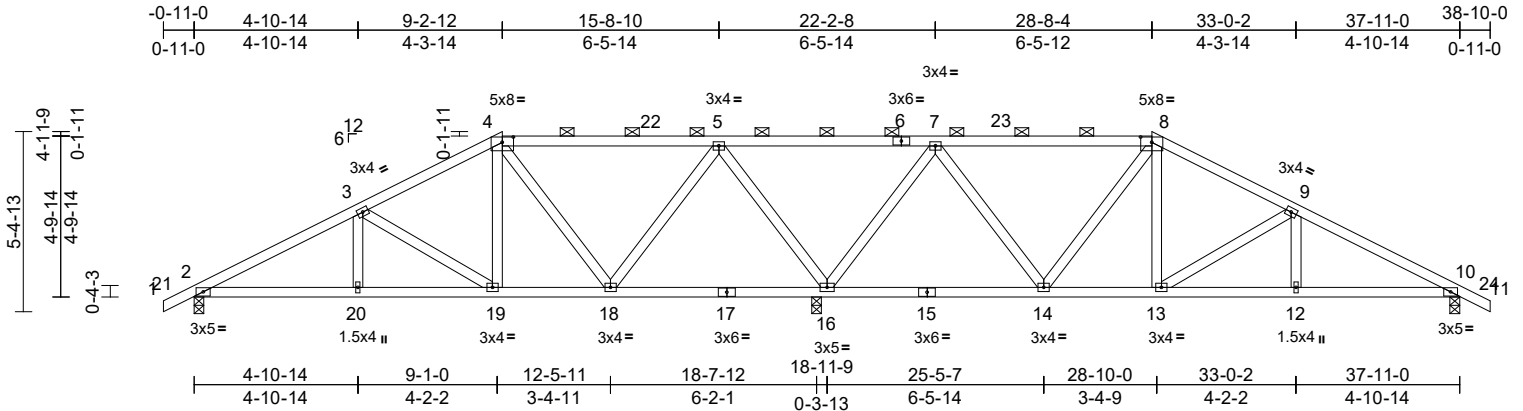

Scale = 1:69
Plate Offsets (X, Y): [4:0-4-0,0-1-15], [8:0-4-0,0-1-15]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.03	2-20	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.40	Vert(CT)	-0.06	14-16	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.94	Horz(CT)	0.03	10	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 200 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2 *Except* 4-6,6-8:2x4 SP No.1
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-8-2 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 16-18,14-16.

REACTIONS (size) 2=0-3-8, 10=0-3-8, 16=0-3-8
Max Horiz 2=-71 (LC 17)
Max Uplift 2=-63 (LC 12), 10=-74 (LC 13), 16=-88 (LC 9)
Max Grav 2=915 (LC 35), 10=915 (LC 35), 16=2583 (LC 34)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-1252/76, 3-4=-645/73, 4-5=-226/58, 5-7=0/994, 7-8=-225/86, 8-9=-644/98, 9-10=-1251/101, 10-11=0/44
BOT CHORD 2-20=-76/1020, 19-20=-76/1020, 18-19=-18/471, 16-18=-391/82, 14-16=-391/55, 13-14=0/471, 12-13=-27/1019, 10-12=-27/1019
WEBS 4-19=-13/410, 8-13=-12/410, 4-18=-623/52, 5-18=0/753, 5-16=-1500/123, 7-16=-1499/114, 7-14=0/754, 8-14=-623/38, 3-19=-688/96, 3-20=0/205, 9-13=-688/95, 9-12=0/205

- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 2, 88 lb uplift at joint 16 and 74 lb uplift at joint 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES
1) Unbalanced roof live loads have been considered for this design.



October 19,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss A16	Truss Type Hip	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476290
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Albemarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:57
ID:0W93STUIU5qmPs3ZaF0Hc1ySRto-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCD0i7J4zJC?f

Page: 1

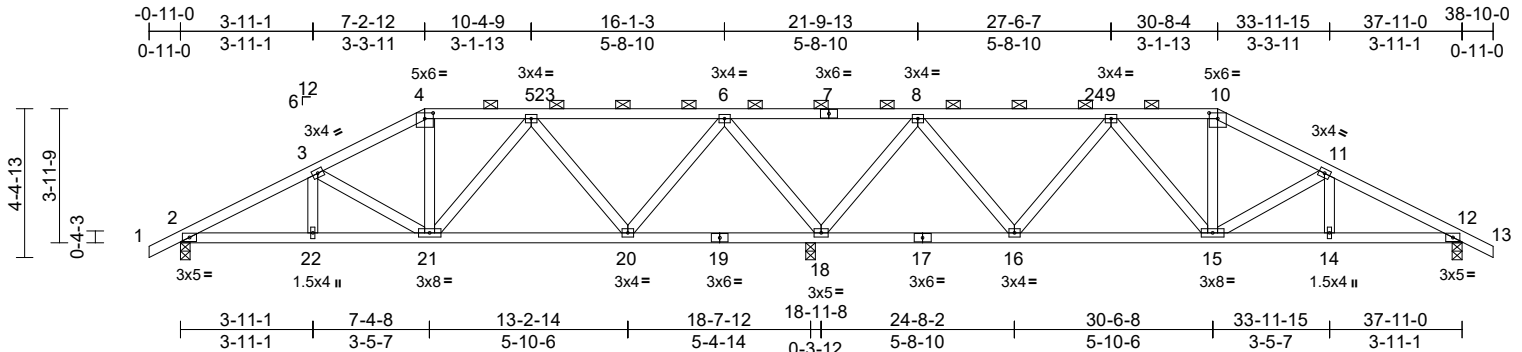

Scale = 1:68.2

Plate Offsets (X, Y): [4:0-3-0,0-2-0], [10:0-3-0,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.99	Vert(LL)	-0.03	20-21	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.33	Vert(CT)	-0.07	20-21	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.76	Horz(CT)	0.03	12	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0										Weight: 197 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-0-1 oc purlins, except 2-0-0 oc purlins (2-2-0 max.): 4-10.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 18-20,16-18.

REACTIONS

(size) 2=0-3-8, 12=0-3-8, 18=0-3-8
Max Horiz 2=-58 (LC 17)
Max Uplift 2=-52 (LC 12), 12=-60 (LC 13), 18=-135 (LC 9)
Max Grav 2=880 (LC 35), 12=880 (LC 35), 18=2755 (LC 34)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-1234/56, 3-4=-782/58, 4-5=-682/59, 5-6=-239/48, 6-8=-28/1307, 8-9=-239/64, 9-10=-682/72, 10-11=-782/68, 11-12=-1234/73, 12-13=0/44
BOT CHORD 2-22=-55/1010, 21-22=-55/1010, 20-21=-49/670, 18-20=-388/56, 16-18=-388/38, 15-16=-27/670, 14-15=-12/1010, 12-14=-12/1010
WEBS 4-21=0/179, 10-15=0/179, 5-21=-2/344, 5-20=-702/76, 6-20=0/846, 6-18=-1669/139, 8-18=-1669/133, 8-16=0/846, 9-16=-702/70, 9-15=0/344, 3-21=-507/83, 3-22=0/131, 11-15=-507/83, 11-14=0/131

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 52 lb uplift at joint 2, 135 lb uplift at joint 18 and 60 lb uplift at joint 12.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

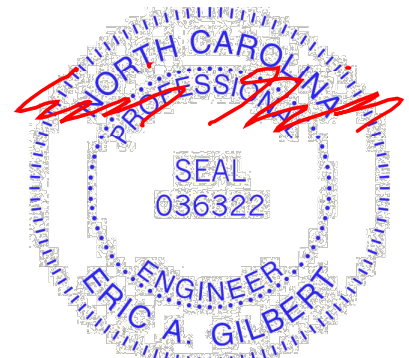

October 19,2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss B01	Truss Type Common	Qty 3	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476291
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:58
ID:c:C?MOGfXBPan508FPBHaA_ySRta-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

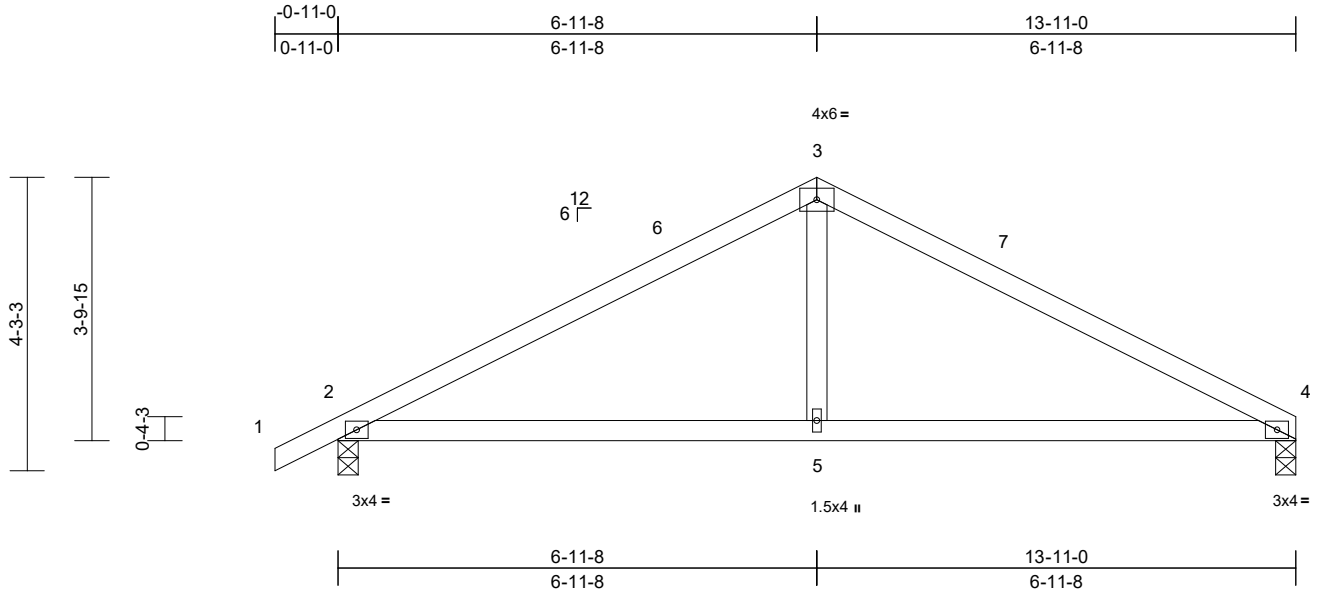

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	-0.05	4-5	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	Vert(CT)	-0.12	4-5	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S							
BCDL	10.0									Weight: 51 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 4=0-3-8
Max Horiz 2=62 (LC 12)
Max Uplift 2=-48 (LC 12), 4=-30 (LC 13)
Max Grav 2=660 (LC 1), 4=584 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/44, 2-3=-840/47, 3-4=-837/45
BOT CHORD 2-5=0/658, 4-5=0/658
WEBS 3-5=0/333

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 4 and 48 lb uplift at joint 2.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss B02	Truss Type Common Supported Gable	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476292
----------------	--------------	--------------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:58
ID:jjilG7iph7ODx90dlfQ?dCjySRtN-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

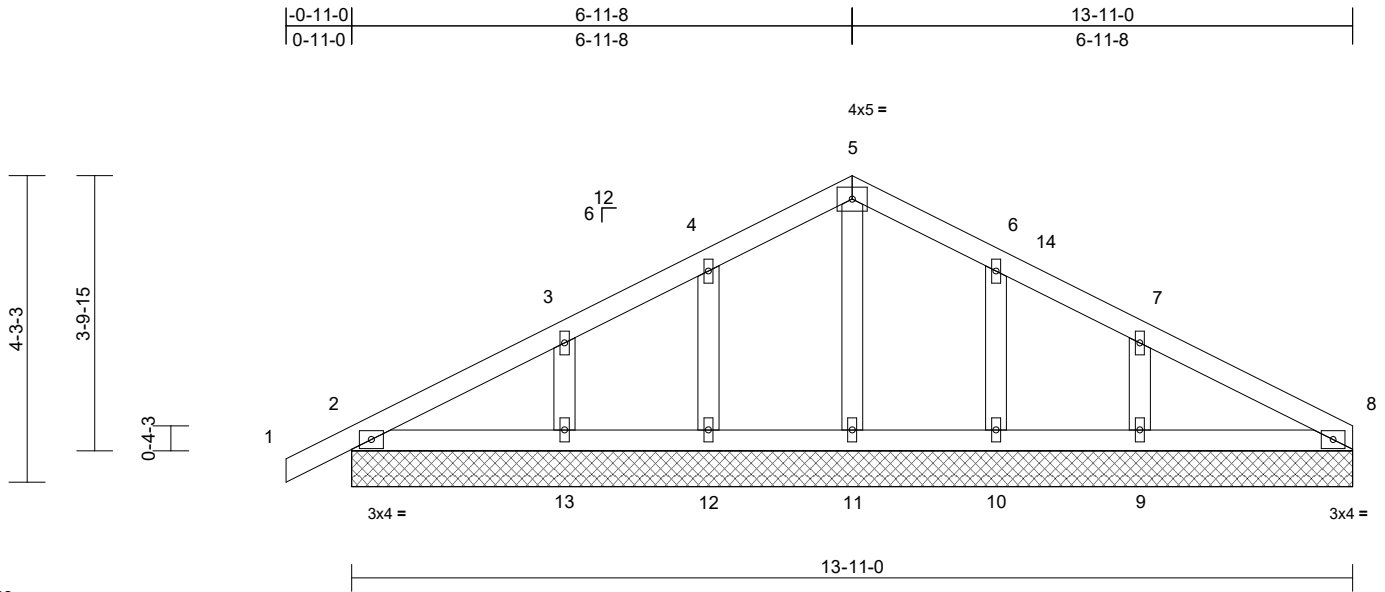

Scale = 1:32

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	8	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 61 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=13-11-0, 8=13-11-0, 9=13-11-0, 10=13-11-0, 11=13-11-0, 12=13-11-0, 13=13-11-0
Max Horiz 2=62 (LC 12)
Max Uplift 2=-8 (LC 12), 9=-53 (LC 13), 10=-31 (LC 13), 12=-34 (LC 12), 13=-47 (LC 12)
Max Grav 2=184 (LC 1), 8=111 (LC 1), 9=261 (LC 1), 10=177 (LC 20), 11=160 (LC 1), 12=173 (LC 19), 13=244 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/43, 2-3=-76/47, 3-4=-49/55, 4-5=-51/74, 5-6=-52/67, 6-7=-51/34, 7-8=-53/37
BOT CHORD 2-13=-2/45, 12-13=-2/45, 11-12=-2/45, 10-11=-2/45, 9-10=-2/45, 8-9=-2/45
WEBS 5-11=-114/0, 4-12=-143/55, 3-13=-179/78, 6-10=-148/53, 7-9=-192/83

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 8 lb uplift at joint 2, 34 lb uplift at joint 12, 47 lb uplift at joint 13, 31 lb uplift at joint 10 and 53 lb uplift at joint 9.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss C01	Truss Type Common	Qty 3	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476293
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:58
ID:nbixGq_5b?6pSKHe23n8JuySRt8-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

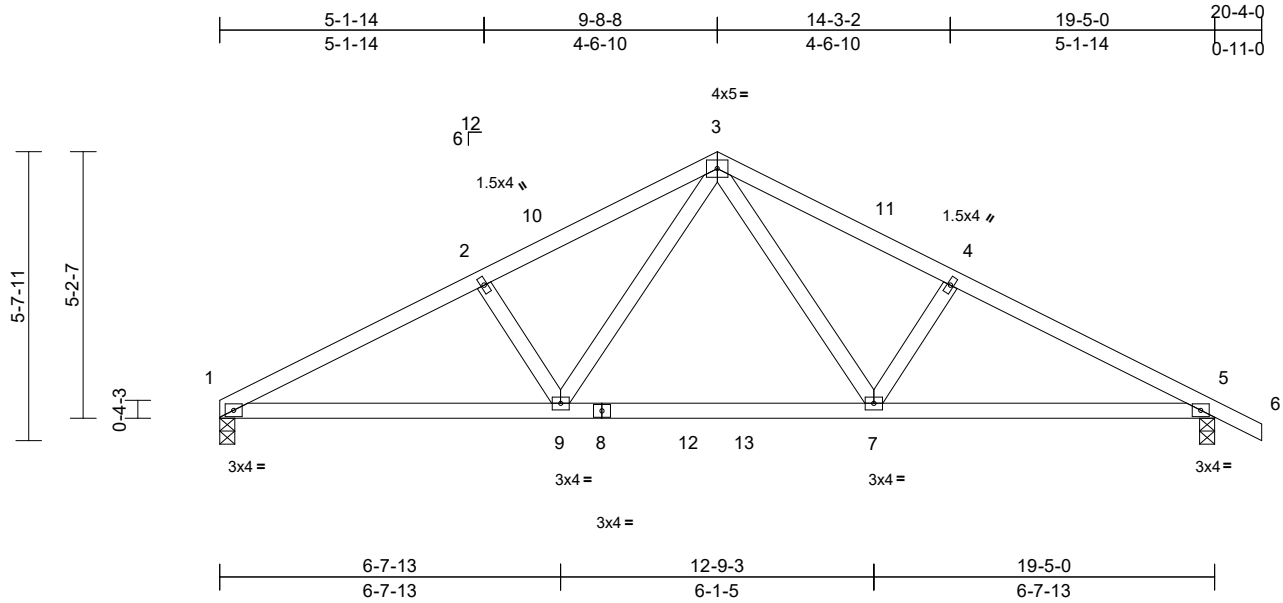

Scale = 1:45

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.39	Vert(LL)	-0.06	1-9	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.50	Vert(CT)	-0.14	1-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.03	5	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
										Weight: 88 lb	FT = 20%	

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-5-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=0-3-8, 5=0-3-8

Max Horiz 1=-81 (LC 17)
Max Uplift 1=-42 (LC 12), 5=-60 (LC 13)
Max Grav 1=822 (LC 1), 5=897 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-1420/88, 2-3=-1261/102, 3-4=-1254/99, 4-5=-1428/85, 5-6=0/44
BOT CHORD 1-9=-91/1217, 7-9=0/809, 5-7=-11/1207
WEBS 3-9=-52/505, 3-7=-49/487, 2-9=-339/143, 4-7=-324/139

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf, BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 1 and 60 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss C02	Truss Type Common Supported Gable	Qty 1	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476294
----------------	--------------	--------------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:59
ID:YPIOWOlnihGgy9hR?pj?p9ySRsl-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

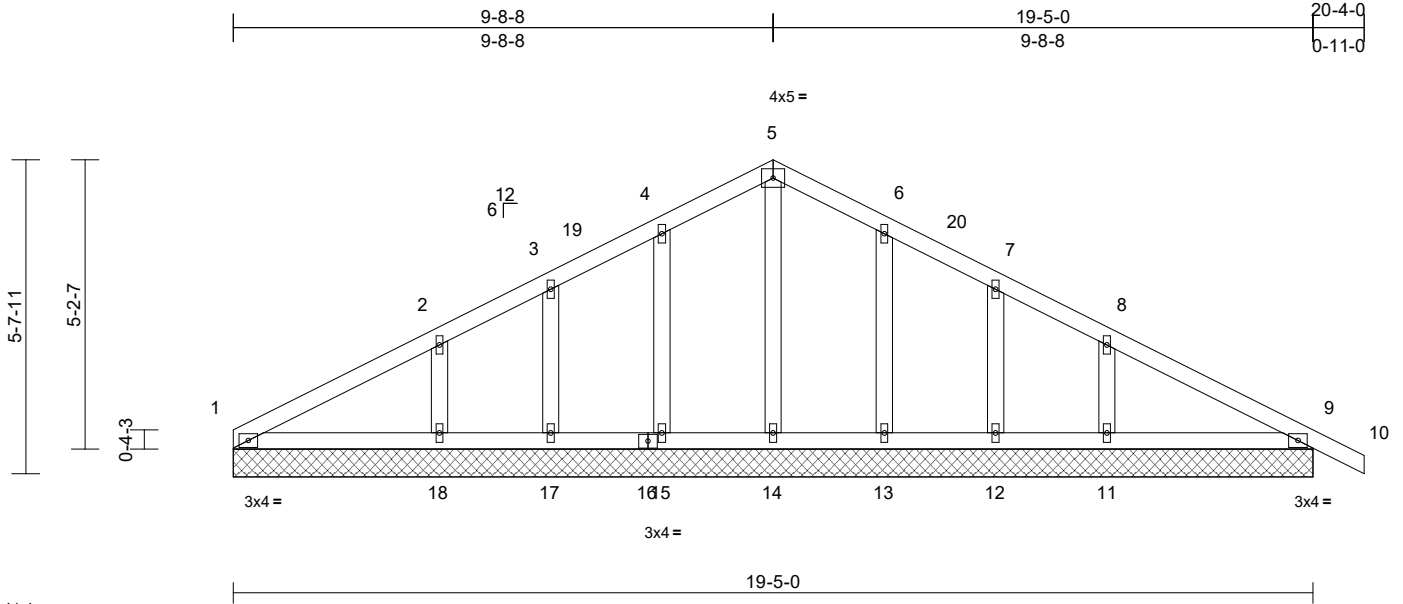

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	9	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 94 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)
1=19-5-0, 9=19-5-0, 11=19-5-0, 12=19-5-0, 13=19-5-0, 14=19-5-0, 15=19-5-0, 17=19-5-0, 18=19-5-0
Max Horiz 1=-81 (LC 13)
Max Uplift 1=-5 (LC 13), 9=-14 (LC 13), 11=-60 (LC 13), 12=-25 (LC 13), 13=-38 (LC 13), 15=-39 (LC 12), 17=-22 (LC 12), 18=-66 (LC 12)
Max Grav 1=136 (LC 1), 9=207 (LC 1), 11=310 (LC 1), 12=119 (LC 20), 13=237 (LC 20), 14=217 (LC 25), 15=245 (LC 19), 17=116 (LC 19), 18=326 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-85/71, 2-3=-60/69, 3-4=-41/87, 4-5=-57/108, 5-6=-56/102, 6-7=-39/63, 7-8=-56/37, 8-9=-72/47, 9-10=0/43
BOT CHORD 1-18=-2/71, 17-18=-2/71, 15-17=-2/71, 14-15=-2/71, 13-14=-2/71, 12-13=-2/71, 11-12=-2/71, 9-11=-2/71
WEBS 5-14=-112/0, 4-15=-199/64, 3-17=-96/41, 2-18=-239/103, 6-13=-191/63, 7-12=-98/44, 8-11=-226/96

NOTES
1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 7) All plates are 1.5x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Gable studs spaced at 2-0-0 oc.
- 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 12) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 1, 39 lb uplift at joint 15, 22 lb uplift at joint 17, 66 lb uplift at joint 18, 38 lb uplift at joint 13, 25 lb uplift at joint 12, 60 lb uplift at joint 11 and 14 lb uplift at joint 9.
- 14) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss J01	Truss Type Jack-Closed	Qty 4	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476295
----------------	--------------	---------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:59
ID:IAseccw2loPfwXAOcPghEyST53-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

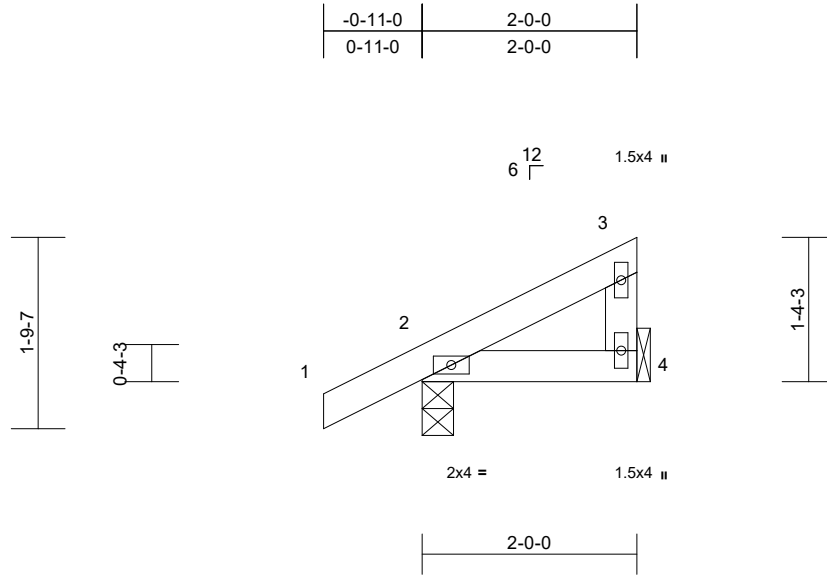

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	0.00	2-4	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	0.00	2-4	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-P								
BCDL	10.0										Weight: 9 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4= Mechanical
Max Horiz 2=44 (LC 12)
Max Uplift 2=-20 (LC 12), 4=-11 (LC 12)
Max Grav 2=170 (LC 18), 4=62 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-3=-36/15, 3-4=-44/22
BOT CHORD 2-4=0/0

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
 - Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 4 and 20 lb uplift at joint 2.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job 3705221	Truss J02G	Truss Type Half Hip Girder	Qty 2	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	I61476296
----------------	---------------	-------------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albemarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:39:59

Page: 1

ID:J_SwJ2Fw1QEAGmw_uQDdF_yST4G-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwrcDoi7J4zJC7f

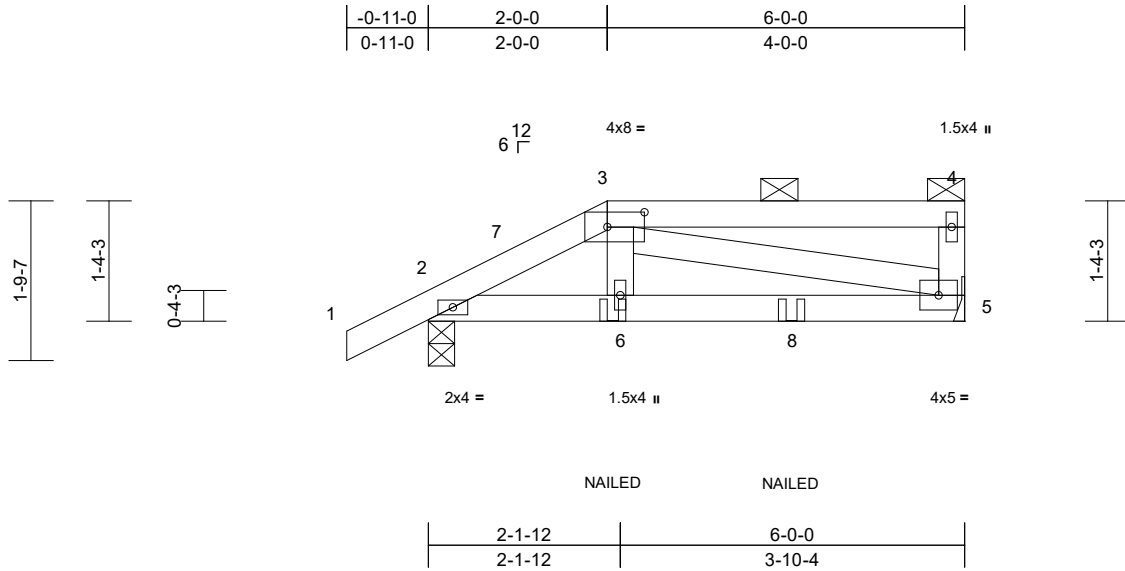

Loading (psf)		Spacing		CSI		DEFL				PLATES		GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.01	5-6	>999	240	MT20	244/190	
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.02	5-6	>999	180			
TCDL	10.0	Rep Stress Incr	NO	WB	0.15	Horz(CT)	0.00	5	n/a	n/a			
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-P								Weight: 27 lb	FT = 20%
BCDL	10.0												

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 5= Mechanical
Max Horiz 2=47 (LC 12)
Max Uplift 2=-45 (LC 12), 5=-47 (LC 9)
Max Grav 2=442 (LC 32), 5=390 (LC 31)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-522/57, 3-4=0/0, 4-5=-213/40
BOT CHORD 2-6=-55/436, 5-6=-55/455
WEBS 3-6=0/167, 3-5=-471/57

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.

- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 47 lb uplift at joint 5 and 45 lb uplift at joint 2.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-66, 3-4=-66, 2-5=-20
Concentrated Loads (lb)
Vert: 6=-42 (B), 8=-42 (B)



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss J03	Truss Type Half Hip	Qty 2	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476297
----------------	--------------	------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:40:00
ID:fyFpMJJ3sysSNXpxgzpoy1yST4B-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCdoi7J4zJC?f

Page: 1

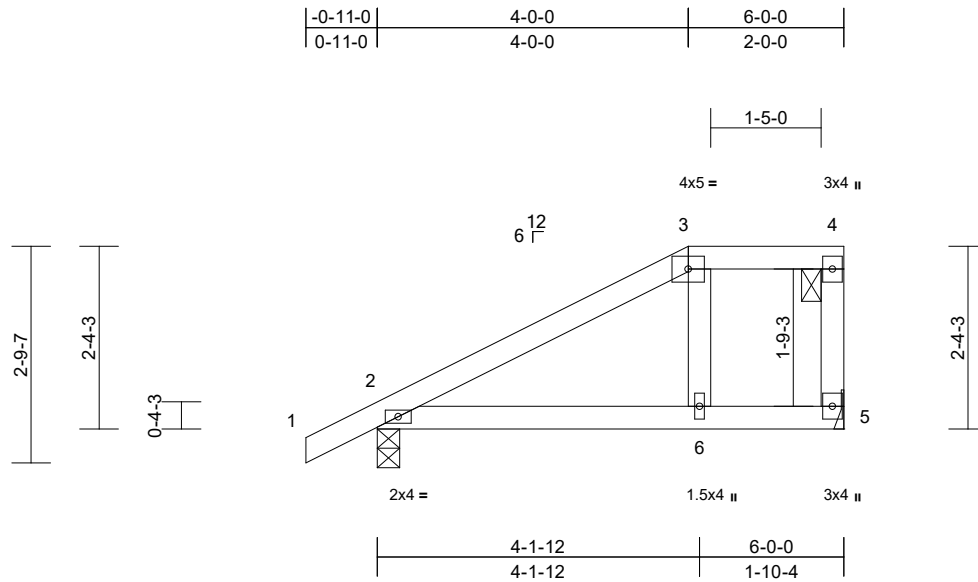

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	-0.05	2-6	>999	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.08	2-6	>828	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-S								
BCDL	10.0											
											Weight: 26 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 5= Mechanical
Max Horiz 2=79 (LC 12)
Max Uplift 2=-28 (LC 12), 5=-16 (LC 9)
Max Grav 2=478 (LC 32), 5=270 (LC 31)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/44, 2-3=-251/0, 3-4=-117/9,
4-5=-159/16
BOT CHORD 2-6=-13/124, 5-6=-9/117
WEBS 3-6=-98/54

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
- Bearings are assumed to be: Joint 2 SP No.2 crushing capacity of 565 psi.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 5 and 28 lb uplift at joint 2.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- Wind: ASCE 7-10; Vult=120mph (3-second gust) Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10, Lu=50-0-0
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job 3705221	Truss M01	Truss Type Monopitch	Qty 3	Ply 1	Sunset B - Lot 15 - Fairground Farms Job Reference (optional)	161476299
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Albermarle), Albermarle, NC - 28001,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Tue Oct 17 17:40:00
ID: _P8MGjAezcw7f8cQ8aXa83ySRqJ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRcDoi7J4zJC?#

Page: 1

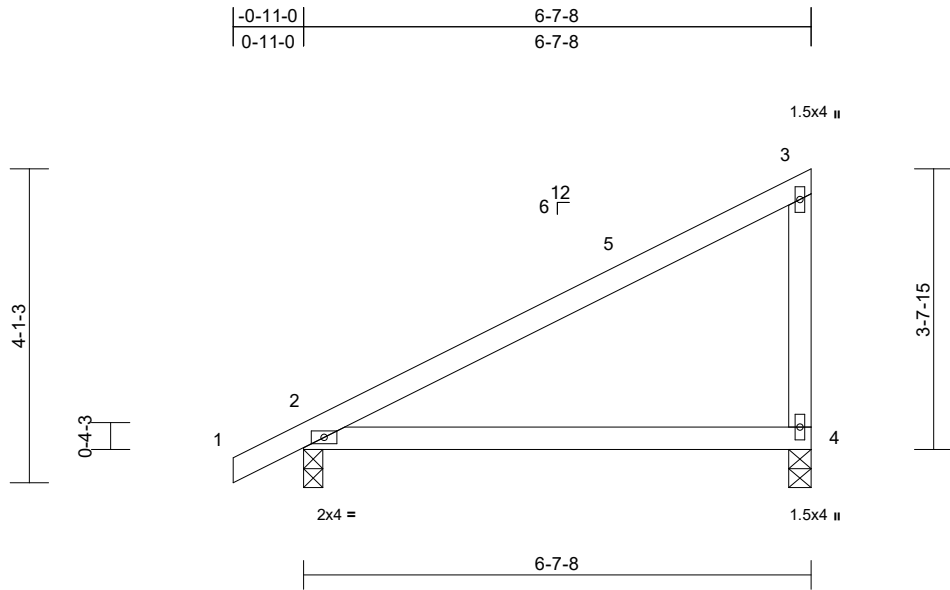

Scale = 1:30.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.10	2-4	>780	240	MT20	244/190
Snow (Pf/Pg)	23.1/30.0	Lumber DOL	1.15	BC	0.52	Vert(CT)	-0.20	2-4	>390	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCLL	0.0*	Code	IRC2015/TPI2014	Matrix-P								
BCDL	10.0											
											Weight: 27 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-0, 4=0-3-8
Max Horiz 2=120 (LC 12)
Max Uplift 2=-19 (LC 12), 4=-54 (LC 12)
Max Grav 2=355 (LC 19), 4=297 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/44, 2-3=-97/83, 3-4=-234/93
BOT CHORD 2-4=0/0

NOTES

- 1) Wind: ASCE 7-10; Vult=120mph (3-second gust)
Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-10; Pr=20.0 psf (roof live load: Lumber DOL=1.15 Plate DOL=1.15); Pg=30.0 psf (ground snow); Pf=23.1 psf (flat roof snow: Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 23.1 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 1-00-00 wide will fit between the bottom chord and any other members.
 - 7) All bearings are assumed to be SP No.2 crushing capacity of 565 psi.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 4 and 19 lb uplift at joint 2.
 - 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



October 19, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MITEK COMPANY


818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

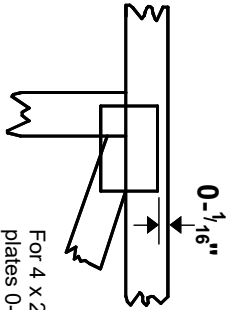

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

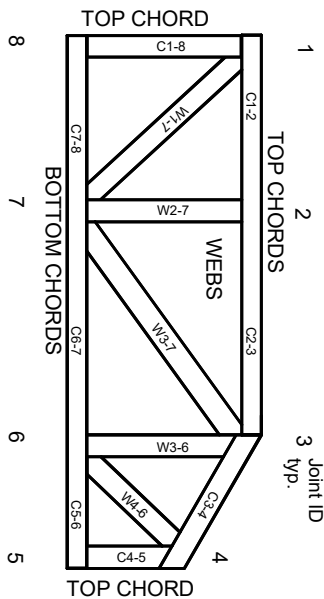

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor 1 bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and weave at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: Mill-7473 rev. 1/22/2023