

Job 72411262	Truss FT200	Truss Type Truss	Qty 12	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	-----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:21

Page: 1

ID:y3sPYq5TsyxrGJGfp8_dOxzS4An-fc4cBsdGQdfE22Ka5Zd6g?9HykKVPXRxQ2HUMzQR2C

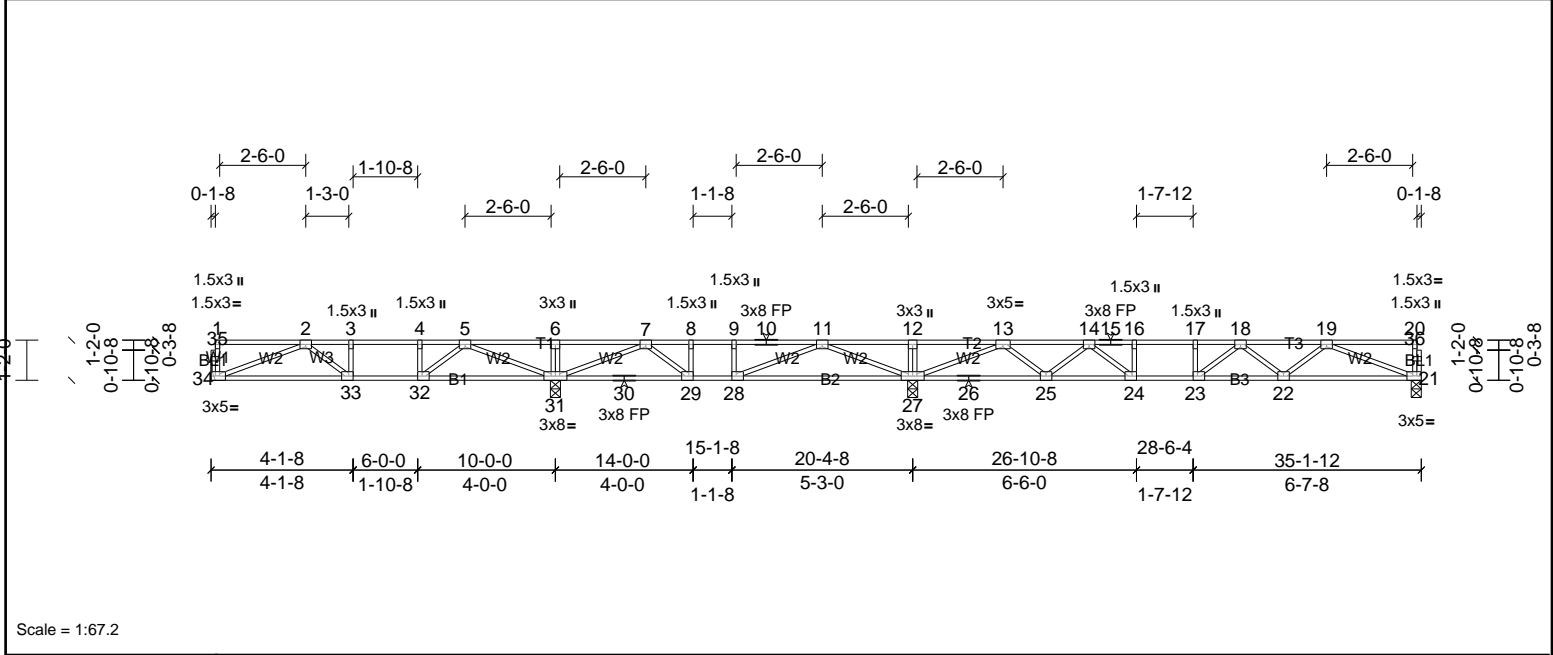


Plate Offsets (X, Y): [21:0-2-0,Edge], [23:0-1-8,Edge], [24:0-1-8,Edge], [28:0-1-8,Edge], [29:0-1-8,Edge], [32:0-1-8,Edge], [33:0-1-8,Edge], [34:0-2-0,Edge]

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.63	Vert(LL)	-0.13	22-23	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.72	Vert(CT)	-0.17	22-23	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.45	Horz(CT)	0.03	21	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH								

Weight: 171 lb FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS All bearings 0-3-8, except 34= Mechanical
 (lb) - Max Grav All reactions 250 (lb) or less at joint(s) except 21=565 (LC 5), 27=1310 (LC 11), 31=918 (LC 3), 34=396 (LC 5)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-844/0, 3-4=-844/0, 4-5=-844/0, 5-6=0/496, 6-7=0/496, 7-8=-661/334, 8-9=-661/334, 9-10=-661/334, 10-11=-661/334, 11-12=0/1298, 12-13=0/1298, 13-14=-952/42, 14-15=-1711/0, 15-16=-1711/0, 16-17=-1711/0, 17-18=-1711/0, 18-19=-1471/0
 BOT CHORD 33-34=0/746, 32-33=0/844, 31-32=-2/593, 30-31=-283/501, 29-30=-283/501, 28-29=-334/661, 27-28=-643/303, 26-27=-212/500, 25-26=-212/500, 24-25=0/1394, 23-24=0/1711, 22-23=0/1704, 21-22=0/1185
 WEBS 5-31=950/0, 2-34=-797/0, 5-32=0/425, 11-27=-1175/0, 7-31=-810/11, 11-28=0/617, 7-29=-64/261, 13-27=-1646/0, 19-21=-1270/0, 13-25=0/623, 19-22=0/372, 14-25=-622/0, 18-22=-303/0, 14-24=0/577, 16-24=-253/0

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72411262	Truss FT201	Truss Type Truss	Qty 1	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, JMP

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:29:33

Page: 1

ID:nCDgotAERob5_Ejp9P41dCzS4Ah-mek2eMnrXHF7jNuk_OwC50vwy56Hjlt0Geh8eJzQQxG

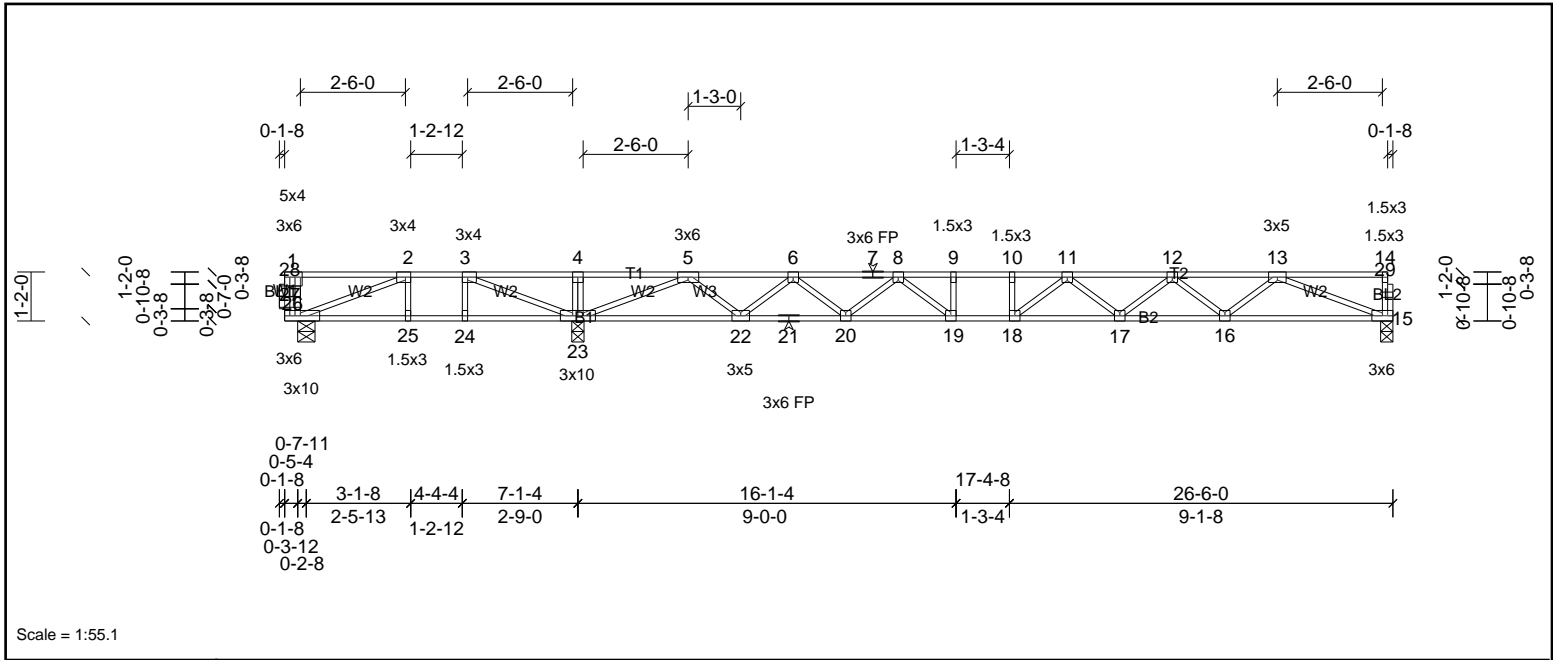


Plate Offsets (X, Y): [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [27:0-1-8,0-1-8], [28:0-1-8,0-1-7]

Loading	(psf)	Spacing	1-7-3	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.84	Vert(LL)	-0.30	17-18	>782	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.98	Vert(CT)	-0.40	17-18	>571	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.62	Horz(CT)	0.06	15	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 133 lb	FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS	(lb/size)
	15=749/0-3-8, (min. 0-1-8), 23=1506/0-3-8, (min. 0-1-8), 26=34/0-4-15, (min. 0-1-8)
Max Uplift	26=-178 (LC 4)
Max Grav	15=757 (LC 7), 23=1506 (LC 1), 26=221 (LC 3)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-253/711, 3-4=0/1805, 4-5=0/1805, 5-6=-1242/0, 6-7=-2370/0, 7-8=-2370/0, 8-9=-3104/0, 9-10=-3104/0, 10-11=-3104/0, 11-12=-2920/0, 12-13=-2180/0
BOT CHORD	25-26=-711/253, 24-25=-711/253, 23-24=-711/253, 22-23=0/512, 21-22=0/1930, 20-21=0/1930, 19-20=0/2806, 18-19=0/3104, 17-18=0/3134, 16-17=0/2668, 15-16=0/1661
WEBS	3-23=-1424/0, 5-23=-2251/0, 13-15=-1782/0, 5-22=0/976, 13-16=0/676, 6-22=-926/0, 12-16=-635/0, 6-20=0/594, 12-17=0/328, 8-20=-590/0, 11-17=-279/0, 8-19=0/598, 11-18=-291/285, 9-19=-264/0, 2-26=-271/760

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x3 MT20 unless otherwise indicated.
 - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 178 lb uplift at joint 26.
 - 4) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT204	Truss Type Truss	Qty 6	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:23

Page: 1

ID:nUI6NhNuR0khWrW4fTu0qozS4AQ-b?CNcYf?o1tNUMCjiWb5B55XnlPzzlckOkXNYEzQR2

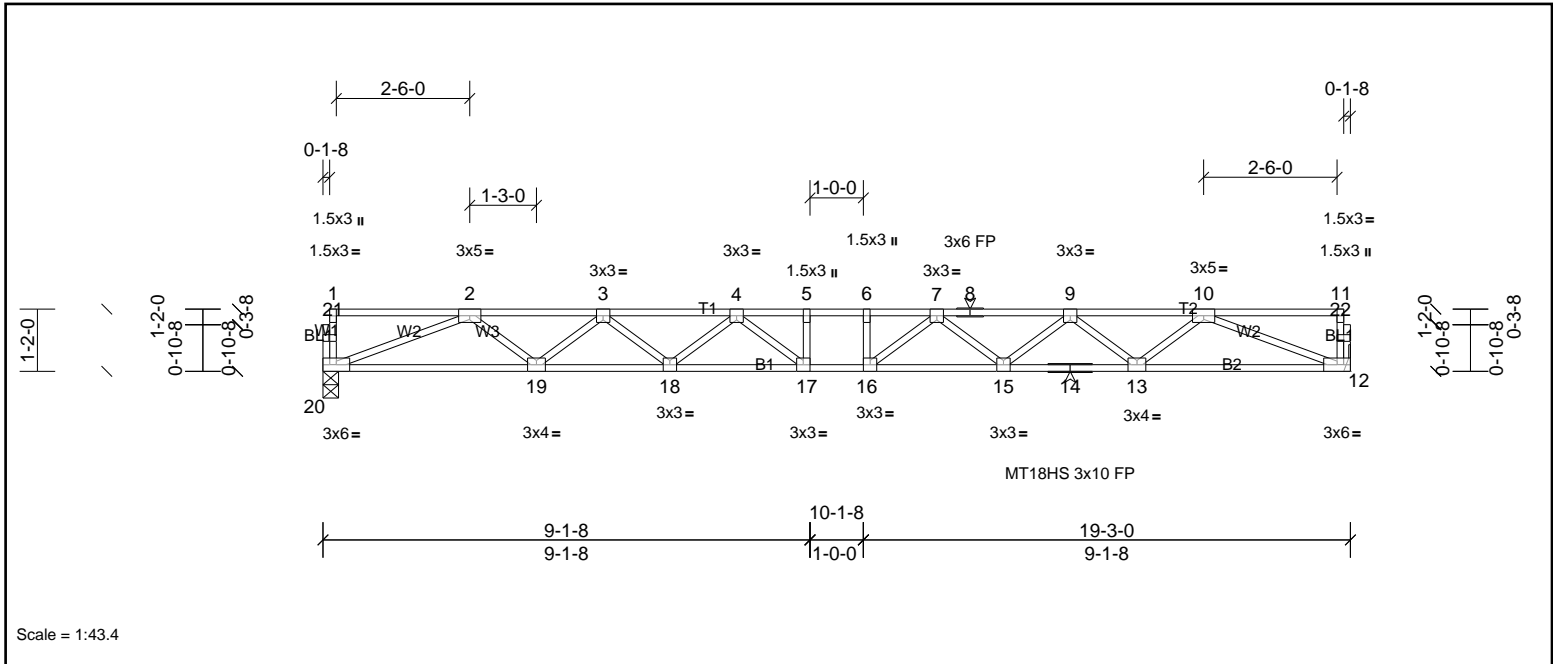

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.50	Vert(LL)	-0.34	16-17	>675	480	MT18HS	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.71	Vert(CT)	-0.46	16-17	>491	360	MT20	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.54	Horz(CT)	0.08	12	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 96 lb	FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS (lb/size) 12=831/ Mechanical, (min. 0-1-8), 20=831/0-3-8, (min. 0-1-8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2455/0, 3-4=-3362/0, 4-5=-3787/0, 5-6=-3787/0, 6-7=-3787/0, 7-8=-3362/0, 8-9=-3362/0, 9-10=-2455/0

BOT CHORD 19-20=0/1847, 18-19=0/3028, 17-18=0/3673, 16-17=0/3787, 15-16=0/3673, 14-15=0/3028, 13-14=0/3028, 12-13=0/1847

WEBS 10-12=-1982/0, 2-20=-1982/0, 10-13=0/791, 2-19=0/791, 9-13=-746/0, 3-19=-746/0, 9-15=0/434, 3-18=0/434, 7-15=-406/0, 4-18=-406/0, 7-16=-158/414, 4-17=-158/414

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 3x3 MT20 unless otherwise indicated.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT205	Truss Type Truss	Qty 3	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:23

Page: 1

ID:vFZRgyijNEWQ7TprPmQ216zS49y-b?CNcYf?o1tNUMCjWb5B55QNIMWzHWkOkXNYEzQR2

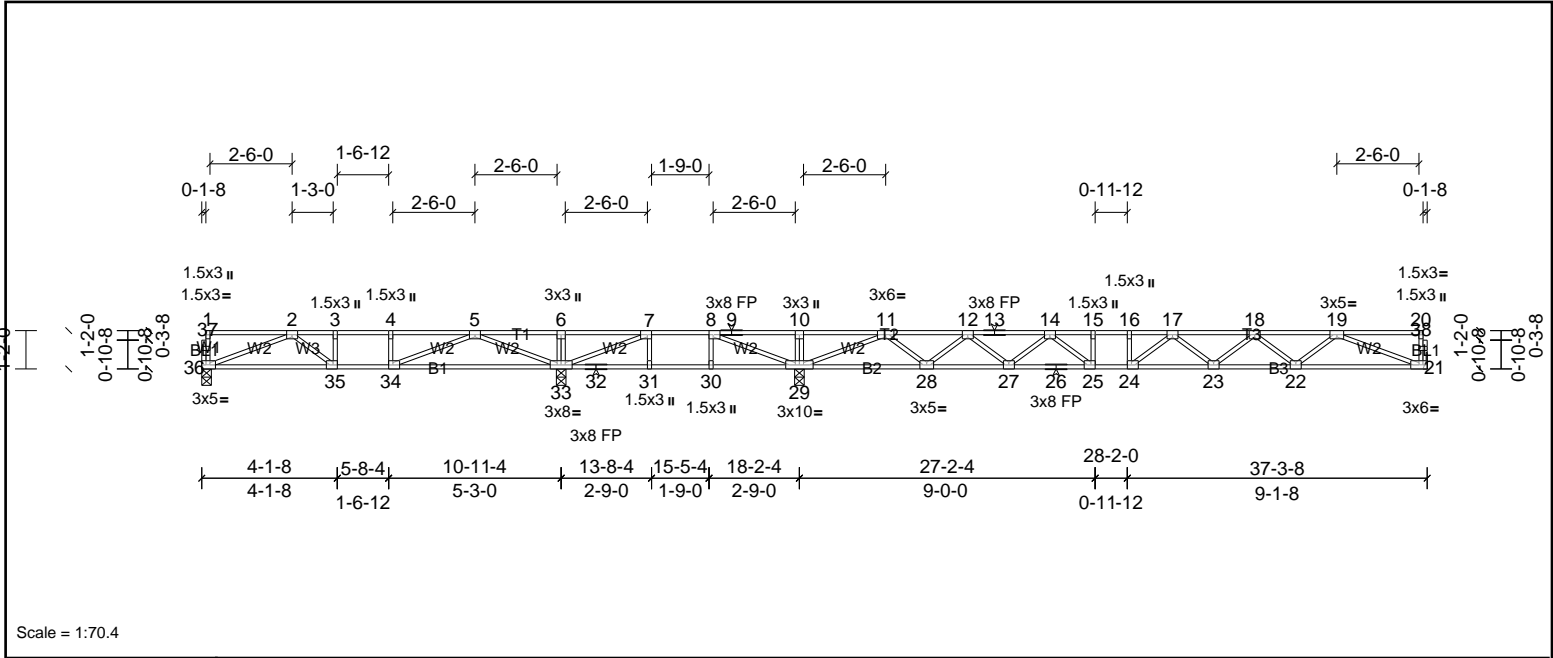

Scale = 1:70.4

Plate Offsets (X, Y):	[7:0-1-8,Edge], [8:0-1-8,Edge], [24:0-1-8,Edge], [25:0-1-8,Edge], [34:0-1-8,Edge], [35:0-1-8,Edge], [36:0-2-0,Edge]											
Loading	(psf)	Spacing	1-7-3	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.91	Vert(LL)	-0.28	23-24	>810	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.93	Vert(CT)	-0.38	23-24	>593	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.05	21	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 182 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS All bearings 0-3-8, except 21= Mechanical
 (lb) - Max Grav All reactions 250 (lb) or less at joint(s) except 21=732 (LC 4), 29=1375 (LC 4), 33=864 (LC 3), 36=399 (LC 3)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-880/85, 3-4=-880/85, 4-5=-880/85, 5-6=0/1235, 6-7=0/1235, 7-8=-21/1351, 8-9=0/1950, 9-10=0/1950, 10-11=0/1950, 11-12=-1029/0, 12-13=-2165/0, 13-14=-2165/0, 14-15=-2888/0, 15-16=-2888/0, 16-17=-2888/0, 17-18=-2764/0, 18-19=-2086/0
 BOT CHORD 35-36=0/759, 34-35=-85/880, 33-34=-478/369, 32-33=-1351/21, 31-32=-1351/21, 30-31=-1351/21, 29-30=-1351/21, 28-29=-202/298, 27-28=0/1724, 26-27=0/2600, 25-26=0/2600, 24-25=0/2888, 23-24=0/2948, 22-23=0/2543, 21-22=0/1598
 WEBS 6-33=-261/0, 5-33=-1250/0, 2-36=-811/0, 5-34=0/746, 7-33=-497/283, 8-29=-987/0, 11-29=-2220/0, 19-21=-1714/0, 11-28=0/969, 19-22=0/635, 12-28=-926/0, 18-22=-594/0, 12-27=0/594, 18-23=0/288, 14-27=-586/0, 14-25=0/575, 17-24=-320/226

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT206	Truss Type Truss	Qty 1	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:24

Page: 1

ID: gF_cC3QPVE6?TqrJzy_dzS4AM-3BmlqgdZL?E5VnvFE6Kkldk19sRiq9tdOGx3gzQR1z

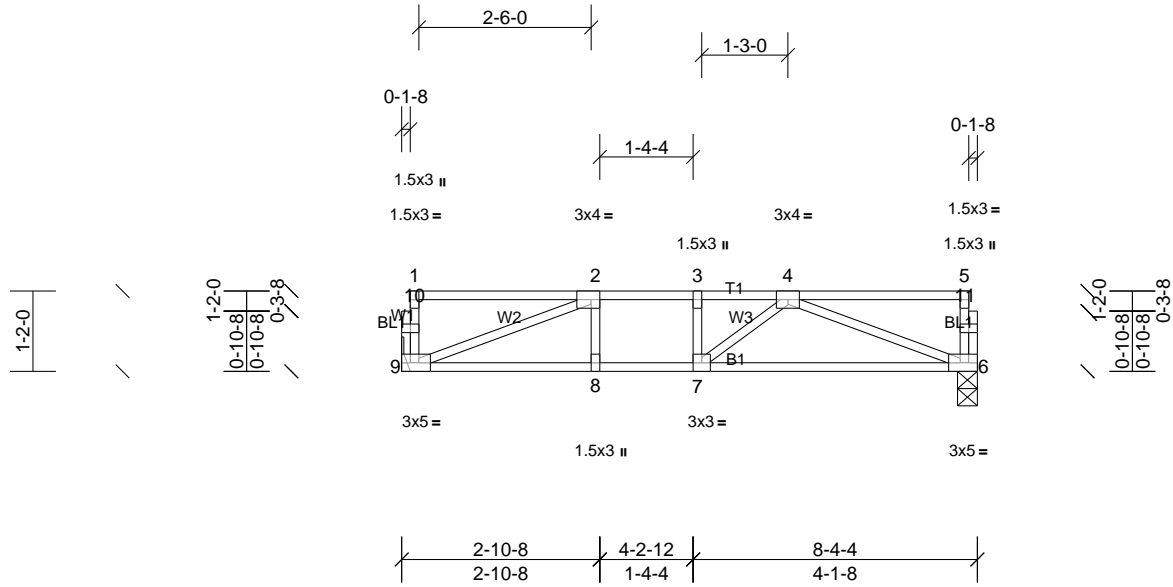

Scale = 1:33.6

Plate Offsets (X, Y): [2:0-1-8,Edge], [6:0-2-0,Edge], [9:0-2-0,Edge]

Loading	(psf)	Spacing	1-7-3	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.34	Vert(LL)	-0.05	6-7	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.31	Vert(CT)	-0.08	6-7	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.20	Horz(CT)	0.01	6	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 42 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	6=352/0-3-7, (min. 0-1-8), 9=352/ Mechanical, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-676/0, 3-4=-676/0	
BOT CHORD	8-9=0/676, 7-8=0/676, 6-7=0/642	
WEBS	4-6=-685/0, 2-9=-720/0	

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72411262	Truss FT207	Truss Type Truss	Qty 4	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:24

Page: 1

ID:UPLt6VA45?GjOH?Ea3MDuzS4AG-3BmlqugdZL?E5VnvFE6Kkldjd9p5jp3tdOGx3gzQR1z

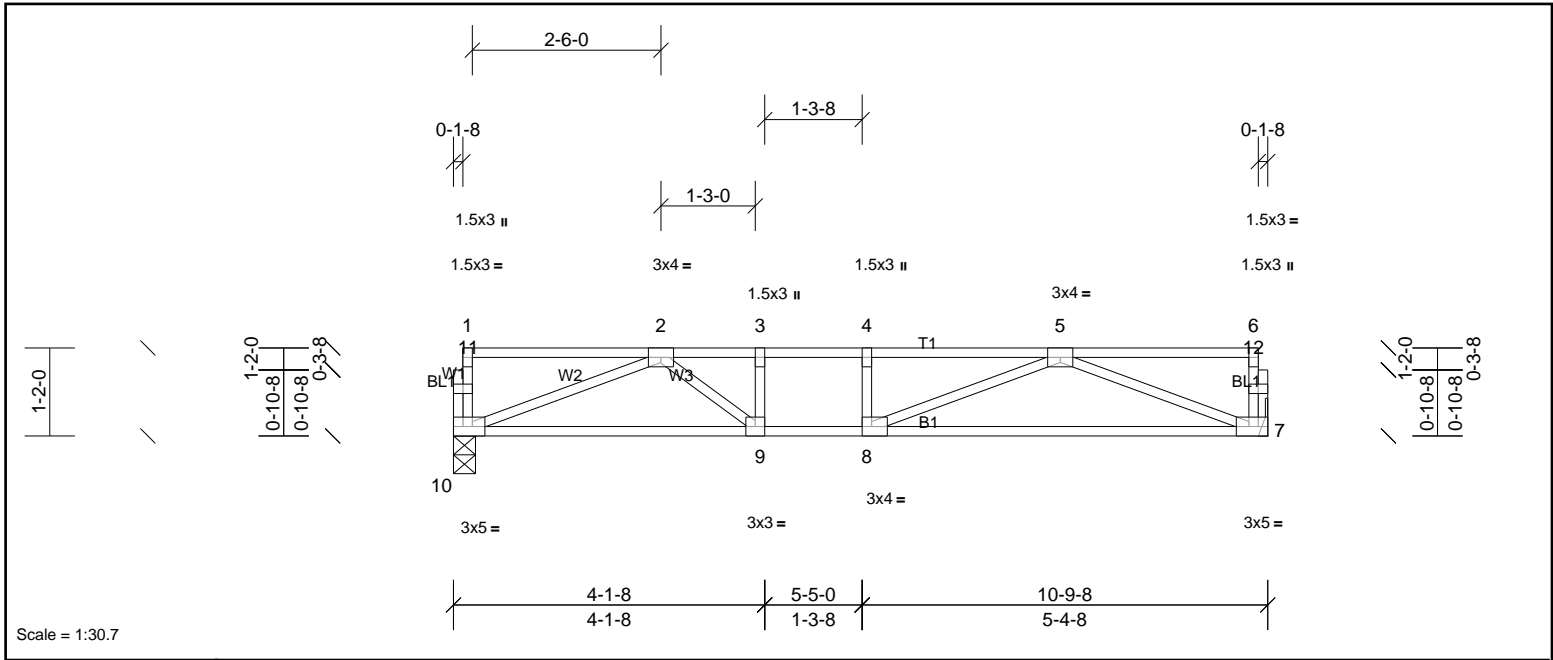


Plate Offsets (X, Y): [7:0-2-0,Edge], [8:0-1-8,Edge], [10:0-2-0,Edge]

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.43	Vert(LL)	-0.09	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.46	Vert(CT)	-0.17	7-8	>762	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.27	Horz(CT)	0.02	7	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 54 lb	FT = 20%F, 11%E

LUMBER	BRACING
TOP CHORD 2x4 SP No.2(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS (lb/size) 7=459/ Mechanical, (min. 0-1-8), 10=459/0-3-8, (min. 0-1-8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1164/0, 3-4=-1164/0, 4-5=-1164/0
 BOT CHORD 9-10=0/915, 8-9=0/1164, 7-8=0/911
 WEBS 5-7=-975/0, 2-10=-979/0, 5-8=0/363, 2-9=0/415

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT208	Truss Type Truss	Qty 4	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:24

Page: 1

ID:YIIYcEhaYiu80hxtDrtK3zS4A1-3BmlqugdZL?E5VnvFE6KkldiX9pKipvtDQGx3gzQR1z

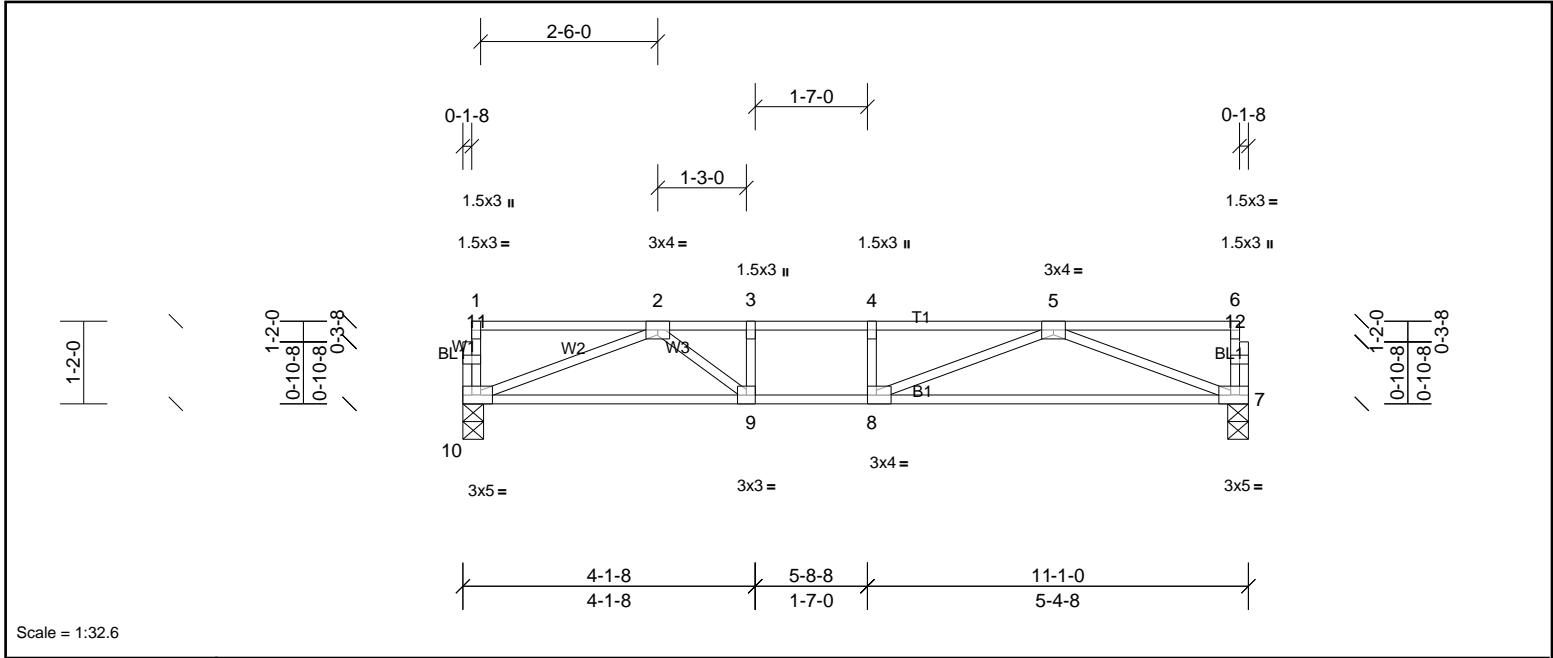

Scale = 1:32.6

Plate Offsets (X, Y): [7:0-2-0,Edge], [8:0-1-8,Edge], [10:0-2-0,Edge]

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.50	Vert(LL)	-0.11	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.51	Vert(CT)	-0.19	7-8	>684	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.28	Horz(CT)	0.02	7	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 54 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	7=472/0-3-8, (min. 0-1-8), 10=472/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD		2-3=-1222/0, 3-4=-1222/0, 4-5=-1222/0
BOT CHORD		9-10=0/947, 8-9=0/1222, 7-8=0/943
WEBS		5-7=-1009/0, 2-10=-1013/0, 5-8=0/398, 2-9=0/454

- NOTES**
- Unbalanced floor live loads have been considered for this design.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT209	Truss Type Truss	Qty 1	Ply 1	HH Hunt\CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:24

Page: 1

ID:rM9mWqZlvddYq9Ay17fXwyzS4AB-3BmlqugdZL?E5VnvFE6Kkldi09rfiq0tdOGx3gzQR1z

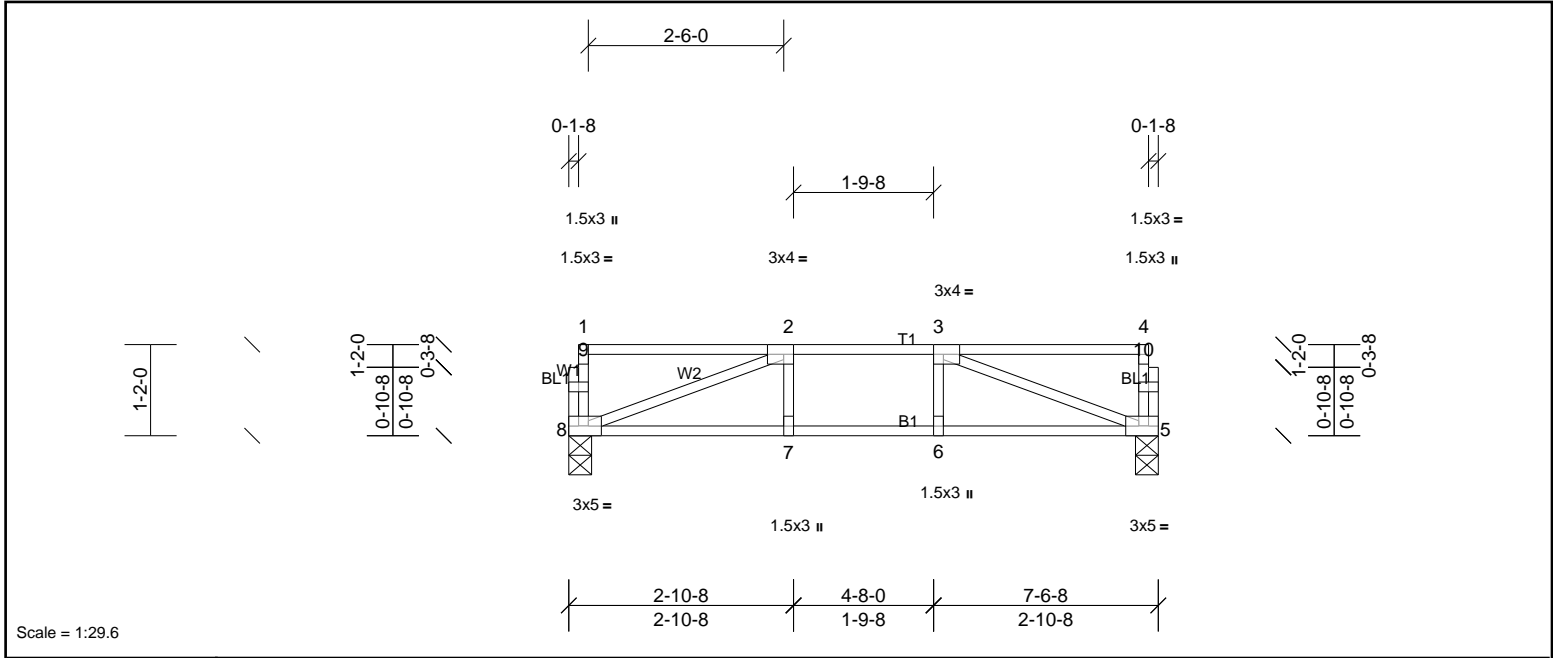

Scale = 1:29.6

Plate Offsets (X, Y): [2:0-1-8,Edge], [3:0-1-8,Edge], [5:0-2-0,Edge], [8:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.47	Vert(LL)	-0.05	7-8	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.36	Vert(CT)	-0.06	7-8	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.01	5	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-SH							Weight: 38 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS	(lb/size)	5=395/0-3-8, (min. 0-1-8), 8=395/0-3-8, (min. 0-1-8)
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-706/0	
BOT CHORD	7-8=0/706, 6-7=0/706, 5-6=0/706	
WEBS	3-5=-750/0, 2-8=-750/0	

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss FT210	Truss Type Truss	Qty 1	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:24

Page: 1

ID:j8OHMBcpzs7_lmTjGykt5ozS4A7-3BmlqugdZL?E5VnvFE6Kkldml9wqitHtdOGx3gzQR1z

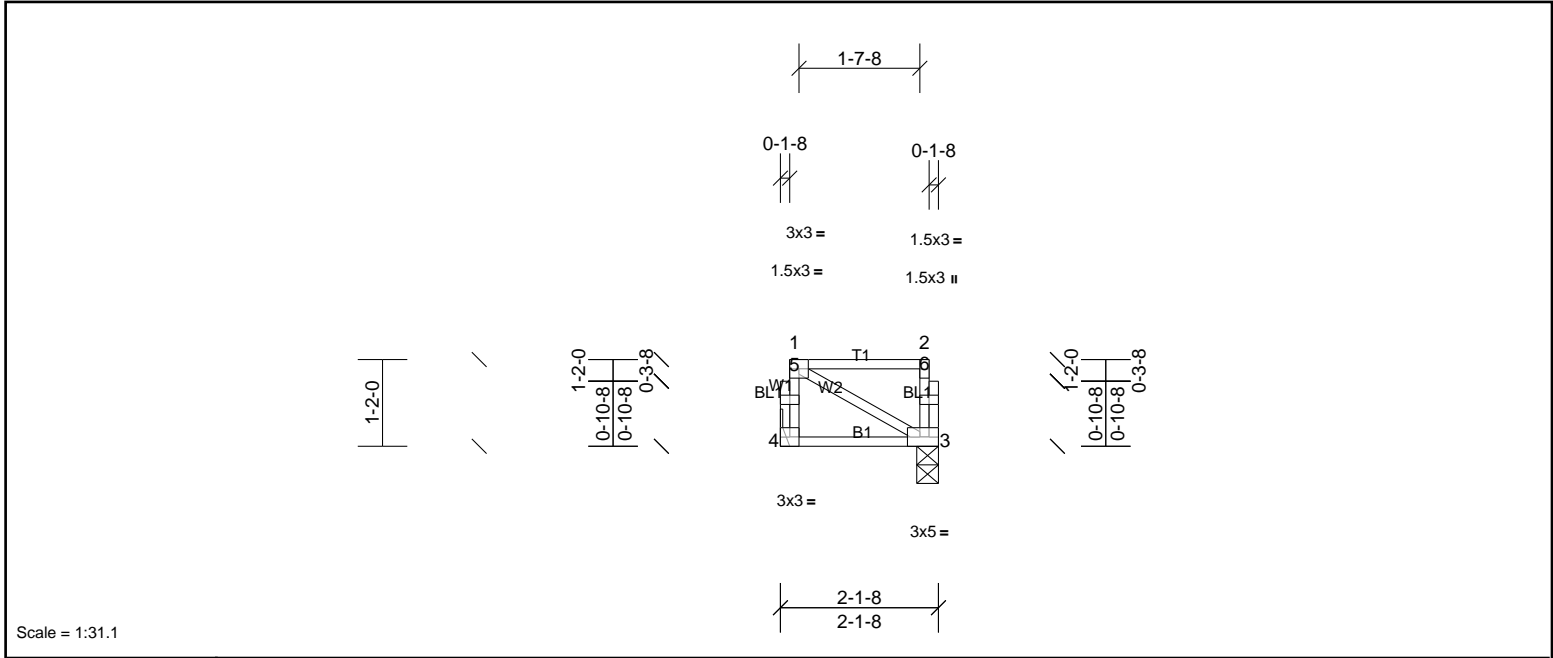

Scale = 1:31.1

Plate Offsets (X, Y): [3:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.23	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.03	Vert(CT)	0.00	3-4	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-P							Weight: 14 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 2-1-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS (lb/size) 3=97/0-3-8, (min. 0-1-8), 4=97/ Mechanical, (min. 0-1-8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72411262	Truss KW200	Truss Type Truss	Qty 1	Ply 1	HH Hunt/CHATHAM FRMH A 2ND FL OW Job Reference (optional)
-----------------	----------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jan 4 2024 Print: 8.730 S Jan 4 2024 MiTek Industries, Inc. Mon Apr 15 16:22:25

Page: 1

ID:YCerL_swZpJnsFkpxdwajzS4B5-XNK71EgFKe85jfM5pxdZGWA_AZGDRK40s20Uc7zQR1y

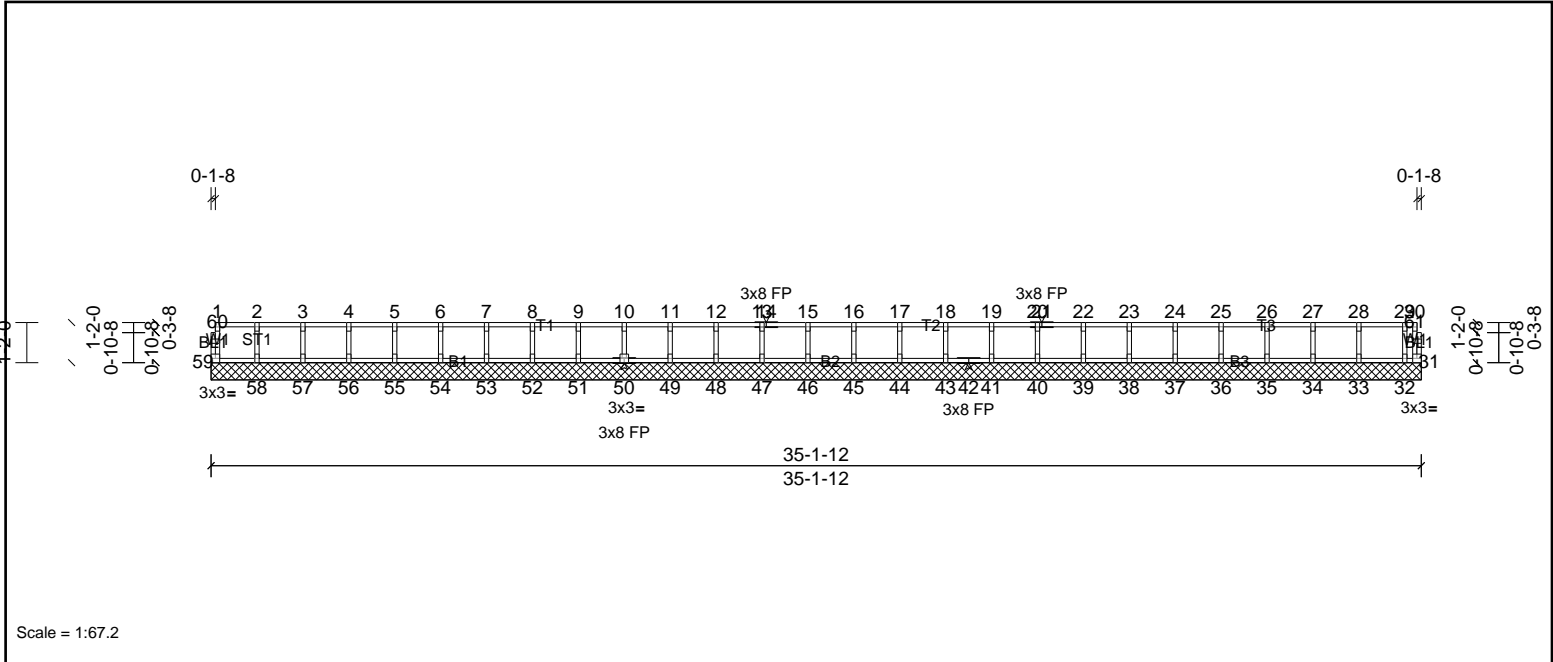

Scale = 1:67.2

Loading	(psf)	Spacing	1-7-3	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	n/a	-	n/a	n/a		
BCDL	5.0	Code	IRC2015/TPI2014	Matrix-R							Weight: 145 lb	FT = 20%F, 11%E

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2(flat)	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2(flat)	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3(flat)		
OTHERS	2x4 SP No.3(flat)		

REACTIONS All bearings 35-1-12.
 (lb) - Max Uplift All uplift 100 (lb) or less at joint(s) 31
 Max Grav All reactions 250 (lb) or less at joint(s) 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 31.
 - 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



