

SOUTHPORT



COVER SHEET

SOUTHPORT REVISION LIST - STRUCTURAL:

1. COMBINED WILMINGTON AND WILMINGTON II PLANS. (2-18)
2. ADDED BRICK OPTION ON SECOND FLOOR. (2-18)
3. CALLED OUT SERIES/SPACING OF JOISTS ON BASEMENT. (2-18)
4. 2018 NCRG UPDATE. (6-19)
5. 2018 SC IRC (2-15-20)
6. ADDED ELEVATION A.2 (BRICK WATERTABLE W/ SIDING ABOVE) & ELEVATION A.3 (STONE WATERTABLE W/ SIDING ABOVE). (2-15-20)

4/21/2024 - Selection Notes Added

SOUTHPORT REVISION LIST - ARCHITECTURAL:


AUGUST 01, 2021

1. CREATED ELEVATIONS TO BE IN STANDARDS WITH OTHER PLANS (SEE SHEETS A-1 THROUGH A.3.5)
2. CHANGED COLUMNS ON ELEVATIONS TO STANDARD COLUMNS
3. CHANGED GARAGE DOORS TO REPRESENT STANDARD GARAGE DOOR FOR EACH ELEVATION
4. FIXED COVERED PORCH TO KEEP COLUMNS FROM OVERLAPPING EDGE OF CONCRETE
5. REMOVED GRIDS FROM TRANSOMS ABOVE FRONT DOOR
6. ADDED NOTE FOR GARAGE DOOR "GARAGE DOOR PER SPECIFICATIONS AND GLASS INSERT (TOP PANEL ONLY)"
7. MOVED ROOF PLANS TO SHEETS A.8 & A.8.1
8. CREATED SLAB INTERFACE PLAN (SEE SHEET A.4 THROUGH A.4.2)
9. MOVED ALL OPTIONS OFF BASE PLAN AND PLACED ON SEPARATE SHEET
10. ADDED NOTE FOR FLUSH COUNTERTOP ON ISLAND
11. CHANGED PATIO SIZE TO STANDARD 12'X10'
12. ADDED OPTIONAL GAS LINE
13. CHANGED KITCHEN LAYOUT
14. ADDED 2ND HOSE BIB
15. CALLED OUT "45" WALL WITH CAP" AS STANDARD
16. CHANGED ALL EXTERIOR WALLS FROM 2X6 TO 2X4 EXCEPT WHERE SHADED
17. ADDED NOTE "OPT. REF."
18. REMOVED NUMBERS ON STAIRS
19. ADDED NOTE "OPT. W/D"
20. ADDED NOTE "WASHER ALWAYS TO BE LOCATED TO THE LEFT OF DRYER"
21. VERIFIED VENTILATION AND LIGHT REQUIREMENTS AT OWNER'S BEDROOM MEETS CODE (11-01-20)
22. SQUARE FOOTAGES ARE UPDATED AND CHANGED DUE TO MOVEMENT OF WALLS FROM 2X6 TO 2X, TO KEEP JOBS IN ROOMS, EXTERIOR WALL MOVED MEANING ROOF LINES HAVE CHANGED
23. SQUARE FOOTAGE OF COVERED PORCH CHANGED DUE TO KEEPING COLUMNS FROM OVERLAPPING CONCRETE EDGE
24. CREATED PARTIAL PLANS FOR B & C ELEVATIONS (FLOOR, SLAB, & ELECTRICAL)
25. REMOVED ALL WALL OUTLETS
26. REMOVED ALL PHONE OUTLETS
27. REMOVED ALL TV OUTLETS
28. PLACED STANDARD 3 BULB LIGHT IN KITCHEN
29. VERIFIED COACH LIGHT LOCATIONS (SEE ELEVS. FOR DIMS)
30. PLACED DASHED FANS WHERE APPLICABLE WITH NOTE "STD. LIGHT, OPT. FAN/LT PREWIRE"
31. UPDATED ELECTRICAL KEY
32. VERIFIED CO2 DETECTOR LOCATIONS
33. SHOWED PENDANT LIGHTS AS OPTIONAL
34. SHOWED CAN LIGHTS IN KITCHEN AND FAMILY ROOM AS "OPTIONAL CAN LIGHTS"
35. PLACED OPTIONAL FLOOD LIGHTS
36. PLACED OPTIONAL FLOOR OUTLET IN FAMILY ROOM
37. PLACED CALCULATIONS FOR SOFFIT AND RIDGE VENT REQUIREMENTS
38. UPDATED STAIR LAYOUT TO KEEP MAIN WALL AT KITCHEN FROM MOVING WHEN OPTIONAL BASEMENT SELECTED.

DREAM FINDERS HOMES
SOUTHPORT


DATE: SEPTEMBER 16, 2019
 REV: AUGUST 01, 2021
 DRAWN BY:
 ENGINEERED BY:
 REVIEWED BY:



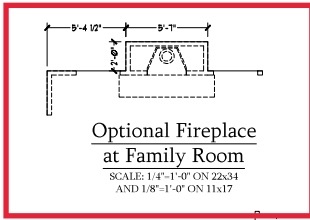


**Optional Fireplace
at Family Room**

SCALE: 1/4"=1'-0" ON 22x34
AND 1/8"=1'-0" ON 11x17




Optional Covered Patio

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

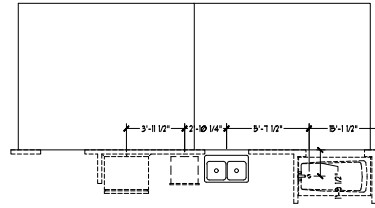

Optional Extended Patio

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



**Optional Butler's Pantry
at Garage Entry**

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



Optional Gourmet Kitchen

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




Optional Desk at Kitchen

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



**Optional Bi-Swing
Doors at Study**

SCALE: 1/4"=1'-0" ON 22x34
AND 1/8"=1'-0" ON 11x17

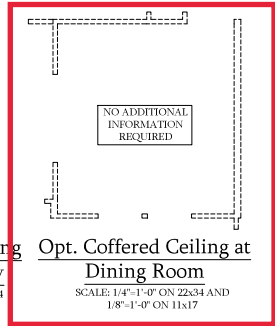


**Opt. Coffered Ceiling at
Dining Room**

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




**Optional Open Rail
ILO 45" Wall w/ Cap**

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

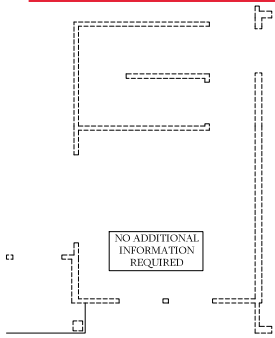


**Dining Room w/
Opt. Basement**

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

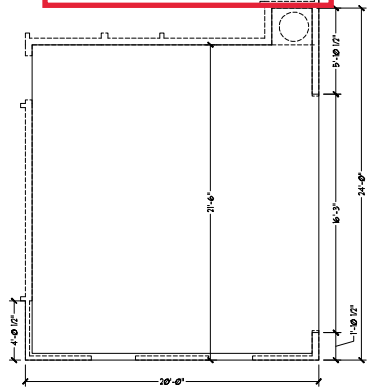


Optional 2-Car Side Load Garage

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




**Optional Service
Door at Garage**

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

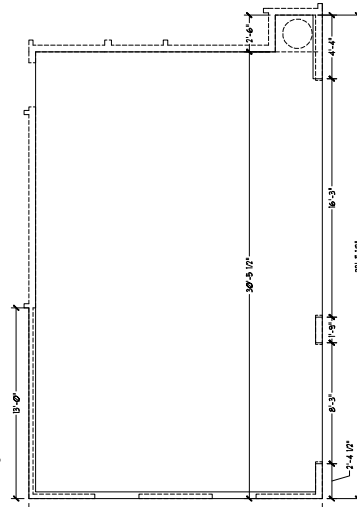


Optional 3-Car Side Load Garage

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

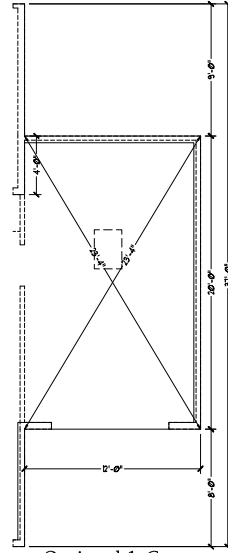

**Optional 1-Car
Carriage Garage**

Not Available w/ Opt. 2-Car Side Load
Garage or 3-Car Side Load Garage
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



**Optional Service
Door at 1-Car
Garage**

SCALE: 1/4"=1'-0" ON 22x34
AND 1/8"=1'-0" ON 11x17




PRICES, FINANCING, INVENTORY, FEATURES, OPTIONS,
DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
SCHEDULES, MATERIALS AND CONSTRUCTION METHODS
OF HOUSES SHOWN WILL BE DETERMINED BY THIS SITE.
RENDERINGS ARE ARTIST CONCEPTIONS. FINISH PLANS
HOMES, AS A USE, REPRESENTATION, ADAPTATION, OR
HOME. MAKE SURE YOU CONSULT WITH CURRENT DETAILS.
COPYRIGHT © DREAM FINDERS HOMES

DREAM FINDERS HOMES
SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"=1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:


SLAB INTERFACE
PLAN - OPTIONS

A-4.1

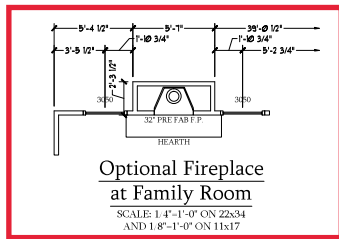


**Optional Fireplace
at Family Room**

SCALE: 1/4"=1'-0" ON Z2x34
AND 1/8"=1'-0" ON 11x17

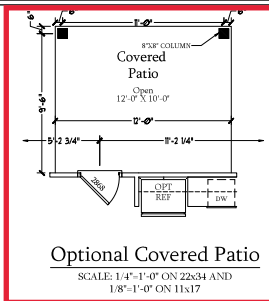


Optional Covered Patio

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

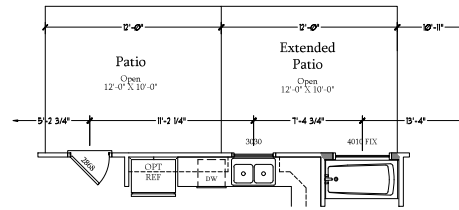


Optional Extended Patio

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17




**Optional Butler's Pantry
at Garage Entry**

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17




Optional Gourmet Kitchen

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17



Optional Desk at Kitchen

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17




**Optional Curb Wall
ILO 45" Wall w/ Cap**

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17




**Optional Bi-Swing
Doors at Study**

SCALE: 1/4"=1'-0" ON Z2x34
AND 1/8"=1'-0" ON 11x17

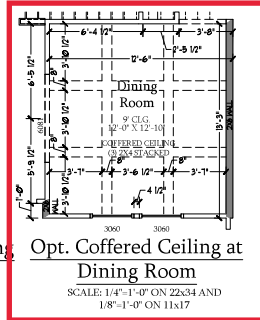


**Opt. Coffered Ceiling at
Dining Room**

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

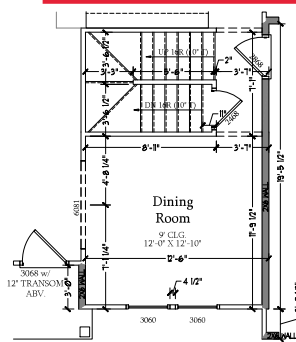

**Dining Room w/
Opt. Basement**

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

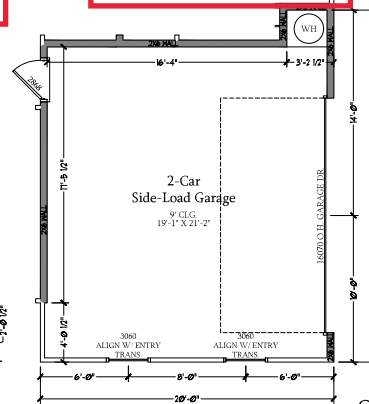


Optional 2-Car Side Load Garage

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17


**Optional Service
Door at Garage**

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

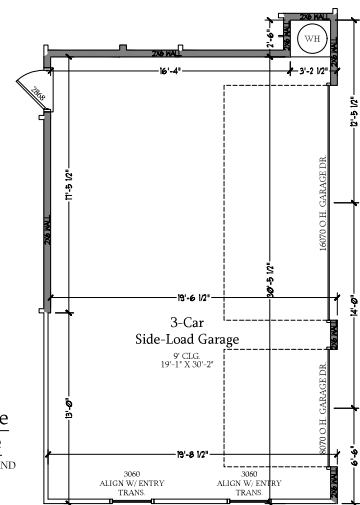

Optional 3-Car Side Load Garage

SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

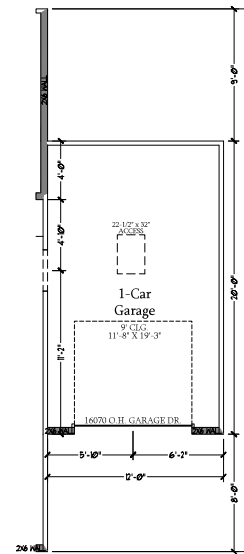

**Optional 1-Car
Carriage Garage**

Not Available w/ Opt. 2-Car Side Load
Garage or 3-Car Side Load Garage
SCALE: 1/4"=1'-0" ON Z2x34 AND
1/8"=1'-0" ON 11x17

**Optional Service
Door at 1-Car
Garage**

SCALE: 1/4"=1'-0" ON Z2x34
AND 1/8"=1'-0" ON 11x17






PRICES, FINISHES, INVENTORIES, FEATURES, OPTIONS,
DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
SCHEDULES, MATERIALS AND CONSTRUCTION ARE SUBJECT TO
CHANGE WITHOUT NOTICE. THESE PLANS ARE PRELIMINARY.
OF HOUSE ONLY WILL BE PROVIDED BY THE SITE.
RENDERINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS
HOMES, AS A USE, REPRESENTATION, ADAPTATION, OR
HOME. ALWAYS CONSULT FOR CURRENT DETAILS.
COPYRIGHT © DREAM FINDERS HOMES

DREAM FINDERS HOMES
SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"=1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:

FIRST FLOOR
PLAN - OPTIONS
A-6.1



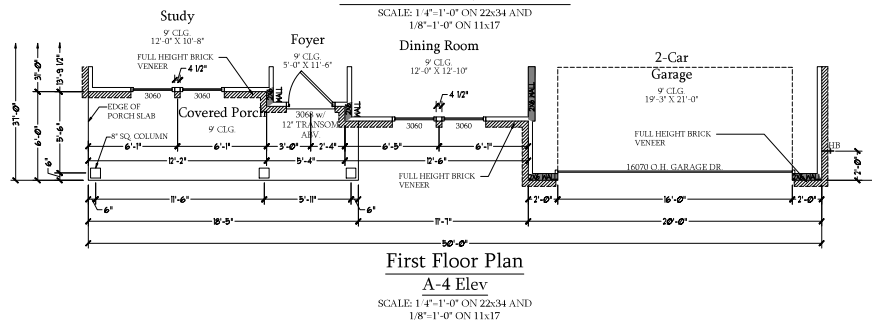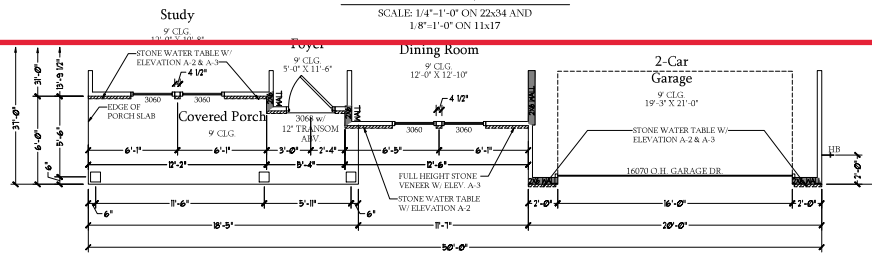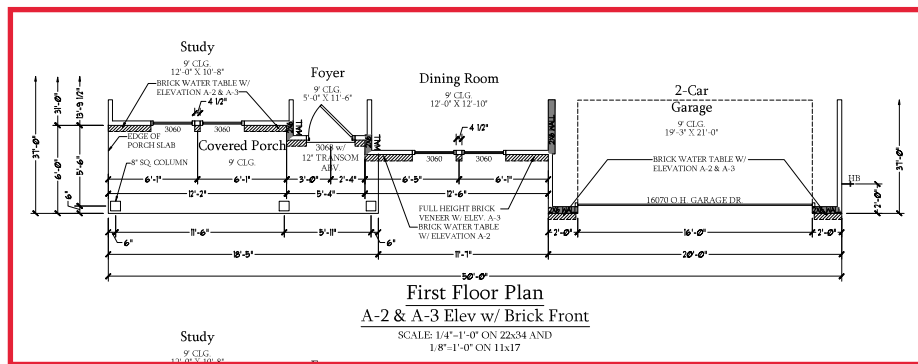


PRICES, FINISHES, INVENTORIES, FEATURES, OPTIONS, DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. DIMENSIONS ARE GIVEN UNLESS OTHERWISE NOTED. MATERIALS LISTED ARE SUGGESTED AND NOT A GUARANTEE OF HOUSE QUALITY WILL BE DETERMINED BY THE SITE. RENDERS ARE ARTIST CONCEPTIONS. ELEVATION, FLOOR PLANS, HOME AS A USE, REPRESENTATION, ADAPTATION, OR HOME MAKE CONSULTANT FOR CURRENT DETAILS. COPYRIGHT © DREAM FINDERS HOMES.


DREAM FINDERS HOMES
 SOUTHPORT

DATE: SEPTEMBER 16, 2019
 REV: AUGUST 01, 2021
 SCALE: 1/4"=1'-0"
 DRAWN BY:
 ENGINEERED BY:
 REVIEWED BY:


A ELEVATION
 FIRST FLOOR
 PARTIAL PLANS
 A-6.2




Optional Owner's Bath 2
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




Optional Owner's Bath 3
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




Optional Rec. Room ILO Loft
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




**Optional Open Rail ILO
45" Wall w/ Cap at Loft**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

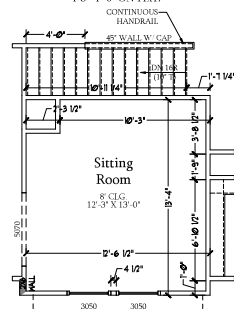


**Optional Sitting Room at
Owner's Bedroom ILO
Bedroom 4**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




**Optional Open Rail ILO 45" Wall
w/ Cap at Loft w/ Opt. Basement**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




**Bedroom 4 w/ Opt.
Basement**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

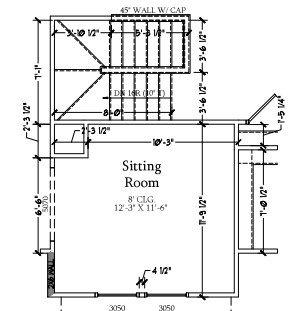

**Optional Sitting Room at Owner's
Bedroom ILO Bedroom 4 w/ Opt. Basement**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

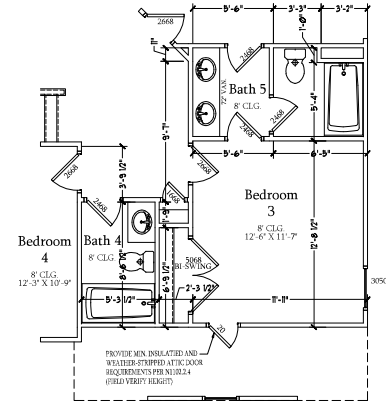

**Opt. Bath 5 w/ Bedroom 3
& Bath 4**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

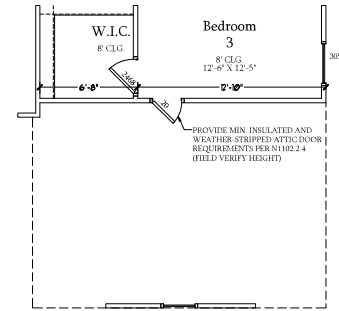

**Opt. 3-Car Side-Load
Garage**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



PRICES, FINANCING, INCENTIVES, FEATURES, OPTIONS,
DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
SCHEDULES, MATERIALS AND FINISHES ARE SUBJECT TO
CHANGE WITHOUT NOTICE. CONSTRUCTION METHODS
OF HOUSES SHOWN WILL BE DETERMINED BY THE SITE
CONDITIONS AND LOCAL CODES. ALL DIMENSIONS
SHOWN ARE BASED ON CONSTRUCTION STANDARDS
UNLESS OTHERWISE NOTED. CONSTRUCTION METHODS,
FINISHES AND MATERIALS ARE SUBJECT TO CHANGE
WITHOUT NOTICE. HOME USE, REPRODUCTION, ADAPTATION, OR
MODIFICATION OF THIS PLAN IS STRICTLY PROHIBITED.
COPYRIGHT © DREAM FINDERS HOMES

DREAM FINDERS HOMES
SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"=1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:


SECOND FLOOR
PLAN - OPTIONS
A-7.1




**Optional Fireplace
at Family Room**
SCALE: 1/4"=1'-0" ON 22x34
AND 1/8"=1'-0" ON 11x17




Optional Covered Patio
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

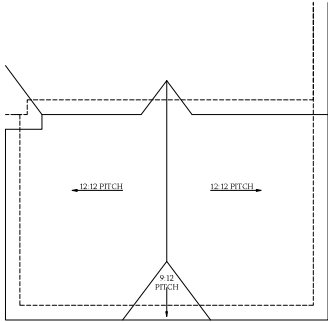

**Optional 3-Car Side Load Garage
Elevation C**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

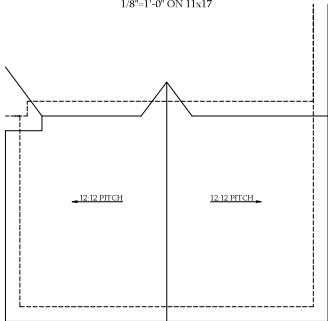


**Optional 3-Car Side Load Garage
Elevation A & B**
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

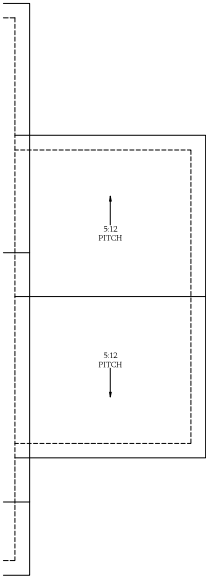

**Optional 1-Car
Carriage Garage
Elevation A & B**

Not Available w/ Opt. 2-Car Side Load
Garage or 3-Car Side Load Garage
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17

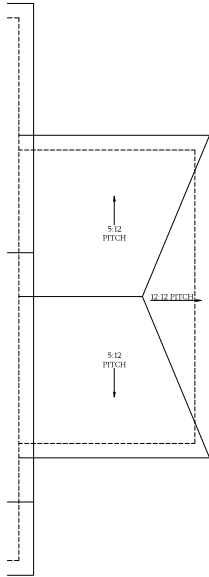

**Optional 1-Car
Carriage Garage
Elevation C**

Not Available w/ Opt. 2-Car Side Load
Garage or 3-Car Side Load Garage
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17














PRICES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS,
DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
SCHEDULES, MATERIALS AND CONSTRUCTION METHODS
OF HOUSES WILL BE DETERMINED BY THE SITE
RENDERINGS ARE ARTIST CONCEPTIONS. EXCEPT FOR
HOMES AS SHOWN, REPRESENTATION, ADAPTATION, OR
HOME MAKEOVERS ARE NOT CURRENT DETAILS.
COPYRIGHT © DREAM FINDERS HOMES

DREAM FINDERS HOMES
SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"=1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:

ROOF PLAN
OPTIONS
A-8.2

110v Outlet
for AV Chase

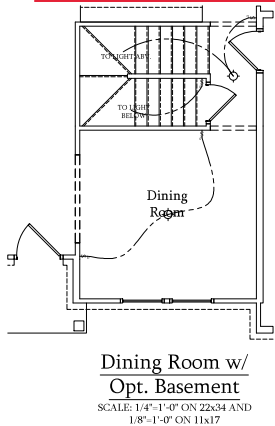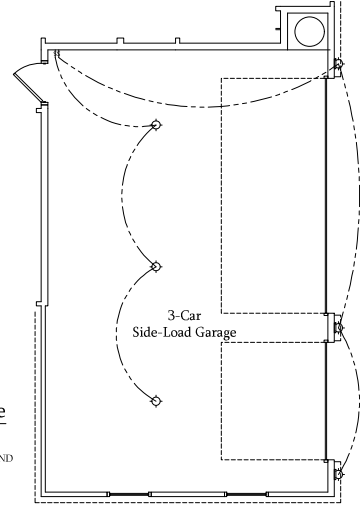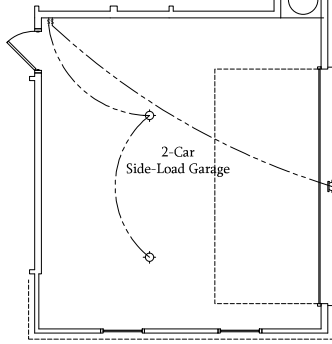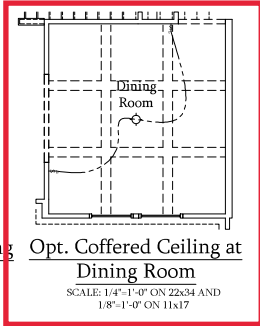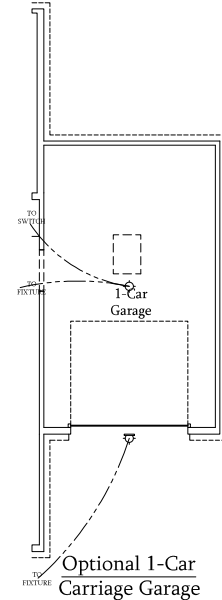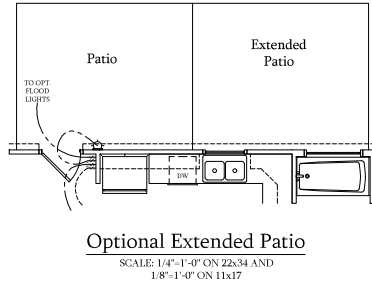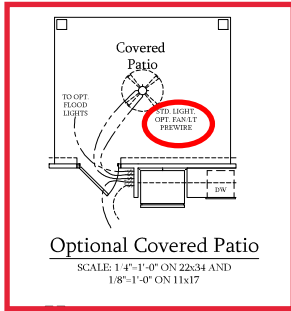

- ELECTRICAL LEGEND**
- 120V OUTLET
 - 120V GFI OUTLET
 - 120V SWITCHED OUTLET
 - 120V BASEBOARD OUTLET
 - 4 PLEX
 - FLOOR MOUNTED 120V
 - FLOOR MOUNTED 120V GFI
 - WEATHERPROOF
 - 220V OUTLET
 - 120V DEDICATED CIRCUIT
 - 220V DEDICATED CIRCUIT
 - SPECIAL PURPOSE (240 V, ETC.)
 - WALL MOUNT LIGHT
 - CEILING MOUNT LIGHT
 - PENDANT LIGHT
 - RECESSED CAN LIGHT
 - MINI CAN LIGHT
 - EYEBALL LIGHT
 - FLUORESCENT LIGHT
 - UNDERCABINET LIGHT
 - FLOOD LIGHT
 - SWITCH
 - 3-WAY SWITCH
 - 4-WAY SWITCH
 - DIMMER SWITCH
 - TELEPHONE
 - TV CONNECTION
 - CONDUIT FOR COMPONENT WIRING
 - SPEAKER
 - COMBO SMOKE CARBON MONOXIDE DETECTOR
 - 110 V SMOKE DETECTOR
 - EXHAUST FAN
 - LOW VOLTAGE PANEL
 - CEILING FAN
 - CEILING FAN W/ LIGHT

- ELECTRICAL NOTES:**
1. PROVIDE AND INSTALL GROUND FAULT CIRCUIT INTERRUPTERS (GFCI) INDICATED ON PLANS OR AS NOTED IN 4 AND 5 BELOW INDICATES.
 2. UNLESS OTHERWISE INDICATED, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISHED FLOOR: SWITCHES - 42" OUTLETS - 14" TELEPHONE - 14" (UNLESS ABOVE COUNTERTOP) TELEVISION - 14"
 3. ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP. PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS.
 4. ALL 15A AND 20A RECEPTACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PORCHES, LIBRARIES, DEN, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE AFCI DEVICE AND TAMPER PROOF RECEPTACLES.
 5. ALL 15A AND 20A 120V RECEPTACLES LOCATED IN THE GARAGE AND UTILITY ROOMS SHALL BE GFI-CI PROTECTED (GFI).
 6. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
 7. EVERY BUILDING HAVING A FOSIL-FUEL-BURNING HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.
 8. ALABAMA SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WHEN SUCH WIRING IS SERVED FROM THE LOCAL POWER UTILITY. SUCH ALARMS SHALL HAVE BATTERY BACKUP. COMBINATION SMOKE/CARBON MONOXIDE ALARMS SHALL BE LISTED OR LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

DREAM FINDERS HOMES
SOUTHPORT


DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"-1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:
FIRST FLOOR ELECTRICAL PLAN - OPTIONS
E-1.1

ELECTRICAL LEGEND

- 120V OUTLET
- 120V GFI OUTLET
- 120V SWITCHED OUTLET
- 120V BASEBOARD OUTLET
- 4 PLEX
- FLOOR MOUNTED 120V
- FLOOR MOUNTED 120V GFI
- WEATHERPROOF
- 220V OUTLET
- 120V DEDICATED CIRCUIT
- 220V DEDICATED CIRCUIT
- SPECIAL PURPOSE (240 V, ETC.)
- WALL MOUNT LIGHT
- CEILING MOUNT LIGHT
- PENDANT LIGHT
- RECESSED CAN LIGHT
- MINI CAN LIGHT
- INVESTAL LIGHT
- FLUORESCENT LIGHT
- UNDERCABINET LIGHT
- FLOOD LIGHT
- SWITCH
- 3-WAY SWITCH
- 4-WAY SWITCH
- DIMMER SWITCH
- TELEPHONE
- TV CONNECTION
- CONDUIT FOR COMPONENT WIRING
- SPEAKER
- COMBINATION CARBON MONOXIDE DETECTOR
- 110 V SMOKE DETECTOR
- EXHAUST FAN
- LOW VOLTAGE PANEL
- CEILING FAN
- CEILING FAN W/ LIGHT

ELECTRICAL NOTES:

1. PROVIDE AND INSTALL GROUND FAULT CIRCUIT INTERRUPTERS (GFCI) AS INDICATED ON PLANS OR AS ITEM NO. 4 AND 5 BELOW INDICATES.
2. UNLESS OTHERWISE INDICATED, INSTALL SWITCHES AND RECEPTACLES AT THE FOLLOWING HEIGHTS ABOVE FINISHED FLOOR: SWITCHES - 42" OUTLETS - 14" TELEPHONE - 14" (UNLESS ASV COUNTERTOP) TELEVISION - 14"
3. ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP. PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS.
4. ALL 15A AND 20A RECEPTACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARELORS, LIBRARIES, DEN, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE AFCI DEVICE AND TAMPER PROOF RECEPTACLES.
5. ALL 15A AND 20A 120V RECEPTACLES LOCATED IN THE GARAGE AND UTILITY ROOMS SHALL BE GFCI PROTECTED (GFI).
6. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
7. EVERY BUILDING HAVING A FOSSIL FUEL-BURNING HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.
8. ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING. WHEN SUCH WIRING IS SERVED FROM THE LOCAL POWER UTILITY, SUCH ALARMS SHALL HAVE BATTERY BACKUP. COMBINATION CARBON MONOXIDE ALARMS SHALL BE LISTED OR LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

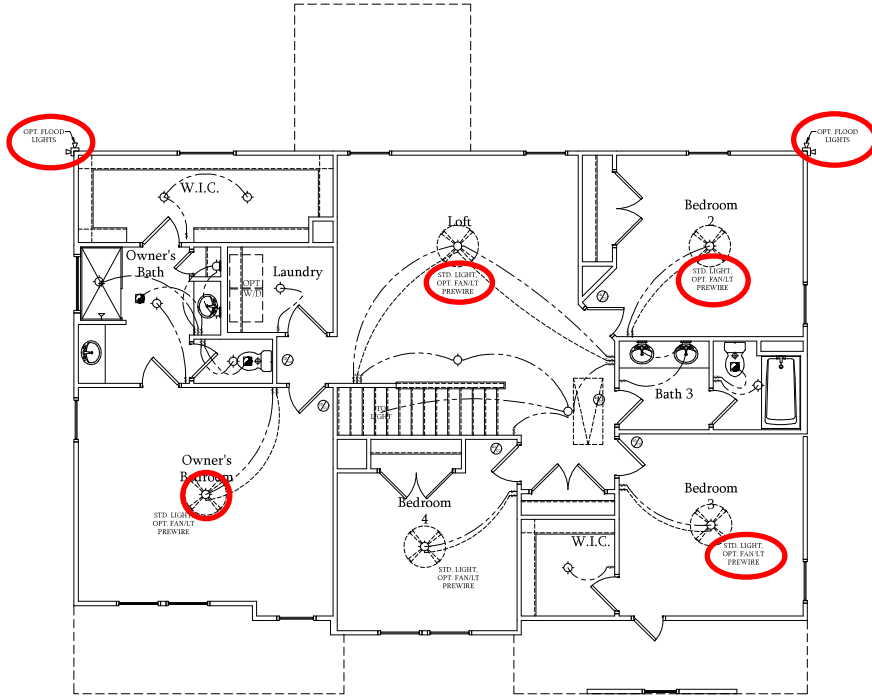

Second Floor Plan

SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17




PRICES, PROVISIONS, INCIDENTS, FEATHERS, OPTIONS, DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. MEASUREMENTS ARE TO FACE UNLESS OTHERWISE NOTED. ALL WORK SHALL BE IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS. ALL WORK SHALL BE PERFORMED BY THE SITE SUPERVISOR AND SHALL BE SUBJECT TO INSPECTION BY THE LOCAL AUTHORITY. ALL WORK SHALL BE IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS. ALL WORK SHALL BE PERFORMED BY THE SITE SUPERVISOR AND SHALL BE SUBJECT TO INSPECTION BY THE LOCAL AUTHORITY. ALL WORK SHALL BE IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS. ALL WORK SHALL BE PERFORMED BY THE SITE SUPERVISOR AND SHALL BE SUBJECT TO INSPECTION BY THE LOCAL AUTHORITY.

DREAM FINDERS HOMES
SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV: AUGUST 01, 2021
SCALE: 1/4"=1'-0"
DRAWN BY:
ENGINEERED BY:
REVIEWED BY:

SECOND FLOOR
ELECTRICAL PLAN
E-2

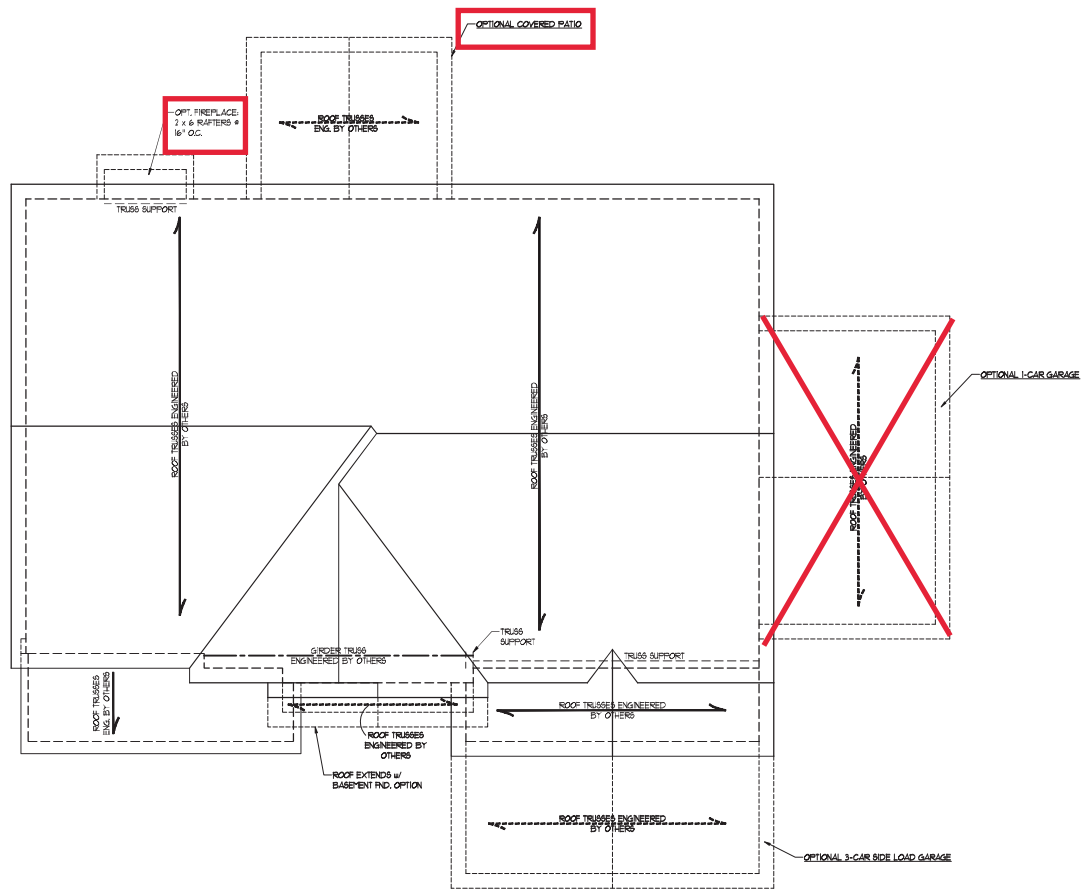

ELEVATIONS A & B

BRICK SUPPORT NOTE:

1. FASTEN (2) 2 x 10 BLOCKING BETWEEN WALL STUDS w/ (4) 10d NAILS PER FLY. FASTEN A 6" x 4" x 5/8" STEEL ANGLE TO (2) 2 x 10 BLOCKING w/ (2) 1/2" LAG SCREWS # 1" O.C. STAGGERED. SEE SECTION R103.821 OF THE 2018 NRC FOR ADDITIONAL BRICK SUPPORT INFORMATION.
2. WHERE ROOF SLOPES EXCEED 10°, INSTALL 3" x 3" x 1/4" STEEL PLATE STOPS AT 24" O.C. PER SECTION R103.821 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.


STRUCTURAL NOTES:

1. ALL FRAMING LUMBER TO BE #2 SPF (NO.1).
2. CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROOF SUPPORT.
3. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS. H/P SPLICES ARE TO BE SPACED A MIN. OF 8'-0". FASTEN MEMBERS WITH THREE ROWS OF 10d NAILS # 16" O.C. (TYP.).
4. STICK FRAME OVER-FRAMED ROOF SECTIONS w/ 2 x 8 RIDGES, 2 x 6 RAFTERS # 16" O.C. AND FLAT 2 x 10 VALLEYS OR USE VALLEY TRUSSES.
5. FASTEN FLAT VALLEYS TO RAFTERS OR TRUSSES WITH STRIPON GLEAS HURRICANE TIES # 3" O.C. MAX. PASS HURRICANE TIES THROUGH NOTCH IN ROOF SHEATHING. EACH RAFTER IS TO BE FASTENED TO THE FLAT VALLEY WITH A MIN. OF (6) 10d TOR NAILS.
6. REFER TO SECTION R803.1 OF THE 2018 NRC FOR REQUIRED UPLIFT RESISTANCE AT RAFTERS AND TRUSSES.
7. REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

J.S. THOMPSON ENGINEERING, INC.
 605 W. HARRIS ST., SUITE 100
 PHONE: (919) 789-9919 • FAX: (919) 789-9921
 N.C. LICENSE NO. C-1131

SOUTHPORT H&H HOMES


DATE: NOVEMBER 2, 2021
 SCALE: 1/4" = 1'-0"
 DRAWN BY: H&H HOMES
 ENGINEERED BY: WTH




sheet 8 of 9
S-5a
 ROOF FRAMING PLAN

11/2/2021

MONOLITHIC SLAB DETAILS

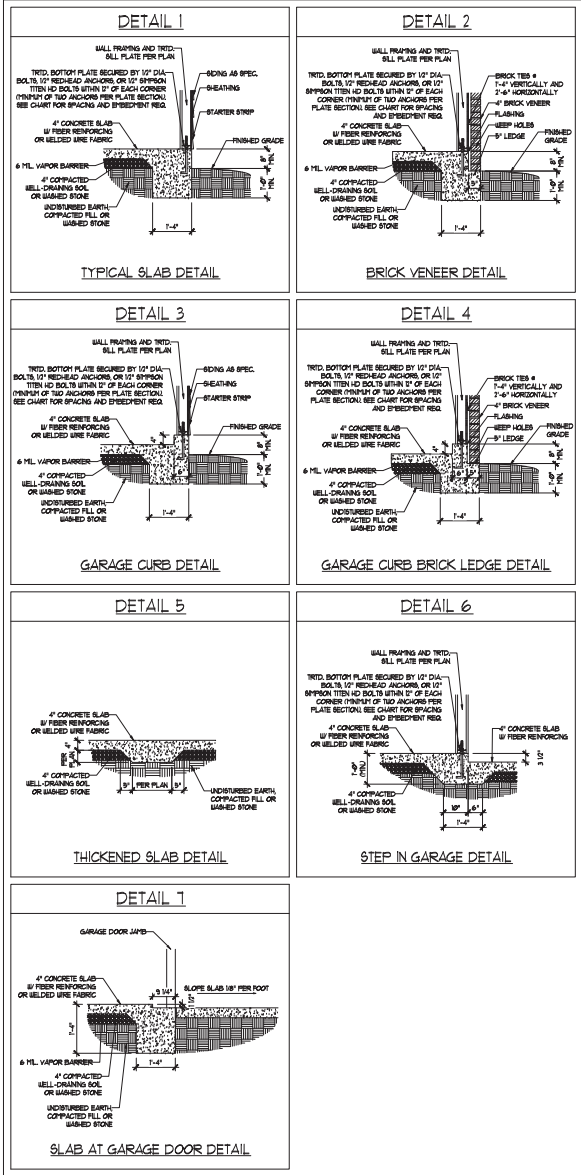

STEMWALL DETAILS

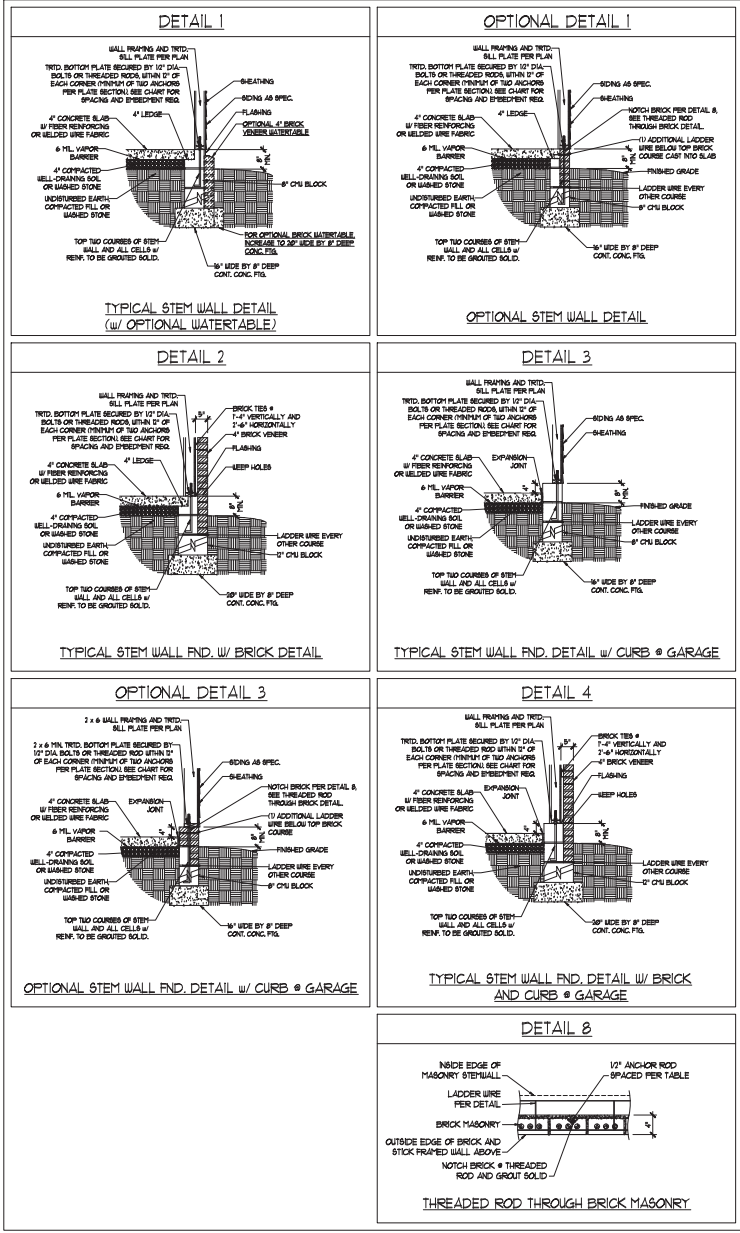

MASONRY STEMWALL SPECIFICATIONS

WALL HEIGHT (FEET)	MASONRY WALL TYPE			
	8" CMU	4" BRICK AND 4" CMU	4" BRICK AND 8" CMU	12" CMU
2 AND BELOW	UNGROUTED	GROUT SOLID	UNGROUTED	UNGROUTED
3	UNGROUTED	GROUT SOLID	UNGROUTED	UNGROUTED
4	GROUT SOLID	GROUT SOLID w/ #4 REBAR @ 48" O.C.	GROUT SOLID	GROUT SOLID w/ #4 REBAR @ 64" O.C.
5	GROUT SOLID w/ #4 REBAR @ 36" O.C.	NOT APPLICABLE	GROUT SOLID w/ #4 REBAR @ 36" O.C.	GROUT SOLID w/ #4 REBAR @ 64" O.C.
6	GROUT SOLID w/ #4 REBAR @ 24" O.C.	NOT APPLICABLE	GROUT SOLID w/ #4 REBAR @ 24" O.C.	GROUT SOLID w/ #4 REBAR @ 64" O.C.
7 AND GREATER	ENGINEERED DESIGN BASED ON SITE CONDITIONS			

- STRUCTURAL NOTES
- WALL HEIGHT MEASURED FROM TOP OF FOOTING TO TOP OF THE WALL.
 - THE MULTIPLE B-TIES TOGETHER WITH LADDER WIRE AT 16" O.C. VERTICALLY. FOUNDATION NOT COMMON TO HOUSE.
 - CHART APPLICABLE FOR HOUSE FOUNDATION ONLY. CONSULT ENGINEER FOR DESIGN OF GARAGE FOUNDATION.
 - BACKFILL OF CLEAN #51 / #01 WASHED STONE IS ALLOWABLE.
 - BACKFILL OF WELL DRAINED OR SAND - GRAVEL MIXTURE SOLLS (48" PER FT. BELOW GRADE) CLASSIFIED AS GROUP 1 ACCORDING TO UNIFIED SOILS CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE (B-20) OF THE 2016 INTERNATIONAL RESIDENTIAL CODE ARE ALLOWABLE.
 - PREP SLAB PER 806.2.1 AND 806.2.2 BASE OF THE 2016 INTERNATIONAL RESIDENTIAL CODE. MINIMUM 2" LAP SPLICE LENGTH.
 - LOCATE REBAR IN CENTER OF FOUNDATION WALL.
 - WHERE REQUIRED, FULL BLOCK SOLID WITH TYPE "N" PORTLAND CEMENT MORTAR OR 3000 PSI GROUT. USE OF "LOW LIFT" GROUTING METHOD REQUIRED WHEN FILLING WALLS WITH GROUT AT HEIGHTS OF 5' AND GREATER.

ANCHOR SPACING AND EMBEDMENT

WIND ZONE	120 MPH	130 MPH
	SPACING	6'-0" O.C.
EMBEDMENT	1"	1" INTO MASONRY 1" INTO CONCRETE

J.S. THOMPSON ENGINEERING, INC.
 1500 W. 15TH ST. SUITE 100
 WILMINGTON, NC 28403
 PHONE: (919) 789-9919 FAX: (919) 789-9911
 N.C. LICENSE NO. C-1731

120 MPH - 130 MPH ULTIMATE DESIGN WIND SPEED
 FOUNDATION DETAILS

DATE: NOVEMBER 14, 2019
 SCALE: MTS
 DRAWN BY: JBT
 ENGINEERED BY: JES



D-1 FOUNDATION DETAILS

11/2/2019

GENERAL NOTES

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPs, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS, HEADERS, COLLARS, CANTILEVERS, OFFSET LOAD BEARING WALLS, PIERS, GIRDER SYSTEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT INCLUDING ROOF. ENGINEER'S SEAL DOES NOT APPLY TO JOIST OR FLOOR/ROOF TRUSS LAYOUT DESIGN AND ACCURACY.
 - ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NRC), 2018 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR AND WILL NOT HAVE CONTROL OF CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
 - STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NRC, 2018 EDITION (R602.4 - R602.1)
- | DESIGN CRITERIA | LIVE LOAD (PSF) | DEAD LOAD (PSF) | DEFLECTION (IN) |
|--|--------------------|-----------------|-----------------------------------|
| ATTIC WITH LIMITED STORAGE | 20 | 10 | L/240 (L/360 w/ BRITTLE FINISHES) |
| ATTIC WITHOUT STORAGE | 10 | 10 | L/360 |
| DECKS | 40 | 10 | L/360 |
| EXTERIOR BALCONIES | 40 | 10 | L/360 |
| FIRE ESCAPES | 40 | 10 | L/360 |
| HANDRAILS/GUARDRAILS | 100 LB OR 50 (PLF) | 10 | L/360 |
| PASSENGER VEHICLE GARAGE | 50 | 10 | L/360 |
| ROOMS OTHER THAN SLEEPING ROOM | 40 | 10 | L/360 |
| SLEEPING ROOMS | 30 | 10 | L/360 |
| STAIRS | 40 | 10 | L/360 |
| WIND LOAD
(BASED ON TABLE R602.4(4) WIND ZONE AND EXPOSURE) | | | |
| GROUND SNOW LOAD, Pg | 20 (PSF) | | |
- 1-JOIST SYSTEMS DESIGNED WITH 12 PSF DEAD LOAD AND DEFLECTION (IN) OF L/400
 - FLOOR TRUSS SYSTEMS DESIGNED WITH 8 PSF DEAD LOAD
- FOR 15 AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION R602.6 OF THE NRC, 2018 EDITION, FOR 150 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION 4504 OF THE NRC, 2018 EDITION.
 - ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER 1 OF THE NRC, 2018 EDITION.

FOOTING AND FOUNDATION NOTES

- FOUNDATION DESIGN BASED ON A MINIMUM ALLOWABLE BEARING CAPACITY OF 3000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARING CAPACITY IS NOT ACHIEVED.
- FOR ALL CONCRETE SLABS AND FOOTINGS, THE AREA WITHIN THE PERIMETER OF THE BUILDING ENVELOPE SHALL HAVE ALL VEGETATION, TOP SOIL AND FOREIGN MATERIAL REMOVED. FILL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL. THE FILL SHALL BE COMPACTED TO ASSURE UNIFORM SUPPORT OF THE SLAB, AND EXCEPT WHERE APPROVED, THE FILL DEPTHS SHALL NOT EXCEED 24" FOR CLEAN SAND OR GRAVEL. A 4" THICK BASE COURSE CONSISTING OF CLEAN GRADED SAND OR GRAVEL SHALL BE PLACED. A BASE COURSE IS NOT REQUIRED WHERE A CONCRETE SLAB IS INSTALLED ON WELL-DRAINED OR SAND-GRAVEL MIXTURE SOILS CLASSIFIED AS GROUP 1, ACCORDING TO THE UNITED SOIL CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R602.5 OF THE NRC, 2018 EDITION.
- PROPERLY DEWATER EXCAVATION PRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB IS AT OR BELOW WATER TABLE. IF APPLICABLE 3/4" - 1" DEEP CONTROL JOINTS ARE TO BE SALED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. JOISTS WHERE NECESSARY.
- CONCRETE SHALL CONFORM TO SECTION R602.5 OF THE NRC, 2018 EDITION. CONCRETE REINFORCING STEEL TO BE ASTM A63 GRADE 60 WELDED WIRE FABRIC TO BE ASTM A955. MAINTAIN A MINIMUM CONCRETE COVER AROUND REINFORCING STEEL OF 3" IN FOOTINGS AND 1 1/2" IN SLABS. FOR POURED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE INSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 3/4". CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE OUTSIDE FACE OF THE WALL SHALL NOT BE LESS THAN 1 1/2" FOR #5 BARS OR 3" WIDER, AND NOT LESS THAN 1" FOR #6 BARS OR LARGER.
- MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/11/15 402. MORTAR SHALL CONFORM TO ASTM C270.
- THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR UNFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS. PIERS MAY BE FILLED SOLID WITH CONCRETE OR TYPE II OR S MORTAR. PIERS AND WALLS SHALL BE CAPPED WITH #4 OF SOLID MASONRY.
- THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING. EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- ALL CONCRETE AND MASONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R604 OF THE NRC, 2018 EDITION, OR IN ACCORDANCE WITH ACE 318, ACE 335, NCHA 1988-4 OR ACE 530/ASCE 5/11/15 402. MASONRY FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R604.1(1), R604.1(2), R604.1(3), OR R604.1(4) OF THE NRC, 2018 EDITION. CONCRETE FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R604.1(5) OF THE NRC, 2018 EDITION. STEEL CONCRETE FOUNDATION WALLS TO 2 x 6 FRAMED WALLS AT 16' OC, WHERE GRADE PERMITS (UNO).

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

FRAMING NOTES

- ALL FRAMING LUMBER SHALL BE #2 SFF MINIMUM (Fb = 875 PSI, Fv = 375 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO). ALL TREATED LUMBER SHALL BE #2 SFF MINIMUM (Fb = 975 PSI, Fv = 475 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO).
- LAMINATED VENEER LUMBER (LVL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb = 2600 PSI, Fv = 285 PSI, E = 1900000 PSI. LAMINATED STRAND LUMBER (LSL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fb = 2325 PSI, Fv = 330 PSI, E = 1900000 PSI. PARALLEL STRAND LUMBER (PSL) UP TO 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2600 PSI, E = 1900000 PSI. PARALLEL STRAND LUMBER (PSL) MORE THAN 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fc = 2300 PSI, E = 1900000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S SPECIFICATIONS.
- STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS:

A. W AND WT SHAPES:	ASTM A992
B. CHANNELS AND ANGLES:	ASTM A36
C. PLATES AND BARS:	ASTM A36
D. HOLLOW STRUCTURAL SECTIONS:	ASTM A500 GRADE B
E. STEEL PIPE:	ASTM A53, GRADE B, TYPE E OR S
- STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH (UNO). PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED AT THE BOTTOM FLANGE TO EACH SUPPORT AS FOLLOWS (UNO):

A. WOOD FRAMING	(2) 1/2" DIA. x 4" LONG LAG SCREWS
B. CONCRETE	(2) 1/2" DIA. x 4" WEDGE ANCHORS
C. MASONRY (FULLY GROUTED)	(2) 1/2" DIA. x 4" LONG SIMPSON TITEN HD ANCHORS

 LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2x NAILER ON TOP OF THE STEEL BEAM AND THE 2x NAILER IS SECURED TO THE TOP OF THE STEEL BEAM w/ (2) ROWS OF SELF TAPPING SCREWS # 16' OC, OR (2) ROWS OF 1/2" DIAMETER BOLTS # 16' OC. 1/2" BOLTS ARE USED TO FASTEN THE NAILER. THE STEEL BEAM SHALL BE FABRICATED w/ (2) ROWS OF 9/16" DIAMETER HOLES # 16' OC.
- SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. SHADED SQUARES DENOTE POINT LOADS FROM ABOVE WHICH REQUIRE SOLID BLOCKING TO SUPPORTING MEMBER BELOW.
- ALL LOAD BEARING HEADERS TO CONFORM TO TABLE R602.1(1) AND R602.1(2) OF THE NRC, 2018 EDITION, OR BE (2) 2 x 6 WITH (1) JACK AND (1) KING STUD EACH END (UNO). WHICHEVER IS GREATER, ALL HEADERS TO BE SECURED TO EACH JACK STUD WITH (4) 8d NAILS. ALL BEAMS TO BE SUPPORTED WITH (2) STUDS AT EACH BEARING POINT (UNO). INSTALL KING STUDS PER SECTION R602.3 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- ALL BEAM HEADERS OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR FULLY ON (1) JACK OR (2) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE 1 1/2" MINIMUM BEARING (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO). BEAM ENDS THAT BUTT INTO ONE ANOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- FLITCH BEAMS SHALL BE BOLTED TOGETHER USING 1/2" DIAMETER BOLTS (ASTM A307) WITH WASHERS PLACED AT THREADED END OF BOLT. BOLTS SHALL BE BRACED AT 24" CENTERS (MAXIMUM) AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE) WITH (2) BOLTS LOCATED AT 6" FROM EACH END (UNO).
- ALL 1-JOIST OR TRUSS LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECIFIED ON THE PLANS. ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION WALL BRACING CRITERIA. THE AMOUNT, LENGTH, AND LOCATION OF BRACINGS SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.8.
- PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR TRUSSES OR 1-JOISTS PER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETWEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT FOR ALL POINT LOADS ALONG OFFSET LOAD LINE.
- FOR ALL HEADERS SUPPORTING BRICK VENEER THAT ARE LESS THAN 8'-0" IN LENGTH REST A 6" x 4" x 5/16" STEEL ANGLE WITH 6" MINIMUM OVERHANG AT SIDES FOR BRICK SUPPORT (UNO). FOR ALL HEADERS 8'-0" AND GREATER IN LENGTH, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO HEADERS WITH 1/2" LAG SCREWS AT 2' OC. STAGGERED FOR BRICK SUPPORT. FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED w/ (4) 16d NAILS EA. PL. BETWEEN WALL STUDS WITH (2) ROWS OF 1/2" LAG SCREWS AT 2' OC. STAGGERED AND IN ACCORDANCE WITH SECTION R702.8.2 OF THE NRC, 2018 EDITION.
- FOR STICK FRAMED ROOFS, CIRCLES DENOTE (3) 2 x 4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8'-0". FASTEN MEMBERS WITH THREE ROWS OF 16d NAILS AT 16' OC. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS SHOWN (UNO).
- FOR TRUSSED ROOFS, FRAME DORMER WALLS ON TOP OF 2 x 4 LADDER FRAMING AT 24" OC. BETWEEN ADJACENT ROOF TRUSSES. STICK FRAME OVER-FRAMED ROOF SECTIONS WITH 2 x 8 RIDGES, 2 x 6 RAFTERS AT 16' OC. AND FLAT 2 x 10 VALLEYS (UNO).
- ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 200 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO). POSTS MAY BE SECURED USING ONE SIMPSON H6 OR L192 UPLIFT CONNECTOR FASTENED TO THE BAND AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST. ONE 16" SECTION OF SIMPSON C586 COLL STRAPPING WITH (8) 8d HDG NAILS AT EACH END MAY BE USED IN LIEU OF EACH TIGHT STRAP IF DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.



120 MPH - 130 MPH ULTIMATE DESIGN WIND SPEED
STANDARD STRUCTURAL NOTES

DATE: NOVEMBER 14, 2018
SCALE: 1/8" = 1'-0"
DRAWN BY: JES
ENGINEERED BY: JST

S0
STRUCTURAL
NOTES