

	HUS28	USP	15		16d/3-1/2"	16d/3-1/2"
	THD28-2	USP	1	NA	16d/3-1/2"	10d/3"

Estimation			
Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	3319.26
Roof Decking	1st Floor	Roof Decking	114

BEAM LEGEND					
PlotID	Length	Product	Plies	Net Qty	Fab Type
1/0 3/0 1/0 Door	6-00-00	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH 9' FL (dropped)	14-00-00	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
GDH 18' FL (dropped)	22-00-00	1-3/4"x 14" LVL Kerto-S	2	2	FF

## Truss Placement Plan

### SCALE: 1/4" = 1'-0"

▲ = Denotes Left End of Truss  
(Reference Engineered Truss Drawing)

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

LOAD CHART FOR JACK STUDS			
(BASED ON TABLES B502.5(1) & (2))			
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUADRE			
END REACTION (UP TO) @ END OF HEADQUADRE	END REACTION (UP TO) @ END OF HEADQUADRE	END REACTION (UP TO) @ END OF HEADQUADRE	END REACTION (UP TO) @ END OF HEADQUADRE
1700	2550	3400	
3400	5100	6800	2
5100	7650	10200	3
6800	10200	13600	4
8500	12750	17000	5
10200	15300		6
11900			7
13600			8
15300			9

<b>BUILDER</b>	Weaver Homes, Inc.	<b>CITY / CO.</b>	Sanford / Harnett
<b>JOB NAME</b>	Lot 12 West Preserve	<b>ADDRESS</b>	293 Thistle Court
<b>PLAN</b>	Lindsay 1553 A (200505B) 3 Car	<b>MODEL</b>	Model
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	//
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Lenny Norris
<b>JOB #</b>	J0624-3319	<b>SALES REP.</b>	Lenny Norris

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris  
Lenny Norris



**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444

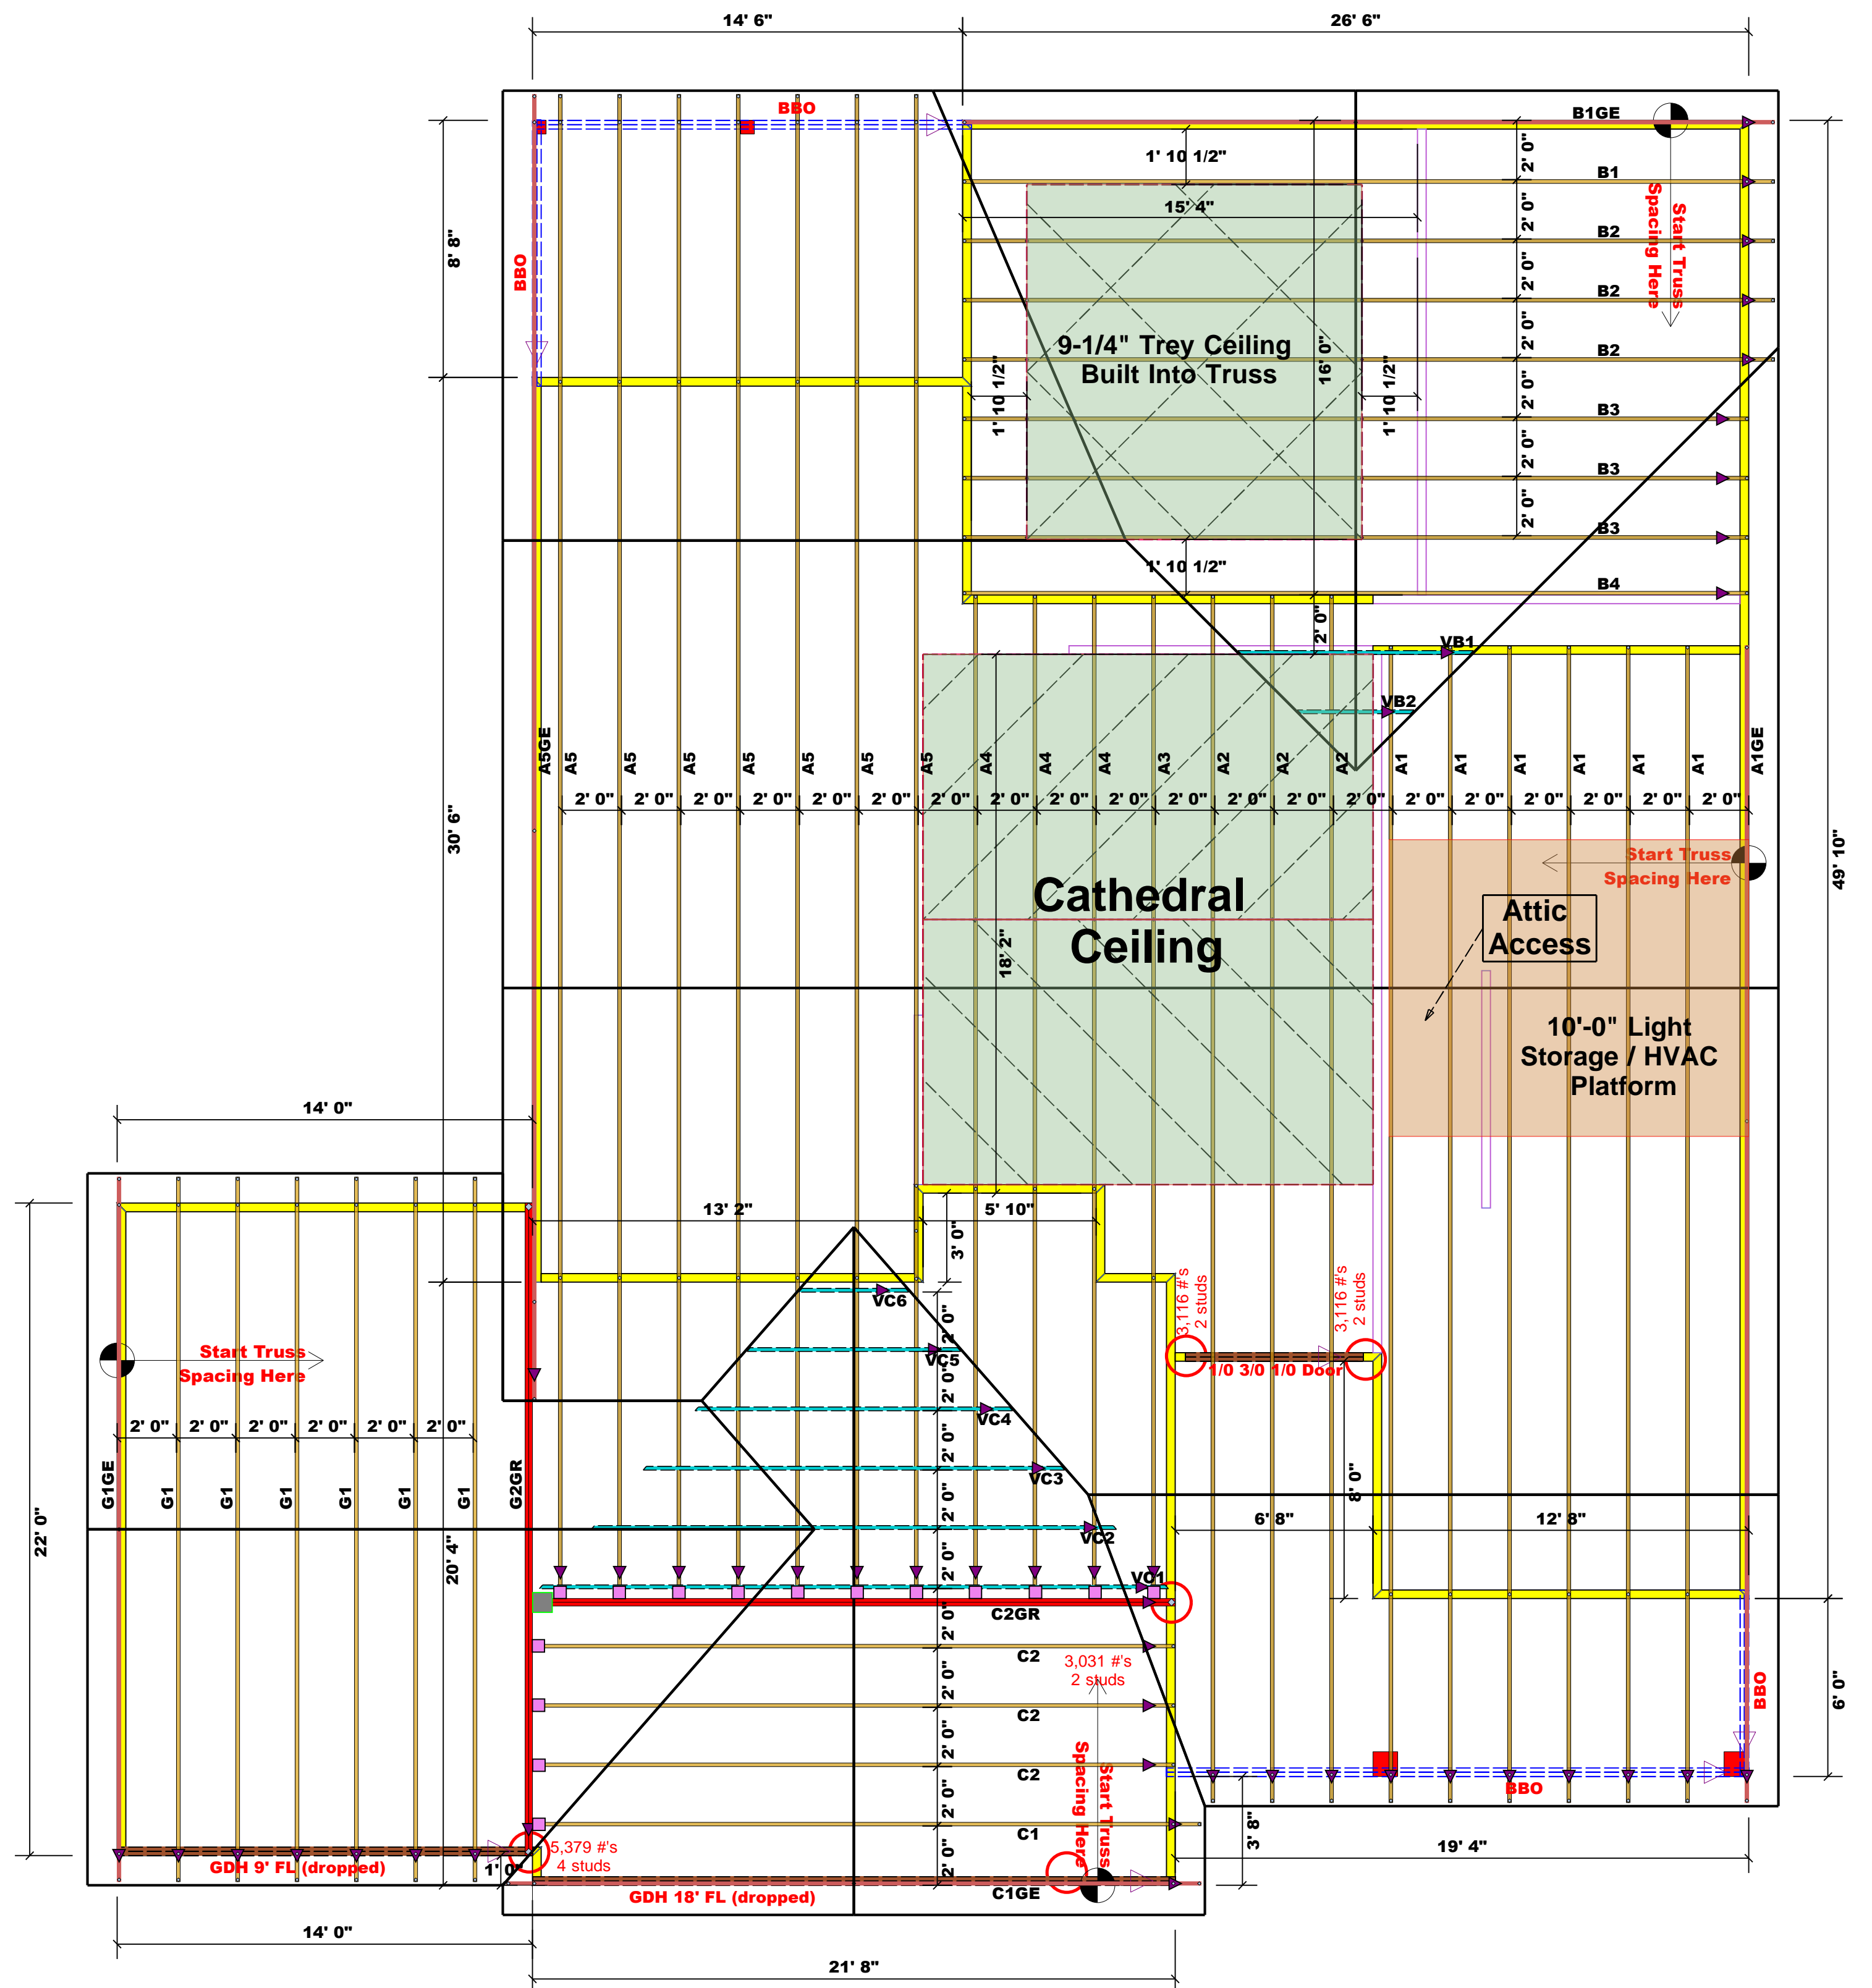

	HUS28	USP	15		16d/3-1/2	16d/3-1/2"
	THD28-2	USP	1	NA	16d/3-1/2"	10d/3"

Estimation			
Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	3319.26
Roof Decking	1st Floor	Roof Decking	114

BEAM LEGEND					
PlotID	Length	Product	Plies	Net Qty	Fab Type
1/0 3/0 1/0 Door	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH 9' FL (dropped)	14' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
GDH 18' FL (dropped)	22' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF

## Truss Placement Plan

### SCALE: 1/4" = 1'-0"

▲ = Denotes Left End of Truss  
(Reference Engineered Truss Drawing)

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

LOAD CHART FOR JACK STUDS			
(BASED ON TABLES B502.5(1) & (2))			
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUADRE			
END REACTION (UP TO) (DOWN TO)	END REACTION (UP TO) (DOWN TO)	END REACTION (UP TO) (DOWN TO)	END REACTION (UP TO) (DOWN TO)
10'D	12'D	14'D	16'D
1700	2550	3400	4250
3400	5100	6800	8500
5100	7650	10200	12800
6800	10200	13600	17000
8500	12750	17000	
10200	15300		
11900			
13600			
15300			

<b>BUILDER</b>	Weaver Homes, Inc.	<b>CITY / CO.</b>	Sanford / Harnett
<b>JOB NAME</b>	Lot 12 West Preserve	<b>ADDRESS</b>	293 Thistle Court
<b>PLAN</b>	Lindsay 1553 A (200505B) 3 Car	<b>MODEL</b>	Model
<b>SEAL DATE</b>	Seal Date	<b>DATE REV.</b>	//
<b>QUOTE #</b>	Quote #	<b>DRAWN BY</b>	Lenny Norris
<b>JOB #</b>	J0624-3319	<b>SALES REP.</b>	Lenny Norris

**THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.**  
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris  
Lenny Norris



**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444