

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 49569

JOB: 24-5147-F01

JOB NAME: LOT 0.0109 BLAKE POND

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

21 Truss Design(s)

Trusses:

F101, F102, F103, F104, F105, F106, F107, F108, F109, F110, F111, F112, F113, F114, F115, F115A, F116, F116A, F117, F118, F119



6/13/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for*

Job 24-5147-F01	Truss F101	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:05 2024 Page 1
ID:UMCU2t6gUxCLqMlKo_q9qxyaVB1-pV7PZzdCRoxA9XffZabx9v5VQqzlyq_4soj2L1z6ebm

0-1-8

Scale = 1:32.8

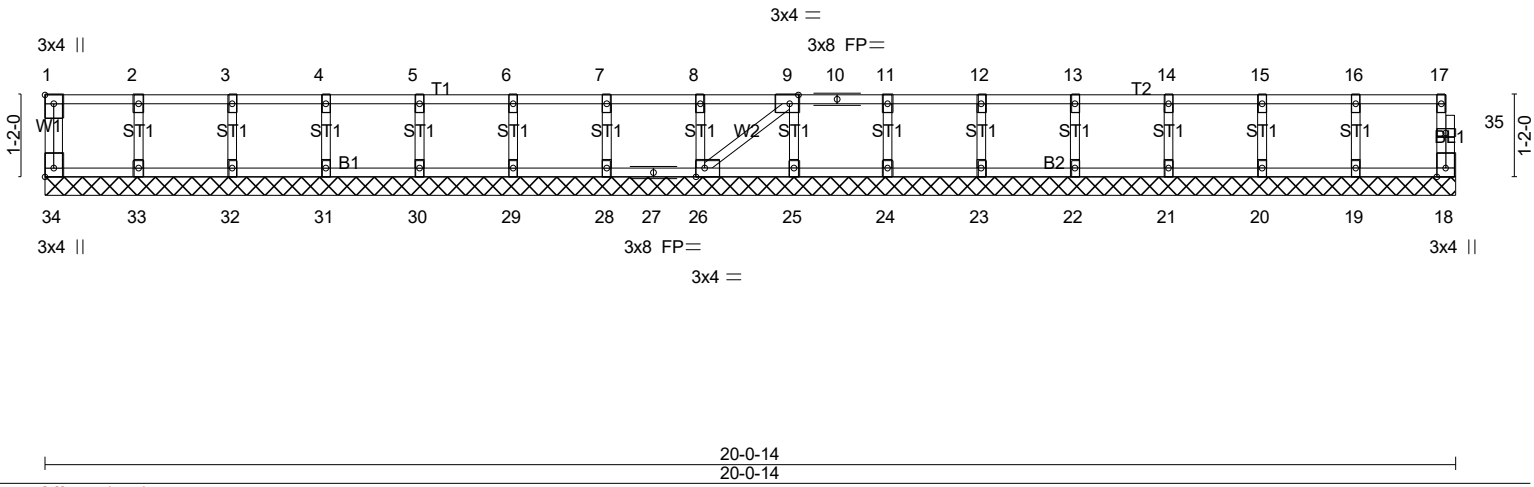


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [9:0-1-8,Edge], [26:0-1-8,Edge], [34:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 18 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH		Weight: 86 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 20-0-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 34, 18, 33, 32, 31, 30, 29, 28, 26, 25, 24, 23, 22, 21, 20, 19

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION. Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F102	Truss Type Floor	Qty 4	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:06 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-lhnmJeqC531nhDs7H7Ah6ecMEC2hDEE4SSbuTz6ebi

0-1-8


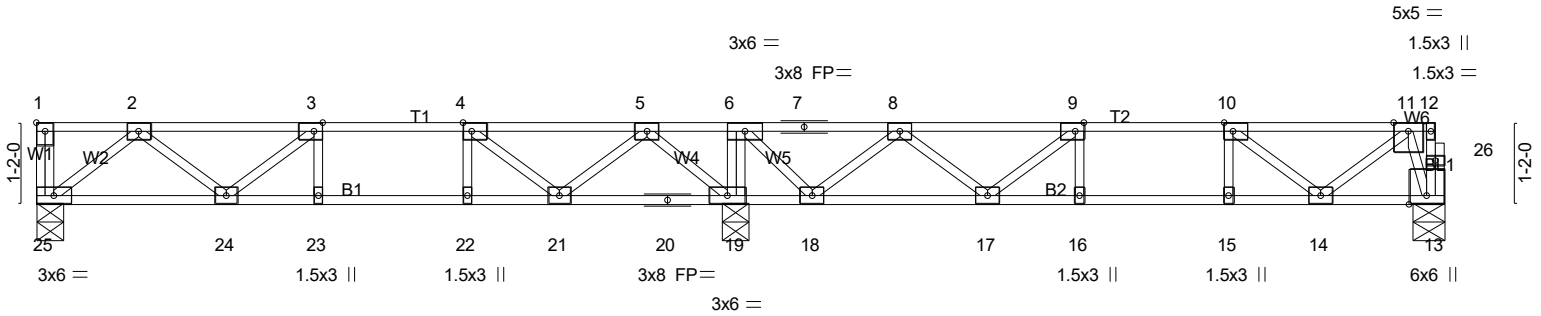



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3 Plate Grip DOL 1.00	TC 0.30	Vert(LL)	-0.05	23-24	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.42	Vert(CT)	-0.07	23-24	>999		
BCLL 0.0	Rep Stress Incr YES	WB 0.29	Horz(CT)	0.01	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 101 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 19-21,18-19,17-18.

REACTIONS. (lb/size) 25=364/0-4-8 (min. 0-1-8), 19=1008/0-4-8 (min. 0-1-8), 13=365/0-5-6 (min. 0-1-8)
Max Grav 25=399(LC 3), 19=1008(LC 1), 13=388(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-678/0, 3-4=-845/0, 4-5=-508/162, 5-6=0/731, 6-7=-3/294, 7-8=-3/294, 8-9=-663/0, 9-10=-819/0, 10-11=-477/0
BOT CHORD 24-25=0/470, 23-24=0/845, 22-23=0/845, 21-22=0/845, 20-21=-316/198, 19-20=-316/198, 18-19=-731/0, 17-18=-43/463,
16-17=0/819, 15-16=0/819, 14-15=0/819
WEBS 6-19=-557/0, 2-24=0/271, 2-25=-597/0, 4-21=-553/0, 5-21=0/480, 5-19=-688/0, 9-17=-299/0, 8-17=0/322, 8-18=-647/0,
6-18=0/607, 10-14=-437/0, 11-14=0/404, 11-13=-496/0

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F103	Truss Type Floor	Qty 3	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:06 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-lhnmJeqC531nhDs7H7Ah6eeAEDchFDE4SSbuTz6ebi



Scale: 3/4"=1'

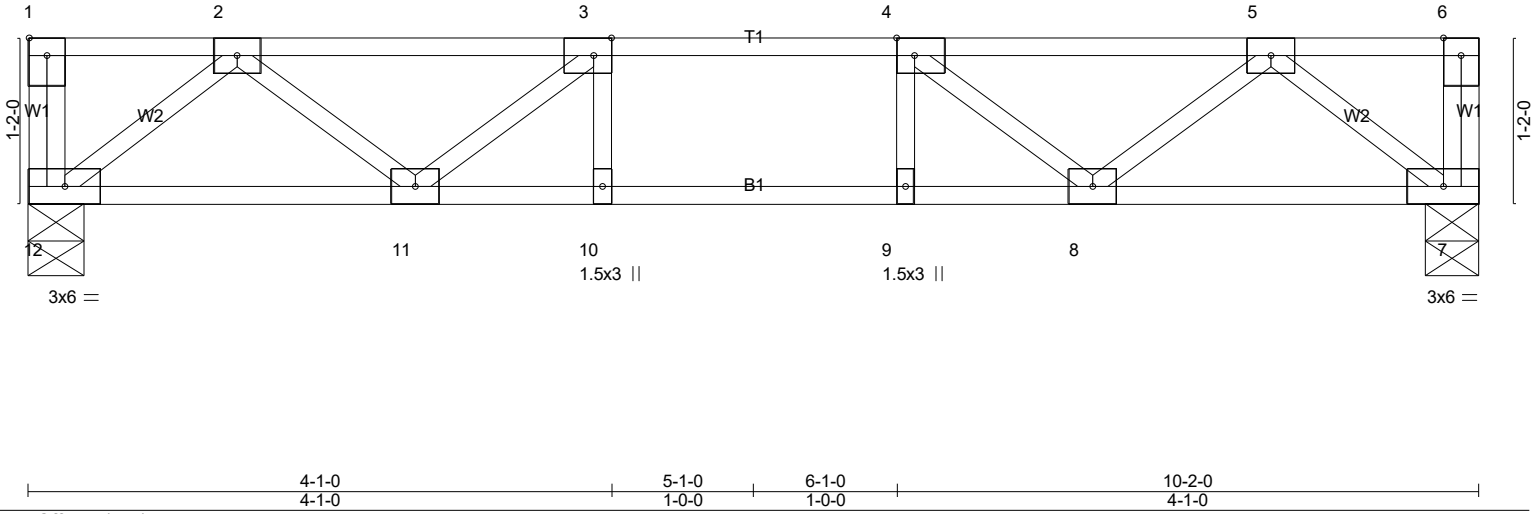


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.19	Vert(LL)	-0.04	9	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.32	Vert(CT)	-0.05	9	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.16	Horz(CT)	0.01	7	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH							
	Code IRC2021/TPI2014							Weight: 52 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 12=436/0-4-8 (min. 0-1-8), 7=436/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-772/0, 3-4=-1022/0, 4-5=-772/0
BOT CHORD 11-12=0/511, 10-11=0/1022, 9-10=0/1022, 8-9=0/1022, 7-8=0/511
WEBS 3-11=-349/0, 2-11=0/340, 2-12=-649/0, 4-8=-349/0, 5-8=0/340, 5-7=-649/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F104	Truss Type Floor	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:06 2024 Page 1
ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-lhnmJeqC531nhDs7H7Ah6eX8E4nh9xE4SSbuTz6eb1



Scale = 1:16.4


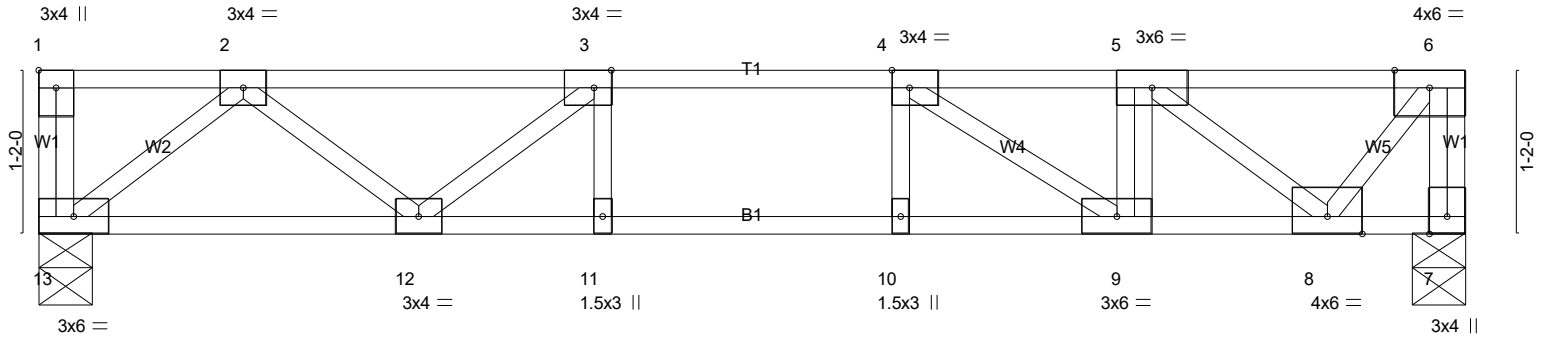


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.64	Vert(LL) -0.12	9-10	>999	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.95	Vert(CT) -0.15	9-10	>776	360			
BCLL 0.0	Rep Stress Incr NO		WB 0.56	Horz(CT) 0.02	7	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 55 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 7=994/0-4-8 (min. 0-1-8), 13=598/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 6-7=-985/0, 2-3=-1181/0, 3-4=-1781/0, 4-5=-1973/0, 5-6=-750/0
BOT CHORD 12-13=0/687, 11-12=0/1781, 10-11=0/1781, 9-10=0/1781, 8-9=0/1973
WEBS 3-12=-795/0, 2-12=0/642, 2-13=-872/0, 4-9=-263/403, 5-8=-1534/0, 6-8=0/1183

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 7-13=-8, 1-6=-80
Concentrated Loads (lb)
Vert: 5=-720



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F106	Truss Type Floor	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:08 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-E4pYB?g5kiJk0?NEFi9emXjxu1uo92kXYmxiylZ6ebj



Scale = 1:36.2

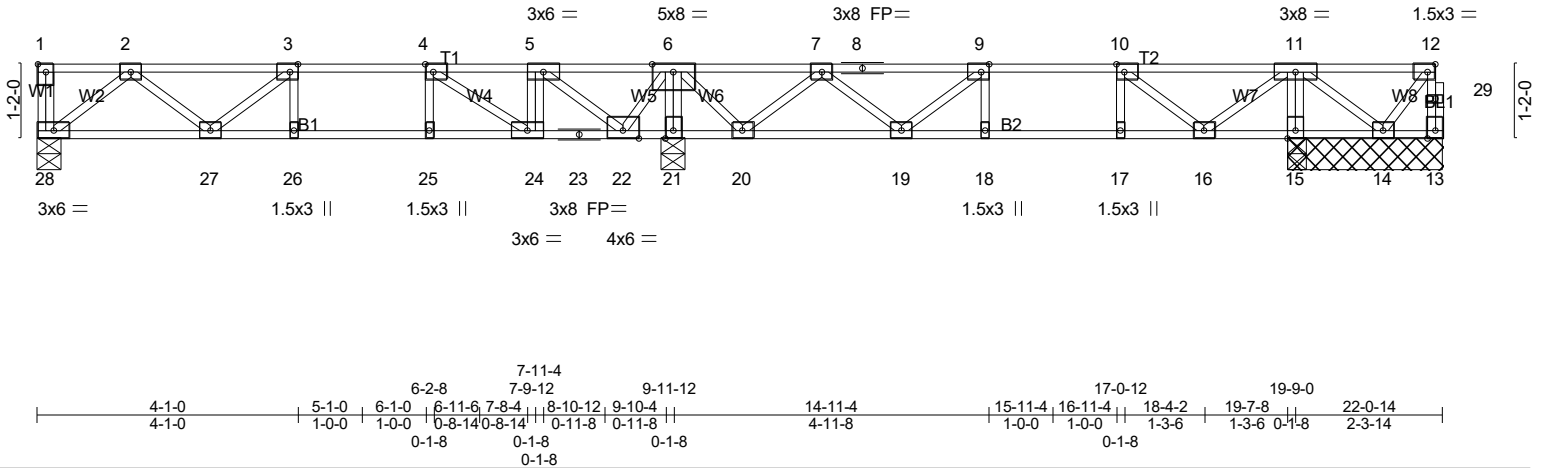


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.37	Vert(LL) -0.05	26-27	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.40	Vert(CT) -0.06	25	>999	360		
BCLL 0.0	Rep Stress Incr NO	WB 0.61	Horz(CT) 0.01	21	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 115 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 27-28,26-27,25-26,24-25.
WEBS 2x4 SP No.3(flat)	

REACTIONS. All bearings 2-5-6 except (jt=length) 28=0-4-8, 21=0-4-8.
(lb) - Max Uplift All uplift 100 lb or less at joint(s) 14 except 13=-176(LC 10)
Max Grav All reactions 250 lb or less at joint(s) 13, 14 except 28=487(LC 3), 21=1675(LC 9), 15=647(LC 10), 15=582(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-903/0, 3-4=-1259/0, 4-5=-1126/50, 5-6=0/650, 6-7=0/945, 7-8=-454/476, 8-9=-454/476, 9-10=-609/305, 10-11=-261/264
BOT CHORD 27-28=0/567, 26-27=0/1259, 25-26=0/1259, 24-25=0/1259, 23-24=-50/1126, 22-23=-50/1126, 21-22=-1396/0, 20-21=-1386/0, 19-20=-625/256, 18-19=-305/609, 17-18=-305/609, 16-17=-305/609, 15-16=-482/0, 14-15=-484/0
WEBS 6-21=-1627/0, 3-27=-456/13, 11-15=-634/0, 2-27=0/436, 2-28=-720/0, 4-24=-508/0, 5-22=-1696/0, 6-22=0/1278, 9-19=-368/0, 7-19=0/368, 7-20=-668/0, 6-20=0/613, 10-16=-445/53, 11-16=0/432, 11-14=0/375, 12-14=-294/0

- NOTES-** (6-7)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=length) 13=176.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-28=-8, 1-12=-80
Concentrated Loads (lb)
Vert: 5=-720

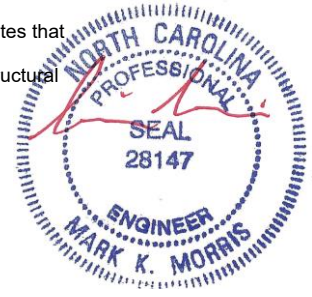

6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F107	Truss Type Floor	Qty 6	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:09 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-iGNwOLhjV0Rbe9yRoPgtJIG7mRDluZEgmPhFVoz6ebi



Scale = 1:36.2


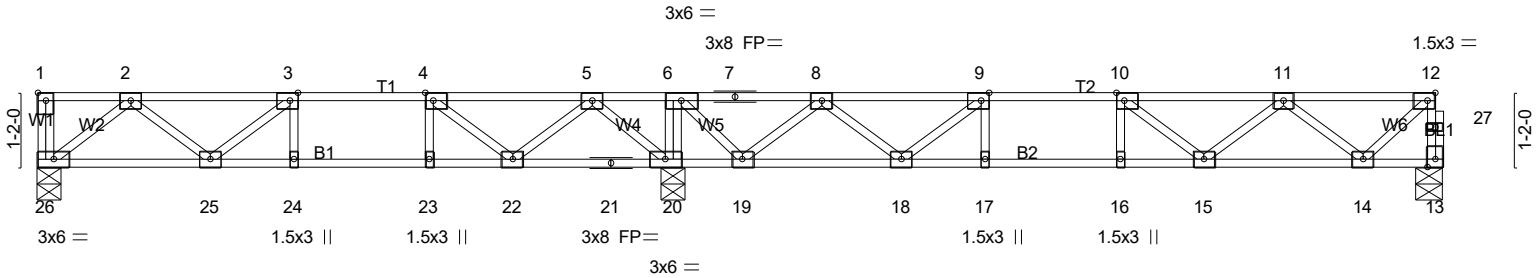


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.29	Vert(LL)	-0.07	15-16	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.49	Vert(CT)	-0.09	15-16	>999		
BCLL 0.0	Lumber DOL 1.00	WB 0.34	Horz(CT)	0.02	13	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 110 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-22,19-20,18-19.

REACTIONS. (lb/size) 26=368/0-4-8 (min. 0-1-8), 13=468/0-5-6 (min. 0-1-8), 20=1078/0-4-8 (min. 0-1-8)
Max Grav 26=399(LC 10), 13=488(LC 7), 20=1078(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 13-27=-484/0, 12-27=-483/0, 2-3=-680/0, 3-4=-849/0, 4-5=-514/131, 5-6=0/698, 8-9=-971/0, 9-10=-1298/0, 10-11=-1134/0, 11-12=-454/0
BOT CHORD 25-26=0/471, 24-25=0/849, 23-24=0/849, 22-23=0/849, 21-22=-280/204, 20-21=-280/204, 19-20=-698/0, 18-19=-3/666, 17-18=0/1298, 16-17=0/1298, 15-16=0/1298, 14-15=0/934
WEBS 6-20=-634/0, 2-25=0/272, 2-26=-598/0, 4-22=-544/0, 5-22=0/475, 5-20=-682/0, 9-18=-503/0, 8-18=0/451, 8-19=-744/0, 6-19=0/707, 11-15=0/261, 11-14=-624/0, 12-14=0/593

NOTES- (5-6)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 4) CAUTION, Do not erect truss backwards.
- 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F108	Truss Type Floor	Qty 3	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:09 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-iGNwOLhjV0RBe9yRoPgtJIG2yR9AuZZgmPhFVoz6ebi



Scale = 1:36.2

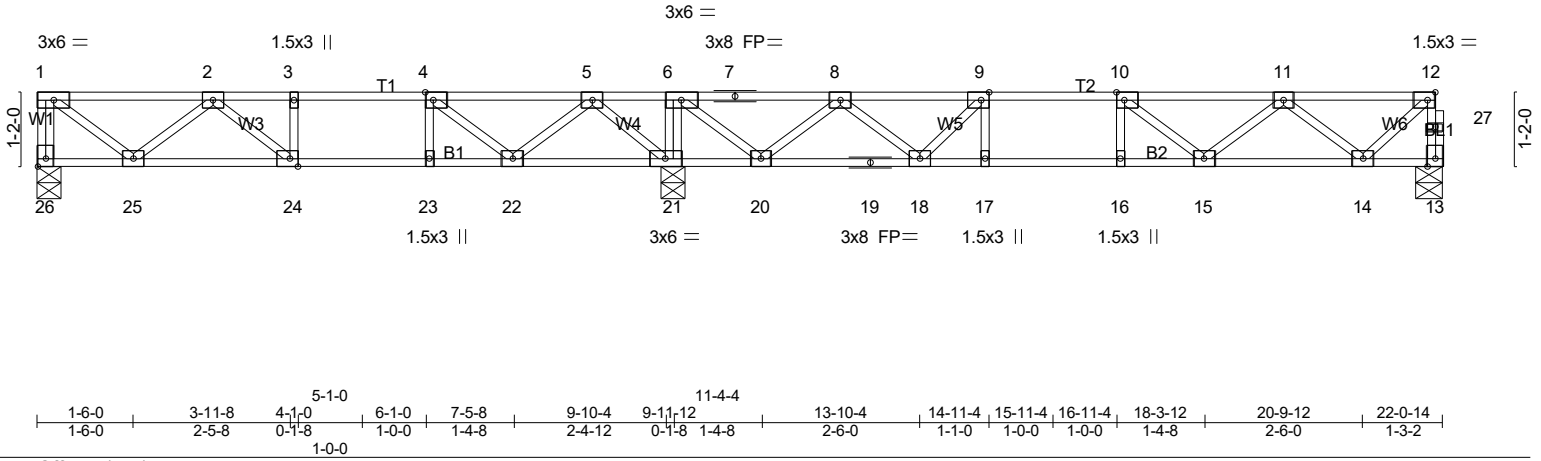


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge], [24:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.60	Vert(LL)	-0.09	24-25	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.72	Vert(CT)	-0.12	24-25	>977		
BCLL 0.0	Lumber DOL 1.00	WB 0.38	Horz(CT)	0.02	13	n/a		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 110 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 21-22,20-21.

REACTIONS. (lb/size) 26=528/0-4-8 (min. 0-1-8), 13=480/0-5-6 (min. 0-1-8), 21=1146/0-4-8 (min. 0-1-8)
Max Grav 26=558(LC 3), 13=500(LC 7), 21=1146(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-26=-565/0, 13-27=-497/0, 12-27=-496/0, 1-2=-635/0, 2-3=-1348/0, 3-4=-1348/0,
4-5=-844/31, 5-6=0/507, 6-7=-372/3, 7-8=-372/3, 8-9=-1144/0, 9-10=-1368/0,
10-11=-1179/0, 11-12=-468/0

BOT CHORD 24-25=0/1148, 23-24=0/1348, 22-23=0/1348, 21-22=-213/418, 20-21=-507/0, 19-20=0/875,
18-19=0/875, 17-18=0/1368, 16-17=0/1368, 15-16=0/1368, 14-15=0/961

WEBS 6-21=-636/0, 1-25=0/797, 2-25=-668/0, 2-24=-28/276, 4-22=-754/0, 5-22=0/627,
5-21=-766/0, 6-20=0/752, 8-20=-693/0, 8-18=0/401, 9-18=-409/0, 11-15=0/285,
11-14=-642/0, 12-14=0/610

NOTES- (5-6)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-26=-8, 1-12=-80
Concentrated Loads (lb)
Vert: 3=-240



6/13/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F109	Truss Type Floor	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:10 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-ASwlcghLGKZSGIXdM7B6syolfraasd1xp?3Qp1Ez6ebh


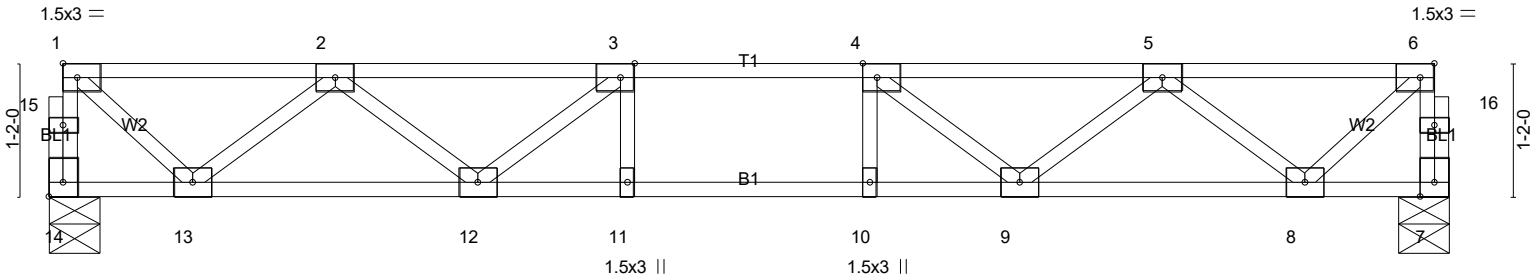



Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [6:0-1-8,Edge], [14:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3 Plate Grip DOL 1.00	TC 0.22	Vert(LL) -0.07	9-10	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.43	Vert(CT) -0.09	10	>999	360		
BCLL 0.0	Rep Stress Incr YES	WB 0.31	Horz(CT) 0.02	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 62 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 14=524/0-5-6 (min. 0-1-8), 7=524/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 14-15=-521/0, 1-15=-521/0, 7-16=-521/0, 6-16=-521/0, 1-2=-493/0, 2-3=-1261/0, 3-4=-1504/0, 4-5=-1261/0, 5-6=-493/0
BOT CHORD 12-13=0/1011, 11-12=0/1504, 10-11=0/1504, 9-10=0/1504, 8-9=0/1011
WEBS 3-12=-393/0, 2-12=0/333, 2-13=-674/0, 1-13=0/643, 4-9=-393/0, 5-9=0/333, 5-8=-674/0, 6-8=0/643

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F110	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:10 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-ASwlcghLGKZSGIXdM7B6syoKxrgRd5Ap73Qp1Ez6ebh

0₁-8

0₁-8

Scale = 1:19.9

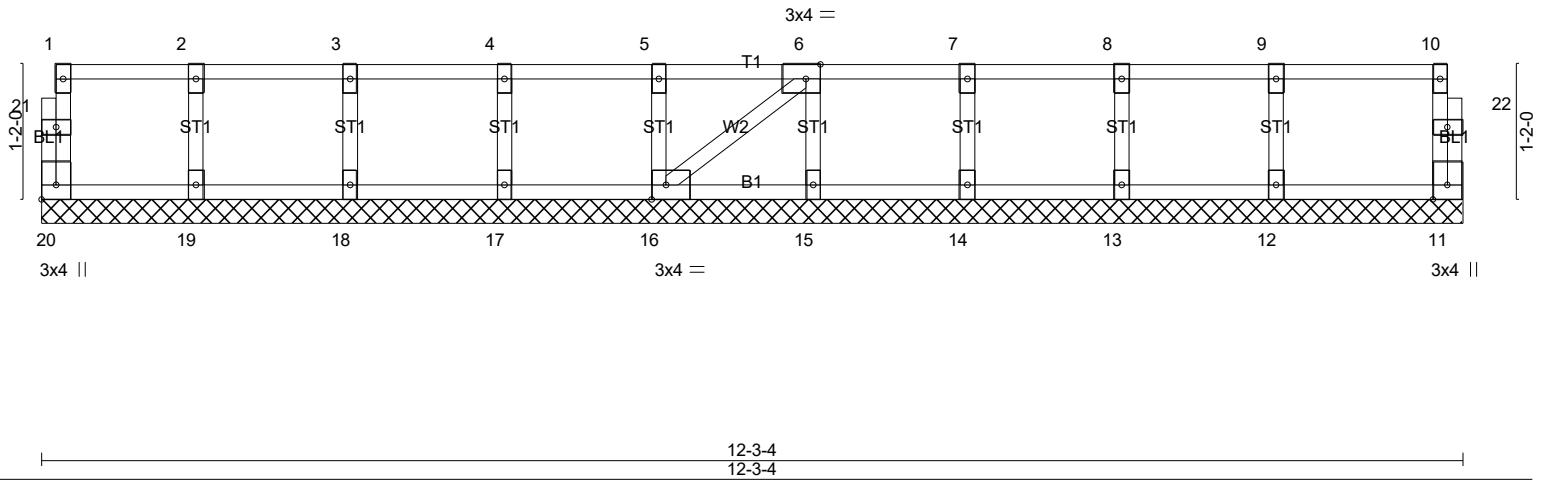


Plate Offsets (X,Y)--		[6:0-1-8,Edge], [16:0-1-8,Edge], [20:Edge,0-1-8]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.08	Vert(LL) n/a	-	n/a	999		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.01	Vert(CT) n/a	-	n/a	999			
BCLL 0.0	Rep Stress Incr YES		WB 0.04	Horz(CT) 0.00	11	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 54 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 12-3-4.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 20, 11, 19, 18, 17, 16, 15, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

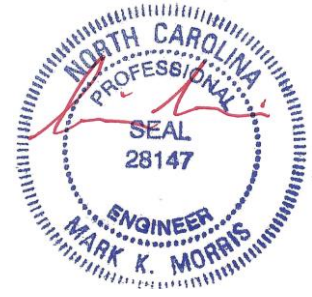


6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F111	Truss Type Floor	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:10 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-ASwlcghLGKZSGIXdM7B6syolhrjd4ip?3Qp1Ez6ebh

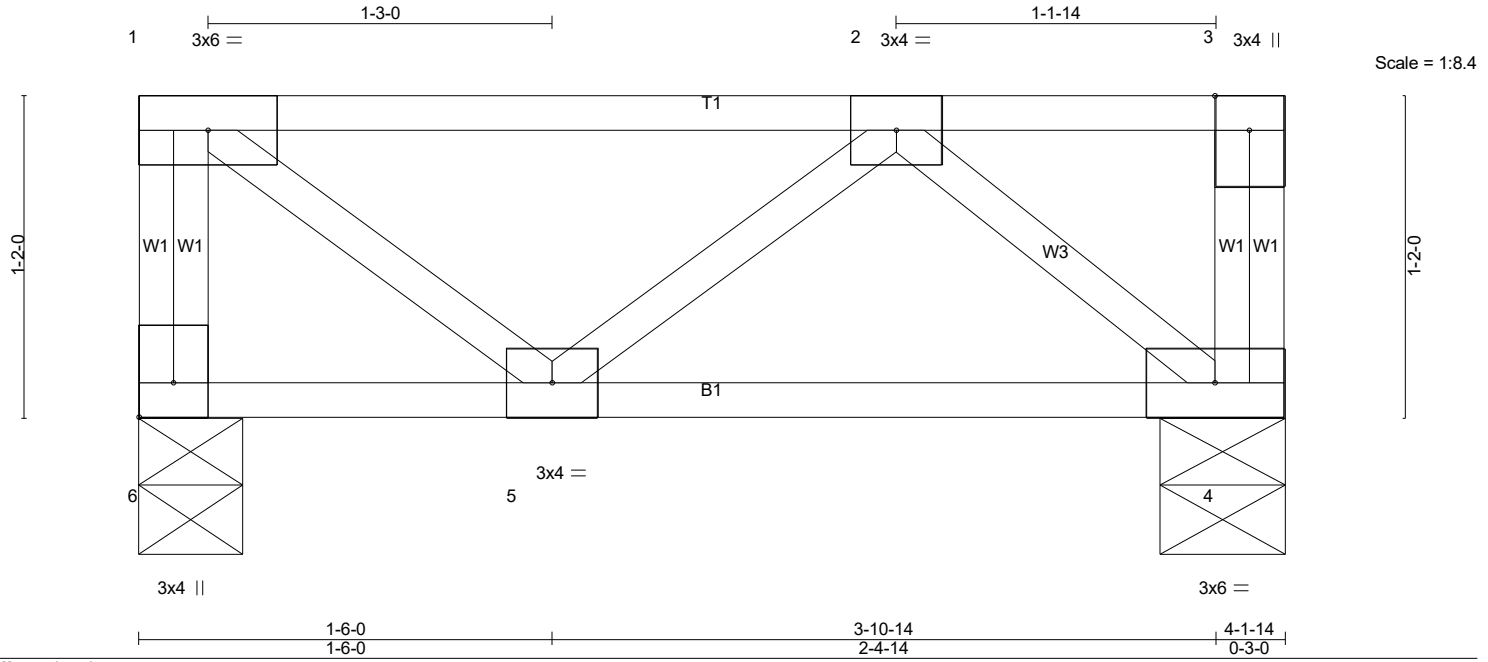

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.22	Vert(LL)	-0.00	5	>999	480	MT20	244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.06	Vert(CT)	-0.00	4-5	>999	360	Weight: 25 lb FT = 20%F, 11%E		
BCLL	0.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	0.00	4	n/a	n/a			
BCDL	5.0	Code IRC2021/TPI2014		Matrix-P									


LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-1-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=172/0-4-8 (min. 0-1-8), 4=172/0-5-6 (min. 0-1-8)
FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (2-3)
1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
2) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
3) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

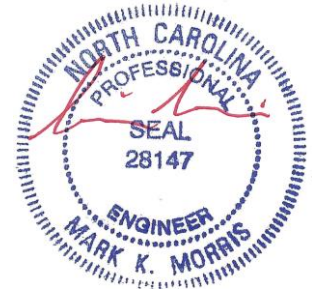

6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F113	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:11 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-efUgp0iz1dhJtS6pqwLLOALWvF0eMYTzEjAMZgz6ebg

0-1-8

Scale = 1:22.1

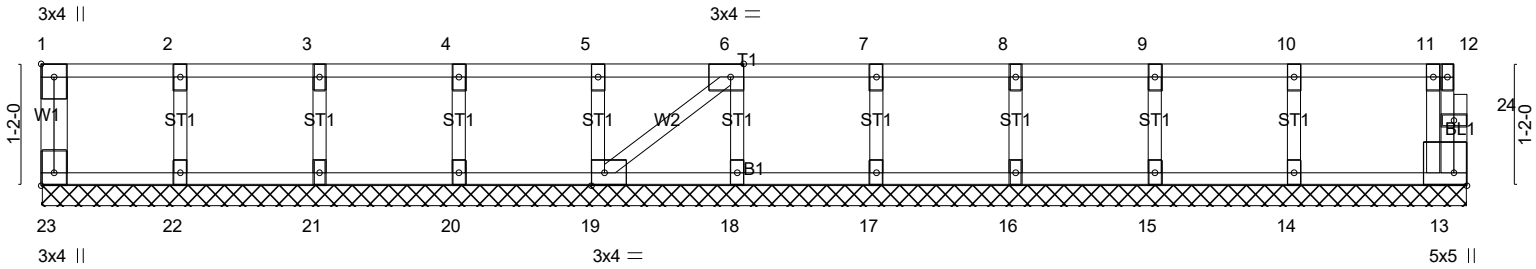


Plate Offsets (X,Y)--	[1:Edge,0-1-8], [6:0-1-8,Edge], [13:Edge,0-1-8], [19:0-1-8,Edge], [23:Edge,0-1-8]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 62 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-7-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 23, 13, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION. Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F114	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:11 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9xyaVB1-efUgp0iz1dhJtS6pwqiLOALVF0hMYpZejAMZgz6ebg

0-1-8
H

Scale = 1:37.5

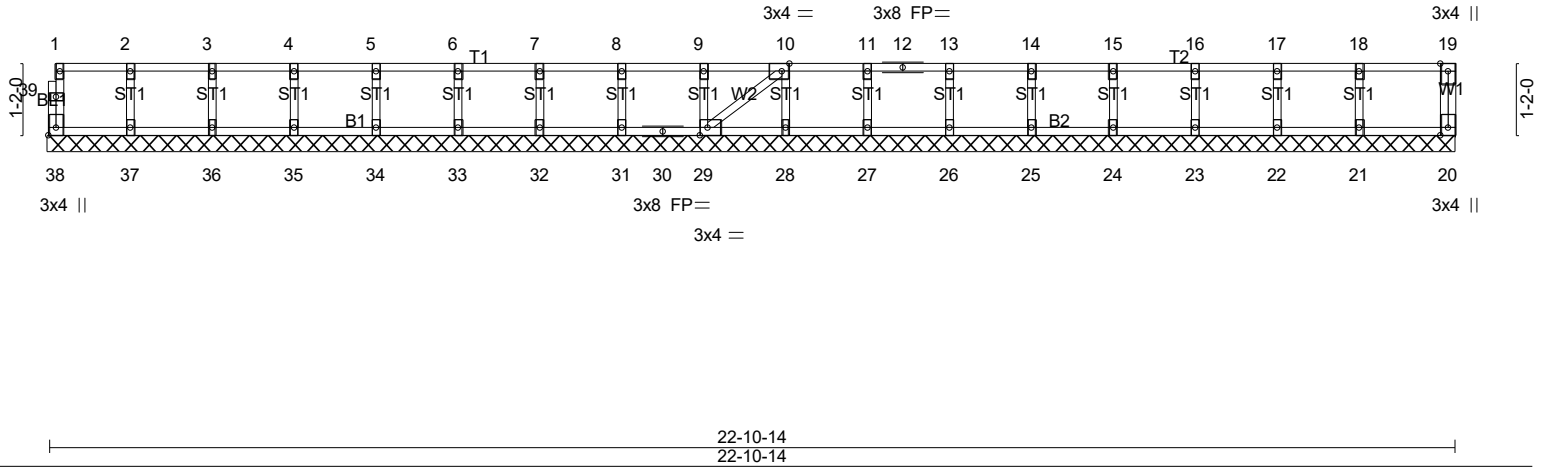


Plate Offsets (X,Y)-- [10:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.08	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	20	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 97 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 22-10-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 31, 29, 28, 27, 26, 25, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

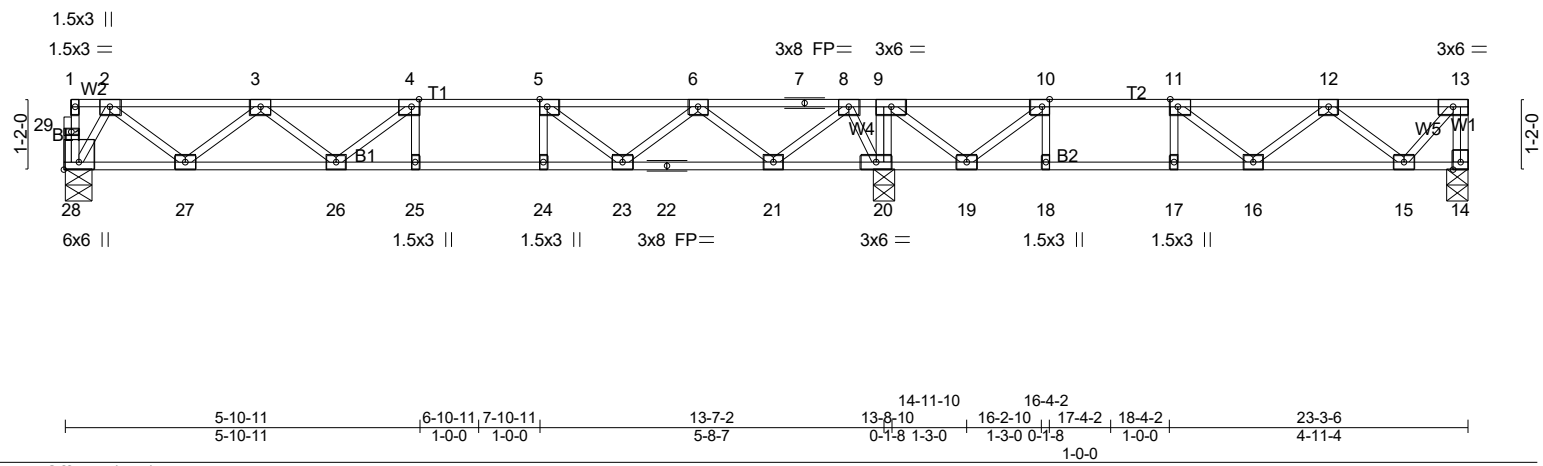

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.43	Vert(LL)	-0.09 25-26 >999 480	MT20	244/190	Weight: 117 lb FT = 20%F, 11%E	
TCDL	10.0	Lumber DOL	1.00	BC	0.60	Vert(CT)	-0.12 25-26 >999 360				
BCLL	0.0	Rep Stress Incr	YES	WB	0.36	Horz(CT)	0.03 14 n/a n/a				
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH							

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 28=547/0-5-6 (min. 0-1-8), 14=364/0-4-8 (min. 0-1-8), 20=1109/0-4-8 (min. 0-1-8)
 Max Grav 28=558(LC 10), 14=409(LC 4), 20=1109(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 13-14=-403/0, 2-3=-847/0, 3-4=-1529/0, 4-5=-1703/0, 5-6=-1387/0, 6-7=-548/0,
 7-8=-548/0, 8-9=0/658, 9-10=-350/348, 10-11=-840/87, 11-12=-821/0, 12-13=-307/0
 BOT CHORD 27-28=0/353, 26-27=0/1321, 25-26=0/1703, 24-25=0/1703, 23-24=0/1703, 22-23=0/1088,
 21-22=0/1088, 20-21=-314/26, 19-20=-658/0, 18-19=-87/840, 17-18=-87/840,
 16-17=-87/840, 15-16=0/710
 WEBS 9-20=-453/0, 4-26=-298/0, 3-26=0/273, 3-27=-616/0, 2-27=0/643, 2-28=-679/0,
 5-23=-473/0, 6-23=0/431, 6-21=-740/0, 8-21=0/765, 8-20=-784/0, 10-19=-771/0,
 9-19=0/616, 12-15=-524/0, 13-15=0/459

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

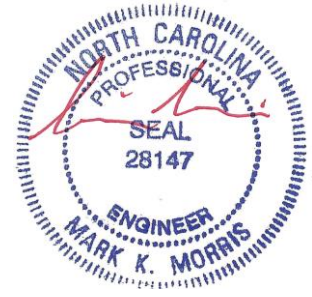

6/13/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC
24-5147-F01	F115A	Floor	1	1	# 49569

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:12 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-6r221MjboxpAVch?UYDaxNuTyf9Q5s86TNvw57z6ebf

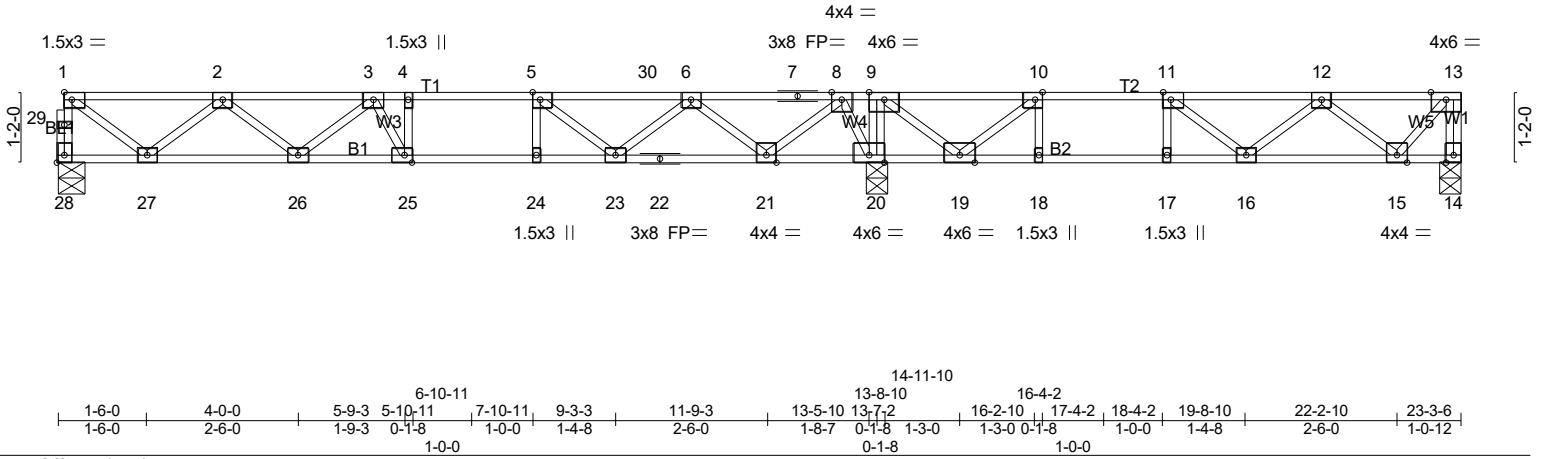


Plate Offsets (X,Y)-- [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [25:0-1-8,Edge], [28:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.94	Vert(LL) -0.16	16-17	>701	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.87	Vert(CT) -0.22	16-17	>529	360		
BCLL 0.0	Rep Stress Incr NO	WB 0.58	Horz(CT) 0.04	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 117 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-21,19-20.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=581/0-5-6 (min. 0-1-8), 14=814/0-4-8 (min. 0-1-8), 20=1962/0-4-8 (min. 0-1-8)
 Max Grav 28=603(LC 10), 14=883(LC 4), 20=1962(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 28-29=-600/0, 1-29=-599/0, 13-14=-870/0, 1-2=-688/0, 2-3=-1602/0, 3-4=-1992/0,
 4-5=-1992/0, 5-30=-1788/0, 6-30=-1788/0, 6-7=-833/0, 7-8=-833/0, 8-9=0/1066,
 9-10=-814/464, 10-11=-1849/0, 11-12=-1783/0, 12-13=-657/0
 BOT CHORD 26-27=0/1287, 25-26=0/1905, 24-25=0/1992, 23-24=0/1992, 22-23=0/1556, 21-22=0/1556,
 20-21=-540/112, 19-20=-1066/0, 18-19=0/1849, 17-18=0/1849, 16-17=0/1849, 15-16=0/1543
 WEBS 10-18=0/412, 11-17=-373/0, 9-20=-970/0, 1-27=0/833, 2-27=-779/0, 2-26=0/409,
 3-26=-395/0, 3-25=-103/359, 5-23=-421/0, 6-23=0/393, 6-21=-1019/0, 8-21=0/1031,
 8-20=-1243/0, 9-19=0/1220, 10-19=-1527/0, 12-16=-57/313, 12-15=-1153/0, 13-15=0/983

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-30=-80, 13-30=-180



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC
24-5147-F01	F116	FLOOR	4	1	# 49569

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MITek Industries, Inc. Thu Jun 13 17:18:13 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-a1cREikDZFx17mGC1FlpTbQht2VdqloGh1fTeZz6ebe

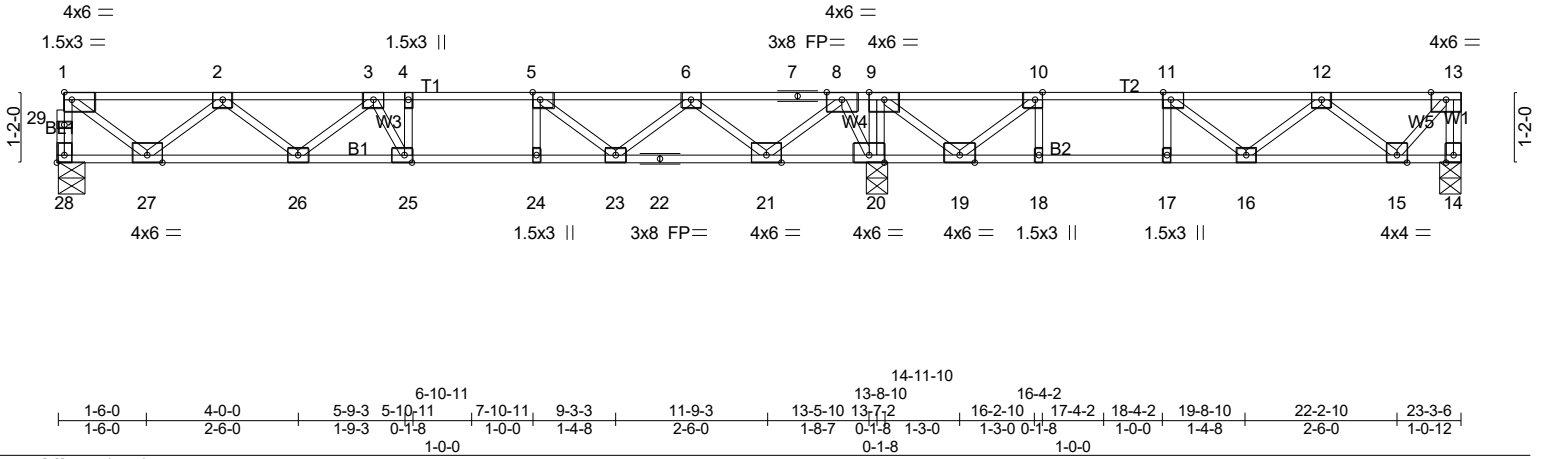


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [25:0-1-8,Edge], [28:Edge,0-1-8]									
LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.73	Vert(LL)	-0.09 25-26	>999	480	MT20	244/190
TCDL 60.0	Lumber DOL	1.00	BC 0.81	Vert(CT)	-0.21 25-26	>752	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.68	Horz(CT)	0.05 14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 117 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-21,19-20.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=1037/0-5-6 (min. 0-1-8), 14=684/0-4-8 (min. 0-1-8), 20=2136/0-4-8 (min. 0-1-8)
 Max Grav 28=1047(LC 10), 14=733(LC 4), 20=2136(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 28-29=-1041/0, 1-29=-1040/0, 13-14=-719/0, 1-2=-1167/0, 2-3=-2679/0, 3-4=-3123/0,
 4-5=-3123/0, 5-6=-2495/0, 6-7=-844/0, 7-8=-844/0, 8-9=0/1189, 9-10=-289/437,
 10-11=-1342/0, 11-12=-1410/0, 12-13=-538/0
 BOT CHORD 26-27=0/2205, 25-26=0/3106, 24-25=0/3123, 23-24=0/3123, 22-23=0/1910, 21-22=0/1910,
 20-21=-531/0, 19-20=-1189/0, 18-19=0/1342, 17-18=0/1342, 16-17=0/1342, 15-16=0/1269
 WEBS 10-18=0/398, 11-17=-359/0, 9-20=-874/0, 1-27=0/1410, 2-27=-1352/0, 2-26=0/617,
 3-26=-555/0, 3-25=-140/252, 5-23=-868/0, 6-23=0/804, 6-21=-1424/0, 8-21=0/1436,
 8-20=-1431/0, 9-19=0/1162, 10-19=-1489/0, 11-16=0/281, 12-15=-951/0, 13-15=0/804

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

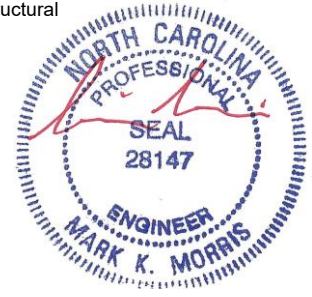

6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F116A	Truss Type Floor	Qty 4	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	----------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:13 2024 Page 1
ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-a1cREikDZFx17mGC1FpTbQht2SHqLdGh1fTeZz6ebe

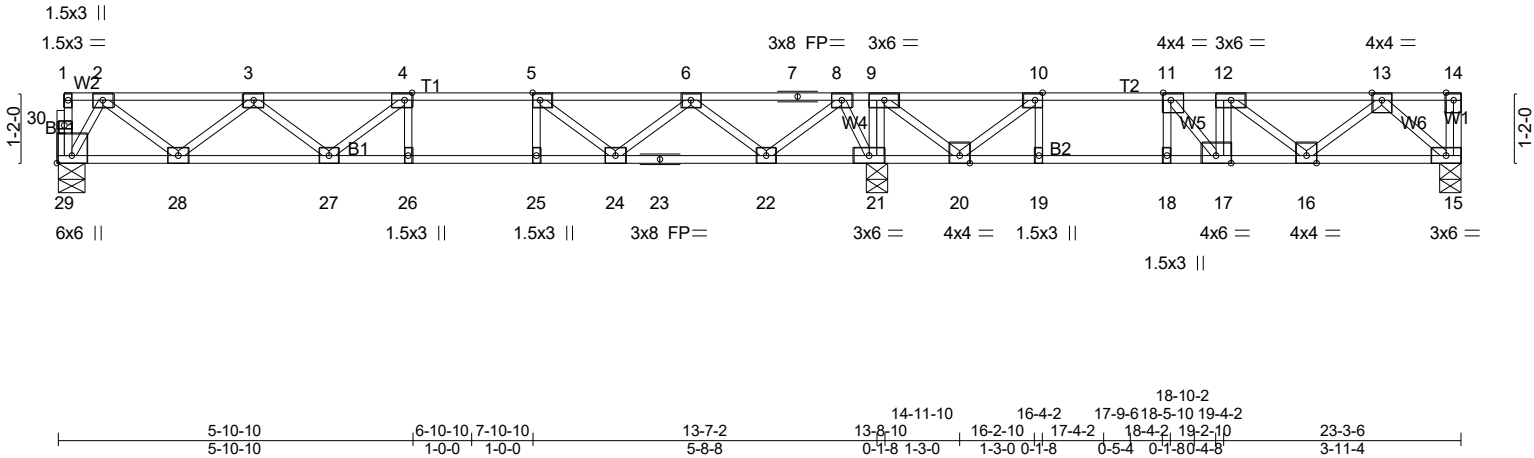


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [29:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.73	Vert(LL) -0.16	17-18	>714	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.96	Vert(CT) -0.22	17-18	>526	360		
BCLL 0.0	Rep Stress Incr NO	WB 0.50	Horz(CT) 0.04	15	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 120 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat) *Except* T2: 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 21-22,20-21.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 29=570/0-5-6 (min. 0-1-8), 21=1310/0-4-8 (min. 0-1-8), 15=781/0-4-8 (min. 0-1-8)
Max Grav 29=580(LC 10), 21=1310(LC 1), 15=830(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-886/0, 3-4=-1621/0, 4-5=-1844/0, 5-6=-1578/0, 6-7=-791/0, 7-8=-791/0,
8-9=-235/608, 9-10=-972/220, 10-11=-1925/0, 11-12=-2492/0, 12-13=-1658/0
BOT CHORD 28-29=0/367, 27-28=0/1383, 26-27=0/1844, 25-26=0/1844, 24-25=0/1844, 23-24=0/1307,
22-23=0/1307, 21-22=-256/352, 20-21=-608/235, 19-20=0/1925, 18-19=0/1925,
17-18=0/1925, 16-17=0/2492, 15-16=0/908
WEBS 12-17=-471/0, 10-19=0/424, 11-18=-472/0, 9-21=-583/0, 4-27=-361/0, 3-27=0/313,
3-28=-646/0, 2-28=0/676, 2-29=-707/0, 5-24=-461/0, 6-24=0/424, 6-22=-732/0,
8-22=0/754, 8-21=-828/0, 10-20=-1370/0, 9-20=0/1019, 11-17=0/1055, 12-16=-1046/0,
13-16=0/977, 13-15=-1207/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-29=-8, 1-14=-80
Concentrated Loads (lb)
Vert: 12=-640

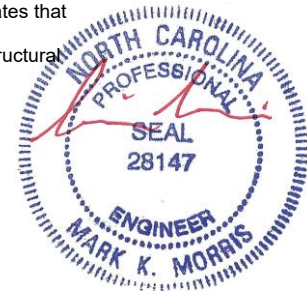

6/13/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F117	Truss Type Floor	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:14 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-3EApr2ksKY3ukwrObzG20ozsdSoWZotPwh00A?z6ebd

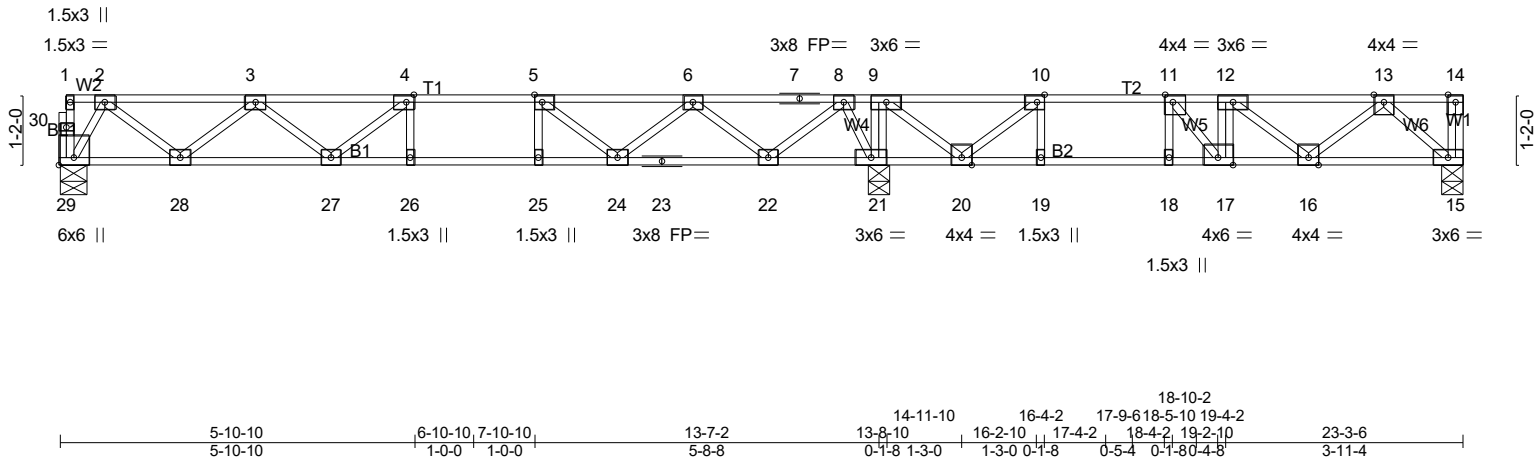


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [29:Edge,0-3-0]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.73	Vert(LL)	-0.16 17-18	>714	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.96	Vert(CT)	-0.22 17-18	>526	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.50	Horz(CT)	0.04 15	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 120 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat) *Except* T2: 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 21-22,20-21.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 29=570/0-5-6 (min. 0-1-8), 21=1310/0-4-8 (min. 0-1-8), 15=781/0-4-8 (min. 0-1-8)
Max Grav 29=580(LC 10), 21=1310(LC 1), 15=830(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-886/0, 3-4=-1621/0, 4-5=-1844/0, 5-6=-1578/0, 6-7=-791/0, 7-8=-791/0,
8-9=-235/608, 9-10=-972/220, 10-11=-1925/0, 11-12=-2492/0, 12-13=-1658/0
BOT CHORD 28-29=0/367, 27-28=0/1383, 26-27=0/1844, 25-26=0/1844, 24-25=0/1844, 23-24=0/1308,
22-23=0/1308, 21-22=-256/352, 20-21=-608/235, 19-20=0/1925, 18-19=0/1925,
17-18=0/1925, 16-17=0/2492, 15-16=0/908
WEBS 12-17=-471/0, 10-19=0/424, 11-18=-472/0, 9-21=-583/0, 4-27=-361/0, 3-27=0/313,
3-28=-646/0, 2-28=0/676, 2-29=-707/0, 5-24=-461/0, 6-24=0/424, 6-22=-732/0,
8-22=0/754, 8-21=-828/0, 10-20=-1370/0, 9-20=0/1019, 11-17=0/1055, 12-16=-1046/0,
13-16=0/977, 13-15=-1207/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 15-29=-8, 1-14=-80
Concentrated Loads (lb)
Vert: 12=-640

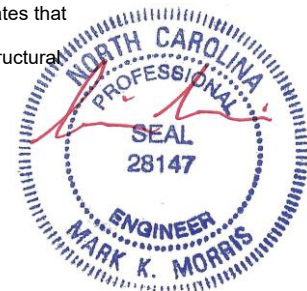

6/13/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F118	Truss Type Floor	Qty 12	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	---------------------	-----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:14 2024 Page 1
ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-3EApR2ksKY3ukwrObzG20ozz5SvQQzbPwh00A?z6ebd

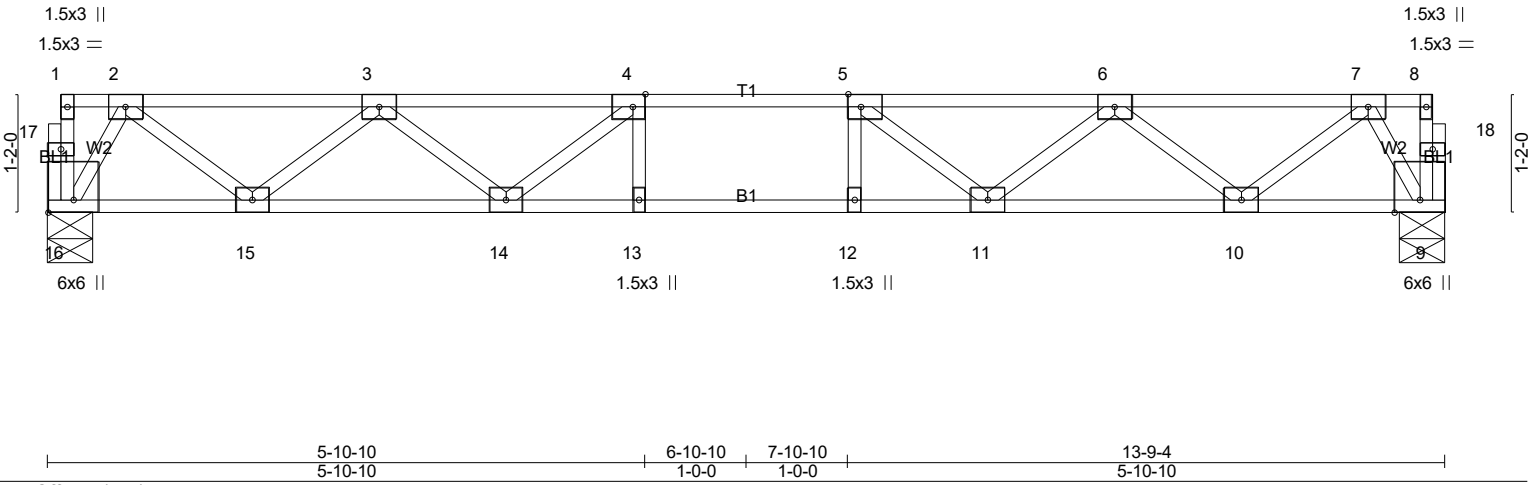



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [16:Edge,0-3-0]	
5-10-10 5-10-10	6-10-10 1-0-0
7-10-10 1-0-0	13-9-4 5-10-10

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.52	Vert(LL) -0.09 13-14 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.33	Vert(CT) -0.12 13-14 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 70 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=590/0-5-6 (min. 0-1-8), 9=590/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-903/0, 3-4=-1662/0, 4-5=-1907/0, 5-6=-1662/0, 6-7=-903/0
BOT CHORD 15-16=0/373, 14-15=0/1410, 13-14=0/1907, 12-13=0/1907, 11-12=0/1907, 10-11=0/1409, 9-10=0/372
WEBS 4-14=-428/0, 3-14=0/355, 3-15=-660/0, 2-15=0/690, 2-16=-719/0, 5-11=-428/0, 6-11=0/355, 6-10=-660/0, 7-10=0/690, 7-9=-719/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

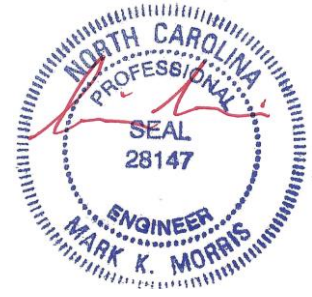

6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D*Onofrio Drive, Madison, WI 53719.

Job 24-5147-F01	Truss F119	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0109 BLAKE POND 101 FROST MEADOW WAY LILLINGTON, NC Job Reference (optional) # 49569
--------------------	---------------	-------------------------------------	----------	----------	---

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Thu Jun 13 17:18:14 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-3EApR2ksKY3ukwrObzG20oz1AS1KZvEPwh00A?z6ebd

0-1-8

0-1-8

Scale = 1:22.2

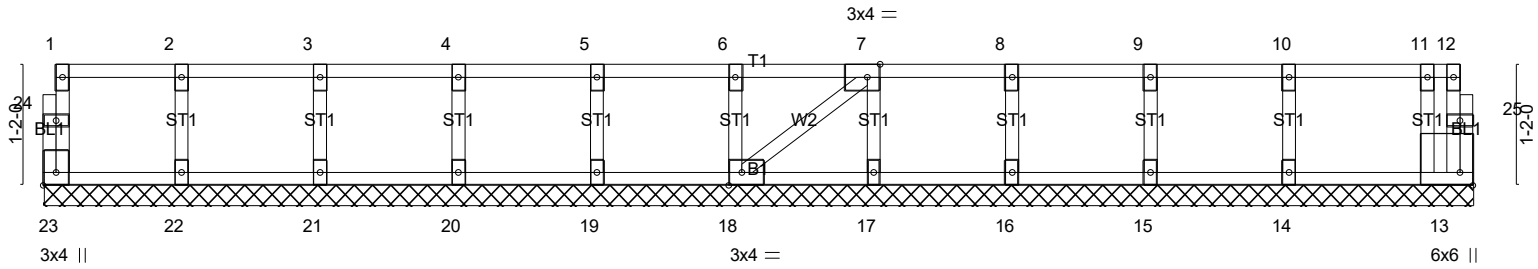


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [13:Edge,0-1-8], [18:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 61 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 13-9-4.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 23, 13, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



6/13/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.