

SOUTHEASTERN SOIL & ENVIRONMENTAL ASSOC., INC.

PROPOSED SUBSURFACE WASTE DISPOSAL SYSTEM DETAIL SHEET

SUBDIVISION: Blake Pond

LOT 109

INITIAL SYSTEM: <sup>Pump</sup> APPROVED 25% REDUCTION

REPAIR <sup>Pump</sup> Approved 25% Reduction

DISTRIBUTION: SEWAGE

DISTRIBUTION SEWAGE OR D-Box

BENCHMARK: 100.0

LOCATION BC IRON 107/109

NO. BEDROOMS: 4

LTAR 0.3 gpd/ft<sup>2</sup>

LINE	FLAG COLOR	ELEVATION	LENGTH
1	B	99.25	65
2	P	99.00	95
3	Y	97.75	130
4a	B	97.38	35
5a	P	97.00	60
6a	Y	96.91	70
7a	B	96.59	80
			<u>535</u>

Iron R

4b	B	97.33	100
5b	P	97.00	100
6b	Y	96.91	100
7b	B	96.59	100
			<u>400</u>

Iron R

BY B.C. Raynor

DATE \_\_\_\_\_

TYPICAL PROFILE \_\_\_\_\_

THERE SHALL BE NO GRADING,

0-15 LS vfri gran

CUTTING, LOGGING OR OTHER SOIL

15-36 clay firm SBK

DISTURBANCE IN SEPTIC AREA


CR2 ≥ 36"

HEALTH DEPARTMENT USE ONLY.

DESIGNS DO NOT GUARANTEE FUNCTIONALITY

# Southeastern Soil & Environmental Associates, Inc.

P.O. Box 9321  
Fayetteville, NC 28311  
Phone/Fax (910) 822-4540  
Email mike@southeasternsoil.com

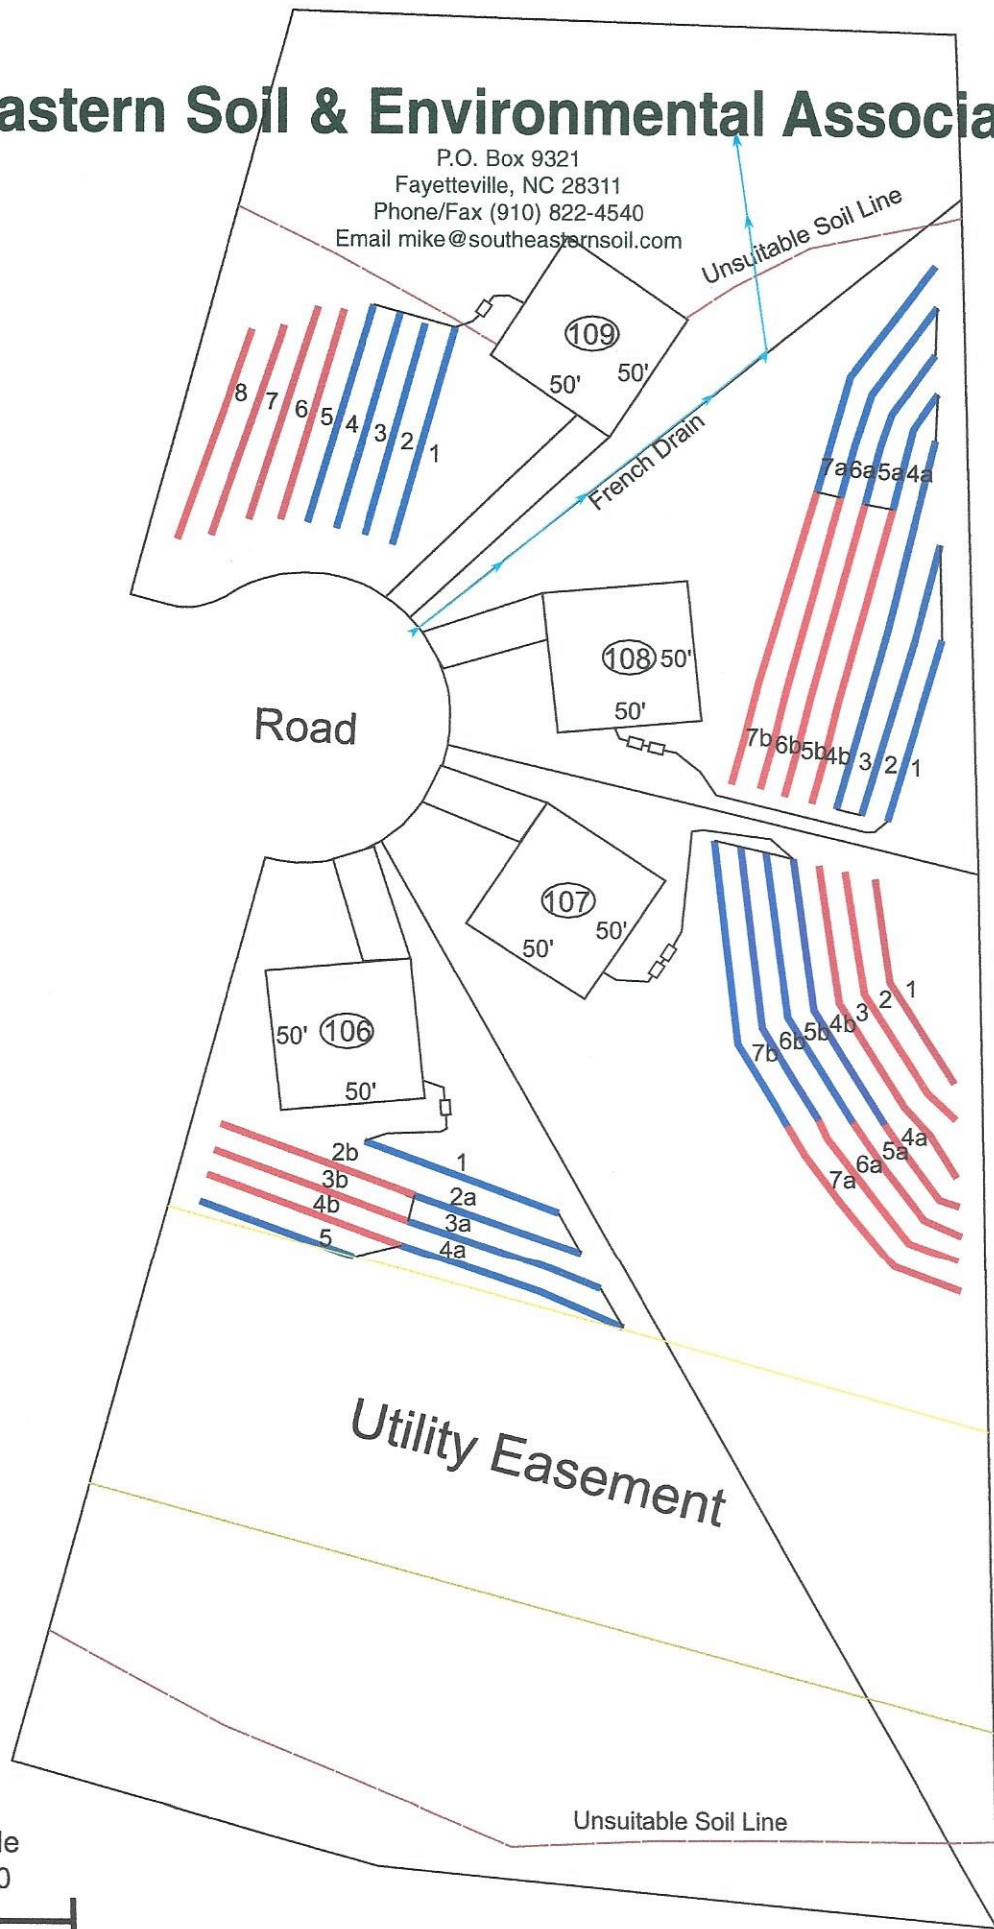

Scale  
1:60