



**North Carolina Onsite Wastewater Contractor Inspector Certification Board  
Authorized Onsite Wastewater Evaluator Permit Option for Non-Engineered Systems  
Notice of Intent (NOI) to Construct**

New     Expansion     Repair     Relocation     Relocation of Repair Area

Owner or Legal Representative Information:  
 Name: RiverWILD Homes  
 Mailing address: 114 W Main St City: Clayton State: NC Zip: 27520  
 Phone: 919-766-8782 Email: brittany@staywild.com

Authorized Onsite Wastewater Evaluator Information:  
 Name: Trent Bostic Certification #: 10056E  
 Mailing address: 501 N Salem St, Ste 203 City: Apex State: NC Zip: 27502  
 Phone: 919-367-6322 Email: tbostic@agriwaste.com

Site Location Information:  
 Site address: 3981 Baileys XRDS Rd, Benson, NC  
 Tax parcel identification number or subdivision lot, block number of property: 1610-58-7651  
Stewart Farms - Lot 4 County: Harnett


System Information:  
 Wastewater System Type: IIIb  
 Daily Design Flow: 480  
 Sapro-lite System:  Yes  No    Subsurface Operator Required:  Yes  No  
 Water Supply Type:  Private Well  Public Water Supply  Spring  Other: \_\_\_\_\_

Facility Type:  
 Residential 4 # Bedrooms 8 Maximum # of Occupants \_\_\_\_\_  
 Business    Type of Business and Basis for Flow: \_\_\_\_\_  
 Public Assembly    Type of Public Assembly and Basis for Flow: \_\_\_\_\_

Required Attachments:  
 Plat or Site Plan  
 Evaluation of Soil and Site Features by Licensed Soil Scientist

Attest: On this the 9 day of JUL, 2024 by signature below I hereby attest that the information required to be included with this NOI to Construct is accurate and complete to the best of my knowledge. Furthermore, I hereby attest that I have adhered to the laws and rules governing onsite wastewater systems in the state of North Carolina.  
 This NOI shall expire on 9 day of JUL, 2027.

Signature of Authorized Onsite Wastewater Evaluator: \_\_\_\_\_  
 Signature of Owner or Legal Representative: [Signature]

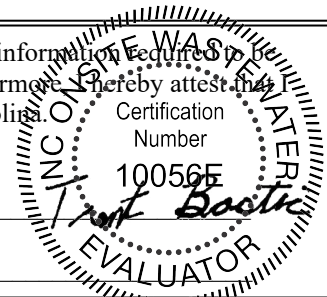


Disclosure: The owner may apply for a building permit for the project upon submitting a complete NOI to Construct and the fee required (if any) to the local health department. An onsite wastewater system authorized by an authorized onsite wastewater evaluator shall be transferable to a new owner with the consent of the authorized onsite wastewater evaluator.

Local Health Department Receipt Acknowledgement:  
 Signature of Local Health Department Representative: \_\_\_\_\_ Date: \_\_\_\_\_



Agri-Waste Technology, Inc.  
501 N Salem Street, Suite 203, Apex, NC 27502  
agriwaste.com | 919.859.0669

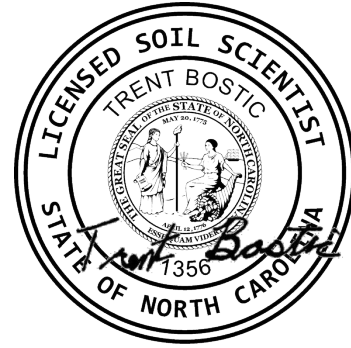

**Soil Suitability for Domestic Sewage Treatment and Disposal Systems  
3981 Baileys XRDS Rd, Benson, NC 27504  
(PIN: 1610-58-7651; Harnett County)**

PREPARED FOR: RiverWILD Homes, c/o Brittany Radziszewski

PREPARED BY: Trent Bostic, Senior Soil Scientist  
Heath Clapp, Senior Soil Scientist

DATE: July 9, 2024

Soil suitability for domestic sewage treatment and disposal systems was evaluated on May 24, 2024, for the property located at 3981 Baileys XRDS Rd in Benson, NC. A layout was performed on May 24, 2024. Trent Bostic and Heath Clapp of Agri-Waste Technology, Inc. (AWT) conducted the soil evaluation. This evaluation was done to facilitate permitting for a septic system. This report and attached documents were prepared to meet the requirements for an Authorized On-Site Wastewater Evaluator to meet G.S. 130A-336.2

A drawing of the site plan, septic layout, and boring locations is included in Attachment 1. Profile descriptions for each boring are included in Attachment 2. Additional documentation about the property is included in Attachment 3.

Site Conditions

The total property area is approximately 1.07 acres. The property is an open field. The drawing in Attachment 1 details the property boundaries, house location, boring locations, and layout of drain field trenches (Completed by AWT).

Soil Suitability for Domestic Sewage Treatment and Disposal Systems

Multiple soil borings/pits were assessed on the property. Soil borings/pits were examined to determine soil suitability for on-site sewage disposal systems in accordance with 15A NCAC 18E: Wastewater Treatment and Dispersal Systems. These borings/pits were advanced with a hand auger and excavator. All soil borings/pits shown are provisionally suitable for a conventional style trench. The proposed LTAR (Long Term Acceptance Rate) by AWT is 0.4 GPD/ft<sup>2</sup>. The soils on this property are group III soils within the distribution and treatment zone as used to define the LTAR. The maximum trench bottom should not exceed 18”.

Field Layout & System Design


A septic layout was performed to demonstrate available space (.0508). The layout in the included design packet indicates there is available space for a four-bedroom system utilizing a 25% reduction product (primary) and a 50% reduction product (repair). With an LTAR of 0.4 GPD/ft<sup>2</sup>, 300 linear feet of trench is necessary to support a four-bedroom home initial and 200 linear feet of trench is required for the repair system. The attached drawing proves that 500 linear feet of trench can be installed with the proposed home location on the property.

**Any disturbances or grading done in the usable soils area may change the potential of using the area designated for a drain field and can result in a revoked permit.**

We appreciate the opportunity to assist you in this matter. Please contact us with any questions, concerns, or comments.

Sincerely,

Trent Bostic

A handwritten signature in black ink that reads "Trent Bostic". The signature is written in a cursive, slightly slanted style.





Agri-Waste Technology, Inc.  
501 N Salem Street, Suite 203, Apex, NC 27502  
agriwaste.com | 919.859.0669

## SOIL & SITE EVALUATION for ON-SITE WASTEWATER SYSTEMS

Evaluation Date	6/24/2024	Site Location	3943 Baileys XRDS Rd, Benson, NC	County	Harnett
PIN/Parcel	1610-58-7651	Property Size	1.07	Property Recorded	Yes
Proposed Facility	SFR	Bedrooms	4	Wastewater Strength	Domestic
Water Supply	Municipal	Design Flow (.0400)	480	Evaluation Method	Auger

Profile #	.0502 Landscape Position Slope %	Horizon Depth (in)	Soil Morphology		Other Factors					
			.0503 Struct ure Textur e	.0503 Consistence Mineralogy	.0504 Soil Wetness Color	.0505 Soil Depth (in)	.0506 Saprolite	.0507 Restrictive Horizon	.0509 Profile Class LTAR	.0502(d) Slope Correction
1	3%	Ap 0-13	SL	NS, NP, VFr	10YR 4/3	36	S	S	0.4	1.2
		Bt1 13-22	SCL	SS, SP, Fr	10YR 5/8					
		Bt2 22-36+	SCL	SS, SP, Fr	7.5YR 5/8					
2	3%	Ap 0-13	SL	NS, NP, VFr	10YR 4/3	36	S	S	0.4	1.2
		Bt1 13-22	SCL	SS, SP, Fr	10YR 5/8					
		Bt2 22-36+	SCL	SS, SP, Fr	7.5YR 5/8					
3	3%	Ap 0-13	SL	NS, NP, VFr	10YR 4/3	32	S	S	0.4	1.2
		Bt1 13-22	SCL	SS, SP, Fr	10YR 5/8					
		Bt2 22-36+	SCL	SS, SP, Fr	7.5YR 5/8					



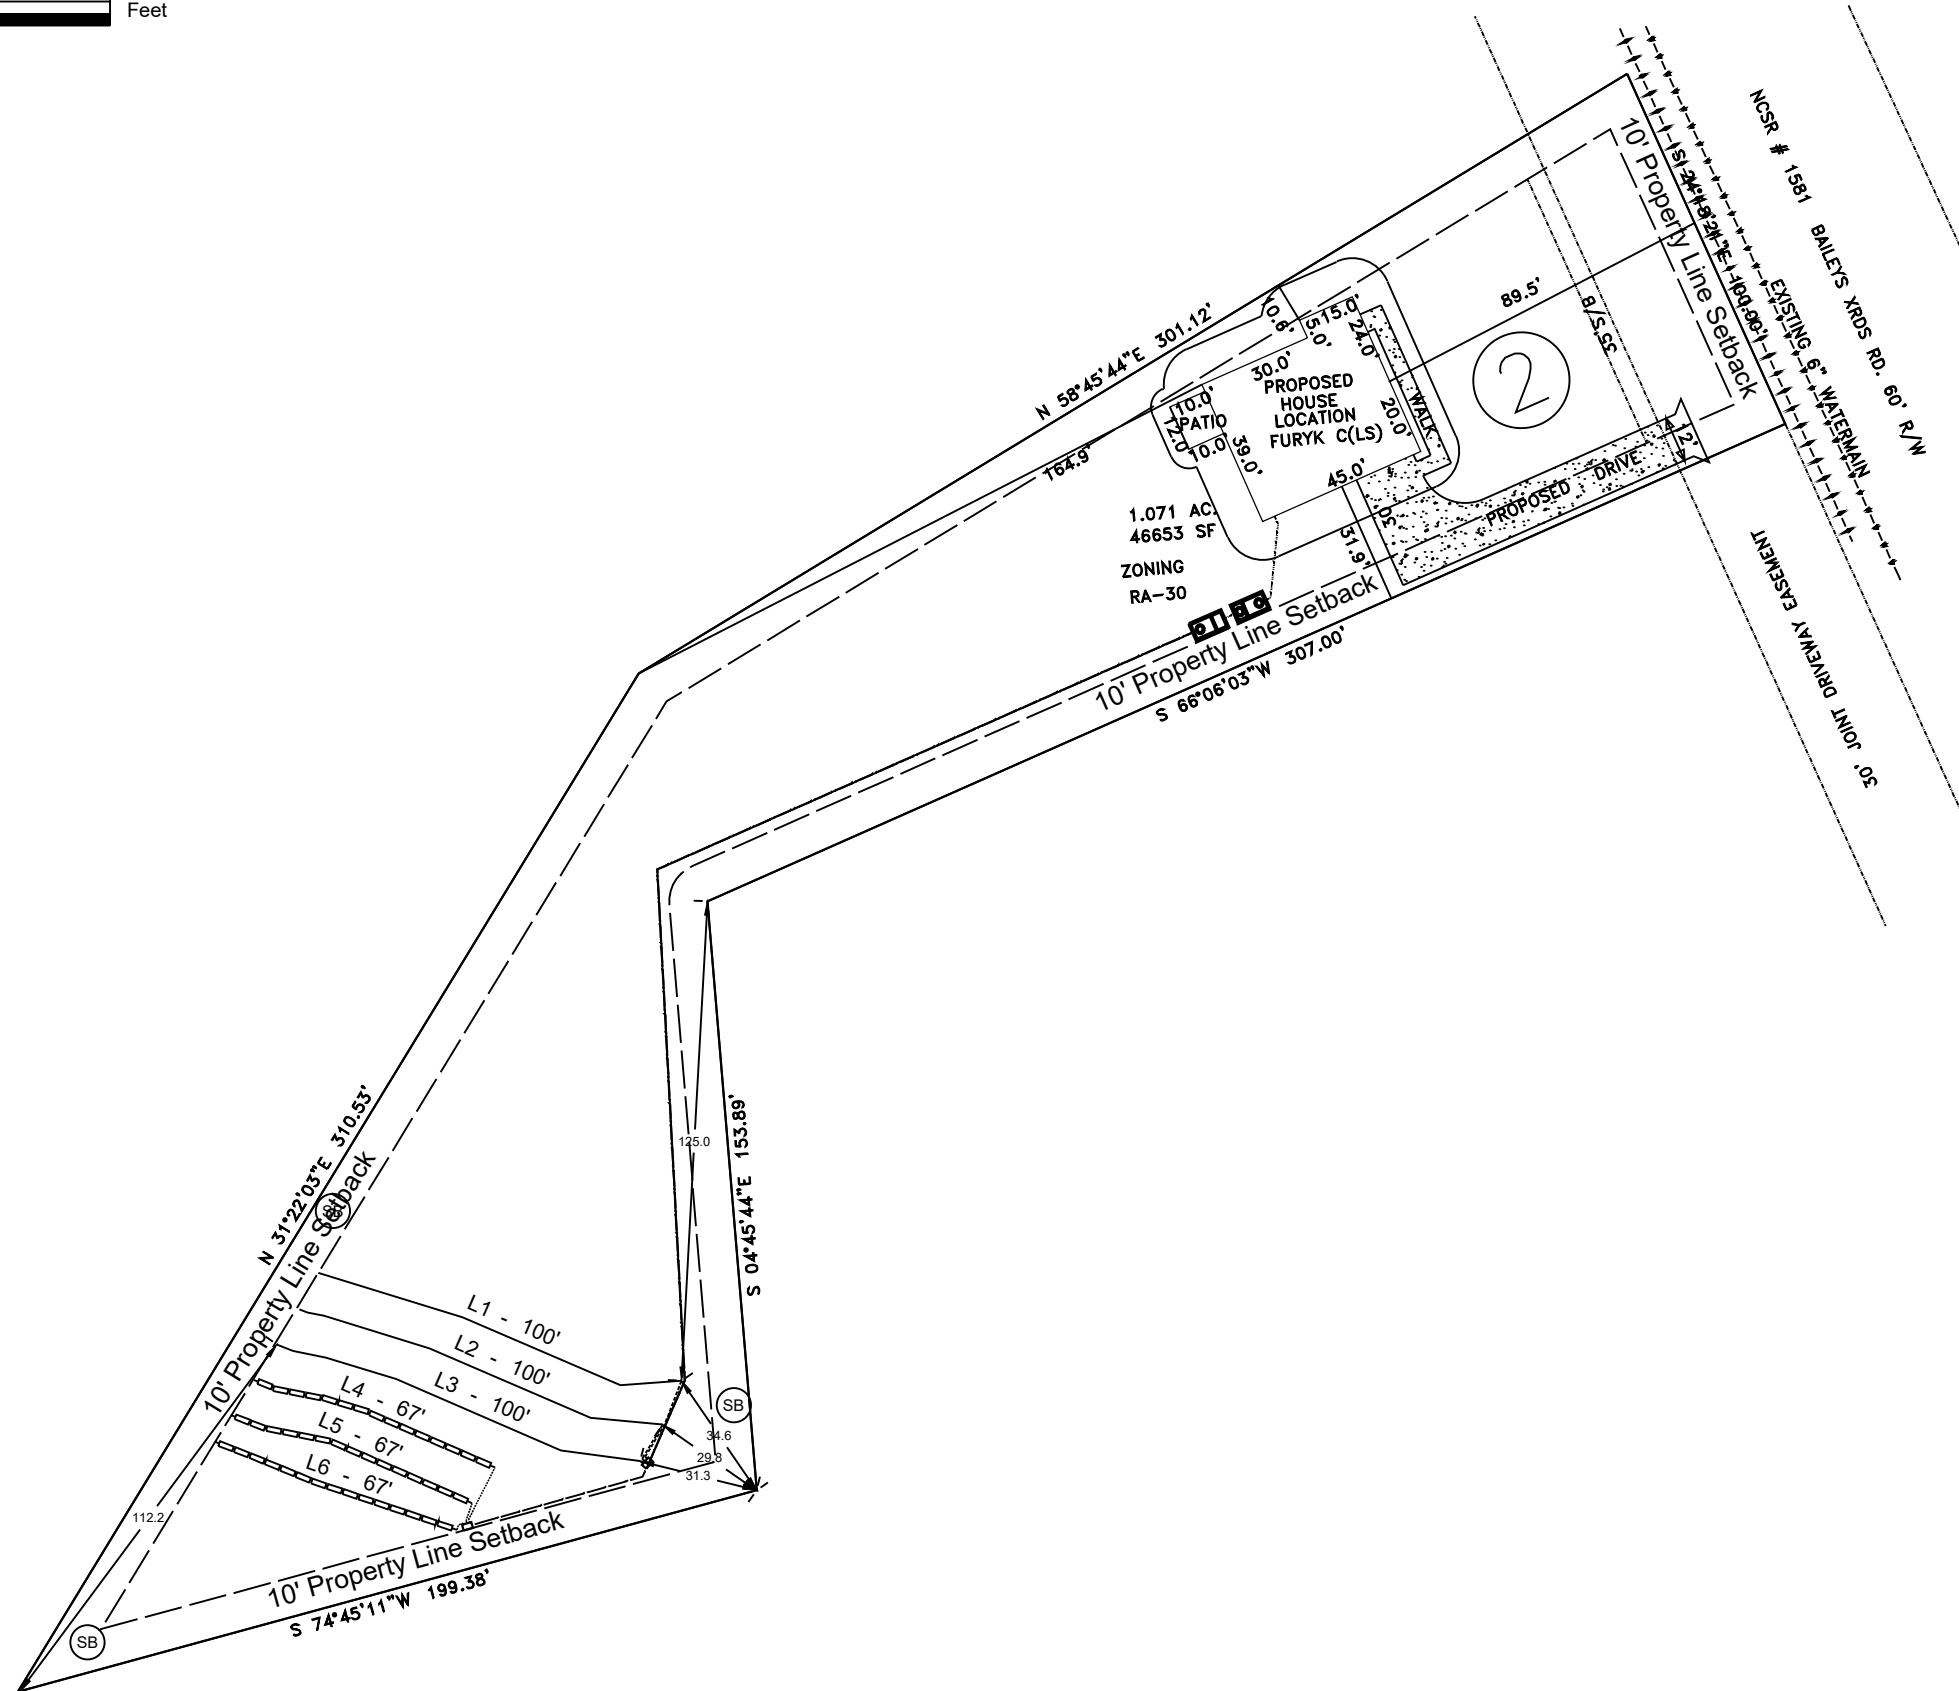

Engineers and Soil Scientists

Agri-Waste Technology, Inc.  
 501 N. Salem Street, Suite 203  
 Apex, North Carolina 27502  
 919-859-0669  
 www.agriwaste.com

RiverWILD Homes  
 Stewart Farms Lot 2

Project Location:  
 3943 Baileys XRDS Rd,  
 Benson, NC 27504  
 Harnett County  
 PIN: 1610-58-7651

Project Owner:  
 RiverWILD Homes  
 114 W Main St  
 Clayton, NC 27520  
 919-766-8782  
 brittany@staywild.com

NC ONSITE WASTEWATER  
 EVALUATOR SEAL



REV.	ISSUED DATE	DESCRIPTION

SHEET TITLE

Property Layout

DRAWN BY: H. Clapp	CREATED ON: 7/9/2024
REVISED BY: ####	REVISED ON: ####
RELEASED BY: ####	RELEASED ON: ####

DRAWING NUMBER


WW-2

**General Drainfield Notes:**

1. Clear all trees less than 8" in diameter (measured at a height 3' from soil surface) from the drainfield.
2. Vegetation that will re-grow from a cut stump shall be stumped or pulled from the ground. Stumps shall not be pushed over.
3. Drainfield area shall be cleared of all leaves, pine straw, debris, etc. The accumulated material shall be removed from the drainfield.
4. In clayey soils, sides of trenches shall be raked and limed per manufacturer's instructions.
5. Supply lines shall be installed with a minimum of 18" cover.
6. The trenches shall be backfilled appropriately so that no low areas are present.
7. Apply lime over the drainfield area as needed. Seed fine fescue over the drainfield at the rate recommended by the seed manufacturer. Hand rake the seed into the soil surface. Straw the seeded area at the rate of 1.5-2 bales per 1000 sq. ft.

**Note:**  
Primary distribution is pressure manifold utilizing accepted trench product.

DRAINFIELD INFO. - Primary						
Proposed Type of System/Distribution:		Pump to Pressure Manifold using EZflow				
Line No.	Flag Color	Line Length (ft)	Tap	Flow (gpm)	Flow/Foot (gpm/ft)	Line L.T.A.R.
1	red	100	1/2in SCH 40	7.11	0.071	0.533
2	white	100	1/2in SCH 40	7.11	0.071	0.533
3	blue	100	1/2in SCH 40	7.11	0.071	0.533
<b>Total</b>		<b>300</b>	<b>Total</b>	<b>21.33</b>	<b>Avg.</b>	<b>0.53</b>

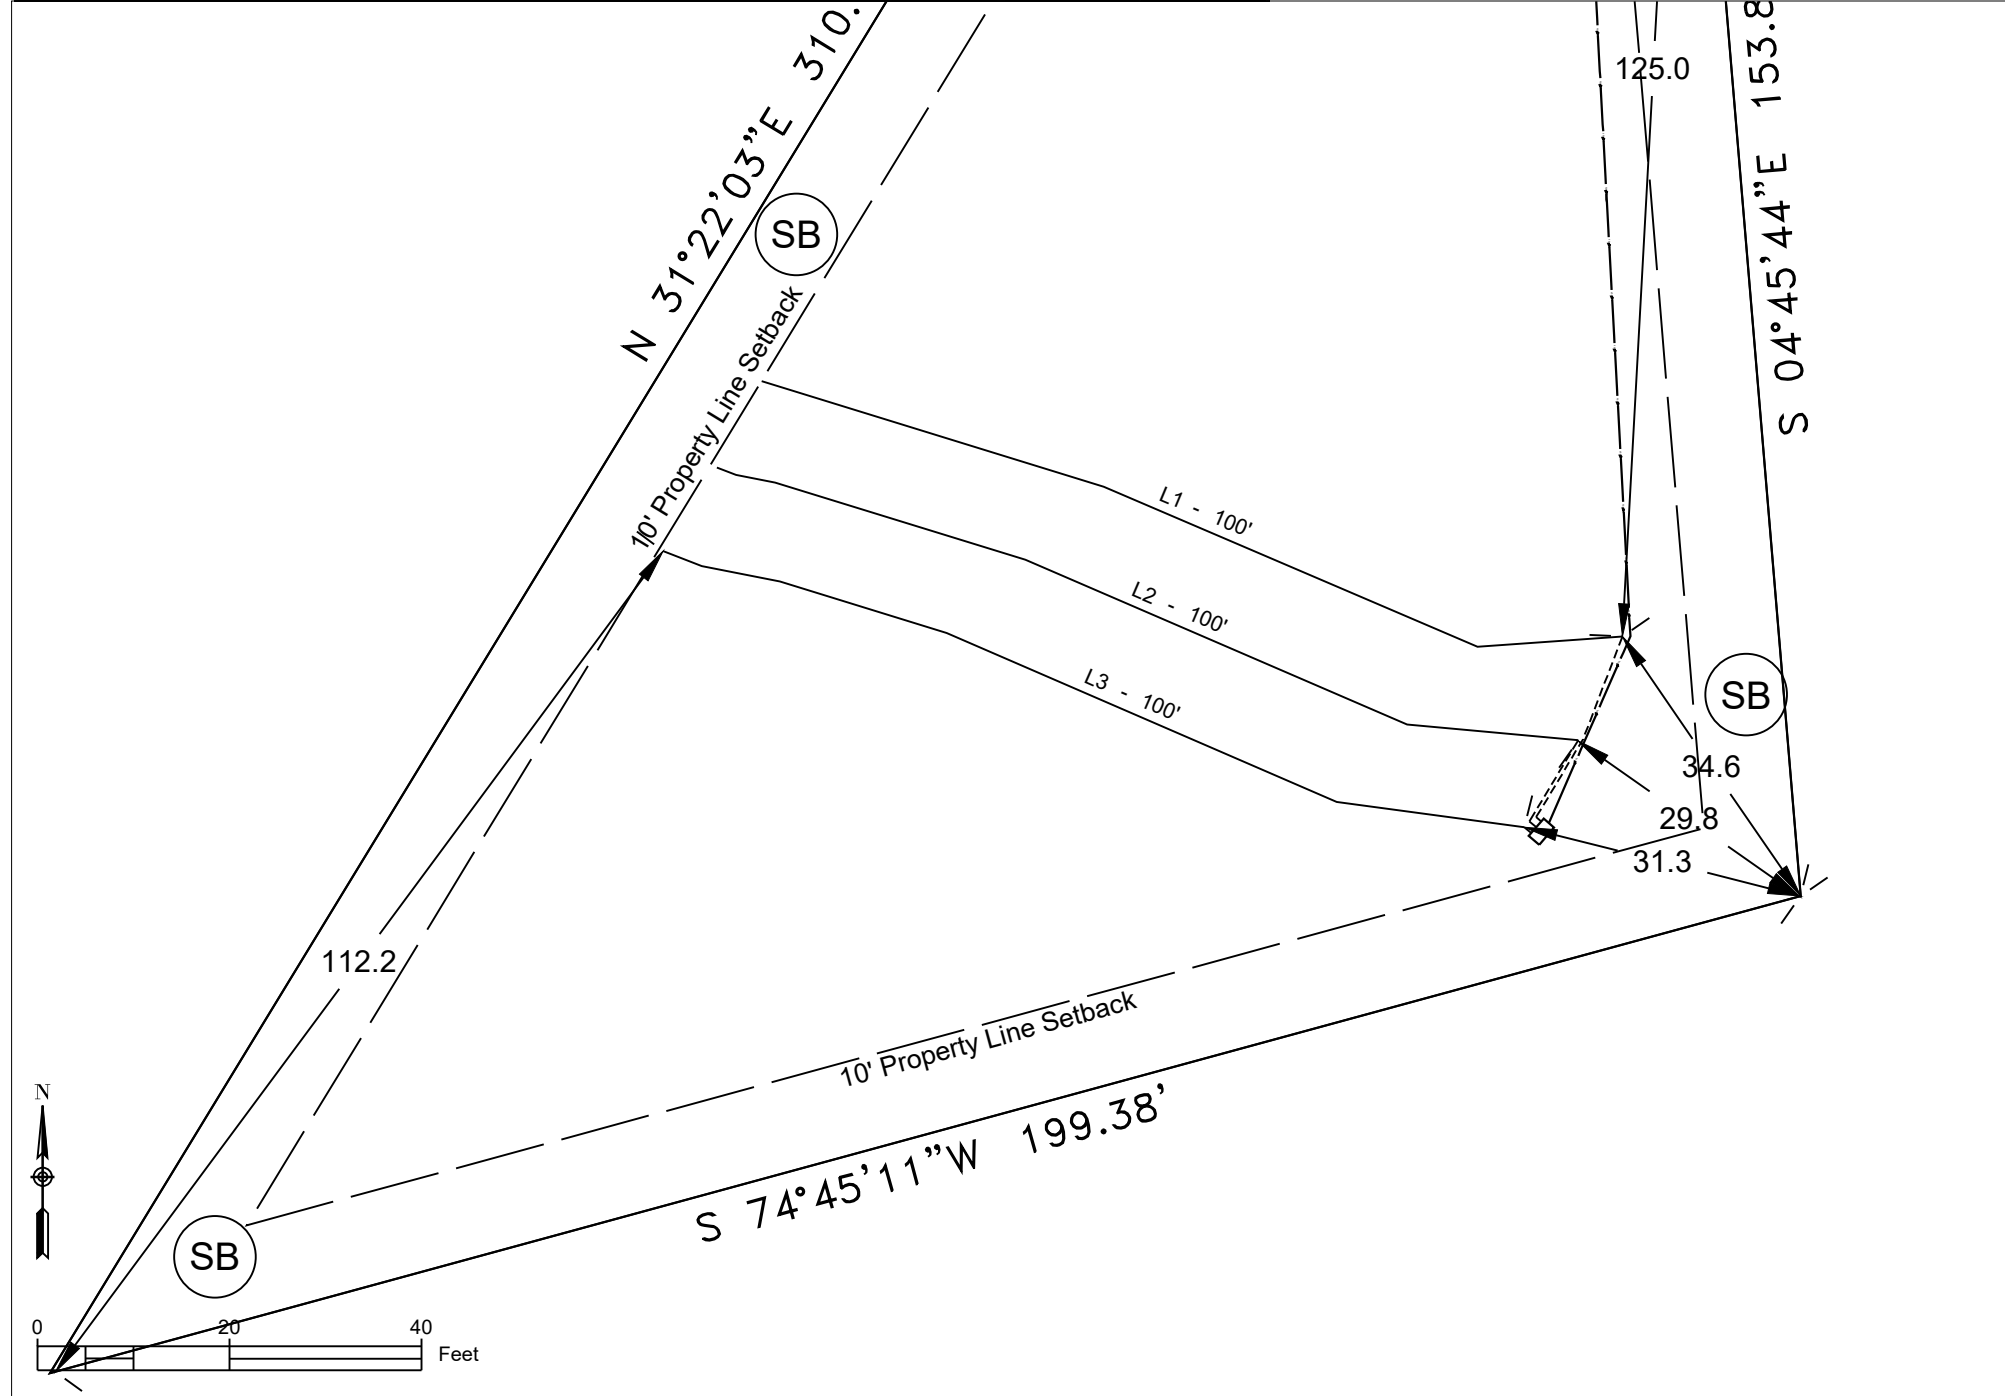

**1** Primary Drainfield  
SOURCE: Agri-Waste Technology, Inc.

RiverWILD Homes  
Stewart Farms Lot 2  
Project Location:  
3943 Baileys XRDS Rd,  
Benson, NC 27504  
Harnett County  
PIN: 1610-58-7651  
Project Owner:  
RiverWILD Homes  
114 W Main St  
Clayton, NC 27520  
919-766-8782  
brittany@staywild.com



REV.	ISSUED DATE	DESCRIPTION

SHEET TITLE  
Primary Drainfield

DRAWN BY: H. Clapp	CREATED ON: 7/9/2024
REVISED BY: ####	REVISED ON: ####
RELEASED BY: ####	RELEASED ON: ####


DRAWING NUMBER  
**WW-3**

**General Drainfield Notes:**

1. Clear all trees less than 8" in diameter (measured at a height 3' from soil surface) from the drainfield.
2. Vegetation that will re-grow from a cut stump shall be stumped or pulled from the ground. Stumps shall not be pushed over.
3. Drainfield area shall be cleared of all leaves, pine straw, debris, etc. The accumulated material shall be removed from the drainfield.
4. In clayey soils, sides of trenches shall be raked and limed per manufacturer's instructions.
5. Supply lines shall be installed with a minimum of 18" cover.
6. The trenches shall be backfilled appropriately so that no low areas are present.
7. Apply lime over the drainfield area as needed. Seed fine fescue over the drainfield at the rate recommended by the seed manufacturer. Hand rake the seed into the soil surface. Straw the seeded area at the rate of 1.5-2 bales per 1000 sq. ft.

**Note:**  
Repair distribution is pressure manifold utilizing PPBPS trench product.

DRAINFIELD INFO. - Repair						
Proposed Type of System/Distribution: <b>Pump to Pressure Manifold using PPBPS, Horizontal</b>						
Line No.	Flag Color	Line Length (ft.)		Flow (gpm)	Flow/Foot (gpm/ft)	Line L.T.A.R.
4	red	67	1/2in SCH 40	7.11	0.106	0.796
5	white	67	1/2in SCH 40	7.11	0.106	0.796
6	blue	67	1/2in SCH 40	7.11	0.106	0.796
<b>Total</b>		<b>201</b>		<b>Total 21.33</b>	<b>Avg. 0.106</b>	<b>0.80</b>

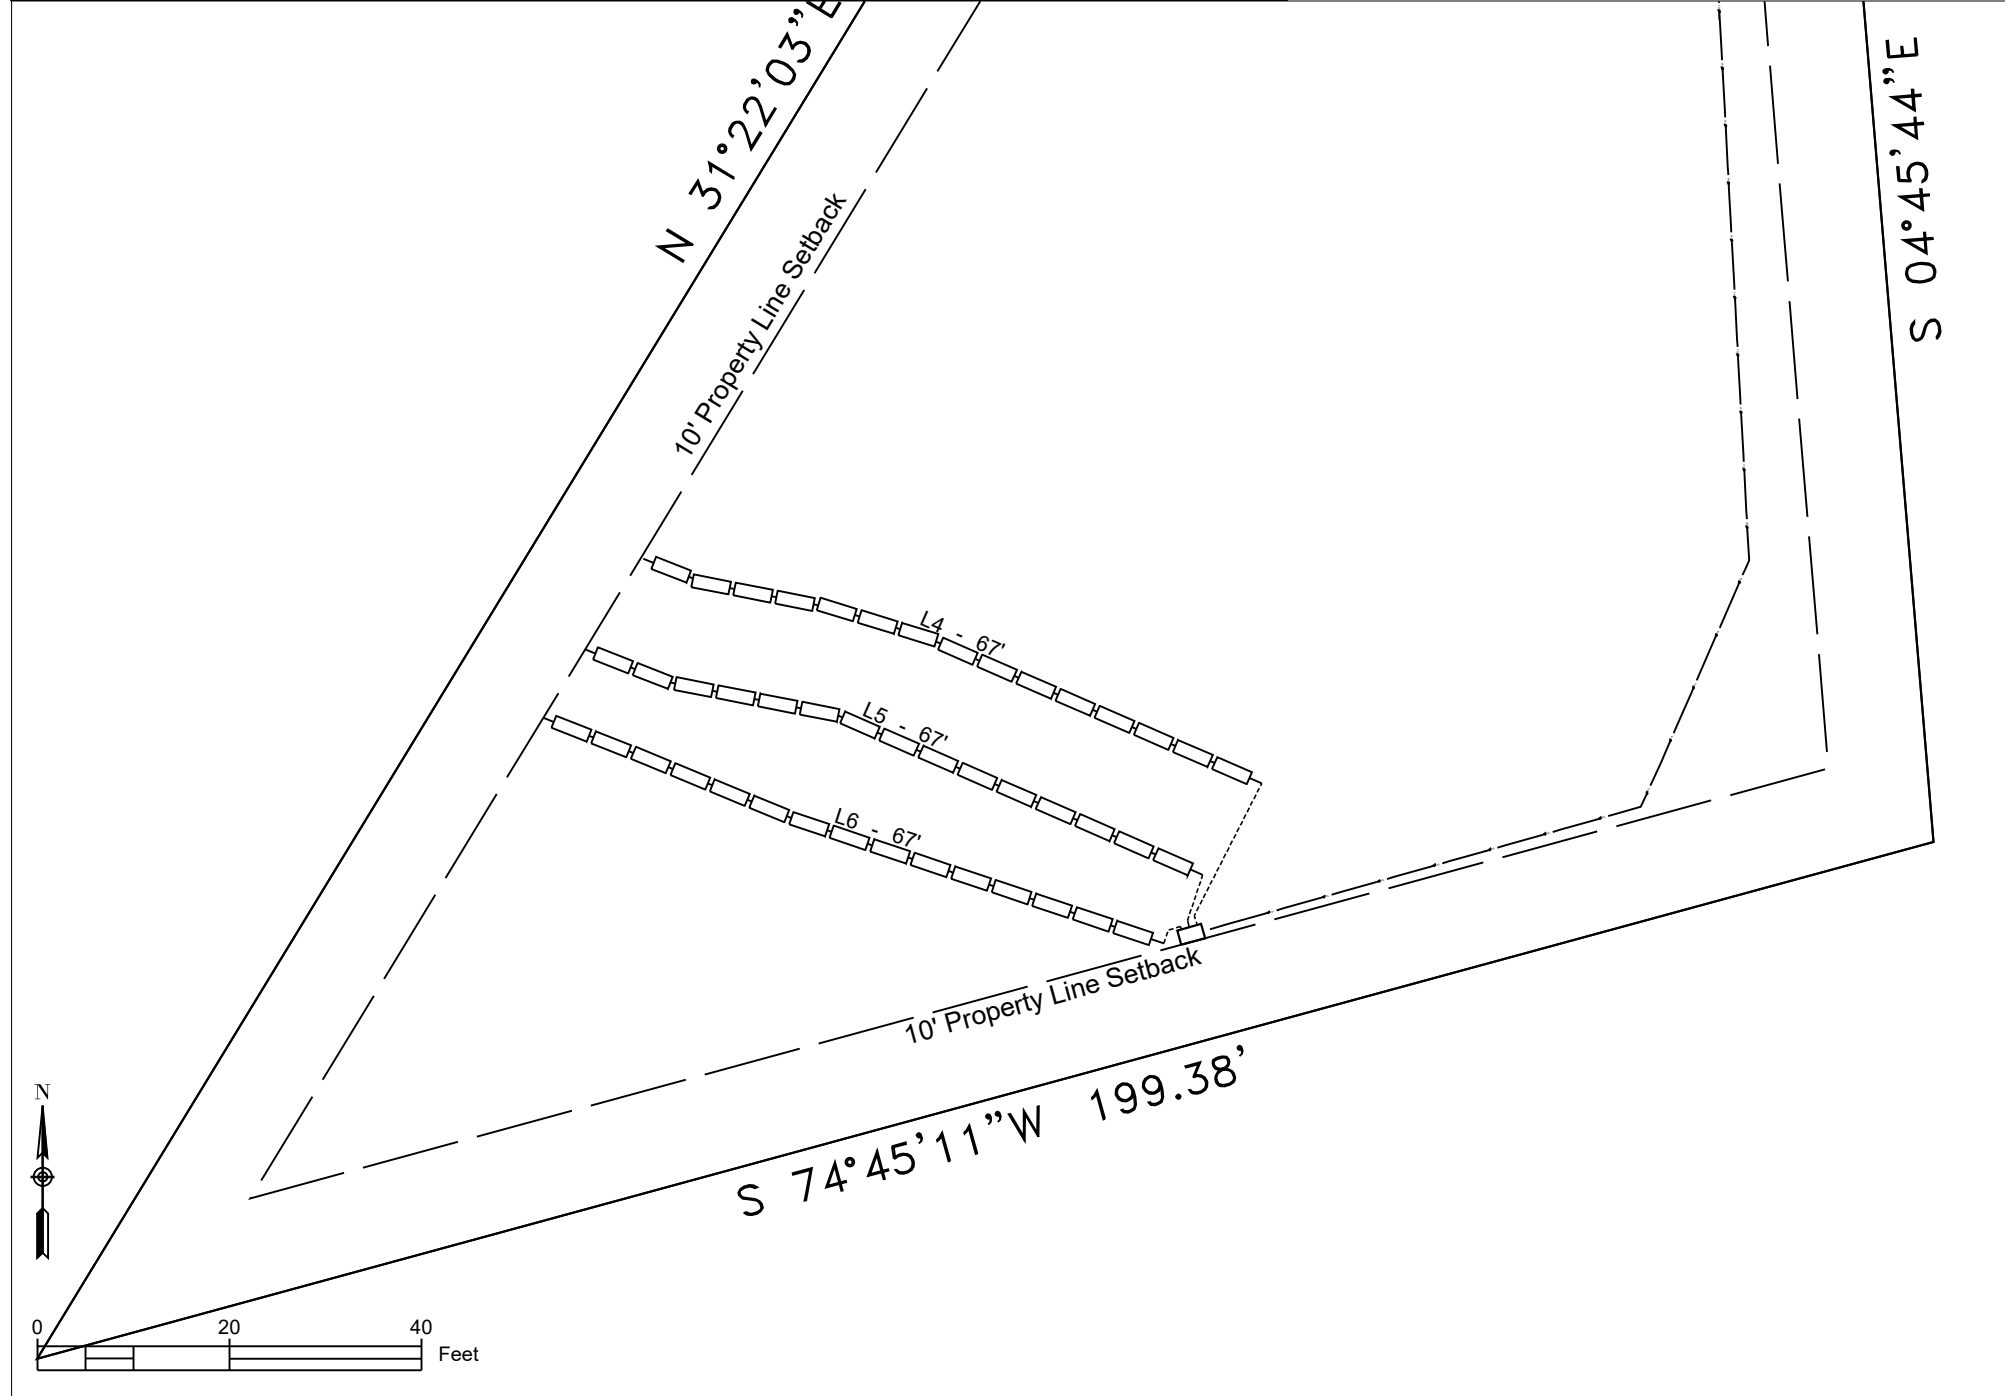

**1** Repair Drainfield  
SOURCE: Agri-Waste Technology, Inc.

RiverWILD Homes  
Stewart Farms Lot 2  
Project Location:  
3943 Baileys XRDS Rd,  
Benson, NC 27504  
Harnett County  
PIN: 1610-58-7651  
Project Owner:  
RiverWILD Homes  
114 W Main St  
Clayton, NC 27520  
919-766-8782  
brittany@staywild.com

NC ONSITE WASTEWATER  
EVALUATOR SEAL




REV.	ISSUED DATE	DESCRIPTION

SHEET TITLE  
Repair Drainfield

DRAWN BY: H. Clapp	CREATED ON: 7/9/2024
REVISED BY: ####	REVISED ON: ####
RELEASED BY: ####	RELEASED ON: ####

DRAWING NUMBER  
**WW-4**




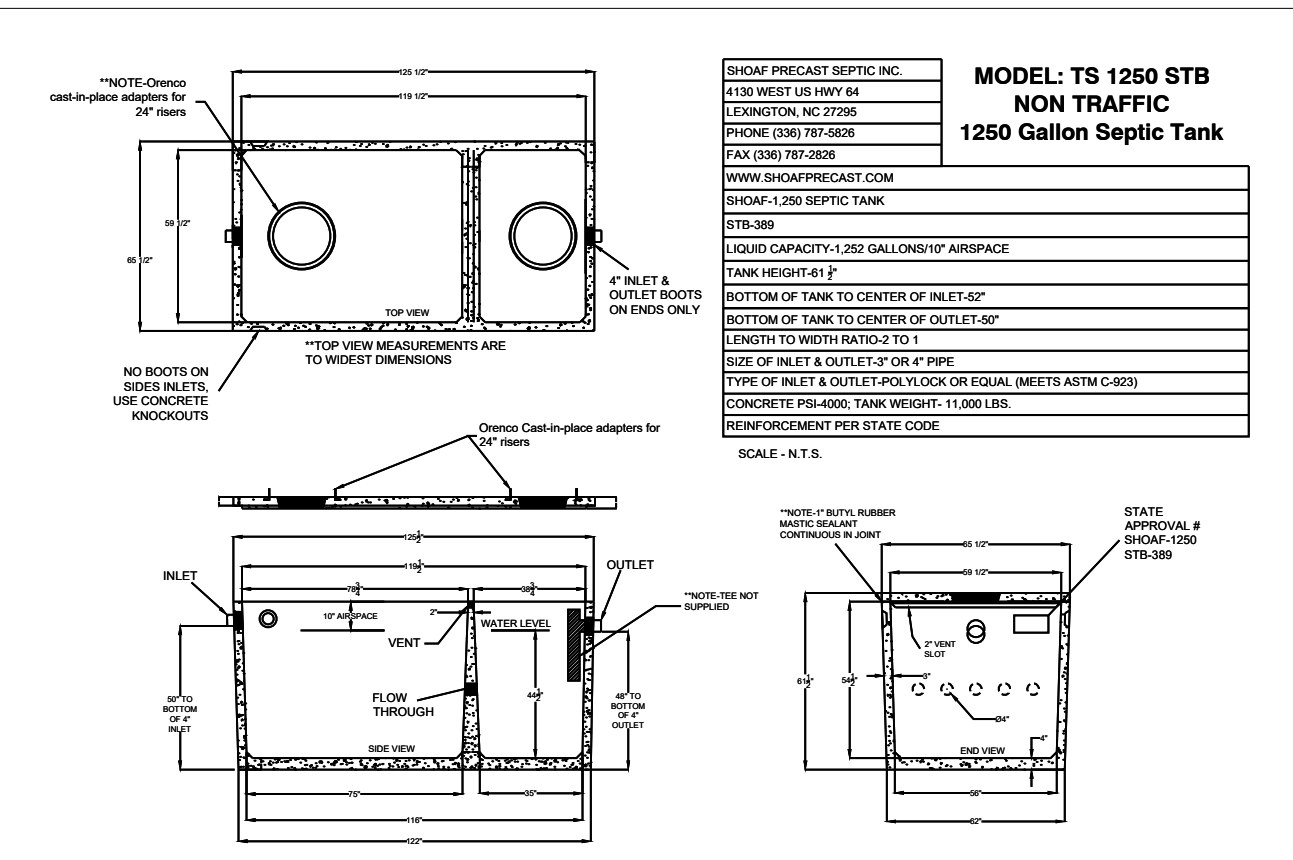

**SHOAF PRECAST SEPTIC INC.**  
4130 WEST US HWY 64  
LEXINGTON, NC 27295  
PHONE (336) 787-5826  
FAX (336) 787-2826  
WWW.SHOAFPRECAST.COM  
SHOAF-1,250 SEPTIC TANK  
STB-389  
LIQUID CAPACITY-1,252 GALLONS/10" AIRSPACE  
TANK HEIGHT-61 1/2"  
BOTTOM OF TANK TO CENTER OF INLET-52"  
BOTTOM OF TANK TO CENTER OF OUTLET-50"  
LENGTH TO WIDTH RATIO-2 TO 1  
SIZE OF INLET & OUTLET-3" OR 4" PIPE  
TYPE OF INLET & OUTLET-POLYLOCK OR EQUAL (MEETS ASTM C-923)  
CONCRETE PSI-4000; TANK WEIGHT- 11,000 LBS.  
REINFORCEMENT PER STATE CODE  
SCALE - N.T.S.

1 Septic Tank

SOURCE: Shoaf Precast Septic, Inc.

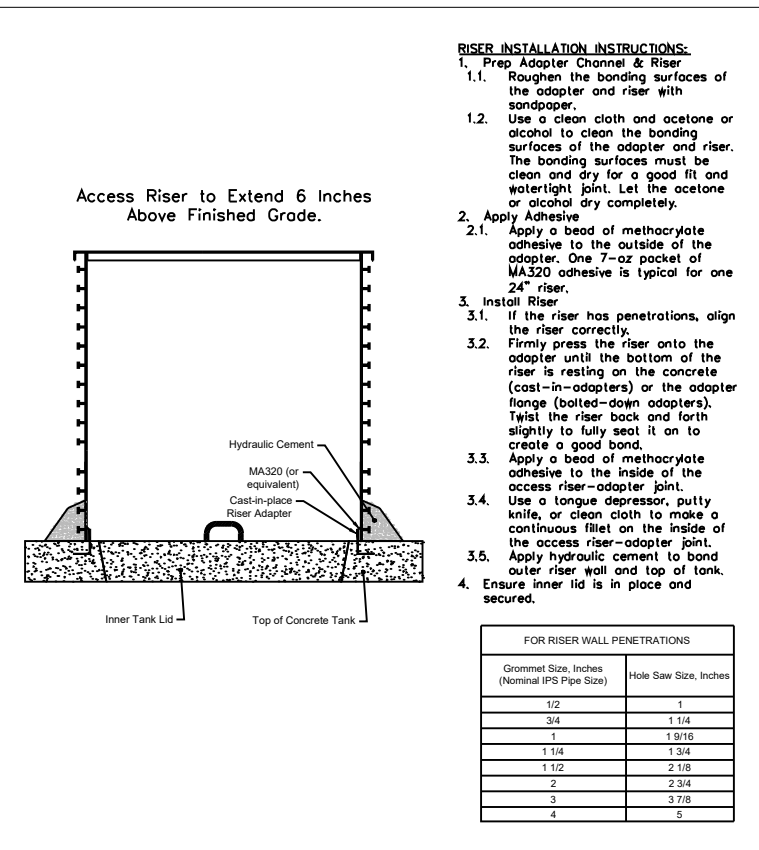


**RISER INSTALLATION INSTRUCTIONS:**

1. Prep Adapter Channel & Riser
  - 1.1. Roughen the bonding surfaces of the adapter and riser with sandpaper.
  - 1.2. Use a clean cloth and acetone or alcohol to clean the bonding surfaces of the adapter and riser. The bonding surfaces must be clean and dry for a good fit and watertight joint. Let the acetone or alcohol dry completely.
2. Apply Adhesive
  - 2.1. Apply a bead of methacrylate adhesive to the outside of the adapter. One 7-oz packet of MA320 adhesive is typical for one 24" riser.
3. Install Riser
  - 3.1. If the riser has penetrations, align the riser correctly.
  - 3.2. Firmly press the riser onto the adapter until the bottom of the riser is resting on the concrete (cast-in-adapters) or the adapter flange (bolted-down adapters). Twist the riser back and forth slightly to fully seat it on to create a good bond.
  - 3.3. Apply a bead of methacrylate adhesive to the inside of the access riser-adapter joint.
  - 3.4. Use a tongue depressor, putty knife, or clean cloth to make a continuous fillet on the inside of the access riser-adapter joint.
  - 3.5. Apply hydraulic cement to bond outer riser wall and top of tank.
4. Ensure inner lid is in place and secured.

FOR RISER WALL PENETRATIONS	
Grommet Size, Inches (Nominal IPS Pipe Size)	Hole Saw Size, Inches
1/2	1
3/4	1 1/4
1	1 9/16
1 1/4	1 3/4
1 1/2	2 1/8
2	2 3/4
3	3 7/8
4	5

3 Riser Installation

WW-5

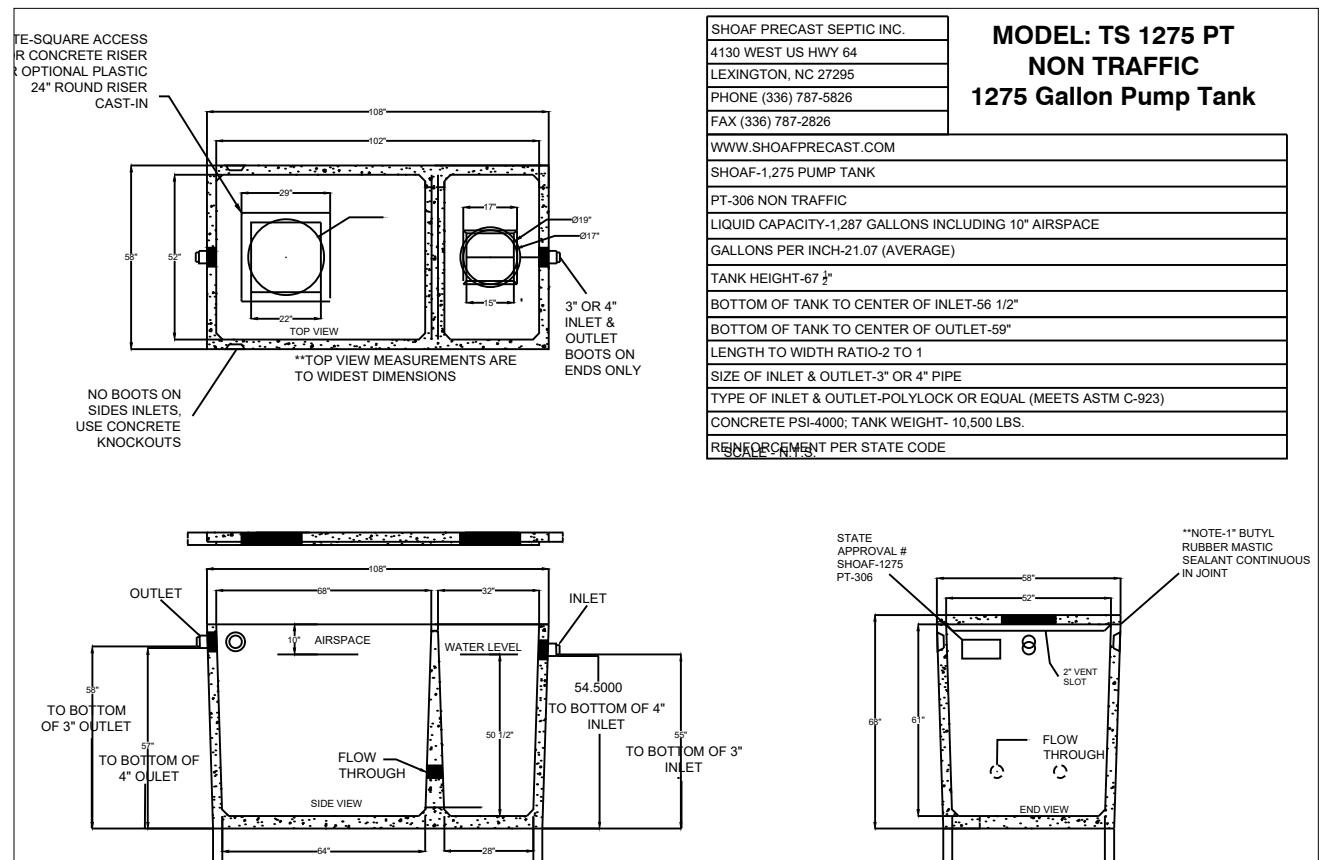


**SHOAF PRECAST SEPTIC INC.**  
4130 WEST US HWY 64  
LEXINGTON, NC 27295  
PHONE (336) 787-5826  
FAX (336) 787-2826  
WWW.SHOAFPRECAST.COM  
SHOAF-1,275 PUMP TANK  
PT-306 NON TRAFFIC  
LIQUID CAPACITY-1,287 GALLONS INCLUDING 10" AIRSPACE  
GALLONS PER INCH-21.07 (AVERAGE)  
TANK HEIGHT-67 1/2"  
BOTTOM OF TANK TO CENTER OF INLET-56 1/2"  
BOTTOM OF TANK TO CENTER OF OUTLET-59"  
LENGTH TO WIDTH RATIO-2 TO 1  
SIZE OF INLET & OUTLET-3" OR 4" PIPE  
TYPE OF INLET & OUTLET-POLYLOCK OR EQUAL (MEETS ASTM C-923)  
CONCRETE PSI-4000; TANK WEIGHT- 10,500 LBS.  
REINFORCEMENT PER STATE CODE

2 Pump Tank (or equiv. tank with 1-day storage)

SOURCE: Shoaf Precast Septic, Inc.


**NOTES**

1. Installation to follow all NC DHHS and Harnett County applicable rules and regulations.
2. AWT to perform construction inspections and final system certification.
3. Septic Tank to have approved effluent filter.
4. Contractor to abide by all safety regulations during system installation.
5. Contractor shall backfill around all access areas such that storm water is shed away from potential entry points.
6. Invert elevations of all components to be verified in field by contractor to insure proper operation.
7. All system piping to be SCH40 PVC (except where noted).
8. All gravity elbows to be long radius or long sweeping type elbows.
9. Actual installation and placement of treatment system to be overseen by Contractor.
10. Tanks to be set on 6" minimum gravel base. Use #5 or #57 stone for base.
11. Contractor to seed and/or mulch disturbed areas to coincide with existing landscape. Area shall not be left with uncovered soil.
12. Mount Control Panel a minimum of 24" above grade.
13. Power to panel to be installed by licensed electrician per code. One 15-amp circuit and one 20-amp circuit with individual neutrals to be run from house to control panel.
14. All risers to have cast-in-place tank adapters and be single-piece riser. Risers to extend 6" above soil surface and be designed to prevent surface water inflow.
15. Backfill around tank(s) shall be gravel or tank hole shall be over-excavated a minimum of 2' in all directions to allow for mechanical tamping of backfill.
16. All penetrations to be sealed.
17. All pressure lines to maintain 18" min. cover.
18. Contractor to adjust tank placement to meet site constraints.

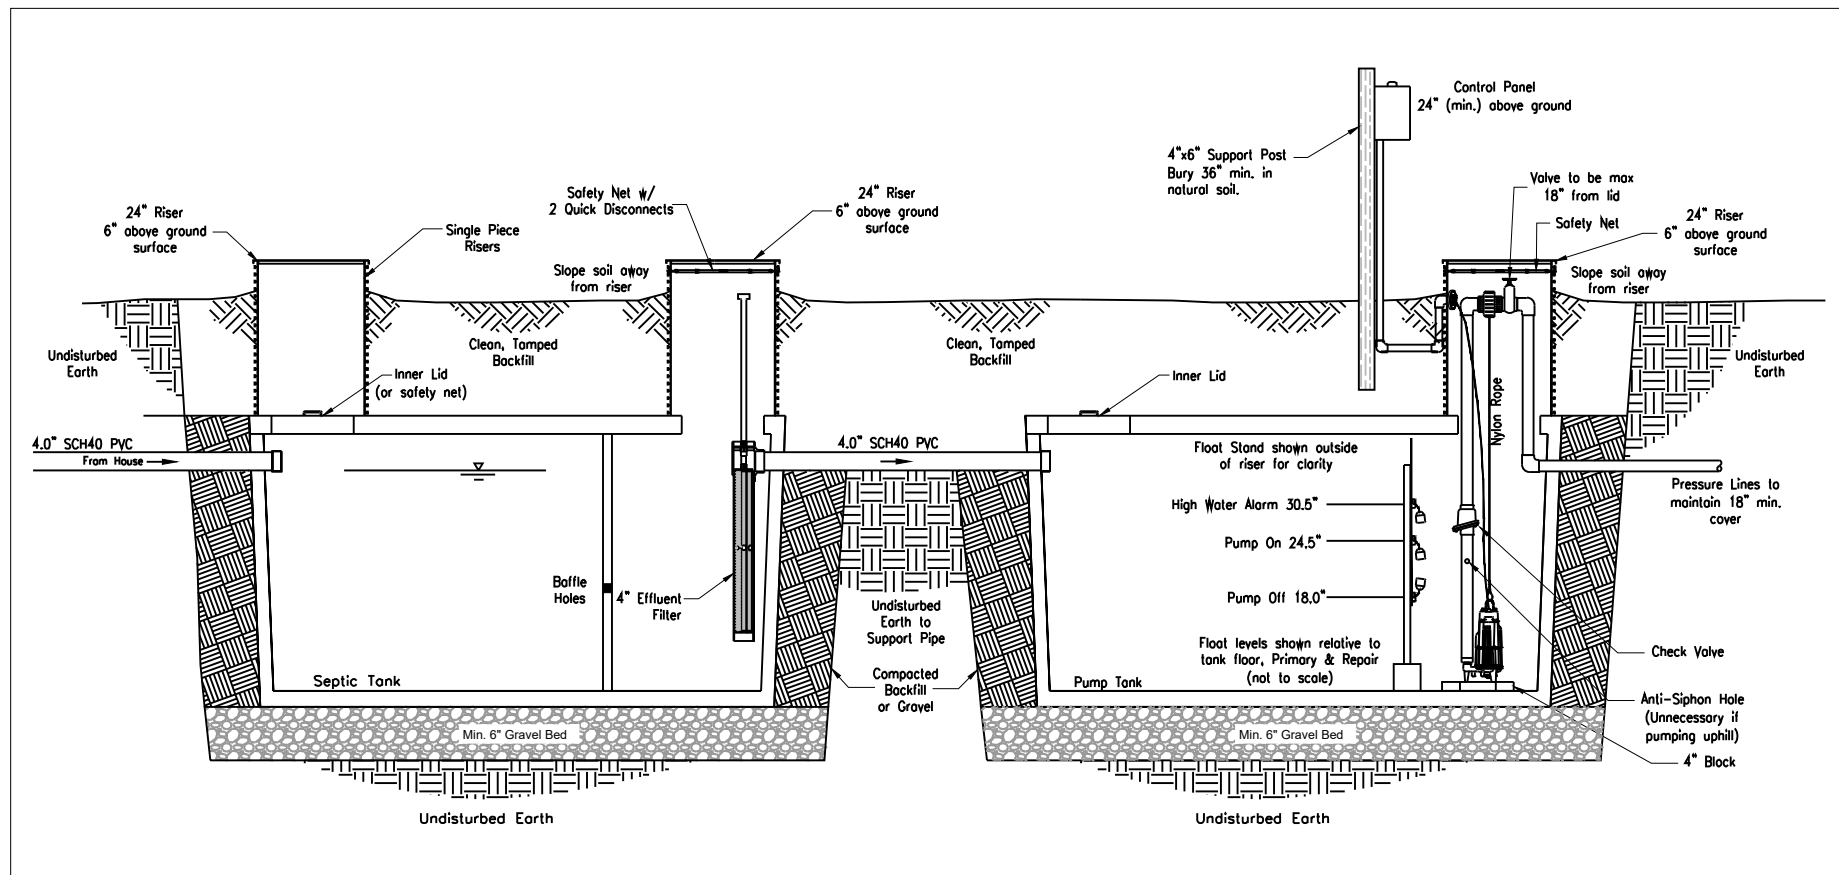


1 SYSTEM PROFILE VIEW

WW-6 N.T.S.

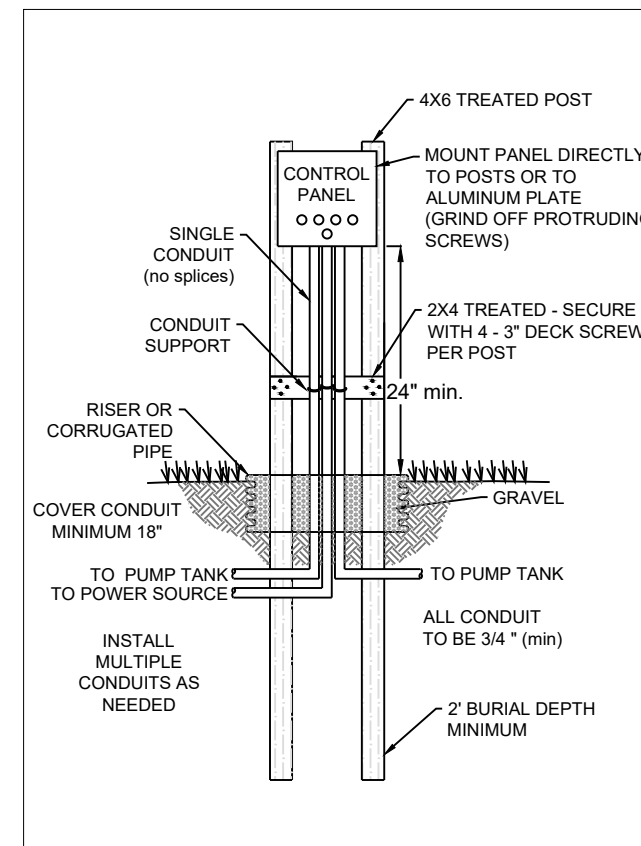


6 CONTROL PANEL SUPPORT

WW-6 N.T.S. SOURCE: AWT

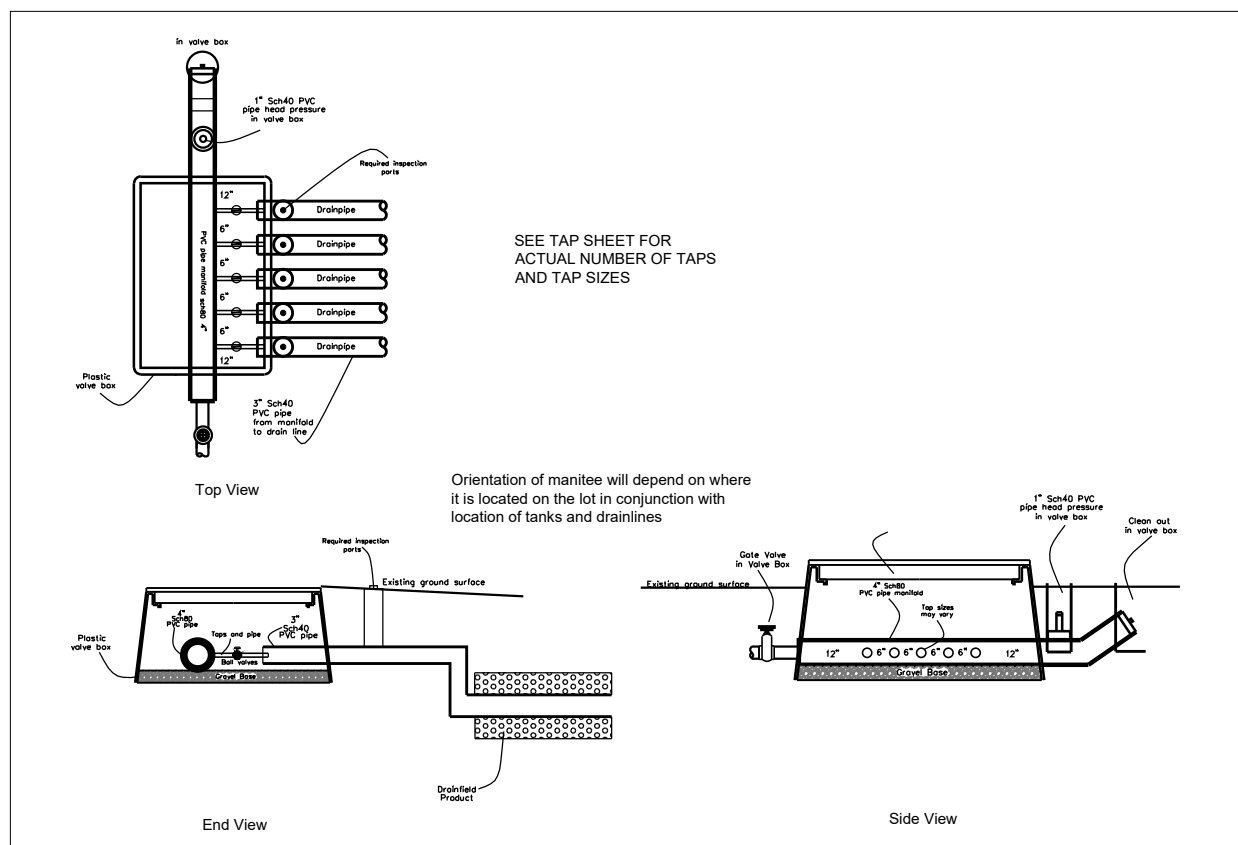

4 PRESSURE MANIFOLD INSTALLATION (Manitee) - For Illustration Only

WW-6 N.T.S. SOURCE: AWT

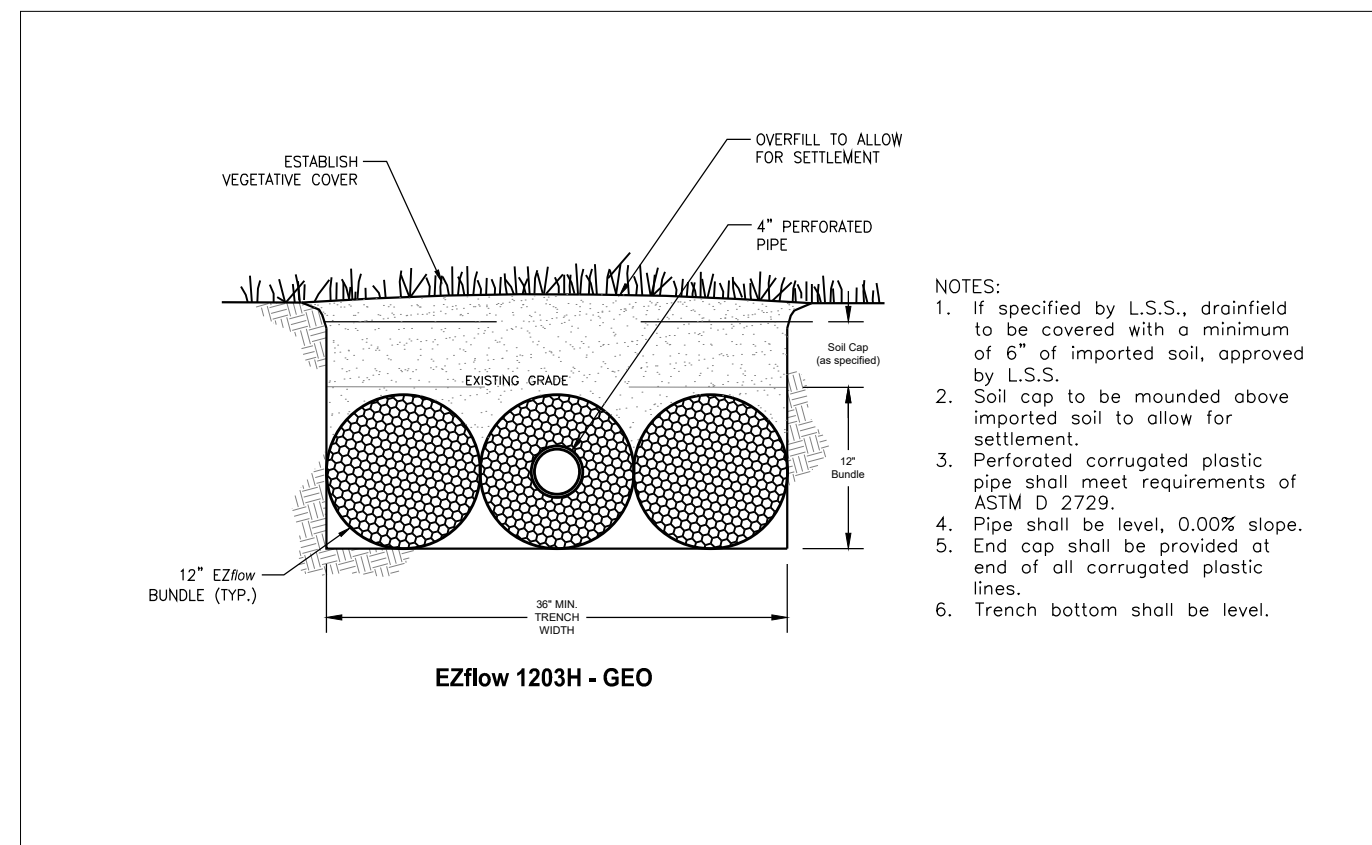

2 TRENCH X-SECTION (Typical)

WW-6 N.T.S. Source: AWT

- NOTES:
1. If specified by L.S.S., drainfield to be covered with a minimum of 6" of imported soil, approved by L.S.S.
  2. Soil cap to be mounded above imported soil to allow for settlement.
  3. Perforated corrugated plastic pipe shall meet requirements of ASTM D 2729.
  4. Pipe shall be level, 0.00% slope.
  5. End cap shall be provided at end of all corrugated plastic lines.
  6. Trench bottom shall be level.

REV.	ISSUED DATE	DESCRIPTION

SHEET TITLE

Detail Sheet 2

DRAWN BY: H. Clapp

CREATED ON: 7/9/2024

REVISED BY: #####

REVISED ON: #####

RELEASED BY: #####

RELEASED ON: #####

DRAWING NUMBER

WW-6

## Septic System Design - Summary Page



Agri-Waste Technology, Inc.  
501 N Salem Street, Suite 203, Apex, NC 27502  
agriwaste.com | 919.859.0669

### Project Manager:

Trent Bostic, AOWE, LSS  
tbostic@agriwaste.com  
919-367-6322

### Designer:

Heath Clapp, LSS  
#N/A

**Project:** Stewart Farms  
**Property:** 3981 Baileys XRDS Rd,  
Benson, NC 27504

**Subdiv.:** Stewart Farms  
**Lot #:** 2

**Owner:** RiverWild Homes  
**Address:** 114 W Main Street  
Clayton, NC 27520

**Phone:** 9.198E+09  
**Email:** brittany@staywild.com

**EHS:**

**Date:** 7/8/2024

**County:** Harnett

**Permit #:**

**Type of System:** III bg

**PIN:** 1610-58-7651

## Soil Parameters

### Soil Evaluation By:

Trent Bostic, AOWE, LSS

### Special Conditions/Notes:

**LTAR:** 0.40 gpd/ft<sup>2</sup>

## Design Parameters

**Type of Establishment:** Dwelling Units, no more than 2 persons per bedroom

**Unit:** Bedroom

**# of Units:** 4

## Septic Tank Specifications

<b>Min. Tank Capacity:</b>	1,000 gal	<b>Exterior</b>	<b>Interior</b>
<b>Actual Tank Volume:</b>	1,250 gal	<b>Length:</b>	125.5 119.5 in.
<b>Tank Manufacturer:</b>	Shoaf	<b>Width:</b>	65.5 59.5 in.
<b>Tank Model:</b>	TS 1250 STB	<b>Depth:</b>	61.5 54.5 in.

## Primary Drainfield Specifications

<b>Type of Distribution:</b>	Parallel Pressure Manifold	<b>Trench Bottom Area:</b>	1200 ft <sup>2</sup>
<b>Trench Media:</b>	EZflow	<b>Minimum Drain Line:</b>	300 ft
<b>Trench Width:</b>	3 ft	<b>Actual Drain Line:</b>	300 ft
<b>Trench Depth:</b>	18 in.	<b>Number of Lines:</b>	3
<i>(or as specified on permit)</i>		<b>Minimum Line Spacing:</b>	9 ft O.C.

# Wastewater Treatment System Design Calculations

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

## Septic Tank Sizing

Daily Flow Estimate:

Unit	# of Units	Flow/Unit	Flow/Day
Bedroom	4	120	480

Q= 480 gpd

Septic Tank Minimum Capacity:

Per NCAC T15A:18A .1952(b)(2)(A):

For large residences, multiple dwelling units, or places of business or public assembly with  $Q \leq 600$ ,

Minimum Liquid Capacity (V)= 1,000 gal

Septic Tank Specs:

Manufacturer: Shoaf  
 Model: TS 1250 STB  
 Volume: 1,250 gal  
 Weight: 11,000 lbs

	Exterior	Interior	
Length:	125.5	119.5	in.
Width:	65.5	59.5	in.
Depth:	61.5	54.5	in.

Shape of Risers: Circular

Diameter: 2.00 ft

## Pump Tank Storage & Float Settings

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

Tank Manufacturer	Shoaf
Tank Model	TS 1275 PT

<b>Interior Height (in.)</b>	<b>60.5 in.</b>
<b>Avg. Storage</b>	<b>21.07 gal/in.</b>
<b><u>Primary System</u></b>	
<b><u>Elevations, measured from bottom towards top (0 = Interior Bottom of Tank):</u></b>	
Top of pump (including 4" block)	16.1 in. (Pump height = 12 1/16")
Pump Off	18.0 in.
Pump On	24.5 in. (set for dose volume)
Alarm On	30.5 in. (6 in. above On Float)
Emergency Storage Available	
Pump Tank	632 gal
Days of Storage	1.32 days
(determined from "interior top of tank" - "High Water Alarm")	
<b><u>Repair System</u></b>	
<b><u>Elevations, measured from bottom towards top (0 = Interior Bottom of Tank):</u></b>	
Top of pump (including 4" block)	16.1 in. (Pump height = 12 1/16")
Pump Off	18.0 in.
Pump On	29.0 in. (set for dose volume)
Alarm On	35.0 in. (6 in. above On Float)
Emergency Storage Available	
Pump Tank	537 gal
Days of Storage	1.12 days
(determined from "interior top of tank" - "High Water Alarm")	

## ELEVATIONS

Project: Stewart Farms  
 Location: 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
 County: Harnett

**Benchmark** 0  
**BM Elev** 0 ft

**Septic Tank** 1,250 gal

Ground Surface		303.03 ft
Depth of Soil Cover	12 in.	1.00 ft
Overall Ht of Tank	61.5 in.	5.13 ft
Elev, Base of Tank		296.91 ft
Ht to 4" Inlet Invert	50 in.	4.17 ft
Elev, 4" Inlet Invert		301.07 ft
Ht to 4" Outlet Invert	48 in.	4.00 ft
Elev, 4" Outlet Invert		300.91 ft
Gravel Base	6 in.	0.50 ft
Elev, Bot of Excavation		296.41 ft

**Pump Tank** 1287 gal

Ground Surface		302.70 ft
Depth of Soil Cover	12 in.	1.00 ft
Overall Ht of Tank	67.5 in.	5.63 ft
Elev, Base of Tank		296.08 ft
Ht to 4" Inlet Invert	57 in.	4.75 ft
Elev, 4" Inlet Invert		300.83 ft
Ht to 2" Outlet Invert	54.5 in.	4.54 ft
Elev, 2" Outlet Invert		300.62 ft
Gravel Base	6 in.	0.50 ft
Elev, Bot of Excavation		295.58 ft

**ST Inlet Pipe**

Grade @ Stub-out		303.1 ft
Depth of Stub-out, top		1.5 ft
Elev, Stub-out Invert		301.25 ft
Elev @ ST Inlet Invert		301.07 ft
Length		6.5 ft
Slope		2.7 %

**Pipe, ST to PT**

ID	4 in.	0.33 ft
OD	4.5 in.	0.38 ft
Elev, ST Outlet Invert		300.91 ft
Elev, PT Inlet Invert		300.83 ft
Length		5 ft
Slope		1.6 %
Cover over inlet pipe		1.60 ft

**Pump Reqmt.**

Floor Thickness	4 in.	0.33 ft
Elev, Pump Tank Floor		296.41 ft
Pump Block Ht.	4 in.	0.33 ft
Elev, Pump Intake		296.74 ft

Grade @ Primary Manifold		304.40 ft
Grade @ Repair Manifold		305.20 ft
Min. Cover	18 in.	1.50 ft
Max Elev, Primary		302.90 ft
Max Elev, Repair		303.70 ft
Elev Diff, Primary		6.16 ft
Elev Diff, Repair		6.96 ft

## Drainfield Design

**Project** Stewart Farms  
**Location** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County** Harnett

## Drainfield Sizing

### Primary

<b>LTAR</b>	0.4 gpd/ft <sup>2</sup>	<b>Type of Drainfield Media</b>	EZflow
<b>Daily Design Flow</b>	480 gpd	<b>Required Drainline</b>	
<b>Req. Drainfield Area</b>	1,200 ft <sup>2</sup>	<b>After 25% Reduction</b>	300 ft
<b>Trench Width, Eff.</b>	3 ft	<b>Minimum Line Spacing</b>	9 ft (O.C.)
<b>Required Drainline</b>	400 ft		

### Repair

<b>LTAR</b>	0.4 gpd/ft <sup>2</sup>	<b>Type of Drainfield Media</b>	PPBPS, Horizontal
<b>Daily Design Flow</b>	480 gpd	<b>Required Drainline</b>	
<b>Req. Drainfield Area</b>	1,200 ft <sup>2</sup>	<b>After 50% Reduction</b>	200 ft
<b>Trench Width, Eff.</b>	3 ft	<b>Minimum Line Spacing</b>	8 ft (O.C.)
<b>Required Drainline</b>	400 ft		

## Drainfield Layout

Line	Use	Flag Color	Elevation (ft)	Line Length (ft)	Used as Primary (ft)	Used as Repair (ft)
1	Layout Line	red	304.0	100	100.0	
2	Layout Line	white	304.2	100	100.0	
3	Layout Line	blue	304.6	100	100.0	
4	Layout Line	red	304.8	67		67.0
5	Layout Line	white	304.9	67		67.0
6	Layout Line	blue	305.2	67		67.0
<b>Total</b>				501	300	201
<b>Count</b>				6	3	3

Note: Line length totals are shown to the nearest foot.

## PRESSURE MANIFOLD DESIGN (Primary)

### Site Information

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

### Design Information

Estimated Daily Flow	480 gal/day
L.T.A.R. (from Harnett Co.)	0.4 gal/day/ft <sup>2</sup>
L.T.A.R. + 5%	0.420 gal/day/ft <sup>2</sup>
Trench Width	3 ft.
Line Length Required	400 ft.
Length after 25% Reduction	300 ft
L.T.A.R. Reduced	0.533 gal/day/ft <sup>2</sup>
L.T.A.R. Reduced + 5%	0.560 gal/day/ft <sup>2</sup>

### DRAINFIELD INFO. - Primary

Proposed Type of System/Distribution: **Pump to Pressure Manifold using EZflow**

Line No.	Flag Color	Line Length (ft)	Tap	Flow (gpm)	Flow/Foot (gpm/ft)	Line L.T.A.R.
1	red	100	1/2in SCH 40	7.11	0.071	0.533
2	white	100	1/2in SCH 40	7.11	0.071	0.533
3	blue	100	1/2in SCH 40	7.11	0.071	0.533
<b>Total</b>		<b>300</b>	<b>Total</b>	<b>21.33</b>	<b>Avg.</b>	<b>0.53</b>

Note: Line lengths are calculated in 4'4" increments to reflect use of PPBPS product.

Total Run Time	22.50 min.	
Drainfield Capacity	195.9 gal	
% of Drainfield Cap	69.0%	(Req. Range 66-75%)
Dose Volume	135.2 gal/dose	
<b>Run Time/Dose</b>	<b>6.3 minutes</b>	Range 5-7 minutes unless uphill, checked
Volume/depth	21.07 gal/in.	(Per tank manufacturer's specifications)
Estimated Drawdown	6.42 in.	

### Manifold Box

Number of Taps: 3 with 0 Split(s)  
 Manifold Length: 3.0 ft. (approximate)



## PRESSURE MANIFOLD SYSTEM DESIGN (Repair)

### Site Information

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

### Design Information

Estimated Daily Flow	480 gal/day
L.T.A.R. (from Harnett Co.)	0.4 gal/day/ft <sup>2</sup>
L.T.A.R. + 5%	0.420 gal/day/ft <sup>2</sup>
Trench Width	3 ft.
Line Length Required	400 ft.
Length after 50% Reduction	200 ft
L.T.A.R. Reduced	0.800 gal/day/ft <sup>2</sup>
L.T.A.R. Reduced + 5%	0.840 gal/day/ft <sup>2</sup>

### DRAINFIELD INFO. - Repair

Proposed Type of System/Distribution: **Pump to Pressure Manifold using PPBPS, Horizontal**

Line No.	Flag Color	Line Length (ft.)		Flow (gpm)	Flow/Foot (gpm/ft)	Line L.T.A.R.
4	red	67	1/2in SCH 40	7.11	0.106	0.796
5	white	67	1/2in SCH 40	7.11	0.106	0.796
6	blue	67	1/2in SCH 40	7.11	0.106	0.796
<b>Total</b>		<b>201</b>		<b>Total 21.33</b>	<b>Avg.</b>	<b>0.80</b>

Note: Line lengths are calculated in 4'4" increments to reflect use of PPBPS product.

Total Run Time	22.50 min.	
Drainfield Capacity	338.4 gal	
% of Drainfield Cap	68.5%	(Max. 100.5% to not exceed 7.2 gal/panel)
Dose Volume	231.7 gal/dose	
<b>Run Time/Dose</b>	<b>10.9 minutes</b>	Time to deliver max. 3.6 gal/panel
Volume/depth	21.07 gal/in.	(Per tank manufacturer's specifications)
Estimated Drawdown	11.00 in.	

### Manifold Box

Number of Taps: 3 with 0 Split(s)  
 Manifold Length: 3.0 ft. (approximate)

## PUMP DESIGN

System (initial/repair): **Primary**

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

### Friction Losses

Suction Head	0 ft	(submersible 0)
Elev. Difference (highest point from pump)	6.16 ft	
Design Pressure At Outlet	2 ft	
<b>Supply Line - 2" Schedule 40 PVC</b>		
Pipe Diameter, Nominal	2 in.	
Pipe Diameter (ID)	2.047 in.	
Pipe Length	308.26 ft	Flow 21.33 gpm Velocity 2.08 ft/sec
Pipe Length for Fittings	30.826 ft	Meets requirement that 2 ft/s < v < 5 ft/s.
Equivalent Length	339.086 ft	
Estimated Friction Loss in Supply Line	2.94 ft	
Friction Loss - Taps/Special Fittings	3.5 ft	
<b>TOTAL</b>	<b>14.60 ft.</b>	

Flow for Anti-Siphon Hole


Hole Diameter 3/16 in.  
 Hole Flowrate 1.58 gpm

Pump Efficiency 0.7 (assumed, typical)  
 Motor Efficiency 0.9 (assumed for electric pumps)  
**Flow 22.91 gpm**

Required Horsepower 0.13 hp  
**TDH 14.60 ft**

### Pump Selection

Manufacturer:	Zoeller
Model:	N98
Horsepower:	0.5

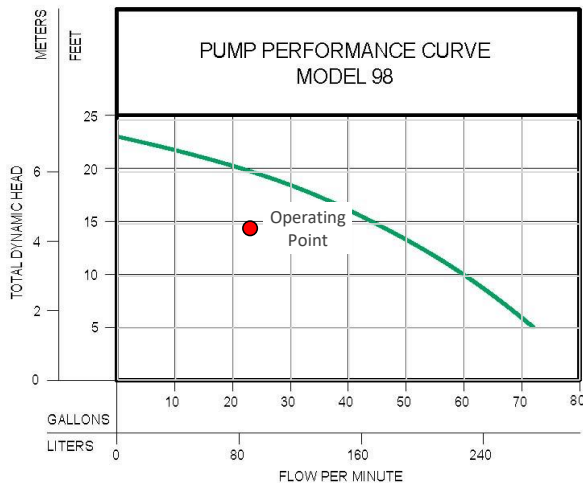

## PUMP DESIGN

System (initial/repair): **Repair**

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

### Friction Losses

Suction Head	0 ft	(submersible 0)
Elev. Difference (highest point from pump)	6.96 ft	
Design Pressure At Outlet	2 ft	
<b>Supply Line - 2" Schedule 40 PVC</b>		
Pipe Diameter, Nominal	2 in.	
Pipe Diameter (ID)	2.047 in.	Flow 21.33 gpm
Pipe Length	358.6 ft	Velocity 2.08 ft/s
Pipe Length for Fittings	35.86 ft	Meets requirement that $2 \text{ ft/s} < v < 5 \text{ ft/s}$ .
Equivalent Length	394.46 ft	
Estimated Friction Loss in Supply Line	3.42 ft	
Friction Loss - Taps/Special Fittings	3.5 ft	
<b>TOTAL</b>	<b>15.88 ft.</b>	

Flow for Anti-Siphon Hole


Hole Diameter 3/16 in.  
 Hole Flowrate 1.65 gpm

Pump Efficiency 0.7 (assumed, typical)  
 Motor Efficiency 0.9 (assumed for electric pumps)  
**Flow 22.98 gpm**

Required Horsepower 0.15 hp  
**TDH 15.88 ft.**

### Pump Selection

Manufacturer:	Zoeller
Model:	N98
Horsepower:	0.5

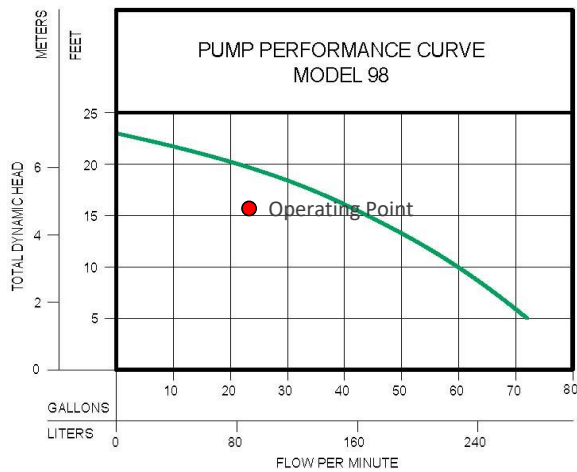

## Septic Tank Buoyancy Calculation

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

Tank Size (nominal) 1250 gal

### Properties/Assumptions:

Min. liquid level to be maintained in tank at all times after initial installation.			
Min. depth to water table	12.0 in.	from ground surface	
Effluent Density	62.4 lb/ft <sup>3</sup>	(Specific Weight of Water)	
Concrete Density	142.6 lb/ft <sup>3</sup>		
Soil App. Sp. Grav.	1.3	(typical value)	
Soil Cover Over Tank	12 in.	(minimum)	
Additional Cover	0 in.	for pipe grade	
Unsubmerged wt of soil	81.1 lb/ft <sup>3</sup>		
Submerged wt of soil	49.9 lb/ft <sup>3</sup>	50% Porosity Assumed	

### Tank Dimensions (from supplier):

		<u>Exterior</u>		<u>Interior</u>	
		Top	Bottom	Top	Bottom
Tank	Length	125.5	122.0	119.5	116.0 in.
	Width	65.5	62.0	59.5	56.0 in.
	Height	58.5	(w/o lid)	54.5	in.
Lid	Length	125.5 in.			
	Width	65.5 in.			
	Height	3.0 in.			
Area of Riser Openings		6.28 ft <sup>2</sup>			
Permanent Liquid Depth in Tank		0.0 in.		0.00 ft	
Tank Weight		11,000 lb		(per manufacturer)	

### Buoyancy Force Calculation:

Buoyancy Force Specific Weight of Water x Displaced Volume	
Displaced Volume	281.4 ft <sup>3</sup> *
<b>Buoyancy Force</b>	<b>17,558 lb.</b>

### Weight Calculation:

Tank Weight	11000 lb	Volume	0.0 ft <sup>3</sup> *
Water Weight in Tank	0 lb		
Soil Weight Over Tank	4121 lb		
Soil Friction Force	4037 lb		
<b>Total Weight</b>	<b>19,158 lb</b>		

**Factor of Safety = 1.09**

Note: Total weight must be greater than buoyancy force so that tank will not float during high water table conditions.

\* Volume calculated by the prismatic formula.

## Pump Tank Buoyancy Calculation

**Project:** Stewart Farms  
**Location:** 3981 Baileys XRDS Rd,  
 Benson, NC 27504  
**County:** Harnett

Tank Size (nominal) 1287 gal

### Properties/Assumptions:

Min. liquid level to be maintained in tank at all times after initial installation.		
Min. depth to water table	12 in.	from ground surface
Effluent Density	62.4 lb/ft <sup>3</sup>	(Specific Weight of Water)
Concrete Density	142.6 lb/ft <sup>3</sup>	
Soil App. Sp. Grav.	1.3	(typical value)
Soil Cover Over Tank	12 in.	(minimum)
Additional Cover	0 in.	for pipe grade
Unsubmerged wt of soil	81.1 lb/ft <sup>3</sup>	
Submerged wt of soil	49.9 lb/ft <sup>3</sup>	50% porosity assumed

### Tank Dimensions (from supplier):

		<i>Exterior</i>		<i>Interior</i>	
		Top	Bottom	Top	Bottom
Tank	Length	108.0	104.0	102.0	98.0 in.
	Width	58.0	54.0	52.0	48.0 in.
	Height	64.5	(w/o lid)	60.5	in.
Lid	Length	108.0 in.			
	Width	58.0 in.			
	Height	3.0 in.			
Area of Riser Openings		3.14 ft <sup>2</sup>			
Permanent Liquid Depth in Tank		0.0 in.		0.00 ft	
Tank Weight		10500 lb		(per manufacturer)	

### Buoyancy Force Calculation:

Buoyancy Force Specific Weight of Water x Displaced Volume	
Displaced Volume	232.5 ft <sup>3</sup> *
<b>Buoyancy Force</b>	<b>14,508 lb</b>

### Weight Calculation:

Tank Weight	10500 lb		
Water Weight in Tank	0 lb	Volume	0.0 ft <sup>3</sup> *
Soil Weight Over Tank	3274 lb		
Soil Friction Force	4227 lb		
<b>Total Weight</b>	<b>18,001 lb</b>		

**Factor of Safety = 1.24**

Note: Total weight must be greater than buoyancy force so that tank will not float during high water table conditions.

\* Volume calculated by the prismatic formula.

