

RE: MP2  
 DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE

**Trenco**  
 818 Soundside Rd  
 Edenton, NC 27932

**Site Information:**

Customer: Project Name: MP2  
 Lot/Block: Model:  
 Address: Subdivision:  
 City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**


Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.6  
 Wind Code: ASCE 7-10 Wind Speed: 120 mph  
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 10 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I65688271	A01G	5/21/2024
2	I65688272	A02V	5/21/2024
3	I65688273	A03	5/21/2024
4	I65688274	A04	5/21/2024
5	I65688275	A05G	5/21/2024
6	I65688276	A06G	5/21/2024
7	I65688277	P01	5/21/2024
8	I65688278	P02	5/21/2024
9	I65688279	P03	5/21/2024
10	I65688280	P04G	5/21/2024

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource (Apex,NC).  
 Truss Design Engineer's Name: Gilbert, Eric  
 My license renewal date for the state of North Carolina is December 31, 2024.  
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

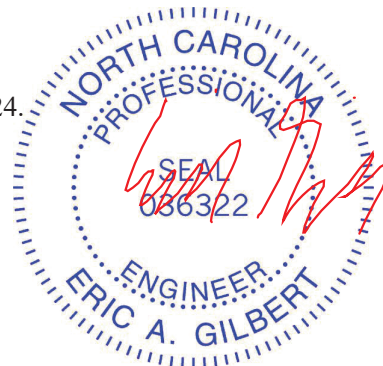

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE	165688271
MP2	A01G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:04 2024 Page 1

ID:YnPtfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

-0-8-0 19-0-0 38-0-0 38-8-0  
 0-8-0 19-0-0 19-0-0 0-8-0

Scale = 1:67.2

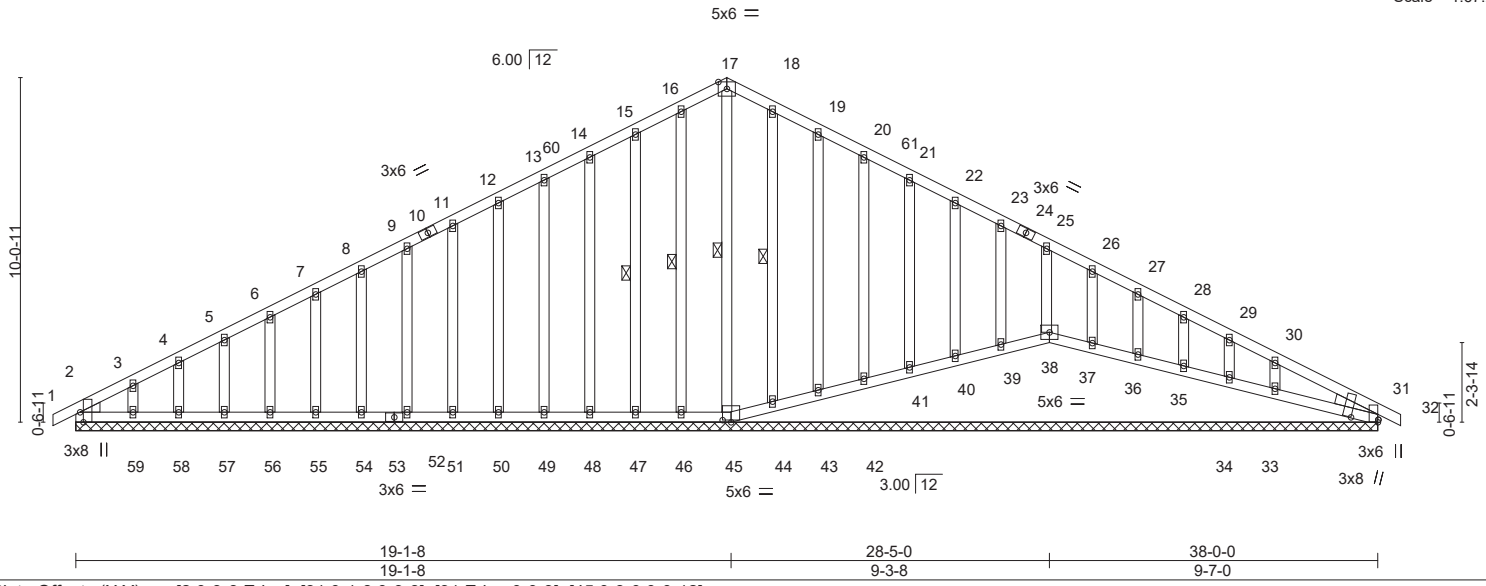


Plate Offsets (X,Y)--	[2:0-3-8,Edge], [31:0-1-8,0-9-8], [31:Edge,0-0-3], [45:0-3-0,0-0-12]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	0.00	32	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	32	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.09	Horz(CT)	0.01	31	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 303 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
OTHERS 2x4 SP No.3	6-0-0 oc bracing: 33-34.
WEDGE	WEBS 1 Row at midpt 17-45, 16-46, 15-47, 18-44
Left: 2x4 SP No.3, Right: 2x4 SP No.3	

**REACTIONS.** All bearings 38-0-0.  
 (lb) - Max Horz 2=143(LC 16)  
 Max Uplift All uplift 100 lb or less at joint(s) 2, 46, 47, 48, 49, 50, 51, 52, 54, 55, 56, 57, 58, 59, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33  
 Max Grav All reactions 250 lb or less at joint(s) 2, 38, 45, 46, 47, 48, 49, 50, 51, 52, 54, 55, 56, 57, 58, 59, 44, 43, 31, 42, 41, 40, 39, 37, 36, 35, 34, 33

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 15-16=-90/273, 16-17=-96/287, 17-18=-96/290, 18-19=-90/276

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-8-0 to 4-4-0, Exterior(2) 4-4-0 to 19-0-0, Corner(3) 19-0-0 to 23-9-10, Exterior(2) 23-9-10 to 38-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 1-4-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 46, 47, 48, 49, 50, 51, 52, 54, 55, 56, 57, 58, 59, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33.
  - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 38, 44, 43, 31, 42, 41, 40, 39, 37, 36, 35, 34, 33.



May 21, 2024

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbccomponents.com)</p>	<p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---





Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE	165688273
MP2	A03	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.630 s Mar 9 2023 MiTek Industries, Inc. Mon May 20 16:33:45 2024 Page 2  
ID:YnPftgg65JxzX?AS1huWL5zfxqm-3KRA?d5ypp65uJNQHTU\_JoVw\_sODRwgQon\_aYzEYd4

**LOAD CASE(S)**

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-60, 5-9=-60, 20-23=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-50, 5-9=-50, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-5=-20, 5-9=-20, 20-23=-40, 16-17=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=47, 2-26=25, 5-26=14, 5-6=25, 6-8=14, 8-9=9, 20-23=-12  
Horz: 1-2=-59, 2-26=-37, 5-26=-26, 5-6=37, 6-8=26, 8-9=21
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=9, 2-4=14, 4-5=25, 5-27=14, 8-27=25, 8-9=47, 20-23=-12  
Horz: 1-2=-21, 2-4=-26, 4-5=-37, 5-27=26, 8-27=37, 8-9=59
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-12, 2-5=-33, 5-8=-33, 8-9=-28, 20-23=-20  
Horz: 1-2=-8, 2-5=13, 5-8=-13, 8-9=-8
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-28, 2-5=-33, 5-8=-33, 8-9=-12, 20-23=-20  
Horz: 1-2=8, 2-5=13, 5-8=-13, 8-9=8
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=9, 2-5=-2, 5-8=9, 8-9=4, 20-23=-12  
Horz: 1-2=-21, 2-5=-10, 5-8=21, 8-9=16
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=4, 2-5=9, 5-8=-2, 8-9=9, 20-23=-12  
Horz: 1-2=-16, 2-5=-21, 5-8=10, 8-9=21
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-15, 2-5=-20, 5-8=-9, 8-9=-4, 20-23=-20  
Horz: 1-2=-5, 2-5=-0, 5-8=11, 8-9=16
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-4, 2-5=-9, 5-8=-20, 8-9=-15, 20-23=-20  
Horz: 1-2=-16, 2-5=-11, 5-8=0, 8-9=5
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=17, 2-3=22, 3-5=11, 5-8=3, 8-9=-2, 20-23=-12  
Horz: 1-2=-29, 2-3=-34, 3-5=-23, 5-8=15, 8-9=10
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-2, 2-5=3, 5-7=11, 7-8=22, 8-9=17, 20-23=-12  
Horz: 1-2=-10, 2-5=-15, 5-7=23, 7-8=34, 8-9=29
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=7, 2-5=11, 5-8=3, 8-9=-2, 20-23=-12  
Horz: 1-2=-19, 2-5=-23, 5-8=15, 8-9=10
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-2, 2-5=3, 5-8=11, 8-9=7, 20-23=-12  
Horz: 1-2=-10, 2-5=-15, 5-8=23, 8-9=19
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=9, 2-3=4, 3-5=-6, 5-8=-15, 8-9=-10, 20-23=-20  
Horz: 1-2=-29, 2-3=-24, 3-5=-14, 5-8=5, 8-9=10
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-10, 2-5=-15, 5-7=-6, 7-8=4, 8-9=9, 20-23=-20  
Horz: 1-2=-10, 2-5=-5, 5-7=14, 7-8=24, 8-9=29
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-5=-20, 5-9=-20, 20-28=-20, 28-29=-60, 29-30=-20, 30-31=-60, 23-31=-20, 16-17=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-46, 2-5=-50, 5-8=-42, 8-9=-38, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)  
Horz: 1-2=-4, 2-5=-0, 5-8=8, 8-9=12
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE	I65688273
MP2	A03	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.630 s Mar 9 2023 MiTek Industries, Inc. Mon May 20 16:33:45 2024 Page 3  
 ID:YnPfgg65JxzX?AS1huWL5zfxqm-3KRA?d5ypp65uJNQQHTU\_JoVw\_sODRwgQon\_aYzEYd4

**LOAD CASE(S)**

Uniform Loads (plf)

Vert: 1-2=-38, 2-5=-42, 5-8=-50, 8-9=-46, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)  
 Horz: 1-2=-12, 2-5=-8, 5-8=0, 8-9=4

21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-28, 2-3=-32, 3-5=-40, 5-8=-46, 8-9=-43, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)  
 Horz: 1-2=-22, 2-3=-18, 3-5=-10, 5-8=4, 8-9=7

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-5=-46, 5-7=-40, 7-8=-32, 8-9=-28, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)  
 Horz: 1-2=-7, 2-5=-4, 5-7=10, 7-8=18, 8-9=22

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 5-9=-20, 20-23=-20

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-20, 5-9=-60, 20-23=-20

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-50, 5-9=-20, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-20, 5-9=-50, 20-28=-20, 28-29=-50, 29-30=-20, 30-31=-50, 23-31=-20, 16-17=-30(F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))



818 Soundside Road  
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE	165688274
MP2	A04	COMMON	7	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:06 2024 Page 1

ID:YnPttfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

0-8-0	9-6-12	19-0-0	28-5-4	38-0-0	38-8-0
0-8-0	9-6-12	9-5-4	9-5-4	9-6-12	0-8-0

Scale = 1:70.8

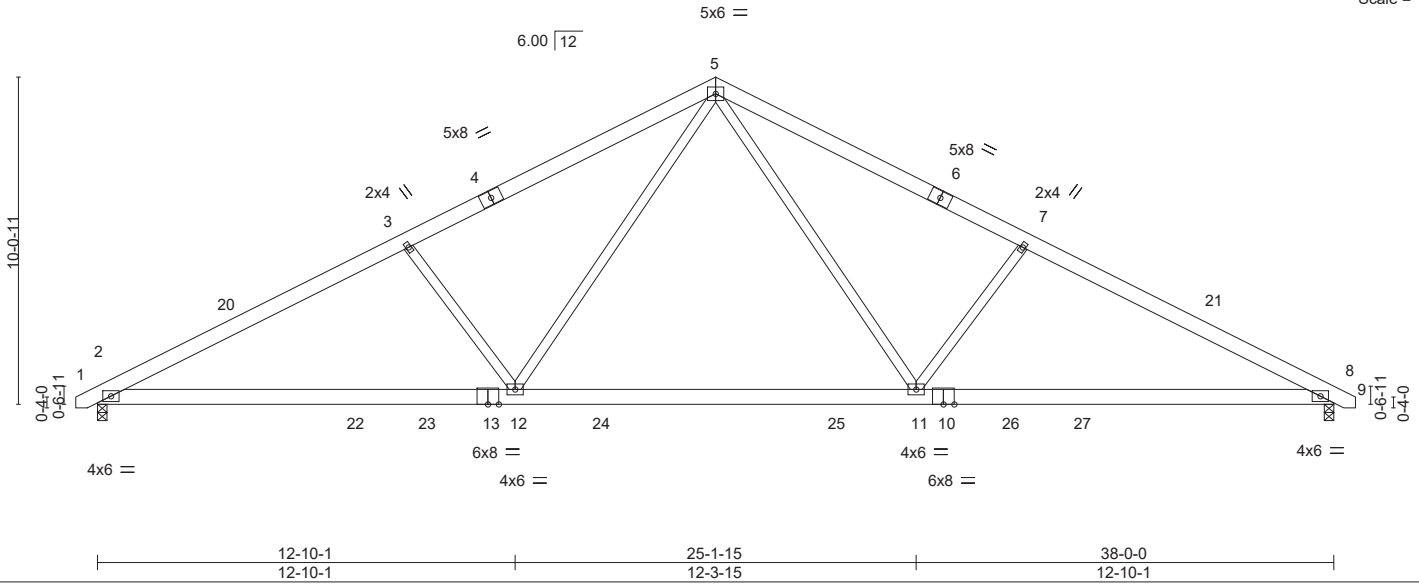

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.54	Vert(LL)	-0.27 11-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-0.42 11-12	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.42	Horz(CT)	0.08 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-MS	Wind(LL)	0.10 12-16	>999	240		
								Weight: 241 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x6 SP No.2  
 BOT CHORD 2x6 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-11-2 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
 Max Horz 2=-134(LC 13)  
 Max Uplift 2=-26(LC 12), 8=-26(LC 13)  
 Max Grav 2=1549(LC 1), 8=1549(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2714/247, 3-5=-2465/269, 5-7=-2465/269, 7-8=-2714/247  
 BOT CHORD 2-12=-132/2381, 11-12=0/1562, 8-11=-127/2381  
 WEBS 5-11=-38/1008, 7-11=-598/223, 5-12=-38/1008, 3-12=-598/223

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-5-14 to 4-3-12, Interior(1) 4-3-12 to 19-0-0, Exterior(2) 19-0-0 to 25-9-7, Interior(1) 25-9-7 to 38-5-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



May 21, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE
MP2	A05G	GABLE	1	1	165688275

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:07 2024 Page 1

ID:YnPttfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

-0-8-0	8-11-11	16-11-15	21-0-0	29-0-5	38-0-0	38-8-0
0-8-0	8-11-11	8-0-4	4-0-1	8-0-4	8-11-11	0-8-0

Scale = 1:68.3

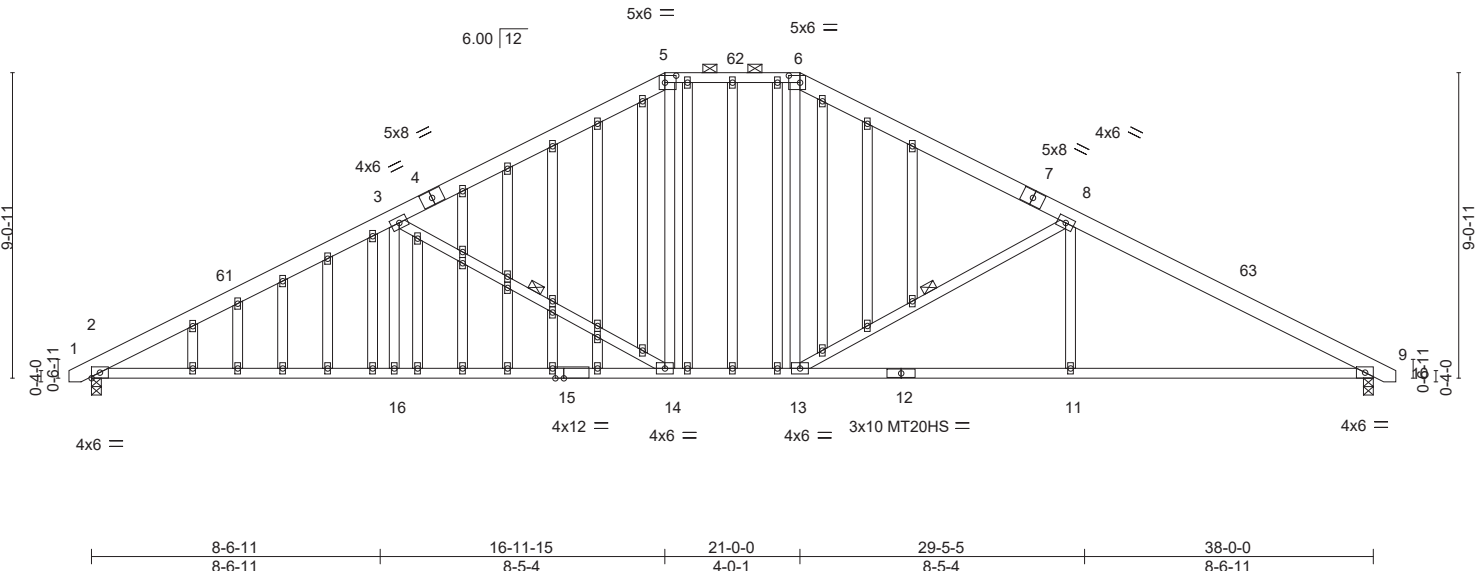


Plate Offsets (X,Y)--	[5:0-4-0,0-2-8], [6:0-4-0,0-2-8], [9:0-0-1,0-0-0], [15:0-3-0,0-0-0]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.34	11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.98	Vert(CT)	-0.52	11-13	>880	240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.42	Horz(CT)	0.12	9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.21	14-16	>999	240		Weight: 359 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 5-6: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-9 oc purlins, except 2-0-0 oc purlins (4-5-13 max.): 5-6.
BOT CHORD 2x4 SP No.1 *Except* 12-15: 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 3-14, 8-13
OTHERS 2x4 SP No.3	

**REACTIONS.** (size) 2=0-3-8, 9=0-3-8  
 Max Horz 2=-128(LC 13)  
 Max Uplift 2=-106(LC 12), 9=-106(LC 13)  
 Max Grav 2=1549(LC 1), 9=1549(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-2736/256, 3-5=-1967/272, 5-6=-1647/272, 6-8=-1967/272, 8-9=-2736/256  
 BOT CHORD 2-16=-196/2357, 14-16=-196/2357, 13-14=-8/1647, 11-13=-146/2357, 9-11=-146/2357  
 WEBS 3-16=0/355, 3-14=-891/234, 5-14=-12/527, 8-11=0/355, 6-13=-12/527, 8-13=-891/235

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-5-14 to 4-3-12, Interior(1) 4-3-12 to 16-11-15, Exterior(2) 16-11-15 to 27-9-8, Interior(1) 27-9-8 to 38-5-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) All plates are MT20 plates unless otherwise indicated.
  - 6) All plates are 2x4 MT20 unless otherwise indicated.
  - 7) Gable studs spaced at 1-4-0 oc.
  - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=106, 9=106.
  - 11) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
  - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 21, 2024




Job MP2	Truss A06G	Truss Type GABLE	Qty 1	Ply 1	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE 165688276
------------	---------------	---------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:08 2024 Page 1

ID:YnPttgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



4x6 =

Scale = 1:36.9

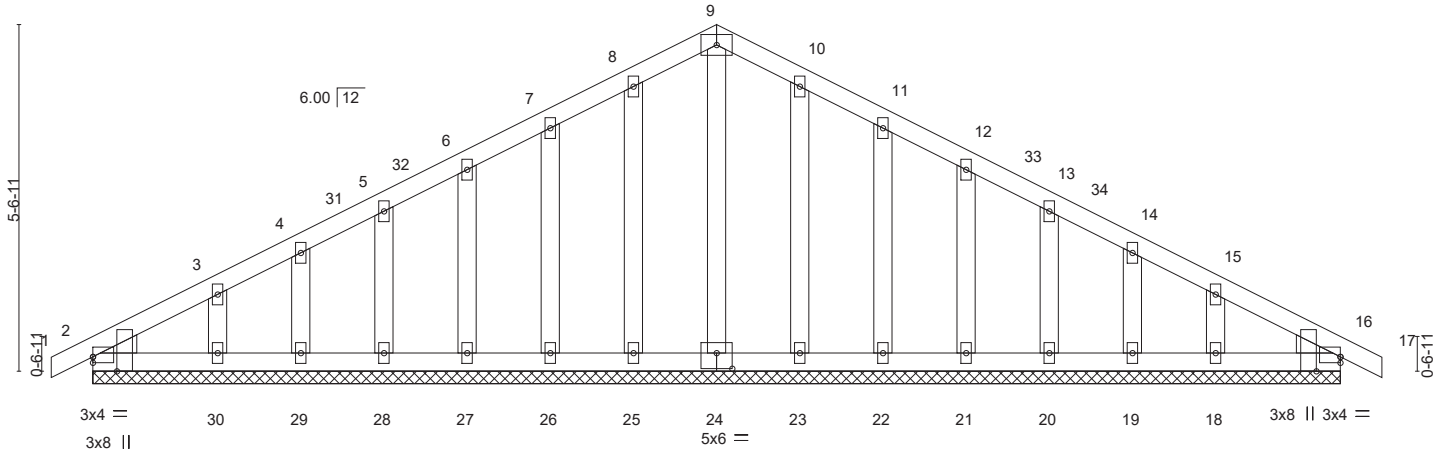


Plate Offsets (X,Y)--	[2:0-0-0,0-1-2], [2:0-2-12,Edge], [16:0-2-12,Edge], [16:Edge,0-1-2], [24:0-3-0,0-3-0]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	0.00	16	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	0.00	16	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.05	Horz(CT)	0.00	16	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 123 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.
OTHERS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3 , Right: 2x4 SP No.3	

**REACTIONS.** All bearings 20-0-0.  
 (lb) - Max Horz 2=77(LC 12)  
 Max Uplift All uplift 100 lb or less at joint(s) 2, 25, 26, 27, 28, 29, 30, 23, 22, 21, 20, 19, 18  
 Max Grav All reactions 250 lb or less at joint(s) 2, 24, 25, 26, 27, 28, 29, 30, 23, 16, 22, 21, 20, 19, 18

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-0 to 4-1-10, Exterior(2) 4-1-10 to 10-0-0, Corner(3) 10-0-0 to 14-9-10, Exterior(2) 14-9-10 to 20-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 1-4-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 25, 26, 27, 28, 29, 30, 23, 22, 21, 20, 19, 18.

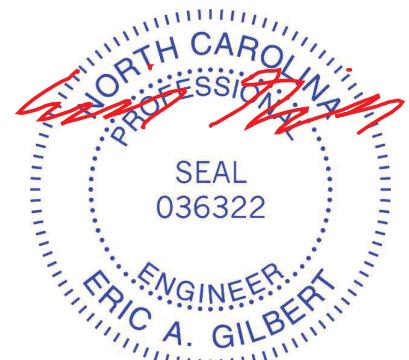

May 21, 2024


Job MP2	Truss P01	Truss Type MONO HIP	Qty 1	Ply 1	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE 165688277
------------	--------------	------------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:08 2024 Page 1

ID:YnPtfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

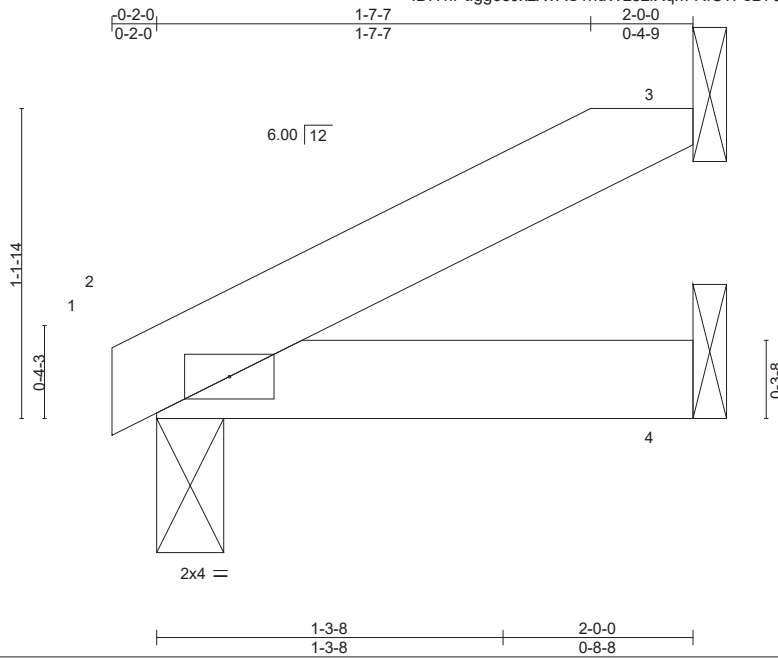

Scale = 1:8.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.05	Vert(LL)	-0.00	7	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT)	-0.00	7	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	2	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP	Wind(LL)	0.00	7	>999	Weight: 7 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-3-0, 4=Mechanical, 3=Mechanical  
Max Horz 2=33(LC 8)  
Max Uplift 3=-21(LC 8)  
Max Grav 2=83(LC 1), 4=36(LC 3), 3=50(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- 6) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



May 21, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE	165688278
MP2	P02	MONO HIP	1	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:09 2024 Page 1

ID:YnPtfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

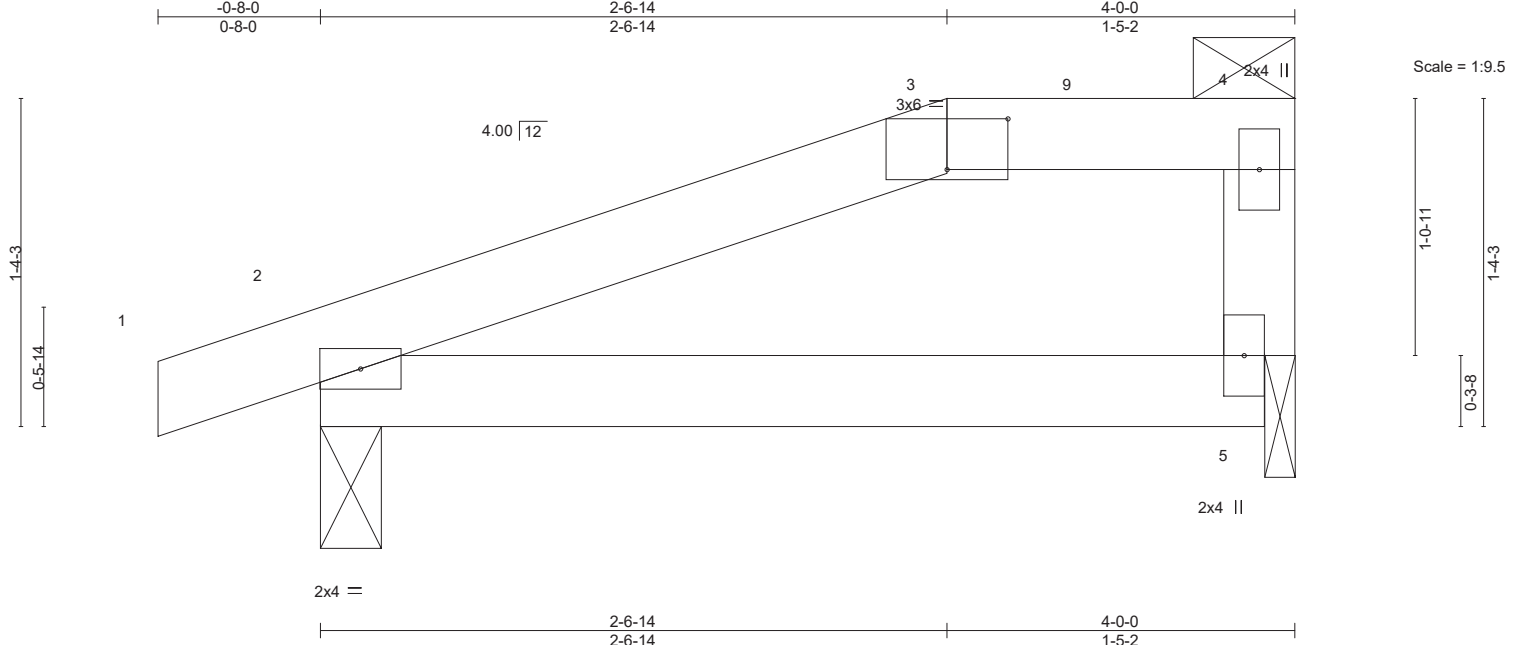

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(LL) -0.00 5-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.01 5-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MR	Horz(CT) 0.00 2 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.00 5-8 >999 240	Weight: 14 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 2=0-3-0, 5=0-1-8  
 Max Horz 2=40(LC 5)  
 Max Uplift 2=-41(LC 4), 5=-20(LC 4)  
 Max Grav 2=206(LC 1), 5=159(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 5.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
  - Girder carries hip end with 0-0-0 right side setback, 0-0-0 left side setback, and 2-6-0 end setback.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-2=-60, 2-3=-63(F=-3), 3-4=-63(F=-3), 5-6=-21(F=-1)




Job MP2	Truss P03	Truss Type MONO TRUSS	Qty 7	Ply 1	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE 165688279
------------	--------------	--------------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:09 2024 Page 1

ID:YnPtfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

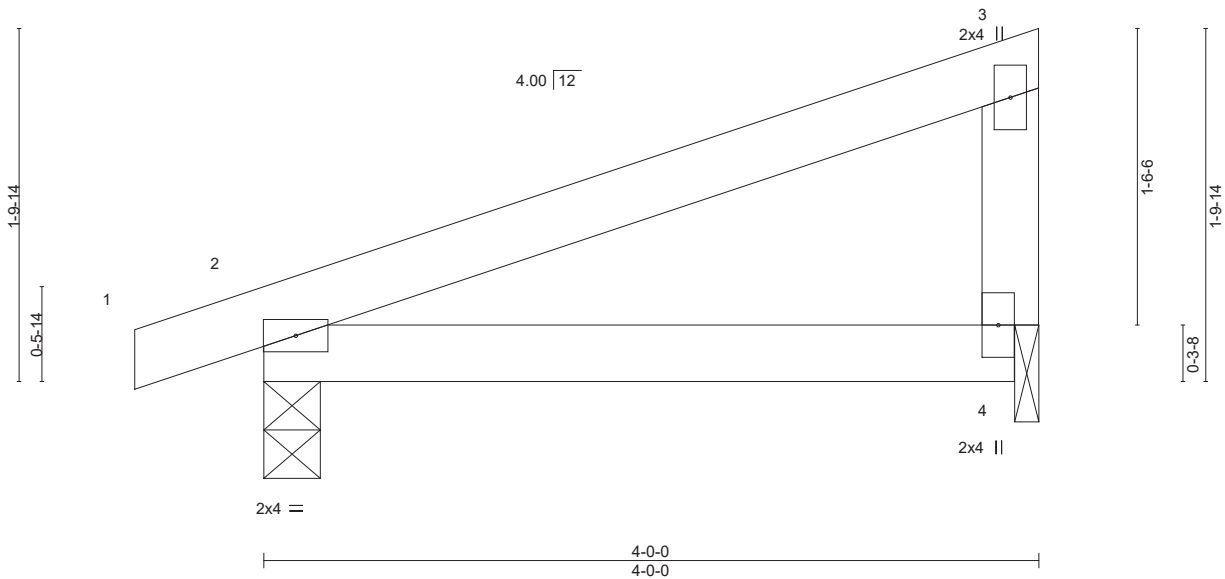

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	-0.01 4-7	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	-0.02 4-7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MP	Wind(LL)	0.01 4-7	>999	240	Weight: 15 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 4=0-1-8  
 Max Horz 2=55(LC 11)  
 Max Uplift 2=38(LC 8), 4=22(LC 12)  
 Max Grav 2=198(LC 1), 4=151(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

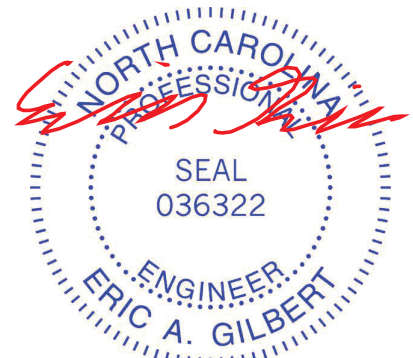

May 21, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
 Edenton, NC 27932

Job MP2	Truss P04G	Truss Type GABLE	Qty 1	Ply 1	DRHORTON/WILMINGTON; LOT 2 MCKAY PLACE Job Reference (optional)	165688280
------------	---------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.630 s Apr 26 2024 MiTek Industries, Inc. Mon May 20 08:43:09 2024 Page 1

ID:YnPtfgg65JxzX?AS1huWL5zfXqm-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale: 1"=1'

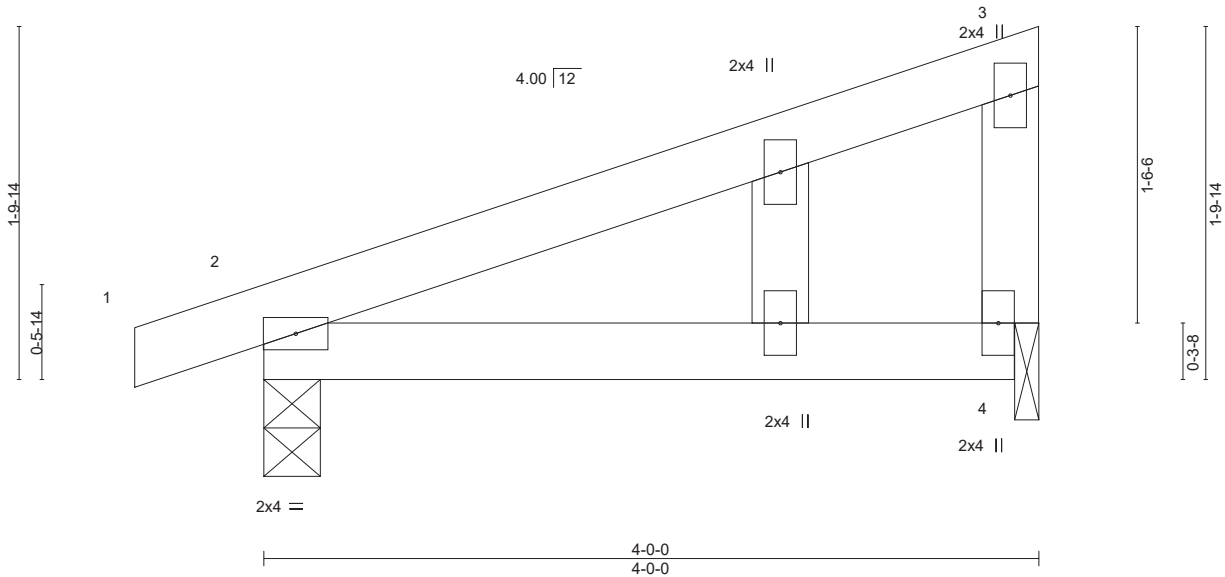

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	-0.01 4-9	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	-0.02 4-9	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MP	Wind(LL)	0.01 4-9	>999	240		
								Weight: 16 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 4=0-1-8  
 Max Horz 2=55(LC 11)  
 Max Uplift 2=-38(LC 8), 4=-22(LC 12)  
 Max Grav 2=198(LC 1), 4=151(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 1-4-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



May 21, 2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
 Edenton, NC 27932

# Symbols


## PLATE LOCATION AND ORIENTATION

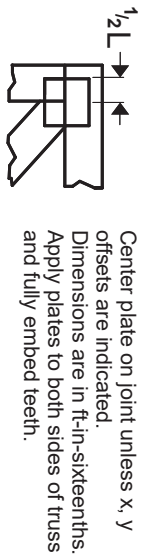

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

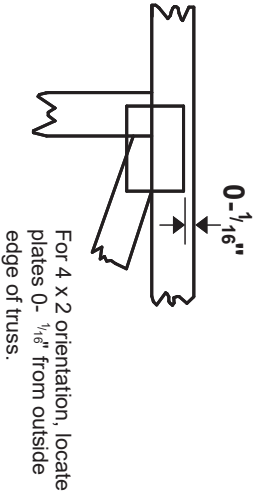

For 4 x 2 orientation, locate plates 0- 1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

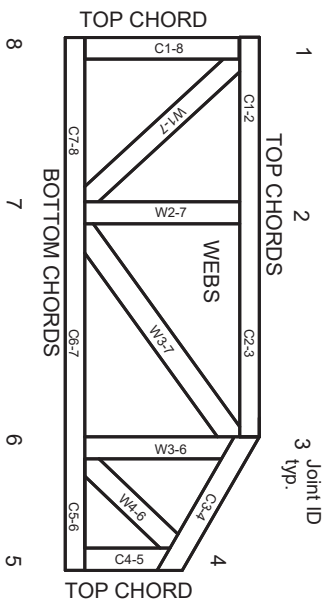

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

**MITek**

ENGINEERING BY  
**TRANGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: Mill-7473 rev. 1/2/2023

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor 1 bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.