

L 3 1/2 x 3 1/2 x 1/4 ANGLE  
AT ACCESS. BEAR 4"  
MIN., EACH END.

4" MASONRY LEDGE, TYPICAL  
AT SLAB PERIMETER.


12  
SD1

12" THK PORCH FOUNDATION WALL MAX HEIGHT = 14';  
EXTERIOR AND INTERIOR FILL OF PORCH WALL TO BE BALANCED  
AND OF EQUIVALENT FILL TYPE. GROUT TOP (2) COURSES OF  
WALL SOLID AND GROUT WALL SOLID FROM TOP OF FOOTING TO  
MINIMUM (2) COURSES ABOVE BALANCED GRADE, TYP

1.5C18 VULCRAFT GALVANIZED DECKING OR  
EQUAL. BEAR 2" MIN @ SUPPORT LEDGE.  
REINFORCE CONCRETE SLAB WITH #4 REBAR  
@ 18" O.C., BOTH DIRECTIONS. SLOPE SLAB  
TO PORCH PERIMETER MAINTAINING 5.5"  
MIN. SLAB THICKNESS.

# CRAWLSPACE FRAMING PLAN

1/4" = 1'-0"

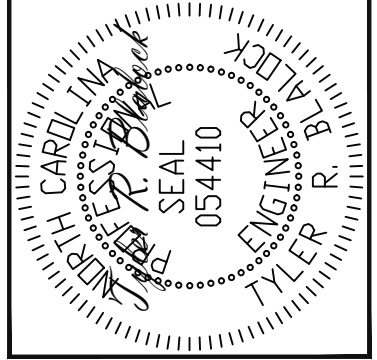

**Engineering**  
**Lech**  
ASSOCIATES, P.A.

STRUCTURAL ENGINEERS  
License No. C-3870  
318 W Millbrook Rd. Unit 201  
Raleigh, North Carolina 27609  
Phone (919) 844-1661

PARAMOUNT HOMES			
SCOPE	PORCH FOUNDATION WALL	REV #	REF PROJ #
LOC	6 COTTON FARMS	DATE	

ENG: TRB  
DATE: 10/21/2024

PARENT  
24-65-286

PROJECT NO.  
24-76-115

SHEET NO.  
SL1  
1 of 1