### COLEMAN

HARRINGTON PLACE LOT 40



PLAN ID 060121.1201

PAGE #

### 110 VILLAGE TRAIL SUITE 215 WOODSTOCK, GA. 30188

DATE

BY

### **DRAWING INDEX** A0.0 **COVER SHEET** FRONT ELEVATIONS A1.1 SIDE & REAR ELEVATIONS A2.1 **SLAB FOUNDATION** A3.1 A5.1 FIRST FLOOR PLANS & DETAILS SECOND FLOOR PLANS & DETAILS A5.2 A6.1 **ROOF PLANS** A7.2-A7.3 ELECTRICAL PLANS

AREA TABULATION		
FIRST FLOOR	838	
SECOND FLOOR	1215	
TOTAL	2053	
GARAGE	438	
FRONT PORCH (COVERED)	84	
REAR PATIO	120	

10/30/2021	AW	Prototype walk revisions - see revision sheet	ALL
4/1/2022	AW	Final walk revisions - see revision sheet	A5.2, A5.2, A7.3
11/1/2022	AW	PCR #4985 Change 2x6 wall in laundry to 2-2x4s - takes 1.5" out of hall/linen	A5.2, A7.3
12/1/2022	AW	PCR #5030 Added 8" in depth to kitchen (pantry & around island) - reduced Dining/Study 8" in depth	A3.1, A5.1, A7.2, A8.1
9/21/2023	ВВ	REMOVED SHOWER AND TUB SIZES FROM ALL AFFECTED PAGES	A3.1, A5.1, A7.3

PLAN REVISIONS

REVISION

### **GOVERNMENTAL CODES & STANDARDS**

HOME TO BE BUILT TO CONFORM TO ALL APPLICABLE LOCAL CODES, PRACTICES AND STANDARDS


### BUILDING CODE ANALYSIS / DESIGN CRITERIA

HOME TO BE BUILT TO MEET OR EXCEED ALL LOCAL CODES AND DESIGN CRITERIA

ALL NON-MASONRY RETURNS TO BE HORIZONTAL SIDING

SEE SHEET D3 OF SDH TYPICAL DETAILS FOR SOFFIT DETAILS PER SOFFIT MATERIAL

### HARRINGTON PLACE LOT 40






ELEVATIONS FRONT ELEVATION COLEMAN


SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH DOUGLAS HOMES.




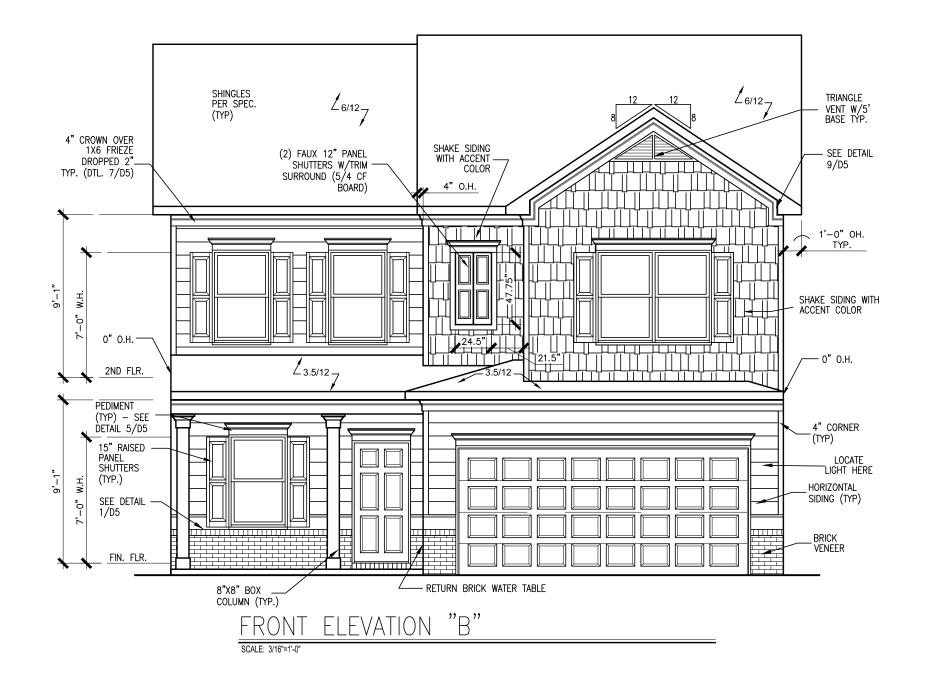


## SHINGLES PER SPEC. (TIP) 17. OF FASCIA TYP. HORIZONTIAL SIDING HORIZONTIAL SIDING LEFT ELEVATION "B" SOLUTION "B"

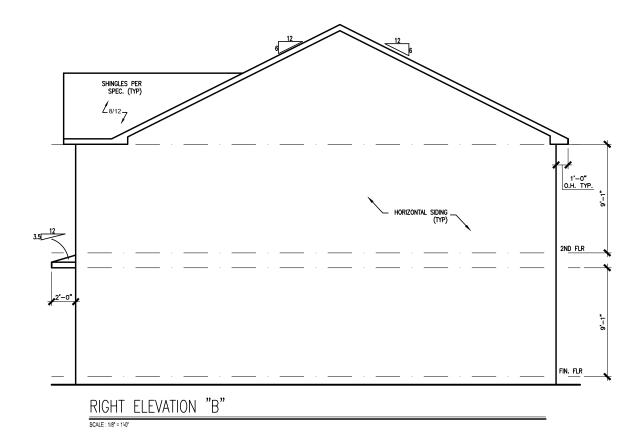

### HARRINGTON PLACE LOT 40

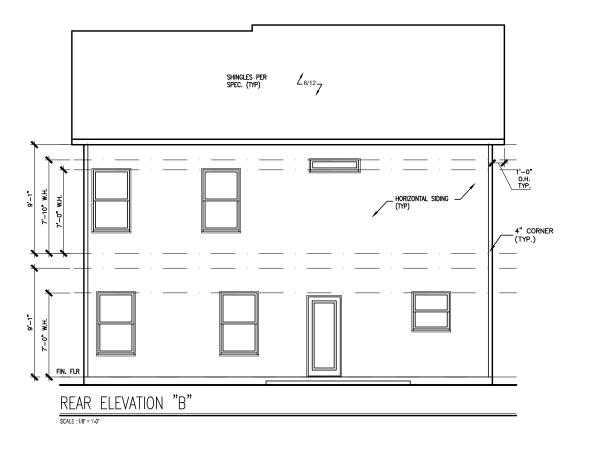





SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

COLEMAN


ELEVATIONS

AND

SIDES


SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans are not relate drawings are not to be reproduced without writt consent from SMITH DOUGLAS HOMES.



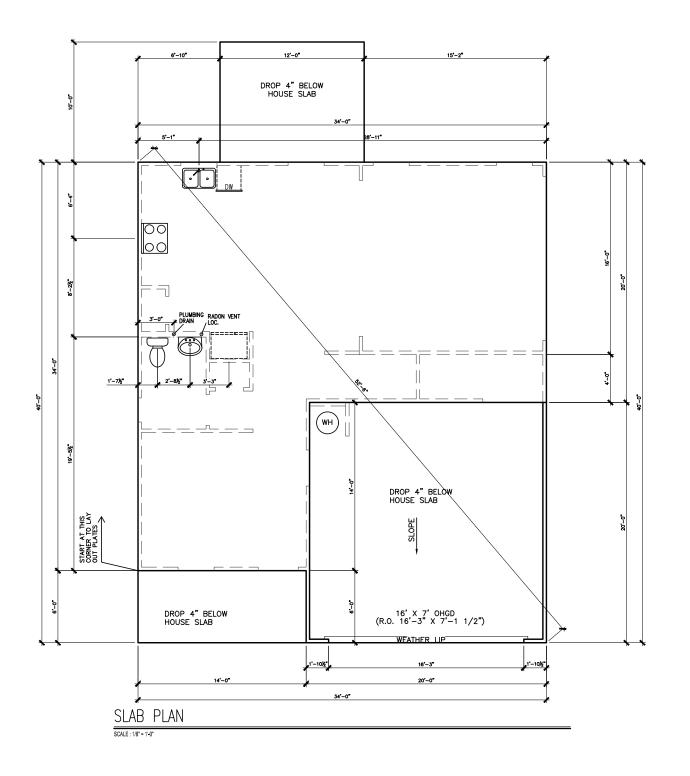

\*RADON VENT PROVIDED PER LOCAL CODE

REFER TO DETAIL 3/D1 FOR BRICK LEDGE DETAIL WHEN BRICK VENEER IS CHOSEN









SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH DOUGLAS HOMES.



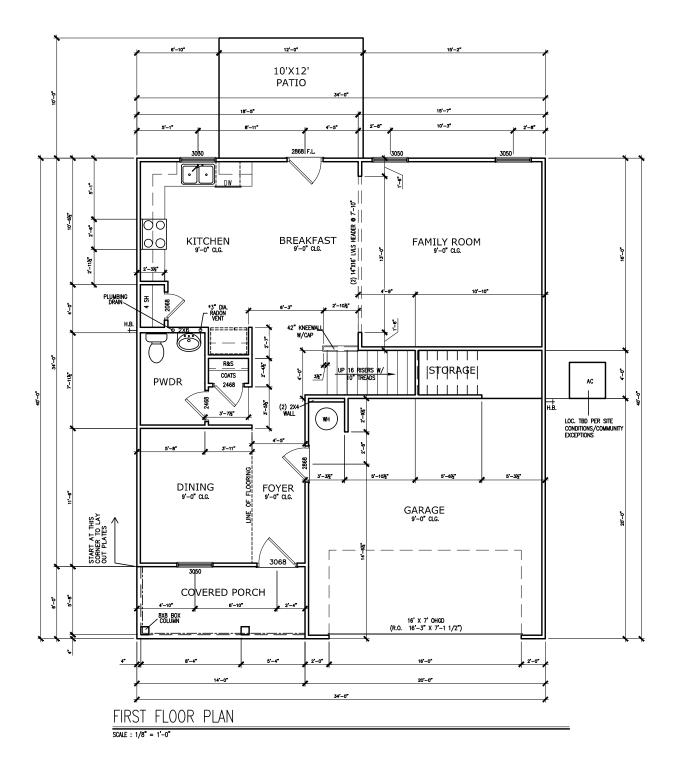




SMITH DOUGLAS HOMES

FLOOR PLAN FIRST FLOOR COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without writte consent from SMITH DOUGLAS HOMES.

\*RADON VENT PROVIDED PER LOCAL CODE

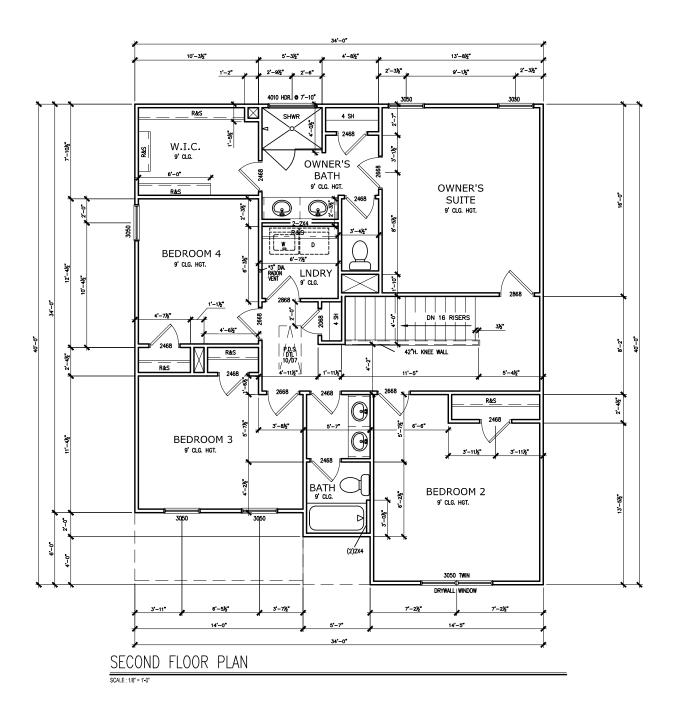





SECOND FLOOR
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com


SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and relate drawings are not to breproduced without writte consent from SMITH DOUGLAS LOWERS.


\*RADON VENT PROVIDED PER LOCAL CODE

REFER TO MANUFACTURER'S SPECS. FOR DRAIN LOCATIONS ON DETAIL SHEETS D12, D12.1, & D12.2

© SMITH DOUGLAS HOMES 2021



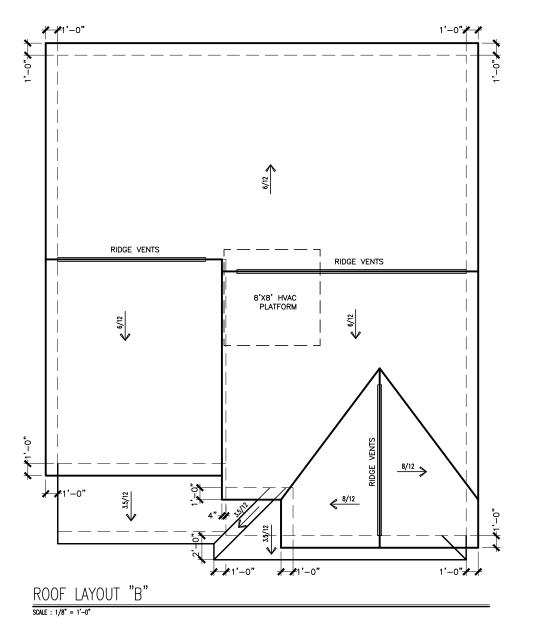





ROOF PLAN
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans are not related drawings are not to be reproduced without writte consent from SMITH DOUGLAS HOMES.




### 10'X12' PATIO DO NOT INSTALL DISPOSAL SWITCH AND OUTLET FOR DISP. **FAMILY** ROOM KITCHEN | BREAKFAST STORAGE ELECTRICAL PROVIDED AS NEEDED GARAGE DINING COVERED PORCH FIRST FLOOR ELECTRICAL PLAN

### HARRINGTON PLACE LOT 40

ELECTRICAL LEGEND				
\$	SWITCH		TV	
\$3	3 WAY SWITCH	φ	120V RECEPTACLE	
\$4	4 WAY SWITCH	<b>P</b>	120V SWITCHED RECEPTACLE	
Ø	CEILING FIXTURE	Φ	220V RECEPTACLE	
- <b>∳</b> <sub>K</sub>	KEYLESS	P <sub>GFCI</sub>	GFCI OUTLET	
₩X	WALL MOUNT FIXTURE	PAFCI	ARCH FAULT CIRCUIT INTERRUPTER	
0	CEILING FIXTURE	† <sub>GL</sub>	GAS LINE	
•	FLEX CONDUIT	† <sub>wL</sub>	WATER LINE	
СН	CHIMES	¥	HOSE BIBB	
PH	TELEPHONE	8	FLOOD LIGHT	
SD/Co	SMOKE DETECTOR & CARBON MONOXIDE		1x4 LUMINOUS FIXTURE	
SO	SECURITY OUTLET		CEILING FAN	
	GARAGE DOOR OPENER		CEILING FAIN	
	EXHAUST FAN		ELECTRICAL WIRING	
	FAN/LIGHT	<del>-</del>	CEILING FIXTURE	
ELECTRICAL PLANS TO FOLLOW ALL LOCAL CODES				
APPROX. FIXTURE HGTS (MEASURED FROM BOTTOM OF FIXTURE)				
BREAKFAST/DINING ROOM 63" ABOVE FINISHED FLOOR				
KITCH	KITCHEN PENDANT LIGHTS 33" ABOVE COUNTER TOP			
TWO	TWO STORY FOYER FIXTURE 96" ABOVE FINISHED FLOOR			
CEILIN	CEILING FAN 96" ABOVE FINISHED FLOOR			
FLOOI	FLOOD LIGHT 10' MAX. ABOVE FIN. FLOOR			

NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER



FIRST FLOOR
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH



# BEDROOM 3 BEDROOM 2 BEDROOM 2 BEDROOM 2 BEDROOM 2

### HARRINGTON PLACE LOT 40

ELECTRICAL LEGEND					
\$	SWITCH		TV		
\$3	3 WAY SWITCH	φ	120V RECEPTACLE		
\$4	4 WAY SWITCH	•	120V SWITCHED RECEPTACLE		
Ø	CEILING FIXTURE	•	220V RECEPTACLE		
$-\phi_{\overline{K}}$	KEYLESS	P <sub>GFCI</sub>	GFCI OUTLET		
+Ø	WALL MOUNT FIXTURE	Pafci	ARCH FAULT CIRCUIT INTERRUPTER		
0	CEILING FIXTURE	† <sub>GL</sub>	GAS LINE		
•	FLEX CONDUIT	† <sub>wL</sub>	WATER LINE		
СН	CHIMES	¥	HOSE BIBB		
PH	TELEPHONE	8	FLOOD LIGHT		
SD/Co	SMOKE DETECTOR & CARBON MONOXIDE		1x4 LUMINOUS FIXTURE		
so	SECURITY OUTLET		0511110 5111		
	GARAGE DOOR OPENER		CEILING FAN		
	EXHAUST FAN		ELECTRICAL WIRING		
	FAN/LIGHT		CEILING FIXTURE		
ELEC <sup>-</sup>	ELECTRICAL PLANS TO FOLLOW ALL LOCAL CODES				
APPROX. FIXTURE HGTS (MEASURED FROM BOTTOM OF FIXTURE)					
BREAKFAST/DINING ROOM 63" ABOVE FINISHED FLOOR					
KITCH	KITCHEN PENDANT LIGHTS 33" ABOVE COUNTER TOP				
TWO	TWO STORY FOYER FIXTURE 96" ABOVE FINISHED FLOOR				
CEILIN	CEILING FAN 96" ABOVE FINISHED FLOOR				
FL00	FLOOD LIGHT 10' MAX. ABOVE FIN. FLOOR				

NOTE: FINAL PLACEMENT OF PHONE/CABLE T.B.D. ON SITE BY THE BUILDER




SMITH DOUGLAS HOMES

SECOND FLOOR
COLEMAN

SMITH DOUGLAS HOMES 110 VILLAGE TRAIL SUITE 115 WOODSTOCK, GA 30188 www.smithdouglas.com

SMITH DOUGLAS HOMES expressly reserves it's property rights in these plans and drawings. These plans and related drawings are not to be reproduced without written consent from SMITH DOUGLAS HOMES.



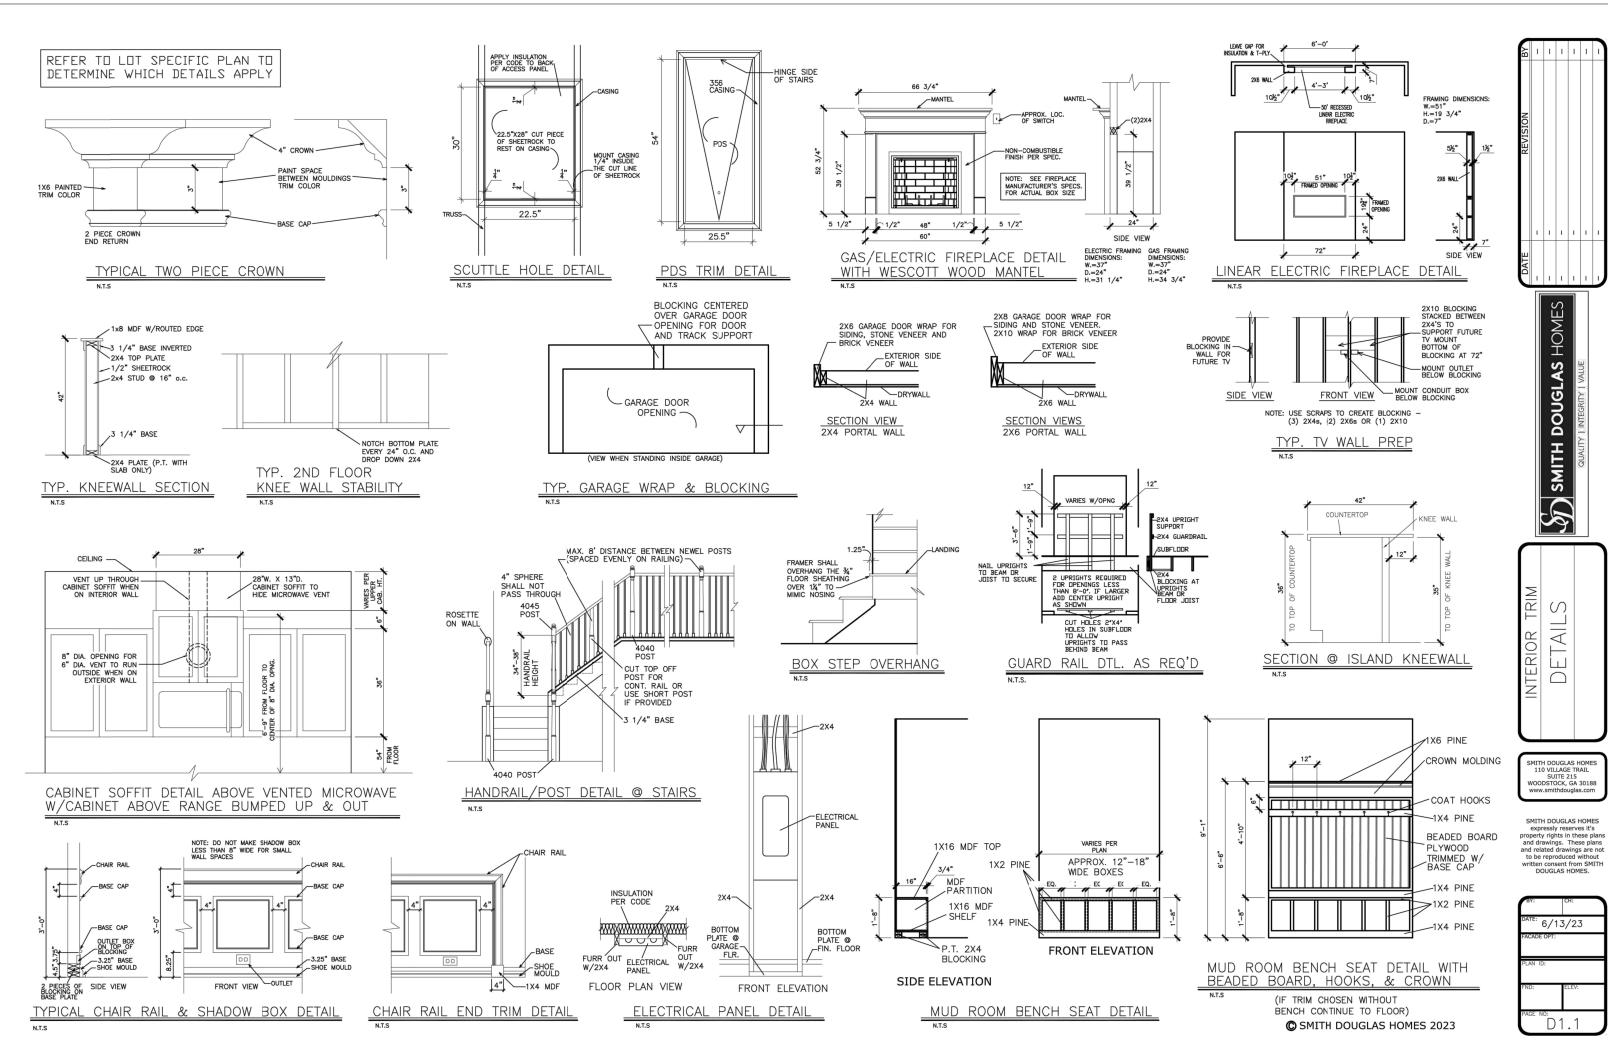

### CONNECTION SPECIFICATIONS (TYP. U.N.O.)

DESCRIPTION OF BLDG. ELEMENT	3"x0.131" NAILS	3"x0.120" NAILS
JOIST TO SOLE PLATE	(3) TOENAILS	(3) TOENAILS*
SOLE PL. TO JOIST/RIM OR BLK'G	NAILS @ 4" o.c.	NAILS @ 4" o.c.
STUD TO PLATE	(4) TOENAILS/ (3)END NAILS	(4) TOENAILS/ (4)END NAILS*
RIM TO TOP PLATE	TOENAILS @ 6" o.c.	TOENAILS @ 4" o.c.*
BLK'G. BTWN. JOISTS TO TOP PL.	(3) TOENAILS EA. END	(3) TOENAILS EA. END*
DOUBLE STUD	NAILS @ 16" o.c.	NAILS @ 16" o.c.
DOUBLE TOP PLATE	NAILS @ 12" o.c.	NAILS @ 8" o.c.
DOUBLE TOP PLATE LAP SPLICE	(I2) NAILS IN LAPPED AREA (24" MIN.)	(15) NAILS IN LAPPED AREA (24" MIN.)
TOP PLATE LAP @ CORNERS & INTERSECTING WALLS	(3) NAILS	(3) NAILS
RAFTER/TRUSS TO TOP PLATE	(4) TOENAILS +	(4) TOENAILS +
	(I) SIMPSON H2.5T	(I) SIMPSON H2.5T
GAB. END TRUSS TO DBL. TOP PL.	TOENAILS @ 8" O.C.	TOENAILS @ 6" o.c.
R.T. w/ HEEL HT. 91/4" TO 12"	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE W/ TOENAILS @ 6" O.C.	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE W/ TOENAILS @ 4" O.C.
R.T. w/ HFFL HT. 12" TO 16"	2xI2 BLK EVERY 3RD BAY	2xI2 BLK EVERY 3RD BAY
K.I. W HEEL HI. 12 10 10	FASTENED TO DBL. TOP PLATE W/ TOENAILS @ 6" O.C.	FASTENED TO DBL. TOP PLATE W/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. UP TO 24"	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C.	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C.*
R.T. w/ HEEL HT. 24" TO 48"	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL	LAP WALL SHTG. W DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL*
WALL TO FOUNDATION	WALL SHTG. LAP W/ SILL PL. & FASTENED PER SHEAR WALL FASTENING SPEC.	

2½"x0.113 IS AN ACCEPTABLE ALTERNATIVE TO A 3"X0.120", SAME SPACING OR NUMBER OF NAILS. ONLY ACCEPTABLE WHERE \* ARE SHOWN)

### ADDITIONAL NOTES FOR TRUSS & I-JOIST MANUFACTURER

ROOF TRUSS AND ENGINEERED JOISTS SHALL BE DESIGNED TO MEET THE DEFLECTION CRITERIA BELOW UNLESS NOTED OTHERWISE ON PLAN. MULHERN & KULP CANNOT BE HELD RESPONSIBLE FOR ANY STRUCTURAL ISSUES RELATED TO ANY BUILDING COMPONENT IF COMPONENT SHOP DRAWINGS ARE NOT SUBMITTED TO M&K FOR REVIEW PRIOR TO FABRICATION, DELIVERY, OR INSTALLATION.

TRUSSES/JOISTS SHALL BE DESIGNED SO THAT DIFFERENTIAL DEFLECTION BETWEEN ADJACENT PARALLEL TRUSSES/JOISTS OR GIRDER TRUSSES/FLUSH BEAMS DO NOT EXCEED THE FOLLOWING:

- ROOF TRUSSES: 1/4" DEAD LOAD
- ATTIC TRUSSES, & I-JOISTS:
- 1/8" DEAD LOAD

ABSOLUTE DEAD LOAD DEFECTION OF ATTIC TRUSSES WHEN AD JACENT TO ELOOR FRAMING BY OTHERS SHALL BE LIMITED TO 3/16". (NOT DIFFERENTIAL DEFLECTION)

### VENEER LINTEL SCHEDULE

SPAN (MAX)	HEIGHT OF VENEER ABOVE LINTEL	STEEL ANGLE SIZE
3'-0"	20 FT. MAX	L3"x3"x¼"
	3 FT. MAX	L3"x3"x¼"
6'-0"	I2 FT. MAX	L4"x3"x¼"
	20 FT. MAX	L5"x3½"x¾"
8'-0"	3 FT. MAX	L4"x4"x¼" *
0-0	I2 FT. MAX	L5"x3½"x5%"
	l6 FT. MAX	L6"x3½"x¾"
9'-6"	I2 FT. MAX	L6"x3½"x5%"

L LINTELS:

##ALL SUPPORT 2 % - 3 ½ ' VENEER w/ 40 ps MAXIMIM MEIGHT.

6/5 SHALL HAVE 4" MIN EEARING

6/5 SHALL LAVE 6" MIN EEARING

6/5 SHALL NOT BE FASTENED BACK TO HEADER.

(4) SHALL BY TEE FASTENDE DACK TO HEADER IN MALL 048°02, M/3° DIA x 3 3/5° LONG 1A6 SCREPE BY ACT LONG VERTICALLY SLOTTED HOLES, M/3° DIA x 3 3/5° LONG 1A6 SCREPE IN 2° LONG VERTICALLY SLOTTED HOLES, MAX VEREER IN APPLIED TO ANY PORTION OF PROKE OVER THE OPENING, ALL INITIES SHALL BE LONG LEG VERTICAL.
ALL INITIES SHALL BE LONG LEG VERTICAL.
BY THE SHAPPING VEREER C 3° MICE OF THE HORIZONTAL LEG MAY BE CUT IN THE FIRLD TO BE 3/2° MICE OVER THE BEARING LENGTH ONLY. THIS IS TO ALLOW FOR MORTAR LONG THISHIBIO.
SETS STRUCTURAL PLANS FOR ANY LINTEL CONDITION NOT ENCOMPASSED BY THE AROUND PARAMETERS.

R QUEEN VENEER USE L4x3x/4".

### GENERAL STRUCTURAL NOTES

### FOUNDATION

- DESIGN IS BASED ON 2018 NCSBC-RESIDENTIAL CODE \$ 2018 IRC WITH SOUTH CAROLINA AMENDMENTS
- FOOTING DESIGN 2,000 PSF NET ALLOWABLE SOIL BEARING PRESSURE IS ASSUMED. BUILDER/CONTRACTOR MUST VERIFY.
- FASTEN 2x4/6 SILL PLATES TO CONC FND WITH A MINIMUM OF 2 ANCHORS PER PLATE, I2" MAX. FROM PLATE ENDS - UTILIZING
- I/2" DIA. ANCHOR BOLTS @ 6'-0" O.C.7" MIN. EMBEDMENT FA4 ANCHOR STRAPS @ 6'-0" O.C.
- FASTEN 2xIO SILL PLATES TO PRECAST BOMT WALLS WITH A MINIMUM OF 2 ANCHORS PER PLATE, 12" MAX. FROM PLATE ENDS - UTILIZING: I/2" DIA, BOLTS @ 2'-0" O.C
- ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT W/ PERIMETER FOUNDATION SHALL BE PRESERVATIVE TREATED SOUTHERN PINE #2
- BUILDER TO VERIFY CORROSION-RESISTANCE COMPATIBILITY OF HARDWARE & FASTENERS IN CONTACT W/ PRESERVATIVE-TREATED WOOD, CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.
- FOUNDATION WALLS & FOOTINGS SHALL BE PLAIN CONCRETE, U.N.O.
- CONCRETE DESIGN BASED ON ACI 318, CONCRETE SHALL ATTAIN THE FOLLOWING MIN. COMPRESSIVE STRENGTHS IN 28 DAYS, U.N.O.:

f'c = 4,000 psi: ...... FOUNDATION WALLS 3,000 psi: ...... FOOTINGS & INTERIOR SLABS ON GRADE 3500 psi: ...... GARAGE & EXTERIOR SLABS ON GRADE eq 000,000 psi

- BASEMENT FOUNDATION WALL DESIGN BASED ON:
  - 8' OR 9' HEIGHT (AS NOTED ON PLANS) TALLER WALLS MUST BE ENGINEERED
- BASEMENT WALL DESIGN IS BASED ON 30 OR 45 PCF BACKFILL SOIL TYPE CLASSIFICATIONS:
  - 30 PCF TYPE (GW GP GW SP) 45 PCF TYPE (GM, GC, SM, SM-SC, ML)
- IMPORTANT IF 60 PCF SOIL TYPE (SC, ML-CL, OR CL) IS UTILIZED FOR BACKFILL. CONTACT MULHERN & KULP FOR FURTHER EVALUATION OF FOUNDATION DESIGN.
- BASEMENT WALLS SHALL BE BRACED PRIOR TO BACKELLING BY ADEQUATE TEMPORARY BRACING OR INSTALL 1st FLOOR DECK.
- ALL CONCRETE EXPOSED TO THE WEATHER SHALL NOT HAVE LESS THAN 5% OR MORE THAN 7% AIR ENTRAINMENT.
- ALL FOOTINGS SHALL BEAR BELOW FROST LINE (TYP.) OR 12" MIN IN REGIONS WHERE CODE FROST DEPTH IS NOT APPLICABLE. CONSULT SOILS REPORT OR BUILDING DEPT. FOR MINIMUM DEPTH BELOW
- FOOTINGS AND SLABS ON GRADE SHALL BEAR ON VIRGIN SOIL OR 95% COMPACTED FILL.
- PROVIDE CONTROL JOINTS AT ALL INSIDE CORNERS OF SLAB EDGES, AND OTHER LOCATIONS WHERE SLAB CRACKS ARE LIKELY TO DEVELOP.
- 15'-0" OC (MAXIMUM)
- JOINT GRID PATTERN SHALL BE AS CLOSE TO SQUARES AS POSSIBLE (I:I RATIO), WITH A MAXIMUM OF I:1.5 RATIO
- · CONTROL JOINTS SHALL NOT BE INSTALLED IN STRUCTURAL SI ABS

TYPICAL REINFORCEMENT DETAILS: PROVIDE 3" MIN. CLEAR COVER WHERE CAST AGAINST FARTH, LI/2" MIN, CLEAR COVER AGAINST FORMS. LAP ALL REBAR 48 BAR DIAMETERS MIN. (24" FOR #4 BARS) & BEND BARS AND LAP AT CORNERS. PROVIDE 6 HOOK INTO SUPPORTING FOOTINGS WHEN FOOTINGS INTERSECT

• DIMENSIONS BY OTHERS, BUILDER TO VERIFY.

### LEGEND

R.T. NDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUE (TYP IINO)

GRADE

OF. INDICATES TRUSS OVERFRAMING @ 24" O.C. (TYP. U.N.O.)

F.J. NDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR. JOIST MANUFACTURER SHALL DESIGN FLOOR
SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS

- INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM/HEADER
- JL METAL HANGER
- INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE

### LATERAL/WALL BRACING & WALL SHEATHING SPECIFICATIONS

THIS MODEL HAS BEEN DESIGNED TO RESIST LATERAL FORCES RESULTING FROM: MPH WIND IN 2018 NCSBC:RO

\$ 120MPH WIND IN 2018 IRC (120 MPH WIND SPEED IN ASCE 7 WIND MAP, PER IRC R301,2,1,1) EXP. B, RISK CAT. 2 & SEISMIC CAT. A/B.

HE DESIGN WAS COMPLETED PER 2015 & 2018 IBC FCTION 1609) & ASCE 7, AS PERMITTED BY R30113 THE 2018 NCSBC:RC & 2018 IRC. ACCORDINGLY THIS MODEL, AS DOCUMENTED AND DETAILED HEREWITHIN, IS ADEQUATE TO RESIST THE CODE REQUIRED LATERAL FORCES.

DESIGN WIND UPLIFT LOADS HAVE BEEN CALCULATED UTILIZING ASCE 1 (ACCEPTED) ENGINEERING PRACTICE) AS ALLOWED PER 2018 NCSBC:RC & 2018 IRC SECTION R802.11.1.1. MODEL HAS BEEN DETAILED WHERE REQUIRED & ENGINEERED TO RESIST THE WIND UPLIET LOAD PATH PER SECTIONS R602.3.5¢ R802.II.

### EXT. WALL SHEATHING SPECIFICATION

- 7/16" OSB OR 15/32" PLYWOOD: FASTEN SHEATHING W 2 3 x0.113 NAILS @ 6" O.C. AT EDGES & @ 12" O.C. IN THE PANEL FIELD. (TYP, U.N.O.)
- ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUDS, AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT ALL UNSUPPORTED PANEL EDGES & EDGE
- ALL EXT. WALLS SHALL BE CONTINUOUSLY SHEATHED AND ARE CONSIDERED SHEAR WALLS.
- ALT, STAPLE CONNECTION SPEC: 1 3/4" 16 GA STAPLES (1/6" CROWN) @ 3" O.C. AT EDGES \$ @ 6" O.C IN FIELD.

### 3" O.C. EDGE NAILING

AT DESIGNATED AREAS - FASTEN PANEL EDGES OF WOOD STRUCTURAL WALL SHEATHING TO FRAMING W 2 3 × 0.113 NAILS @ 3" O.C. AND 12" O.C. IN THE PANEL FIELD NO STAPLE ALTERNATIVE AVAILABLE AT THIS SPEC. ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEI TO STUD) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR - 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT UNSUPPORTED PANEL EDGES AND 3" O.C. EDGE FASTENING

### NOTES

- SEE CONNECTION SPECIFICATIONS CHART FOR STANDARD SHEAR TRANSFER DETAILING. IF ADDITIONAL CAPACITY IS REQUIRED BY DESIGN. T WILL BE SPECIFICALLY NOTED ON PLAN.
- DESIGN ASSUMES 16" O.C MAX. STUD SPACING, U.N.O.
- ALL STRUCTURAL PANELS ARE TO BE DIRECTLY APPLIED TO STUD FRAMING.
- PRE-MANUFACTURED PANELIZED WALLS: FASTEN TOGETHER END STUDS OF WALL PANELS SHEATHED W/ OSB OR PLYWOOD W/ 3" x 0.120 NAILS @ 4" O.C. (THRU ONE SIDE ONLY)

INDICATES EXTENT OF INT. OSB SHEARWALL, AND/OR 3" O.C. EDGE NAILING

INDICATES HOLDOWN

### FLOOR FRAMING

- I-JOISTS SHALL BE DESIGNED BY MANUE TO MEET OR EXCEED L/480 LIVE LOAD DEFLECTION CRITERIA, (EXCLUDES STONE/MARBLE OR WET BED CONSTRUCTED FLOORS - CONTACT M&K FOR EXCLUDED FLOOR DESIGNS)
- PER THE GUIDELINES OF THE TILE COUNCIL OF NORTH AMERICA (TCNA HANDBOOK), IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO VERIFY THAT THE FINISHES TO BE INSTALLED MATCH THE DESIGN CRITERIA NOTED ABOVE (UNDER "DESIGN LOADS")
- FLOOR SYSTEMS & SHEATHING HAVE BEEN DESIGNED TO SUPPORT ADDITIONAL DEAD LOAD FROM CERAMIC TILE (EXCLUDING MARBLE OR STONE) HOWEVER IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO PROVIDE PROPER UNDERLAYMENT, UNCOUPLING MEMBRANE AND MORTAR/GROUT PER THE ASSEMBLY DESIGNATIONS IN THE TONA HANDBOOK (TILE COUNCIL OF NORTH AMERICA).
- AT I-JOIST FLOORS, PROVIDE I" MIN. OSB RIM BOARD.
- METAL HANGERS SHALL BE SPECIFIED BY MANUFACTURER, U.N.O.
- REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY. FLOOR SHEATHING SHALL BE 23/32" A.P.A. RATED 'STURD-I-FLOOR'
- 24" O.C., EXPOSURE I (OR APPROVED EQUAL) WITH TONGUE AND GROOVE EDGES. FASTEN TO FRAMING MEMBERS W/ GLUE AND
- $2\frac{1}{2}$ "  $\times$  0.131" NAILS @ 6"o.c. @ PANEL EDGES & @ 12"o.c. FIELD. x 0.120" NAILS @ 4" O.C. @ PANEL EDGES & @ 8" O.C. FIELD.
- 2 🖁 × 0.113" NAILS @ 3" O.C. @ PANEL EDGES & @ 6" O.C. IN FIELD.

### ROOF FRAMING

- ROOF SHEATHING SHALL BE 7/16" A.P.A. RATED SHEATHING 24/16 EXPOSURE I (OR APPROVED EQUAL). FASTEN TO FRAMING MEMBERS w/ 2 ½" x 0.131" NAILS @ 6"o.c. @ PANEL EDGES € @ 12" O.C. FIELD.
- w/ 2 3 × 0.120 NAILS @ 4 O.C. @ PANEL EDGES & @ 8 O.C. FIELD. - w/ 2 3 × 0.113" NAILS @ 3"o.c. @ PANEL EDGES \$ @ 6" O.C. FIELD.
- WITHIN 48" OF ALL ROOF EDGES, RIDGES, & HIPS FASTEN ROOF SHEATHING FIELDS PER EDGE NAILING SPEC.
- FASTEN EACH ROOF TRUSS TO TOP PLATE W USP RTTA CLIP (OR APPROVED EQUAL) @ ALL BEARING POINTS. PROVIDE (2) RTTA CLIPS AT 2-PLY GIRDER TRUSSES, (3) RTTA CLIPS AT 3-PLY GIRDER TRUSSES & ROOF BEAMS - AT ALL BEARING POINTS.
- METAL HANGERS SHALL BE SPECIFIED BY THE MANUFACTURER, U.N.C
- ROOF TRUSS SHOP DWGS. SHALL BE SUBMITTED TO ARCH & ENG. FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY ERECT AND INSTALL ROOF TRUSSES PER WTCA & TPI'S BCSI I "GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES.
- SUPPORT SHORT SPAN ROOF TRUSSES W/2x4 LEDGER FASTENED TO FRAMING w/(2) 3" x 0.120" NAILS @ 16" O.C. (UP TO T' SPAN).

### MEANS & METHODS NOTES

AFTER THE BUILDING IS FINISHED AND ALL PLAN, DETAIL, AND NOTE SPECIFICATIONS HAVE BEEN COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE THE ERECTION PROCEDURES AND SEQUENCE TO INSURE THE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION. THIS INCLUDES, BUT IS NOT IMITED TO THE ADDITION OF NECESSARY SHORING SHEETING TEMPORARY BRACING, GUYS, AND TIE-DOWNS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING AND BRACING REQUIRED TO TABILIZE AND PROTECT EXISTING AND ADJACENT STRUCTURES AND SYSTEMS DURING COURSE OF DEMOLITION AND CONSTRUCTION OF

TRUCTURAL DESIGN AND SPECIFICATIONS ASSUME THAT ALL SUPPORTING AND NON-SUPPORTING ELEMENTS IN CONTACT WITH LOOR FRAMING ARE LEVEL, INCLUDING, BUT NOT LIMITED FOUNDATIONS, SLABS ON GRADE, BEAMS, WALLS, AND NON-BEARING LEMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIF LEVELNESS AND MAKE ADJUSTMENTS AS NECESSARY, INCLUDING CONSIDERATION OF THOSE AREAS THAT MAY BE WITHIN CONTRACTUAL, INDUSTRY, OR WARRANTY TOLERANCES.

### GENERAL STRUCTURAL NOTES

- DESIGN IS BASED ON 2018 NCSBC-RESIDENTIAL CODE & 2018 IRC
- WOOD FRAME ENGINEERING IS BASED ON NDS, "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" - LATEST EDITION.

DESIGN LOADS: ROOF

LIVE = 20 PSF DEAD = 7 PSF T.C., IO PSF B.C. LOAD DURATION FACTOR = 1.25

FLOOR LIVE = 40 PSF (30 PSF @ SLEEPING AREAS) DEAD = 10 PSF (1-JOISTS)

ADD'L IO PSF @ CERAMIC TILE IN BATHS & LAUND.

2,000 PSF ASSUMED ALLOWABLE BEARING PRESSURE (TO BE VERIFIED BY BUILDER)

### GENERAL FRAMING

- CONNECTIONS TABLE (IRC TABLE R602.3(1)) OR ON PLANS. ALL NAILS SPECIFIED ARE MIN DIAMETER AND LENGTH REQUIRED FOR CONNECTION, ALL HANGER NAILS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS FOR MAX CHARTED CAPACITY. NOTE: HANGERS USE COMMON NAIL DIAMETERS NOT TYPICAL
- EXT. & INT. BEARING WALLS SHALL BE 2x4 OR 2x6 (AS SHOWN ON PLANS) @ 16" O.C. SPF/SP "STUD" GRADE LUMBER, OR BETTER, U.N.O WALLS OVER 12' TALL SHALL BE PER PLAN.
- ALL INTERIOR BEARING WALLS ARE ASSUMED TO BE SHEATHED W/ GYP WALL BOARD (ONE SIDE MIN.) OR PROVIDE MID HT. BLOCKING
- ALL HEADERS, BEAMS & OTHER STRUCTURAL MEMBERS SHALL BE SPRUCE-PINE-FIR #2 (SPF) OR SOUTHERN PINE #2 (SP) LUMBER, OR BETTER, SUPPORT ALL HEADERS/ BEAMS W/ (1)2x JACK STUD & (1)2x
- THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE NUMBER OF JACK STUDS REQUIRED, U.N.O..
- ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED WITH 2x 'STUD' GRADE MEMBERS SPACED @ 24" O.C. (MAX., U.N.O.) . HEADERS IN NON-LOAD BEARING WALLS SHALL BE
- (I)2x4/6 FLAT @ OPENINGS UP TO 4', (2)2x4/6 FLAT UP TO 8'. ALL FRAMING LUMBER SHALL BE DRIED TO 15% MC (KD-15)
- ENGINEERED LUMBER BEAMS TO MEET OR EXCEED THE FOLLOWING: • 'LVL' - Fb=2600 psi; Fv=285 psi; E=2.0xI0^6 psi
- ENGINEERED LUMBER POSTS TO MEET OR EXCEED THE FOLLOWING:
   'LVL' Fb=2400 psi; FcII=2500 psi; E=I.8xI0^6 psi
- FOR 2 & 3 PLY BEAMS OF EQUAL 13/4" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 3"XO.120" NAILS @ 8" O/C OR 2 ROWS USP WS35 SCREWS (OR 31/3" TRUSSLOK SCREWS) @ 16" O/C, USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER.

  APPLY FASTENING AT BOTH FACES FOR 3-PLY CONDITION. LOCATE TOP & BOTTOM NAILS/SCREWS 2" FROM EDGE. SOLID 3  $\frac{1}{2}$ " OR 5  $\frac{1}{4}$ 4 BEAMS ARE ACCEPTABLE. USE 2 ROWS OF NAILS FOR 2x6 & 2x8
- FOR 4 PLY BEAMS OF EQUAL 13/4" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROMS OF USP WS6 SCREWS (OR 6 3/4" TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER. APPLY FASTENING AT BOTH FACES (ONE SIDE ONLY FOR TRUSSLOK SCREWS). LOCATE TOP AND BOTTOM SCREWS 2" FROM EDGE, A SOLID T" BEAM IS ACCEPTABLE.
- PROVIDE SOLID BLOCKING IN FLOOR SYSTEM UNDER ALL POSTS CONTINUOUS TO FND./BEARING. BLOCKING TO MATCH POST ABOVE.
- ALL EXTERIOR 4x4 WOOD POSTS SHALL HAVE USP BCS22-4 CAP & PA44E BASE, U.N.O.
- CORROSION NOTES
- BUILDER RESPONSIBLE TO DETERMINE CORROSION-RESISTANCE REQUIREMENTS AND COMPATIBILITY OF HARDWARE, FASTENERS AND CONNECTORS FOR ENVIRONMENTAL EXPOSURE AND IN CONTACT W PRESERVATIVE-TREATED WOOD OF ACTUAL FINA CONDITIONS AND SOURCED MATERIALS. CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.
- ALL FASTENERS AND CONNECTORS EXPOSED TO SALT WATER (WITHIN 300' OF SALT WATER SHORELINE, INCLUDING VENTED SPACES) SHALL BE STAINLESS STEEL.

Harrington

Lot 40

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS C-3825



Mulhern+Kulp project numbe 256-21006

SMK ILM

issue date: 10-21-202 REVISIONS


initial: JPP


SMITH DOUGI HOMES


STRUCTURAL NOTES  $\Xi$ MODI


ZONI COLEMAN WIND 021 0 0 0

GENERAL

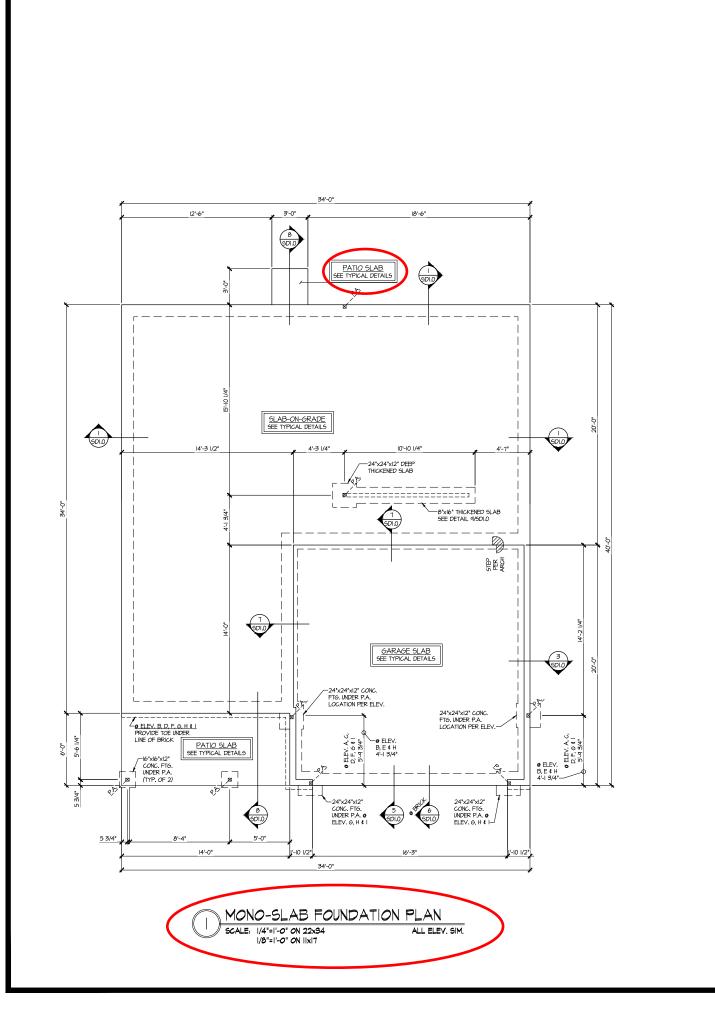

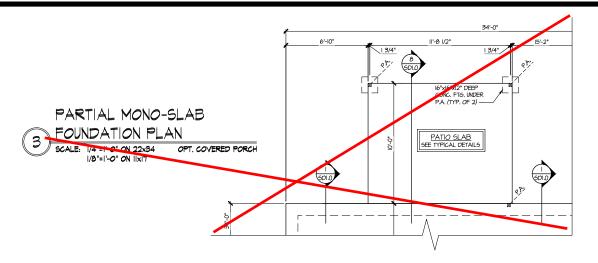

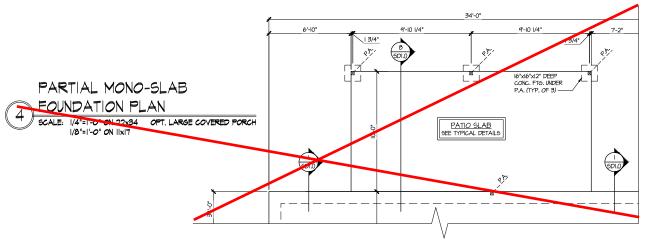

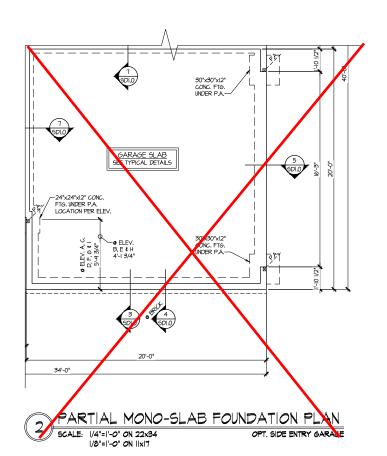

Harrington Lot 40

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

### LEGEND

• R.T. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. UNO.)

F-J. NDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

D.J. NDICATES 2x8 P.T. DECK JOISTS @ 16" O.C. (MAX.) INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• IIIIIII INTERIOR BEARING WALL

• CTTT BEARING WALL ABOVE (B.W.A.)

• --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING

2005 Encloside Parkway, Suite 1964 - Agent 1970-177-1974 - Implementationary NC License # C-3825



Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:


initial: JPP

SMITH DOUGLAS HOMES

MODEL FOUNDATION

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

MONO-SLAB

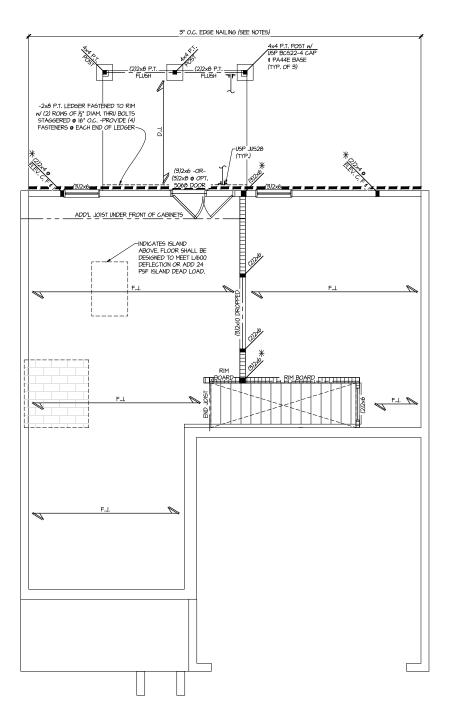


IST FLOOR FRAMING PLAN

SCALE: |/4"=|'-0" ON 22x34 |/8"=|'-0" ON ||x|7

ALL ELEV. SIM.

PARTIAL IST FLOOR FRAMING PLAN SCALE: 1/4"=1"-0" ON 22x34 OPT. EXT. DECK 1/8"=1'-0" ON 11x17 COVERED DECK SIM.

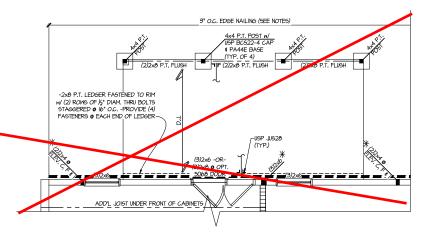

Harrington Lot 40

THIS LEVEL HAS BEEN DESIGNED FOR 9'-I" PLATE HEIGHT

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

### LEGEND

• R.T. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

F.J. NDICATES 14" DEEP FLOOR I-JOISTS (24" O.C. MAX SPACING). JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER

• D.J. INDICATES 2x8 P.T. DECK JOISTS • 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR. L JOIST MANUFACTURER SHALL DESIGN FLOOR F SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• IIIIII INTERIOR BEARING WALL

• CTTT BEARING WALL ABOVE (B.W.A.)

• --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

8/1/23

MUCHERNAL STRUCTURAL ENGINEERING
TESTINGTHE RANGE STREET STRUCTURAL ENGINEERING
TESTINGTHE RANGE STREET STR



Mulhern+Kulp project number: 256-21006

SMK MJF

issue date: 10-21-202

REVISIONS:

initial: JPP


SMITH DOUGLAS HOMES

PLAN COLEMAN MODEL FLOOR FRAMING

120 MPH WIND ZONE NORTH CAROLINA


ST

**S2.0** 

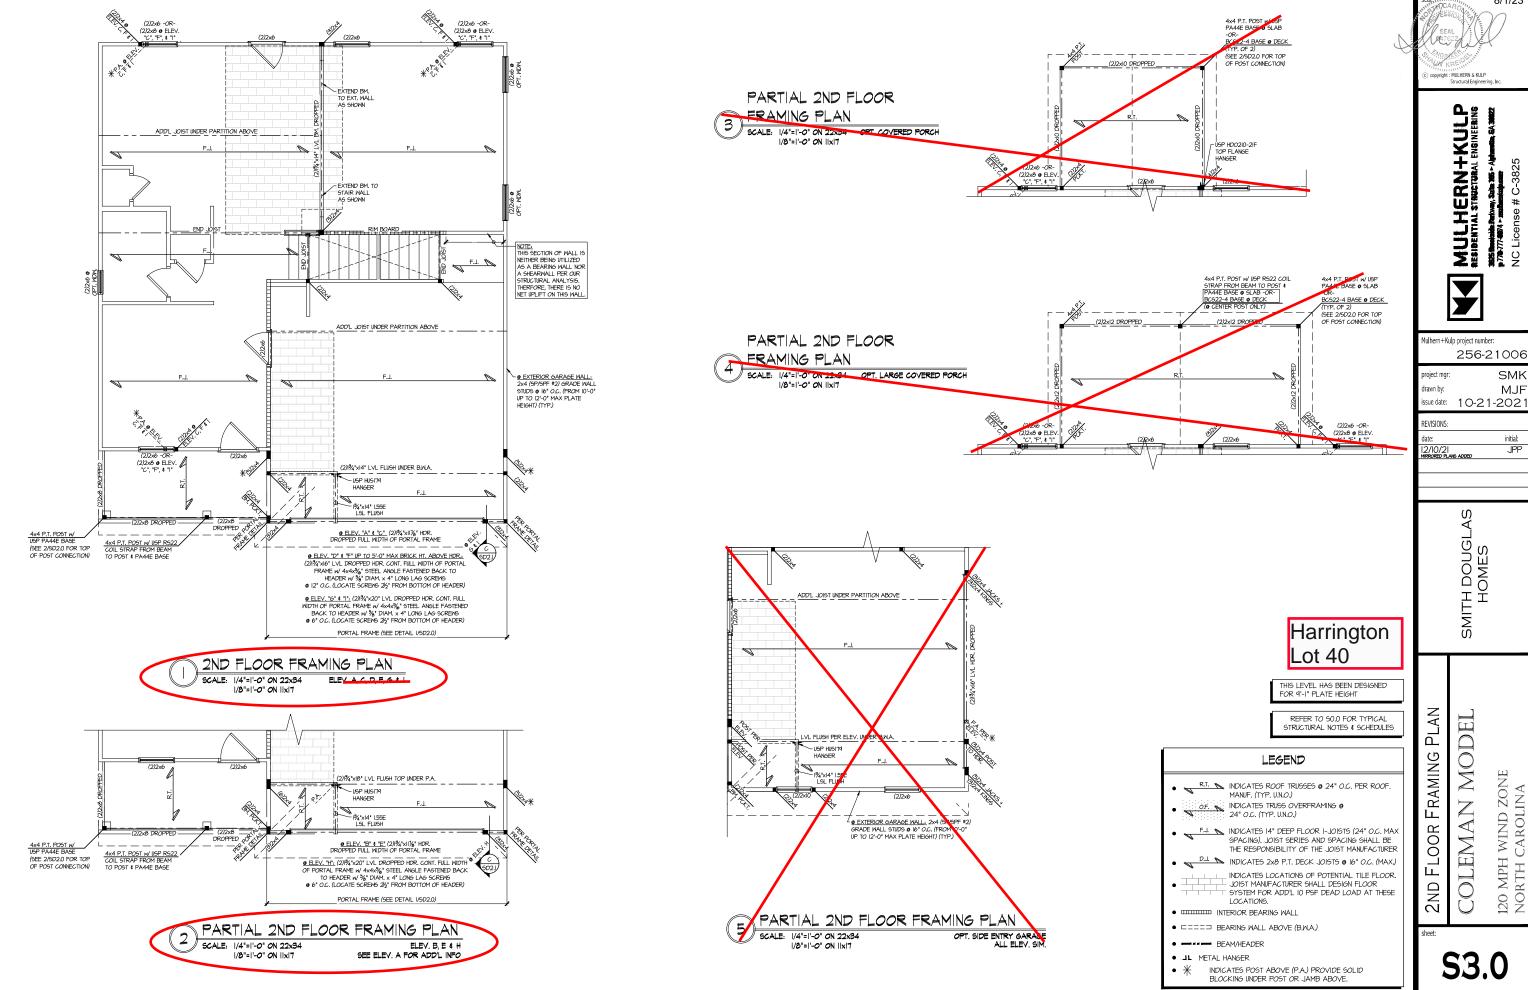

8/1/23

SMK

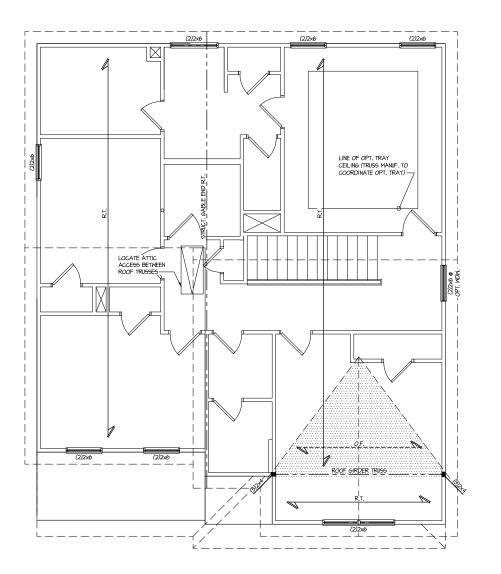



8/1/23

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENSINEERING

RESERVAÇÃO STRUCTURAL ENSINEERING

FINATION OF THE STRUCTURAL ENSINTIES

FIN



Mulhern+Kulp project number:

256-21006

SMK MJF issue date: 10-21-202

initial: JPP

SMITH DOUGLAS HOMES

COLEMAN MODEL

### LEGEND

Harrington

THIS LEVEL HAS BEEN DESIGNED FOR 9'-I" PLATE HEIGHT

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

Lot 40

• --- BEAM/HEADER

• JL METAL HANGER

INDICATES POST ABOVE (P.A.) PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

• RT. INDICATES ROOF TRUSSES @ 24" O.C. PER ROOF. MANUF. (TYP. U.N.O.)

• OF. INDICATES TRUSS OVERFRAMING • 24" O.C. (TYP. U.N.O.)

F.J. NDICATES 14" DEEP FLOOR 1-JOISTS (24" O.C. MAX SPACING), JOIST SERIES AND SPACING SHALL BE THE RESPONSIBILITY OF THE JOIST MANUFACTURER • D.J. INDICATES 2x8 P.T. DECK JOISTS • 16" O.C. (MAX.)

INDICATES LOCATIONS OF POTENTIAL TILE FLOOR.

JOIST MANUFACTURER SHALL DESIGN FLOOR
T SYSTEM FOR ADD'L 10 PSF DEAD LOAD AT THESE LOCATIONS.

• IIIIII INTERIOR BEARING WALL


● □□□□□ BEARING WALL ABOVE (B.W.A.)

ROOF


FRAMING PLAN

**S4**.


120 MPH WIND ZONE NORTH CAROLINA

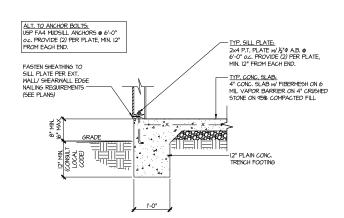








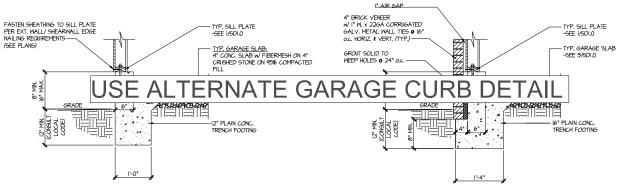


TYPICAL SLAB ON GRADE GARAGE 3 PERIMETER FOOTING




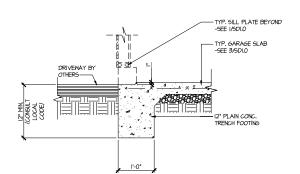


TYPICAL SLAB ON GRADE GARAGE 5 ENTRY @ PERIMETER FOOTING



TYPICAL SLAB ON GRADE GARAGE 6 ENTRY @ PERIMETER FOOTING




TYPICAL MONOLITHIC INTERIOR GARAGE FOOTING

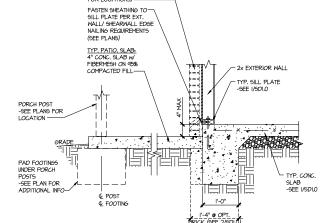

OPT. BRICK (SEE ARCH FOR LOCATIONS)

TYPICAL SLAB ON GRADE PERIMETER FOOTING @ PORCH/PATIO



TYPICAL THICKENED SLAB @ 9 INTERIOR BEARING WALL



8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERINS 265 Street city Parkey, Suite 255 - Agina 2-778-777-4874 - memberschapen NC License # C-3825

Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES

MODEL FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

**SD1.0** 



MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING

3625 Brookside Parkway, Suite 165, Alpharetta, GA 30022 🔻 p 770-777-0074 🔻 mulhernkulp.com

August 18, 2023

lody Hunt

Director of Product Development

### **SMITH DOUGLAS HOMES**

110 Village Trail, Suite 215 Woodstock, GA 30188

## **ALTERNATE GARAGE CURB DETAIL**

### Smith Douglas Homes

### Reference

Current Structural Plans prepared by Mulhern & Kulp


Jody:

these are an acceptable alternative to the 6" wide curb at the garage per M&K foundation details 3 & 4 on sheet SD-1.0 at 2x4 garage Pursuant to your request, we have prepared this letter to address the "Alternate Garage Curb Details", prepared by Mulhern & Kulp for Smith Douglas Homes shown below. The foundation details shown below call for a 4" wide curb with a maximum of 8" stem wall height; wall locations.

TYP. SILL PLATE.

2x4 P.T. PLATE W/K'O A.B. (B)
6'-O'. OZ. PRZVIDE (2) PER PLATE,
MIN. 12" FROM EACH BND.

8"MAX. STEM HEIGHT

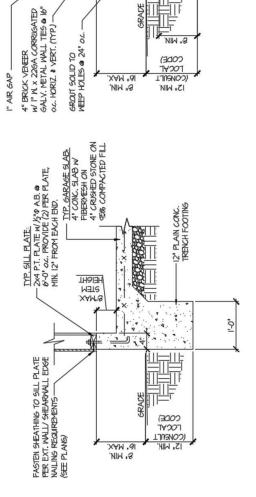

.XAM "&I

NIM .8

(3002€) | TOCYT | (CONFOITL | IS., WIN

TYPICAL SLAB ON GRADE GARAGE PERIMETER FOOTING m

TYPICAL SLAB ON GRADE GARAGE PERIMETER FOOTING

1

Please feel free to call if you have any questions.

A/ BRICK VENER

MANDER

Respectfully,


# **MULHERN & KULP STRUCTURAL ENGINEERING, INC.**

NC License # C-3825

Project Manager + Atlanta Office Director Shaun M. Kreidel, P.E.



P:|Client Files|256 - Smith Douglas Homes|2023|23000 - 2023 Client Admin|2023-08-17 - 4in Garage Curb Letter|Alternate Garage Curb Detail - Letter - NC.docx

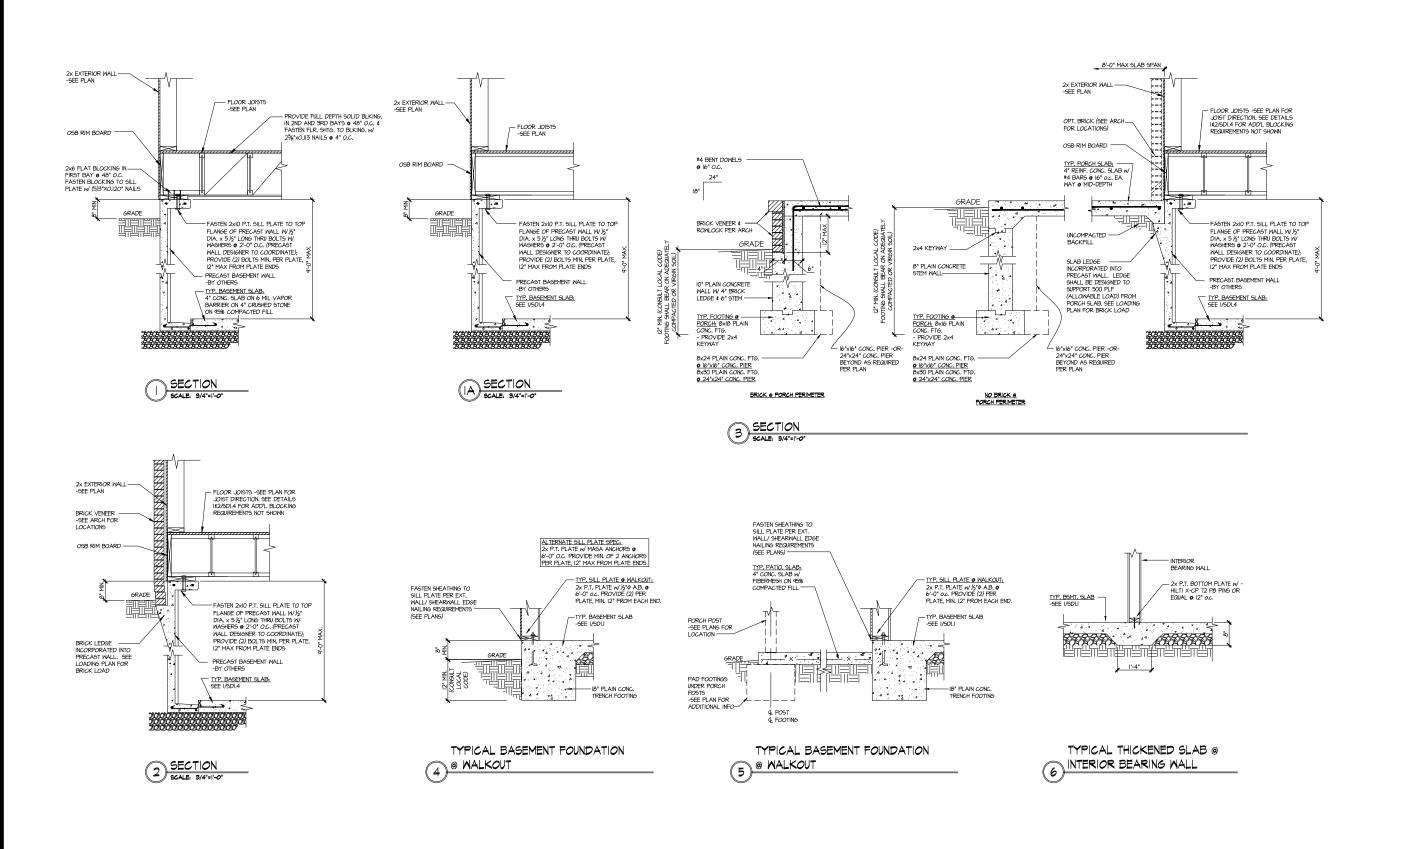

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING

NC License # C-3825

Mulhern+Kulp project number: 256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES


MODEL FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

Harrington

Lot 40

**SD1.4** 

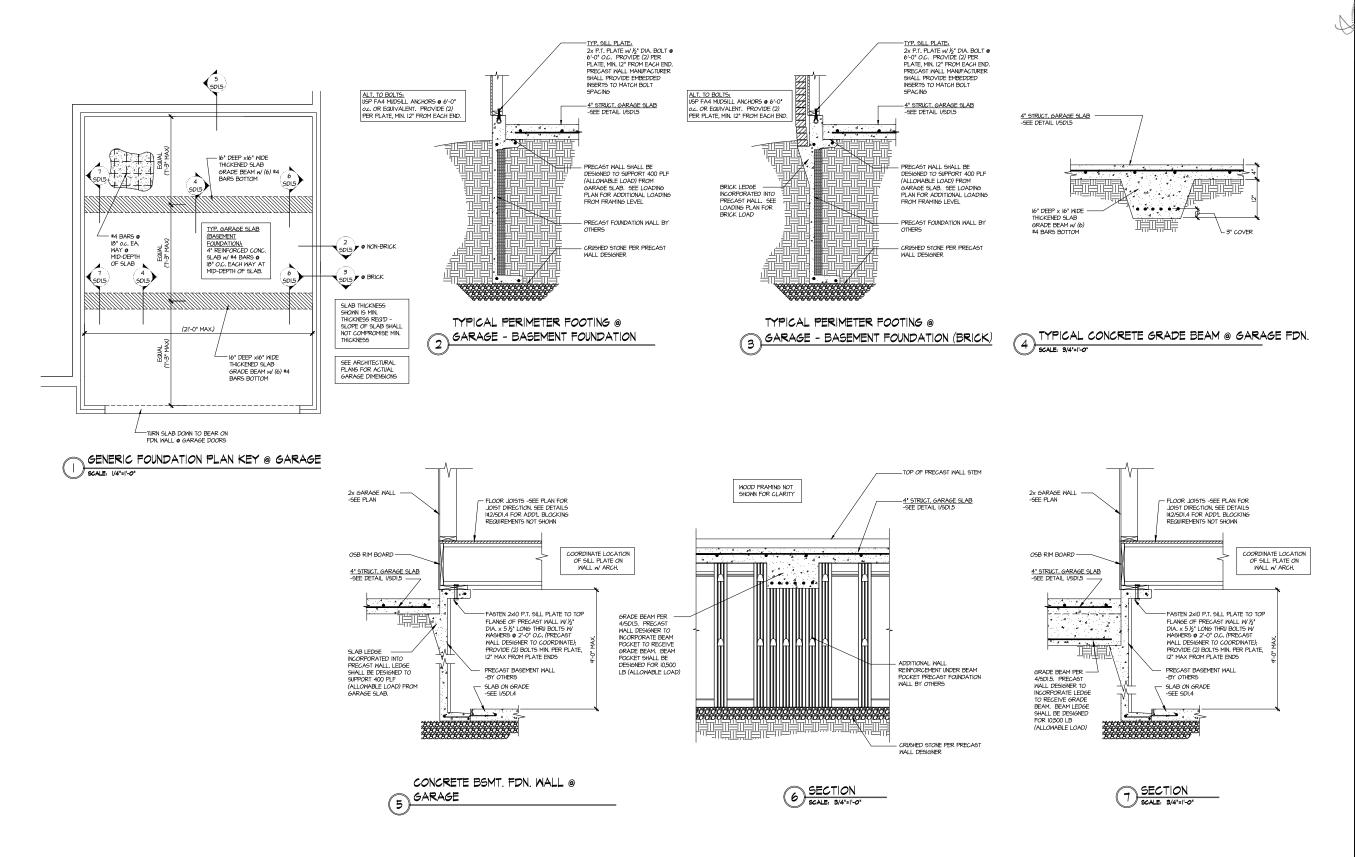

Harrington Lot 40

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENSINEERINS • T/1-474 ► market appearance | C-3825

Y

Mulhern+Kulp project number: 256-21006

SMK drawn by: MJF issue date: 10-21-202

REVISIONS:


initial: JPP

SMITH DOUGLAS HOMES


MOD FOUNDATION DETAILS

120 MPH WIND ZONE NORTH CAROLINA COLEMAN

**SD1.5** 

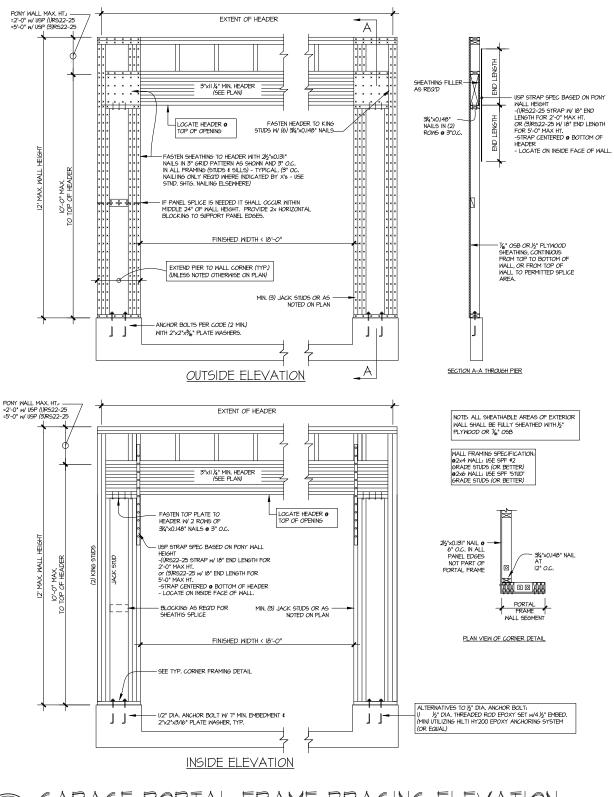

GARAGE PORTAL FRAME BRACING ELEVATION SCALE: N.T.S. BOTH SIDES OF GARAGE DOOR 120 MPH WIND SPEED (ULT)

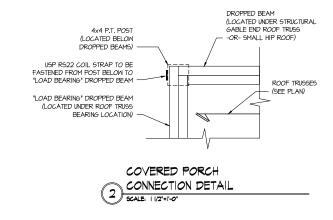

8/1/23

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENSINEERINS

2855 medicide Perkway, Sulte 1865 - Apha 2778-777-8874 - mediamidahan NC License # C-3825

Mulhern+Kulp project number:

256-21006

SMK MJF issue date: 10-21-202

REVISIONS:

initial: JPP

SMITH DOUGLAS HOMES


MODEL


FRAMING DETAILS COLEMAN

Harrington Lot 40

**SD2.0** 


120 MPH WIND ZONE NORTH CAROLINA

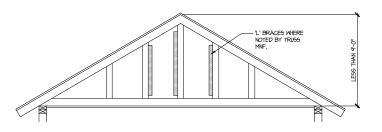

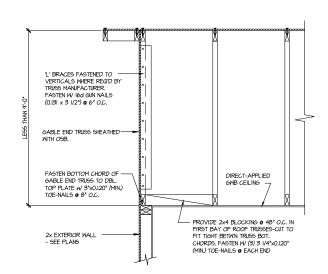


BRACE GABLE END TRUGGES PER ABOVE DETAIL WHEN GABLE HEIGHT IS LESS THAN 9"-0". "L" BRACES REQUIRED WHERE NOTED BY TRUGS MANUFACTURER.

TYPICAL GABLE END BRACING DETAIL SCALE: NONE REGIO & GABLE END TRUSS

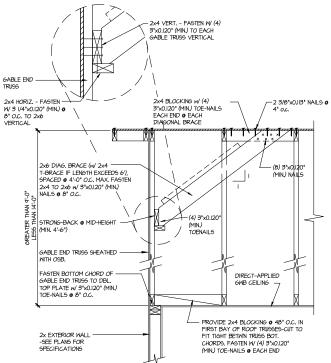

TYPICAL GABLE END BRACING DETAIL
SCALE: NONE REGOL & GABLE END TRUGG
HEIGHT BETWIN 91-07 TO 141-07

BRACE GABLE END TRUSSES PER ABOVE DETAIL WHEN GABL

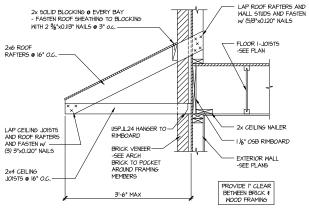

DETAIL @ PENT ROOF

SCALE: 3/4"=1"-0"

LETTERED DETAILS ARE TYPICAL FOR THIS HOME & SHALL BE IMPLEMENTED IN ALL APPLICABLE AREAS. THESE DETAILS ARE NOT "CUT" ON THE PLANS. NUMBERED DETAILS ARE PLAN SPECIFIC AND ARE ONLY REQUIRED WHERE SPECIFICALLY INDICATED ("CUT") ON THE PLANS.

> Harrington Lot 40

SEAL BITTON SILLP

(Copping MUHERN & KULP

Structural Engineering, Inc.

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENSINERRING

RESIDENTIAL ENS

**Y** 

Mulhern+Kulp project number: 256-21006

project mgr: SMK drawn by: MJF issue date: 10-21-202

REVISIONS:

date: initial:
12/10/21 JPP


SMITH DOUGLAS HOMES

FRAMING DETAILS
COLEMAN MODEL

COLEMAN MO 120 MPH WIND ZONE NORTH CAROLINA


SD2.1

### 72421833 40 HARRINGTON PLACE

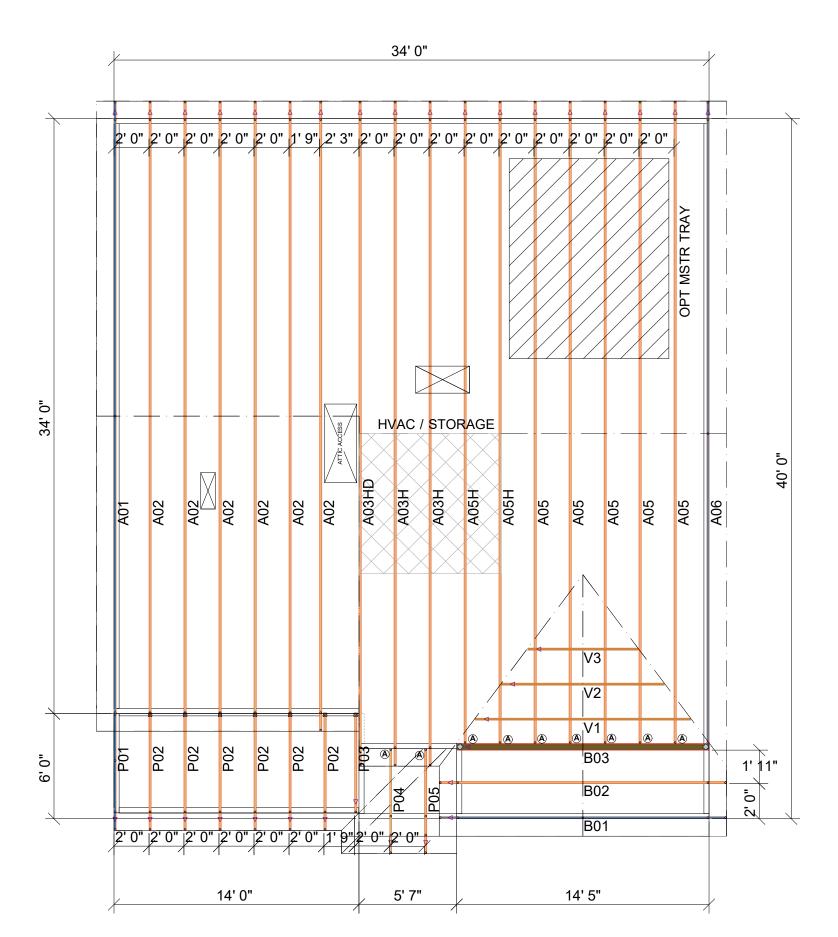

Roof Hanger List				
MARK	TYPE	DESCRIPTION	QTY	
(A)	HUS26	FACE MOUNT HANGER	9	

### COLEMAN BEH NO TRAY

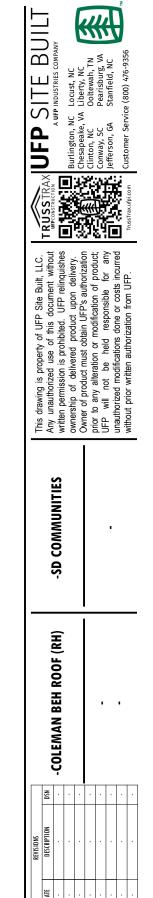

DESIGNER -THATHCOCK
LAYOUT DATE -04.11.2022
ARCH DATE -


JOB #: -22040623

**PLACEMENT PLAN** 

SCALE: N.T.S

A1 1/8" RIMBOARD BAND

1 1/8" RIMBOARD BAND

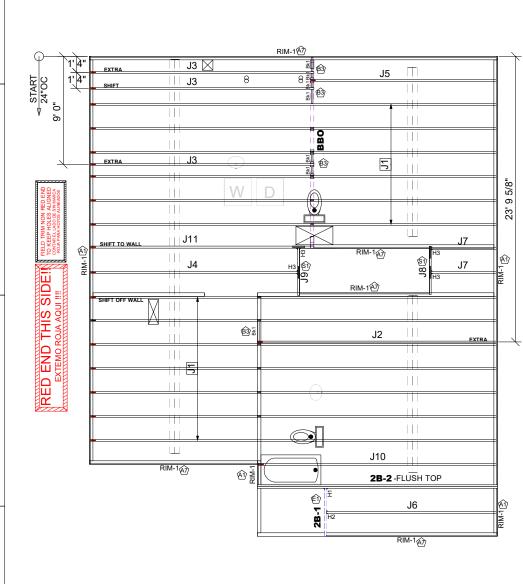

		Products			
PlotID	Length	Product	Plies	Net Qty	Fab Type
J1	34' 0"	14" TJI® 110	1	13	MFD
J2	20' 0"	14" TJI® 110	1	1	MFD
J3	19' 0"	14" TJI® 110	1	3	MFD
J4	18' 0"	14" TJI® 110	1	1	MFD
J5	16' 0"	14" TJI® 110	1	1	MFD
J6	15' 0"	14" TJI® 110	1	1	MFD
J7	6' 0"	14" TJI® 110	1	2	MFD
J8	5' 0"	14" TJI® 110	1	1	MFD
J9	4' 0"	14" TJI® 110	1	1	MFD
J10	20' 0"	14" TJI® 210	1	1	MFD
J11	19' 0"	14" TJI® 210	1	1	MFD
2B-1	4' 0"	1 3/4" x 14" 2.0E Microllam® LVL	1	1	MFD
2B-2	20' 0"	1 3/4" x 18" 2.0E Microllam® LVL	2	2	MFD
RIM-1	16' 0"	1 1/8" x 14" TJ® Rim Board	1	10	FF
Bk1	2' 0"	14" TJI® 110	1	7	MFD

Connector Summary			
PlotID	Qty	Manuf	Product
H1	1	USP	HUS179
H2	1	USP	IHFL1714
Н3	4	USP	TFL1714

### **GENERAL NOTES:**

1.) TOP CHORD OF JOISTS ARE PAINTED RED AT NUMBERED END. PLACE PAINTED END AS

NOTED ON PLAN. 2.) FOLLOW SPECIAL SPACING AND LOCATION DIMENSIONS FOR EXTRAS OR SHIFTED JOISTS AS SHOWN ON PLAN.

AS SHOWN ON PLAN.
3.) ALL INTERIOR WALL PLATES MUST BE LEVEL WITH OUTSIDE WALL TOP PLATES.
4.) DO NOT STACK CONSTRUCTION LOADS ON UN-BRACED JOISTS.
5.) PROVIDE SOLID SUPPORT BELOW ALL BEAM AND HEADER BEARING POINTS IN WALL AND JOIST SPACES CONTINUOUS DOWN TO THE FOUNDATION.
6.) LOCATE CRIPPLE STUDS IN JOIST SPACE DIRECTLY BELOW HEADER JACKS AT ALL FIRST FLOOR EXTERIOR DOOR LOCATIONS.
7.) INSTALL NAILS IN ALL HOLES PROVIDED IN

(.) INSTALL NAILS IN ALL HOLES PROVIDED IN JOIST HANGERS EXCEPT AT BOTTOM CHORD SEAT. PLACE A DAB OF GLUE IN THE HANGER SEAT BEFORE SETTING JOISTS

BEAT BEFORE SET TIME JUSTIS.

8.) IMPORTANT NOTE! NO STRUCTURAL

ANALYSIS OF CONVENTIONAL HEADERS HAS

BEEN CONDUCTED IF NOT NOTED. THEY ARE CONSIDERED TO BE ADEQUATE TO SUPPORT THE APPLIED LOADS.

### FRAMER NOTE

DENOTES DUCT HOLE RUNS ALL DIMENSIONS TO CENTERLINE UNLESS OTHERWISE NOTED

• Avoid Plumbing Drops

### FRAMER NOTE

GLUE AND NAIL PLYWOOD SUBFLOOR TO BEAMS AND GIRDERS AT 6" O/C WHERE NO WALL IS ABOVE. 2. FILL HANGER SEAT WITH GLUE

BEFORE SETTING JOIST IN HANGER. FILL ROUND HOLES WITH

### CRITICAL !!

INSTALL 2X4 SQUASH BLOCKS IN FLOOR TRUSS SPACE BELOW ALL EXTERIOR DOOR HEADER JACKS. CUT 1/16" TALLER THAN TRUSS.

### PLAN LEGEND

1B-, 2B-

\*INDICATES BEAM ABOVE TOP PLATE (FLUSH WITH FLOOR SYSTEM)

H-, 1H-, GDH- INDICATES BEAM BELOW TOP PLATE (DROPPED BELOW FLOOR SYSTEM)

\*BEAMS MAY PROTRUDE ABOVE OR BELOW DECKING OR TOP PLATE RESPECTIVELY, REFER TO DETAIL IF BEAM IS A DIFFERENT DEPTH THAN FLOOR SYSTEM

(ADD LINE FOR EACH ADDITIONAL PLY)

SHIFT JOIST TO MISS PLUMBING, ALIGN W/WALL OR SUPPORT FURNITURE A JOIST ADDED TO THE LAYOUT IN ADDITION TO THE ON CENTER JOISTS

DOUBLE

FIELD TRIM NON RED END TO KEEP HOLES ALIGNED CONTAR EL LADO DE SIN MARCA **ROJA PARA HOYOS ALINEADOS** 

*\_\_\_\_\_\_* **FIELD LOCATE PLUMBING DROPS/CAN LIGHTS, ETC... PRIOR TO JOIST SECUREMENT TO** AVOID INTERFERENCE.

LAYOUT FOR 19.2" O/C

1= 19-3/16" 9= 172-13/16" 2= 38-3/8" 10= 192" 3=57-5/8" 11= 211-3/16" 4= 76-13/16" 12= 230-3/8" 5= 96" 13= 249-13/16" 14= 268-13/16" 6= 115-3/16" 7= 134-3/8" 15= 288" 8= 153-5/8"

FIELD VERIFY DIMENSIONS TO **JOISTS LOCATED UNDER WALLS!!** 

2ND FLOOR LAYOUT

2ND FLOOR PLACEMENT PLAN

SCALE: 1/8"=1'



BUILT

ةً لـــا S | S

UFP

製業

use of this documents prohibited. UFP relayed product upon coust obtain UFP's author or modification of higher relayed responsal.

**Douglas** I

Smith

2nd

Coleman

DESIGNER PB2 LAYOUT DATE 7/9/2024 ARCH DATE 12/2/2021 **STRUC DATE** 5/24/2023

JOB #: 24070546F2