

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 52105

JOB: 24-7417-F02

JOB NAME: LOT 0.0036 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

30 Truss Design(s)

Trusses:

F200, F201, F202, F202A, F203, F204, F205, F206, F207, F208, F209, F209A, F209B, F210, F211, F212, F213, F215, F216, F217, F218, F219, F220, F221, F222, F223, F224, F225,



9/6/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSL/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI


Job 24-7417-F02	Truss F200	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:45 2024 Page 1
ID:oDuW00MhLxMOJ2fwcp2aKqzMG6w-c_tVHPWKZP3kO34axvR8GT4XGWKqz4rF55lqiyfwDq

0₁-8

0₁-8

Scale = 1:21.3

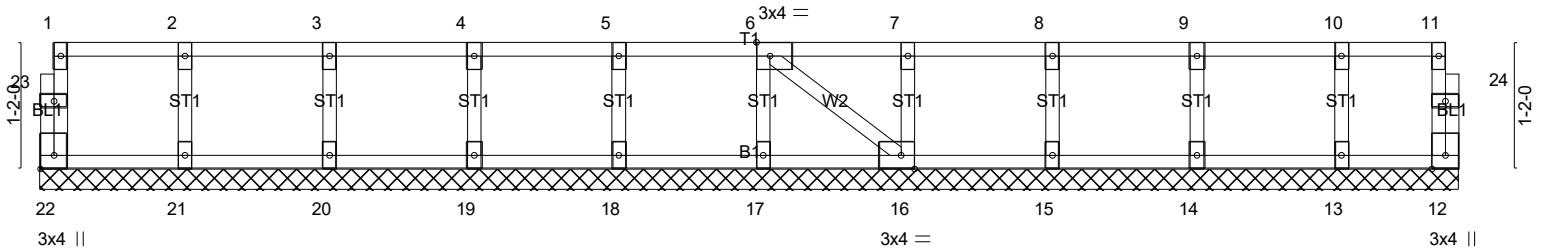

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-1-0
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-1-0

Plate Offsets (X,Y)-- [6:0-1-8,Edge], [16:0-1-8,Edge], [22:Edge,0-1-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 58 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 13-1-0.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard





9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F201	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:46 2024 Page 1
ID: oDuW00MhLxMOj2fwcp2aKqzMG6w-5AQuUIXyKjBb0DfnVdyNogdeTwaQiQVpKIVOEpyfwDp

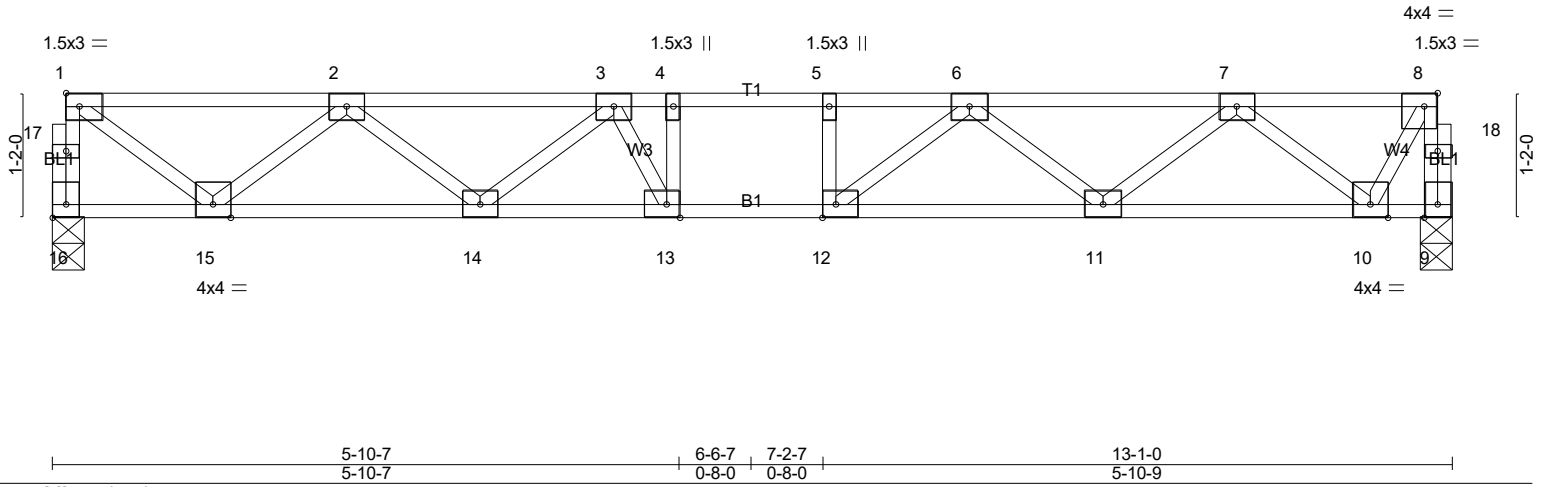

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.28	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.43	Vert(LL) -0.08 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.45	Vert(CT) -0.12 12-13 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=700/0-3-8 (min. 0-1-8), 9=700/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 16-17=-695/0, 1-17=-694/0, 9-18=-701/0, 8-18=-700/0, 1-2=-787/0, 2-3=-1803/0, 3-4=-2148/0, 4-5=-2148/0, 5-6=-2148/0, 6-7=-1569/0, 7-8=-388/0
BOT CHORD 14-15=0/1472, 13-14=0/2107, 12-13=0/2148, 11-12=0/1980, 10-11=0/1127
WEBS 4-13=-254/95, 1-15=0/952, 2-15=-891/0, 2-14=0/431, 3-14=-395/0, 3-13=-160/368, 6-12=-25/412, 6-11=-534/0, 7-11=0/576, 7-10=-962/0, 8-10=0/723

NOTES- (4)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC
24-7417-F02	F202	Floor	2	1	Job Reference (optional) # 52105

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:46 2024 Page 2
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-5AQuUIXyKjBb0DfnVdyNogdcLwY6iKPPKIV0EPyfwDp

LOAD CASE(S) Standard

- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-8=-20, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-8=-20, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-5=-100, 5-8=-20, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-4=-20, 4-8=-100, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 9) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-5=-100, 5-8=-20, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 10) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-4=-20, 4-8=-100, 8-9=-180
 - Concentrated Loads (lb)
 - Vert: 9=-3680



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F202A	Truss Type Floor	Qty 3	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:47 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-ZN_Gi4Ya50JSdMDz3KtCu9n7JuLRncYYPExnryfwDo

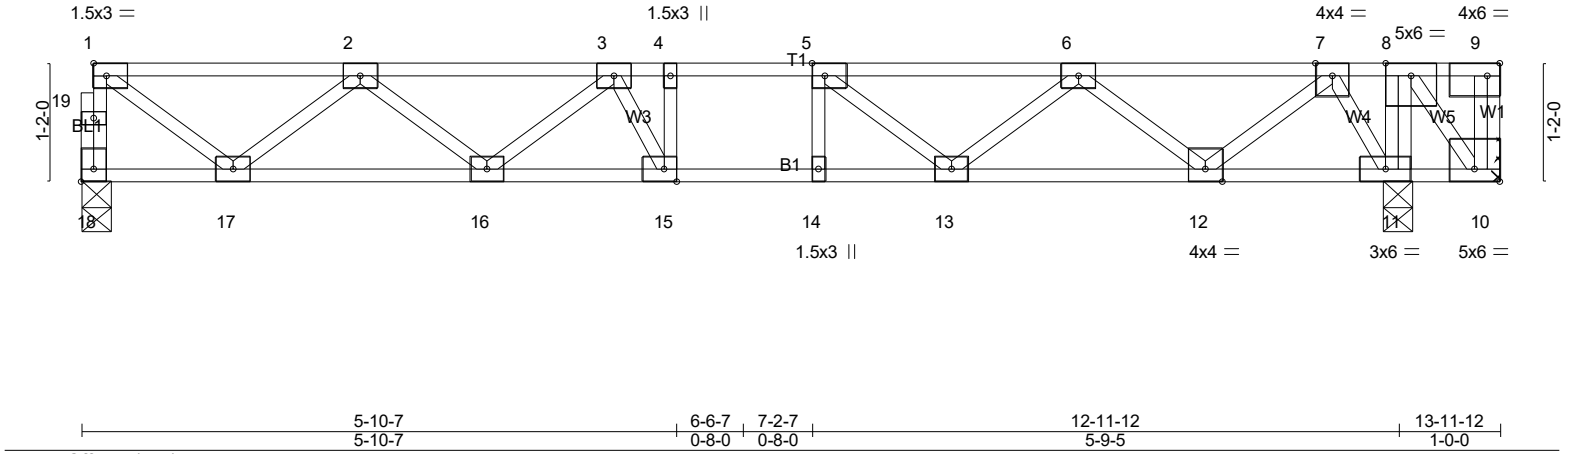



Plate Offsets (X,Y)-- [5:0-1-8,Edge], [9:0-1-8,Edge], [10:Edge,0-1-8], [15:0-1-8,Edge], [18:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.42	Vert(LL) -0.07 15-16 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.52	Vert(CT) -0.10 15-16 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.85	Horz(CT) 0.02 11 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH		Weight: 75 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12,10-11.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 18=605/0-3-8 (min. 0-1-8), 10=2325/Mechanical, 11=2253/0-3-8 (min. 0-1-8)
Max Grav 18=605(LC 1), 10=3349(LC 4), 11=2253(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 18-19=-599/0, 1-19=-598/0, 9-10=-3706/0, 1-2=-661/0, 2-3=-1460/0, 3-4=-1574/0, 4-5=-1574/0, 5-6=-1161/0, 7-8=0/1144
BOT CHORD 16-17=0/1236, 15-16=0/1635, 14-15=0/1574, 13-14=0/1574, 12-13=0/767, 11-12=-650/0, 10-11=-1144/0
WEBS 8-11=-1430/0, 1-17=0/798, 2-17=-748/0, 2-16=0/291, 3-15=-274/176, 5-13=-528/0, 6-13=0/513, 6-12=-910/0, 7-12=0/935, 7-11=-931/0, 8-10=0/1778

- NOTES-** (7)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Refer to girder(s) for truss to truss connections.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.

- LOAD CASE(S)**
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 10-18=-10, 1-9=-100
Concentrated Loads (lb)
Vert: 9=-3680
 - Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 10-18=-10, 1-9=-100
Concentrated Loads (lb)
Vert: 9=-3680
 - 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 10-18=-10, 1-8=-100, 8-9=-20
Concentrated Loads (lb)
Vert: 9=-3680



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC
24-7417-F02	F202A	Floor	3	1	Job Reference (optional) # 52105

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:47 2024 Page 2
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-ZN_Gi4Ya50JSdMDz3KTcLu9n7JuLRncYYPExnryfwDo

LOAD CASE(S)

- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-8=-20, 8-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-8=-100, 8-9=-20
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-8=-20, 8-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-5=-100, 5-8=-20, 8-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-4=-20, 4-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 9) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-5=-100, 5-8=-20, 8-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680
- 10) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 10-18=-10, 1-4=-20, 4-9=-100
 - Concentrated Loads (lb)
 - Vert: 9=-3680



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F204	Truss Type Floor	Qty 4	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	---------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:48 2024 Page 1
ID: oDuWOOMhLxMOj2fwcp2aKqzMG6w-1ZYevQZCsKRJFWo9d2_rt5iyjC9AJ8hn2_UJHyfWdN



Scale = 1:35.1

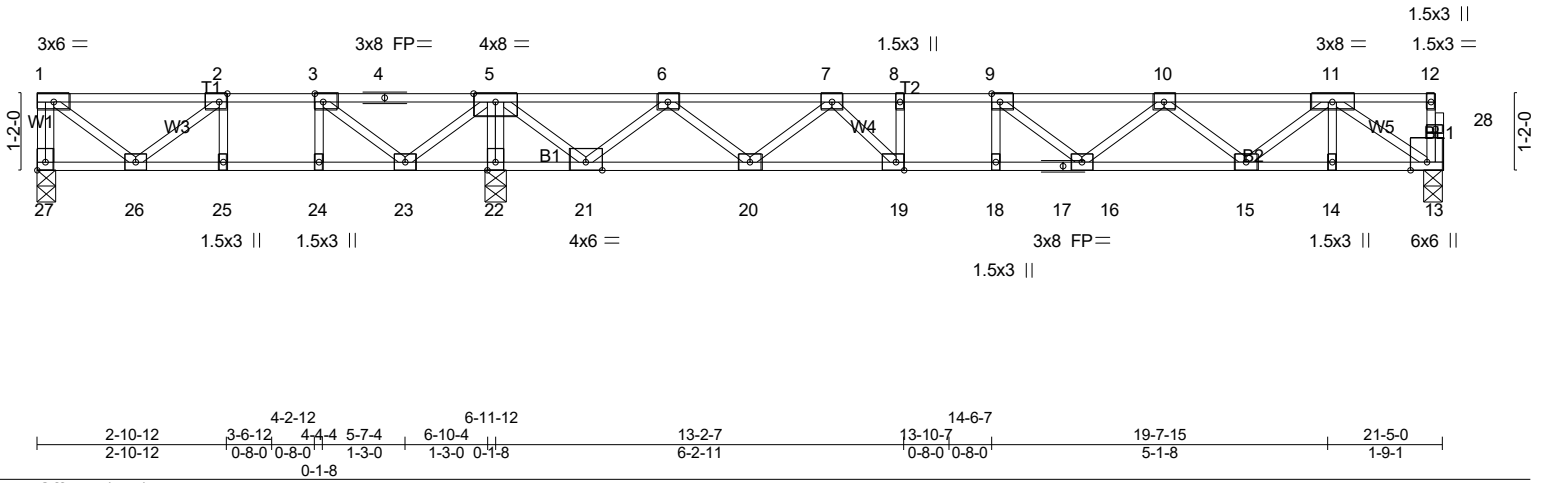


Plate Offsets (X,Y)-- [2:0-1-8,Edge], [3:0-1-8,Edge], [9:0-1-8,Edge], [19:0-1-8,Edge], [27:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.42	Vert(LL)	-0.13	16-18	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.67	Vert(CT)	-0.17	16-18	>997		
BCLL 0.0	Lumber DOL 1.00	WB 0.57	Horz(CT)	0.03	13	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
							Weight: 110 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 27=214/0-3-8 (min. 0-1-8), 22=1404/0-3-8 (min. 0-1-8), 13=703/0-3-8 (min. 0-1-8)
Max Uplift 27=-50(LC 4)
Max Grav 27=322(LC 3), 22=1404(LC 1), 13=716(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-27=-321/42, 1-2=-266/105, 2-3=-459/331, 3-4=-62/694, 4-5=-62/694, 6-7=-1448/0, 7-8=-2225/0, 8-9=-2225/0, 9-10=-2163/0, 10-11=-1527/0
BOT CHORD 25-26=-331/459, 24-25=-331/459, 23-24=-331/459, 22-23=-1138/0, 21-22=-1138/0, 20-21=0/948, 19-20=0/1946, 18-19=0/2225, 17-18=0/2225, 16-17=0/2225, 15-16=0/2021, 14-15=0/990, 13-14=0/990
WEBS 3-24=0/259, 8-19=-251/0, 5-22=-1349/0, 1-26=-132/333, 2-26=-245/287, 3-23=-765/0, 5-23=0/627, 5-21=0/1203, 6-21=-1112/0, 6-20=0/692, 7-20=-699/0, 7-19=0/576, 10-16=0/258, 10-15=-644/0, 11-15=0/686, 11-13=-1185/0

- NOTES-** (6)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 27.
4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F205	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:48 2024 Page 1
ID:oDuWOOMhLxMOj2fwcp2aKqzMG6w-1ZYevQZCsKRJFWo9d2_rt5ixjjC5A11hn2_UJHyfWdn



0-1-8
0-3-1
Scale = 1:39.3

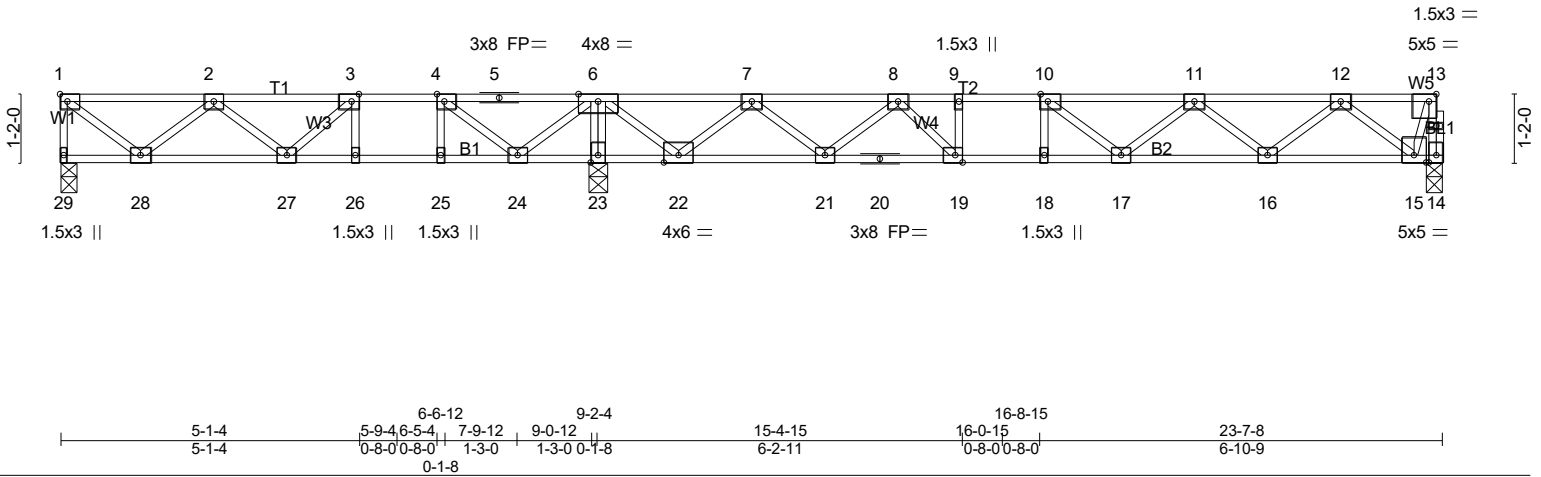


Plate Offsets (X,Y)-- [3:0-1-8,Edge], [4:0-1-8,Edge], [10:0-1-8,Edge], [13:0-1-8,Edge], [19:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.49	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.67	Vert(LL) -0.12 17-18 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.58	Vert(CT) -0.17 17-18 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 14 n/a n/a		
	Code IRC2021/TPI2014			Weight: 120 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 29=364/0-3-8 (min. 0-1-8), 14=699/0-3-8 (min. 0-1-8), 23=1514/0-3-8 (min. 0-1-8)
Max Grav 29=453(LC 3), 14=711(LC 7), 23=1514(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-29=-445/0, 13-14=-716/0, 1-2=-439/16, 2-3=-860/179, 3-4=-766/419, 4-5=-158/790,
5-6=-158/790, 6-7=0/254, 7-8=-1329/0, 8-9=-2142/0, 9-10=-2142/0, 10-11=-2101/0,
11-12=-1499/0
BOT CHORD 27-28=-46/843, 26-27=-419/766, 25-26=-419/766, 24-25=-419/766, 23-24=-1222/0,
22-23=-1222/0, 21-22=0/818, 20-21=0/1843, 19-20=0/1843, 18-19=0/2142, 17-18=0/2142,
16-17=0/1975, 15-16=0/1000
WEBS 3-26=-308/0, 4-25=0/324, 9-19=-258/0, 6-23=-1450/0, 1-28=-20/560, 2-28=-526/39,
3-27=0/400, 4-24=-987/0, 6-24=0/799, 6-22=0/1216, 7-22=-1125/0, 7-21=0/700,
8-21=-710/0, 8-19=0/593, 11-16=-619/0, 12-16=0/650, 12-15=-990/0, 13-15=0/699

- NOTES-** (5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F206	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:49 2024 Page 1
ID: oDuWOOmHxMOj2fwcp2aKqzMG6w-VI606mZqdea9tgNLAIV4QJFDQ7invuvr0ij2rkyfwDm
3x4 =

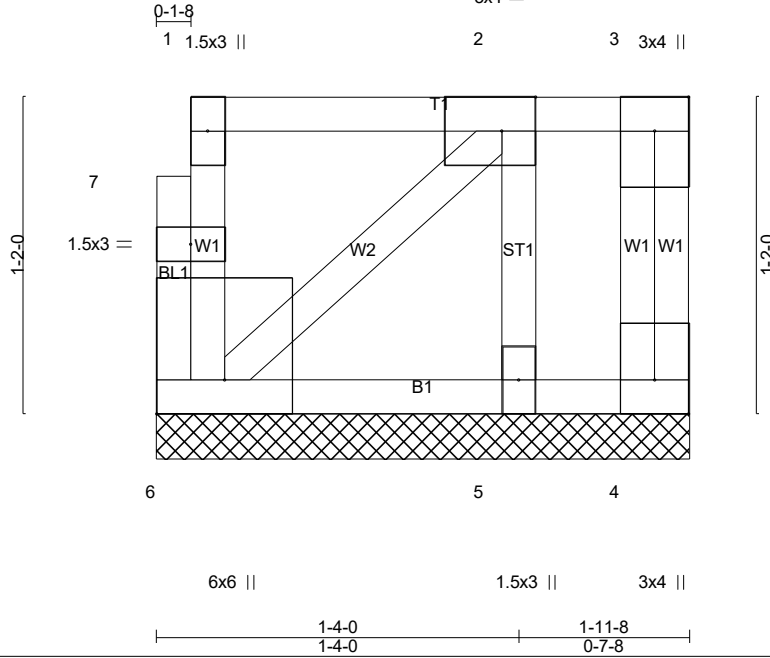

Scale = 1:8.5

Plate Offsets (X,Y)-- [2:0-1-8,Edge], [4:Edge,0-1-8], [6:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0 Plate Grip DOL 1.00	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00		n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P						
							Weight: 14 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 1-11-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 4=2/1-11-8 (min. 0-1-8), 6=50/1-11-8 (min. 0-1-8), 5=130/1-11-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6)
- 1) Gable requires continuous bottom chord bearing.
 - 2) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 3) Gable studs spaced at 1-4-0 oc.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard




9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F207	Truss Type Floor	Qty 4	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:50 2024 Page 1
ID:9vTDwC2bJN39NxbhMk8CGOyOxYS-zygOK6aSOxi0UqyYKT0JyWnGFxo4e7O_FMTbNAYfwdI



Scale = 1:30.6


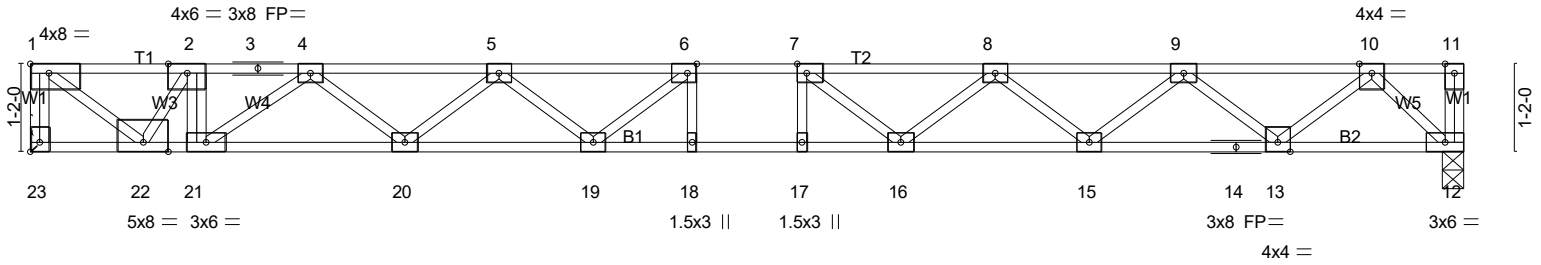


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [6:0-1-8,Edge], [7:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.55	Vert(LL)	-0.24	17-18	>934	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.96	Vert(CT)	-0.42	18	>536	360		
BCLL 0.0	Rep Stress Incr	NO	WB 0.91	Horz(CT)	0.07	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 99 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 23=1222/Mechanical, 12=755/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-23=-1212/0, 1-2=-1519/0, 2-3=-2302/0, 3-4=-2302/0, 4-5=-3234/0, 5-6=-3646/0, 6-7=-3687/0, 7-8=-3388/0, 8-9=-2659/0, 9-10=-1481/0
BOT CHORD 21-22=0/2302, 20-21=0/2892, 19-20=0/3558, 18-19=0/3687, 17-18=0/3687, 16-17=0/3687, 15-16=0/3121, 14-15=0/2173, 13-14=0/2173, 12-13=0/769
WEBS 2-21=0/421, 1-22=0/1906, 2-22=-1392/0, 5-20=-421/0, 4-20=0/446, 4-21=-716/0, 7-16=-555/0, 8-16=0/434, 8-15=-602/0, 9-15=0/632, 9-13=-901/0, 10-13=0/927, 10-12=-1062/0

NOTES- (7)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Refer to girder(s) for truss to truss connections.
- Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-11=-67
Concentrated Loads (lb)
Vert: 2=-600
- Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-11=-67
Concentrated Loads (lb)
Vert: 2=-600
- 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-23=-7, 1-7=-67, 7-11=-13
Concentrated Loads (lb)
Vert: 2=-600

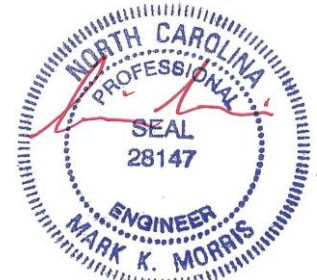

9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC
24-7417-F02	F207	Floor	4	1	Job Reference (optional) # 52105

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:50 2024 Page 2
ID:9vTDwC2bJN39NxlMk8CGOyOxYS-zygOK6aSOxi0UqyYKT0JyWnGFxo4e7O_FMTbNAyfwDI

LOAD CASE(S) Standard

4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-6=-13, 6-11=-67

Concentrated Loads (lb)

Vert: 2=-600

5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-7=-67, 7-11=-13

Concentrated Loads (lb)

Vert: 2=-600

6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00

Uniform Loads (plf)

Vert: 12-23=-7, 1-6=-13, 6-11=-67

Concentrated Loads (lb)

Vert: 2=-600




9/6/2024


Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F208	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:50 2024 Page 1
ID:9vTDwC2bJN39NxxhIMk8CGOyOxYS-zygOK6aSoxi0UqyYkT0JyWnC2XqBe6M_FMTbNAyfwDI



Scale: 3/8"=1'

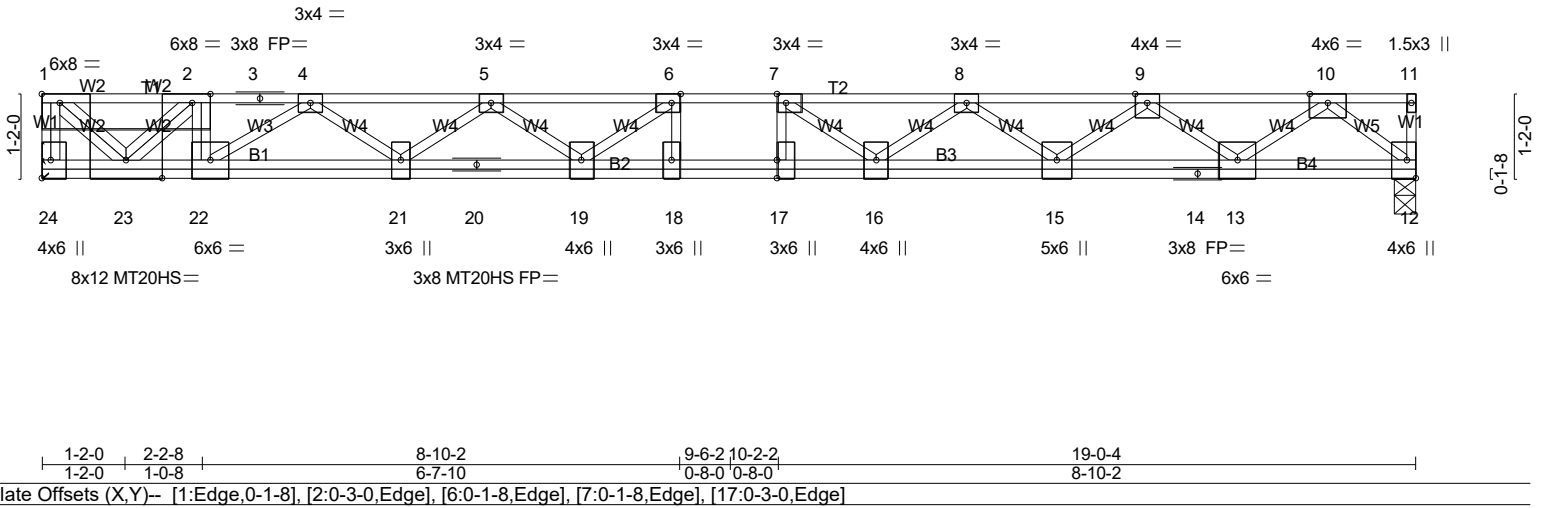

1-2-0	2-2-8	8-10-2	9-6-2, 10-2-2	19-0-4
1-2-0	1-0-8	6-7-10	0-8-0, 0-8-0	8-10-2

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-3-0,Edge], [6:0-1-8,Edge], [7:0-1-8,Edge], [17:0-3-0,Edge]

LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.82	Vert(LL)	-0.19	17	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.89	Vert(CT)	-0.51	18-19	>440	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	NO	WB 0.97	Horz(CT)	0.06	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 127 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat) *Except* T2: 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 4-10-5 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 24=3001/Mechanical, 12=953/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-24=-2940/0, 1-2=-2979/0, 2-3=-5750/0, 3-4=-5750/0, 4-5=-6197/0, 5-6=-6149/0, 6-7=-5796/0, 7-8=-5049/0, 8-9=-3820/0, 9-10=-2080/0

BOT CHORD 22-23=0/5730, 21-22=0/6071, 20-21=0/6301, 19-20=0/6301, 18-19=0/5796, 17-18=0/5796, 16-17=0/5796, 15-16=0/4535, 14-15=0/3061, 13-14=0/3061, 12-13=0/1085

WEBS 6-18=-511/0, 7-17=0/547, 7-16=-1123/0, 8-16=0/725, 8-15=-908/0, 9-15=0/965, 9-13=-1246/0, 10-13=0/1264, 10-12=-1422/0, 1-23=0/4089, 2-23=-3959/0, 6-19=0/739, 5-19=-364/0, 4-22=-382/0

- NOTES-** (7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.

- LOAD CASE(S)**
- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-157, 2-11=-67
Concentrated Loads (lb)
Vert: 2=-2394
 - 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-157, 2-11=-67
Concentrated Loads (lb)
Vert: 2=-2394
 - 3) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-157, 2-7=-67, 7-11=-13



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC
24-7417-F02	F208	Floor	2	1	Job Reference (optional) # 52105

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:50 2024 Page 2
ID:9vTDwC2bJN39NxlMk8CGOyOxYS-zygOK6aSOxi0UqyYkT0JyWnC2XqBe6M_FMTbNAyfwDI

LOAD CASE(S)

- Concentrated Loads (lb)
Vert: 2=-2394
- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-103, 2-6=-13, 6-11=-67
Concentrated Loads (lb)
Vert: 2=-2394
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-157, 2-7=-67, 7-11=-13
Concentrated Loads (lb)
Vert: 2=-2394
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 12-24=-7, 1-2=-103, 2-6=-13, 6-11=-67
Concentrated Loads (lb)
Vert: 2=-2394



9/6/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F209	Truss Type Floor	Qty 3	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	---------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:51 2024 Page 1
ID:WqGEjhAqGZsGZLRd2cp_4Yygjl1-R8EnXSb58Fqt6_XkiAXyVvKtSxCYNiB8T0C9wcyfwDk

0-10-2 1-3-0

1-4-0

0-8-10

Scale = 1:32.9

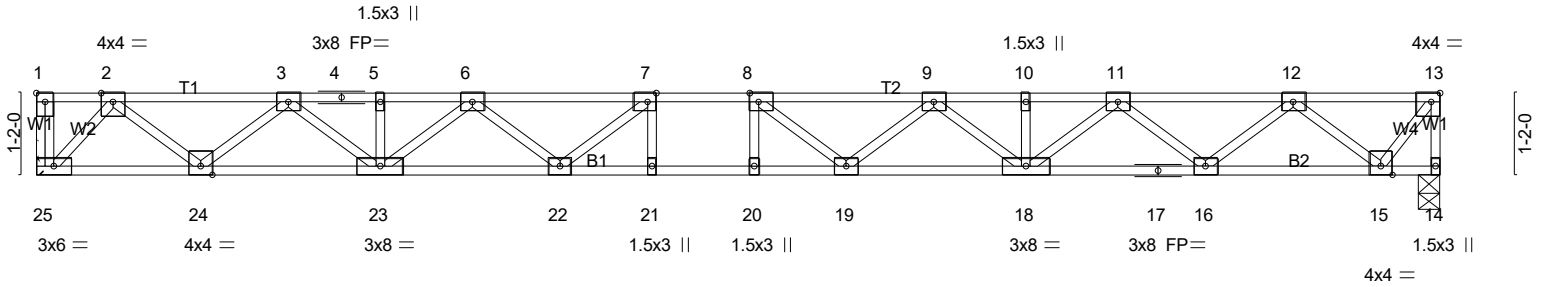


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge], [13:0-1-8,Edge]					
LOADING (psf)	SPACING- 1-4-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.40	Vert(LL) -0.30 20 >781 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.75	Vert(CT) -0.42 20 >568 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.42	Horz(CT) 0.07 14 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 103 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 25=727/Mechanical, 14=727/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 13-14=-725/0, 2-3=-1350/0, 3-4=-2524/0, 4-5=-2524/0, 5-6=-2524/0, 6-7=-3192/0, 7-8=-3441/0, 8-9=-3342/0, 9-10=-2864/0, 10-11=-2864/0, 11-12=-1887/0, 12-13=-505/0
 BOT CHORD 24-25=0/666, 23-24=0/2015, 22-23=0/2957, 21-22=0/3441, 20-21=0/3441, 19-20=0/3211, 17-18=0/2453, 16-17=0/2453, 15-16=0/1299
 WEBS 7-22=-476/6, 6-22=0/381, 6-23=-552/0, 3-23=0/651, 3-24=-865/0, 2-24=0/891, 2-25=-977/0, 8-19=-349/133, 9-19=-4/291, 9-18=-443/0, 11-18=0/526, 11-16=-737/0, 12-16=0/765, 12-15=-1034/0, 13-15=0/842

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F209A	Truss Type Floor	Qty 5	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:51 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygjl1-R8EnXSb58Fqt6_XkIAXYVvkKUdxDANjb8T0C9wcyfwDk



Scale = 1:27.3

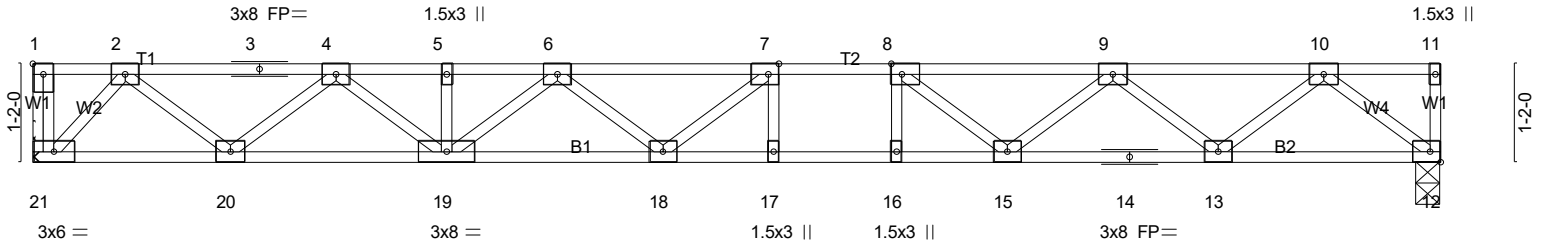

8-10-2	9-6-2, 10-2-2	16-8-4
8-10-2	0-8-0 0-8-0	6-6-2

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.32	Vert(LL)	-0.16	17-18	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.65	Vert(CT)	-0.22	17-18	>884		
BCLL 0.0	Lumber DOL 1.00	WB 0.33	Horz(CT)	0.04	12	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 85 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 21=605/Mechanical, 12=605/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1092/0, 3-4=-1092/0, 4-5=-1961/0, 5-6=-1961/0, 6-7=-2332/0, 7-8=-2344/0, 8-9=-2013/0, 9-10=-1240/0
BOT CHORD 20-21=0/553, 19-20=0/1609, 18-19=0/2260, 17-18=0/2344, 16-17=0/2344, 15-16=0/2344, 14-15=0/1726, 13-14=0/1726, 12-13=0/727
WEBS 6-19=-382/0, 4-19=0/449, 4-20=-674/0, 2-20=0/702, 2-21=-811/0, 8-15=-497/0, 9-15=0/392, 9-13=-632/0, 10-13=0/668, 10-12=-925/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F209B	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	----------------	---------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:51 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygl1-R8EnXSb58Fqt6_XkIAXVYkKUCxDJNc8T0C9wcyfwDk



Scale = 1:31.2

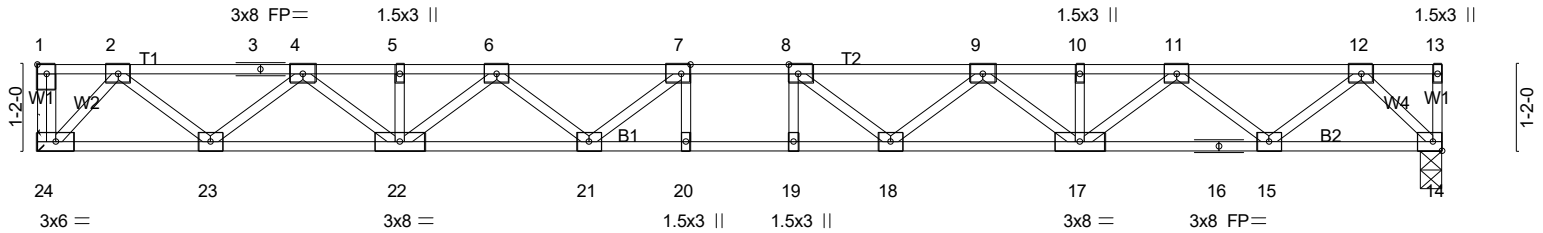

8-10-2	9-6-2, 10-2-2	19-0-4
8-10-2	0-8-0 0-8-0	8-10-2

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.32	Vert(LL)	-0.24	19-20	>928	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.64	Vert(CT)	-0.34	19-20	>674		
BCLL 0.0	Lumber DOL 1.00	WB 0.40	Horz(CT)	0.06	14	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							

Weight: 98 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 24=691/Mechanical, 14=691/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1273/0, 3-4=-1273/0, 4-5=-2355/0, 5-6=-2355/0, 6-7=-2934/0, 7-8=-3112/0, 8-9=-2943/0, 9-10=-2375/0, 10-11=-2375/0, 11-12=-1304/0
 BOT CHORD 23-24=0/632, 22-23=0/1893, 21-22=0/2748, 20-21=0/3112, 19-20=0/3112, 18-19=0/3112, 17-18=0/2763, 16-17=0/1919, 15-16=0/1919, 14-15=0/668
 WEBS 7-21=-399/49, 6-21=0/327, 6-22=-501/0, 4-22=0/590, 4-23=-808/0, 2-23=0/834, 2-24=-928/0, 8-18=-391/56, 9-18=0/321, 9-17=-494/0, 11-17=0/582, 11-15=-800/0, 12-15=0/828, 12-14=-950/0

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Refer to girder(s) for truss to truss connections.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F210	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:51 2024 Page 1
ID:WqGEjhAqGZsGZLRd2cp_4Yyggj1-R8EnXSb58Fqt6_XklAXyVvkYexNENol8T0C9wcyfwDk

Scale = 1:25.7

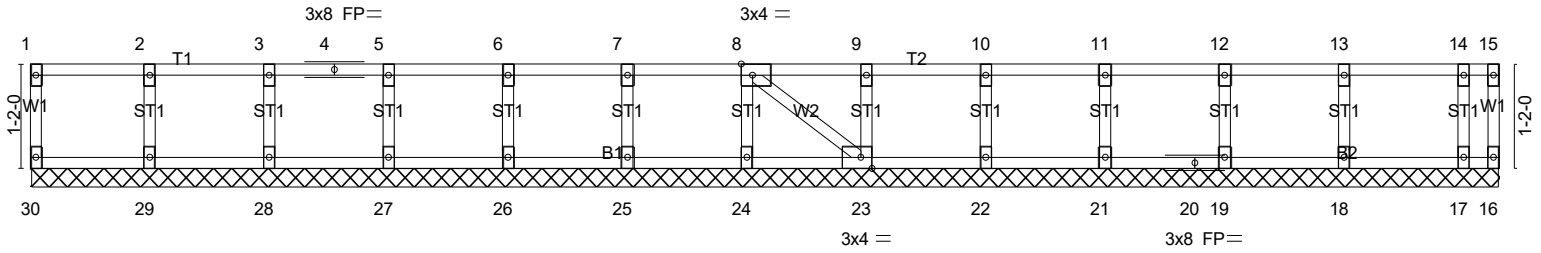

16-4-12
16-4-12

Plate Offsets (X,Y)-- [8:0-1-8,Edge], [23:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	16	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 70 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 16-4-12.
(lb) - Max Uplift All uplift 100 lb or less at joint(s) 16
Max Grav All reactions 250 lb or less at joint(s) 30, 16, 29, 28, 27, 26, 25, 24, 23, 22, 21, 19, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7-8)
1) All plates are 1.5x3 MT20 unless otherwise indicated.
2) Gable requires continuous bottom chord bearing.
3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
4) Gable studs spaced at 1-4-0 oc.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16.
6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F211	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	---------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:52 2024 Page 1
ID:9vTDwC2bJN39NxlMk8CGOyOxYS-vKo9locjvZykk86wst3n2xtgLKjlf6F4HigyIS2yfwDj

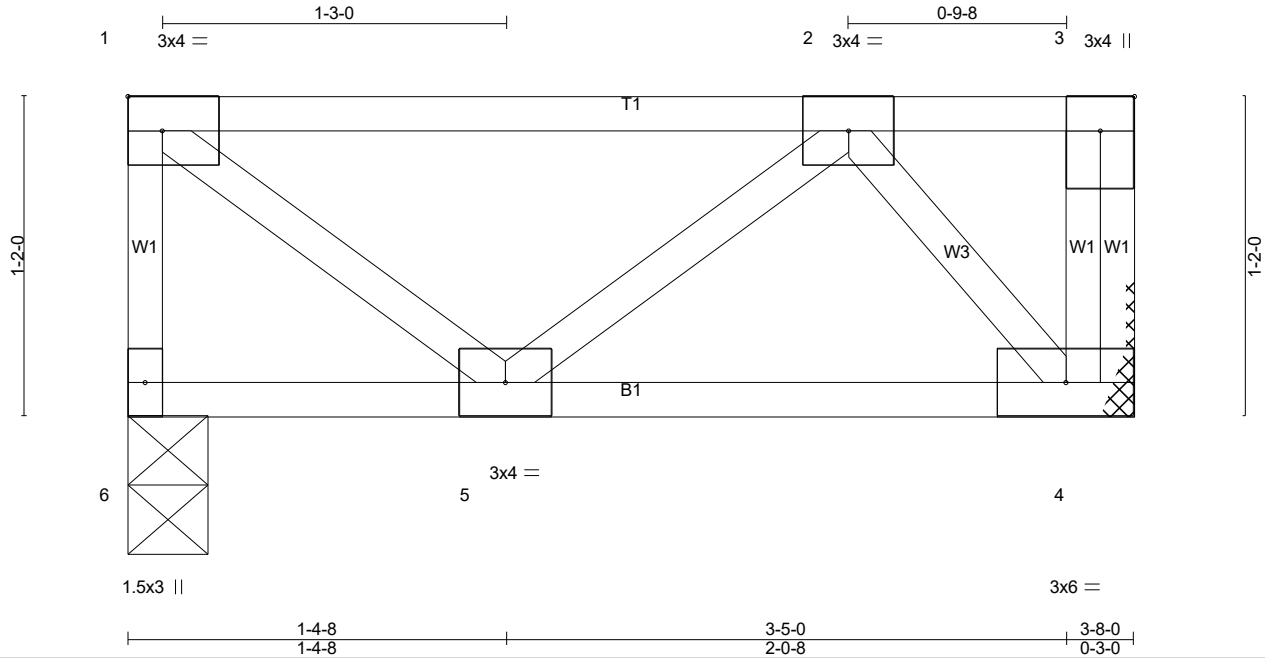

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.26	Vert(LL) -0.00 5 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.05	Vert(CT) -0.00 4-5 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.06	Horz(CT) 0.00 4 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P		Weight: 21 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=191/0-3-8 (min. 0-1-8), 4=191/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-271/0

NOTES- (3)
1) Refer to girder(s) for truss to truss connections.
2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard



9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F212	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 52105
--------------------	---------------	----------------------------	----------	----------	--	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:52 2024 Page 1
ID:oDuW00MhLxMOj2fwcp2aKqzMG6w-vKo9locjvZykh86wst3n2xtgckhF6CrHigyis2yfwDj



Scale: 1"=1'

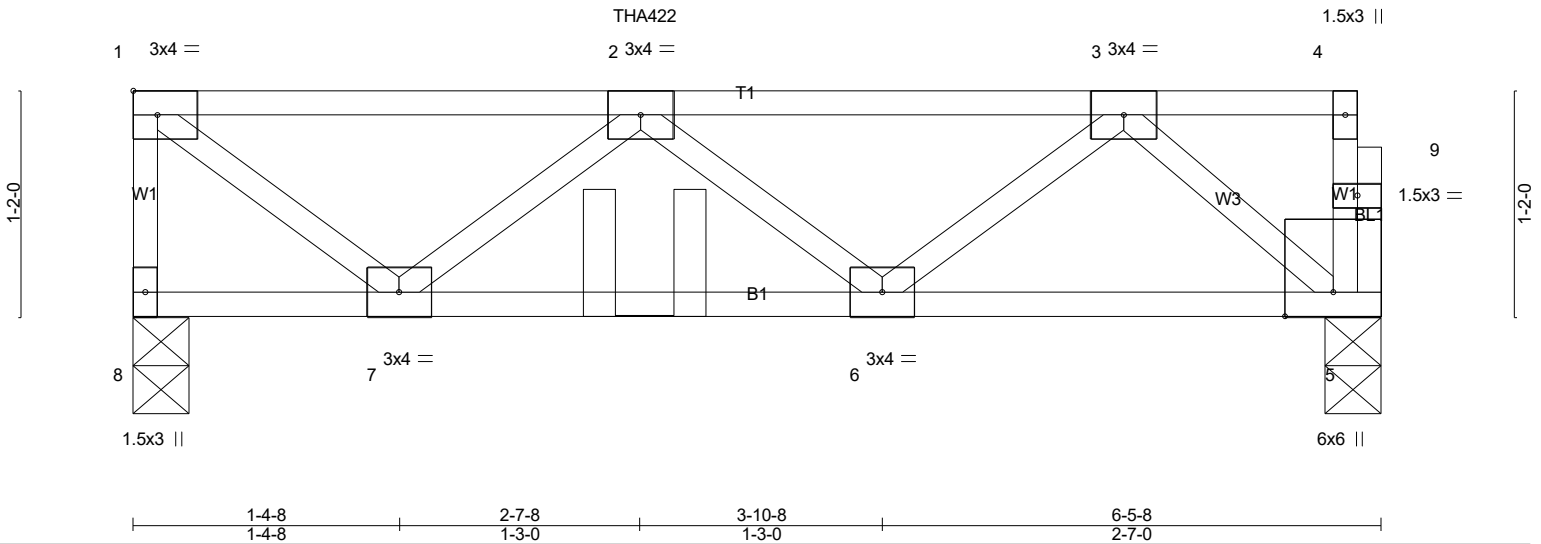

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.31	Vert(LL) -0.01 6 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.15	Vert(CT) -0.01 6-7 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.21	Horz(CT) 0.00 5 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P			
				Weight: 34 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 8=376/0-3-8 (min. 0-1-8), 5=361/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-8=-371/0, 1-2=-340/0, 2-3=-524/0
BOT CHORD 6-7=0/641, 5-6=0/374
WEBS 1-7=0/434, 2-7=-392/0, 3-5=-492/0

NOTES- (6)

- 1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 2) CAUTION, Do not erect truss backwards.
- 3) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent at 2-7-12 from the left end to connect truss(es) F213 (1 ply 2x4 SP) to front face of top chord, skewed 0.0 deg.to the right, sloping 0.0 deg. down.
- 4) Fill all nail holes where hanger is in contact with lumber.
- 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 5-8=-10, 1-4=-100
Concentrated Loads (lb)
Vert: 2=-53(F)



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F213	Truss Type Floor Girder	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 52105
--------------------	---------------	----------------------------	----------	----------	--	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:52 2024 Page 1
ID:9vTDwC2bJN39NxxhIMk8CGOyOxYS-vKo9locjvZykk86wst3n2xtcJKjP6FwHigyiS2yfwDj

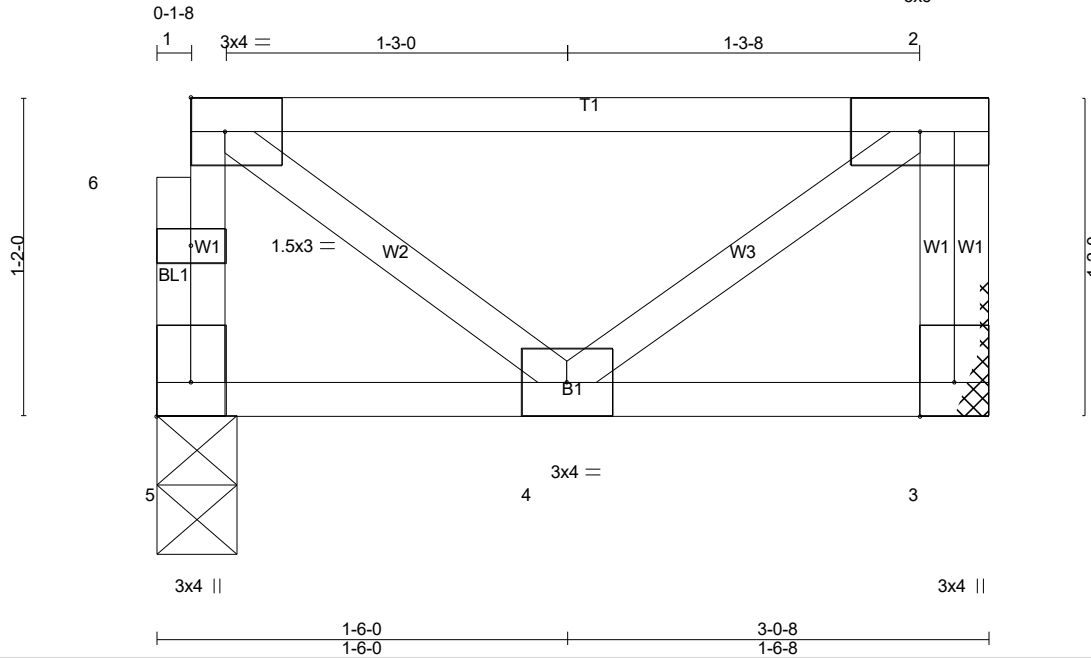


Plate Offsets (X,Y)-- [5:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.52	Vert(LL)	-0.00	4	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	-0.00	4	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.01	Horz(CT)	0.00	3	n/a	n/a		
BCDL 5.0	Rep Stress Incr NO	Matrix-P							
	Code IRC2021/TPI2014							Weight: 19 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS. (lb/size) 5=147/0-3-8 (min. 0-1-8), 3=153/Mechanical

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (4)

- 1) Refer to girder(s) for truss to truss connections.
- 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 3) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

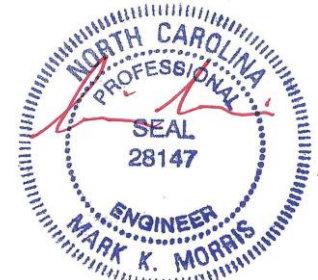

9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F215	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:52 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygjl1-vKo9locjvZykk86wst3n2xtjOKJT6FYHigyiS2yfwDj

Scale = 1:24.7

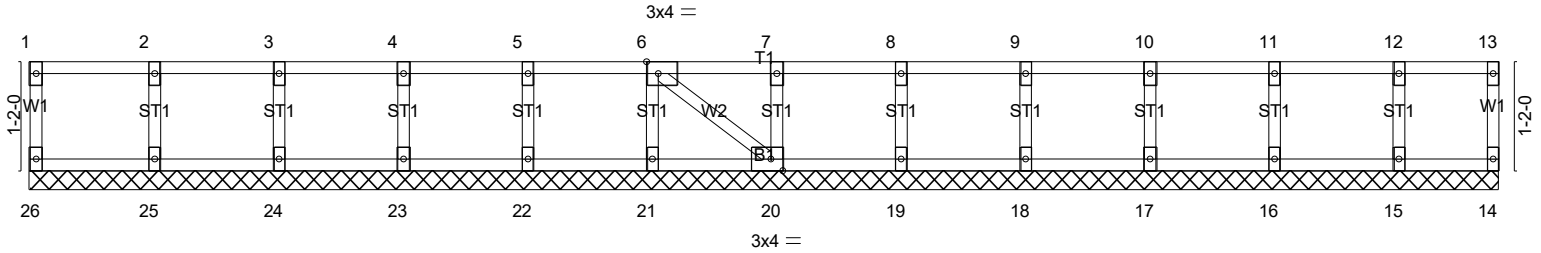


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [20:0-1-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 67 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-8-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 26, 14, 25, 24, 23, 22, 21, 20, 19, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F216	Truss Type Floor	Qty 3	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	---------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:52 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygjl1-vKo9locjvZykk86wst3n2xtclKU3673Higyis2yfwDj



Scale = 1:26.2

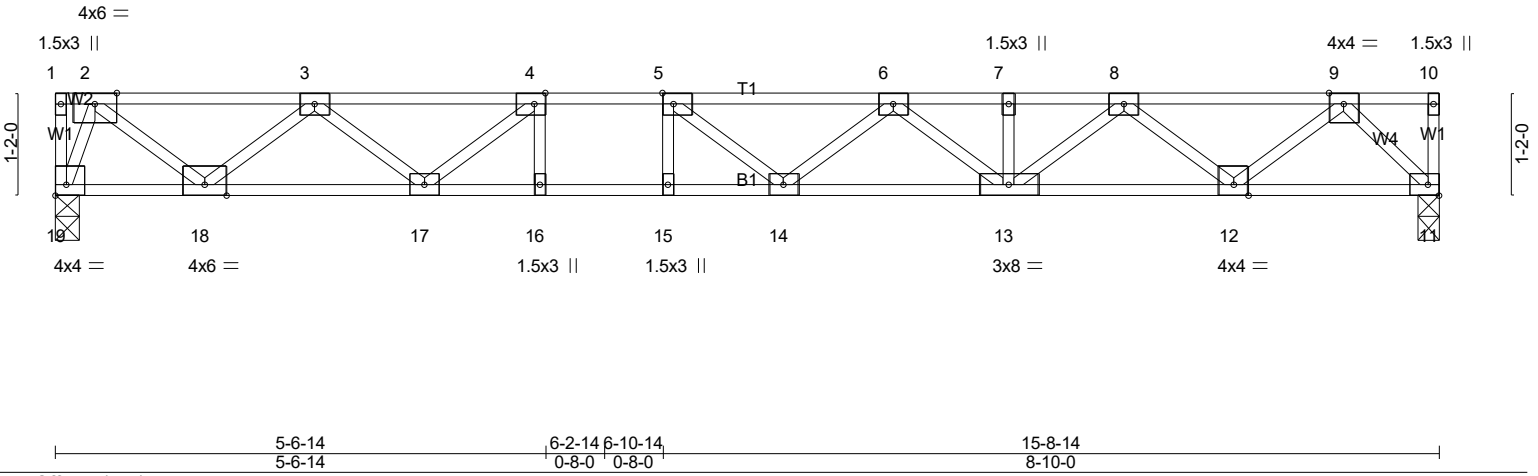


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [19:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.55	Vert(LL) -0.21 14-15 >873 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.99	Vert(CT) -0.29 14-15 >636 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.51	Horz(CT) 0.05 11 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 80 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 19=859/0-3-6 (min. 0-1-8), 11=859/0-3-0 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1179/0, 3-4=-2469/0, 4-5=-3071/0, 5-6=-3158/0, 6-7=-2733/0, 7-8=-2733/0, 8-9=-1565/0
BOT CHORD 18-19=0/352, 17-18=0/1965, 16-17=0/3071, 15-16=0/3071, 14-15=0/3071, 13-14=0/3123, 12-13=0/2276, 11-12=0/821
WEBS 4-16=-25/288, 5-15=-266/47, 4-17=-823/0, 3-17=0/656, 3-18=-1024/0, 2-18=0/1075, 2-19=-1016/0, 5-14=-231/315, 6-13=-498/0, 8-13=0/583, 8-12=-925/0, 9-12=0/970, 9-11=-1172/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F217	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:53 2024 Page 1
ID:WqGEjhaqGZsGZLRd2cp_4Yygi1-NXMXy8dLgs4bLHh7Pba0a9PqQkwarcxRxKhF_VyfwDI



Scale = 1:25.6

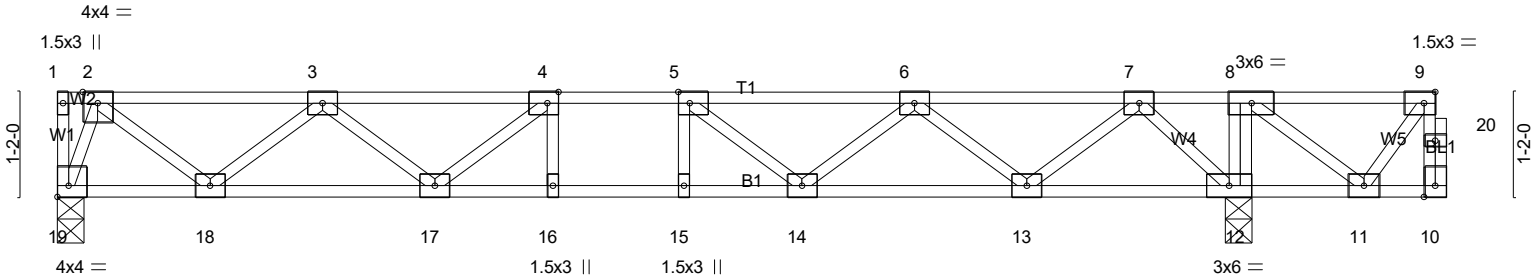

5-6-14	6-2-14, 6-10-14	13-1-14	13-3-6	15-5-6
5-6-14	0-8-0, 0-8-0	6-3-0	0-1-8	2-2-0
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [9:0-1-8,Edge], [19:Edge,0-1-8]				

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.30	Vert(LL)	-0.10	15	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.59	Vert(CT)	-0.13	15	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.03	12	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 81 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 12=971/0-3-8 (min. 0-1-8), 19=701/0-3-6 (min. 0-1-8)
Max Grav 12=971(LC 1), 19=715(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-954/0, 3-4=-1898/0, 4-5=-2220/0, 5-6=-2036/0, 6-7=-1260/0
BOT CHORD 18-19=0/294, 17-18=0/1584, 16-17=0/2220, 15-16=0/2220, 14-15=0/2220, 13-14=0/1816, 12-13=-21/680
WEBS 8-12=-285/0, 4-17=-503/0, 3-17=0/422, 3-18=-820/0, 2-18=0/859, 2-19=-847/0, 5-14=-426/2, 6-14=0/367, 6-13=-746/0, 7-13=0/779, 7-12=-992/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F218	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:53 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yyglj1-NXMXy8dLgs4bLHh7Pba0a9PofkxSrcTRxKhF_VyfWdI



Scale = 1:32.4

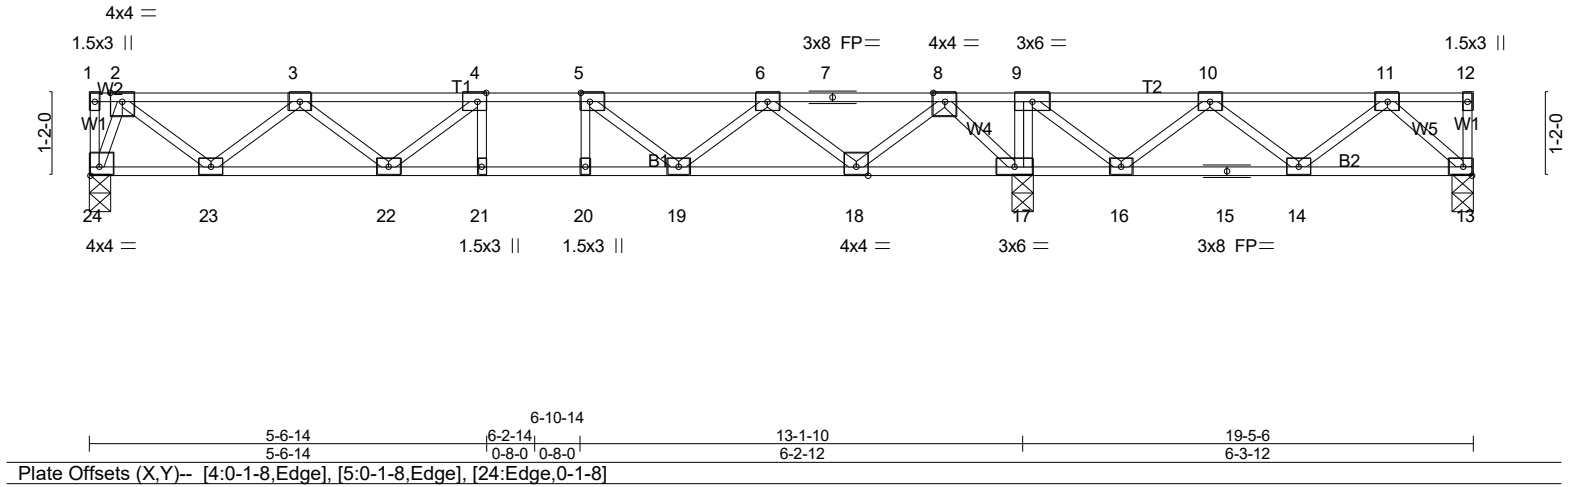

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.42	Vert(LL) -0.07	21	>999	480	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.53	Vert(CT) -0.10	21	>999	360		
BCLL 0.0	Lumber DOL 1.00	WB 0.44	Horz(CT) 0.02	17	n/a	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 99 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 13=108/0-3-8 (min. 0-1-8), 17=1412/0-3-8 (min. 0-1-8), 24=606/0-3-6 (min. 0-1-8)
Max Uplift 13=-126(LC 3)
Max Grav 13=264(LC 4), 17=1412(LC 1), 24=614(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-795/0, 3-4=-1496/0, 4-5=-1623/0, 5-6=-1243/0, 8-9=0/1359, 9-10=0/933, 10-11=-280/367
BOT CHORD 23-24=0/253, 22-23=0/1315, 21-22=0/1623, 20-21=0/1623, 19-20=0/1623, 18-19=0/889, 17-18=-574/0, 16-17=-1359/0, 15-16=-619/278, 14-15=-619/278
WEBS 9-17=-634/0, 4-22=-255/24, 3-23=-677/0, 2-23=0/706, 2-24=-729/0, 5-19=-524/0, 6-19=0/472, 6-18=-883/0, 8-18=0/921, 8-17=-1131/0, 9-16=0/729, 10-16=-670/0, 10-14=0/327, 11-14=-282/41, 11-13=-338/205

- NOTES-** (6-7)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 126 lb uplift at joint 13.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

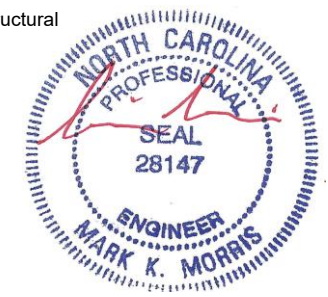

9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F219	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:53 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yyglj1-NXMXy8dLgs4bLHh7Pba0a9PofkxSrcTRxKhF_VyfwDI



Scale = 1:32.4

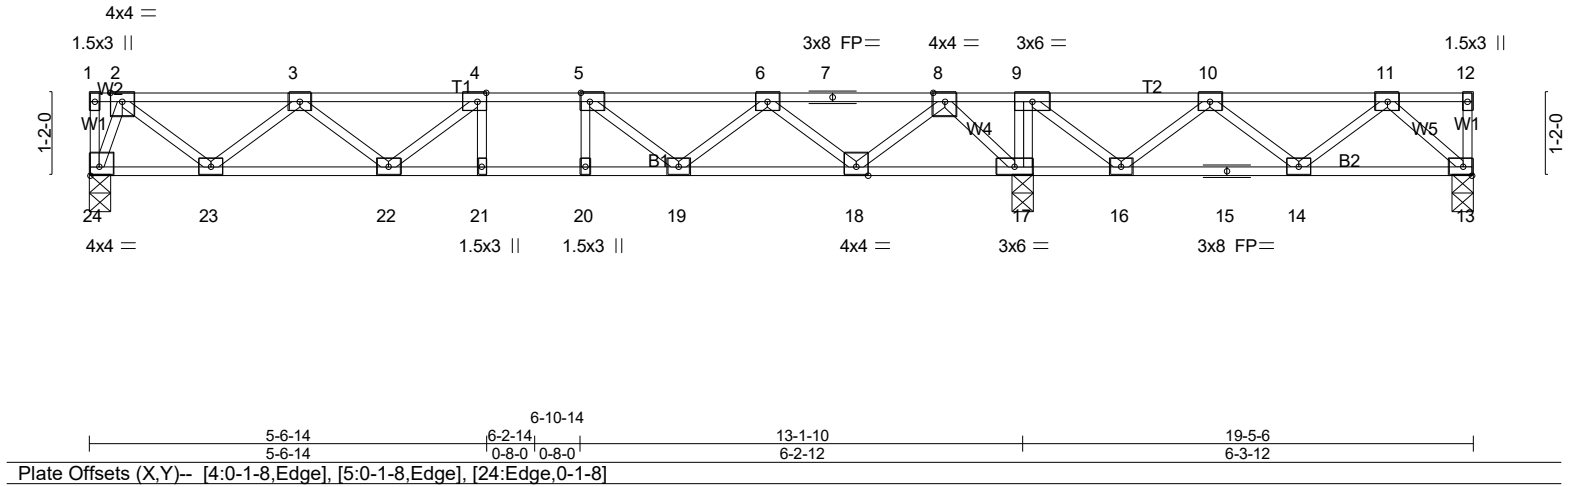

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.42	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.53	Vert(LL) -0.07 21 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.44	Vert(CT) -0.10 21 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.02 17 n/a n/a		
	Code IRC2021/TPI2014			Weight: 99 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 13=108/0-3-8 (min. 0-1-8), 17=1412/0-3-8 (min. 0-1-8), 24=606/0-3-6 (min. 0-1-8)
Max Uplift 13=-126(LC 3)
Max Grav 13=264(LC 4), 17=1412(LC 1), 24=614(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-795/0, 3-4=-1496/0, 4-5=-1623/0, 5-6=-1243/0, 8-9=0/1359, 9-10=0/933, 10-11=-280/367
BOT CHORD 23-24=0/253, 22-23=0/1315, 21-22=0/1623, 20-21=0/1623, 19-20=0/1623, 18-19=0/889, 17-18=-574/0, 16-17=-1359/0, 15-16=-619/278, 14-15=-619/278
WEBS 9-17=-634/0, 4-22=-255/24, 3-23=-677/0, 2-23=0/706, 2-24=-729/0, 5-19=-524/0, 6-19=0/472, 6-18=-883/0, 8-18=0/921, 8-17=-1131/0, 9-16=0/729, 10-16=-670/0, 10-14=0/327, 11-14=-282/41, 11-13=-338/205

- NOTES-** (6-7)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 126 lb uplift at joint 13.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

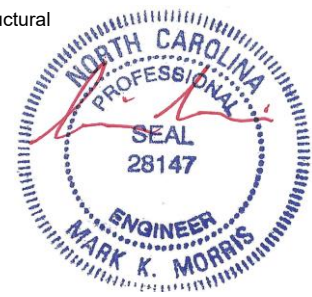


9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F220	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:54 2024 Page 1
ID:WqGEjhAqGZsGZLRD2cp_4Yygl1-sjvvAUdzRACSzRGJzI5F7Myzz8HRa2ca9_RpWxyfWdh



Scale = 1:37.5

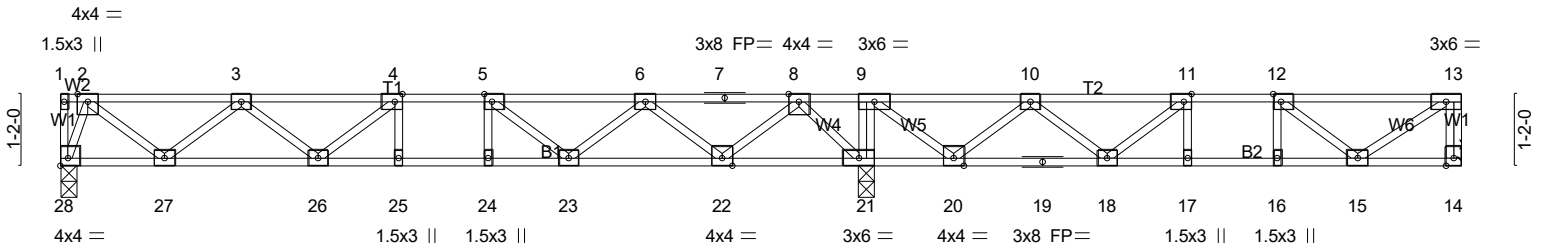

5-6-14	6-2-14	13-1-10	18-5-2	19-9-2	22-9-14
5-6-14	0-8-0 0-8-0	6-2-12	5-3-8	0-8-0 0-8-0	3-0-12
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [28:Edge,0-1-8]					

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.44	Vert(LL)	-0.07	25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.55	Vert(CT)	-0.10	25	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.02	21	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
Weight: 116 lb FT = 20%F, 11%E										

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 14=368/Mechanical, 21=1519/0-3-8 (min. 0-1-8), 28=603/0-3-6 (min. 0-1-8)
Max Grav 14=442(LC 4), 21=1519(LC 1), 28=634(LC 10)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 13-14=-433/0, 2-3=-827/0, 3-4=-1576/0, 4-5=-1741/0, 5-6=-1400/0, 6-7=-428/272, 7-8=-428/272, 8-9=0/1481, 9-10=0/777, 10-11=-679/319, 11-12=-858/93, 12-13=-473/10
BOT CHORD 27-28=0/261, 26-27=0/1369, 25-26=0/1741, 24-25=0/1741, 23-24=0/1741, 22-23=-63/1073, 21-22=-678/0, 20-21=-1481/0, 19-20=-513/473, 18-19=-513/473, 17-18=-93/858, 16-17=-93/858, 15-16=-93/858
WEBS 9-21=-741/0, 3-26=0/270, 3-27=-705/0, 2-27=0/736, 2-28=-752/0, 5-23=-568/0, 6-23=0/490, 6-22=-897/0, 8-22=0/936, 8-21=-1105/0, 11-18=-465/0, 10-18=0/395, 10-20=-823/0, 9-20=0/916, 12-15=-491/107, 13-15=-12/568

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F221	Truss Type Floor	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:54 2024 Page 1
ID:WqGEjhAqGZsGZLRD2cp_4Yygl1-sjvvAUdzRACSzRGJzI5F7Myzz8HRa2ca9_RpWxyfWdh



Scale = 1:37.5

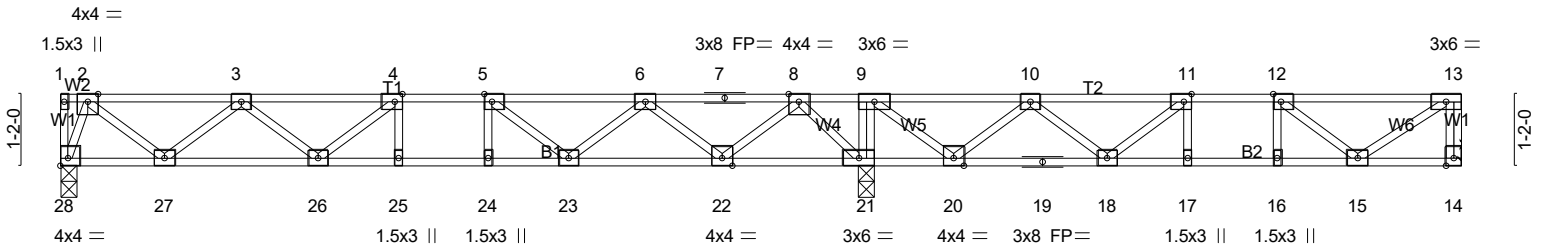

5-6-14	6-2-14	13-1-10	18-5-2	19-9-2	22-9-14
5-6-14	0-8-0 0-8-0	6-2-12	5-3-8	0-8-0 0-8-0	3-0-12
Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [28:Edge,0-1-8]					

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.44	Vert(LL)	-0.07	25	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.55	Vert(CT)	-0.10	25	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.02	21	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH							
									Weight: 116 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 14=368/Mechanical, 21=1519/0-3-8 (min. 0-1-8), 28=603/0-3-6 (min. 0-1-8)
Max Grav 14=442(LC 4), 21=1519(LC 1), 28=634(LC 10)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 13-14=-433/0, 2-3=-827/0, 3-4=-1576/0, 4-5=-1741/0, 5-6=-1400/0, 6-7=-428/272, 7-8=-428/272, 8-9=0/1481, 9-10=0/777, 10-11=-679/319, 11-12=-858/93, 12-13=-473/10
BOT CHORD 27-28=0/261, 26-27=0/1369, 25-26=0/1741, 24-25=0/1741, 23-24=0/1741, 22-23=-63/1073, 21-22=-678/0, 20-21=-1481/0, 19-20=-513/473, 18-19=-513/473, 17-18=-93/858, 16-17=-93/858, 15-16=-93/858
WEBS 9-21=-741/0, 3-26=0/270, 3-27=-705/0, 2-27=0/736, 2-28=-752/0, 5-23=-568/0, 6-23=0/490, 6-22=-897/0, 8-22=0/936, 8-21=-1105/0, 11-18=-465/0, 10-18=0/395, 10-20=-823/0, 9-20=0/916, 12-15=-491/107, 13-15=-12/568

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F222	Truss Type Floor	Qty 11	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	-----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:55 2024 Page 1
ID:WqGEjhAqGZsGZLRD2cp_4Yygi1-KvTHNqebCUKJbbrVX0cUfaV9QYbpJWRjOeAM3NyfwDg



Scale = 1:26.4

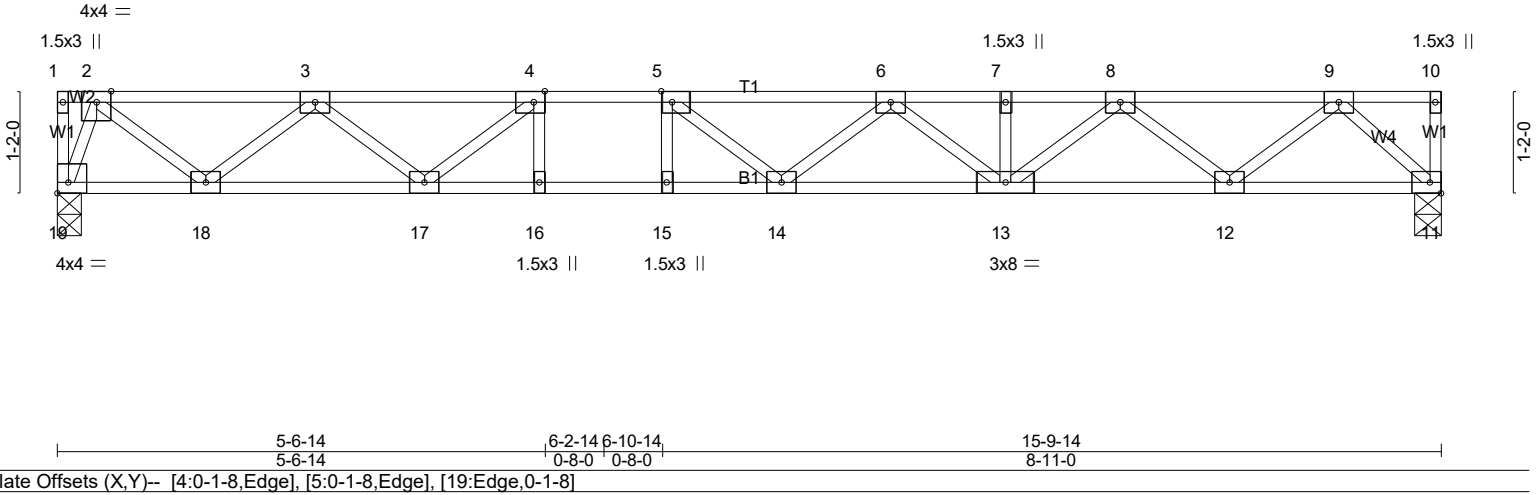


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [19:Edge,0-1-8]	
LOADING (psf)	SPACING- 1-4-0
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr YES
BCDL 5.0	Code IRC2021/TPI2014
CSI.	DEFL. in (loc) l/defl L/d
TC 0.33	Vert(LL) -0.15 14-15 >999 480
BC 0.67	Vert(CT) -0.20 14-15 >938 360
WB 0.34	Horz(CT) 0.03 11 n/a n/a
Matrix-SH	
PLATES	GRIP
MT20	244/190
Weight: 80 lb FT = 20%F, 11%E	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 19=576/0-3-6 (min. 0-1-8), 11=576/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-791/0, 3-4=-1658/0, 4-5=-2065/0, 5-6=-2129/0, 6-7=-1853/0, 7-8=-1853/0, 8-9=-1083/0
BOT CHORD 17-18=0/1318, 16-17=0/2065, 15-16=0/2065, 14-15=0/2065, 13-14=0/2110, 12-13=0/1553, 11-12=0/589
WEBS 4-17=-556/0, 3-17=0/442, 3-18=-687/0, 2-18=0/722, 2-19=-681/0, 6-13=-328/0, 8-13=0/383, 8-12=-612/0, 9-12=0/642, 9-11=-810/0

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




9/6/2024


Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F223	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:55 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygjl1-KvTHNqebCUKJbbrVX0cUfaVBOYflJXLjOeAM3NyfwDg



Scale = 1:22.6

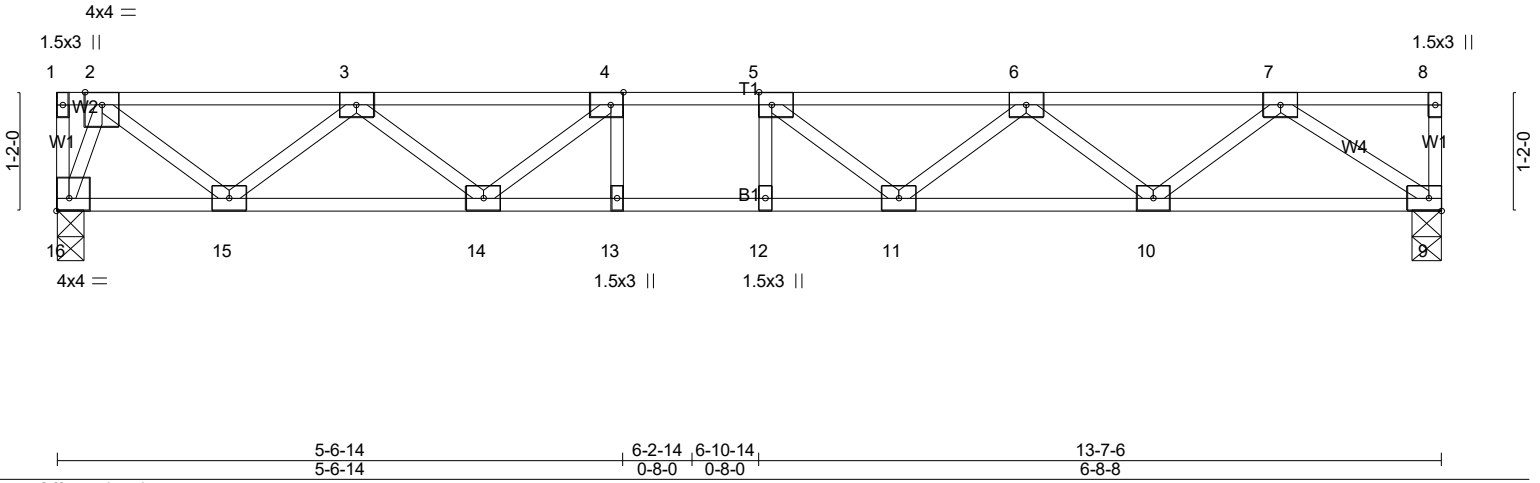

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.21	Vert(LL) -0.08	12	>999	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.44	Vert(CT) -0.10	12	>999	360			
BCLL 0.0	Rep Stress Incr YES	WB 0.29	Horz(CT) 0.02	9	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH							
								Weight: 68 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=495/0-3-6 (min. 0-1-8), 9=495/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-664/0, 3-4=-1337/0, 4-5=-1586/0, 5-6=-1497/0, 6-7=-1027/0
BOT CHORD 14-15=0/1104, 13-14=0/1586, 12-13=0/1586, 11-12=0/1586, 10-11=0/1375, 9-10=0/658
WEBS 4-14=-376/0, 3-14=0/309, 3-15=-572/0, 2-15=0/600, 2-16=-586/0, 6-10=-453/0, 7-10=0/481, 7-9=-797/0

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F224	Truss Type Floor	Qty 3	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:55 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yyjj1-KvTHNqebCUKJbbrVX0cUfaV9QYbpJWRjOeAM3NyfwDg



Scale = 1:26.4

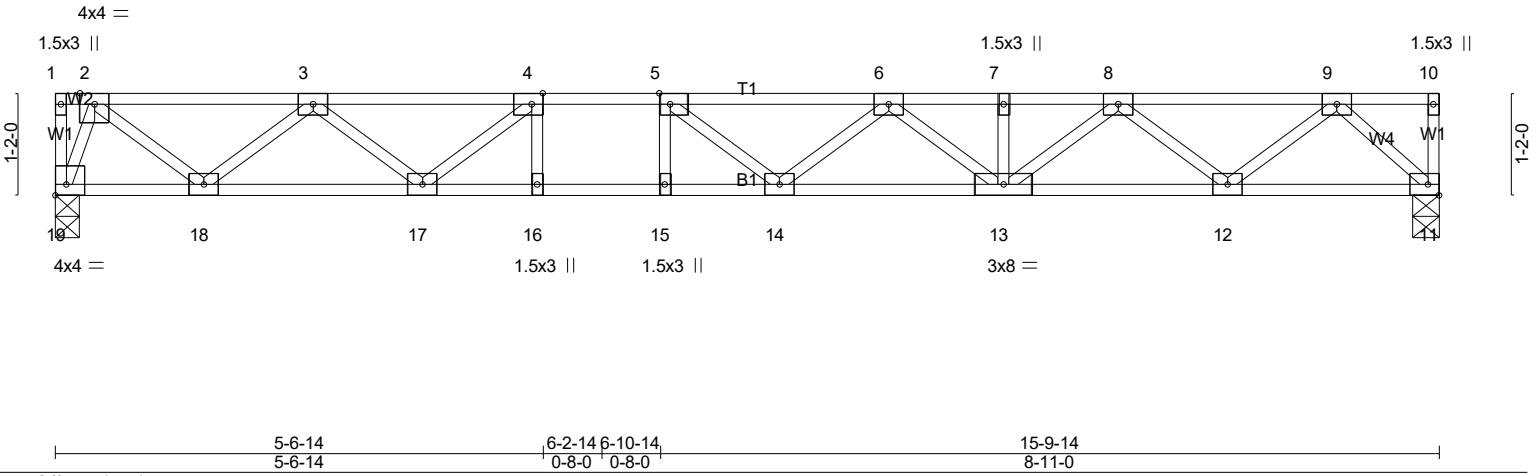


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [19:Edge,0-1-8]	5-6-14 5-6-14	6-2-14 6-10-14 0-8-0 0-8-0	15-9-14 8-11-0
LOADING (psf)	SPACING- 1-4-0	CSI.	DEFL. in (loc) l/defl L/d
TCLL 40.0	Plate Grip DOL 1.00	TC 0.33	Vert(LL) -0.15 14-15 >999 480
TCDL 10.0	Lumber DOL 1.00	BC 0.67	Vert(CT) -0.20 14-15 >938 360
BCLL 0.0	Rep Stress Incr YES	WB 0.34	Horz(CT) 0.03 11 n/a n/a
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH	
			PLATES MT20
			GRIP 244/190
			Weight: 80 lb FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 19=576/0-3-6 (min. 0-1-8), 11=576/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-791/0, 3-4=-1658/0, 4-5=-2065/0, 5-6=-2129/0, 6-7=-1853/0, 7-8=-1853/0, 8-9=-1083/0
 BOT CHORD 17-18=0/1318, 16-17=0/2065, 15-16=0/2065, 14-15=0/2065, 13-14=0/2110, 12-13=0/1553, 11-12=0/589
 WEBS 4-17=-556/0, 3-17=0/442, 3-18=-687/0, 2-18=0/722, 2-19=-681/0, 6-13=-328/0, 8-13=0/383, 8-12=-612/0, 9-12=0/642, 9-11=-810/0

- NOTES-** (4-5)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F225	Truss Type Floor	Qty 6	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	---------------	---------------------	----------	----------	--	---------


Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:55 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygi1-KvTHNqebCUKJbbrVX0cUfaV76YX2JVUjOeAM3NyfwDg

0-10-8 | 1-3-0

1-4-0

0-3-14

Scale = 1:30.3

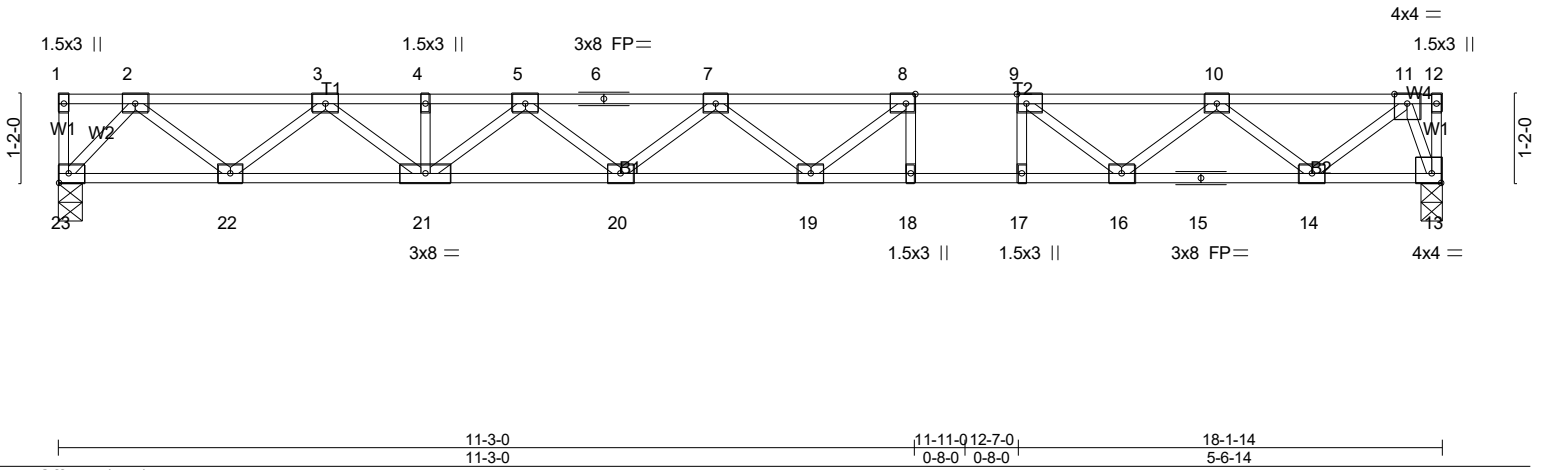

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-4-0	TC 0.48	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.91	Vert(LL) -0.25 18-19 >879 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.40	Vert(CT) -0.34 18-19 >639 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.05 13 n/a n/a		
	Code IRC2021/TPI2014			Weight: 92 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 13=661/0-3-6 (min. 0-1-8), 23=661/0-3-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1195/0, 3-4=-2216/0, 4-5=-2216/0, 5-6=-2732/0, 6-7=-2732/0, 7-8=-2801/0, 8-9=-2569/0, 9-10=-1998/0, 10-11=-924/0
BOT CHORD 22-23=0/587, 21-22=0/1783, 20-21=0/2557, 19-20=0/2898, 18-19=0/2569, 17-18=0/2569, 16-17=0/2569, 15-16=0/1545, 14-15=0/1545, 13-14=0/271
WEBS 8-18=-257/0, 9-17=0/272, 8-19=-67/414, 5-21=-436/0, 3-21=0/552, 3-22=-766/0, 2-22=0/791, 2-23=-878/0, 9-16=-750/0, 10-16=0/589, 10-14=-809/0, 11-14=0/850, 11-13=-781/0

NOTES- (4-5)
1) Unbalanced floor live loads have been considered for this design.
2) All plates are 3x4 MT20 unless otherwise indicated.
3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
4) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
5) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F225A	Truss Type Floor	Qty 2	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC	# 52105
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:56 2024 Page 1
ID:WqGEjhAqGZsGZLrD2cp_4Yygl1-o61fa9fDznSACIPi5j7jCn1Lxyye2zPtdlwwbqyfwDf



Scale = 1:24.7

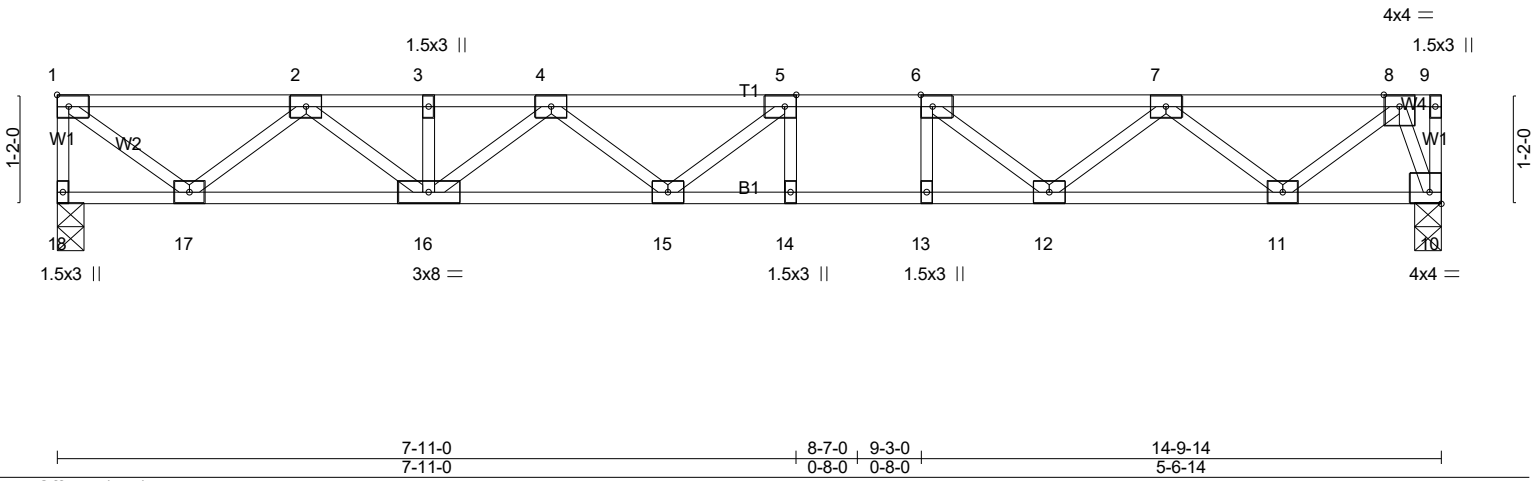


Plate Offsets (X,Y)-- [5:0-1-8,Edge], [6:0-1-8,Edge], [10:Edge,0-1-8]		7-11-0 7-11-0	8-7-0 0-8-0	9-3-0 0-8-0	14-9-14 5-6-14
LOADING (psf)	SPACING-	1-4-0	CSI.	DEFL.	PLATES
TCLL 40.0	Plate Grip DOL 1.00	TC 0.28	in (loc) l/defl L/d	MT20	GRIP
TCDL 10.0	Lumber DOL 1.00	BC 0.57	Vert(LL) -0.11 14-15 >999 480	244/190	
BCLL 0.0	Rep Stress Incr YES	WB 0.36	Vert(CT) -0.15 14-15 >999 360		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH	Horz(CT) 0.03 10 n/a n/a		
				Weight: 75 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 18=539/0-3-8 (min. 0-1-8), 10=539/0-3-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-535/0, 1-2=-603/0, 2-3=-1474/0, 3-4=-1474/0, 4-5=-1842/0, 5-6=-1849/0, 6-7=-1513/0, 7-8=-733/0
BOT CHORD 16-17=0/1141, 15-16=0/1774, 14-15=0/1849, 13-14=0/1849, 12-13=0/1849, 11-12=0/1221
WEBS 4-16=-383/0, 2-16=0/426, 2-17=-701/0, 1-17=0/760, 6-12=-474/0, 7-12=0/379, 7-11=-635/0, 8-11=0/666, 8-10=-638/0

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard




9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-7417-F02	Truss F226	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0036 HONEYCUTT HILLS 286 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 52105
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.630 s Jul 12 2024 Print: 8.630 s Jul 12 2024 MiTek Industries, Inc. Sat Sep 7 20:57:56 2024 Page 1
ID:WqGEjhAqGZsGZLRD2cp_4Yygl1-o61fa9fDznSACIPi5j7Jcn1ONy4P22tdlwwbqyfwDf

Scale = 1:28.5

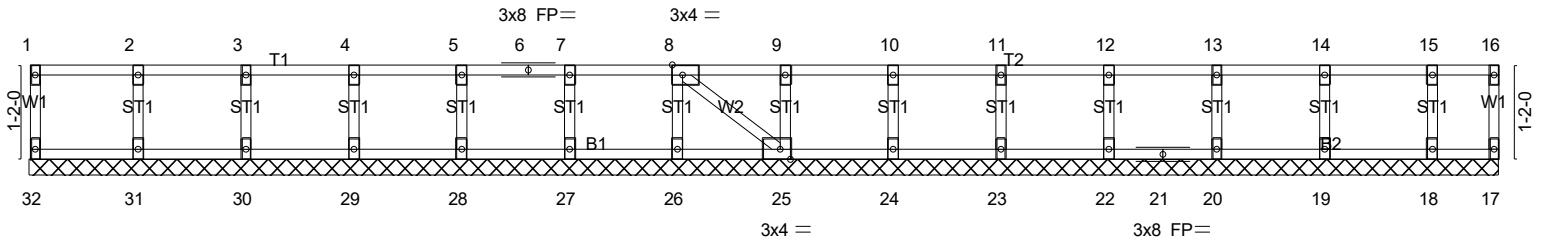

18-1-14
18-1-14

Plate Offsets (X,Y)-- [8:0-1-8,Edge], [25:0-1-8,Edge]

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) -0.00 17 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 77 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 18-1-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 17, 31, 30, 29, 28, 27, 26, 25, 24, 23, 22, 20, 19, 18

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



9/6/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.