

# Harnett County Department of Public Health

PERMIT # SFD 2409-0040

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 23 Brodhead Dr, Fuquay

Name: (owner) KB Homes

SUBDIVISION Birchwood Grove

LOT # 138

System Installer: David Brantley

Basement with plumbing:  Garage  Number of Bedrooms 3


Type of Water Supply:  Community  Public  Well Distance from well \_\_\_\_\_ feet

System Type: 50% Reduction T&J panel Type III(6) Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

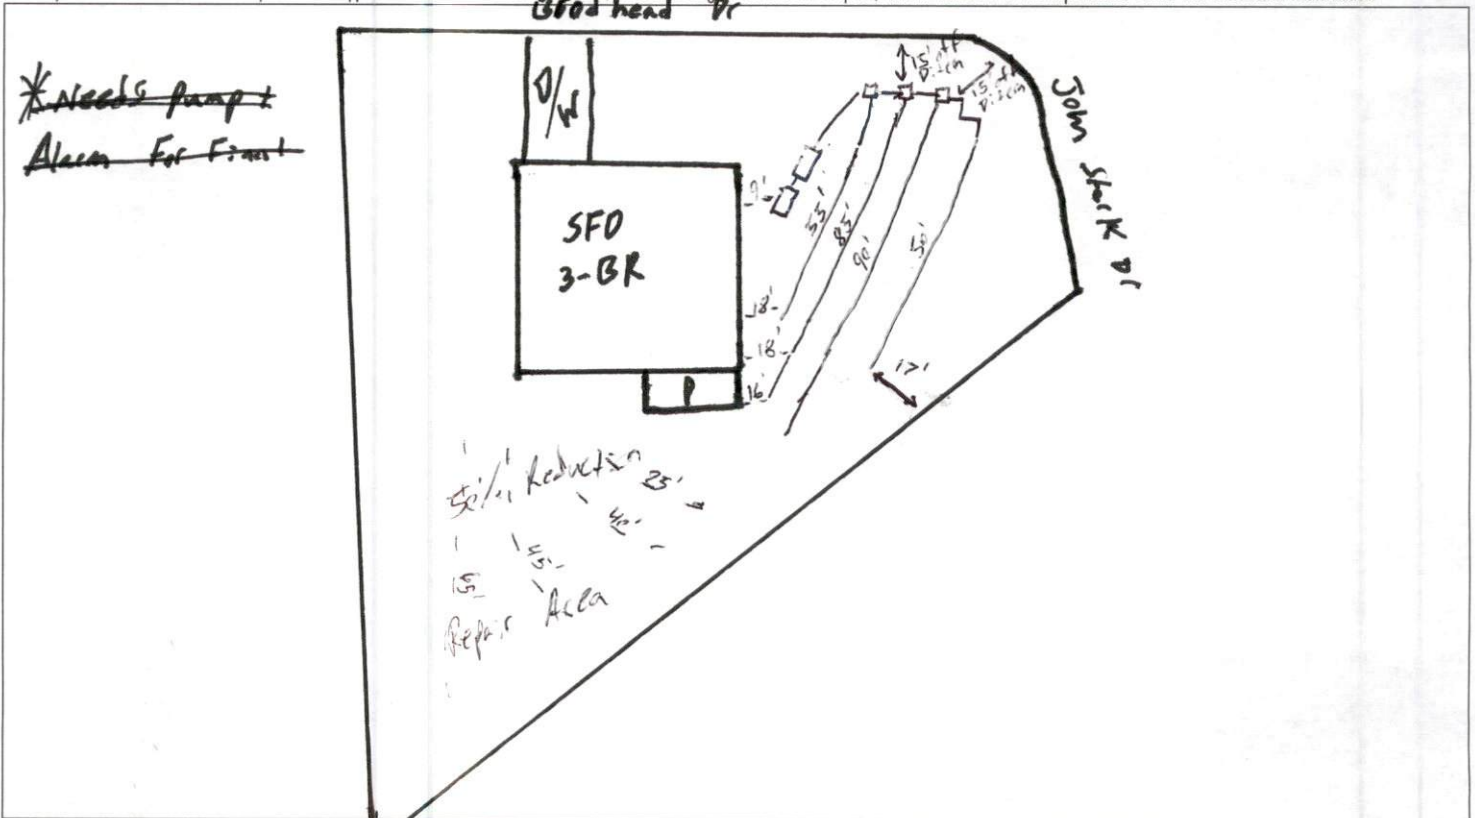

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

\_\_\_\_\_ D-Box  
  \_\_\_\_\_ Pump  
  \_\_\_\_\_ Alarm  
  \_\_\_\_\_ H2O Line  
  \_\_\_\_\_ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional  
  Other T&J panel Type III(6)  
 Septic Tank: 1,000 gallons  
 Pump Tank: 1,000 gallons  
 Subsurface No. of exact length  
 width of  
 depth of  
 Drainage Field ditches 1  
 of each ditch 280' feet  
 ditches 3' feet  
 ditches 18" inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent [Signature]  
 Date 1-16-25