

Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 50695

JOB: 24-6140-F01

JOB NAME: LOT 0.0012 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

20 Truss Design(s)

Trusses:

F101, F102, F103, F104, F105, F107A, F108, F109, F110, F111, F112, F113, F114, F115, F115A, F116, F116A, F117, F118, F119



7/19/2024

Mark Morris

Warning !—Verify design parameters and read notes before use.


This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSL/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job 24-6140-F01	Truss F101	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
					# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:50:57 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-OP_0hg780?VSILLoEpJPnaxSNLS7rbm6FAqP8wywfy

0-1-8

Scale = 1:37.6

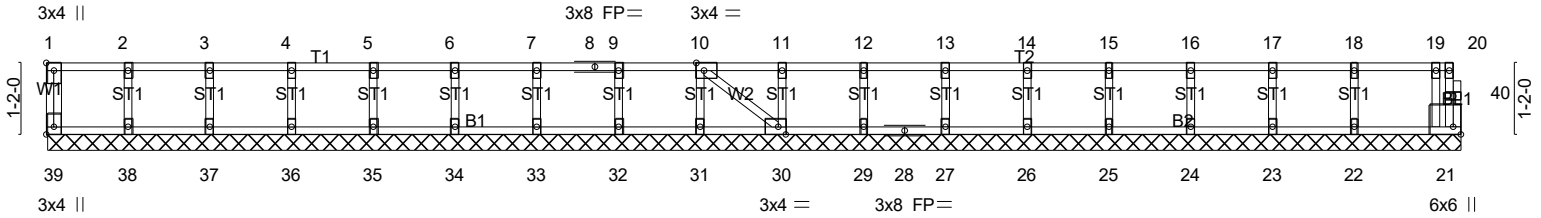

23-0-14
23-0-14

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [10:0-1-8,Edge], [21:Edge,0-1-8], [30:0-1-8,Edge], [39:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	21	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 99 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 23-0-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 39, 21, 38, 37, 36, 35, 34, 33, 32, 31, 30, 29, 27, 26, 25, 24, 23, 22

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7-8)

- All plates are 1.5x3 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Scale = 1:37.9

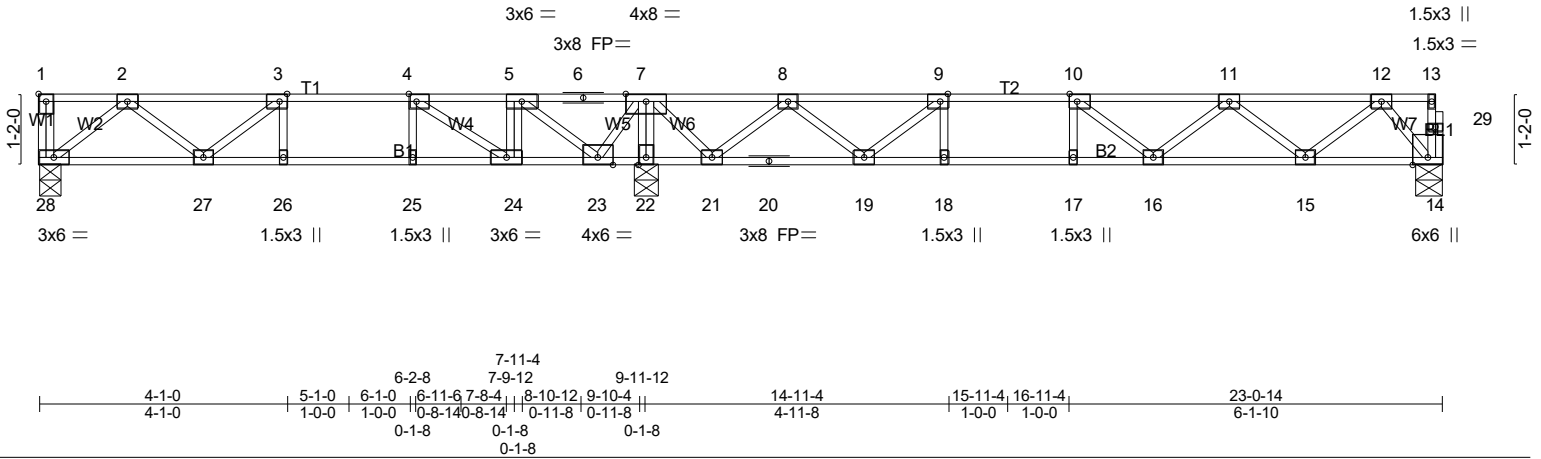


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.55	Vert(LL)	-0.11 16-17	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.80	Vert(CT)	-0.15 16-17	>999	360		
BCLL 0.0	Rep Stress Incr NO	WB 0.61	Horz(CT)	0.02 14	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 118 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 14=463/0-5-6 (min. 0-1-8), 22=1802/0-4-8 (min. 0-1-8), 28=457/0-4-8 (min. 0-1-8)
 Max Grav 14=479(LC 7), 22=1802(LC 1), 28=489(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-907/0, 3-4=-1268/0, 4-5=-1139/0, 5-6=0/596, 6-7=0/596, 7-8=0/784, 8-9=-626/312,
 9-10=-1167/47, 10-11=-1216/0, 11-12=-779/0
 BOT CHORD 27-28=0/569, 26-27=0/1268, 25-26=0/1268, 24-25=0/1268, 23-24=0/1139, 22-23=-1335/0,
 21-22=-1324/0, 20-21=-520/188, 19-20=-520/188, 18-19=-47/1167, 17-18=-47/1167,
 16-17=-47/1167, 15-16=0/1148, 14-15=0/396
 WEBS 7-22=-1759/0, 3-27=-461/0, 2-27=0/440, 2-28=-722/0, 9-19=-767/0, 8-19=0/620,
 8-21=-858/0, 7-21=0/808, 11-15=-480/0, 12-15=0/498, 12-14=-611/0, 4-24=-289/21,
 5-23=-1690/0, 7-23=0/1272

NOTES- (6-7)

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x4 MT20 unless otherwise indicated.
- 3) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) CAUTION, Do not erect truss backwards.
- 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-13=-80
 Concentrated Loads (lb)
 Vert: 5=-720
- 2) Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-13=-80

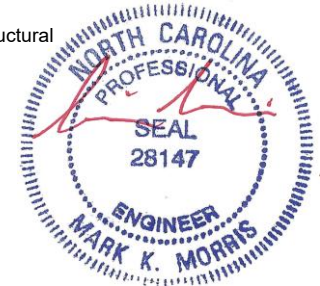

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI I-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F102	Floor	4	1	Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:50:58 2024 Page 2
ID:UMCU2t6gUxCLqMKo_q9qyaVB1-sbYOV08mnlJJKVw_oXqeJoTVRlc?av4GTqaygNywfix


LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 5=-720
- 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-80, 7-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-16, 7-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-80, 7-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-16, 7-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-80, 4-7=-16, 7-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-3=-16, 3-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 9) 3rd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-10=-80, 10-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 10) 4th chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-80, 7-9=-16, 9-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 11) 5th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-80, 4-7=-16, 7-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 12) 6th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-3=-16, 3-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 13) 7th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-10=-80, 10-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 14) 8th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-7=-80, 7-9=-16, 9-13=-80
Concentrated Loads (lb)
Vert: 5=-720



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Scale = 1:16.4

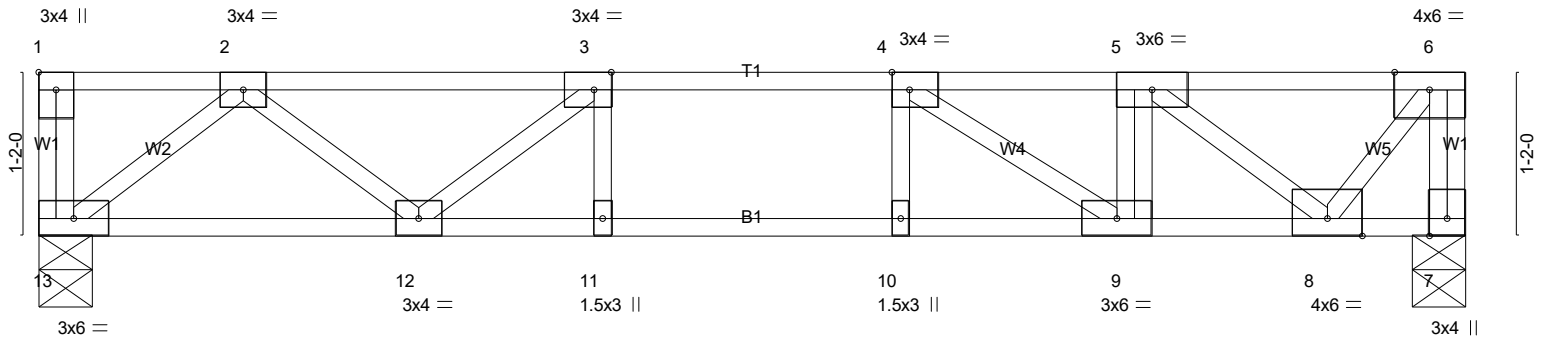


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge]

LOADING (psf)	SPACING-	1-7-3	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.64	Vert(LL)	-0.04	11	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.95	Vert(CT)	-0.15	9-10	>776		
BCLL 0.0	Rep Stress Incr	NO	WB 0.56	Horz(CT)	0.02	7	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 55 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 7=994/0-4-8 (min. 0-1-8), 13=598/0-4-8 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 6-7=-985/0, 2-3=-1181/0, 3-4=-1781/0, 4-5=-1973/0, 5-6=-750/0
 BOT CHORD 12-13=0/687, 11-12=0/1781, 10-11=0/1781, 9-10=0/1781, 8-9=0/1973
 WEBS 3-12=-795/0, 2-12=0/642, 2-13=-872/0, 4-9=0/403, 5-8=-1534/0, 6-8=0/1183

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
 - Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION. Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S)** Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-13=-8, 1-6=-80
 Concentrated Loads (lb)
 Vert: 5=-720
 - Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-13=-8, 1-6=-80
 Concentrated Loads (lb)
 Vert: 5=-720
 - 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 7-13=-8, 1-4=-80, 4-6=-16
 Concentrated Loads (lb)
 Vert: 5=-720



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F103	Floor	3	1	Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:50:59 2024 Page 2
ID:UMCU2t6gUxCLqMlKo_q9qxyaVB1-Kn6m6L9OYcmAyfvAMELts?0fs9wwJNzPiUJWCpywfw

LOAD CASE(S) Standard

- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 7-13=-8, 1-3=-16, 3-6=-80
 - Concentrated Loads (lb)
 - Vert: 5=-720
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 7-13=-8, 1-4=-80, 4-6=-16
 - Concentrated Loads (lb)
 - Vert: 5=-720
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 7-13=-8, 1-3=-16, 3-6=-80
 - Concentrated Loads (lb)
 - Vert: 5=-720



7/19/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F105	Floor	7	1	
					# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:01 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-HADXX1Ae4D0uByfZTfNLxQ50gyeinGpi9oodHiywfiu



Scale = 1:37.9

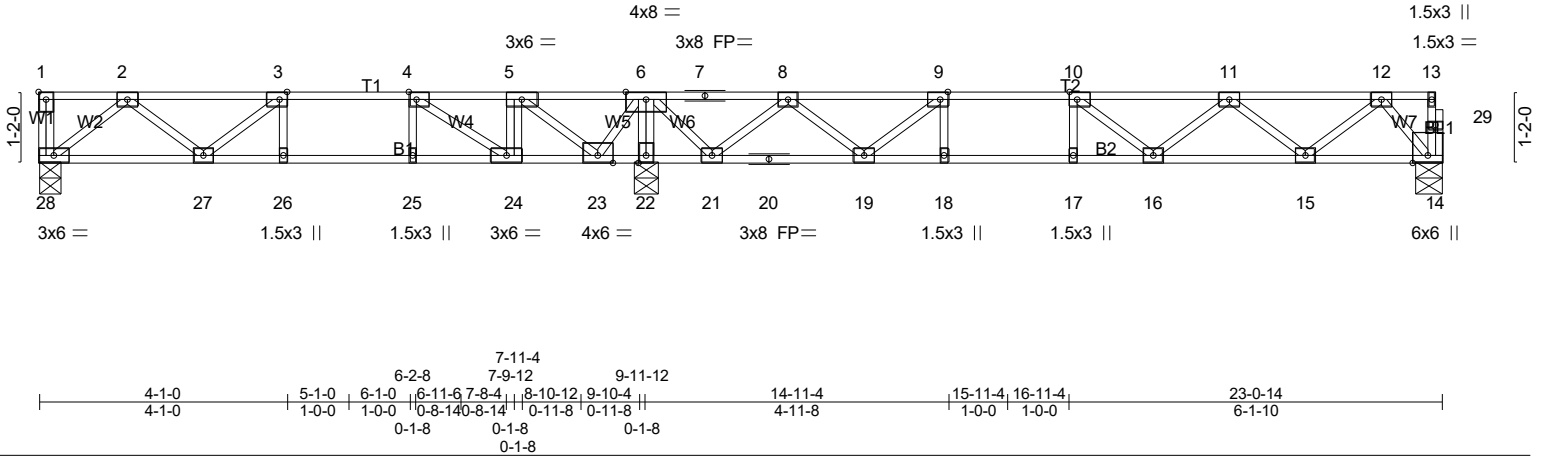


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.55	Vert(LL)	-0.11	16-17	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.80	Vert(CT)	-0.15	16-17	>999		
BCLL 0.0	Rep Stress Incr NO	WB 0.61	Horz(CT)	0.02	14	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 118 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (lb/size) 28=457/0-4-8 (min. 0-1-8), 22=1802/0-4-8 (min. 0-1-8), 14=463/0-5-6 (min. 0-1-8)
 Max Grav 28=489(LC 3), 22=1802(LC 1), 14=479(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-907/0, 3-4=-1268/0, 4-5=-1139/0, 5-6=0/596, 6-7=0/784, 7-8=0/784, 8-9=-626/312,
 9-10=-1167/47, 10-11=-1216/0, 11-12=-779/0
 BOT CHORD 27-28=0/569, 26-27=0/1268, 25-26=0/1268, 24-25=0/1268, 23-24=0/1139, 22-23=-1335/0,
 21-22=-1324/0, 20-21=-520/188, 19-20=-520/188, 18-19=-47/1167, 17-18=-47/1167,
 16-17=-47/1167, 15-16=0/1148, 14-15=0/396
 WEBS 6-22=-1759/0, 3-27=-461/0, 2-27=0/440, 2-28=-722/0, 9-19=-767/0, 8-19=0/620,
 8-21=-858/0, 6-21=0/808, 11-15=-480/0, 12-15=0/498, 12-14=-611/0, 4-24=-289/21,
 5-23=-1690/0, 6-23=0/1272

NOTES- (6-7)

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-13=-80
 Concentrated Loads (lb)
 Vert: 5=-720
- Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-13=-80

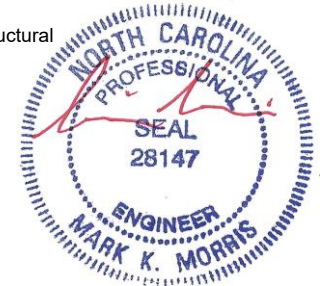

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F105	Floor	7	1	Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:01 2024 Page 2
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-HADXX1Ae4D0uByfZTfNLxQ50gyeinGpi9oodHiywfiu

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 5=-720
- 3) 1st Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-80, 6-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 4) 2nd Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-16, 6-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 5) 3rd unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-80, 6-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 6) 4th unbalanced Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-16, 6-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 7) 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-80, 4-6=-16, 6-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 8) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-3=-16, 3-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 9) 3rd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-10=-80, 10-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 10) 4th chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-80, 6-9=-16, 9-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 11) 5th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-4=-80, 4-6=-16, 6-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 12) 6th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-3=-16, 3-13=-80
Concentrated Loads (lb)
Vert: 5=-720
- 13) 7th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-10=-80, 10-13=-16
Concentrated Loads (lb)
Vert: 5=-720
- 14) 8th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-28=-8, 1-6=-80, 6-9=-16, 9-13=-80
Concentrated Loads (lb)
Vert: 5=-720



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F107A	Truss Type Floor	Qty 3	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 50695
--------------------	----------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:03 2024 Page 1
ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-DZLHjyCucrGcQGpyb4Qp0rBQDmO7FEW?d6HjMaywfs



Scale = 1:36.2

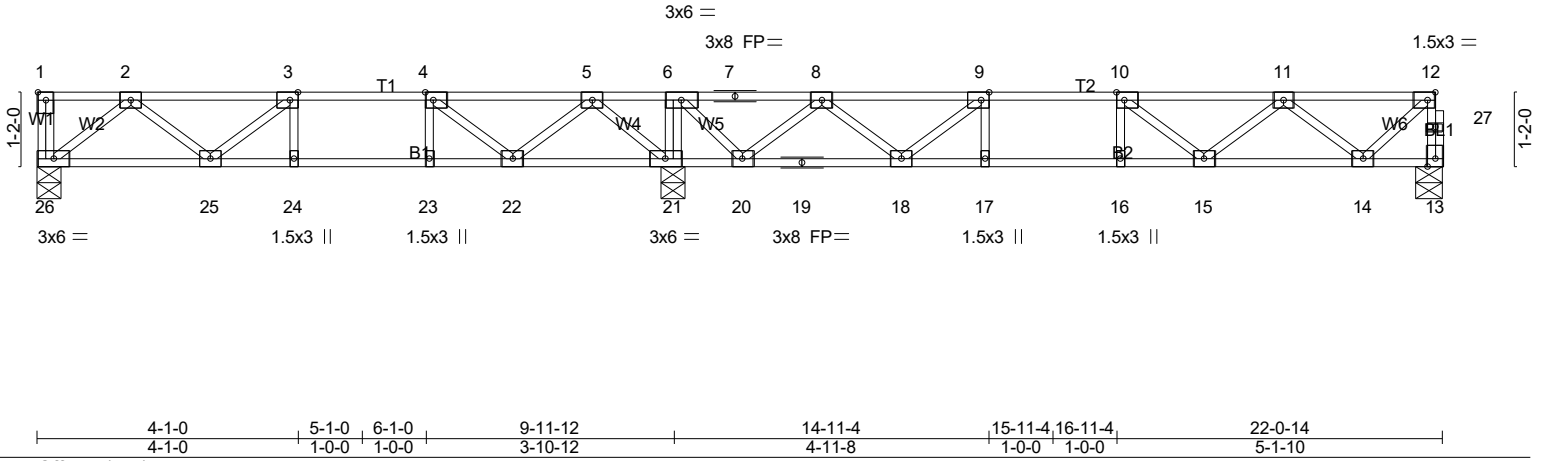


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [3:0-1-8,Edge], [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge]					
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.29	Vert(LL) -0.07 15-16 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.49	Vert(CT) -0.09 15-16 >999 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.34	Horz(CT) 0.02 13 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 110 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3(flat)	6-0-0 oc bracing: 21-22,20-21,18-20.

REACTIONS. (lb/size) 26=368/0-4-8 (min. 0-1-8), 13=468/0-5-6 (min. 0-1-8), 21=1078/0-4-8 (min. 0-1-8)
Max Grav 26=399(LC 10), 13=488(LC 7), 21=1078(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 13-27=-484/0, 12-27=-483/0, 2-3=-680/0, 3-4=-849/0, 4-5=-514/131, 5-6=0/698, 8-9=-971/0, 9-10=-1298/0, 10-11=-1134/0, 11-12=-454/0
BOT CHORD 25-26=0/471, 24-25=0/849, 23-24=0/849, 22-23=0/849, 21-22=-280/204, 20-21=-698/0, 19-20=-3/666, 18-19=-3/666, 17-18=0/1298, 16-17=0/1298, 15-16=0/1298, 14-15=0/934
WEBS 6-21=-634/0, 2-25=0/272, 2-26=-598/0, 4-22=-544/0, 5-22=0/475, 5-21=-682/0, 9-18=-503/0, 8-18=0/451, 8-20=-744/0, 6-20=0/707, 11-15=0/261, 11-14=-624/0, 12-14=0/593

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F108	Truss Type Floor	Qty 3	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
					# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:04 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-hlvf93CXN8OT2QN89nx2Z3jW9Agn_h58sm1Hu1ywfir



Scale = 1:36.2

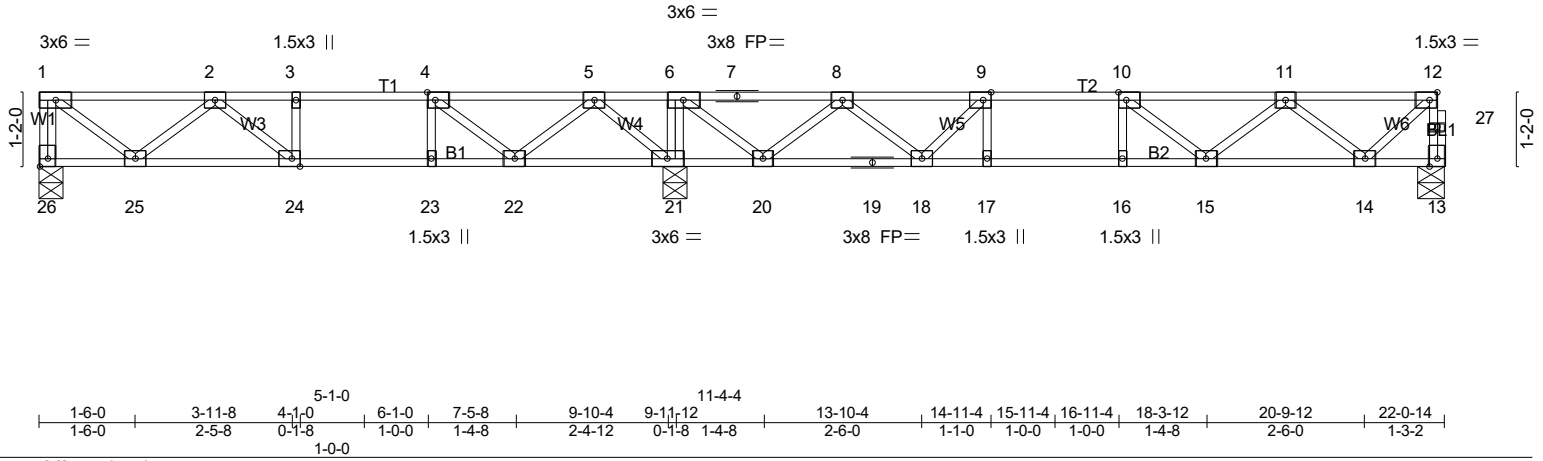


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [9:0-1-8,Edge], [10:0-1-8,Edge], [12:0-1-8,Edge], [24:0-1-8,Edge], [26:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.60	Vert(LL)	-0.09	24-25	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.72	Vert(CT)	-0.12	24-25	>977		
BCLL 0.0	Lumber DOL 1.00	WB 0.38	Horz(CT)	0.02	13	n/a		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH						
	Code IRC2021/TPI2014							
								Weight: 110 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3(flat)	6-0-0 oc bracing: 21-22,20-21.

REACTIONS. (lb/size) 26=528/0-4-8 (min. 0-1-8), 13=480/0-5-6 (min. 0-1-8), 21=1146/0-4-8 (min. 0-1-8)
Max Grav 26=558(LC 3), 13=500(LC 7), 21=1146(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-26=-565/0, 13-27=-497/0, 12-27=-496/0, 1-2=-635/0, 2-3=-1348/0, 3-4=-1348/0,
4-5=-844/31, 5-6=0/507, 6-7=-372/3, 7-8=-372/3, 8-9=-1144/0, 9-10=-1368/0,
10-11=-1179/0, 11-12=-468/0
BOT CHORD 24-25=0/1148, 23-24=0/1348, 22-23=0/1348, 21-22=-213/418, 20-21=-507/0, 19-20=0/875,
18-19=0/875, 17-18=0/1368, 16-17=0/1368, 15-16=0/1368, 14-15=0/961
WEBS 6-21=-636/0, 1-25=0/797, 2-25=-668/0, 2-24=-28/276, 4-22=-754/0, 5-22=0/627,
5-21=-766/0, 6-20=0/752, 8-20=-693/0, 8-18=0/401, 9-18=-409/0, 11-15=0/285,
11-14=-642/0, 12-14=0/610

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 13-26=-8, 1-12=-80
Concentrated Loads (lb)
Vert: 3=-240

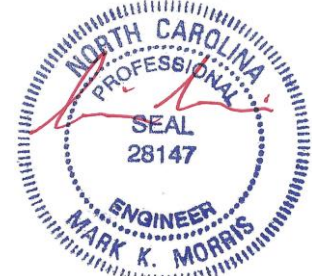

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F109	Floor	1	1	
					# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:05 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-9xT2NPD98SWKgayKiVSH5GGk1Z0fj8qL4PmqQTywfq


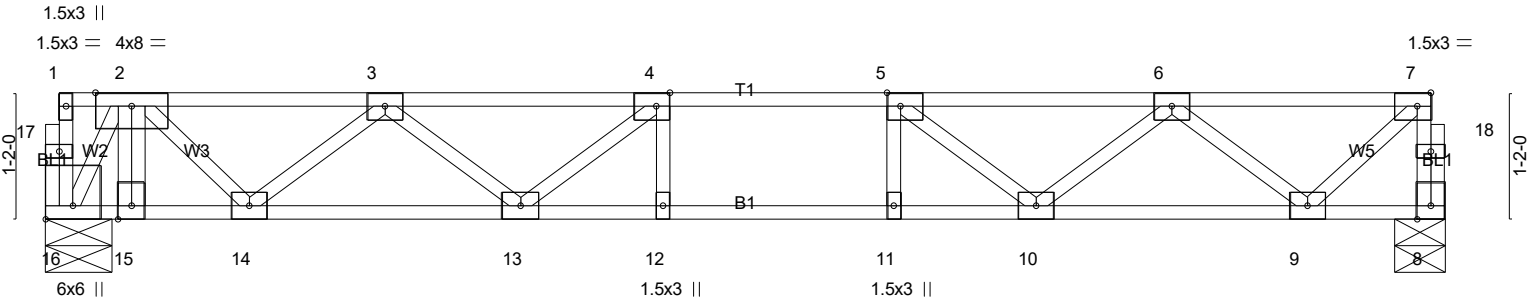



Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [7:0-1-8,Edge], [16:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.40	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.74	Vert(LL) -0.09 12-13 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.35	Vert(CT) -0.15 12-13 >999 360		
BCDL 5.0	Rep Stress Incr NO	Matrix-SH	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2021/TPI2014			Weight: 68 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 8=585/0-5-6 (min. 0-1-8), 16=1156/0-7-4 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 8-18=-585/0, 7-18=-584/0, 2-3=-1140/0, 3-4=-1748/0, 4-5=-1857/0, 5-6=-1476/0, 6-7=-559/0
 BOT CHORD 15-16=0/746, 14-15=0/746, 13-14=0/1580, 12-13=0/1857, 11-12=0/1857, 10-11=0/1857, 9-10=0/1142
 WEBS 5-10=-559/0, 6-10=0/437, 6-9=-759/0, 7-9=0/730, 2-16=-1368/0, 4-13=-257/48, 3-14=-572/0, 2-14=0/550

- NOTES-** (6-7)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Load case(s) 1, 2, 3, 4, 5, 6 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S)** Standard
- Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-16=-8, 1-7=-80
 Concentrated Loads (lb)
 Vert: 2=-640
 - Dead: Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-16=-8, 1-7=-80
 Concentrated Loads (lb)
 Vert: 2=-640
 - 1st chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-16=-8, 1-5=-80, 5-7=-16
 Concentrated Loads (lb)
 Vert: 2=-640



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F109	Floor	1	1	Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:05 2024 Page 2
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-9xT2NPD98SWKgayKiVSH5GGk1Z0fj8qI4PmqQTywfq

LOAD CASE(S) Standard

- 4) 2nd chase Dead + Floor Live (unbalanced): Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 8-16=-8, 1-4=-16, 4-7=-80
 - Concentrated Loads (lb)
 - Vert: 2=-640
- 5) 3rd chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 8-16=-8, 1-5=-80, 5-7=-16
 - Concentrated Loads (lb)
 - Vert: 2=-640
- 6) 4th chase Dead: Lumber Increase=1.00, Plate Increase=1.00
 - Uniform Loads (plf)
 - Vert: 8-16=-8, 1-4=-16, 4-7=-80
 - Concentrated Loads (lb)
 - Vert: 2=-640



7/19/2024

Warning !—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F110	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 50695
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:06 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-d81QalEnumeAHjXWGCzWeUp_9zXKSG0RJ3WNyvywfp

0₁-8

0₁-8

Scale = 1:20.9

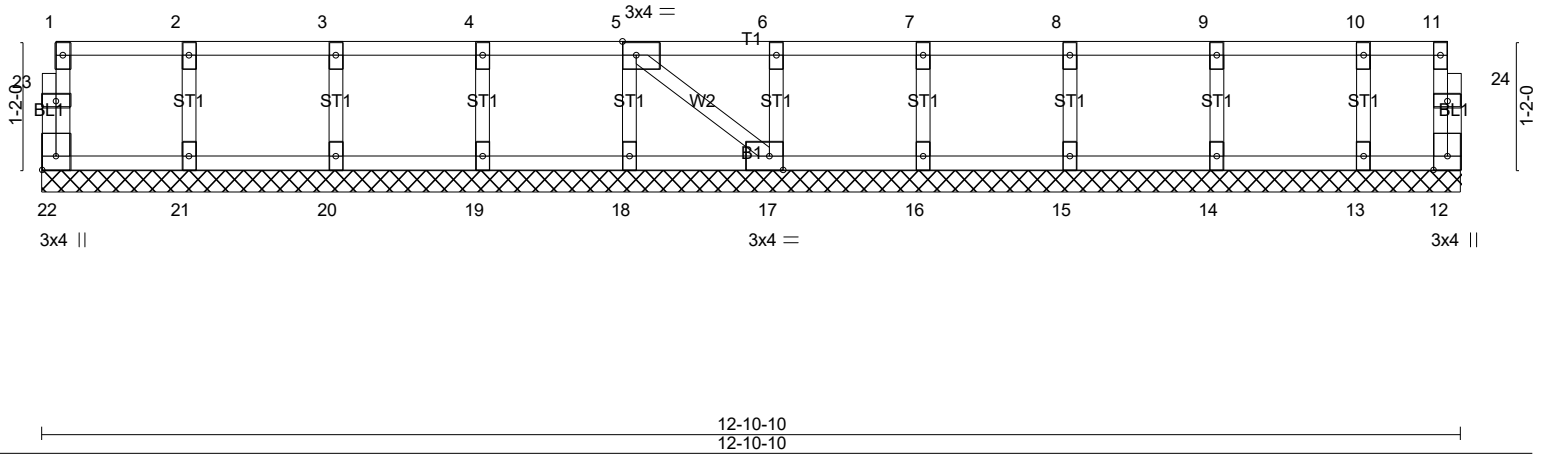


Plate Offsets (X,Y)-- [5:0-1-8,Edge], [17:0-1-8,Edge], [22:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 57 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 12-10-10.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F111	Truss Type Floor	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC	# 50695
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:07 2024 Page 1
ID:UMCU2t6gUxCLqMlKo_q9qxyaVB1-5Kboo4FPf3m1vt6jqwUIAhL6ONtoB6kbYjFxFVLywfio

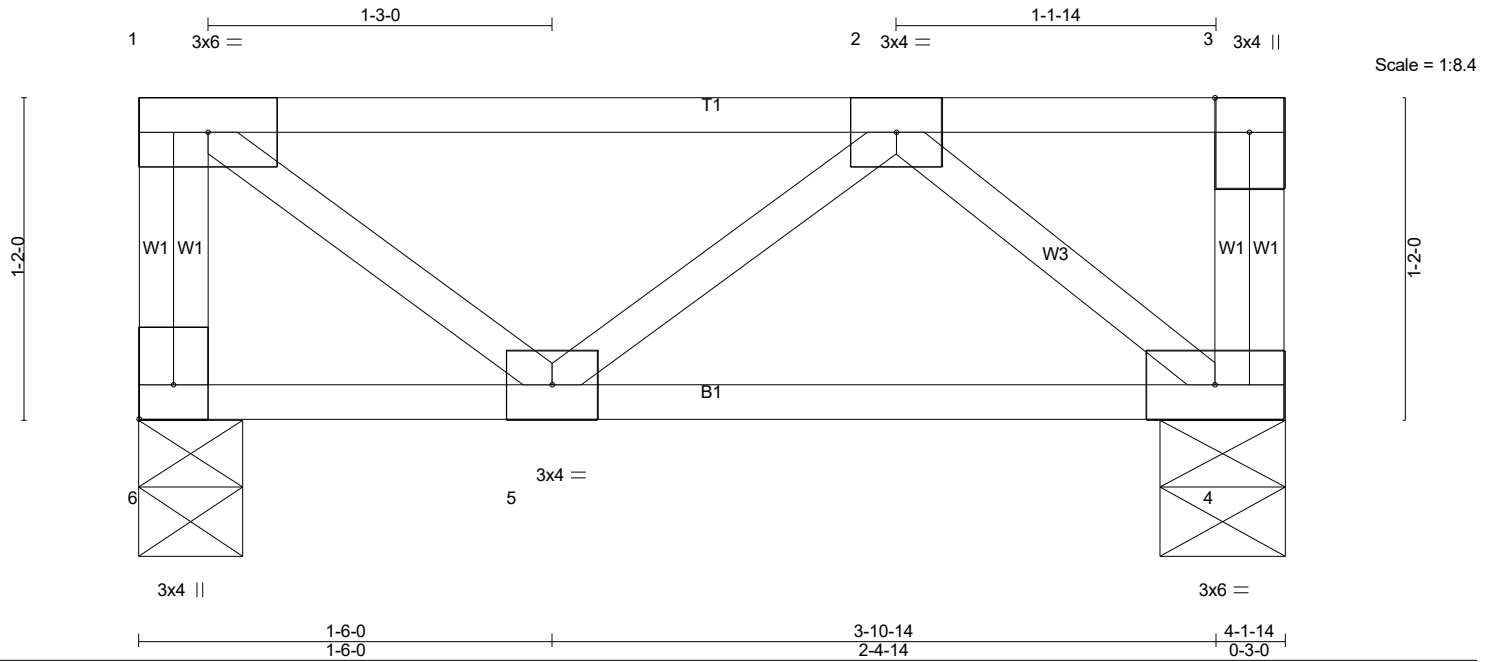


Plate Offsets (X,Y)-- [6:Edge,0-1-8]		CSI.		DEFL.				PLATES	GRIP
LOADING (psf)	SPACING-	1-7-3	TC	in	(loc)	l/defl	L/d		
TCLL 40.0	Plate Grip DOL	1.00	0.22	Vert(LL)	-0.00	5	>999	480	MT20
TCDL 10.0	Lumber DOL	1.00	BC	Vert(CT)	-0.00	4-5	>999	360	244/190
BCLL 0.0	Rep Stress Incr	YES	WB	Horz(CT)	0.00	4	n/a	n/a	
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 25 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-1-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=172/0-4-8 (min. 0-1-8), 4=172/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (2-3)

- 1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 2) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 3) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F112	Truss Type Floor	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) # 50695
--------------------	---------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:07 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-5Kboo4FPf3m1vt6jqwUIAhL6ONtoB6kbYjFxFVLywfio

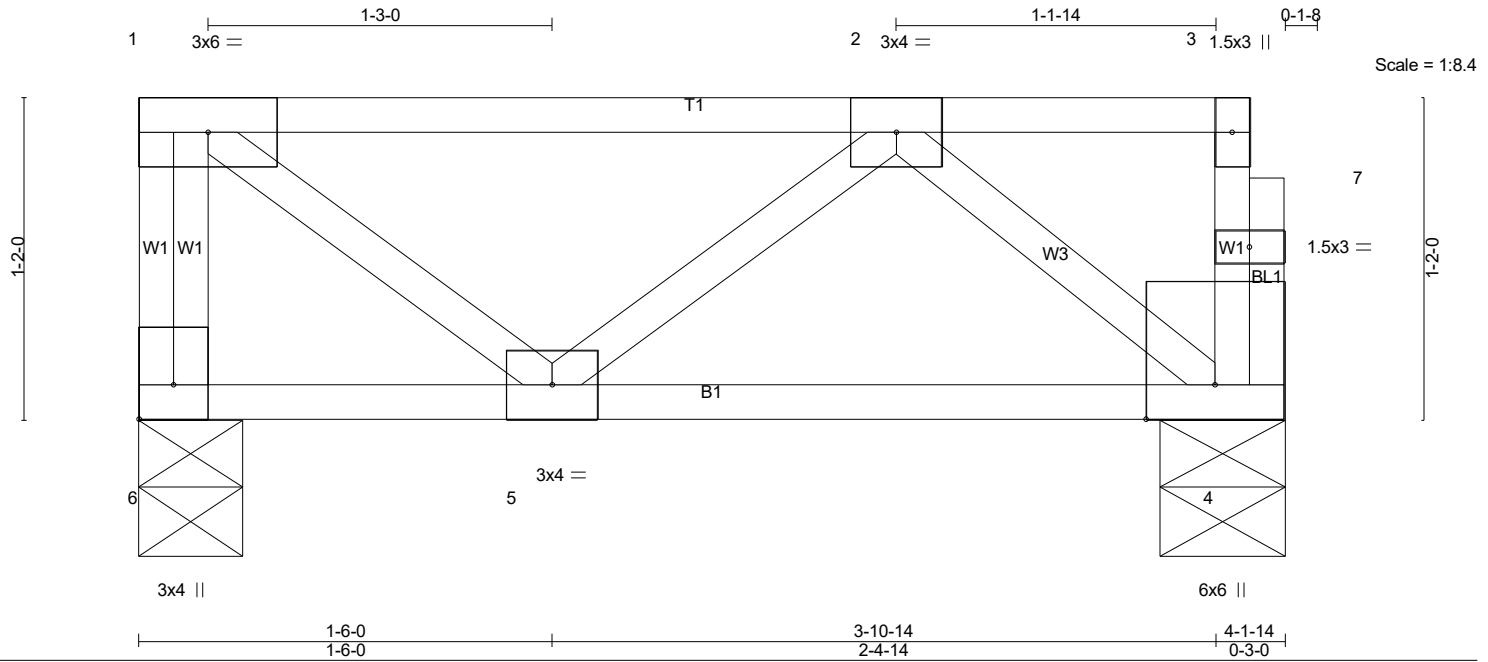


Plate Offsets (X,Y)-- [6:Edge,0-1-8]		CSI.		DEFL.				PLATES	GRIP
LOADING (psf)	SPACING-	1-7-3	TC	in	(loc)	l/defl	L/d	MT20	244/190
TCLL 40.0	Plate Grip DOL	1.00	0.22	Vert(LL)	-0.00	5	>999	480	
TCDL 10.0	Lumber DOL	1.00	0.06	Vert(CT)	-0.00	4-5	>999	360	
BCLL 0.0	Rep Stress Incr	YES	0.07	Horz(CT)	0.00	4	n/a	n/a	
BCDL 5.0	Code IRC2021/TPI2014		Matrix-P						Weight: 24 lb FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-1-14 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 6=172/0-4-8 (min. 0-1-8), 4=167/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (3-4)

- 1) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 2) CAUTION, Do not erect truss backwards.
- 3) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 4) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F113	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) # 50695
--------------------	---------------	-------------------------------------	----------	----------	--	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:08 2024 Page 1
ID:UMCU2t6gUxCLqMlKo_q9qxyaVB1-ZW8A?QG1QNuuX1hvOd?_juKbnDjwaVknN?U1oywfin

0-1-8

Scale = 1:22.1

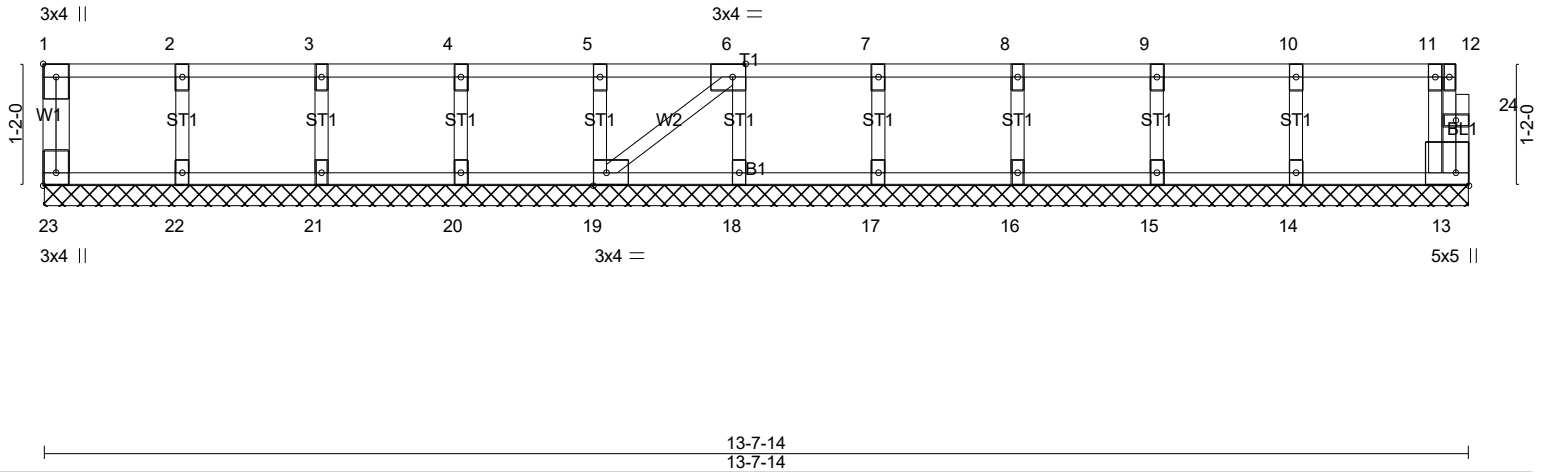


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [6:0-1-8,Edge], [13:Edge,0-1-8], [19:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	13	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 62 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-7-14.
(lb) - Max Grav All reactions 250 lb or less at joint(s) 23, 13, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F114	Floor Supported Gable	1	1	
					# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:09 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-2jiYDmGfBh0l8BG5xKWGD6RU5BY?f1ht?1k2ZEywfim

0-1-8

Scale = 1:37.5

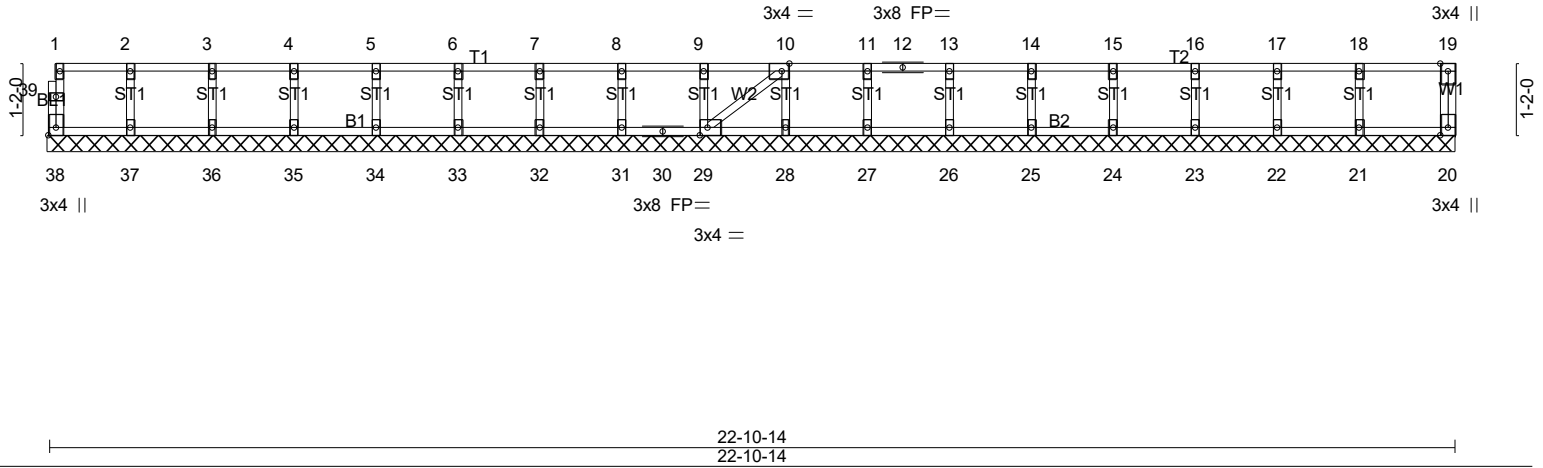


Plate Offsets (X,Y)-- [10:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.08	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.00 20 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 97 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

REACTIONS. All bearings 22-10-14.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 31, 29, 28, 27, 26, 25, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - CAUTION, Do not erect truss backwards.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F115	Truss Type Floor	Qty 11	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC	# 50695
--------------------	---------------	---------------------	-----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:10 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-WvGwQ6HHy_8cmLrIV22SoKzaOalyOPp1EhUb5gywfl

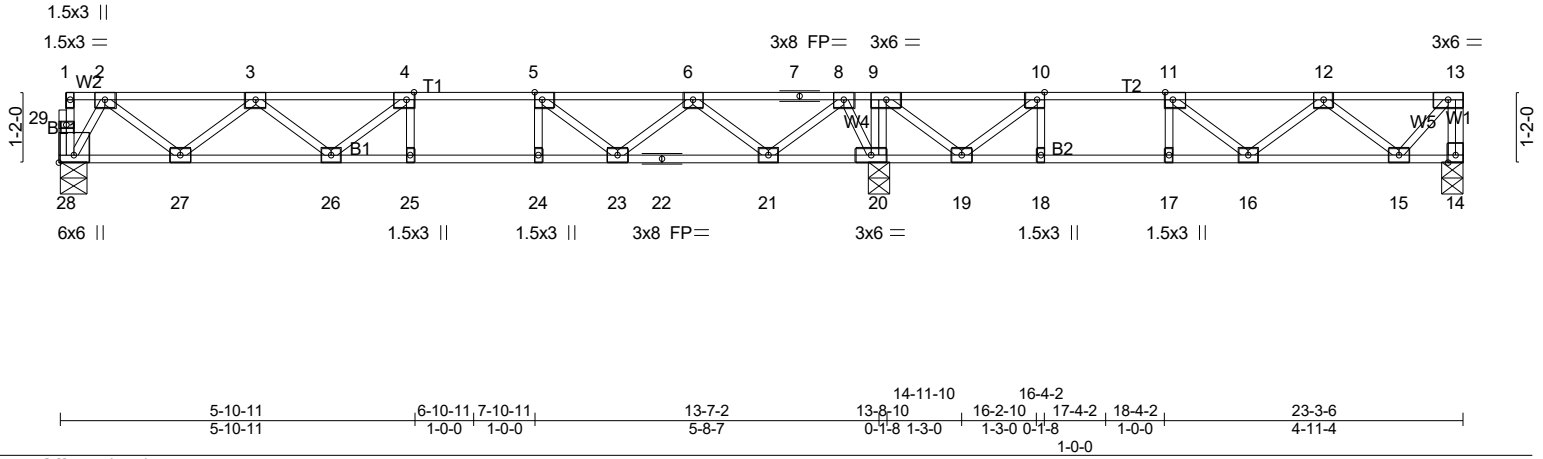


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [28:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.43	Vert(LL)	-0.09	25-26	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.60	Vert(CT)	-0.12	25-26	>999		
BCLL 0.0	Lumber DOL 1.00	WB 0.36	Horz(CT)	0.03	14	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014							
								Weight: 117 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=547/0-5-6 (min. 0-1-8), 14=364/0-4-8 (min. 0-1-8), 20=1109/0-4-8 (min. 0-1-8)
Max Grav 28=558(LC 10), 14=409(LC 4), 20=1109(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 13-14=-403/0, 2-3=-847/0, 3-4=-1529/0, 4-5=-1703/0, 5-6=-1387/0, 6-7=-548/0,
7-8=-548/0, 8-9=0/658, 9-10=-350/348, 10-11=-840/87, 11-12=-821/0, 12-13=-307/0
BOT CHORD 27-28=0/353, 26-27=0/1321, 25-26=0/1703, 24-25=0/1703, 23-24=0/1703, 22-23=0/1088,
21-22=0/1088, 20-21=-314/26, 19-20=-658/0, 18-19=-87/840, 17-18=-87/840,
16-17=-87/840, 15-16=0/710
WEBS 9-20=-453/0, 4-26=-298/0, 3-26=0/273, 3-27=-616/0, 2-27=0/643, 2-28=-679/0,
5-23=-473/0, 6-23=0/431, 6-21=-740/0, 8-21=0/765, 8-20=-784/0, 10-19=-771/0,
9-19=0/616, 12-15=-524/0, 13-15=0/459


- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

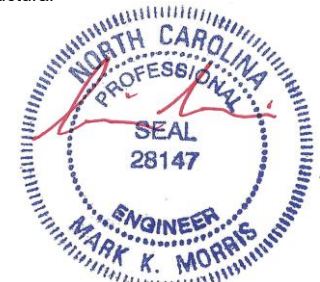

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

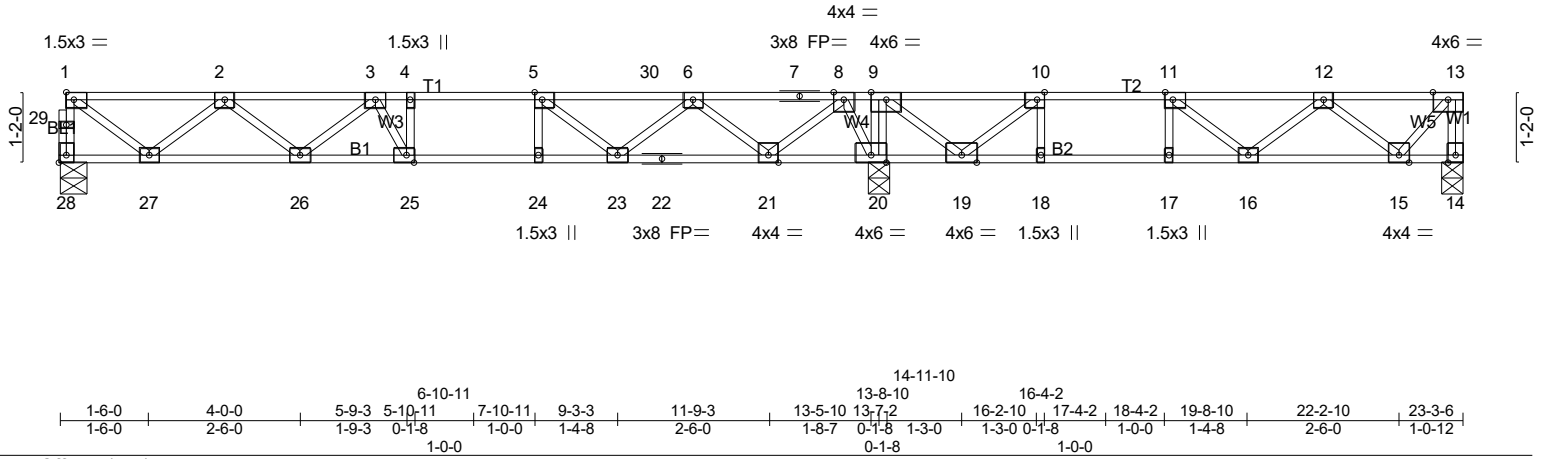

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.94	Vert(LL)	-0.16 16-17 >701 480	MT20	244/190	Weight: 117 lb FT = 20%F, 11%E	
TCDL	10.0	Lumber DOL	1.00	BC	0.87	Vert(CT)	-0.22 16-17 >529 360				
BCLL	0.0	Rep Stress Incr	NO	WB	0.58	Horz(CT)	0.04 14 n/a n/a				
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH							

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat) *Except*
 B2: 2x4 SP SS(flat)
 WEBS 2x4 SP No.3(flat)


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-21,19-20.

REACTIONS. (lb/size) 28=581/0-5-6 (min. 0-1-8), 14=814/0-4-8 (min. 0-1-8), 20=1962/0-4-8 (min. 0-1-8)
 Max Grav 28=603(LC 10), 14=883(LC 4), 20=1962(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 28-29=-600/0, 1-29=-599/0, 13-14=-870/0, 1-2=-688/0, 2-3=-1602/0, 3-4=-1992/0, 4-5=-1992/0, 5-30=-1788/0, 6-30=-1788/0, 6-7=-833/0, 7-8=-833/0, 8-9=0/1066, 9-10=-814/464, 10-11=-1849/0, 11-12=-1783/0, 12-13=-657/0
 BOT CHORD 26-27=0/1287, 25-26=0/1905, 24-25=0/1992, 23-24=0/1992, 22-23=0/1556, 21-22=0/1556, 20-21=-540/112, 19-20=-1066/0, 18-19=0/1849, 17-18=0/1849, 16-17=0/1849, 15-16=0/1543
 WEBS 10-18=0/412, 11-17=-373/0, 9-20=-970/0, 1-27=0/833, 2-27=-779/0, 2-26=0/409, 3-26=-395/0, 3-25=-103/359, 5-23=-421/0, 6-23=0/393, 6-21=-1019/0, 8-21=0/1031, 8-20=-1243/0, 9-19=0/1220, 10-19=-1527/0, 12-16=-57/313, 12-15=-1153/0, 13-15=0/983

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 14-28=-8, 1-30=-80, 13-30=-180

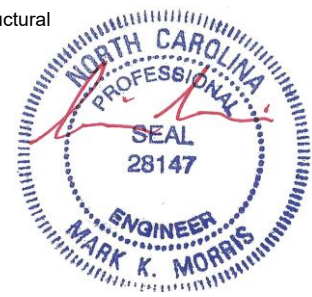

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F116	FLOOR	4	1	

Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:13 2024 Page 1
ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-wUy328JAFvWBdoZtAAAb9Qyb0qokPbgZTwrFi?ywfii

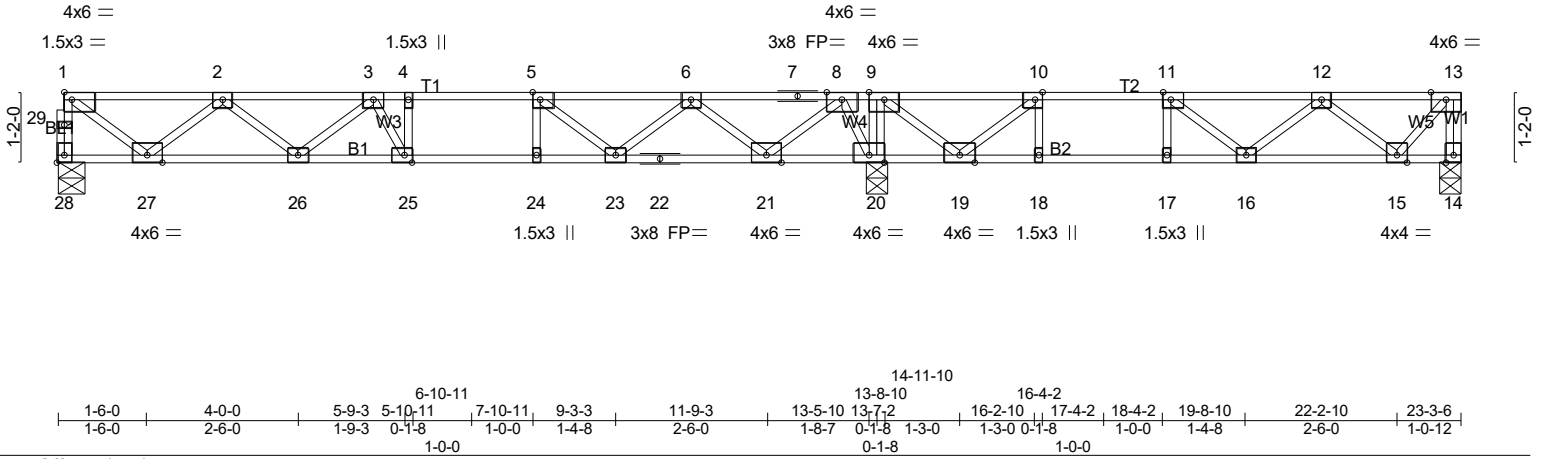


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [25:0-1-8,Edge], [28:Edge,0-1-8]					
LOADING (psf)	SPACING- 1-7-3	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.73	Vert(LL) -0.09 25-26 >999 480	MT20	244/190
TCDL 60.0	Lumber DOL 1.00	BC 0.81	Vert(CT) -0.21 25-26 >752 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.68	Horz(CT) 0.05 14 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 117 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 20-21,19-20.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 28=1037/0-5-6 (min. 0-1-8), 14=684/0-4-8 (min. 0-1-8), 20=2136/0-4-8 (min. 0-1-8)
Max Grav 28=1047(LC 10), 14=733(LC 4), 20=2136(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 28-29=-1041/0, 1-29=-1040/0, 13-14=-719/0, 1-2=-1167/0, 2-3=-2679/0, 3-4=-3123/0,
4-5=-3123/0, 5-6=-2495/0, 6-7=-844/0, 7-8=-844/0, 8-9=0/1189, 9-10=-289/437,
10-11=-1342/0, 11-12=-1410/0, 12-13=-538/0
BOT CHORD 26-27=0/2205, 25-26=0/3106, 24-25=0/3123, 23-24=0/3123, 22-23=0/1910, 21-22=0/1910,
20-21=-531/0, 19-20=-1189/0, 18-19=0/1342, 17-18=0/1342, 16-17=0/1342, 15-16=0/1269
WEBS 10-18=0/398, 11-17=-359/0, 9-20=-874/0, 1-27=0/1410, 2-27=-1352/0, 2-26=0/617,
3-26=-555/0, 3-25=-140/252, 5-23=-868/0, 6-23=0/804, 6-21=-1424/0, 8-21=0/1436,
8-20=-1431/0, 9-19=0/1162, 10-19=-1489/0, 11-16=0/281, 12-15=-951/0, 13-15=0/804


- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard

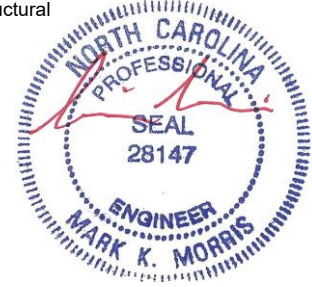

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

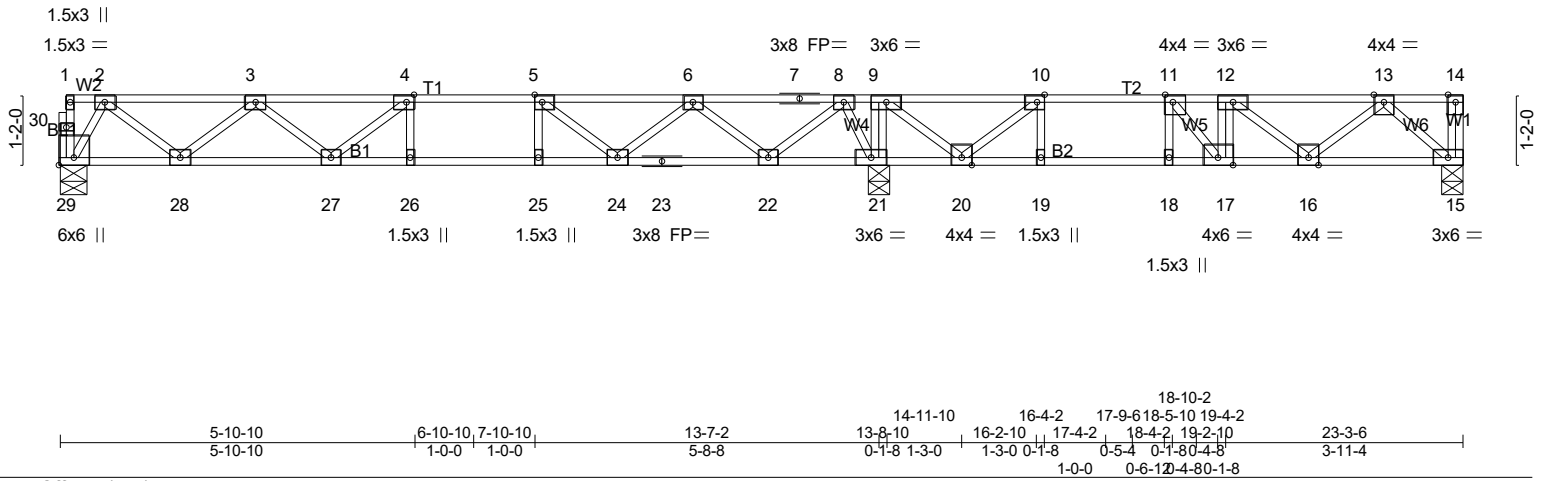

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.73	Vert(LL) -0.16 17-18 >714 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.96	Vert(CT) -0.22 17-18 >526 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.50	Horz(CT) 0.04 15 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
Weight: 120 lb FT = 20%F, 11%E					

LUMBER-
 TOP CHORD 2x4 SP No.1(flat) *Except*
 T2: 2x4 SP SS(flat)
 BOT CHORD 2x4 SP No.1(flat) *Except*
 B2: 2x4 SP SS(flat)
 WEBS 2x4 SP No.3(flat)


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 21-22,20-21.

REACTIONS. (lb/size) 29=570/0-5-6 (min. 0-1-8), 21=1310/0-4-8 (min. 0-1-8), 15=781/0-4-8 (min. 0-1-8)
 Max Grav 29=580(LC 10), 21=1310(LC 1), 15=830(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-886/0, 3-4=-1621/0, 4-5=-1844/0, 5-6=-1578/0, 6-7=-791/0, 7-8=-791/0, 8-9=-235/608, 9-10=-972/220, 10-11=-1925/0, 11-12=-2492/0, 12-13=-1658/0
 BOT CHORD 28-29=0/367, 27-28=0/1383, 26-27=0/1844, 25-26=0/1844, 24-25=0/1844, 23-24=0/1307, 22-23=0/1307, 21-22=-256/352, 20-21=-608/235, 19-20=0/1925, 18-19=0/1925, 17-18=0/1925, 16-17=0/2492, 15-16=0/908
 WEBS 12-17=-471/0, 10-19=0/424, 11-18=-472/0, 9-21=-583/0, 4-27=-361/0, 3-27=0/313, 3-28=-646/0, 2-28=0/676, 2-29=-707/0, 5-24=-461/0, 6-24=0/424, 6-22=-732/0, 8-22=0/754, 8-21=-828/0, 10-20=-1370/0, 9-20=0/1019, 11-17=0/1055, 12-16=-1046/0, 13-16=0/977, 13-15=-1207/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 15-29=-8, 1-14=-80
 Concentrated Loads (lb)
 Vert: 12=-640

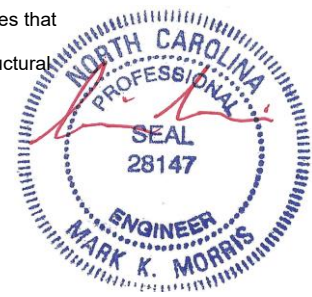

7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F117	Floor	1	1	# 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:16 2024 Page 1
 ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-K3dCh9M2YqvmUGIRsJ8s2bDX3?imo48vcdxvJKYwff

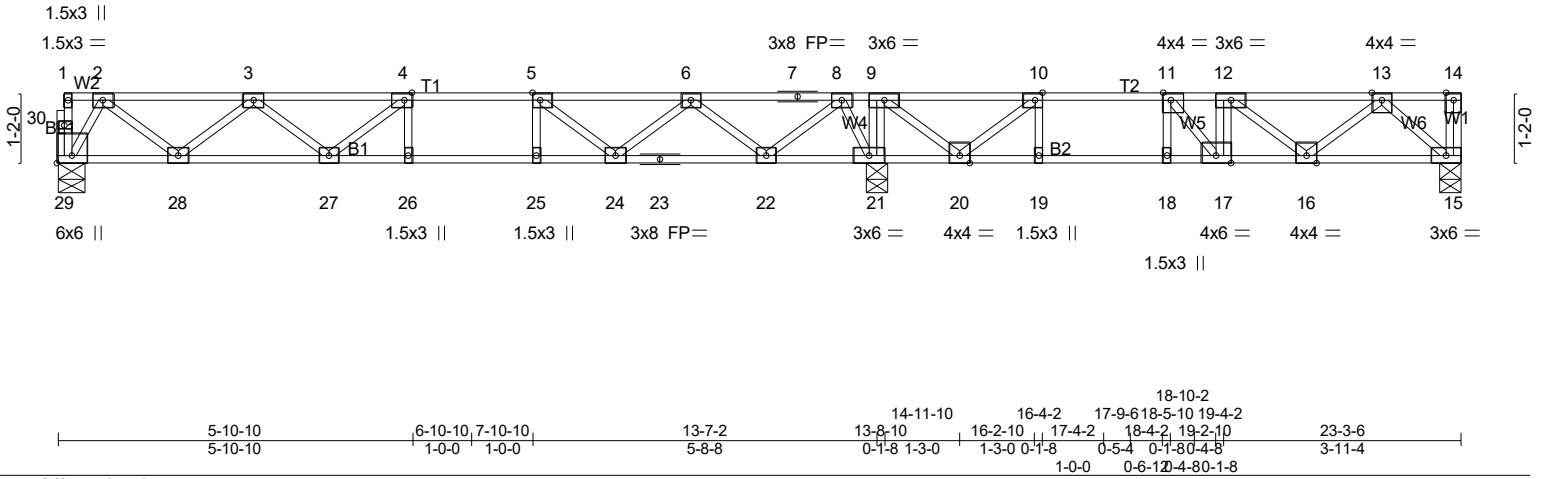


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge], [29:Edge,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.73	Vert(LL)	-0.16 17-18	>714	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.96	Vert(CT)	-0.22 17-18	>526	360		
BCLL 0.0	Rep Stress Incr NO	WB 0.50	Horz(CT)	0.04 15	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH						
							Weight: 120 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat) *Except* T2: 2x4 SP SS(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat) *Except* B2: 2x4 SP SS(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 21-22,20-21.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (lb/size) 29=570/0-5-6 (min. 0-1-8), 21=1310/0-4-8 (min. 0-1-8), 15=781/0-4-8 (min. 0-1-8)
 Max Grav 29=580(LC 10), 21=1310(LC 1), 15=830(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-886/0, 3-4=-1621/0, 4-5=-1844/0, 5-6=-1578/0, 6-7=-791/0, 7-8=-791/0,
 8-9=-235/608, 9-10=-972/220, 10-11=-1925/0, 11-12=-2492/0, 12-13=-1658/0
 BOT CHORD 28-29=0/367, 27-28=0/1383, 26-27=0/1844, 25-26=0/1844, 24-25=0/1844, 23-24=0/1308,
 22-23=0/1308, 21-22=-256/352, 20-21=-608/235, 19-20=0/1925, 18-19=0/1925,
 17-18=0/1925, 16-17=0/2492, 15-16=0/908
 WEBS 12-17=-471/0, 10-19=0/424, 11-18=-472/0, 9-21=-583/0, 4-27=-361/0, 3-27=0/313,
 3-28=-646/0, 2-28=0/676, 2-29=-707/0, 5-24=-461/0, 6-24=0/424, 6-22=-732/0,
 8-22=0/754, 8-21=-828/0, 10-20=-1370/0, 9-20=0/1019, 11-17=0/1055, 12-16=-1046/0,
 13-16=0/977, 13-15=-1207/0

- NOTES- (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 4) CAUTION, Do not erect truss backwards.
 - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 15-29=-8, 1-14=-80
 Concentrated Loads (lb)
 Vert: 12=-640


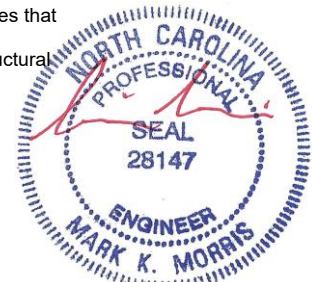


7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F01	Truss F118	Truss Type Floor	Qty 12	Ply 1	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC	# 50695
--------------------	---------------	---------------------	-----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:17 2024 Page 1
ID:UMCU2t6gUxCLqMKo_q9qxyaVB1-pFBauVNgJ81d6QteP0g5aompHP9vXZ63rHgTrmywfi

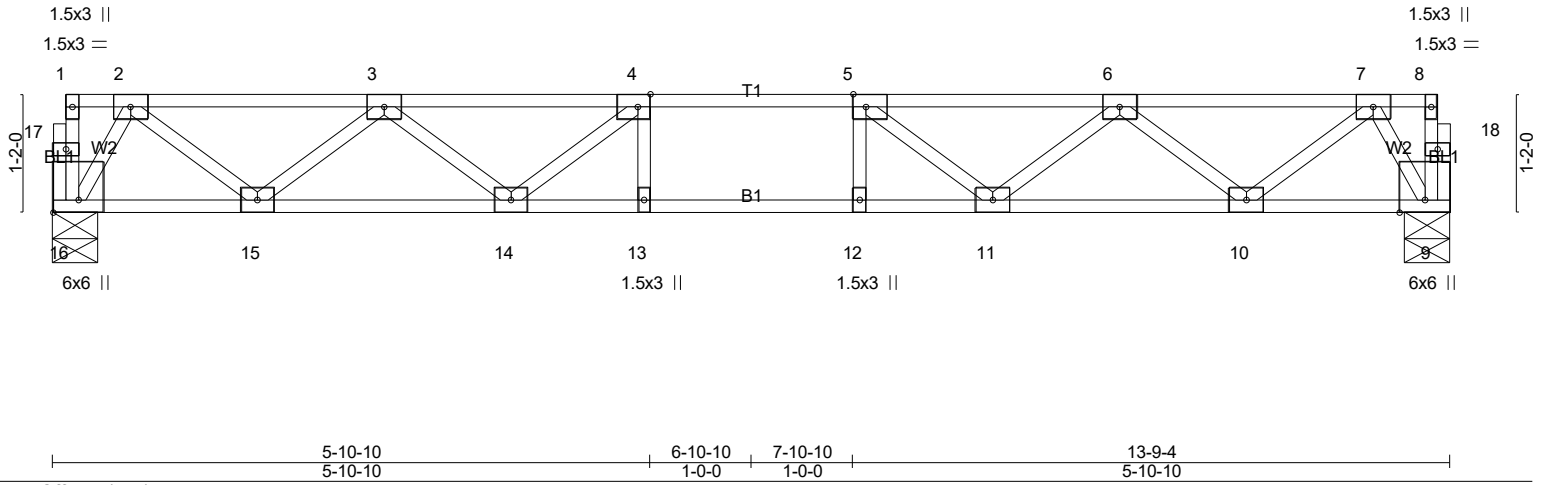

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.52	Vert(LL) -0.09 13-14 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.33	Vert(CT) -0.12 13-14 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 70 lb	FT = 20%F, 11%E

LUMBER-
TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 16=590/0-5-6 (min. 0-1-8), 9=590/0-5-6 (min. 0-1-8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-903/0, 3-4=-1662/0, 4-5=-1907/0, 5-6=-1662/0, 6-7=-903/0
BOT CHORD 15-16=0/373, 14-15=0/1410, 13-14=0/1907, 12-13=0/1907, 11-12=0/1907, 10-11=0/1409, 9-10=0/372
WEBS 4-14=-428/0, 3-14=0/355, 3-15=-660/0, 2-15=0/690, 2-16=-719/0, 5-11=-428/0, 6-11=0/355, 6-10=-660/0, 7-10=0/690, 7-9=-719/0

- NOTES-** (4-5)
- Unbalanced floor live loads have been considered for this design.
 - All plates are 3x4 MT20 unless otherwise indicated.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS 257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F01	F119	Floor Supported Gable	1	1	Job Reference (optional) # 50695

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:18 2024 Page 1
 ID:UMCU2t6gUxCLqMIKo_q9qxyaVB1-HRly5rNJ4S9TjZSqzjBK70l26pd2G5_C4xQ0NDywfid

0₁-8

0₁-8

Scale = 1:22.2

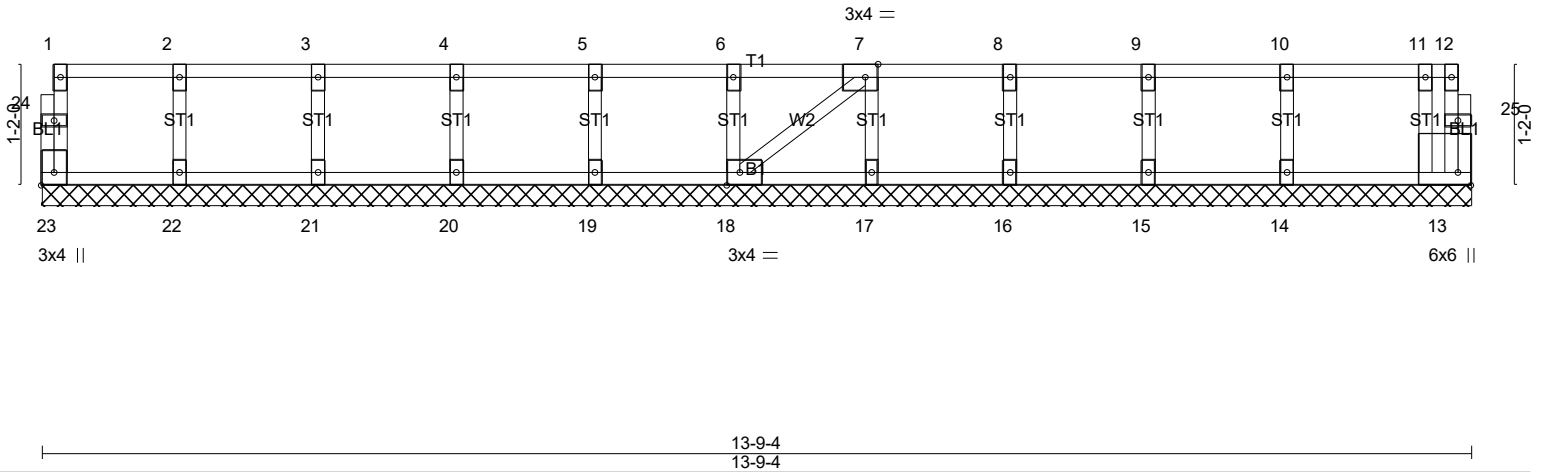


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [13:Edge,0-1-8], [18:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.00	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 61 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-9-4.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 23, 13, 22, 21, 20, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
 - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

LOAD CASE(S) Standard



7/19/2024

Warning!—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.