

# Mark Morris, P.E.

#126, 1317-M, Summerville, SC 29483

843 209-5784, Fax (866)-213-4614

The truss drawing(s) listed below have been prepared by **Atlantic Building Components** under my direct supervision based on the parameters provided by the truss designers.

AST #: 50696

JOB: 24-6140-F02

JOB NAME: LOT 0.0012 HONEYCUTT HILLS

Wind Code: N/A

Wind Speed: Vult= N/A

Exposure Category: N/A

Mean Roof Height (feet): N/A

These truss designs comply with IRC 2015 as well as IRC 2018.

*20 Truss Design(s)*

Trusses:

F201, F202, F203, F205, F205A, F206, F208, F209, F210, F211, F212, F213, F214, F215, F216, F217, F218, F219, F220, F221



**7/19/2024**

**Mark Morris**

***Warning !—Verify design parameters and read notes before use.***

This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSL/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI

Job 24-6140-F02	Truss F201	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 50696</b>
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:41 2024 Page 1  
ID: gUCksxzC6J7HT2yGkHFINYyiOvf-6tefwjfkW2D\_6iFp35jZslzH4TV9VgbM0UkhNywfiG

0-1-8

Scale = 1:37.2

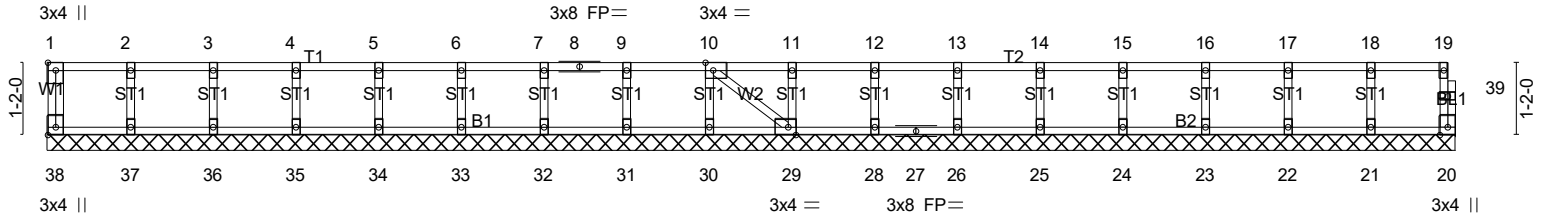


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [10:0-1-8,Edge], [29:0-1-8,Edge], [38:Edge,0-1-8]	
---	--

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	20	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 97 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS.** All bearings 22-8-6.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 38, 20, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 26, 25, 24, 23, 22, 21

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
  - 2) Gable requires continuous bottom chord bearing.
  - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 4) Gable studs spaced at 1-4-0 oc.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Scale = 1:38.4

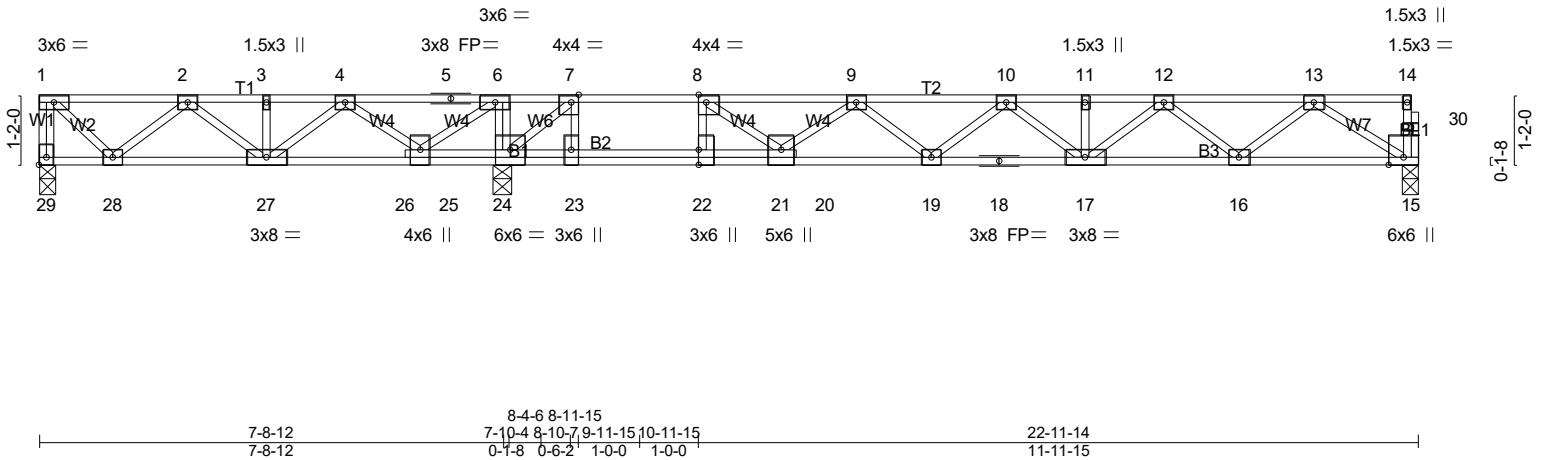


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [22:0-3-0,0-0-0], [29:Edge,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr YES
BCDL 5.0	Code IRC2021/TPI2014
	<b>CSI.</b>
	TC 0.70
	BC 0.81
	WB 0.57
	Matrix-SH
	<b>DEFL.</b> in (loc) l/defl L/d
	Vert(LL) -0.18 21-22 >984 480
	Vert(CT) -0.25 21-22 >719 360
	Horz(CT) 0.02 15 n/a n/a
	<b>PLATES GRIP</b>
	MT20 244/190
	Weight: 127 lb FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 29=180/0-3-8 (min. 0-1-8), 24=1232/0-3-8 (min. 0-1-8), 15=583/0-3-6 (min. 0-1-8)  
 Max Uplift 29=-44(LC 4)  
 Max Grav 29=273(LC 3), 24=1232(LC 1), 15=593(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-29=-271/45, 2-3=-391/306, 3-4=-391/306, 4-5=0/726, 5-6=0/726, 6-7=0/1217,  
 7-8=-413/49, 8-9=-1336/0, 9-10=-1855/0, 10-11=-1869/0, 11-12=-1869/0, 12-13=-1271/0  
 BOT CHORD 27-28=-157/418, 26-27=-485/296, 25-26=-468/290, 24-25=-1217/0, 23-24=-49/413,  
 22-23=-49/413, 21-22=-49/413, 20-21=0/1720, 19-20=0/1764, 18-19=0/1956, 17-18=0/1956,  
 16-17=0/1671, 15-16=0/844  
 WEBS 7-23=0/950, 8-22=-787/0, 6-24=-505/0, 6-25=0/742, 4-25=-593/0, 4-27=0/268,  
 2-28=-276/121, 1-28=-88/283, 7-24=-1960/0, 8-21=0/1194, 9-21=-562/0, 12-17=0/254,  
 12-16=-521/0, 13-16=0/556, 13-15=-1000/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 29.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.
  - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard

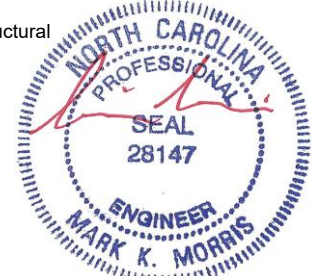

7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F203	Floor	4	1	
					<b># 50696</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:44 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYyiOvf-WSKnZkchcyRQnrZRqVBFQAUNKblJgMk212\_jOliywfID



Scale = 1:37.9

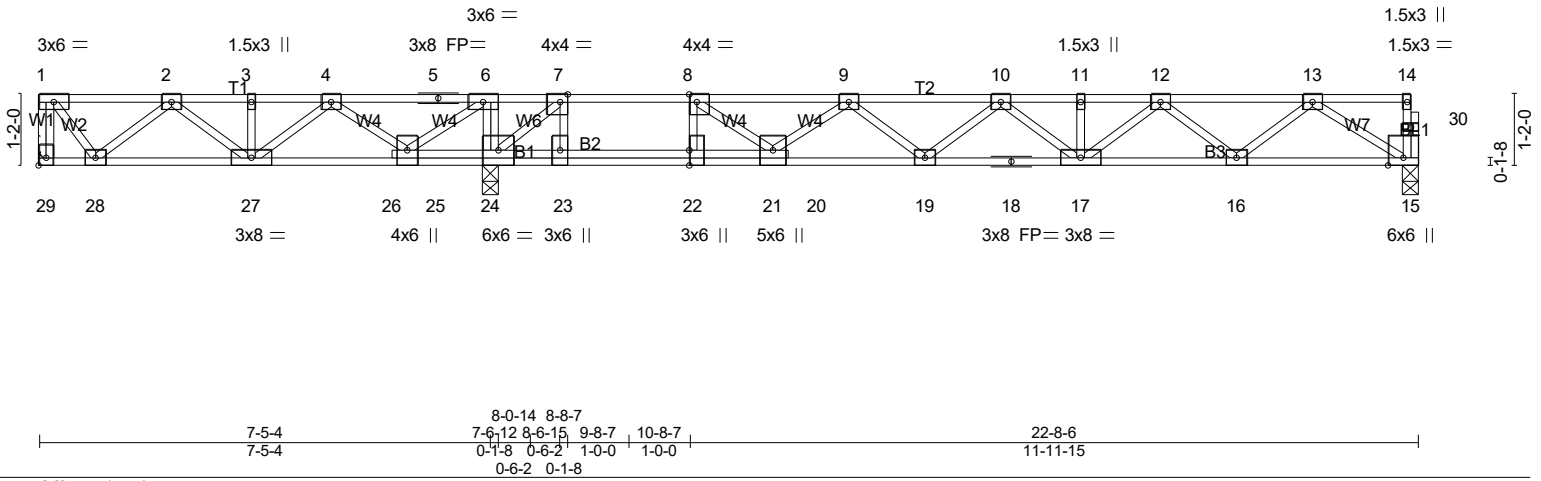


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [22:0-3-0,0-0-0], [29:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.70	Vert(LL) -0.18 21-22 >985 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.81	Vert(CT) -0.25 21-22 >719 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.57	Horz(CT) 0.02 15 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 125 lb FT = 20%F, 11%E


<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 29=163/Mechanical, 24=1223/0-3-8 (min. 0-1-8), 15=584/0-3-6 (min. 0-1-8)  
 Max Uplift 29=-54(LC 4)  
 Max Grav 29=260(LC 3), 24=1223(LC 1), 15=592(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-29=-261/53, 2-3=-363/300, 3-4=-363/300, 4-5=0/727, 5-6=0/727, 6-7=0/1206,  
 7-8=-409/34, 8-9=-1333/0, 9-10=-1853/0, 10-11=-1868/0, 11-12=-1868/0, 12-13=-1270/0  
 BOT CHORD 27-28=-151/362, 26-27=-483/281, 25-26=-466/275, 24-25=-1206/0, 23-24=-34/409,  
 22-23=-34/409, 21-22=-34/409, 20-21=0/1717, 19-20=0/1762, 18-19=0/1954, 17-18=0/1954,  
 16-17=0/1670, 15-16=0/843  
 WEBS 7-23=0/949, 8-22=-786/0, 6-24=-498/0, 6-25=0/729, 4-25=-580/0, 4-27=0/259,  
 2-28=-275/129, 7-24=-1961/0, 8-21=0/1192, 9-21=-561/0, 12-17=0/253, 12-16=-521/0,  
 13-16=0/555, 13-15=-999/0

- NOTES-** (7-8)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 29.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard

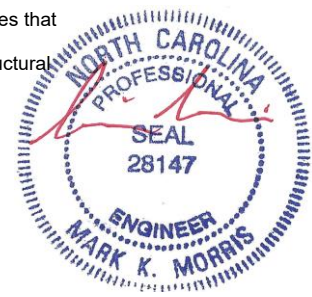

7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F205	Floor	3	1	# 50696

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:46 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYiOvf-SqRX\_QjtU2hV4tbCcchuGvTg55?8qeYKWICVNbywfiB



Scale = 1:37.9

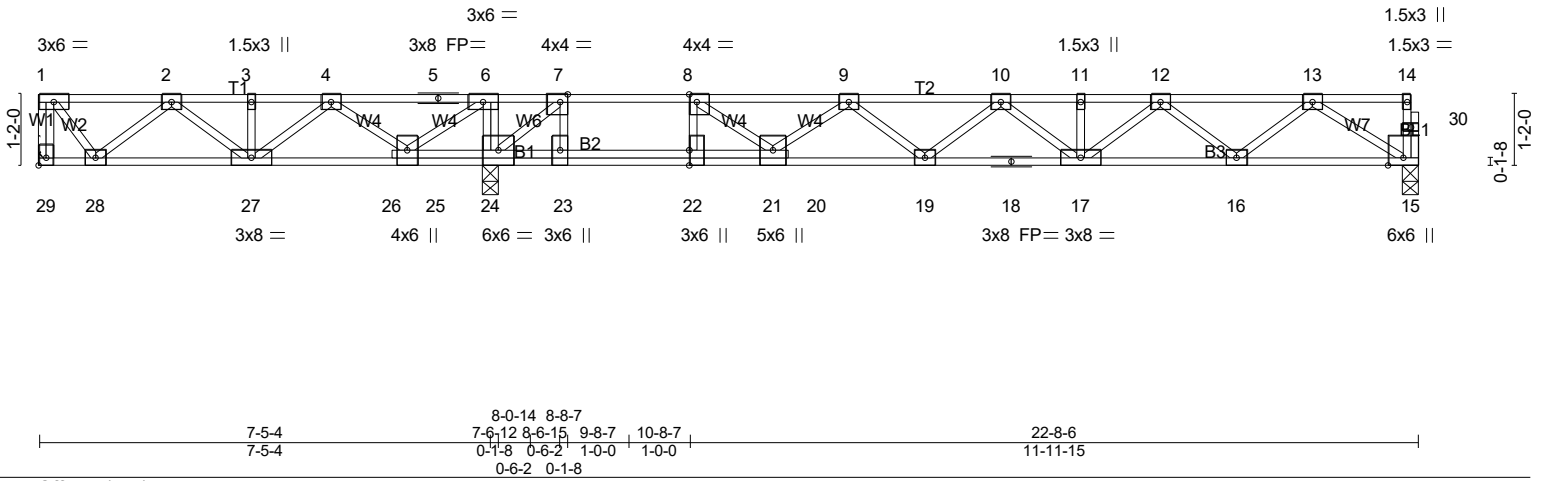


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [22:0-3-0,0-0-0], [29:Edge,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr YES
BCDL 5.0	Code IRC2021/TPI2014
	<b>CSI.</b>
	TC 0.70
	BC 0.81
	WB 0.57
	Matrix-SH
	<b>DEFL.</b> in (loc) l/defl L/d
	Vert(LL) -0.18 21-22 >985 480
	Vert(CT) -0.25 21-22 >719 360
	Horz(CT) 0.02 15 n/a n/a
	<b>PLATES GRIP</b>
	MT20 244/190
	Weight: 125 lb FT = 20%F, 11%E


<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 29=163/Mechanical, 24=1223/0-3-8 (min. 0-1-8), 15=584/0-3-6 (min. 0-1-8)  
 Max Uplift 29=-54(LC 4)  
 Max Grav 29=260(LC 3), 24=1223(LC 1), 15=592(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-29=-261/53, 2-3=-363/300, 3-4=-363/300, 4-5=0/727, 5-6=0/727, 6-7=0/1206,  
 7-8=-409/34, 8-9=-1333/0, 9-10=-1853/0, 10-11=-1868/0, 11-12=-1868/0, 12-13=-1270/0  
 BOT CHORD 27-28=-151/362, 26-27=-483/281, 25-26=-466/275, 24-25=-1206/0, 23-24=-34/409,  
 22-23=-34/409, 21-22=-34/409, 20-21=0/1717, 19-20=0/1762, 18-19=0/1954, 17-18=0/1954,  
 16-17=0/1670, 15-16=0/843  
 WEBS 7-23=0/949, 8-22=-786/0, 6-24=-498/0, 6-25=0/729, 4-25=-580/0, 4-27=0/259,  
 2-28=-275/129, 7-24=-1961/0, 8-21=0/1192, 9-21=-561/0, 12-17=0/253, 12-16=-521/0,  
 13-16=0/555, 13-15=-999/0

- NOTES-** (7-8)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 29.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard

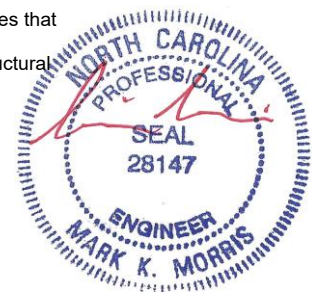

7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F205A	Truss Type Floor	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	# 50696
--------------------	----------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:47 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf-w0?wBmkVFMpMi1APAJC7o7?pBVlkZ6HTkyx2v1ywfiA



Scale = 1:37.2

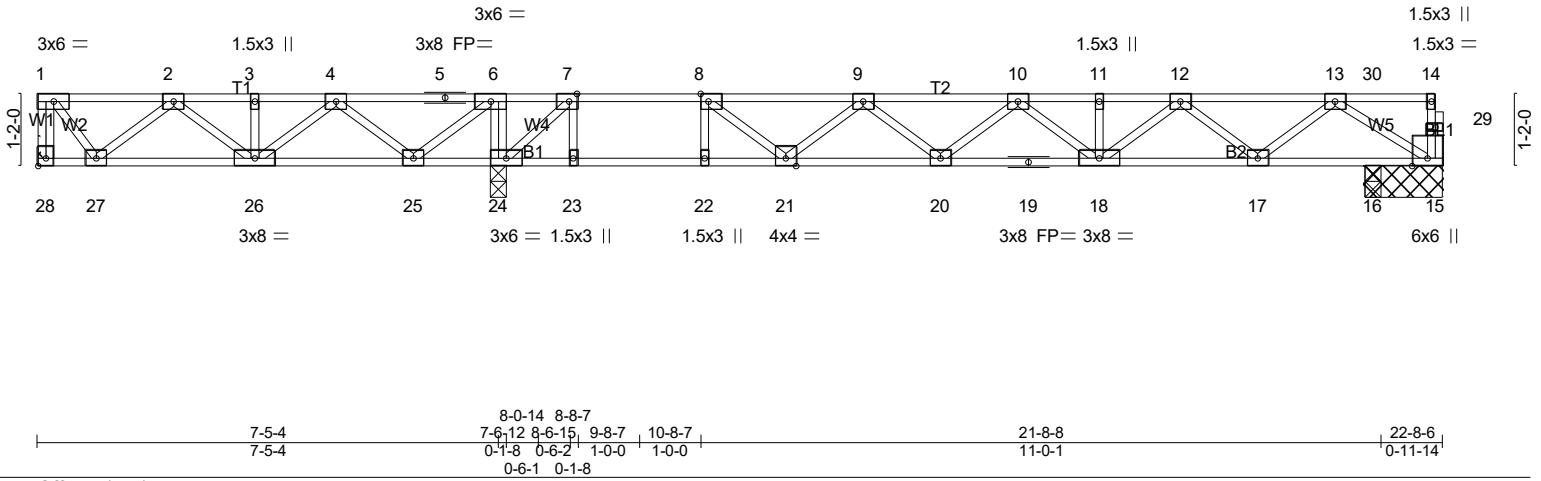


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [28:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.80	Vert(LL) -0.33 21-22 >513 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.98	Vert(CT) -0.45 21-22 >375 360		
BCLL 0.0	Rep Stress Incr YES	WB 0.47	Horz(CT) 0.03 15 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 117 lb FT = 20%F, 11%E


<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP SS(flat) *Except* T1: 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 24-25 2-2-0 oc bracing: 22-23.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** All bearings 0-3-8 except (jt=length) 28=Mechanical, 15=1-3-6.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 16 except 28=300(LC 12), 24=1014(LC 1), 15=475(LC 4)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-28=-301/0, 2-3=-489/0, 3-4=-489/0, 7-8=-1131/0, 8-9=-1888/0, 9-10=-2246/0,  
10-11=-2086/0, 11-12=-2086/0, 12-13=-1244/0  
BOT CHORD 26-27=0/440, 25-26=0/470, 23-24=0/1131, 22-23=0/1131, 21-22=0/1131, 20-21=0/2270,  
19-20=0/2244, 18-19=0/2244, 17-18=0/1761, 16-17=0/829, 15-16=0/829  
WEBS 7-23=0/557, 8-22=-497/0, 6-24=-332/52, 6-25=0/506, 4-25=-368/0, 2-27=-336/0,  
1-27=0/296, 7-24=-1720/0, 8-21=0/992, 9-21=-511/0, 12-18=0/416, 12-17=-681/0,  
13-17=0/549, 13-15=-982/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Refer to girder(s) for truss to truss connections.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.
  - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard

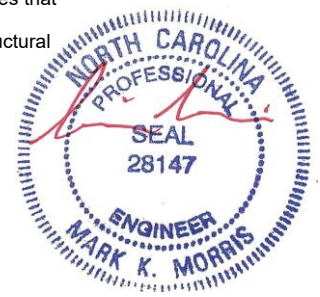

7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F206	Truss Type Floor	Qty 2	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
					# 50696

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:49 2024 Page 1  
ID: gUCksxzC6J7HT2yGkHFINYiOvf-tP7gcSllmz34xKKnHkEbTY5BjZ6128mCGQ9\_wywf8



Scale = 1:36.0

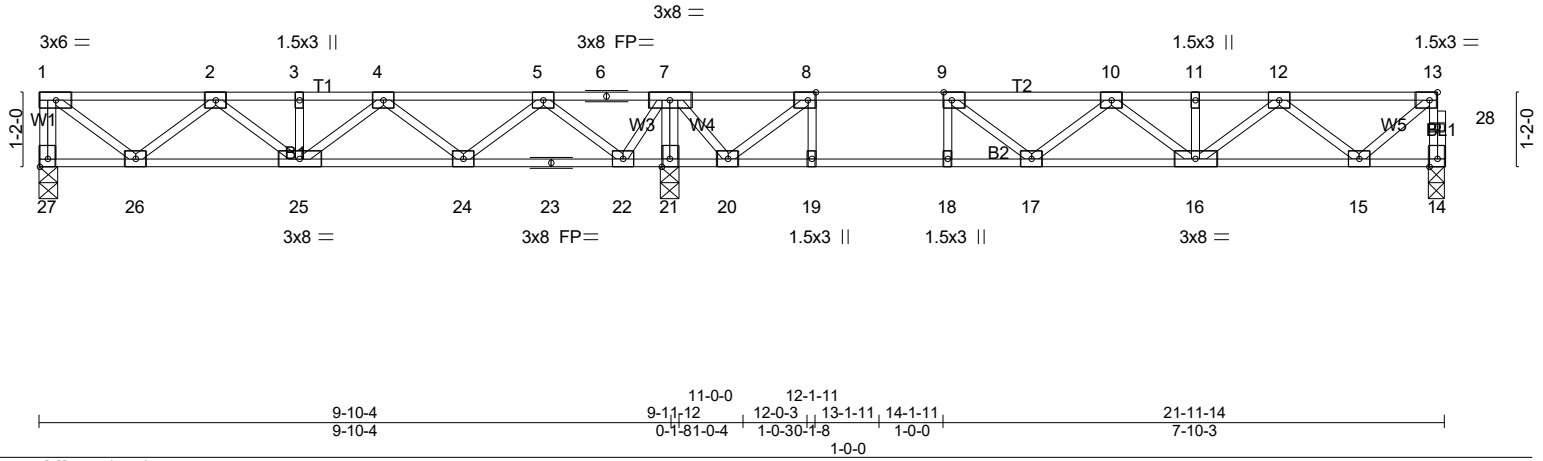


Plate Offsets (X,Y)-- [8:0-1-8,Edge], [9:0-1-8,Edge], [13:0-1-8,Edge], [27:Edge,0-1-8]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	1-7-3	<b>CSI.</b>	<b>DEFL.</b>	in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.67	Vert(LL) -0.19 17-18	>771 480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.98	Vert(CT) -0.25 17-18	>568 360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.32	Horz(CT) 0.03 14	n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH				
						Weight: 114 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 27=415/0-3-8 (min. 0-1-8), 14=513/0-3-6 (min. 0-1-8), 21=979/0-3-8 (min. 0-1-8)  
Max Grav 27=427(LC 8), 14=532(LC 4), 21=979(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**TOP CHORD** 1-27=-423/0, 14-28=-531/0, 13-28=-530/0, 1-2=-445/0, 2-3=-957/0, 3-4=-957/0, 4-5=-862/0, 7-8=-479/125, 8-9=-1267/0, 9-10=-1531/0, 10-11=-1326/0, 11-12=-1326/0, 12-13=-535/0  
**BOT CHORD** 25-26=0/829, 24-25=0/1014, 23-24=0/683, 22-23=0/683, 21-22=-347/110, 20-21=-344/112, 19-20=0/1267, 18-19=0/1267, 17-18=0/1267, 16-17=0/1596, 15-16=0/1049  
**WEBS** 8-19=0/333, 9-18=-287/0, 7-21=-858/0, 1-26=0/558, 2-26=-500/0, 4-24=-268/0, 5-24=0/301, 5-22=-601/0, 7-22=0/459, 8-20=-1059/0, 7-20=0/569, 9-17=0/410, 10-16=-346/0, 12-16=0/353, 12-15=-670/0, 13-15=0/675

- NOTES-** (5-6)
- Unbalanced floor live loads have been considered for this design.
  - All plates are 3x4 MT20 unless otherwise indicated.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F208	Truss Type Floor	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	# 50696
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:49 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYiOvf-tP7gcSllmz34xKKnHkEbtY5lJ9L13zmCGQ9\_wywf8

1-3-0

0-7-8

Scale: 3/4"=1'

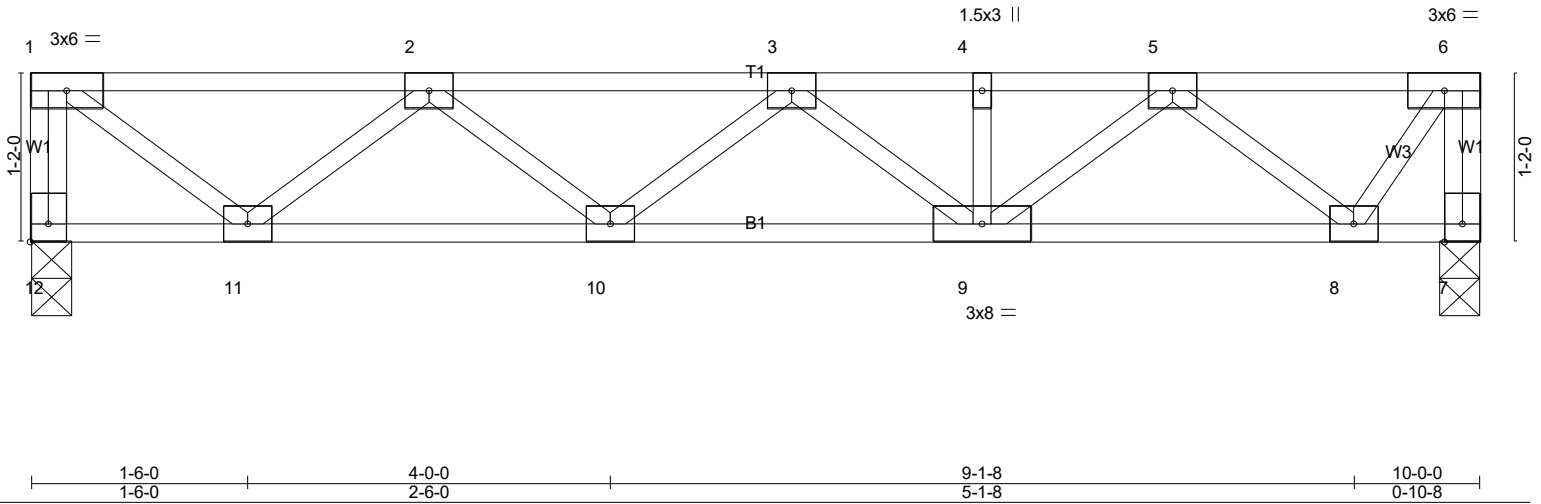


Plate Offsets (X,Y)-- [12:Edge,0-1-8]

<b>LOADING</b> (psf)	<b>SPACING-</b>	1-7-3	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.22	Vert(LL)	-0.02	9-10	>999	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.20	Vert(CT)	-0.03	9-10	>999	360		
BCLL 0.0	Rep Stress Incr	YES	WB 0.27	Horz(CT)	0.01	7	n/a	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						Weight: 54 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 12=429/0-3-8 (min. 0-1-8), 7=429/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-12=-424/0, 6-7=-429/0, 1-2=-450/0, 2-3=-941/0, 3-4=-902/0, 4-5=-902/0, 5-6=-261/0  
BOT CHORD 10-11=0/839, 9-10=0/1019, 8-9=0/677  
WEBS 1-11=0/564, 2-11=-507/0, 5-9=0/287, 5-8=-541/0, 6-8=0/447

- NOTES-** (3-4)
- All plates are 3x4 MT20 unless otherwise indicated.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard




7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F209	Floor	5	1	# 50696

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:50 2024 Page 1  
 ID: gUCksxzC6J7HT2yGkHFINYiOvf-Lbh2pnmNXHBxZUu\_rSmqQldMuiK3mUlwRwAiWMywfi7



Scale = 1:29.7


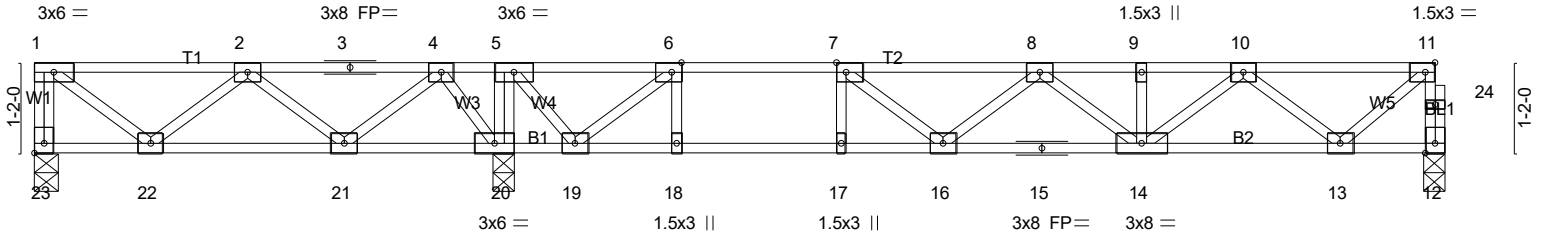


Plate Offsets (X,Y)-- [6:0-1-8,Edge], [7:0-1-8,Edge], [11:0-1-8,Edge], [23:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.64	Vert(LL)	-0.18	16-17	>809	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.94	Vert(CT)	-0.24	16-17	>595		
BCLL 0.0	Lumber DOL 1.00	WB 0.33	Horz(CT)	0.02	12	n/a		
BCLD 5.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2021/TPI2014						Weight: 95 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
 6-0-0 oc bracing: 19-20  
 2-2-0 oc bracing: 17-18.

**REACTIONS.** (lb/size) 23=282/0-3-8 (min. 0-1-8), 12=533/0-3-6 (min. 0-1-8), 20=758/0-3-8 (min. 0-1-8)  
 Max Grav 23=305(LC 8), 12=539(LC 4), 20=758(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-23=-301/0, 12-24=-538/0, 11-24=-537/0, 1-2=-287/0, 2-3=-480/0, 3-4=-480/0, 5-6=-552/0, 6-7=-1325/0,  
 7-8=-1573/0, 8-9=-1351/0, 9-10=-1351/0, 10-11=-543/0  
 BOT CHORD 21-22=0/525, 20-21=0/421, 18-19=0/1325, 17-18=0/1325, 16-17=0/1325, 15-16=0/1629, 14-15=0/1629, 13-14=0/1066  
 WEBS 6-18=0/301, 7-17=-259/0, 5-20=-436/0, 1-22=0/360, 2-22=-310/0, 4-20=-337/0, 6-19=-1004/0, 5-19=0/574, 7-16=0/345,  
 8-14=-355/0, 10-14=0/364, 10-13=-681/0, 11-13=0/686

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 4) CAUTION, Do not erect truss backwards.
  - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F210	Floor Supported Gable	1	1	Job Reference (optional) # 50696

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:52 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYyiOvf-H\_ppEToe3uRfpo2MzsoIVajsWWE5ETODuDfpaEywrf5

0-1-8

Scale = 1:19.4

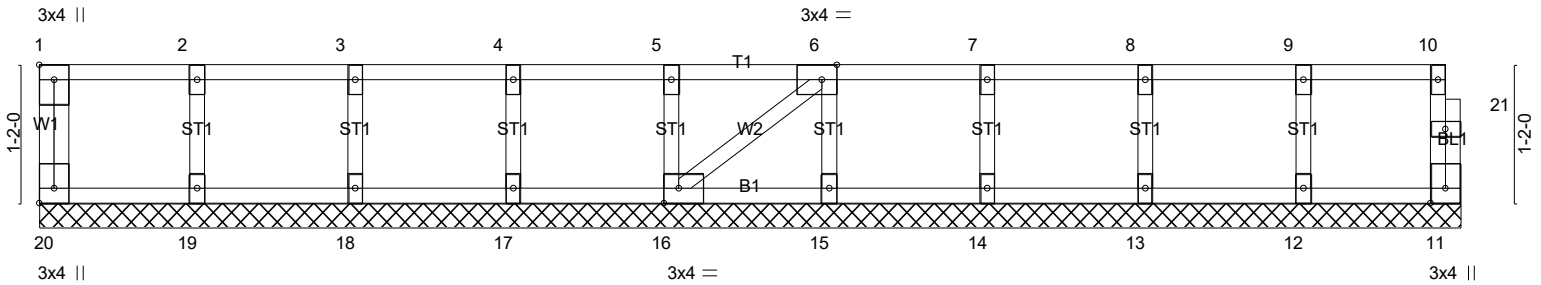


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [6:0-1-8,Edge], [16:0-1-8,Edge], [20:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 11 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			
				Weight: 54 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 11-11-14.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 20, 11, 19, 18, 17, 16, 15, 14, 13, 12

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION. Do not erect truss backwards.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F211	Truss Type FLOOR GIRDER	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	Job Reference (optional) <b># 50696</b>
--------------------	---------------	----------------------------	----------	----------	--	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:52 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf-H\_ppEToe3uRfpo2MzsoIVAjhVWBKEOHduDfpaEywfi5

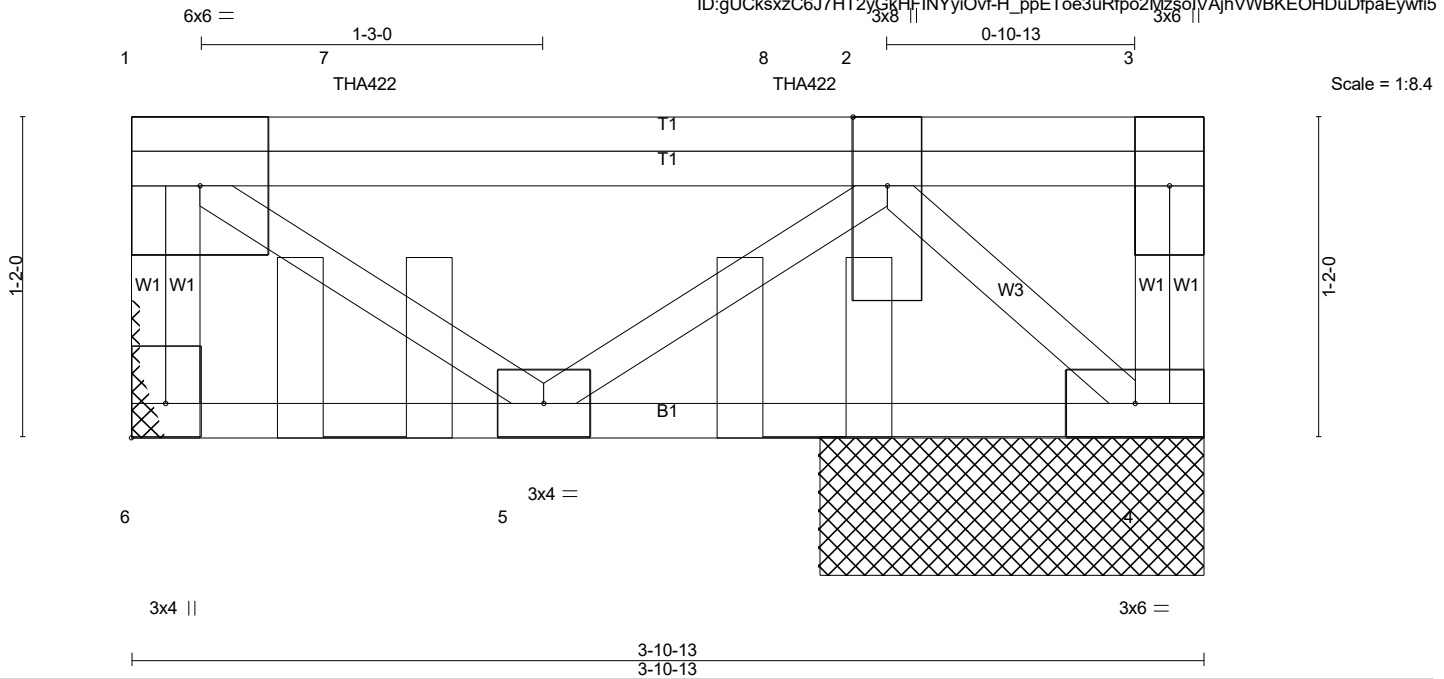


Plate Offsets (X,Y)-- [6:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	1-7-3 Plate Grip DOL 1.00	TC 0.77	Vert(LL) -0.00	5	>999	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.25	Vert(CT) -0.01	4-5	>999	360			
BCLL 0.0	Rep Stress Incr NO	WB 0.36	Horz(CT) 0.00	4	n/a	n/a			
BCDL 5.0	Code IRC2021/TPI2014	Matrix-P							
								Weight: 28 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-10-13 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 6=1059/Mechanical, 4=803/1-4-13 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-6=-1053/0, 3-4=0/283, 1-7=-599/0, 7-8=-599/0, 2-8=-599/0  
BOT CHORD 4-5=0/1127  
WEBS 1-5=0/735, 2-5=-671/0, 2-4=-1558/0

- NOTES-** (6-7)
- 1) Refer to girder(s) for truss to truss connections.
  - 2) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 3) Use Simpson Strong-Tie THA422 (6-16d Girder, 6-10d Truss) or equivalent spaced at 1-7-3 oc max. starting at 0-10-3 from the left end to 2-5-6 to connect truss(es) F216 (1 ply 2x4 SP) to back face of top chord.
  - 4) Fill all nail holes where hanger is in contact with lumber.
  - 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
  - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard  
1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00  
Uniform Loads (plf)  
Vert: 4-6=-8, 1-3=-80  
Concentrated Loads (lb)  
Vert: 7=-772(B) 8=-769(B)



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F212	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 50696</b>
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:53 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf-IAMBSpoGqCZWQydZWaJX2OF1lwaKzwm71ON7hywfi4

0-1-8  
H

Scale = 1:38.1

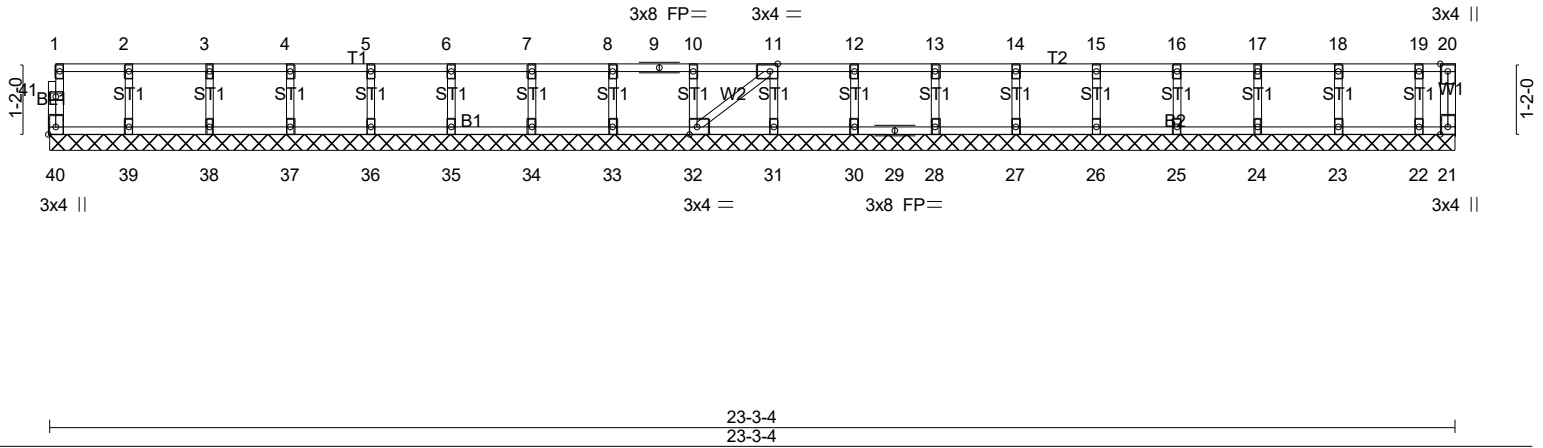


Plate Offsets (X,Y)-- [11:0-1-8,Edge], [32:0-1-8,Edge], [40:Edge,0-1-8]

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	21	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 100 lb	FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)  
OTHERS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 23-3-4.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 40, 21, 39, 38, 37, 36, 35, 34, 33, 32, 31, 30, 28, 27, 26, 25, 24, 23, 22

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (7-8)
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
  - 2) Gable requires continuous bottom chord bearing.
  - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 4) Gable studs spaced at 1-4-0 oc.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F213	Truss Type FLOOR	Qty 3	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 50696</b>
--------------------	---------------	---------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:55 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf-hZUxsVqWMppEgFnxe?L07pLJMj65RehfaBtTBZywf12

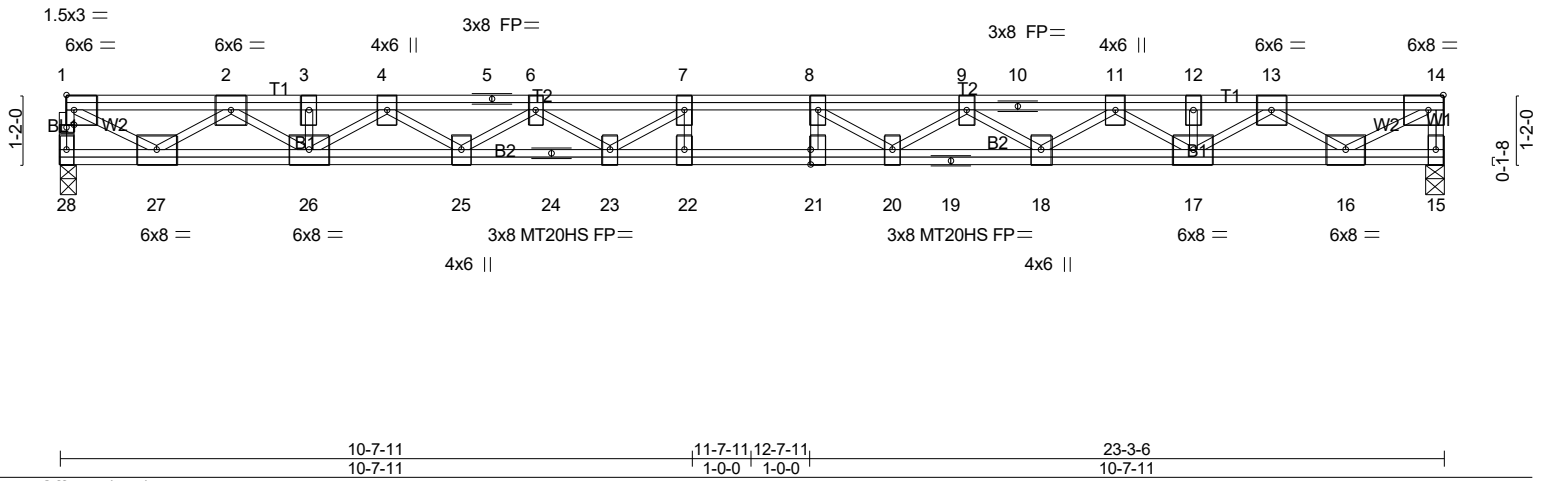



Plate Offsets (X,Y)-- [1:0-1-8,0-0-8], [14:0-3-0,Edge], [21:0-3-0,0-0]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.21	Vert(LL) -0.42 21-22 >653 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.63	Vert(CT) -0.58 21-22 >475 360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr YES	WB 0.83	Horz(CT) 0.07 15 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 180 lb FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 28=1013/0-3-6 (min. 0-1-8), 15=1013/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-28=-996/0, 14-15=-997/0, 1-2=-1501/0, 2-3=-3651/0, 3-4=-3651/0, 4-5=-5118/0, 5-6=-5118/0, 6-7=-5975/0, 7-8=-6248/0, 8-9=-5975/0, 9-10=-5118/0, 10-11=-5118/0, 11-12=-3651/0, 12-13=-3651/0, 13-14=-1485/0  
BOT CHORD 26-27=0/2697, 25-26=0/4521, 24-25=0/5691, 23-24=0/5691, 22-23=0/6248, 21-22=0/6248, 20-21=0/6248, 19-20=0/5691, 18-19=0/5691, 17-18=0/4521, 16-17=0/2697  
WEBS 7-23=-678/135, 6-23=0/527, 6-25=-711/0, 4-25=0/740, 4-26=-1061/0, 2-26=0/1163, 2-27=-1485/0, 1-27=0/1743, 8-20=-678/135, 9-20=0/527, 9-18=-711/0, 11-18=0/740, 11-17=-1061/0, 13-17=0/1163, 13-16=-1503/0, 14-16=0/1735

- NOTES-** (6-7)
- Unbalanced floor live loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - All plates are 3x6 MT20 unless otherwise indicated.
  - Required 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F214	Truss Type FLOOR	Qty 8	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	# 50696
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:56 2024 Page 1  
ID: gUCksxzC6J7HT2yGkHFYiOvf-AI2J4r877x4HPM7CisFg0tMW7VtA63oprd1j0ywf1

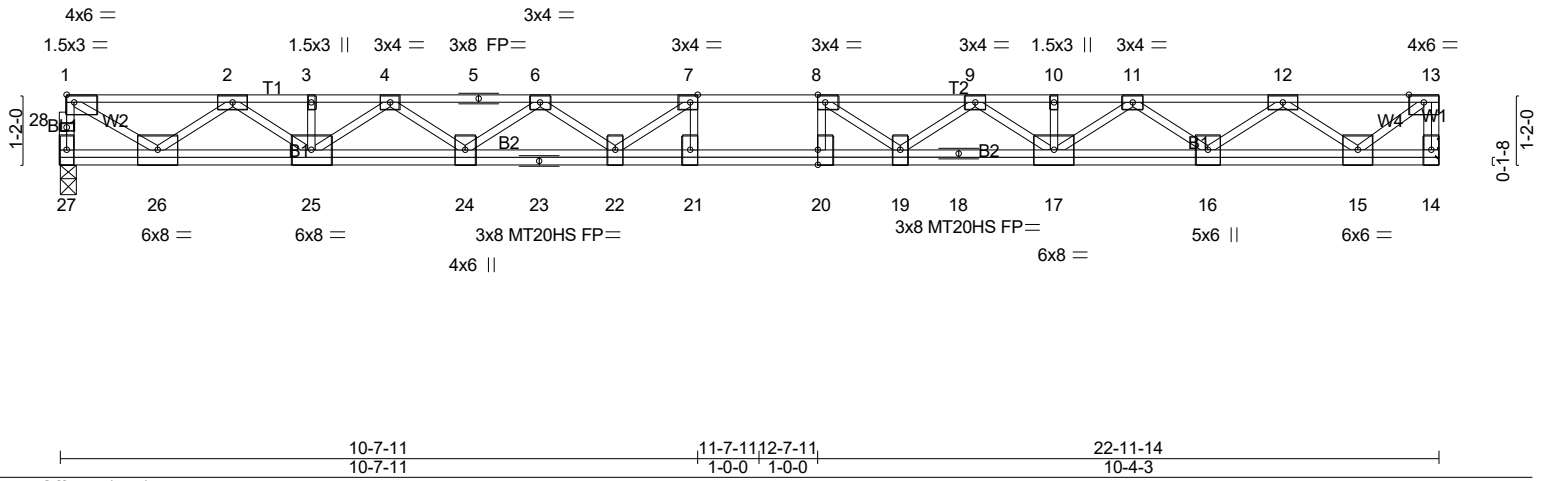



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [8:0-1-8,Edge], [20:0-3-0,0-0-0]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.76	Vert(LL) -0.50 20-21 >548 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.40	Vert(CT) -0.68 20-21 >399 360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr YES	WB 0.76	Horz(CT) 0.05 14 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 147 lb FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP SS(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-5-11 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 27=995/0-3-6 (min. 0-1-8), 14=1000/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 27-28=-978/0, 1-28=-977/0, 13-14=-984/0, 1-2=-1379/0, 2-3=-3366/0, 3-4=-3366/0, 4-5=-4723/0, 5-6=-4723/0, 6-7=-5476/0, 7-8=-5728/0, 8-9=-5411/0, 9-10=-4584/0, 10-11=-4584/0, 11-12=-3122/0, 12-13=-1131/0  
BOT CHORD 25-26=0/2500, 24-25=0/4178, 23-24=0/5235, 22-23=0/5235, 21-22=0/5728, 20-21=0/5728, 19-20=0/5728, 18-19=0/5131, 17-18=0/5131, 16-17=0/3948, 15-16=0/2272  
WEBS 7-21=-259/279, 8-20=-234/305, 7-22=-675/158, 6-22=0/437, 6-24=-651/0, 4-24=0/691, 4-25=-1013/0, 2-25=0/1081, 2-26=-1423/0, 1-26=0/1588, 8-19=-727/102, 9-19=0/468, 9-17=-682/0, 11-17=0/794, 11-16=-1049/0, 12-16=0/1079, 12-15=-1450/0, 13-15=0/1448

- NOTES-** (7-8)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 3x6 MT20 unless otherwise indicated.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Required 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F215	Truss Type FLOOR GIRDER	Qty 1	Ply 2	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	# 50696
--------------------	---------------	----------------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:57 2024 Page 1  
ID: gUCksxzC6J7HT2yGkHFINYyiOvf-eyciHBrmuR3xvZxKIQOUCEQZWXmYvbyh2VMaGSywf0

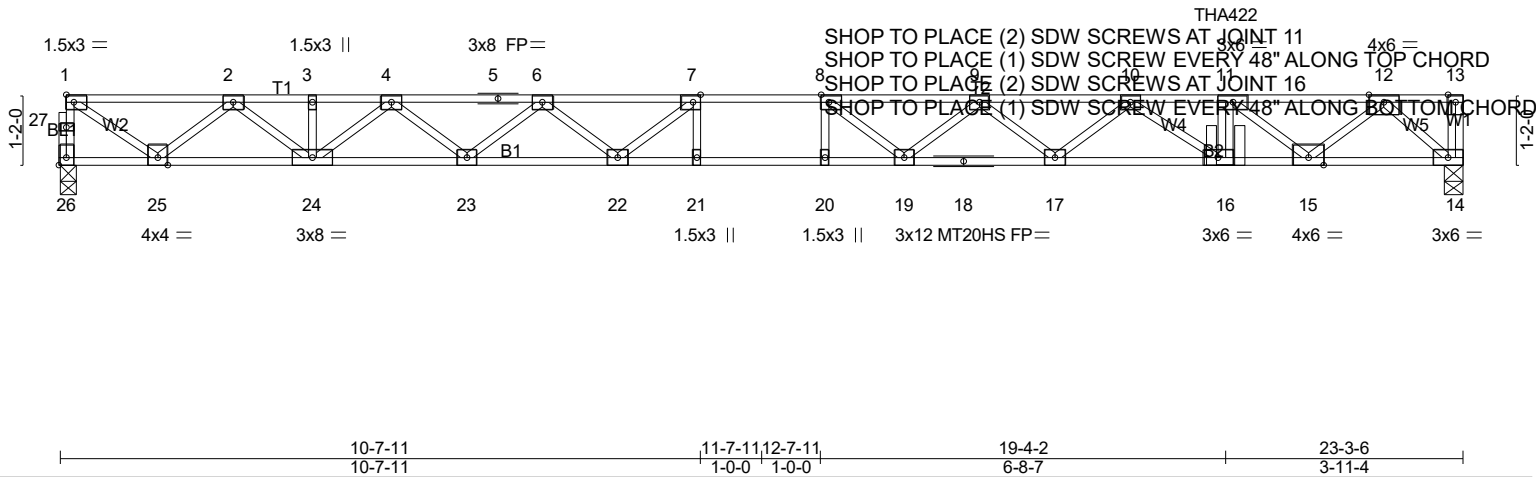



Plate Offsets (X,Y)-- [7:0-1-8,Edge], [8:0-1-8,Edge], [26:Edge,0-1-8]					
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL 1.00	TC 0.62	Vert(LL) -0.45 20 >614 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.76	Vert(CT) -0.62 19-20 >444 360	MT20HS	187/143
BCLL 0.0	Rep Stress Incr NO	WB 0.60	Horz(CT) 0.08 14 n/a n/a		
BCDL 5.0	Code IRC2021/TPI2014	Matrix-SH			Weight: 236 lb FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 26=1173/0-3-6 (min. 0-1-8), 14=1843/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 26-27=-1167/0, 1-27=-1165/0, 1-2=-1569/0, 2-3=-3885/0, 3-4=-3885/0, 4-5=-5599/0, 5-6=-5599/0, 6-7=-6755/0, 7-8=-7372/0, 8-9=-7494/0, 9-10=-7137/0, 10-11=-6133/0, 11-12=-4018/0

BOT CHORD 24-25=0/2839, 23-24=0/4880, 22-23=0/6279, 21-22=0/7372, 20-21=0/7372, 19-20=0/7372, 18-19=0/7471, 17-18=0/7471, 16-17=0/6785, 15-16=0/6133, 14-15=0/2068

WEBS 11-16=0/438, 7-21=0/406, 8-20=-378/2, 7-22=-1118/0, 6-22=0/778, 6-23=-885/0, 4-23=0/936, 4-24=-1270/0, 2-24=0/1335, 2-25=-1652/0, 1-25=0/1845, 8-19=-150/601, 9-17=-434/0, 10-17=0/458, 10-16=-782/0, 11-15=-2654/0, 12-15=0/2537, 12-14=-2751/0

- NOTES-** (10-11)
- 1) Fasten trusses together to act as a single unit as per standard industry detail, or loads are to be evenly applied to all plies.
  - 2) Unbalanced floor live loads have been considered for this design.
  - 3) All plates are MT20 plates unless otherwise indicated.
  - 4) All plates are 3x4 MT20 unless otherwise indicated.
  - 5) Required 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Use Simpson Strong-Tie THA422 (Single Chord Girder) or equivalent at 19-4-2 from the left end to connect truss(es) F211 (1 ply 2x4 SP) to back face of top chord.
  - 8) Fill all nail holes where hanger is in contact with lumber.
  - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
  - 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard

1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
Uniform Loads (plf)
Vert: 14-26=-8, 1-13=-80
Concentrated Loads (lb)
Vert: 11=-996(B)




7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F216	Truss Type Floor	Qty 2	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC	# 50696
--------------------	---------------	---------------------	----------	----------	--	---------

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:51:59 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf-aKkSist1Q2Jf8t5itrQyHfVrzLPMNXsEVpshKLywfi\_

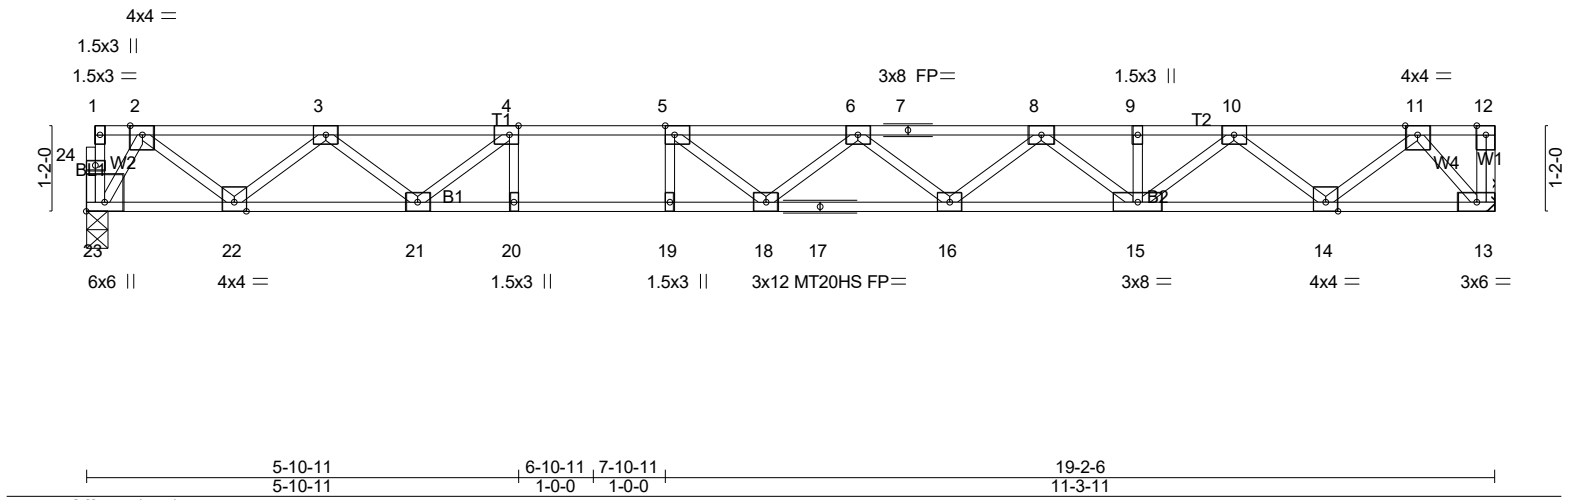

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	1-7-3	TC 0.88	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.93	Vert(LL) -0.40 18-19 >575 480	MT20HS	187/143
BCLL 0.0	Lumber DOL 1.00	WB 0.50	Vert(CT) -0.54 18-19 >418 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.06 13 n/a n/a		
	Code IRC2021/TPI2014			Weight: 97 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 19-20.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 23=828/0-3-6 (min. 0-1-8), 13=833/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1336/0, 3-4=-2669/0, 4-5=-3450/0, 5-6=-3738/0, 6-7=-3556/0, 7-8=-3556/0, 8-9=-2838/0, 9-10=-2838/0, 10-11=-1514/0

BOT CHORD 22-23=0/534, 21-22=0/2092, 20-21=0/3450, 19-20=0/3450, 18-19=0/3450, 17-18=0/3812, 16-17=0/3812, 15-16=0/3296, 14-15=0/2268, 13-14=0/736

WEBS 4-20=0/378, 5-19=-352/0, 4-21=-1051/0, 3-21=0/751, 3-22=-984/0, 2-22=0/1044, 2-23=-1025/0, 5-18=-125/535, 6-16=-333/0, 8-16=0/339, 8-15=-584/0, 10-15=0/728, 10-14=-982/0, 11-14=0/1012, 11-13=-1104/0

- NOTES-** (7-8)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 3x4 MT20 unless otherwise indicated.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) CAUTION, Do not erect truss backwards.
  - 7) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 8) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.



Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F217	Floor	4	1	
					<b># 50696</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:52:00 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYjiOvf-2XHqwCufBMRWm1fvRYxBqs2?ykk36\_zOkTbErmYwfhz

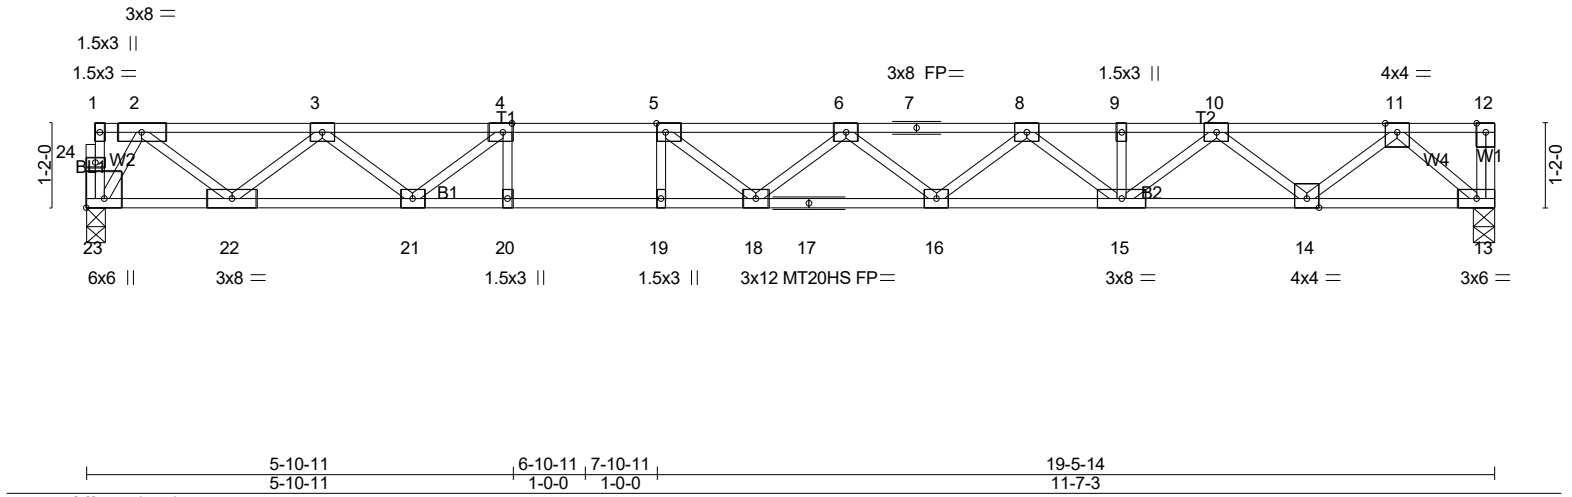


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [5:0-1-8,Edge], [23:Edge,0-3-0]	
<b>LOADING</b> (psf)	<b>SPACING-</b> 1-7-3
TCLL 40.0	Plate Grip DOL 1.00
TCDL 10.0	Lumber DOL 1.00
BCLL 0.0	Rep Stress Incr YES
BCDL 5.0	Code IRC2021/TPI2014
<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d
TC 0.93	Vert(LL) -0.42 18-19 >550 480
BC 0.96	Vert(CT) -0.58 18-19 >400 360
WB 0.51	Horz(CT) 0.07 13 n/a n/a
Matrix-SH	
<b>PLATES</b>	<b>GRIP</b>
MT20	244/190
MT20HS	187/143
Weight: 98 lb FT = 20%F, 11%E	

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP SS(flat) *Except* B2: 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 19-20.
WEBS 2x4 SP No.3(flat)	

**REACTIONS.** (lb/size) 23=841/0-3-6 (min. 0-1-8), 13=846/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1359/0, 3-4=-2723/0, 4-5=-3533/0, 5-6=-3850/0, 6-7=-3699/0, 7-8=-3699/0, 8-9=-3013/0, 9-10=-3013/0, 10-11=-1720/0

BOT CHORD 22-23=0/543, 21-22=0/2129, 20-21=0/3533, 19-20=0/3533, 18-19=0/3533, 17-18=0/3941, 16-17=0/3941, 15-16=0/3453, 14-15=0/2459, 13-14=0/956

WEBS 4-20=0/393, 5-19=-366/0, 4-21=-1085/0, 3-21=0/773, 3-22=-1001/0, 2-22=0/1063, 2-23=-1042/0, 5-18=-111/569, 6-16=-315/0, 8-16=0/320, 8-15=-563/0, 10-15=0/707, 10-14=-962/0, 11-14=0/995, 11-13=-1255/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 3x4 MT20 unless otherwise indicated.
  - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 5) CAUTION, Do not erect truss backwards.
  - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard





7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F218	Floor	13	1	
					<b># 50696</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:52:00 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYjiOvf-2XHqwCufBMRWm1fvRYxBqs29Rkqy60IOkTbEmywfhz

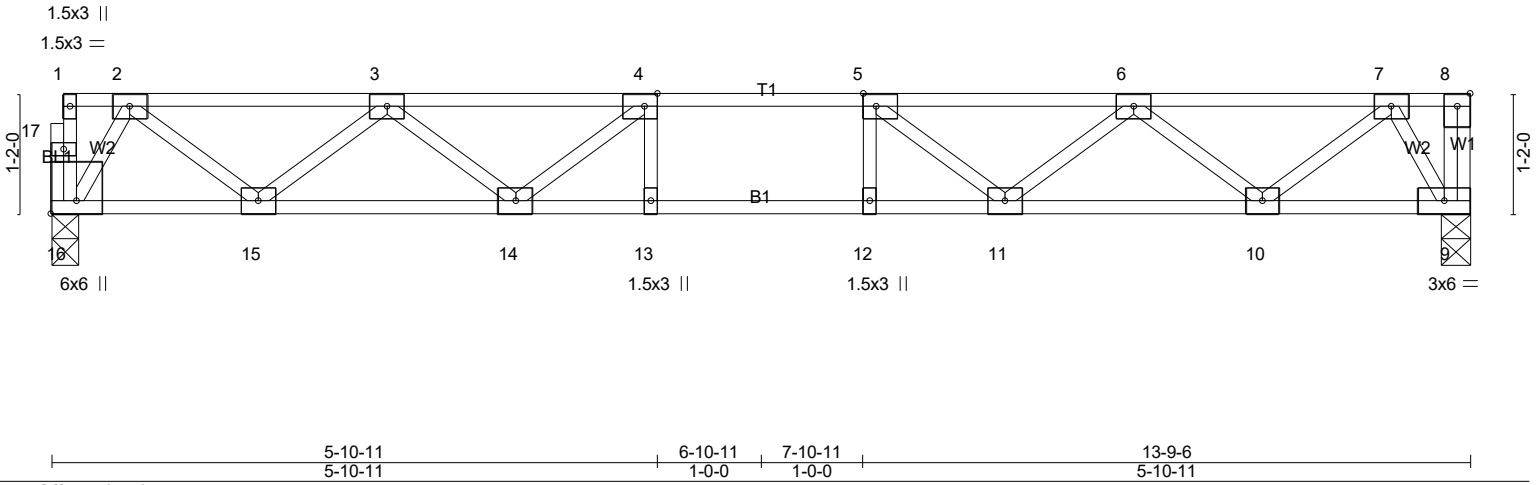

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	1-7-3	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.52	Vert(LL) -0.09 11-12 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.33	Vert(CT) -0.12 11-12 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2021/TPI2014			Weight: 70 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 16=590/0-3-6 (min. 0-1-8), 9=595/0-3-8 (min. 0-1-8)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-906/0, 3-4=-1665/0, 4-5=-1910/0, 5-6=-1665/0, 6-7=-906/0  
 BOT CHORD 15-16=0/376, 14-15=0/1413, 13-14=0/1910, 12-13=0/1910, 11-12=0/1910, 10-11=0/1413, 9-10=0/376  
 WEBS 4-14=-428/0, 3-14=0/355, 3-15=-660/0, 2-15=0/690, 2-16=-720/0, 5-11=-428/0, 6-11=0/355, 6-10=-660/0, 7-10=0/690, 7-9=-717/0

- NOTES-** (5-6)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are 3x4 MT20 unless otherwise indicated.
  - 3) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 4) CAUTION, Do not erect truss backwards.
  - 5) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 6) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 *Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job	Truss	Truss Type	Qty	Ply	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
24-6140-F02	F219	Floor Supported Gable	1	1	
					<b># 50696</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:52:01 2024 Page 1  
 ID:gUCksxzC6J7HT2yGkHFINYiOvf-WjrC7YvHxfZNOAE5\_FSQN4aOF8l5rYeXy7LoODywfhy

0-1-8

Scale = 1:22.4

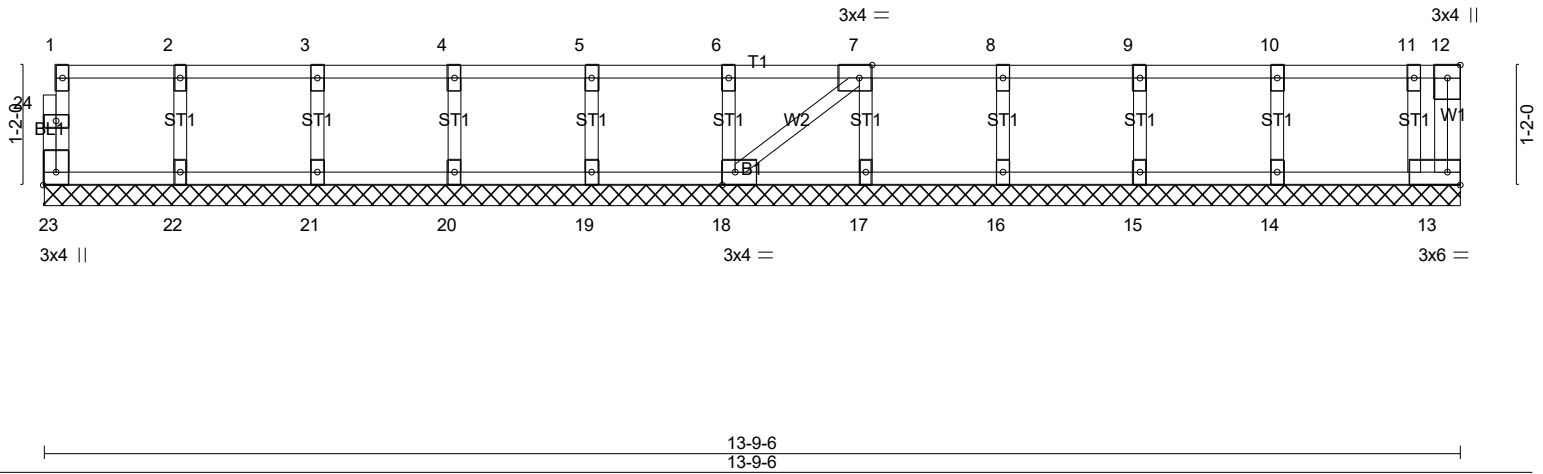


Plate Offsets (X,Y)-- [7:0-1-8,Edge], [18:0-1-8,Edge], [23:Edge,0-1-8]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	13	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 62 lb	FT = 20%F, 11%E

**LUMBER-**  
 TOP CHORD 2x4 SP No.1(flat)  
 BOT CHORD 2x4 SP No.1(flat)  
 WEBS 2x4 SP No.3(flat)  
 OTHERS 2x4 SP No.3(flat)

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 13-9-6.  
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 23, 13, 22, 21, 20, 19, 18, 17, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (7-8)**
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - CAUTION, Do not erect truss backwards.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard





7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F220	Truss Type Floor	Qty 12	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC
					Job Reference (optional) <b># 50696</b>

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:52:02 2024 Page 1  
ID:gUCksxzC6J7HT2yGkHFINYyiOvf\_vPbKuvviziE?KpHYzzfvH7TQYRPaughBn4Lwfywfhx

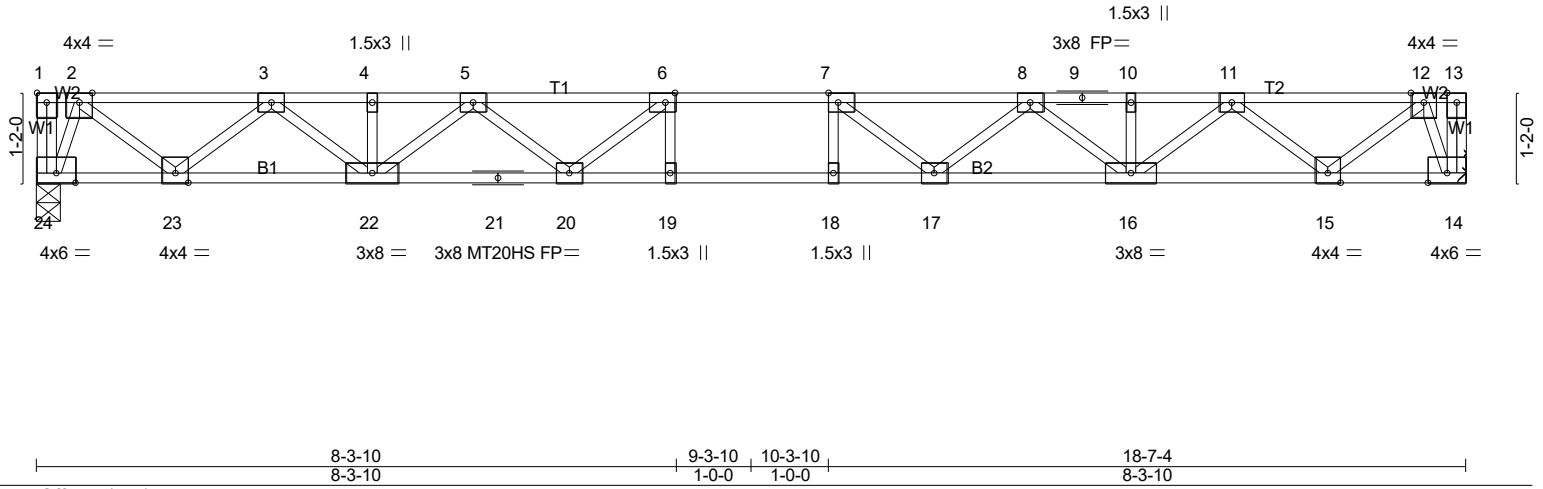

LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.42	Vert(LL)	-0.26	18-19	>832	480	MT20	244/190	
TCDL	10.0	Lumber DOL	1.00	BC	0.84	Vert(CT)	-0.37	18-19	>603	360	MT20HS	187/143	
BCLL	0.0	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.06	14	n/a	n/a			
BCDL	5.0	Code IRC2021/TPI2014		Matrix-SH									Weight: 97 lb FT = 20%F, 11%E

**LUMBER-**  
TOP CHORD 2x4 SP No.1(flat)  
BOT CHORD 2x4 SP No.1(flat)  
WEBS 2x4 SP No.3(flat)

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size) 24=807/0-3-8 (min. 0-1-8), 14=807/Mechanical

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1153/0, 3-4=-2517/0, 4-5=-2517/0, 5-6=-3276/0, 6-7=-3528/0, 7-8=-3276/0, 8-9=-2517/0, 9-10=-2517/0, 10-11=-2517/0, 11-12=-1153/0  
BOT CHORD 23-24=0/357, 22-23=0/1927, 21-22=0/3018, 20-21=0/3018, 19-20=0/3528, 18-19=0/3528, 17-18=0/3528, 16-17=0/3018, 15-16=0/1927, 14-15=0/357  
WEBS 6-20=-540/18, 5-20=0/429, 5-22=-640/0, 3-22=0/753, 3-23=-1007/0, 2-23=0/1036, 2-24=-942/0, 7-17=-540/18, 8-17=0/429, 8-16=-640/0, 11-16=0/753, 11-15=-1007/0, 12-15=0/1036, 12-14=-942/0

- NOTES-** (6-7)
- 1) Unbalanced floor live loads have been considered for this design.
  - 2) All plates are MT20 plates unless otherwise indicated.
  - 3) All plates are 3x4 MT20 unless otherwise indicated.
  - 4) Refer to girder(s) for truss to truss connections.
  - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - 6) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - 7) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Job 24-6140-F02	Truss F221	Truss Type Floor Supported Gable	Qty 1	Ply 1	LOT 0.0012 HONEYCUTT HILLS   257 SHELBY MEADOW LANE ANGIER, NC Job Reference (optional) <b># 50696</b>
--------------------	---------------	-------------------------------------	----------	----------	--

Run: 8.430 s Feb 12 2021 Print: 8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Jul 19 01:52:03 2024 Page 1  
ID: gUCksxzC6J7HT2yGkHFINYiOvf-S5zzYEwXTHq5dUOU6gUuSVgkky\_fJS6qQRqV S6ywfhw

Scale = 1:29.9

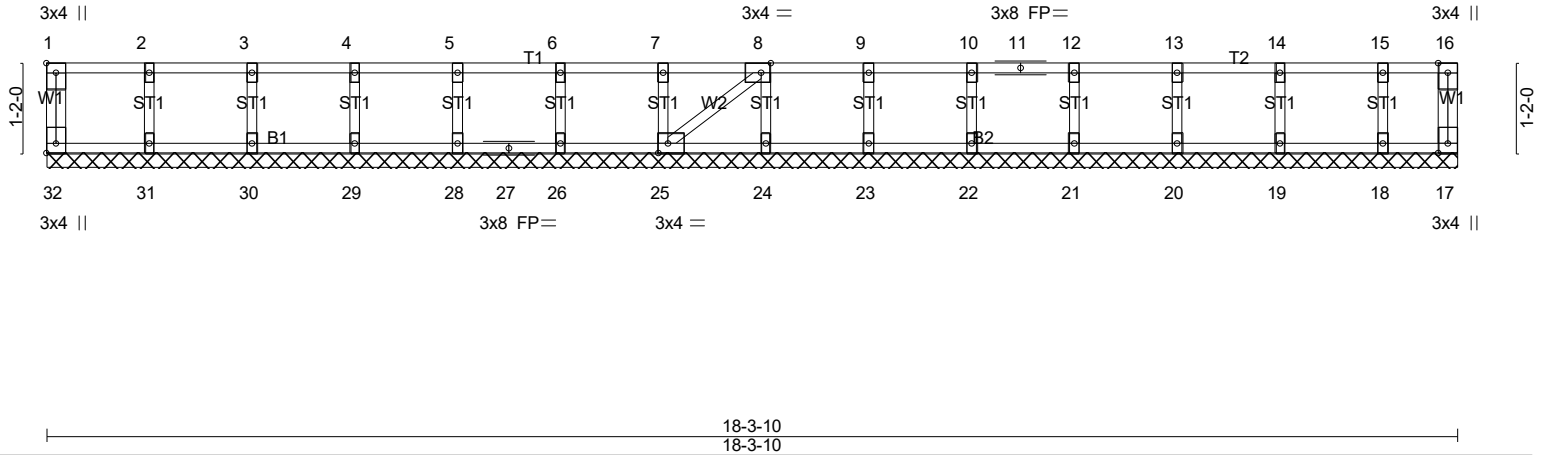


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [8:0-1-8,Edge], [25:0-1-8,Edge], [32:Edge,0-1-8]

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	25	n/a		
BCDL 5.0	Code IRC2021/TPI2014		Matrix-SH						
								Weight: 80 lb	FT = 20%F, 11%E

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	

**REACTIONS.** All bearings 18-3-10.  
(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 17, 31, 30, 29, 28, 26, 25, 24, 23, 22, 21, 20, 19, 18

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (6-7)
- All plates are 1.5x3 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
  - Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
  - Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)** Standard



7/19/2024

**Warning!**—Verify design parameters and read notes before use. This design is based only upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of building designer – not truss designer or truss engineer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to ensure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI 1 *National Design Standard for Metal Plate Connected Wood Truss Construction* and BCSI 1-03 Guide to *Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses* from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.