



ECS Southeast, LLC

6151 Raeford Road, Suite A
Fayetteville, NC 28304
9104013288
9103230539

LETTER OF TRANSMITTAL

October 22, 2024
Precision Custom Homes

Raeford, NC 28376
ATTN: Shaun Gardner


RE: **Magnolia Hills Subdivision - Lot 4**
ECS Job # **33:7095-C**

Permits:
Location: **123 Persimmon Tree Dr.**
Cameron, NC 28326

Field Reports For your use As requested

CC: Precision Custom Homes - Allen Peterson Precision Custom Homes - Lauren Ceruti

ENCL: Field Report # 1 10/21/2024

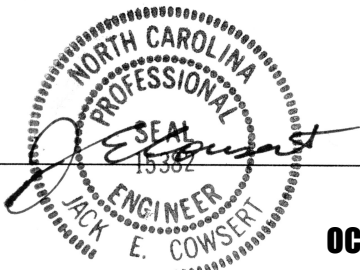

OCT 22 2024

Jack Cowsert, P.E.
Office Manager

Aaron Kyle Adair
CMT Senior Project Coordinator

Disclaimer

1. This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.
2. The information in this report relates only to the activities performed on the report date.
3. Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.
4. Incomplete or non-conforming work will be reported for future resolution.
5. The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLC
6151 Raeford Road, Suite A
Fayetteville, NC 28304
(910) 401-3288 [Phone]
(910) 323-0539 [Fax]

FIELD REPORT

Project **Magnolia Hills Subdivision - Lot 4**
Location **Cameron, NC**
Client **Precision Custom Homes**
Contractor **Precision Custom Homes**

Project No. **33:7095-C**
Report No. **1**
Day & Date **Monday 10/21/2024**
Weather **72 °/ Sunny**
On-Site Time **1.00**
Lab Time **0.00**
Travel Time* **0.00**
Total **1.00**
Re Obs Time **0.00**

Remarks

| | | | | |
|------------------|----------------|----------|-----------------|--------------|
| Trip Charges* | Tolls/Parking* | Mileage* | Time of Arrival | Departure |
| Chargeable Items | | | 12:00P | 1:00P |

* Travel time and mileage will be billed in accordance with the contract.

Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

An ECS representative arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method (ASTM STP-399) for preliminary pad fill. Please see the attached sketch and data sheet for details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity of 2,000 psf.

ECS will return, as requested, for additional services.



Christopher H.A. Johnson
10/21/2024
Magnolia Hills Subdivision
Lot 4
Proj #: 7095-C
W/O # 80517

Key (NTS)
DCP Test Location



NORTH





Report of Spread Footing - Foundation Observations

Project: Magnolia Hills Subdivision - Lot 4
 Location: 123 Persimmon Tree Dr.
 Cameron - Harnett - NC - 28326
 Contractor: Precision Custom Homes

Project No.: 33:7095-C
 Day/Date: 10/21/2024

| Footing Number | Location | Size (W x H x L) | | Footing Bottom Elevation | | Description of Steel Placed | Description of Subgrade Material | Required Blow Counts | Design Bearing Pressure |
|----------------|------------------------------|------------------|--------|--------------------------|------------------------|-----------------------------|---|---|-------------------------|
| | | Design | Actual | Design ** | Depth of Undercut (in) | | | # of Blows / Increment | |
| 1 | proposed south corner of pad | x x | x x | N/A | N/A | | (0)orange clayey sand (-1, -2)black sand (-3,-4) | 6 0)5,5,7 -1)6,8,8 -2)6,7,6 -3)4,4,7 -4)6,8,11 | 2000 |
| 2 | proposed west corner of pad | x x | x x | N/A | N/A | | (0)orange clayey sand (-1, -2)black sand (-3,-4) | 6 0)5,6,7 -1)5,7,10 -2)7,10,8 -3)5,6,9 -4)4,5,6 | 2000 |
| 3 | proposed north corner of pad | x x | x x | N/A | N/A | | (0)orange clayey sand (-1)black sand (-2,-3,-4)tan sand | 6 0)5,4,4 -1)4,7,6 -2)9,11,13 -3)10,11,12 -4)4,4,6 | 2000 |
| 4 | proposed east corner of pad | x x | x x | N/A | N/A | | (0)orange clayey sand (-1)black sand (-2,-3,-4)black/tan sand | 6 0)5,4,3 -1)6,7,10 -2)9,7,8 -3)8,9,8 -4)12,15 | 2000 |

** SGE: Subgrade Elevation to be determined by surveyor.

By: Christopher H Johnson

ECS Southeast, LLC

WO: 80517