NC Registered Firm	m # F-1519							
ECS	ECS Southeast, 6151 Raeford Roa Fayetteville, NC 28 9104013288 9103230539	d, Suite A		LETTER OF TRANSMITTAL				
November 01 Precision Cus				RE: ECS Job #	-	Subdi	vision - Lot 10	
Raeford, NC 2	28376			Permits:				
ATTN: Shaun	Gardner			Location:	Pomogranate Cameron, NC			
	X	Field Reports	<u>X</u>	For your	ruse	<u>X</u>	As requested	
CC: P	recision Custom Hom	es - Allen Peterson		Precisio	on Custom Homes	s - Laur	en Ceruti	
ENCL: Fiel	d Report # 1	10/31/2024						

NOV 01 2024 Jack Cowsert Office Manager

Aaron Kyle Adair CMT Senior Project Coordinator

Disclaimer

^{1.} This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

^{2.} The information in this report relates only to the activities performed on the report date.

^{3.} Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

^{4.} Incomplete or non-conforming work will be reported for future resolution.


^{5.} The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.

ECS	ECS Southeast, LLC 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone]		FIELD F	REPORT			
Project	 (910) 323-0539 [Fax] Magnolia Hills Subdivision - Lot 10 	,			33:7095-B 1 Thursday 10/31/2024 64 °/ Sunny		
Location	Cameron, NC		On-Site Time	1.25			
Client	Precision Custom Homes		Lab Time Travel Time*	0.00 <u>0.00</u>			
Contractor	Precision Custom Homes		Total Re Obs Time	1.25 0.00			
Remarks							
Trip Charges*	Tolls/Parking*	Mileage*	Time of	Arrival	Departure		
Chargeable Ite	ems			9:30A	10:45A		

ECS Representative arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method (ASTM STP-399) for monolithic slab. Please see the attached sketch and data sheet for details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 4 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity of 2,000 psf.

ECS will return, as requested, for additional services.

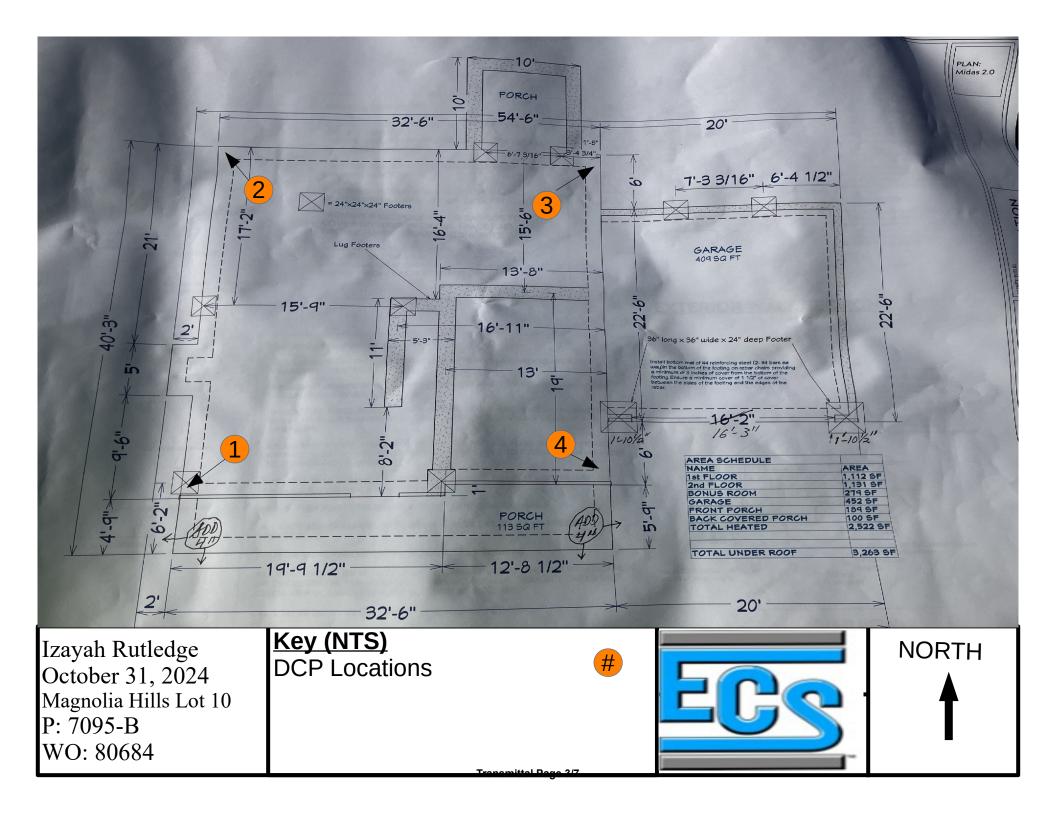



Report of Spread Footing - Foundation Observations

Project: Magnolia Hills Subdivision - Lot 10

Location: Pomogranate Circle

Cameron - Harnett - NC - 28326

Contractor: Precision Custom Homes

Project No.: 33:7095-B

Day/Date: 10/31/2024

		Size (W x H x L)		Footing Bottom Elevation			Decemination of	Required Blow Counts	Decian	
Footing Number	Location	Design	Actual	Design **	Depth of Undercut (in)	Description of Steel Placed	Description of Subgrade Material	# of Blows / Increment	Design Bearing Pressure	
1	Southwest Corner	x x	x x	N/A	N/A		-1:Red Clayey Sand [Offest by 3']> -2:Red Clayey Sand -3, -4:Brown Sand	6 -1:4,3,11 -2:11,11,11 - 3:11,8,7 -4:9,5,6	2000	
2	Northwest Corner	хх	хх	N/A	N/A		-1,-2:Red Clayey Sand -3, -4:Brown Sand	6 -1:6,6,7 -2:7,7,7 -3:5,4,3 -4:4,2,3	2000	
3	Northeast Corner	х х	хх	N/A	N/A		-1:Red Brown Sand -2,- 3:Brown Sand - 4:Tan Sand	6 -1:7,5,6 -2:6,5,5 -3:7,6,5 -4:8,6,6	2000	
4	Southeast Corner	хх	хх	N/A	N/A		-1:Red Gray Sand -2,-3,- 4:Brown Sand	6 -1:9,8,7 -2:8,7,7 -3:7,6,5 -4:8,6,8	2000	

** SGE: Subgrade Elevation to be determined by surveyor.

By: Izayah MoRell Rutledge

ECS Southeast, LLC

WO: 80684

Attachments



2024-Oct-31 (10)

Figure 1



2024-Oct-31 (9)





Transmittal Page 5/7

Attachments



2024-Oct-31 (8)

Figure 3



2024-Oct-31 (7)





Transmittal Page 6/7

Attachments



2024-Oct-31 (6)

Figure 5



2024-Oct-31 (5)

Figure 6



Transmittal Page 7/7