



**North Carolina Onsite Wastewater Contractor Inspector Certification Board
Authorized Onsite Wastewater Evaluator Permit Option for Non-Engineered Systems
Notice of Intent (NOI) to Construct**

New Expansion Repair Relocation Relocation of Repair Area

Owner or Legal Representative Information:
 Name: Mattamy Homes, LLC
 Mailing address: 11000 Regency Parkway, Suite 110 City: Cary State: NC Zip: 27518
 Phone: 919-625-9546 Email: drew.brody@mattamycorp.com

Authorized Onsite Wastewater Evaluator Information:
 Name: Hal Owen Certification #: 10036E
 Mailing address: PO Box 400 City: Lillington State: NC Zip: 27546
 Phone: 910-893-8743 Email: hal@halowensoil.com

Site Location Information:
 Site address: Bering Cir, Angier, NC
 Tax parcel identification number or subdivision lot, block number of property: _____
Lot 17 Ph 1, Riverfall SD PIN 0682-29-4041.000 County: Harnett

System Information:
 Wastewater System Type: IIIbg (Pump to Accepted Status 25% reduction)
 Daily Design Flow: 480 gpd
 Sapro-lite System: Yes No Subsurface Operator Required: Yes No
 Water Supply Type: Private Well Public Water Supply Spring Other: _____

Facility Type:
 Residential 4 # Bedrooms 8 Maximum # of Occupants _____
 Business Type of Business and Basis for Flow: _____
 Public Assembly Type of Public Assembly and Basis for Flow: _____

Required Attachments:
 Plat or Site Plan
 Evaluation of Soil and Site Features by Licensed Soil Scientist

Attest: On this the 24 day of January, 2024 by signature below I hereby attest that the information required to be included with this NOI to Construct is accurate and complete to the best of my knowledge. Furthermore, I hereby attest that I have adhered to the laws and rules governing onsite wastewater systems in the state of North Carolina.
 This NOI shall expire on 24 day of January, 2025.
 Signature of Authorized Onsite Wastewater Evaluator: Hal Owen
 Signature of Owner or Legal Representative: _____

Disclosure: The owner may apply for a building permit for the project upon submitting a complete NOI to Construct and the fee required (if any) to the local health department. An onsite wastewater system authorized by an authorized onsite wastewater evaluator shall be transferable to a new owner with the consent of the authorized onsite wastewater evaluator.

Local Health Department Receipt Acknowledgement:
 Signature of Local Health Department Representative: _____ Date: _____



CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)
12/05/2023

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).


PRODUCER INSURANCE SERVICE CTR -LILLING LILLINGTON BRANCH OFFICE PO Box 1565 LILLINGTON, NC 27546 DANIEL L. BABB		910-893-5707		CONTACT NAME: SHARON WOODY	
				PHONE (A/C, No, Ext): 910-893-5707	
				FAX (A/C, No): 910-893-2077	
				E-MAIL ADDRESS: SWOODY@ISCFAY.COM	
				INSURER(S) AFFORDING COVERAGE	
				INSURER A : STARSTONE NATIONAL	
				INSURER B :	
				INSURER C :	
				INSURER D :	
				INSURER E :	
				INSURER F :	
INSURED HAL OWEN & ASSOCIATES, INC. PO BOX 400 LILLINGTON, NC 27546				NAIC #	

COVERAGES CERTIFICATE NUMBER: REVISION NUMBER:


THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
	COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:						EACH OCCURRENCE \$ DAMAGE TO RENTED PREMISES (Ea occurrence) \$ MED EXP (Any one person) \$ PERSONAL & ADV INJURY \$ GENERAL AGGREGATE \$ PRODUCTS - COMP/OP AGG \$ \$
	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO <input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> HIRED AUTOS ONLY <input type="checkbox"/> NON-OWNED AUTOS ONLY						COMBINED SINGLE LIMIT (Ea accident) \$ BODILY INJURY (Per person) \$ BODILY INJURY (Per accident) \$ PROPERTY DAMAGE (Per accident) \$ \$
	UMBRELLA LIAB <input type="checkbox"/> OCCUR EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE DED RETENTION \$						EACH OCCURRENCE \$ AGGREGATE \$ \$
	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) <input type="checkbox"/> Y/N <input checked="" type="checkbox"/> N/A If yes, describe under DESCRIPTION OF OPERATIONS below						<input type="checkbox"/> PER STATUTE <input type="checkbox"/> OTH-ER E.L. EACH ACCIDENT \$ E.L. DISEASE - EA EMPLOYEE \$ E.L. DISEASE - POLICY LIMIT \$
A	PROFESSIONAL LIAB.			42ESP00143901	01/27/2023	01/27/2024	PER OCC. 1,000,000 AGGREGATE 2,000,000

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

CERTIFICATE HOLDER MATTAMY HOMES, LLC 11000 REGENCY PRKWAY, STE. 110 CARY, NC 27518	CANCELLATION SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS. AUTHORIZED REPRESENTATIVE 
---	--

Site Plan-Lot 17

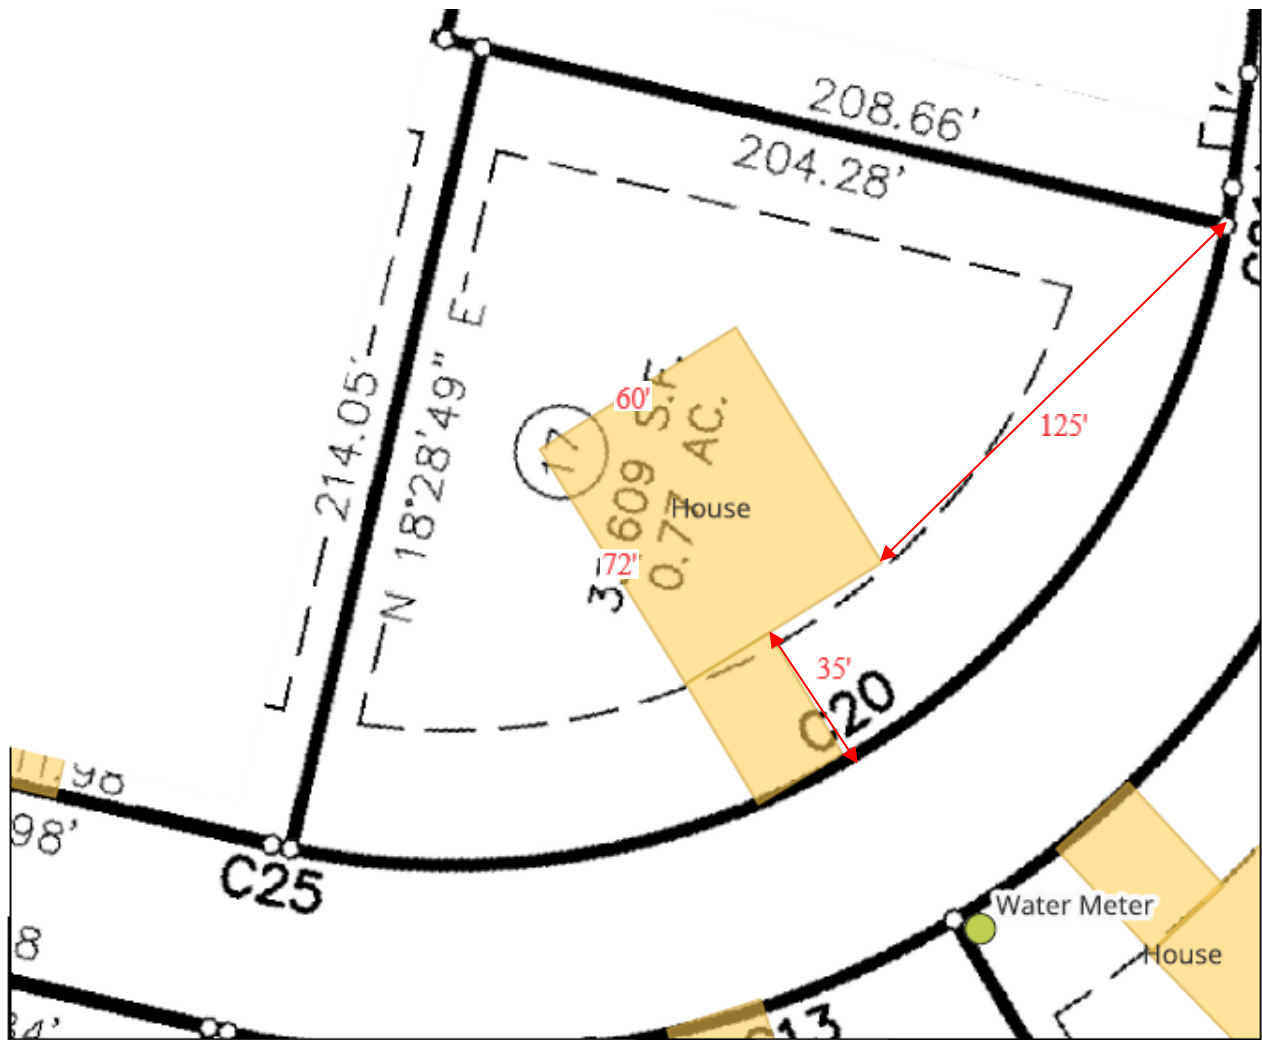

<p>0 50 100 ft</p>		<p>Map for reference only. Not a survey.</p>
<p>Hal Owen & Associates Inc. PO Box 400, Lillington NC 27546 www.halowensoil.com 919-893-8743</p>	<p>Lot 17 Riverfall Subdivision Phase 1</p>	<p>SITE PLAN</p>

HAL OWEN & ASSOCIATES, INC.

SOIL & ENVIRONMENTAL SCIENTISTS

P.O. Box 400, Lillington NC 27546-0400
Phone (910) 893-8743 / Fax (910) 893-3594

www.halowensoil.com

25 January 2024

Mattamy Homes, LLC
11000 Regency Parkway, Suite 110
Cary, NC 27518

Reference: AOWE Evaluation
Bering Cir, Angier, Harnett Co., NC
Lot 17 Ph 1, Riverfall SD
PIN 0682-29-4041.000

Dear Mattamy Homes LLC,

A soil and site evaluation has been conducted for the above referenced property for the purpose of permitting a subsurface sewage waste disposal system. **This LSS Evaluation is being submitted pursuant to and meets the requirements of G.S.130A-336.2.** This evaluation of soil conditions and site features is provided in accordance with G.S. 130A-335(e), the Rules for "Wastewater Treatment and Dispersal Systems-15A NCAC 18E", and local septic regulations (if any). This report represents my professional opinion as a Licensed Soil Scientist and Authorized Onsite Wastewater Evaluator.

This report shall be used to file a Notice of Intent to Construction a wastewater system with the Local Health Department within one year of the date of this evaluation. Failure to file an NOI before then shall result in the AOWE Evaluation to become void.

Sincerely,



A handwritten signature in black ink that reads "Hal Owen".

Hal Owen
Senior Licensed Soil Scientist
Authorized Onsite Wastewater Evaluator

CONTENTS

SPECIAL TERMS AND CONDITIONS..... 3

PROPOSED USE..... 4

WATER SUPPLY 4

EXISTING SITE CONDITIONS..... 4

SOIL AND SITE INVESTIGATION 4

Figure 1 Soil map showing septic suitability..... 5

Soil/Site Evaluation Form for On-Site Wastewater System..... 6

SEPTIC SYSTEM DESIGN..... 8

SEPTIC AREA PREPARATION..... 8

PERMIT CONDITIONS 9

WASTEWATER TREATMENT SYSTEM PLANS..... 10

Septic System Design Specifications..... 11

Figure 2 Septic System Layout..... 12

Initial System Specifications 13

Repair System Specifications 17

SPECIAL TERMS AND CONDITIONS

This evaluation includes a signed and sealed soil and site evaluation, specifications, plans, and reports for the site layout and construction of a proposed onsite wastewater system by an Authorized On-Site Wastewater Evaluator (AOWE) in accordance with G.S. § 130A-336.2. This evaluation was prepared based on information provided by the owner of the proposed system; to include the basis for design flow, proposed structure location(s), and property boundaries. Any false, inaccurate, or incomplete information provided by the owner may result in denial or revocation of applications, approvals, or permits.

This evaluation is not a permit to develop. The owner and subcontractors will need to abide by all state and local rules and regulations pertaining to planning, zoning, and land use development.

Notice of Intent to Construct – The proposed wastewater system is not “permitted” until the owner files an application with the Local Health Department (LHD) and provides a complete Notice of Intent (NOI) to Construct a wastewater system using an AOWE. The owner may apply for a building permit for the project upon submitting a complete NOI and the required fee.

On-Site Wastewater System Contractor – The AOWE shall assist the owner in the selection of an on-site wastewater system contractor who shall be under contractual obligation to the owner and have sufficient errors and omissions, liability, or other insurance for the system constructed.

Inspections, Construction Observations, and Reports – The AOWE shall make periodic visits to the site to observe the progress and quality of the construction. Upon determining that the system is properly installed and capable of being operated in accordance with the conditions of the permit, the AOWE will issue an Authorization to Operate (ATO) and include an inspection report and a written operation and management program. The owner shall provide a complete ATO package and fee to the LHD, who will issue the certificate of occupancy for the facility.

Operation and Management – The owner shall be responsible for continued adherence to the operations and management program established by the AOWE. This permit shall in no way be taken as a guarantee or implied warranty that the septic system will function satisfactorily for any given period of time.

Change in System Ownership. – An authorized wastewater system shall be transferrable to a new owner with the consent of the AOWE. The new owner and the AOWE shall enter a contract for the wastewater system.

Revocation – The AOWE permit is subject to revocation if the site plan, plat, or the intended use changes. This permit is subject to compliance with the provisions of the Laws and Rules for Sewage Treatment and Disposal and to the conditions of this permit.

Repair of Malfunctioning Systems. – The owner may apply for an Improvement Permit and a Construction Authorization from the LHD or obtain a NOI from an AOWE to repair a malfunctioning wastewater system.

PROPOSED USE

A new single-family residence will be built at the site. The home will not have a basement. The proposed single-family residence will contain four bedrooms and have a design wastewater flow of 480 gallons per day. The maximum occupancy of the home is 8 people.

WATER SUPPLY

Public water supplies will be utilized.

EXISTING SITE CONDITIONS


At the time of the investigation, the site had been cleared, lot corners were staked, and the new building footprint was marked. No existing wells, streams, or wetlands were observed within 50 feet of the proposed septic system and repair area.

SOIL AND SITE INVESTIGATION

The soils were evaluated under moist soil conditions through the advancing of auger borings. This evaluation included observations of topography and landscape position, soil morphology (texture, structure, clay mineralogy, organics), soil wetness, soil depth, and restrictive horizons. Descriptions of the soil borings located within the investigated portions of the site are provided in the attached Soil/Site Evaluation form.

Soils in the proposed system area were observed to rate as suitable for subsurface sewage waste disposal systems. (Figure 1). The subsoils were observed to be friable sandy loams to about 44 inches below ground surface, underlain by friable sand clay loams that extended to greater than 48 inches below ground surface. Evidence of a soil wetness condition was observed at 45 inches below surface or deeper. These soils appear adequate to support long-term acceptance rates of 0.7 gal/day/ft² for conventional drainlines.

Figure 1 Soil map showing septic suitability

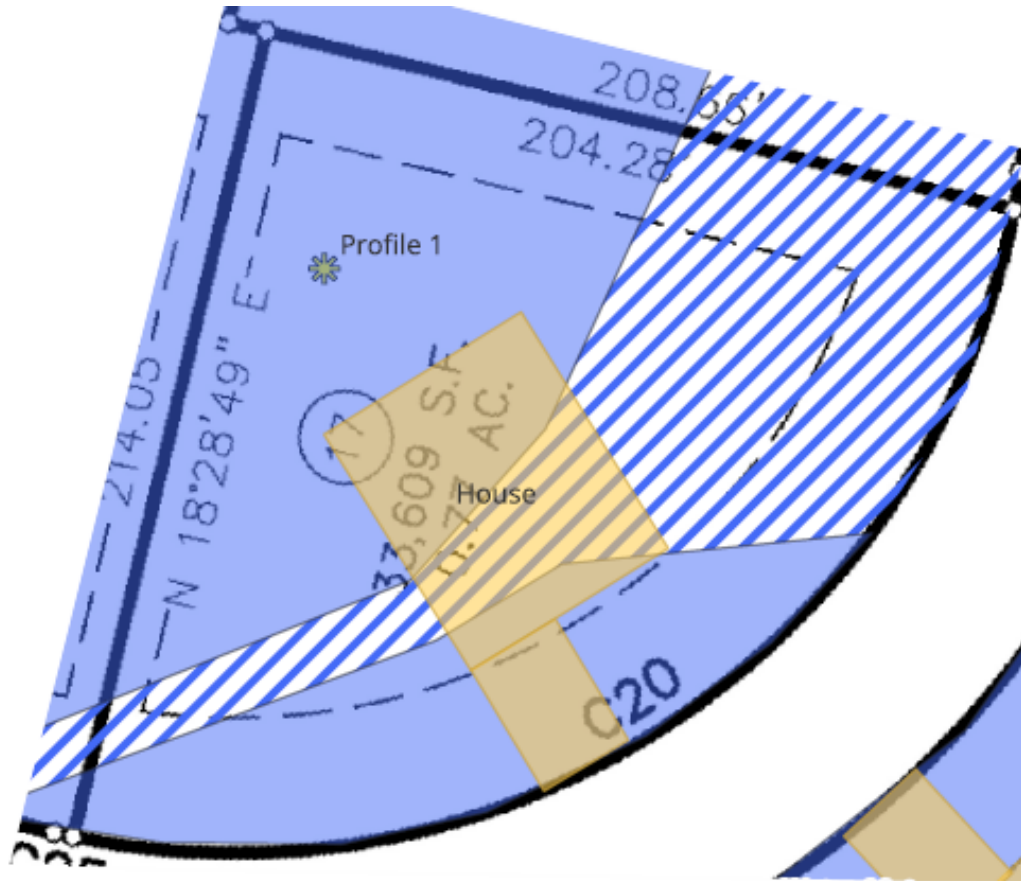

Legend

- House
- soil boring
- ★ Suitable
- Soil Unit
- Suitable
- Suitable for Modified or Alternative



0 50 100 ft

Map for reference only.
Not a survey.

Hal Owen & Associates Inc. PO Box 400, Lillington NC 27546 www.halowensoil.com 919-893-8743	Lot 17 Riverfall Subdivision Phase 1	Figure 1 Soil Map for Septic Suitability
--	--	--

Soil/Site Evaluation Form for On-Site Wastewater System

OWNER NAME: Mattamy Homes, LLC OWNER ADDRESS: 11000 Regency Parkway, Suite 110
 PROPOSED FACILITY: Residential PROPOSED DESIGN FLOW: 480 PROPERTY SIZE: 0.77
 LOCATION OF SITE: Bering Cir, Angier, NC PIN: 0682-29-4041.000
 WASTEWATER TYPE: Domestic COUNTY: Harnett
 WATER SUPPLY: Public Water WATER SUPPLY SETBACK: 10
 EVALUATION METHOD: AUGER BORING PIT CUT
 EVALUATED BY: Hal Owen, LSS 1102 and Steven Boor DATE EVALUATED: 10/24/2023

	INITIAL SYSTEM	REPAIR SYSTEM
AVAILABLE SPACE	514 ft ² trench bottom	514 ft ² trench bottom
SYSTEM TYPE	Accepted (25% reduction) System	Accepted (25% reduction) System
SITE LTAR	0.70 gpd/ft ²	0.70 gpd/ft ²
MAX TRENCH DEPTH	24 inches (measured on downhill side)	24 inches (measured on downhill side)

SITE CLASSIFICATION Suitable OTHER FACTORS _____

COMMENTS _____

PROFILE 1

HORIZON DEPTH	COLOR	CONSISTENCE	TEXTURE	STRUCTURE	MINERALOGY	OTHER PROFILE FACTORS	
0-13	10YR 5/4	VFR	SL	GR	SEXP	LANDSCAPE POSITION	L
13-26	10YR 7/4	VFR	SL	GR	SEXP	SOIL WETNESS DEPTH	45"
26-44	10YR 6/8	FR	SL	SBK	SEXP	SOIL WETNESS COLOR	
44-48	10YR 6/8	FR	SCL	SBK	SEXP	SOIL DEPTH	48"
						SAPROLITE CLASS	NA
						RESTRICTIVE HORIZON	NA
						SLOPE %	4
PROFILE CLASSIFICATION			<u>Suitable</u>	LTAR gpd/ft ²	<u>0.7</u>	SLOPE CORRECTION (IN)	<u>1.4</u>
COMMENT							

LEGEND OF ABBREVIATIONS FOR SITE EVALUATION FORM

<p><u>LANDSCAPE POSITION</u> CC - Concave Slope CV - Convex Slope DS - Debris Slump D - Depression DW - Drainage Way FP - Flood Plain FS - Foot Slope H - Head Slope L - Linear Slope N - Nose Slope R - Ridge S - Shoulder Slope T - Terrace TS - Toe Slope</p>	<p><u>TEXTURE GROUP</u></p>	<p><u>TEXTURE CLASS</u></p>	<p><u>.1955 LTAR (gal/day/sqft)</u></p>
	I	S - Sand LS - Loamy Sand	1.2-0.8
	II	SL - Sandy Loam L - Loam	0.8 – 0.6
	III	SCL - Sandy Clay Loam	0.6 – 0.3
		CL - Clay Loam	
		SiL - Silt Loam	
	IV	Si - Silt	0.4 – 0.1
		SiCL - Silt Clay Loam	
		SC - Sandy Clay	
		C - Clay	
	SiC - Silty Clay		
	O - Organic	none	
<p><u>STRUCTURE</u> G - Single Grain M - Massive CR - Crumb GR - Granular SBK - Subangular Blocky ABK - Angular Blocky PL - Platy PR - Prismatic</p>	<p><u>MOIST CONSISTENCE</u> VFR - Very Friable FR - Friable FI - Firm VFI - Very Firm EFI - Extremely Firm</p>	<p><u>WET CONSISTENCE</u> NS - Non Stick SS - Slightly Sticky MS - Moderately Stick VS - Very Sticky NP - Non Plastic SP - Slightly Plastic MP - Moderately Plastic</p>	
<p><u>MINERALOGY</u> SEXP - Slightly Expansive EXP - Expansive</p>			
<p><u>MOTTLES</u></p>			
f - few	1 - fine	F - Faint	
c - common	2 - medium	D - Distinct	
m - many	3 - coarse	P - Prominent	

Give Horizon Depth in inches below natural soil surface and Fill Depth in inches above land surface.
 Depth to Soil Wetness: inches below land surface to free water or to soil colors with chroma 2 or less.
 Classification: S – Suitable U – Unsuitable

SEPTIC SYSTEM DESIGN

See section *Wastewater Treatment System Plans* and Figure 2 for a diagram of the septic system layout and design specifications.

A 1000 gallon (at minimum) septic tank and an approved septic effluent filter is required. A pump tank (1000 gallon at minimum) is required to lift effluent to the nitrification field. The pump tank may be eliminated if gravity distribution can be demonstrated.

The initial septic system is proposed as a pump driven system to 171 linear feet of Accepted Status drainlines utilizing a 25% reduction in total drainline length (Figure 2). A long-term application rate (LTAR) of 0.7 gal/day/ft² was used to design the nitrification field. A pressure manifold will be used to deliver effluent to three unequal length drainlines. The drainlines shall be installed on contour with maximum trench bottom depths at 24 inches below surface (as measured on low side).

The repair septic system is proposed as a pump driven system to 172 linear feet of Accepted Status drainlines utilizing a 25% reduction in total drainline length (Figure 2). A long-term application rate (LTAR) of 0.7 gal/day/ft² was used to design the nitrification field. A pressure manifold will be used to deliver effluent to two unequal length drainlines. The first drainline is composed of two runs on different contours, connected by a drop-box or over-flow pipe. The drainlines shall be installed on contour with maximum trench bottom depths at 24 inches below surface (as measured on low side).

SEPTIC AREA PREPARATION

It is important that you do not disturb the septic areas during site construction. A staked line or protective fence should be placed around the system areas prior to construction to eliminate any potential damage to the soil or the layout of the system. Septic areas should not be used for staging construction materials or subjected to vehicular traffic. Do not cut, grade, fill, install utilities, or otherwise alter the designated septic areas.

Care should be taken when clearing vegetation from the septic area. Work should only occur when the soil is at the appropriate moisture content to limit the impact to the soil structure in the soil treatment area. Do not scrape the ground inside the drainfield. **Any clearing or preparation of the septic areas shall be done without removal, disturbance, or compaction of the soil.**

PERMIT CONDITIONS

Standard Conditions

The requirements of 15A NCAC 18E are incorporated by reference into this permit and shall be met.

System shall be installed in accordance with the attached *Wastewater Treatment System Plans*.

Any changes to the site plan or intended use must be approved by Hal Owen & Associates. Permit modification and resubmittal to the LHD may be necessary to ensure regulatory compliance.

Conformance to all regulatory setbacks shall be maintained. Local regulations (such as well or riparian buffer ordinances) may require more stringent setbacks.

Minimum soil cover of six inches shall be established over nitrification field. Soil cover above the original grade shall be placed at a uniform depth over the entire nitrification and shall extend laterally five feet beyond the nitrification trench. Site shall be graded to shed water away from field and a vegetative cover established to prevent erosion.

The nitrification field and repair area shall not be subject to vehicular traffic. Vehicular traffic can damage soils, pipes, and valve boxes. Do not use septic areas for parking.

Do not allow underground utilities, water lines, or sprinkler systems to be installed in the septic areas. Damage to the septic areas could result in the septic permit being revoked.

The wastewater system shall not be covered until inspected by Hal Owen & Associates and shall not be placed into use until an Authorization to Operate is issued.

Specific Conditions:

- To ensure a watertight joint, the inlet and outlet of all tanks shall be equipped with an approved pipe penetration boot.
- No foundation drain.
- The septic and pump tanks must be watertight. The installer shall either provide documentation that the tank has been leak tested by the manufacturer or be prepared to run leak testing (hydrostatic or vacuum testing in the ready- to-use-state) at the site.

WASTEWATER TREATMENT SYSTEM PLANS

PROJECT INFORMATION

Wastewater System	New	.0403 Eng Low Flow	No
Wastewater Strength	Domestic		
Effluent Standard	DSE		
Water Supply	Public Water		
Facility Type	Residential		
Design Wastewater Flow	480	gpd	gal/unit 120
Basis for Flow	4	bedrooms	max occupancy 8
Basement	No	Fixtures in basement?	No
Crawl Space	No	Slab Foundation	Yes

PROPERTY INFORMATION

County	Harnett
Site Address	Bering Cir, Angier, NC
S/D Name and Lot#	Lot 17 Ph 1 Riverfall SD
PIN	0682-29-4041.000
County PID	040682 0131 19
Size (Acre)	0.77

APPLICANT INFORMATION

Name	Mattamy Homes, LLC
Mailing Address	11000 Regency Parkway, Suite 110
	Cary, NC 27518
Telephone Number	919-625-9546
E-mail Address	Drew.Brody@mattamycorp.com

CONSULTANT INFORMATION

Company Name	Hal Owen & Associates, Inc.
Mailing Address	PO Box 400, Lillington, NC 27546
Telephone Number	910-893-8743 Fax: 910-893-3594
E-mail Address	hal@halowensoil.com
Licensed Soil Scientist	Hal Owen, LSS #1102 and AOWE# 10036E
System Designer	Jocelyn Proulx

Septic System Design Specifications

Proposed Design Daily Flow	<u>480</u> gpd	Drainfield Meets Requirements:
Septic Tank Size (minimum)	<u>1000</u> gallons	.0508 Available Space <u>Yes</u>
Pump Tank Size (minimum)	<u>1000</u> gallons, if required	.0601 Setbacks <u>Yes</u>

Initial System

*See Detailed Design Parameters

System Type	<u>Illbg –Pump to Other non-conventional systems</u>		
Pump Required	<u>Yes</u>	<u>10.60</u> ft TDH at	<u>24.3</u> GPM
Trenches:	<u>Accepted (25% reduction) System</u>		
Design LTAR	<u>0.70</u> gal/day/ft ²	Saprolite System	<u>No</u>
Total Trench/ Bed Length	<u>171</u> feet	Fill System	<u>No</u>
Trench Spacing	<u>9</u> ft on center		
Usable soil depth to LC	<u>45</u> inches	Soil Cover	<u>6</u> inches
Maximum Trench Depth	<u>24</u> inches, measured on downhill side of trench		
Artificial Drainage Required	<u>No</u>		

Repair System

System Type:	<u>Illbg –Pump to Other non-conventional systems</u>		
Trenches:	<u>Accepted (25% reduction) System</u>		
Design LTAR	<u>0.70</u> gal/day/ft ²	Saprolite System	<u>No</u>
Total Trench/ Bed Length	<u>172</u> feet	Fill System	<u>No</u>
Trench Spacing	<u>9</u> ft on center		
Usable soil depth to LC	<u>45</u> inches		
Maximum Trench Depth of	<u>24</u> inches, measured on downhill side of trench		
Pump Required	<u>Yes</u>		

Potential Drainlines flagged at site on 9-ft centers.

Line #	Color	Relative Elevation (ft)	Drainline Length(ft)	Field Length(ft)
1	Y	108.86	25	25
2	B	108.49	60	61
3	W	108.20	86	95
4	R	107.96	70	108
5	Y	107.62	50	52
6	B	107.30	50	54
Septic Tank:		107.02		
Pump Tank:		107.02		
Reference Elev:		100.00		


Notes:

*No grading or removal of soil in initial or repair areas

*Property lines per owner

*Trench bottoms shall be level to +/- 1/4" in 10ft

*All parts of septic system must meet minimum setbacks

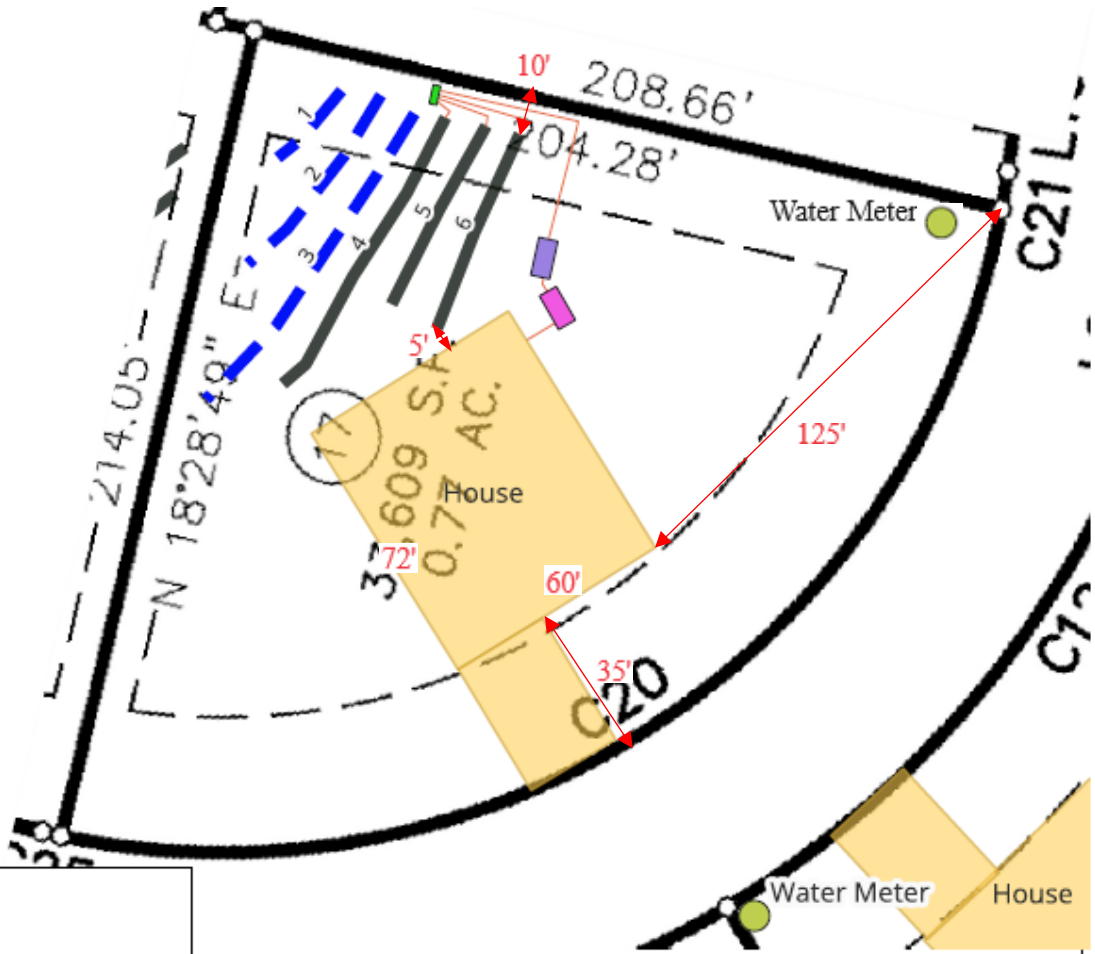


Legend

- Reference Elevation
- House
- drainlines
 - Intial
 - Repair
 - supply/conveyance
- Septic Components
 - PM
 - Pump Tank
 - Septic Tank

Notes:

- *No grading or removal of soil in initial or repair areas
- *Property lines per owner
- *Trench bottoms shall be level to +/- 1/4" in 10ft
- *All parts of septic system must meet minimum setbacks:
 - 10' from property line
 - 5' from foundation (15' from basement)
 - 10' from water line
 - 1ft from sidewalks and driveway



Map for reference only.
Not a survey.

Hal Owen & Associates Inc.
PO Box 400, Lillington NC 27546
www.halowensoil.com
919-893-8743

Lot 17
Riverfall Subdivision
Phase 1

Figure 2
Septic System Layout

Initial System Specifications

Pressure Manifold Design Criteria

DESIGN DAILY FLOW 480 gallons/day **SOIL LTAR:** 0.70 gpd/ft²
TANKS (min) Septic Tank: 1000 gallons Pump Tank: 1000 gallons
SUPPLY LINE Length: 68 ft Diameter: 2 " SCH 40 PVC
 Minimum flow (gpm) to maintain 2fps scour velocity: 20.9 gpm
 Supply Pipe Volume 12 gallons

TRENCHES Drainline Type: Accepted (25% reduction) System
 Maximum Trench Depth of 24 inches, measured on low side of trench
 Trench width: 3 feet Effective Trench Width: 4 ft
 Absorption Area: 514 ft² Minimum Linear Length: 171 ft

MANIFOLD Length (ft): 3 Diameter: 4" sch 80 pvc Elevation: 108.96
 # Taps 3 Tap Configuration: 6in. spacing, 1 side of manifold

TAP CHART

Line	Color	Relative Elevation	Length(ft)	Tap Size/ Schedule	flow/tap gpm	gpd/ft	LTAR (gpd/ft ²)
4	R	107.96	70	3/4"sch 80	10.10	2.848	0.949
5	Y	107.62	50	1/2"sch 40	7.11	2.807	0.936
6	B	107.3	50	1/2"sch 40	7.11	2.807	0.936
Total Drainline:			170	Total Flow:	24.32		

Target LTAR*: 0.93

LTAR + 5%: 0.980

PUMP CALCULATIONS


Dose Volume: 83.26 gallons, with Pipe Volume at 75 % *65.3gal/100ft pipe
 Dose Pump Run Time (min): 3.42 Daily Pump Run Time (min): 19.74
 Drawdown (in.): 83 gallons ÷ 20.25 gal/ inch = 4.11 inches
 Pump Tank Elevation (ft): 107.02 Pump Elevation (ft): 102.02
 Friction Head: 1.66 *Hazen Williams Formula (use supply line length+70' for fittings in pump tank)
 Elevation Head: 6.9 Design Head: 2.0 Total Head: 10.60 ft
 Pump to Deliver: 24.3 gpm @ 10.6 ft head

NEMA 4X Simplex Control Panel with elapsed time meter, event counter, audible and visible alarm (w/ silence button), hand-off-automatic (HOA) switch, pump run light, and pump on separate circuits is required. Control panel bottom shall be mounted a minimum of 24 in. above finished grade within 50 ft of pump tank. A septic tank filter is required. Floats to be determined by type of pump tank used.

Possible Septic Tank: Brantley 1000 STB-499 Possible Septic Filter: Polylock PL-122
 Possible Pump Tank: Brantley 1000 PT-237 Vol(gal): 1000 GPI: 20.25
 Possible Pump: Ashland EPH30 (0.3HP) pump height (in) = 9.4
 Possible Control Panel: _____


Pressure Manifold Diagram

	1	2	3
Manifold	4" SCH 80 PVC		
tap size	3/4" sch 80	1/2" sch 40	1/2" sch 40
flow (gpm)	10.10	7.11	7.11
length (ft)	70	50	50

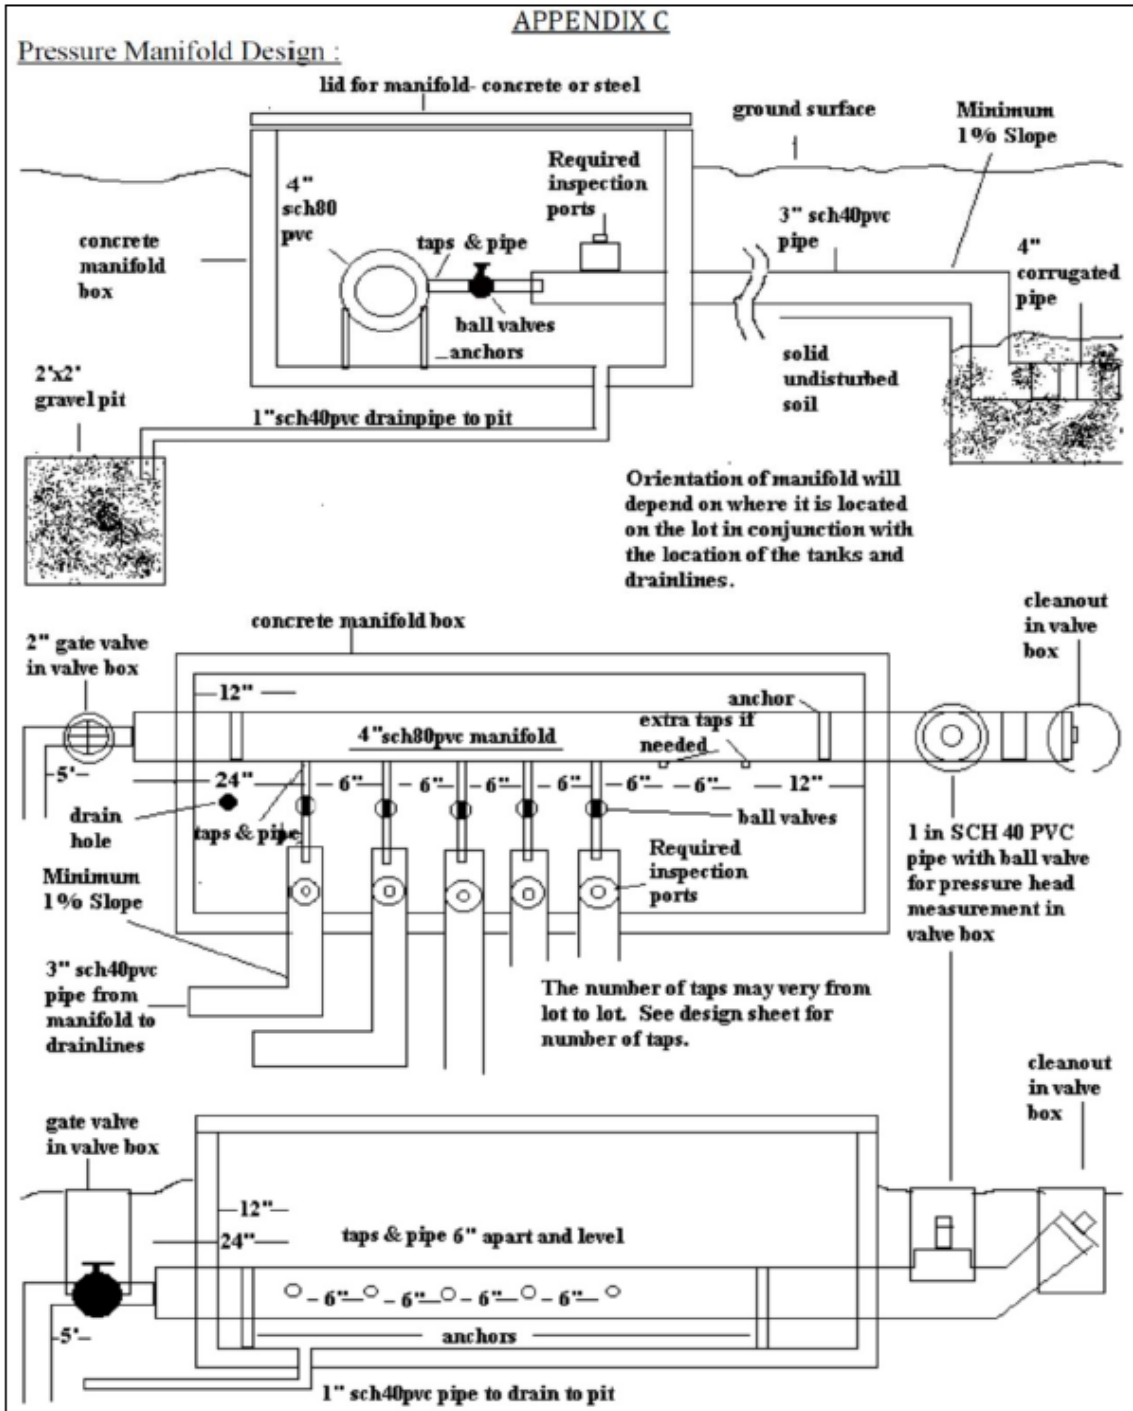


Typical Septic Tank

1000 GALLON SEPTIC TANK, minimum

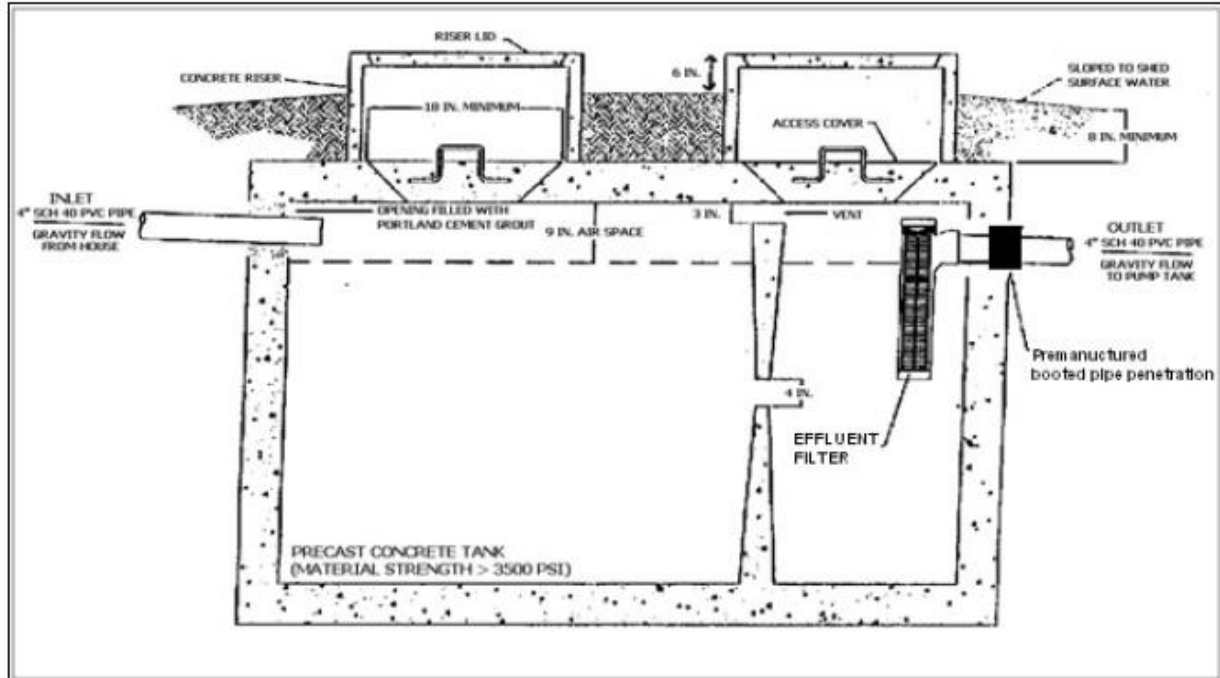

Typical Pump Tank

1000 GALLON PUMP TANK, minimum

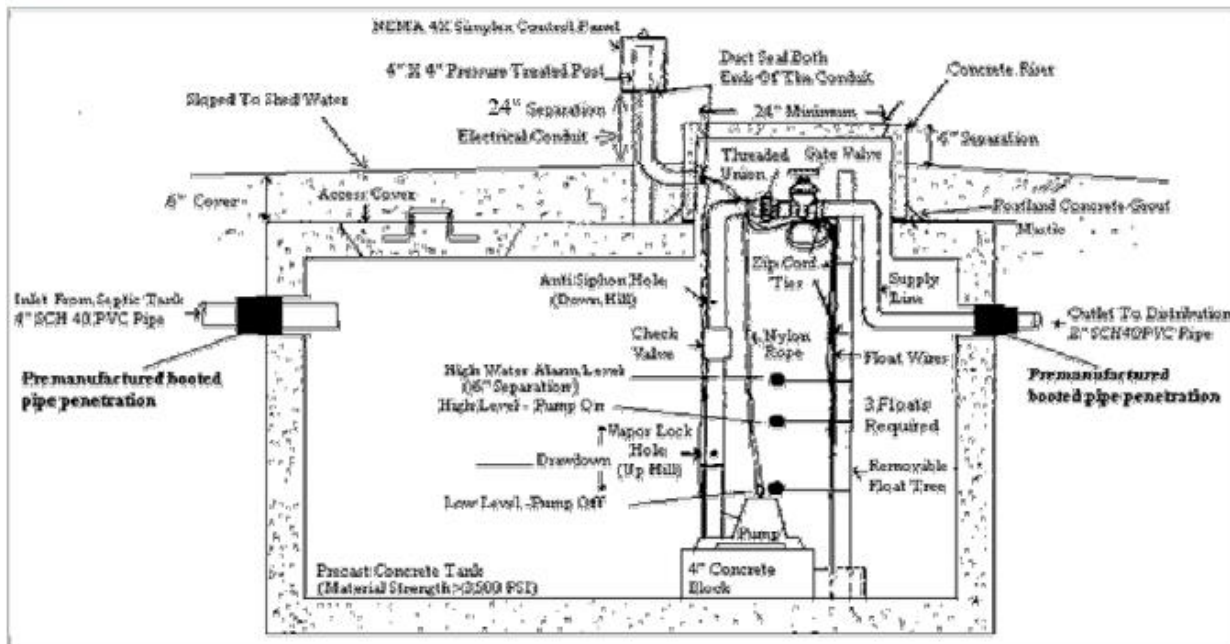

Pump Tank Calculations:

Possible pump tank: Brantley 1000_PT-237

Possible Pump: Ashland EPH30 (0.3HP)


tank GPI (gal/in): 20.25 calculated

height: 9.4 in

tank volume (gal): 1000 per manufacturer


minimum emergency storage: 480 gal

tank height (in): 50.0 per manufacturer

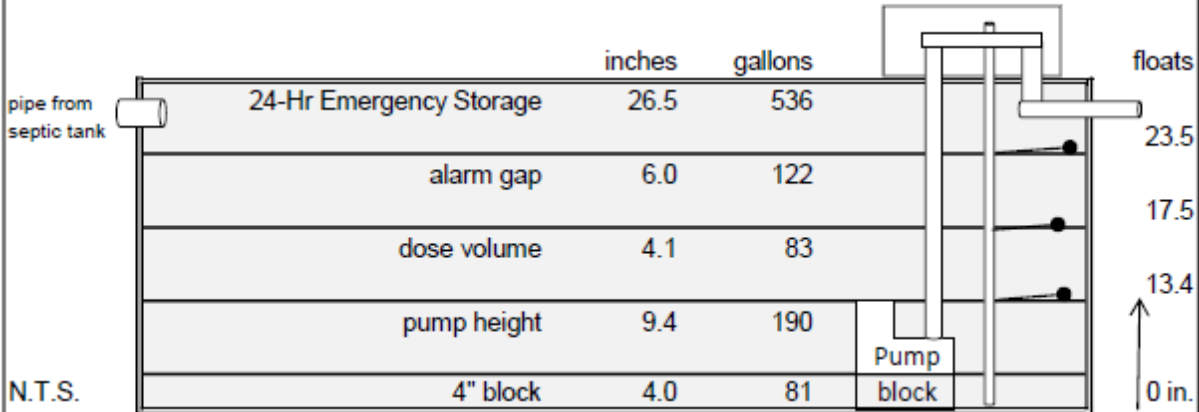

Supply Line Profile:

	Distance	Elevation
Pump	0	102.02
pump tank	1	107.02
Pressure manifold	68	108.96
4)		
5)		

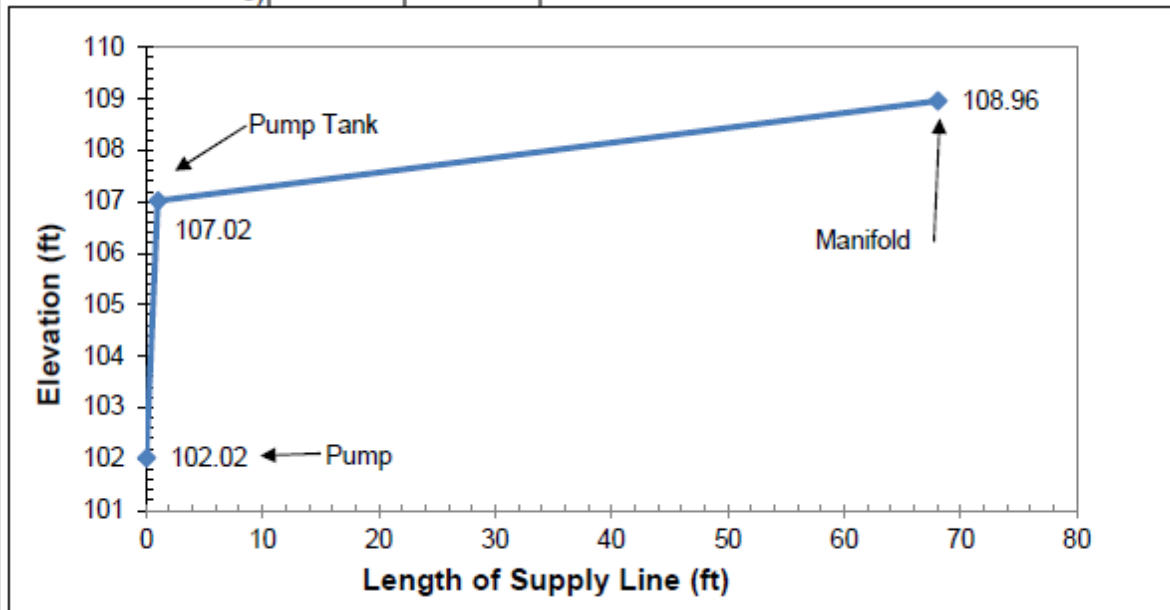

Repair System Specifications

DESIGN FLOW 480 gal/day **SOIL LTAR:** 0.70 gpd/ft²

TANKS (minimum) Septic Tank: 1000 gallons Pump Tank: 1000 gallons

TRENCHES Drainline Type: Accepted (25% reduction) System
 Maximum Trench Depth of 24 inches, measured on low side of trench
 Trench width: 3 feet Effective Trench Width: 4 ft
 Absorption Area: 514 ft² Minimum Linear Length: 171 ft

PRESSURE MANIFOLD DESIGN CRITERIA

MANIFOLD # Taps 2 Tap Configuration: 6in. spacing, 1 side of manifold
 Length (ft): 2.5 Diameter: 4" sch 80 pvc Elevation: 109.86

TAP CHART

Tap #	Line Number	Color	Relative Elevation	Drainline Length(ft)	Tap Size/ Schedule	Flow/tap (gpm)	LTAR (gpd/ft ²)
1	1	Y	108.86	25	3/4"sch 40	12.50	0.941
	2	B	108.49	60			
2	3	W	108.2	86	3/4"sch 40	12.50	0.930

Total Drainline: 171 Total Flow: 25.00

Target LTAR*: 0.93
 LTAR + 5%: 0.980

PUMP CALCULATIONS

Total Flow: 25.00 gpm Design Head (ft): 2.0
 Daily Pump Run Time: 19.20 min (Daily Flow/Total Flow)
 Dose Volume: 83.75 gallons with Pipe Volume at 75 % (65.3gal/100ft pipe)
 Dose Pump Run 3.35 minutes (Dose Volume/Total Flow)

* Target LTAR: Convert LTAR for non-conventional drainline types by dividing by trench length factor

MANIFOLD DIAGRAM:

