

Job 72427142	Truss A1	Truss Type Truss	Qty 12	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	-----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:15

Page: 1

ID:fuHK0Mp8XDuU3hpOA3OS5cyMrac-j7Acsltkjh7E1B18YUpysBL2vYYIZGHa2unpH6yk0HE

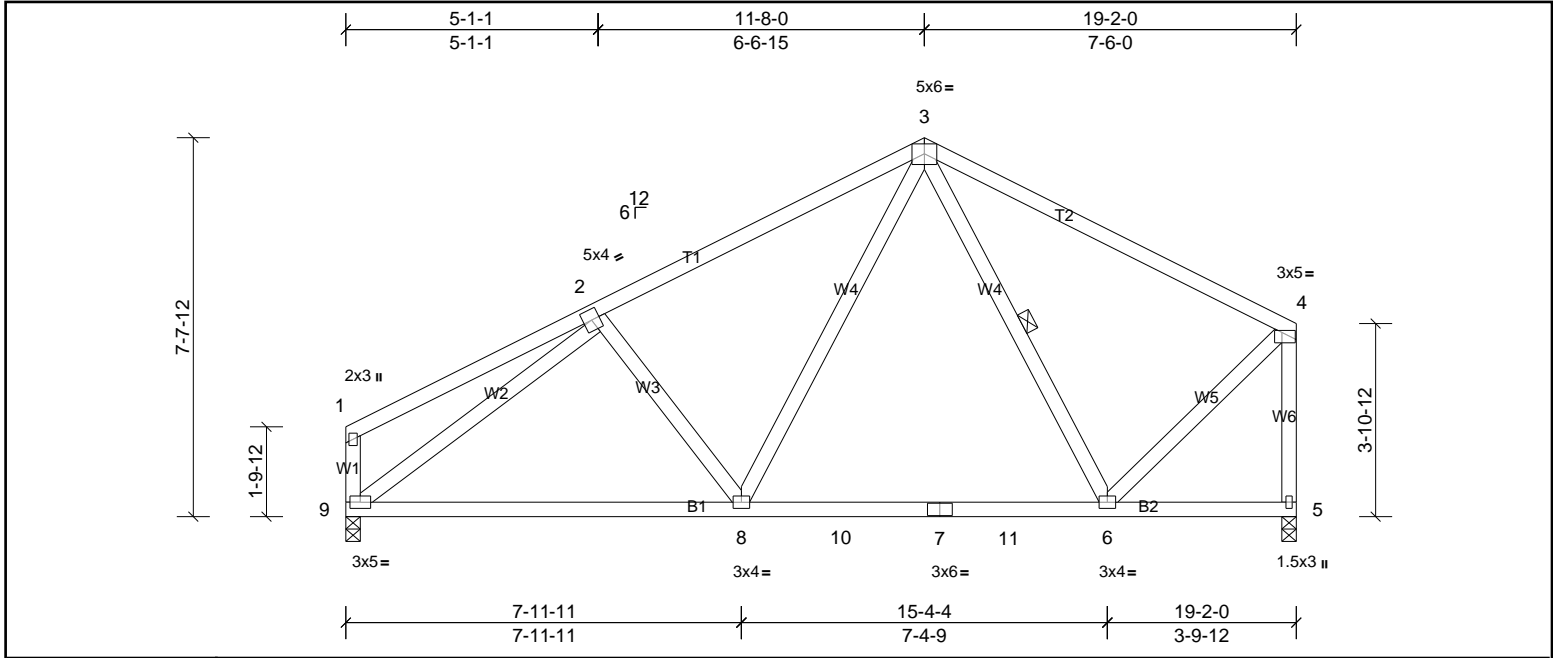


Plate Offsets (X, Y): [4:0-3-4,0-2-8]

Loading	(psf)	Spacing		2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL		1.15	TC	0.83	Vert(LL)	-0.12	6-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL		1.15	BC	0.58	Vert(CT)	-0.18	8-9	>999	180		
BCLL	0.0*	Rep Stress Incr		YES	WB	0.65	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code		IRC2015/TPI2014	Matrix-MSH							Weight: 115 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 3-6

REACTIONS

(lb/size)	5=755/0-3-8, (min. 0-1-8), 9=755/0-3-8, (min. 0-1-8)
Max Horiz	9=192 (LC 9)
Max Uplift	5=87 (LC 11), 9=107 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-789/304, 3-4=-509/217, 4-5=-728/210
BOT CHORD	8-9=-169/717, 8-10=-45/478, 7-10=-45/478, 7-11=-45/478, 6-11=-45/478
WEBS	3-8=-71/366, 2-9=-852/221, 4-6=-7/506

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 107 lb uplift at joint 9 and 87 lb uplift at joint 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss A1G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:15

Page: 1

ID:U2ebGPtv73eencHYWKVsLtyMraW-j7AcstKjh7E1BI8YUpysBLALYfhZPja2unpH6yk0HE

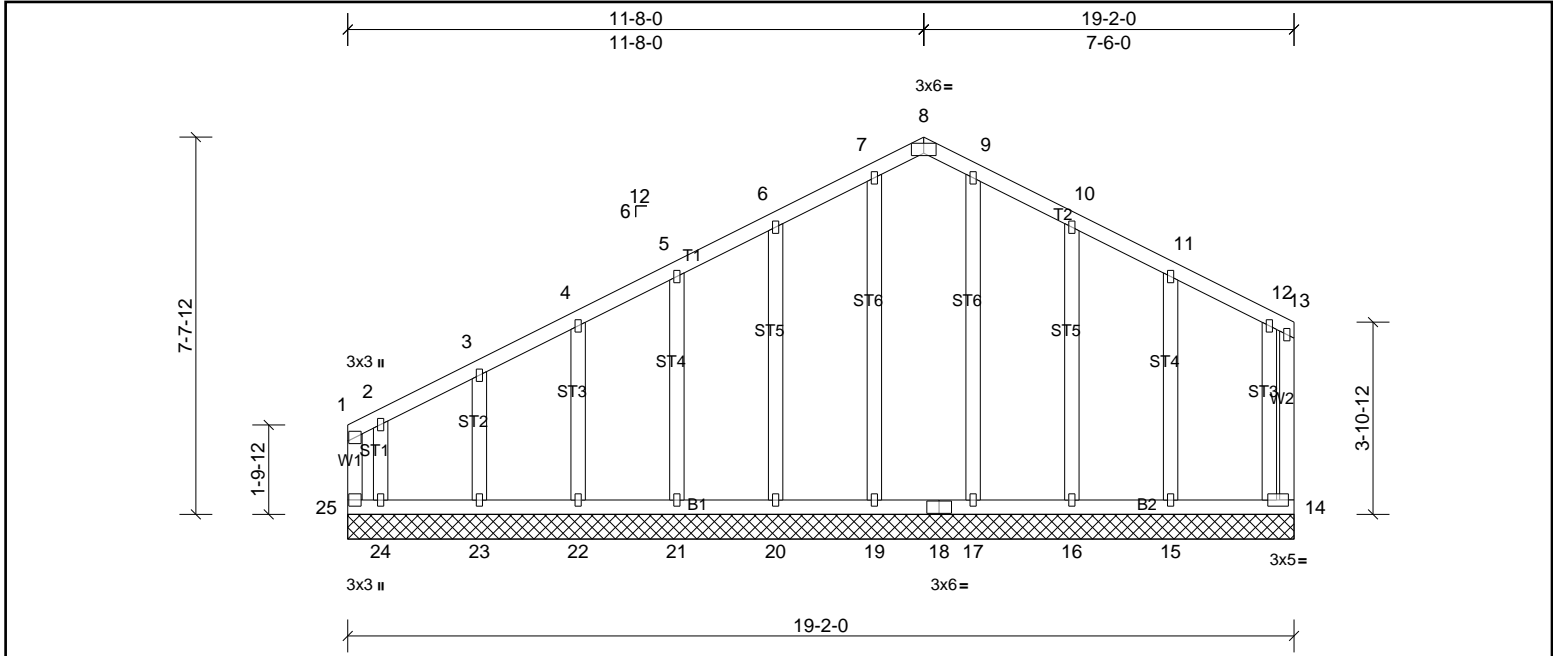


Plate Offsets (X, Y): [8:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.00	14	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 135 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS All bearings 19-2-0.
 (lb) - Max Horiz 25=192 (LC 7)
 Max Uplift All uplift 100 (lb) or less at joint(s) 14, 15, 16, 20, 21, 22, 23 except 24=-416 (LC 7), 25=-262 (LC 8)
 Max Grav All reactions 250 (lb) or less at joint(s) 14, 15, 16, 17, 19, 20, 21, 22, 23 except 24=299 (LC 8), 25=455 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 20, 21, 22, 23, 16, 15 except (jt=lb) 25=262, 24=415.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss A2	Truss Type Truss	Qty 7	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:16

Page: 1

ID:uus9TF7SPDAoAgpOhXsY95yMraC-BKk_45tyU?G5fLKK6CKBPouF8yuXljXkGYXmpZyk0HD

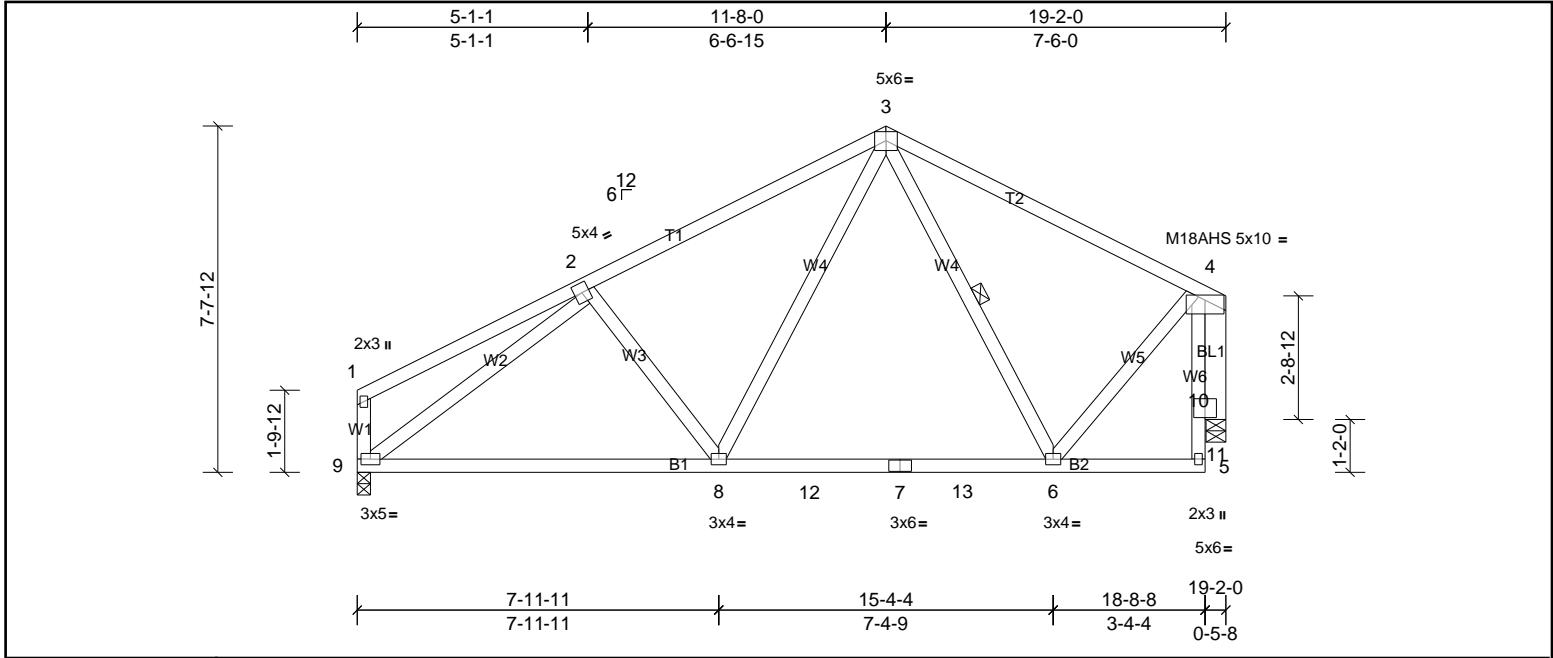


Plate Offsets (X, Y): [4:0-3-4,0-0-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.11	6-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.18	8-9	>999	180	M18AHS	186/179
BCLL	0.0*	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.03	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH								Weight: 120 lb FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-7-8 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 3-6
OTHERS	2x6 SP No.2		

REACTIONS (lb/size) 9=752/0-3-8, (min. 0-1-8), 11=722/0-5-4, (min. 0-1-8)
 Max Horiz 9=151 (LC 7)
 Max Uplift 9=99 (LC 10), 11=-82 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-785/282, 3-4=-505/184
 BOT CHORD 8-9=-247/714, 8-12=-82/470, 7-12=-82/470, 7-13=-82/470, 6-13=-82/470
 WEBS 4-6=-24/441, 3-8=-79/368, 2-9=-849/200, 4-11=-734/208

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 99 lb uplift at joint 9 and 82 lb uplift at joint 11.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss A2G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF
UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton					Job Reference (optional)

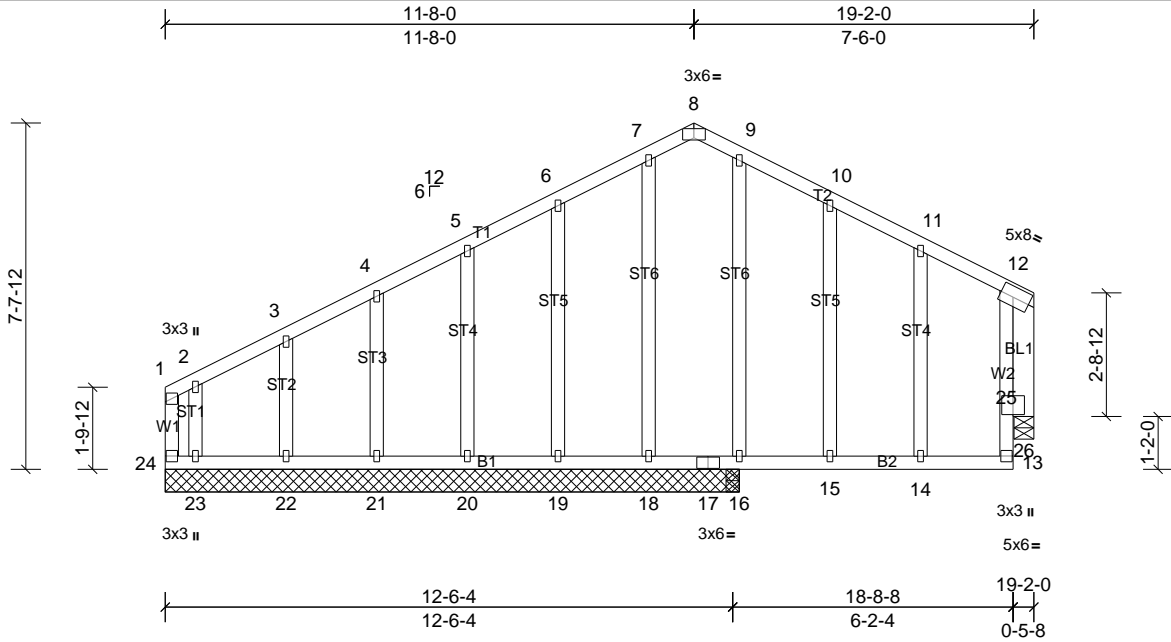


Plate Offsets (X, Y): [8:0-3-0,Edge], [12:0-3-8,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	0.04	14-15	>999	240	MT20	244/190
TCDL	18.0	Lumber DOL	1.15	BC	0.35	Vert(CT)	-0.08	14-15	>992	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.24	Horz(CT)	-0.01	26	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 135 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3 *Except* BL1:2x6 SP No.2	

REACTIONS
All bearings 12-8-0. except 26=0-5-4
(lb) - Max Horiz 24=135 (LC 7)
Max Uplift All uplift 100 (lb) or less at joint(s) 16, 19, 20, 21, 22, 26 except 18=-115 (LC 22), 23=-449 (LC 10), 24=-114 (LC 6)
Max Grav All reactions 250 (lb) or less at joint(s) 18, 19, 20, 21, 22, 23 except 16=507 (LC 1), 24=479 (LC 14), 26=305 (LC 22)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-24=-259/50
WEBS 9-16=-263/28, 12-26=-311/119

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 26 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 19, 20, 21, 22, 26 except (jt=lb) 24=113, 18=114, 23=449.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job 72427142	Truss B1	Truss Type Truss	Qty 13	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF	
UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton					Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:16	Page: 1
ID:cvZfrw3N2A_kXfmgvFrJyMrZ4-Bkk_45tU?G5fLK6CCKBPOuAlyskleWkGYXmpZyk0HD						

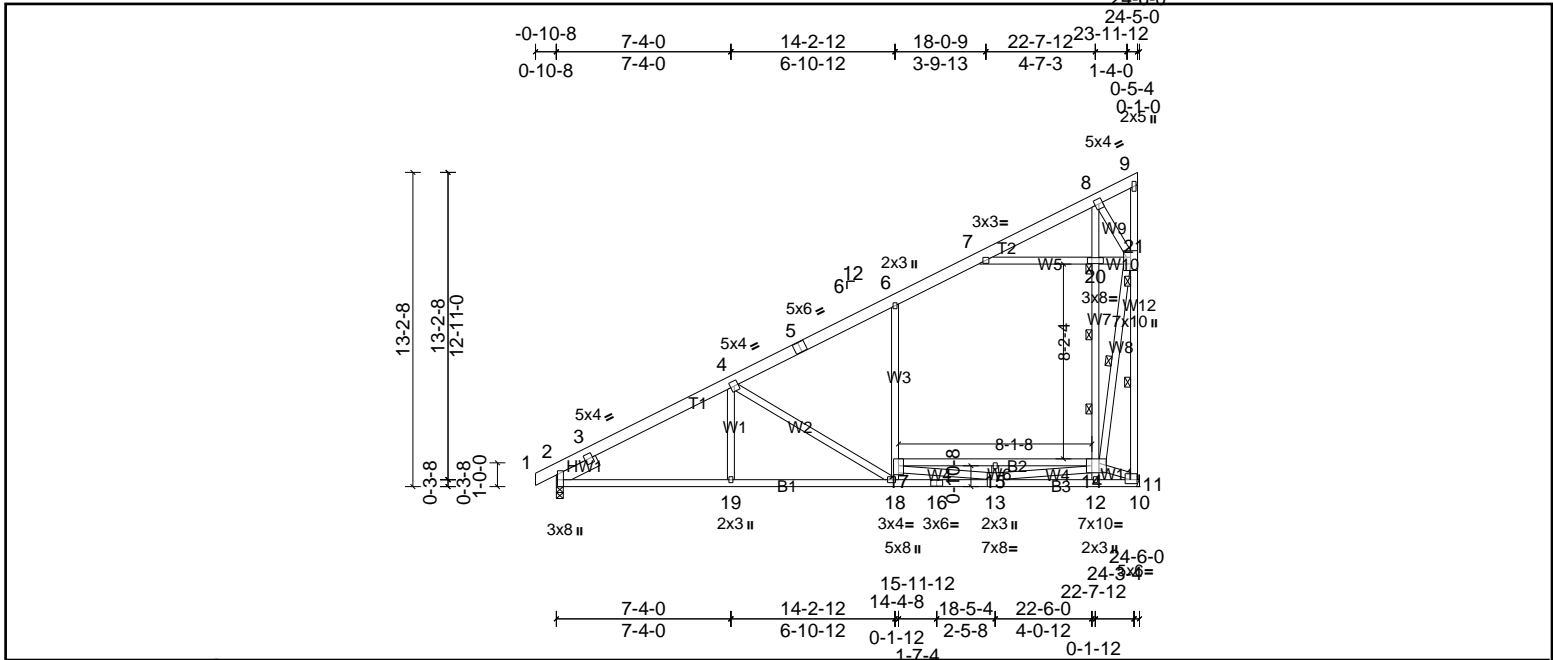


Plate Offsets (X, Y): [2:0-5-14,Edge], [11:0-2-12,0-2-0], [14:0-2-12,Edge]

Loading	(psf)	Spacing		CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	2-0-0	TC	0.98	Vert(LL)	-0.42	18-19	>697	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.86	18-19	>338	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.97	Horz(CT)	-0.02	2	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH		Attic	-0.19	14-17	>517	360	Weight: 224 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 3-1-4 oc bracing.
WEBS	2x4 SP No.2 *Except* W12:2x4 SP SS, W1,W2,W6,W10,W9:2x4 SP No.3	WEBS	1 Row at midpt
SLIDER	Left 2x6 SP No.2 -- 1-11-0	WEBS	2 Rows at 1/3 pts
			9-11, 14-20

REACTIONS	(lb/size)	
	2=1084/0-3-8, (min. 0-1-8), 11=1178/ Mechanical, (min. 0-1-8)	
	Max Horiz	2=505 (LC 10)
	Max Uplift	2=48 (LC 10), 11=-209 (LC 10)
	Max Grav	2=1084 (LC 1), 11=1427 (LC 2)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-551/6, 3-4=-1644/63, 4-5=-1107/0, 5-6=-969/0, 6-7=-776/6, 7-8=-422/942, 11-21=-2759/570
BOT CHORD	2-19=-537/1404, 18-19=-507/1404, 16-18=-280/1056, 13-16=-280/1056, 12-13=-2790/631, 11-12=-2580/592, 15-17=-552/986, 14-15=-552/986
WEBS	4-19=0/291, 4-18=-704/338, 17-18=-64/447, 6-17=0/391, 14-20=-1702/704, 8-20=-1644/716, 7-20=-1695/490, 13-15=-492/0, 11-14=-666/2896, 20-21=-1636/478, 8-21=-474/1445, 14-21=-1010/3973, 13-14=-294/3092, 13-17=-1212/638

- NOTES**
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - The Fabrication Tolerance at joint 14 = 4%
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 6-7, 7-20, 20-21
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 15-17, 14-15
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 209 lb uplift at joint 11 and 48 lb uplift at joint 2.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Attic room checked for L/360 deflection.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B1G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:17

Page: 1

ID:8fntY7EIWnm0AnzsG5kh2yMedJ-fWINHRubFIOyHVvXgvrQxcQQbLJq1lktVCGvM?yk0HC

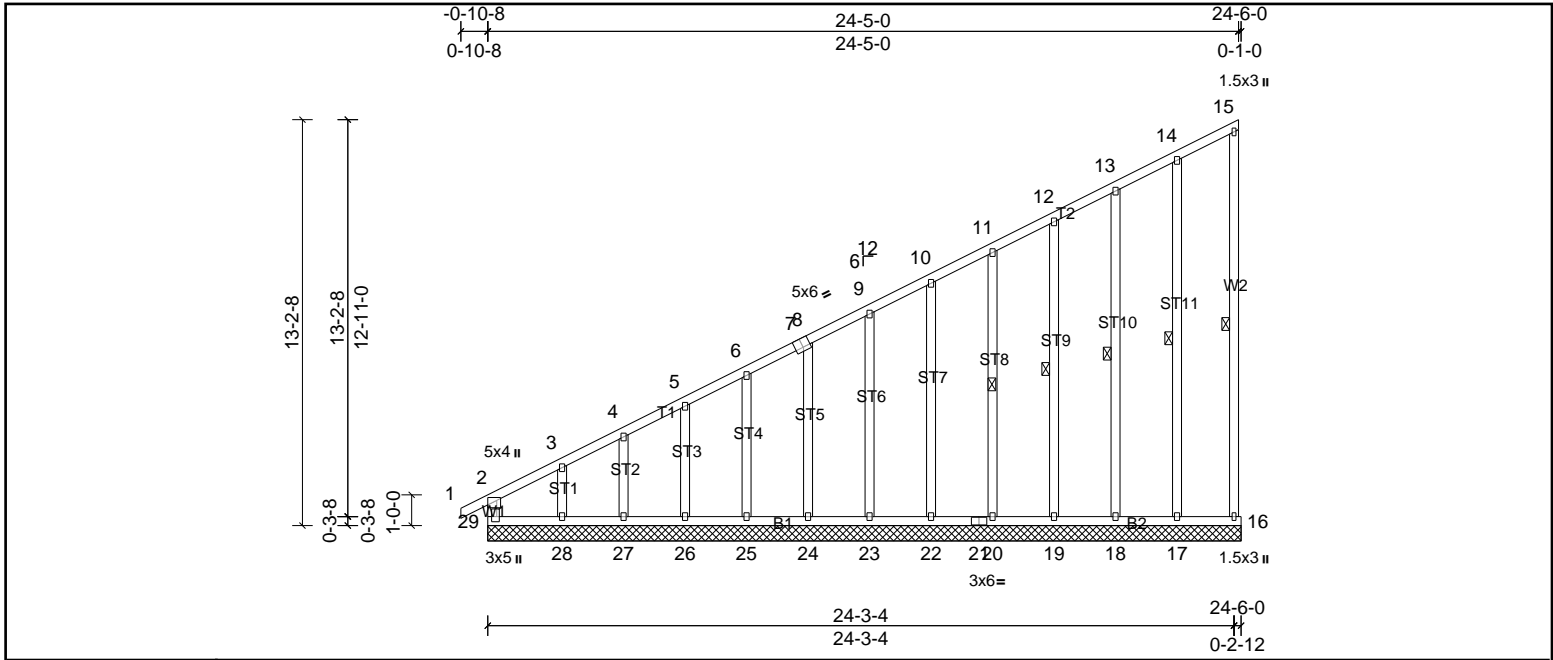


Plate Offsets (X, Y): [7:0-3-0,Edge], [29:0-2-0,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 207 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt
OTHERS 2x4 SP No.3	

REACTIONS All bearings 24-6-0.
 (lb) - Max Horiz 29=494 (LC 10)
 Max Uplift All uplift 100 (lb) or less at joint(s) 16, 17, 18, 19, 20, 22, 23, 24, 25, 26 except 28=334 (LC 10)
 Max Grav All reactions 250 (lb) or less at joint(s) 16, 17, 18, 19, 20, 22, 23, 24, 25, 26, 27, 28 except 29=402 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-29=-297/91, 2-3=-638/233, 3-4=-506/182, 4-5=-478/174, 5-6=-424/154, 6-7=-375/128, 7-8=-365/137, 8-9=-325/120, 9-10=-275/103
 WEBS 3-28=-154/267

- NOTES**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only.
 - 3) All plates are 2x3 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 17, 18, 19, 20, 22, 23, 24, 25, 26 except (jt=lb) 28=333.
 - 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B2	Truss Type Truss	Qty 7	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:17

Page: 1

ID:c6tg3iLW322DAX9Rw2PyQryMed1-fWINHRubFIOyHVvXgvrQxcQTiLHk1CftVCGvM?yk0HC

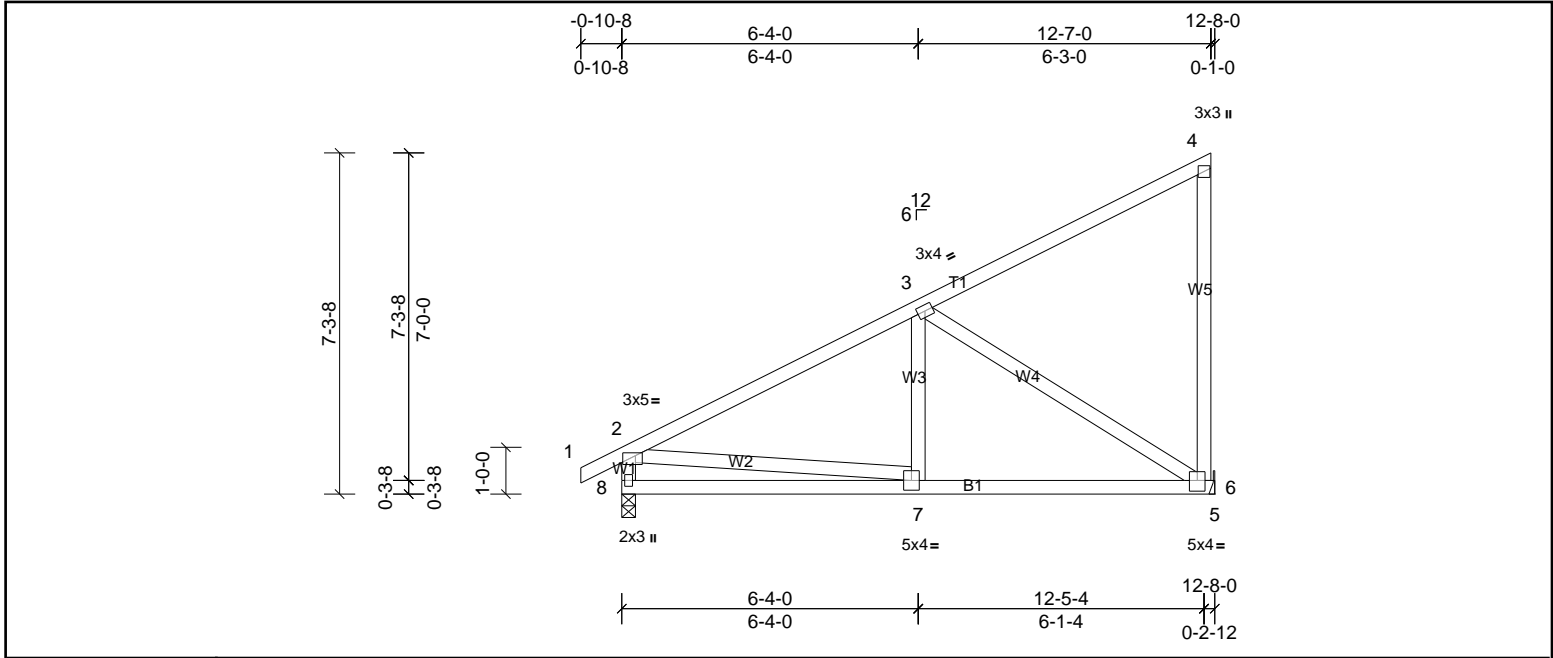


Plate Offsets (X, Y): [2:0-3-4,0-2-4], [6:0-2-0,0-2-4]

Loading	(psf)	Spacing		CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	2-0-0	TC	0.48	Vert(LL)	0.06	7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.07	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.53	Horz(CT)	-0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 76 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 7-7-1 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS	(lb/size)	
	6=494/ Mechanical, (min. 0-1-8), 8=555/0-3-8, (min. 0-1-8)	
	Max Horiz	8=255 (LC 10)
	Max Uplift	6=175 (LC 10), 8=82 (LC 7)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-598/385, 2-8=-499/335
BOT CHORD	7-8=-521/260, 6-7=-559/465
WEBS	3-7=-281/255, 3-6=-537/647, 2-7=-39/264

- NOTES**
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 82 lb uplift at joint 8 and 175 lb uplift at joint 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B2G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:17

Page: 1

ID:kQktVa6f_j67sm3kgUZz0LyMec1-fWINHRubFIOyHVvXgvrQxcQOLL9m1AntVCGvM?yk0HC

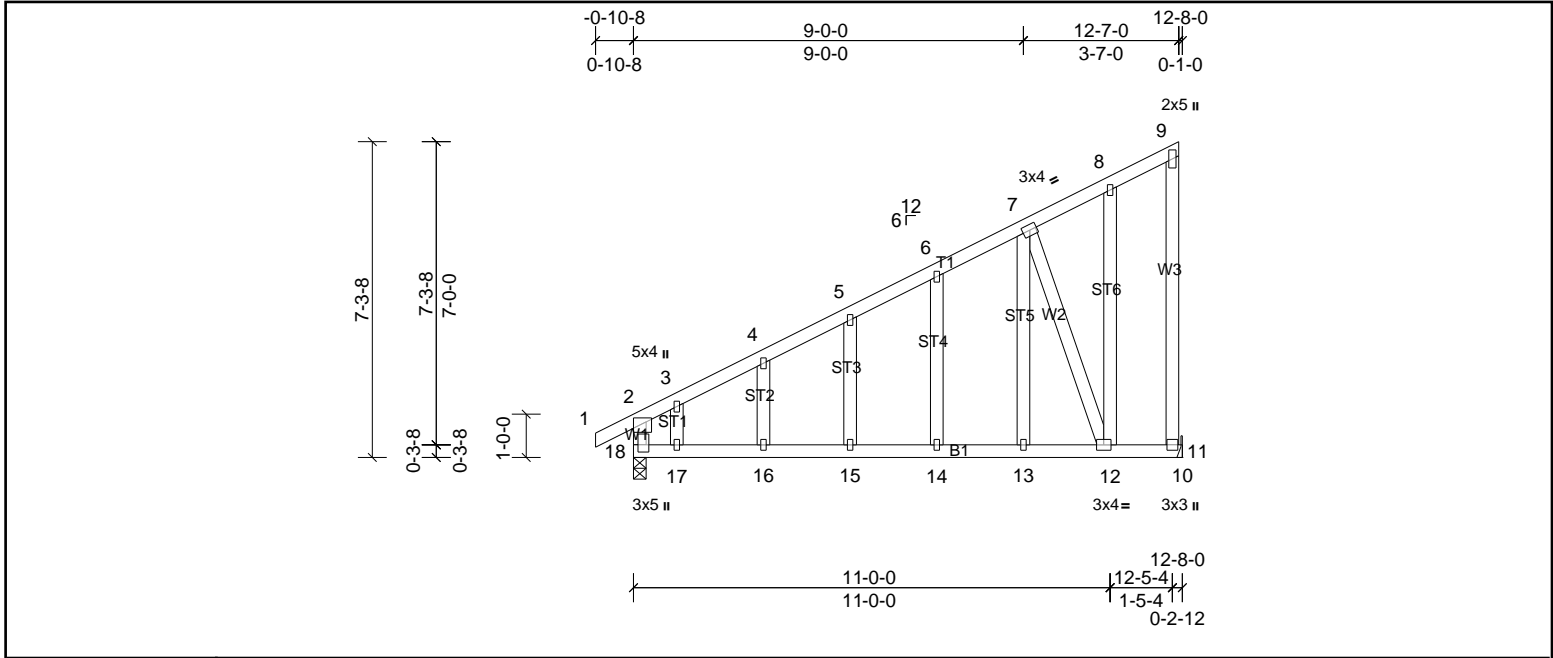


Plate Offsets (X, Y): [18:0-2-0,0-1-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	0.33	15-16	>447	240	MT20	244/190
TCDL	18.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.35	15-16	>426	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.01	11	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 91 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-9-12 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS	(lb/size)	11=591/ Mechanical, (min. 0-1-8), 18=671/0-3-8, (min. 0-1-8)
Max Horiz	18=255 (LC 10)	
Max Uplift	11=-175 (LC 10), 18=-82 (LC 7)	

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-563/219, 3-4=-536/224, 4-5=-491/241, 5-6=-458/259, 6-7=-414/273, 9-11=-280/260, 2-18=-515/297
BOT CHORD	17-18=-423/411, 16-17=-423/411, 15-16=-423/411, 14-15=-423/411, 13-14=-423/411, 12-13=-423/411
WEBS	7-13=-636/566, 8-12=-468/407, 7-12=-1075/1111

- NOTES**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only.
 - 3) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 2-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 175 lb uplift at joint 11 and 82 lb uplift at joint 18.
 - 9) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B3	Truss Type Truss	Qty 9	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:18

Page: 1

ID:bNU6i03jXhsW7GidzxBv0yMeYD-fVINHRubFIOyHVvXgvrQxcQOHl8i15etVCGvM?yk0HC

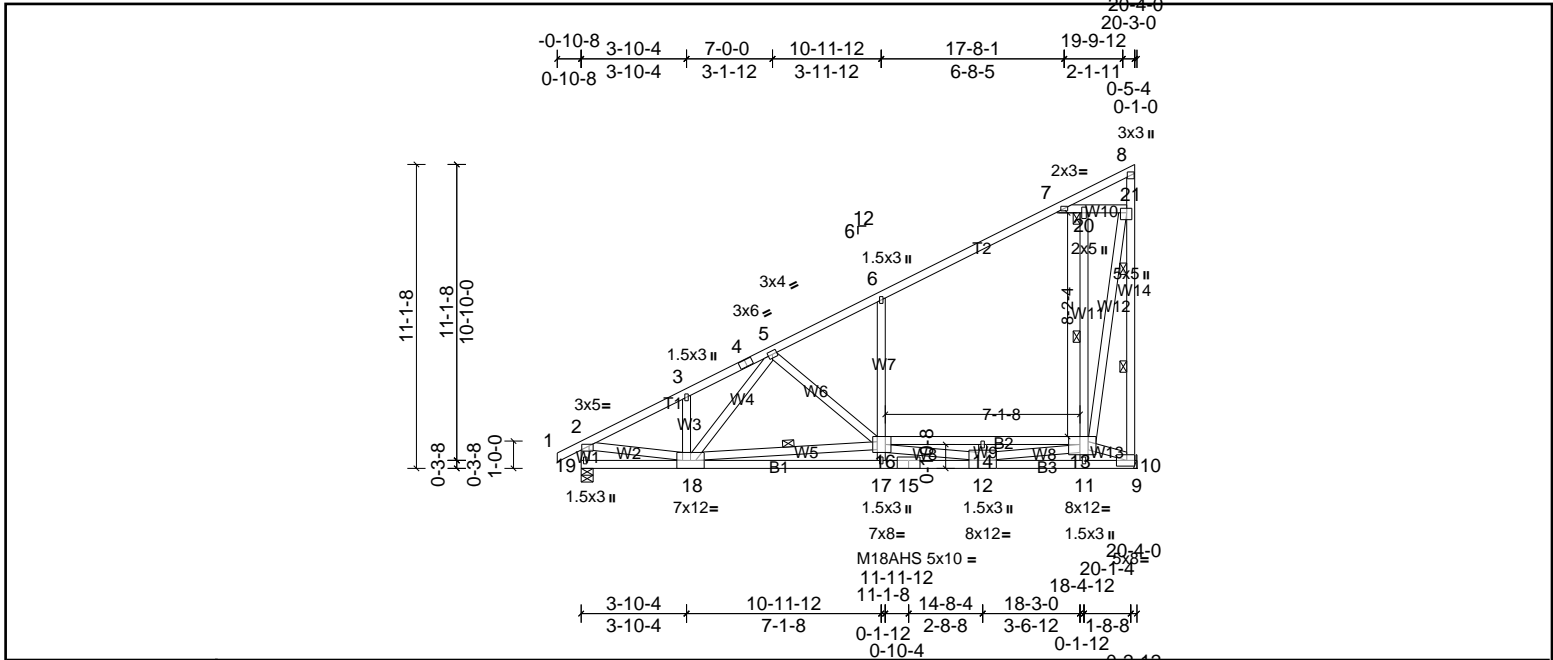


Plate Offsets (X, Y): [2:0-3-4,0-0-12], [10:0-3-8,0-2-8], [13:0-5-0,Edge], [16:0-2-8,Edge], [21:0-2-0,0-2-4]

Loading	(psf)	Spacing	2-10-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.33	17-18	>728	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.67	17-18	>358	180	M18AHS	186/179
BCLL	0.0*	Rep Stress Incr	NO	WB	0.98	Horz(CT)	0.04	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH		Attic	0.15	13-16	>582	360	Weight: 178 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP SS *Except* T1:2x4 SP No.2	TOP CHORD	2-0-0 oc purlins (4-2-5 max.), except end verticals (Switched from sheeted: Spacing > 2-0-0).
BOT CHORD	2x4 SP SS *Except* B2:2x4 SP No.2, B3:2x4 SP No.1	BOT CHORD	Rigid ceiling directly applied or 3-5-6 oc bracing.
WEBS	2x4 SP No.3 *Except* W14:2x4 SP SS, W7,W11,W10,W13,W12:2x4 SP No.2, W8:2x4 SP No.1	WEBS	1 Row at midpt 13-20, 16-18
REACTIONS	(lb/size) 10=1382/ Mechanical, (min. 0-1-8), 19=1304/0-5-4, (min. 0-1-9) Max Horiz 19=581 (LC 10) Max Uplift 10=-244 (LC 10), 19=-50 (LC 10) Max Grav 10=1682 (LC 2), 19=1312 (LC 2)	WEBS	2 Rows at 1/3 pts 8-10
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	JOINTS	1 Brace at Jt(s): 8, 20, 2
TOP CHORD	2-3=-1813/51, 3-4=-1756/129, 4-5=-1667/151, 5-6=-897/0, 6-7=-832/0, 10-21=-2914/614, 2-19=-1288/173		
BOT CHORD	18-19=-683/340, 17-18=-1081/4084, 15-17=-1157/4278, 12-15=-1157/4278, 11-12=-2591/603, 10-11=-2453/589, 14-16=-1336/0, 13-14=-1336/0		
WEBS	16-17=0/262, 6-16=-393/293, 11-13=0/302, 13-20=-522/334, 7-20=-788/200, 20-21=-783/202, 2-18=0/1439, 12-14=-595/0, 12-16=-2658/1122, 12-13=-691/4642, 16-18=-2886/646, 5-16=-660/341, 10-13=-660/2728, 13-21=-721/3125, 5-18=-258/592		

- NOTES**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Ceiling dead load (5.0 psf) on member(s). 6-7, 7-20, 20-21
 - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 14-16, 13-14
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 244 lb uplift at joint 10 and 50 lb uplift at joint 19.
 - 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 10) Attic room checked for L/360 deflection.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B3G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:18

Page: 1

ID:AptPIB9s7xwABRTwqtumigyMeLB-7irlVnvD0cWpvfUjDcMfUpzc3lfqml_0ks0TuRyk0HB

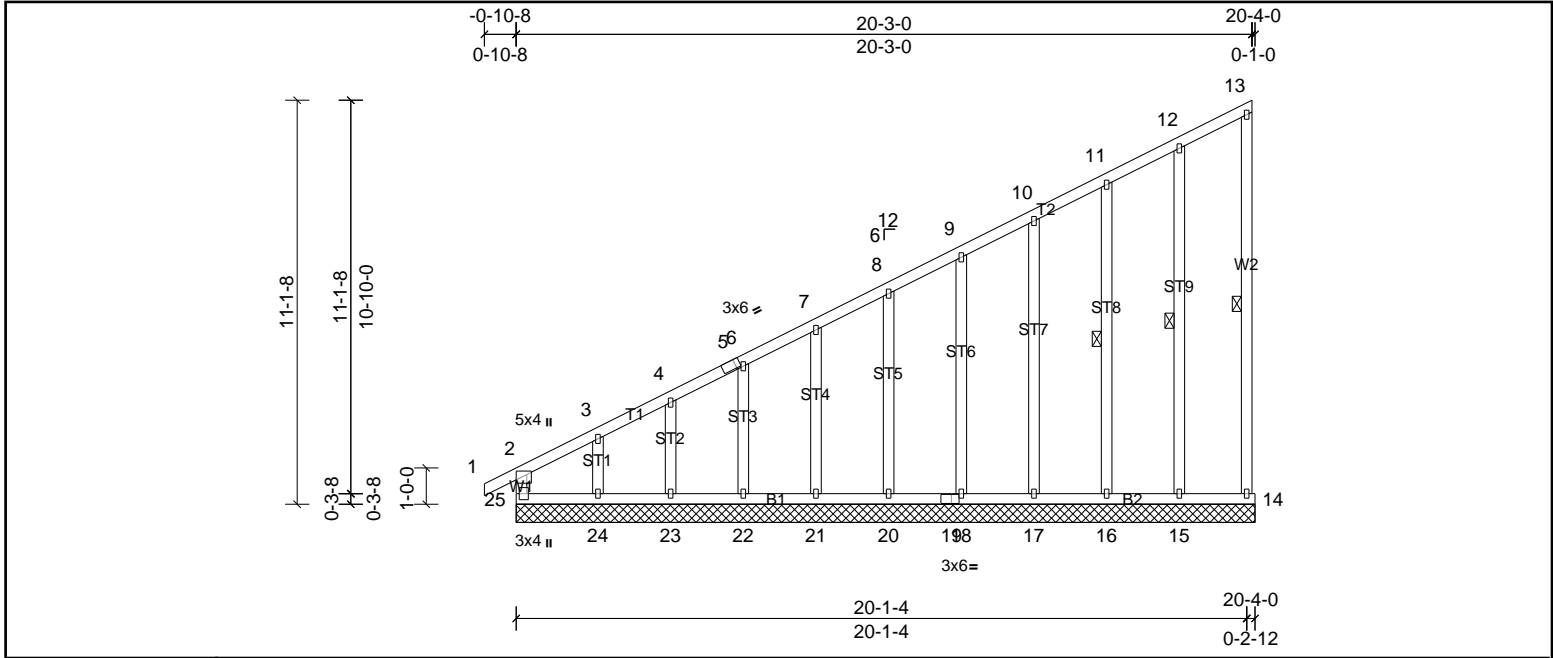


Plate Offsets (X, Y): [5:0-1-10,Edge], [19:0-2-8,0-1-8], [25:0-2-0,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 157 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 13-14, 12-15, 11-16
OTHERS 2x4 SP No.3	

REACTIONS All bearings 20-4-0.
 (lb) - Max Horiz 25=410 (LC 10)
 Max Uplift All uplift 100 (lb) or less at joint(s) 14, 15, 16, 17, 18, 20, 21, 22 except 24=293 (LC 10)
 Max Grav All reactions 250 (lb) or less at joint(s) 14, 15, 16, 17, 18, 20, 21, 22, 23, 24 except 25=337 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-528/194, 3-4=-410/149, 4-5=-377/129, 5-6=-368/139, 6-7=-324/120, 7-8=-275/103

- NOTES**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only.
 - 3) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 15, 16, 17, 18, 20, 21, 22 except (jt=lb) 24=293.
 - 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B4	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:18

Page: 1

ID:jrYOKuSuxNsCZpYPHMD615yMdeW-7irfVnvD0cWpvfUjDcMfUpzbolUamau0ks0TuRyk0HB

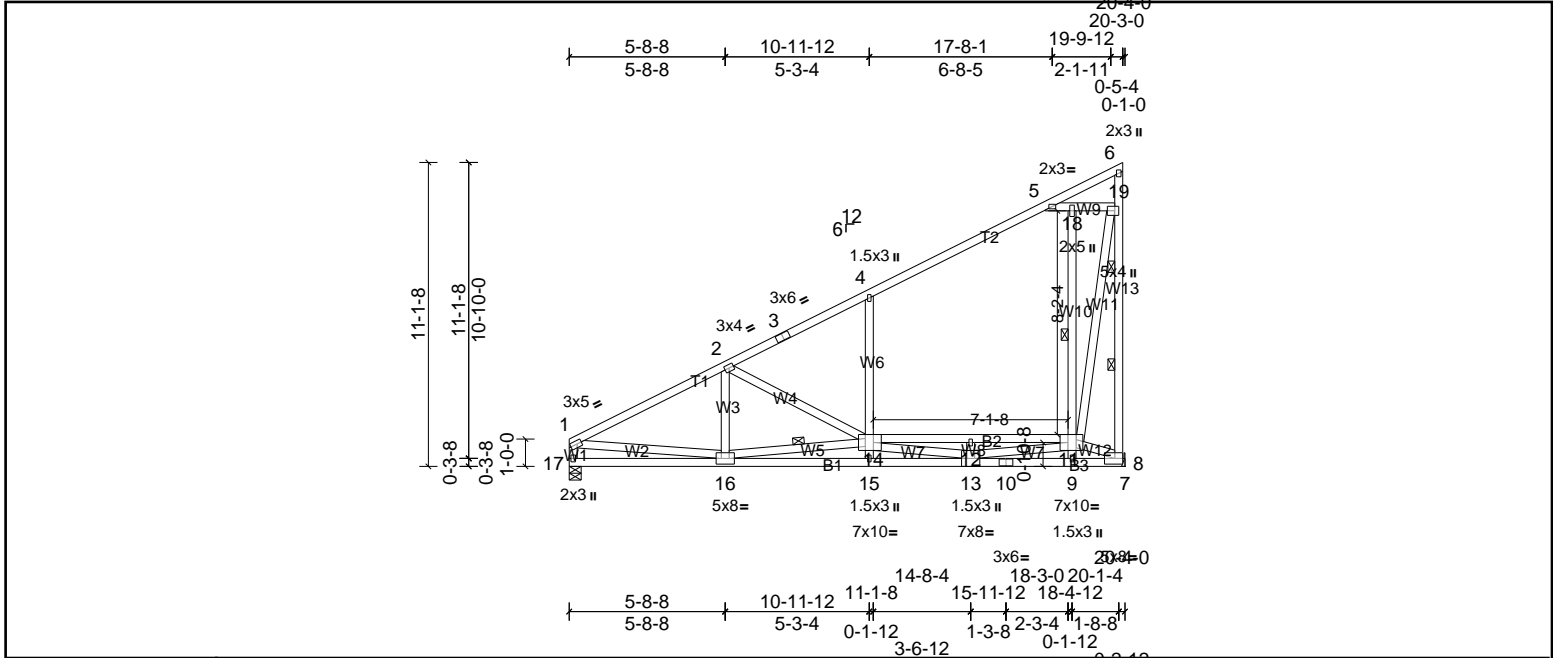


Plate Offsets (X, Y): [1:0-2-0,0-1-8], [11:0-3-8,Edge], [14:0-3-8,Edge], [19:0-2-0,0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.25	15	>974	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.99	Vert(CT)	-0.48	15-16	>495		180
BCLL	0.0*	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.04	8	n/a		n/a
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH		Attic	0.11	11-14	>784	Weight: 172 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-9-14 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3 *Except* W13,W6,W10,W9,W7:2x4 SP No.2	WEBS	1 Row at midpt 11-18, 14-16
REACTIONS	(lb/size) 8=977/ Mechanical, (min. 0-1-8), 17=858/0-5-4, (min. 0-1-8)	WEBS	2 Rows at 1/3 pts 6-8
	Max Horiz 17=392 (LC 10)		
	Max Uplift 8=172 (LC 10), 17=12 (LC 10)		
	Max Grav 8=1189 (LC 2), 17=874 (LC 2)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-1322/31, 2-3=-607/0, 3-4=-537/0, 4-5=-558/0, 8-19=-1925/409, 1-17=-827/75		
BOT CHORD	16-17=-486/269, 15-16=-847/3153, 13-15=-895/3279, 10-13=-1560/373, 9-10=-1560/373, 8-9=-1461/362, 12-14=-1194/0, 11-12=-1194/0		
WEBS	2-16=-26/384, 4-14=-328/223, 11-18=-366/239, 5-18=-511/130, 18-19=-507/132, 1-16=0/1006, 8-11=-404/1624, 11-19=-488/2062, 12-13=-415/0, 13-14=-1857/823, 11-13=-483/3283, 14-16=-2047/450, 2-14=-737/318		

- NOTES**
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 4-5, 5-18, 18-19
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 12-14, 11-12
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 172 lb uplift at joint 8 and 12 lb uplift at joint 17.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Attic room checked for L/360 deflection.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B5G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:19

Page: 1

ID: iJle1vvMK8w1wEUkkgG1sVyMdU?cvP7i7wrnwegWp2vnKtu01Vnn9?4VCBAyWl0Qtyk0HA

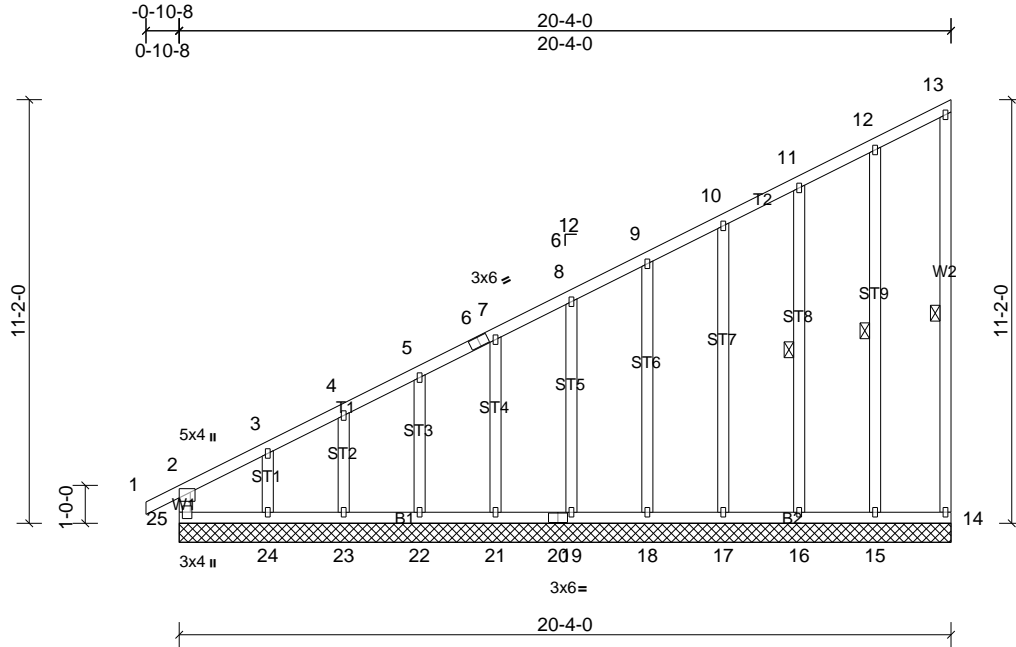


Plate Offsets (X, Y): [2:0-2-0,0-1-12], [25:0-2-0,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.00	14	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 157 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 13-14, 12-15, 11-16

REACTIONS All bearings 20-4-0.
(lb) - Max Horiz 25=412 (LC 10)
Max Uplift All uplift 100 (lb) or less at joint(s) 14, 15, 16, 17, 18, 19, 21, 22 except 24=-290 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 14, 15, 16, 17, 18, 19, 21, 22, 23, 24 except 25=332 (LC 10)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-528/194, 3-4=-410/148, 4-5=-377/139, 5-6=-324/103, 6-7=-314/120, 7-8=-275/103

- NOTES**
- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only.
 - 3) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 15, 16, 17, 18, 19, 21, 22 except (jt=lb) 24=290.
 - 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss B5S	Truss Type Truss	Qty 4	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:19

Page: 1

ID:txoZj96Kq9vMoDdRznexGnyMdaC-cvP7i7wrnwegWp2vnKtu01VmY9qfV18AyWl0Qtyk0HA

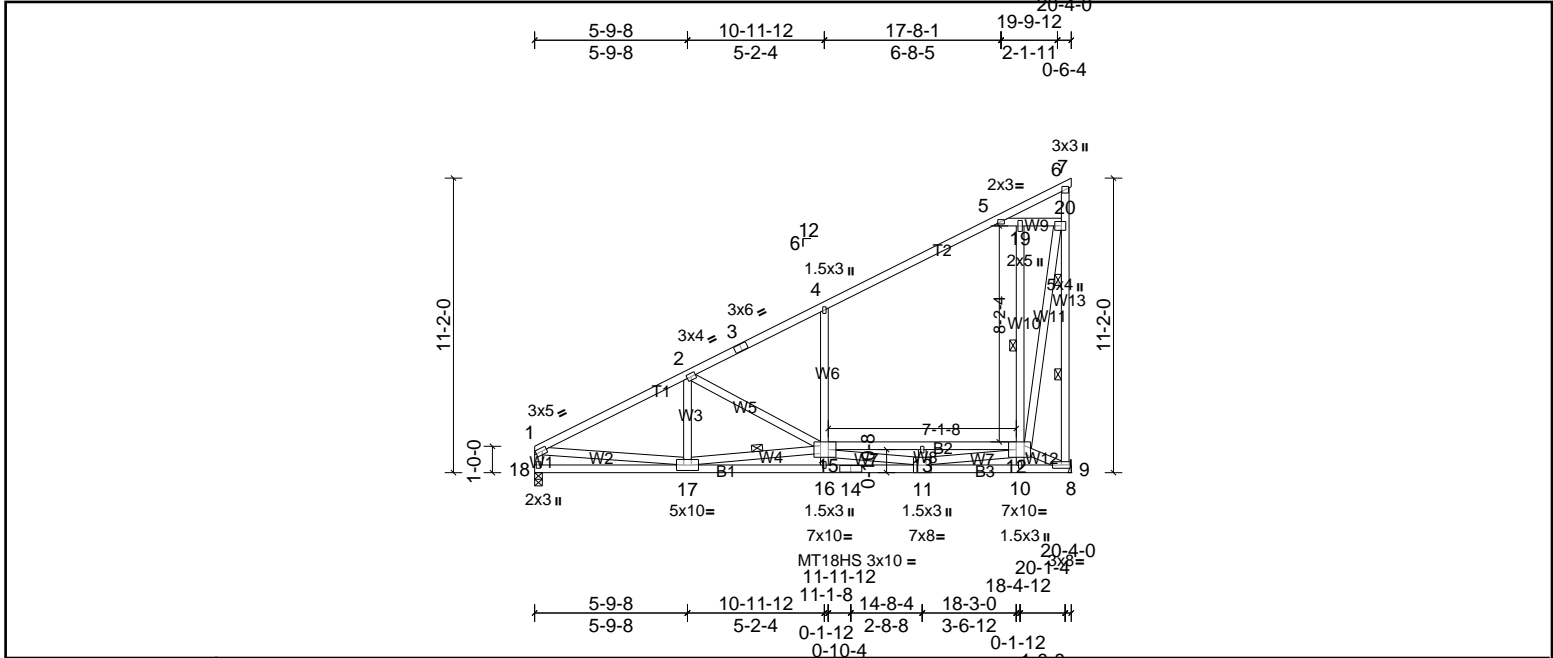


Plate Offsets (X, Y): [1:0-2-0,0-1-8], [12:0-3-8,Edge], [15:0-3-8,Edge], [20:0-2-0,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.24	16	>982	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	1.00	Vert(CT)	-0.48	16	>498	180	MT18HS	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.04	9	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH		Attic	0.11	12-15	>784	360	Weight: 172 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-9-10 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS	2x4 SP No.3 *Except* W13,W6,W10,W9,W7:2x4 SP No.2	WEBS	1 Row at midpt 12-19, 15-17
REACTIONS	(lb/size) 9=982/ Mechanical, (min. 0-1-8), 18=858/0-3-8, (min. 0-1-8)	WEBS	2 Rows at 1/3 pts 6-9
	Max Horiz 18=396 (LC 10)		
	Max Uplift 9=180 (LC 10), 18=10 (LC 10)		
	Max Grav 9=1193 (LC 2), 18=874 (LC 2)		
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-1321/30, 2-3=-608/0, 3-4=-536/0, 4-5=-556/0, 9-20=-1924/405, 1-18=-826/75		
BOT CHORD	17-18=-488/273, 16-17=-847/3156, 14-16=-894/3281, 11-14=-894/3281, 10-11=-1547/370, 9-10=-1448/359, 13-15=-1202/0, 12-13=-1202/0		
WEBS	2-17=-28/390, 2-15=-739/318, 4-15=-324/220, 12-19=-369/241, 5-19=-521/132, 19-20=-517/134, 1-17=0/998, 11-13=-415/0, 11-15=-1850/822, 11-12=-480/3278, 9-12=-401/1610, 12-20=-487/2057, 15-17=-2053/452		

- NOTES**
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 4-5, 5-19, 19-20
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 13-15, 12-13
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 180 lb uplift at joint 9 and 10 lb uplift at joint 18.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Attic room checked for L/360 deflection.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss C1	Truss Type Truss	Qty 3	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:19

Page: 1

ID:VHrj7bdMFWCjnuhb0fEW?eykyd6-cvP7i7wrnwegWp2vnKtu01Vo_90gVDSayWl0Qtk0HA

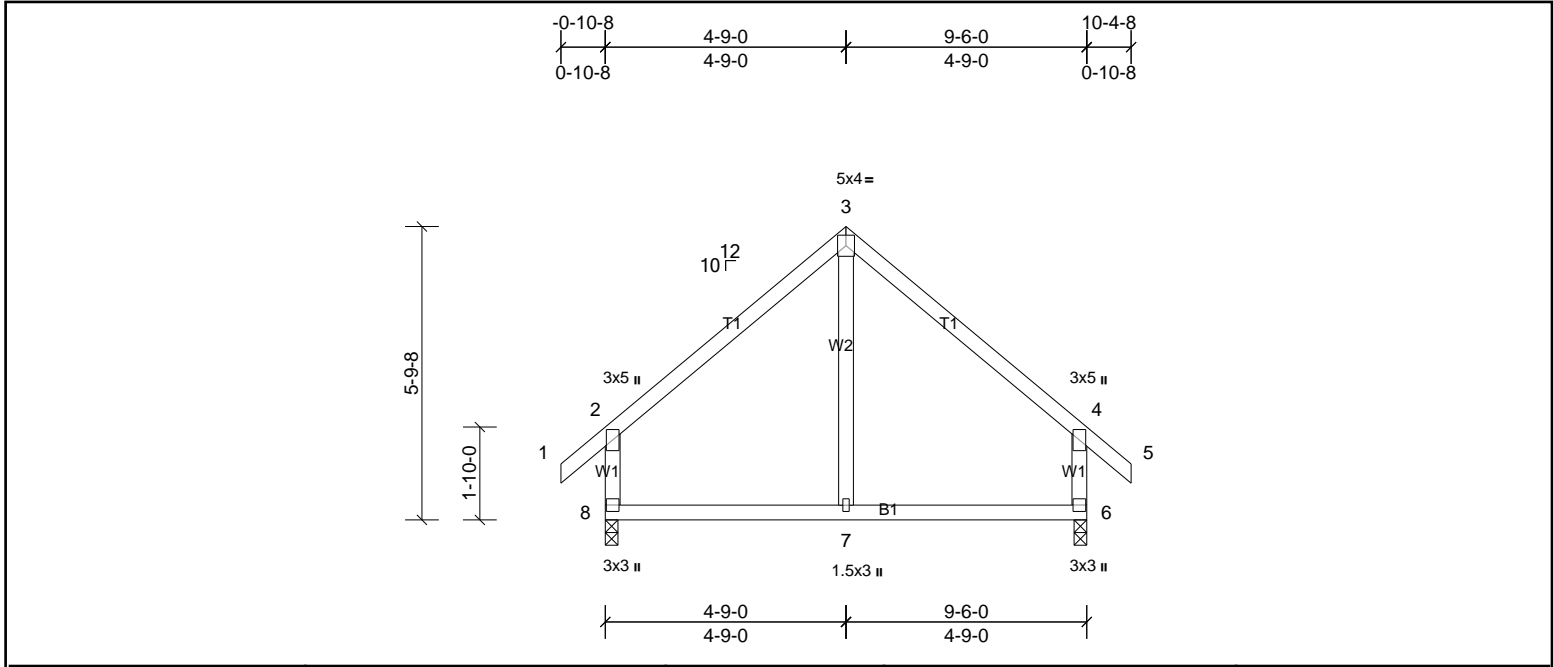

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	0.04	7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.06	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 48 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS	(lb/size)	6=430/0-3-0, (min. 0-1-8), 8=430/0-3-0, (min. 0-1-8)
	Max Horiz	8=182 (LC 9)
	Max Uplift	6=57 (LC 11), 8=57 (LC 10)

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-303/291, 3-4=-303/291, 2-8=-357/298, 4-6=-357/298

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 8 and 57 lb uplift at joint 6.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss C1G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:20

Page: 1

ID:JRC_Nei6qMytVp9lNwLwFvykyd0-45zVwTWtYDmX8yd6L1O7ZE22oZNPehJBAVazKyk0H9

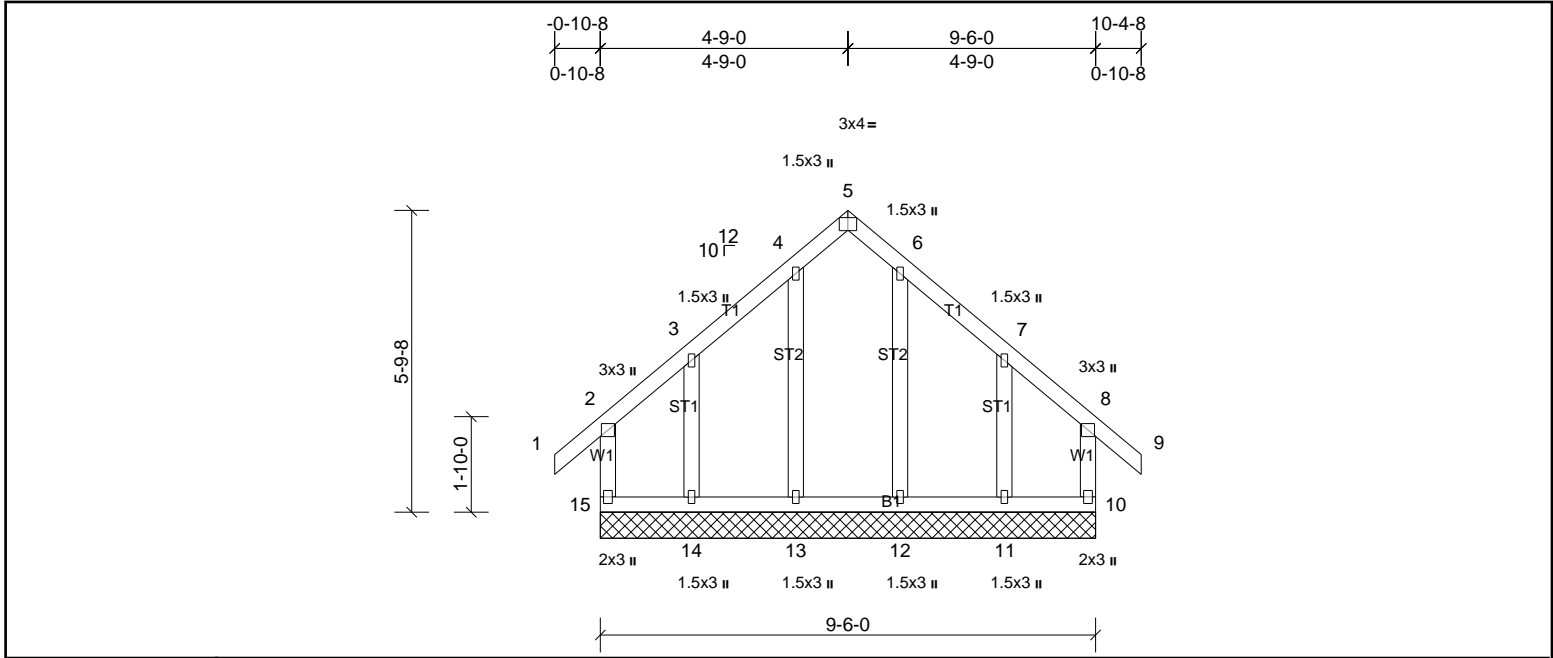


Plate Offsets (X, Y): [5:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00	10	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 62 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		

REACTIONS All bearings 9-6-0.
 (lb) - Max Horiz 15=182 (LC 9)
 Max Uplift All uplift 100 (lb) or less at joint(s) 10 except 11=170 (LC 11), 14=170 (LC 10), 15=103 (LC 6)
 Max Grav All reactions 250 (lb) or less at joint(s) 10, 11, 12, 13, 14, 15

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 15=102, 14=170, 11=169.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss V1G	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:20

Page: 1

ID:kAEQe1_FRSSqo?f1YzNtGykyqr-45zVwTWtYDmX8yd6L1O7ZE23AZNvEf6JBAVazKyk0H9

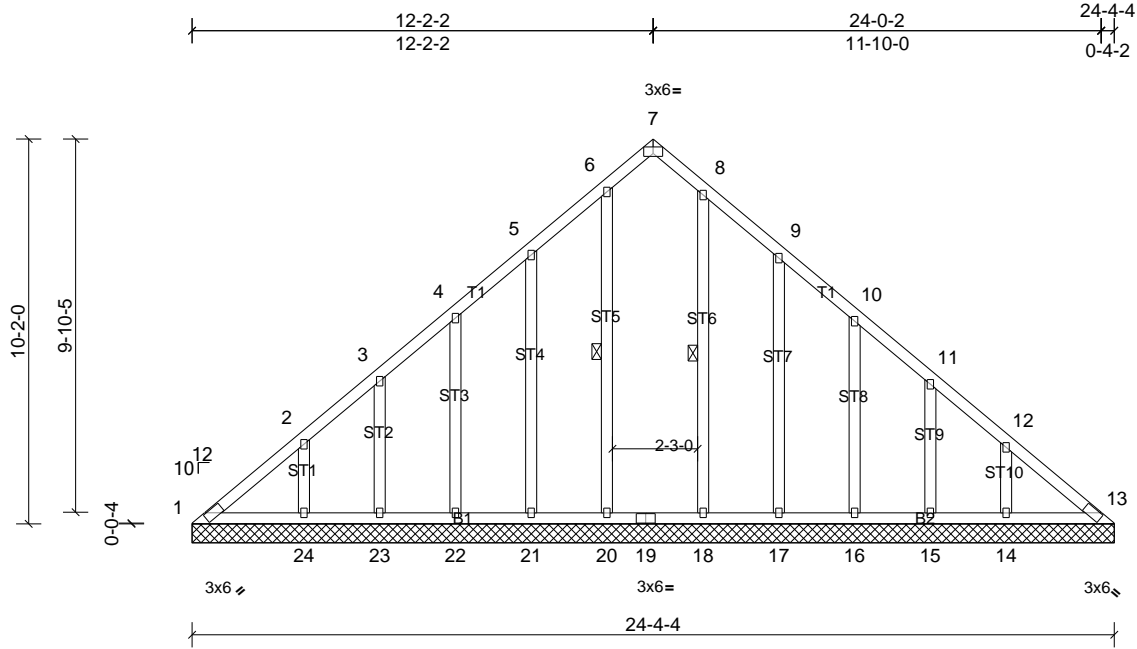


Plate Offsets (X, Y): [7:0-3:0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.16	Horiz(TL)	0.01	13	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 160 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	WEBS 1 Row at midpt 6-20, 8-18

REACTIONS
All bearings 24-4-4.
(lb) - Max Horiz 1=257 (LC 7)
Max Uplift All uplift 100 (lb) or less at joint(s) 1, 13, 15, 16, 20, 22, 23, 24 except 14=-116 (LC 11), 17=-116 (LC 11), 21=-112 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1, 13, 14, 15, 16, 17, 18, 20, 21, 22, 23 except 24=267 (LC 17)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-356/246, 2-3=-265/161, 12-13=-339/250
BOT CHORD 1-24=-212/299, 23-24=-212/299, 22-23=-212/299, 21-22=-212/299, 20-21=-212/299, 19-20=-212/299, 18-19=-212/299, 17-18=-212/299, 16-17=-212/299, 15-16=-212/299, 14-15=-212/299, 13-14=-212/299

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only.
 - All plates are 2x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 13, 20, 22, 23, 24, 16, 15 except (jt=lb) 21=112, 17=115, 14=116.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss V2	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:20

Page: 1

ID:CMoorN?c0laISyZrbGUcUykyqq-45zVwTwTYDmX8y6L107ZE21WZMbEfmJBAVazKyk0H9

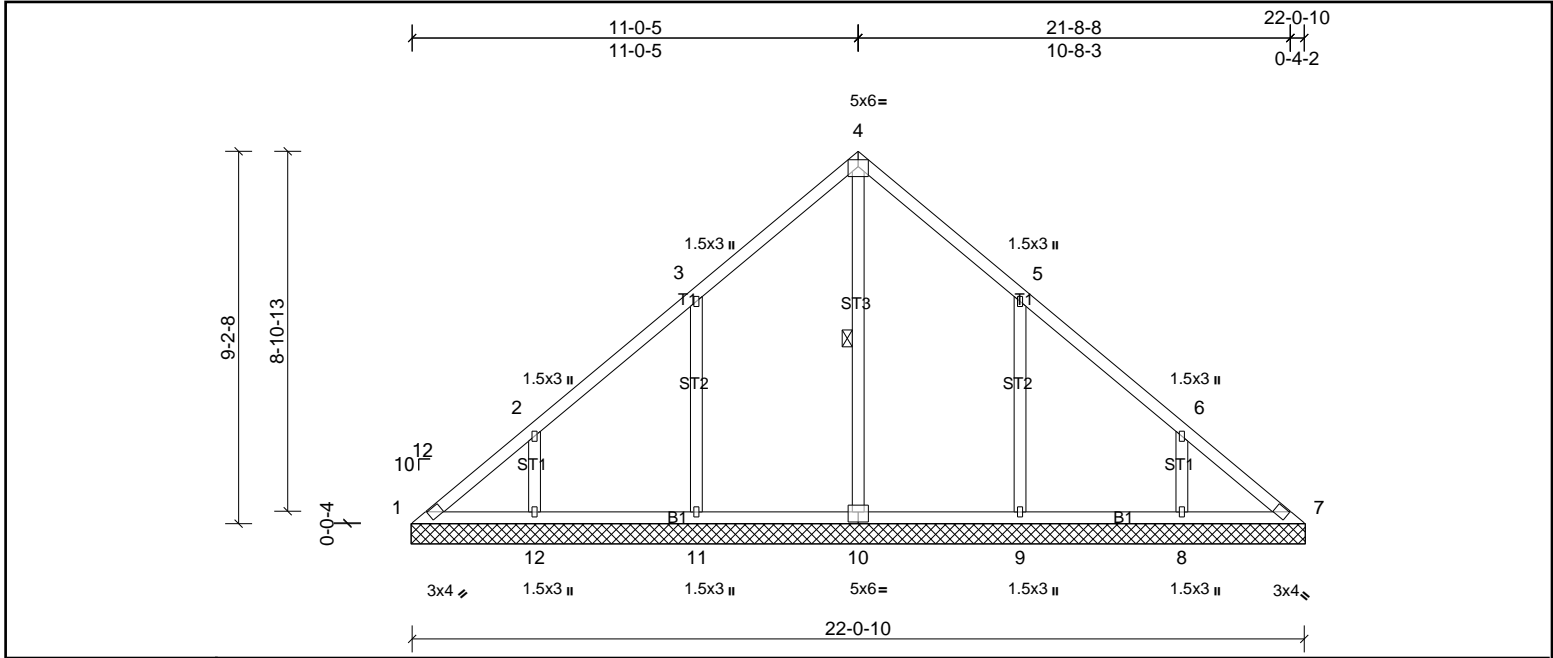


Plate Offsets (X, Y): [10:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horiz(TL)	0.01	7	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 109 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS	2x4 SP No.3	WEBS	1 Row at midpt 4-10

REACTIONS
All bearings 22-1-3.
(lb) - Max Horiz 1=-233 (LC 6)
Max Uplift All uplift 100 (lb) or less at joint(s) 1, 7 except 8=-141 (LC 11), 9=-201 (LC 11), 11=-200 (LC 10), 12=-146 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1, 7 except 8=323 (LC 18), 9=438 (LC 18), 10=443 (LC 20), 11=438 (LC 17), 12=328 (LC 17)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-11=-318/249, 2-12=-258/187, 5-9=-318/249, 6-8=-258/185

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7 except (jt=lb) 11=200, 12=145, 9=200, 8=141.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 7.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss V3	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:20

Page: 1

ID:CMoorN?c0lalSyZrbGUcQUykyqq-45zVwTwTYDmX8ydl6L1O7ZE21SZMbEeRJBAVazKyk0H9

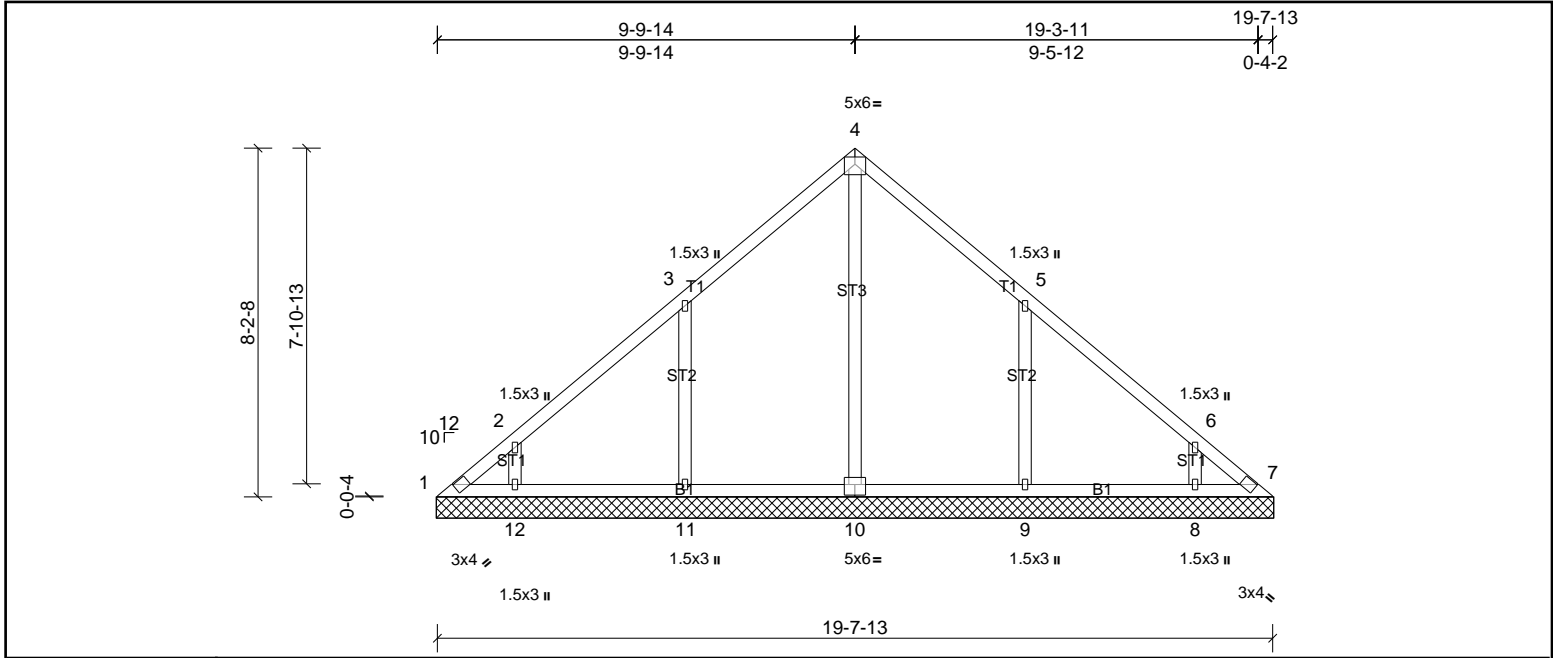


Plate Offsets (X, Y): [10-0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.21	Horiz(TL)	0.01	7	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 93 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	
REACTIONS	
All bearings 19-8-6.	
(lb) - Max Horiz 1=207 (LC 7)	
Max Uplift All uplift 100 (lb) or less at joint(s) 1, 7 except 8=-142 (LC 11), 9=-201 (LC 11), 11=-203 (LC 10), 12=-116 (LC 10)	
Max Grav All reactions 250 (lb) or less at joint(s) 1, 7 except 8=275 (LC 18), 9=446 (LC 18), 10=390 (LC 20), 11=446 (LC 17), 12=282 (LC 17)	
FORCES	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
WEBS 3-11=-321/250, 5-9=-320/249	

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 1.5x3 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7 except (jt=lb) 11=203, 12=115, 9=200, 8=141.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V4	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:21

Page: 1

ID:CMoorN?c0lalSyZrbGUcQUykyqq-YHXi7ox5JXuOm6ClvM6SbB2zhjz5KTQqE7Vmyk0H8

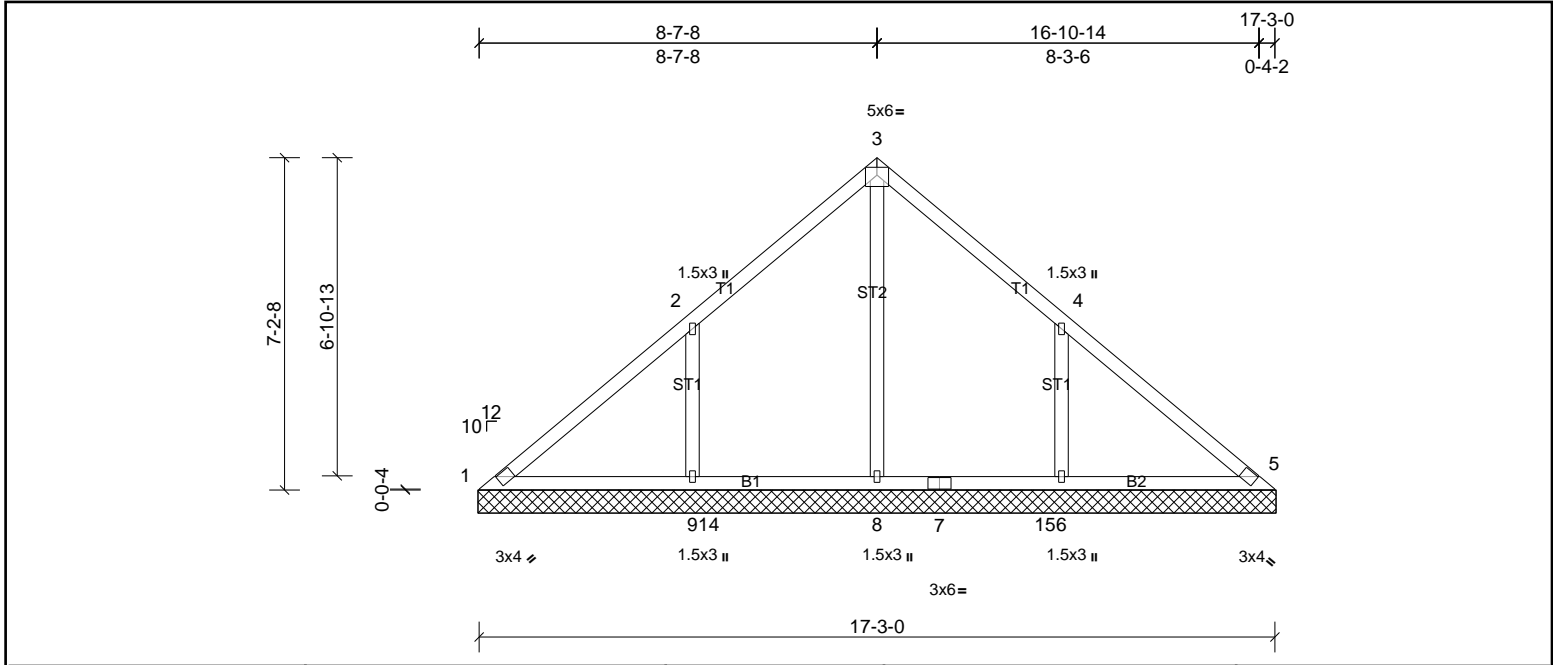

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.23	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 77 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS
All bearings 17-3-10.
(lb) - Max Horiz 1=181 (LC 7)
Max Uplift All uplift 100 (lb) or less at joint(s) 1 except 6=-225 (LC 11), 9=-222 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1, 5 except 6=485 (LC 18), 8=445 (LC 17), 9=502 (LC 17)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS
3-8=-253/0, 2-9=-344/253, 4-6=-340/254

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=222, 6=225.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V5	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:21

Page: 1

ID:gZMA3j0En3i946828z?ryhykyqp-YHXi7ox5JXuOm6ClivM6SbC6ziNz6STQqE7Vmyk0H8

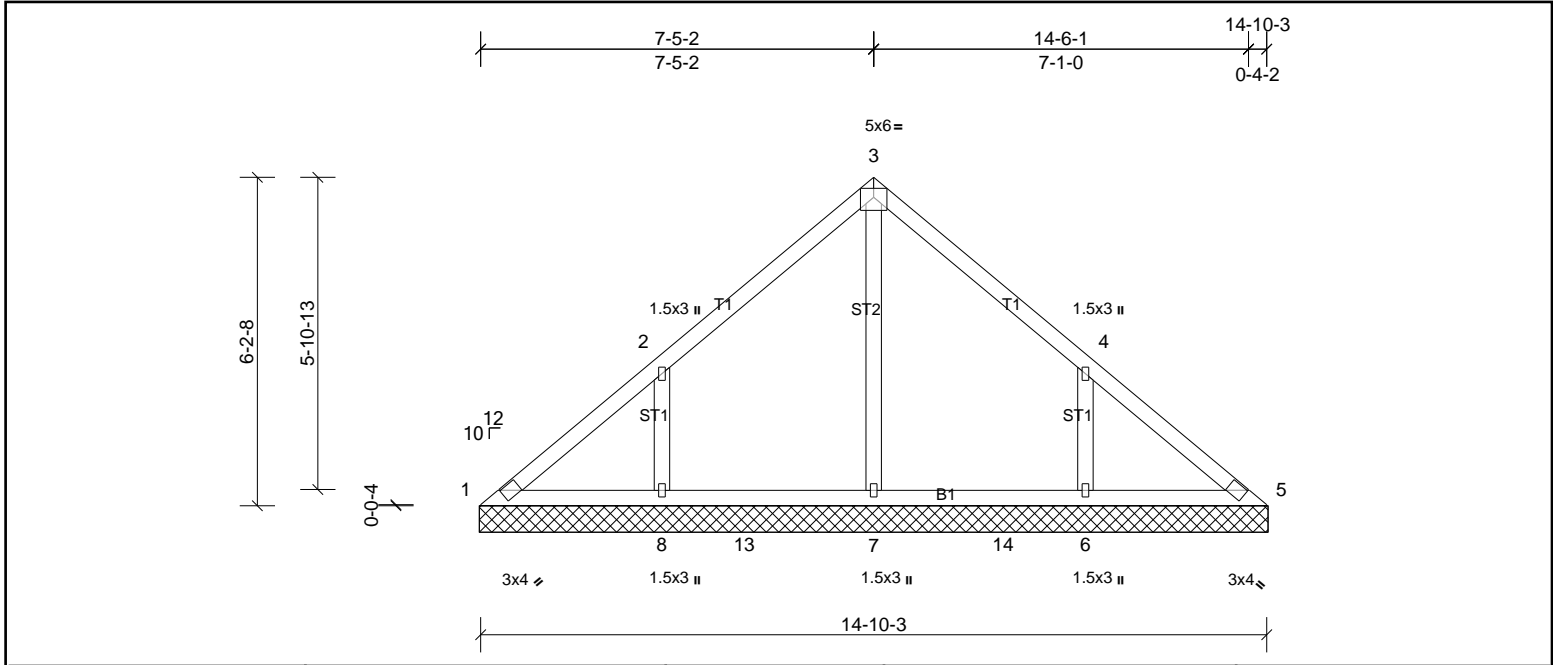

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.16	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 65 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS	2x4 SP No.3		

REACTIONS	
	All bearings 14-10-13.
(lb) - Max Horiz	1=-156 (LC 6)
Max Uplift	All uplift 100 (lb) or less at joint(s) 1 except 6=-185 (LC 11), 8=-188 (LC 10)
Max Grav	All reactions 250 (lb) or less at joint(s) 1, 5 except 6=400 (LC 18), 7=409 (LC 17), 8=403 (LC 17)

FORCES	
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS	
	2-8=-301/224, 4-6=-301/223

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=188, 6=185.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V6	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:21

Page: 1

ID:gZMA3j0En3i946828z?ryhykyqp-YHXt7ox5JXuOm6ClvM6SbDOzjtz7hTQqE7Vmyk0H8

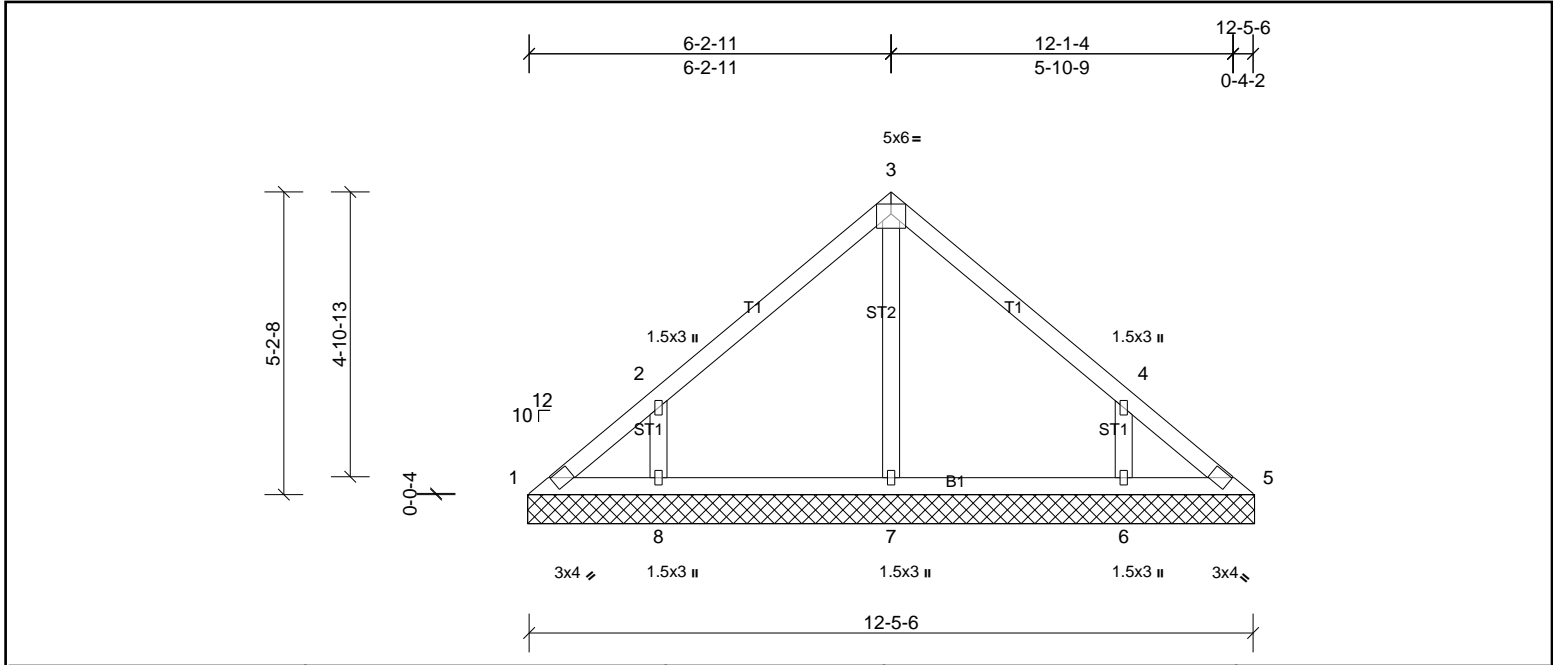

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 52 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS
All bearings 12-6-0.
(lb) - Max Horiz 1=-130 (LC 6)
Max Uplift All uplift 100 (lb) or less at joint(s) 1, 5 except 6=-161 (LC 11), 8=-164 (LC 10)
Max Grav All reactions 250 (lb) or less at joint(s) 1, 5, 7 except 6=334 (LC 18), 8=338 (LC 17)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-287/218, 4-6=-287/217

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=164, 6=160.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V7	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:21

Page: 1

ID:gZMA3j0En3i946828z?ryhykyqp-YHXt7ox5JXuOm6ClvlvM6SbBhzgXz5tTQqE7Vmyk0H8

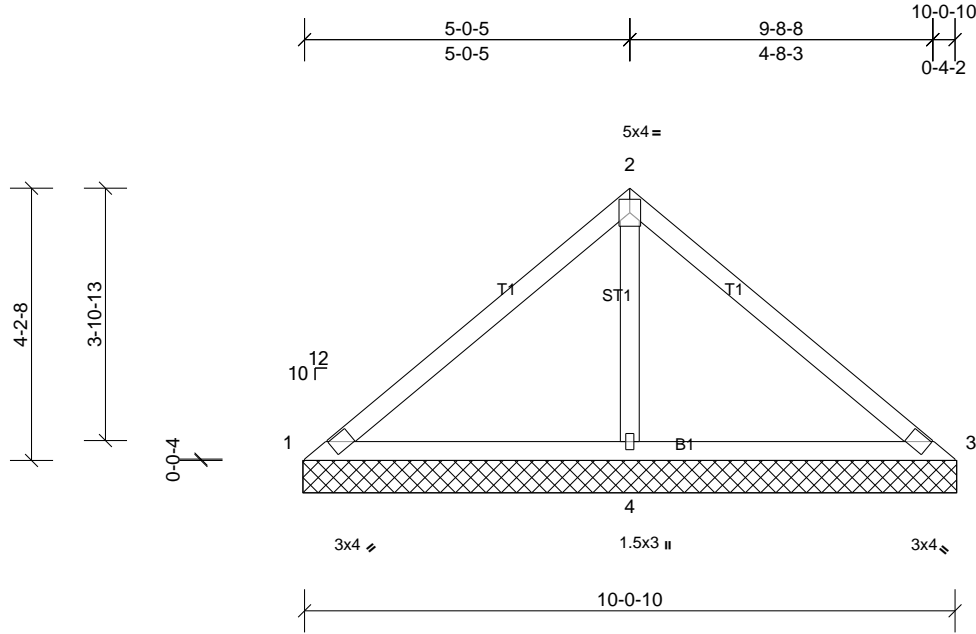

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.19	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 38 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	(lb/size)	1=19/10-1-3, (min. 0-1-8), 3=19/10-1-3, (min. 0-1-8), 4=770/10-1-3, (min. 0-1-8)
Max Horiz	1=104 (LC 6)	
Max Uplift	1=37 (LC 22), 3=37 (LC 21), 4=156 (LC 10)	
Max Grav	1=64 (LC 21), 3=64 (LC 22), 4=770 (LC 1)	

FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-119/339, 2-3=-119/339
BOT CHORD	1-4=-282/172, 3-4=-282/172
WEBS	2-4=-595/255

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 37 lb uplift at joint 3 and 156 lb uplift at joint 4.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V8	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:22

Page: 1

ID:gZMA3j0En3i946828z?ryhykyqp-YHXi7ox5JXuOm6ClivM6SbDuziEz7UTQqE7Vmyk0H8

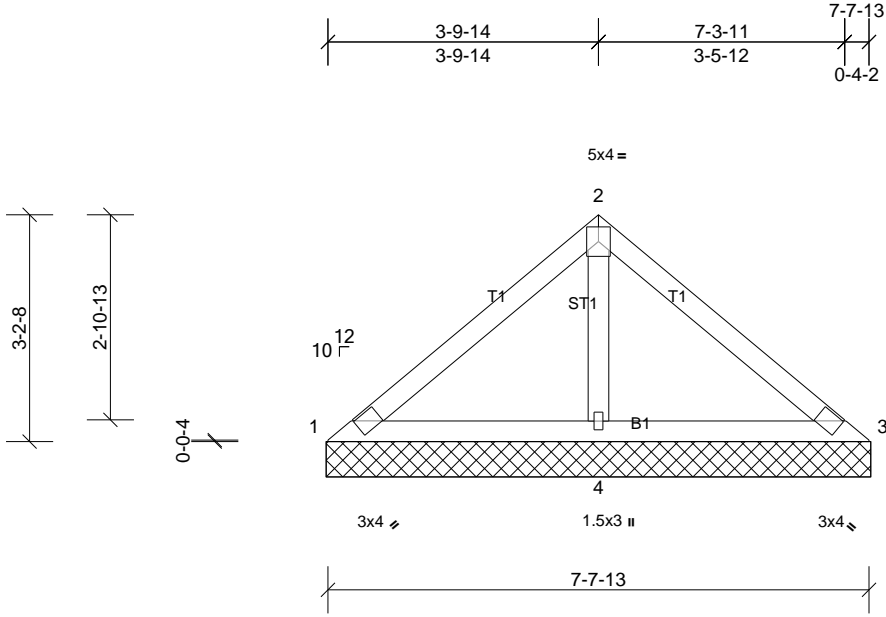

Loading	(psf)	Spacing	2-0-0	CSI	DEFLL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 29 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 7-7-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (lb/size) 1=47/7-8-6, (min. 0-1-8), 3=47/7-8-6, (min. 0-1-8), 4=522/7-8-6, (min. 0-1-8)
Max Horiz 1=-78 (LC 6)
Max Uplift 1=-4 (LC 22), 3=-7 (LC 6), 4=-94 (LC 10)
Max Grav 1=73 (LC 21), 3=73 (LC 22), 4=522 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-382/158

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 1, 7 lb uplift at joint 3 and 94 lb uplift at joint 4.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V9	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	-------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:22

Page: 1

ID:F4xAReSZqc0uiSrKX0vcpGykyYA-0U5GK8yj4r0FNGnUSSRbef7QAM3libYcfU_g1Cyk0H7

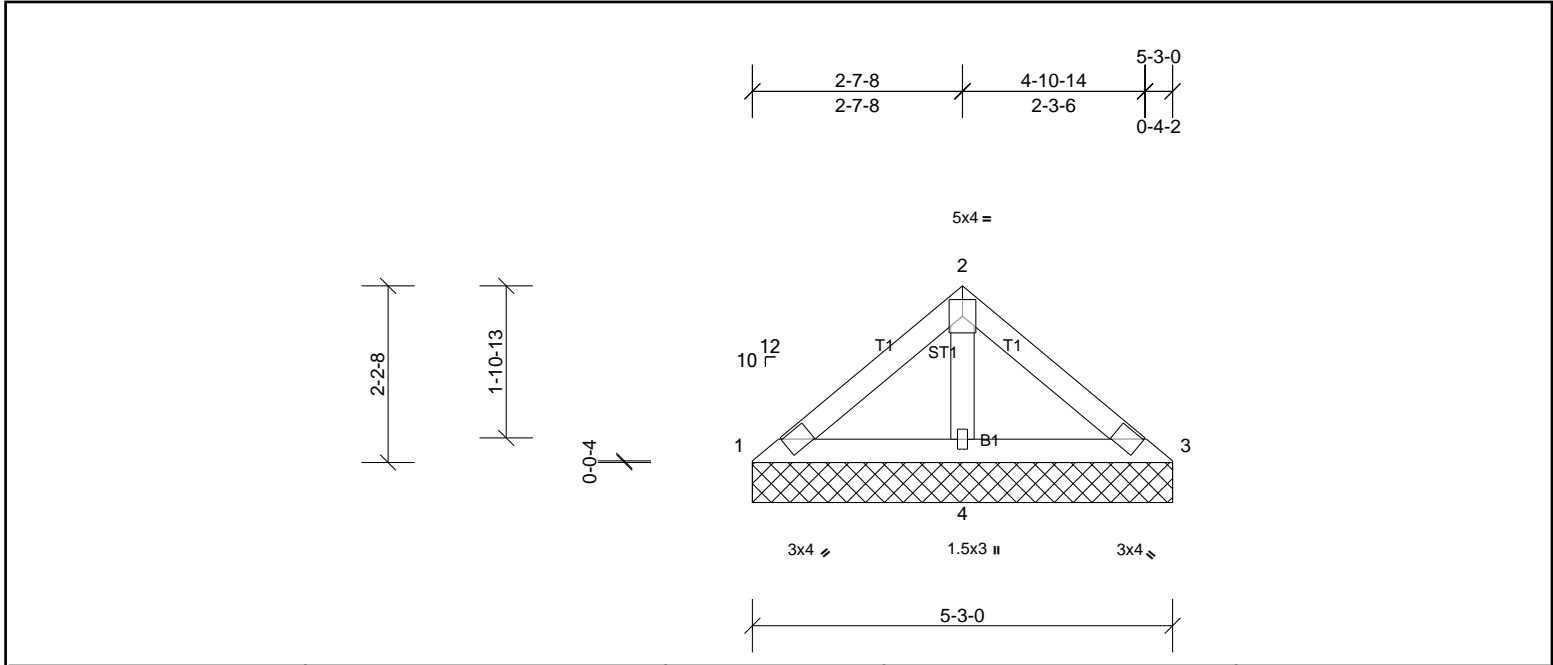

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MSH							Weight: 19 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS	(lb/size)	1=56/5-3-0, (min. 0-1-8), 3=56/5-3-0, (min. 0-1-8), 4=309/5-3-0, (min. 0-1-8)
Max Horiz	1=52 (LC 6)	
Max Uplift	1=-1 (LC 11), 3=-11 (LC 11), 4=-47 (LC 10)	
Max Grav	1=67 (LC 21), 3=67 (LC 22), 4=309 (LC 1)	

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1 lb uplift at joint 1, 11 lb uplift at joint 3 and 47 lb uplift at joint 4.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.



Job 72427142	Truss V10	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:22

Page: 1

ID:ffdJ4gUS7XOTZvavC9SJRvvykyY7-0U5GK8yj4r0FNGnUSSRbef7QAM4Cib9cfU_g1Cyk0H7

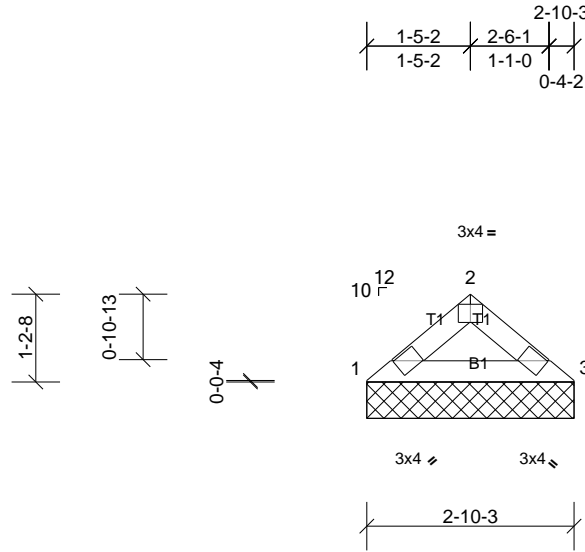


Plate Offsets (X, Y): [2:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MP							Weight: 8 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

REACTIONS
(lb/size) 1=114/2-10-3, (min. 0-1-8), 3=114/2-10-3, (min. 0-1-8)
Max Horiz 1=26 (LC 7)
Max Uplift 1=14 (LC 10), 3=14 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-00-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 1 and 14 lb uplift at joint 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V11	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:22

Page: 1

ID:oBs5kzCDH4hUx5IkO5NINzykyx0-0U5GK8yj4r0FNGnUSSRbef7LTM2ViZgcfU_g1Cyk0H7

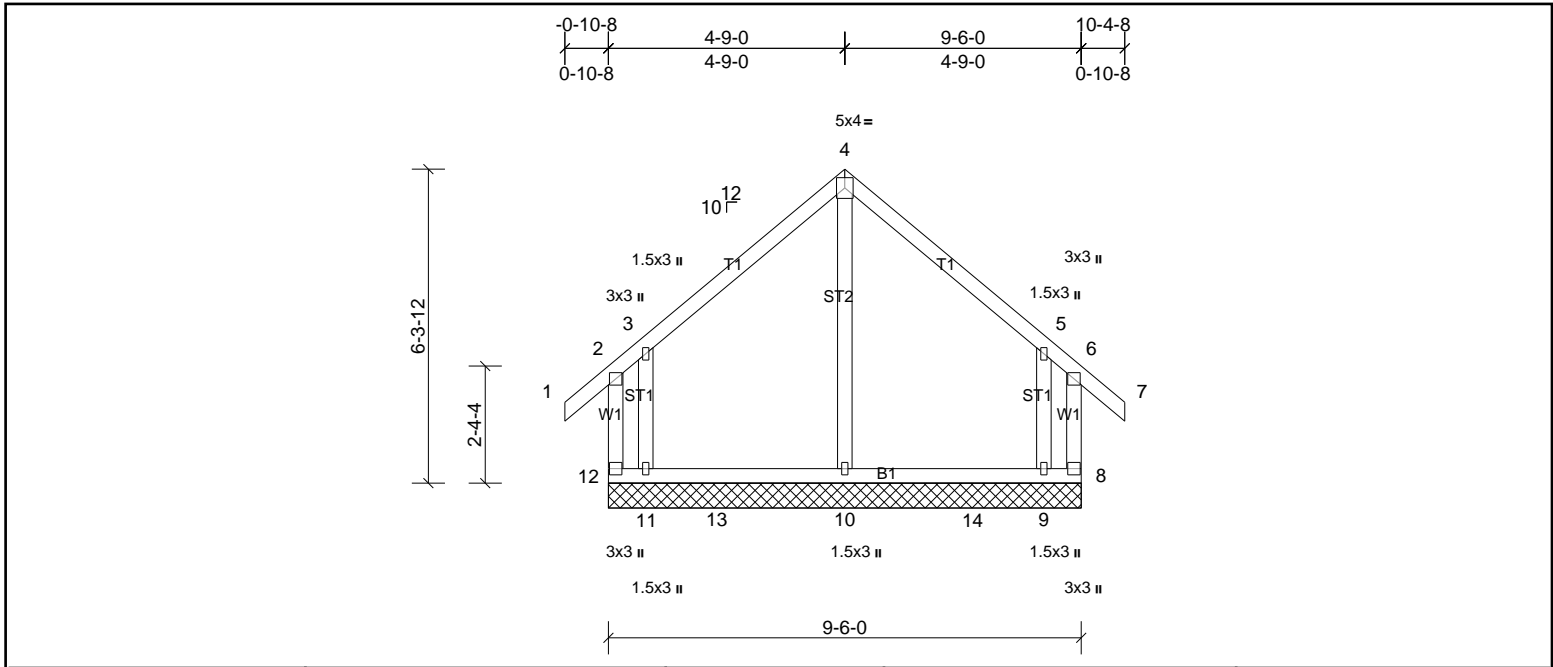

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.16	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.16	Horz(CT)	0.00	8	n/a	n/a		
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR							Weight: 58 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS	FORCES
All bearings 9-6-0.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
(lb) - Max Horiz 12=202 (LC 9)	
Max Uplift All uplift 100 (lb) or less at joint(s) except 8=397 (LC 9), 9=347 (LC 6), 11=354 (LC 7), 12=406 (LC 8)	
Max Grav All reactions 250 (lb) or less at joint(s) except 8=322 (LC 6), 9=636 (LC 18), 10=398 (LC 20), 11=641 (LC 17), 12=330 (LC 7)	

WEBS
3-11=-382/283, 5-9=-379/282

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 406 lb uplift at joint 12, 397 lb uplift at joint 8, 354 lb uplift at joint 11 and 347 lb uplift at joint 9.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.




Job 72427142	Truss V12	Truss Type Truss	Qty 1	Ply 1	PBS\CLAYTON FRENCH COUNTRY RH ROOF Job Reference (optional)
-----------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Micah Clayton

Run: 8.73 S Jul 24 2024 Print: 8.730 S Jul 24 2024 MiTek Industries, Inc. Mon Aug 26 10:48:22

Page: 1

ID:cA0ySWegu8JxL7Mlmo2G5Zykyz2-0U5GK8yj4r0FNgnUSSRbef7NzM3HiaScfU_g1Cyk0H7

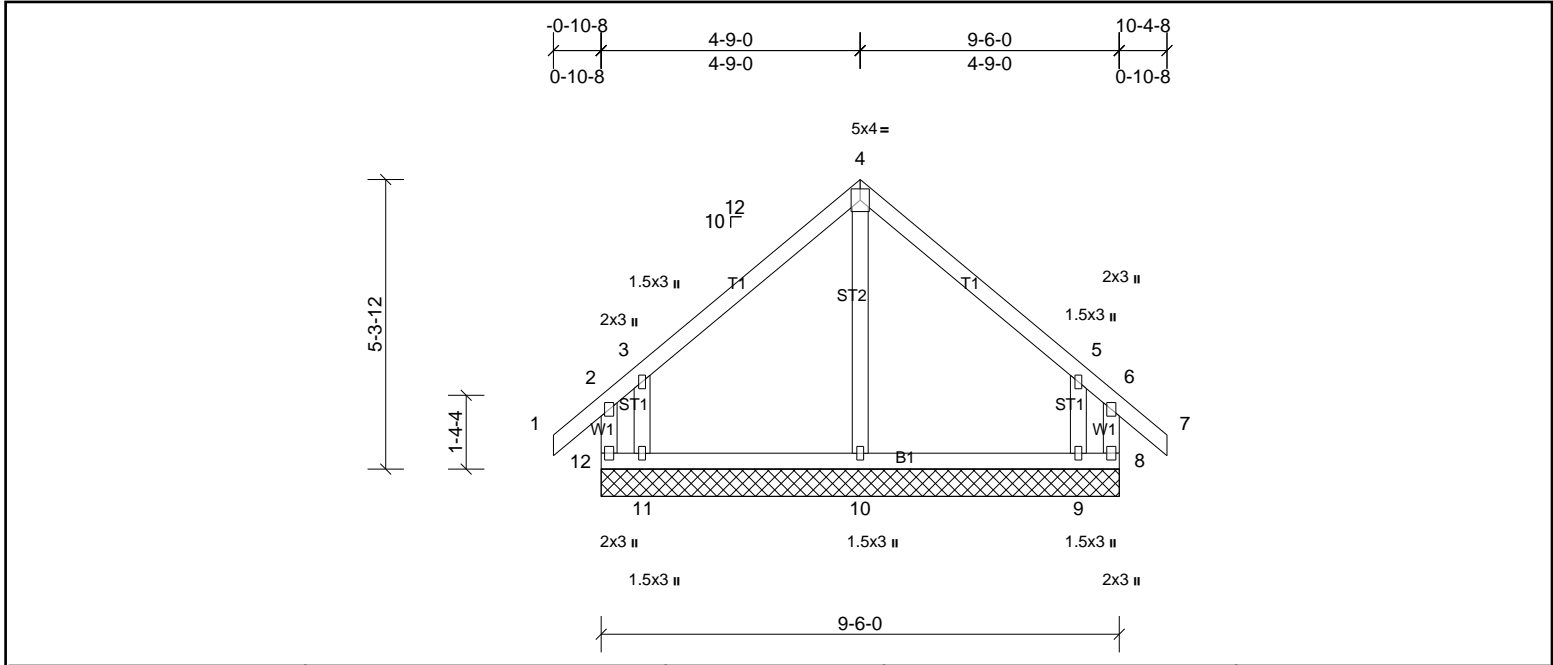

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a	-	n/a	999	244/190
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	n/a	-	n/a	999	
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.00	8	n/a	n/a	
BCDL	10.0	Code	IRC2015/TPI2014	Matrix-MR						Weight: 51 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS
All bearings 9-6-0.
(lb) - Max Horiz 12=164 (LC 9)
Max Uplift All uplift 100 (lb) or less at joint(s) except 8=242 (LC 9), 9=276 (LC 11), 11=280 (LC 10), 12=263 (LC 8)
Max Grav All reactions 250 (lb) or less at joint(s) 8, 12 except 9=465 (LC 18), 10=309 (LC 1), 11=477 (LC 17)

FORCES
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-11=-373/288, 5-9=-373/286

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCCL=6.0psf; h=35ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 262 lb uplift at joint 12, 241 lb uplift at joint 8, 279 lb uplift at joint 11 and 275 lb uplift at joint 9.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFPI plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

