

**PROPERTY OF TPDCLLC**

DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE ARE AND SHOULD NOT BE USED FOR DESIGNER WHETHER MADE FOR EXECUTED OR NOT. THE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY THE OWNER ON OTHER PROJECTS FOR ADDITIONS TO THIS PROJECT OR FOR COMPLETION OF THIS PROJECT BY OTHERS EXCEPT BY AGREEMENT IN WRITING WITH THE APPROPRIATE COMPENSATION TO THE DESIGNER.

IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR BUILDER TO CONFORM TO ALL STANDARDS, PROVISIONS, REQUIREMENTS AND USES OF MATERIALS IN BUILDING CODES ANY OTHER LOCAL AGENCIES AND IN ACCORDANCE WITH GOOD ENGINEERING AND CONSTRUCTION PRACTICES.

I CERTIFY THAT THE CONSTRUCTION EXHIBITS FOR IDENTIFICATION OF THE PROPERTY BY HOUSE TYPE, LOT, LOCK, SUBDIVISION NAME, AND SO ON) MEET ALL LOCAL CODE REQUIREMENTS AND ARE SUBMITTED IN COMPLIANCE WITH BOTH SH AND VA MINIMUM PROPERTY REQUIREMENTS. ALL BUILDING STANDARDS AS SET FORTH BY THE INTERNATIONAL CODE COUNCIL (ICC) AND FEDERAL SAFE DRINKING WATER PLUMBING STANDARD.

Charles Temm

The Lauren III

Weaver Development Companies

Cover Sheet

Climate Zone	Zone 3	Zone 4	Zone 5
Fenstration U-Factor	0.35	0.35	0.35
Skylight U-Factor	0.65	0.60	0.60
Glazed Fenstration SHGC	0.30	0.30	0.30
Ceiling R-Value	30	38	38
Wall R-Value	15	15	19
Floor R-Value	19	19	30
*Basement Wall R-Value	10/13	10/13	10/13
**Slab R-Value	0	10	10
**Crawl Space Wall R-Value	5/13	10/13	10/13

\*10/13 means R-10 sheathing insulation or R-13 cavity insulation  
 \*\*Insulation depth with monolithic slab 18" or from inspection gap to bottom of footing; insulation depth with stem wall slab 24" or to bottom of foundation wall.

Design Pressure for Doors and Window Positive and Negative in PSF		
	Mean Roof Height (FT)	
Velocity (MPH)	15	25
90	15	17
100	20	23
120	25	29
Assumed Mean Roof Height 25'-9"		

Designed for windspeed of 110 MPH,  
 3 Second Gust (95 Fastest Mile) Exposure "B"

**Air Leakage**
**Section N1102.4**

**N1102.4.1 Building Thermal Envelope.** The building thermal envelope shall be durably sealed with an air barrier system to limit infiltration. The sealing methods between dissimilar materials shall allow for differential expansion and contraction. For all homes, where present, the following shall be caulked, gasketed, weather stripped or otherwise sealed with an air barrier material or solid material consistent with Appendix E-2.4 of this code:

- Blocking and sealing floor/ceiling systems and under knee walls open to unconditioned or exterior areas.
- Capping and sealing shafts or chases, including flue shafts.
- Capping and sealing soffit or dropped ceiling areas.

**General Notes:**

- Design Loads: Local
- Materials
  - Brick Face Brick Standard: ASTM C216-84, Grade SW. Brick type and color to be chosen by owner.
  - Mortar ASTM C270, Type S. Mortar style and color consult owner. Do not use calcium chloride in mortar.
  - Brick Ties ASTM A62 steel wire, hot dip galvanized after fabrication to ASTM A 153/A 153M, Class B
  - Insulation ASTM C685; pre-formed glass fiber batt (R-19)
  - Wood Framing No. 2 Southern Pine
  - Waterproofing #15 asphalt felt
  - Roof Shingles Match existing
  - Masonry
    - Install mortar in accordance with premix mortar instructions or in accordance with ASTM C780.
    - Clean mortar off exposed finished surfaces immediately following placement.
    - Conform to the applicable code requirements for masonry construction and guidelines outlined by the Brick Institute of America.
    - Provide brick ties.
    - Cut masonry units with motor-driven saws to provide clean, sharp, squared edges.
    - Prepare masonry surfaces so they are smooth and free from projections that could puncture flashing. Place through-wall flashing on sloping bed of mortar and cover with mortar. Seal penetrations in flashing with adhesive/sealant/tape as recommended by flashing manufacturer before covering with mortar.
    - Install weep holes in the head joints in exterior wythes of the first course of masonry immediately above embedded flashings as follows:
      - Keep head joints free and clear of mortar.
      - Space weep holes 24 inches o.c.
    - After wall construction is complete, clean brick with a non-acidic solution recommended by masonry unit manufacturer.
  - Insulation
    - Verify that adjacent materials and insulation materials are dry.
    - Install insulation per manufacturer's instructions.


- Wood Framing
  - All field nailing will comply with the North Carolina State Building Code Fastening Schedule Table 2304.9.1 unless noted otherwise. All nails are to be common nails.
  - Miscellaneous framing not shown on the structural drawings may be required in some areas. Contractor will provide all framing required to complete the project.
- Exterior Wall Sheathing:
  - Sheathing will be 1/2" plywood APA rated sheathing with an exterior exposure 1 durability rating.
  - Place long dimension of sheathing perpendicular to studs in a staggered arrangement. Fasten to studs with 10d common nails 6" o/c at all panel edges and 12" o/c at intermediate supports. Block all unsupported edges.
  - Leave 1/4" space at all panel edge joints and 1/8" space at all panel end joints unless otherwise recommended by manufacturer.
- Plywood Roof Sheathing
  - Roof sheathing is to be APA rated with an exterior exposure 1 rating and a panel span rating of 32/16. Thickness of sheathing is to match existing roof sheathing thickness.
  - Place long dimension of sheathing perpendicular to outriggers. Remove sections of existing sheathing and stagger every other new plywood sheet back to the 2nd interior roof truss. Fasten to trusses and outriggers with 10d common nails. 6" o/c at all panel edges and 12" o/c at intermediate supports. Block all unsupported edges.
  - Leave 1/4" space at all panel edge joints and 1/8" space at all panel end joints unless otherwise recommended by the manufacturer.
- Miscellaneous
  - The contractor will be responsible for properly guying and bracing the structure to resist live, dead, wind and construction loads during construction.
  - Provide all existing building dimensions, elevations and details with the field conditions.
  - Tape seal tears or cuts in vapor retarder.

Square Footage	
<b>Heated</b>	
First Floor	2175 Sq Ft
Total	
	2175 Sq Ft
<b>Unheated</b>	
Garage	640 Sq Ft
Third Garage	290 Sq Ft
Front Porch	347 Sq Ft
Total	
	1277 Sq Ft

Symbols Legend:	
STONE CLADDING	WOOD
CONCRETE BLOCK	PLYWOOD
CONCRETE	WOOD ROUGH FRAMING
ARCHITECTURAL PRECAST CONCRETE	SLAB
PORELL FILL	BATT INSULATION
EARTH	RIGID INSULATION
METAL	FIRE SAFING
GYPSUM WALLBOARD	IMPREGNATED FOAM SEALANT
GWB SOFFIT OR CEILING	SEALANT AND BACKER ROD



② 3D View 7

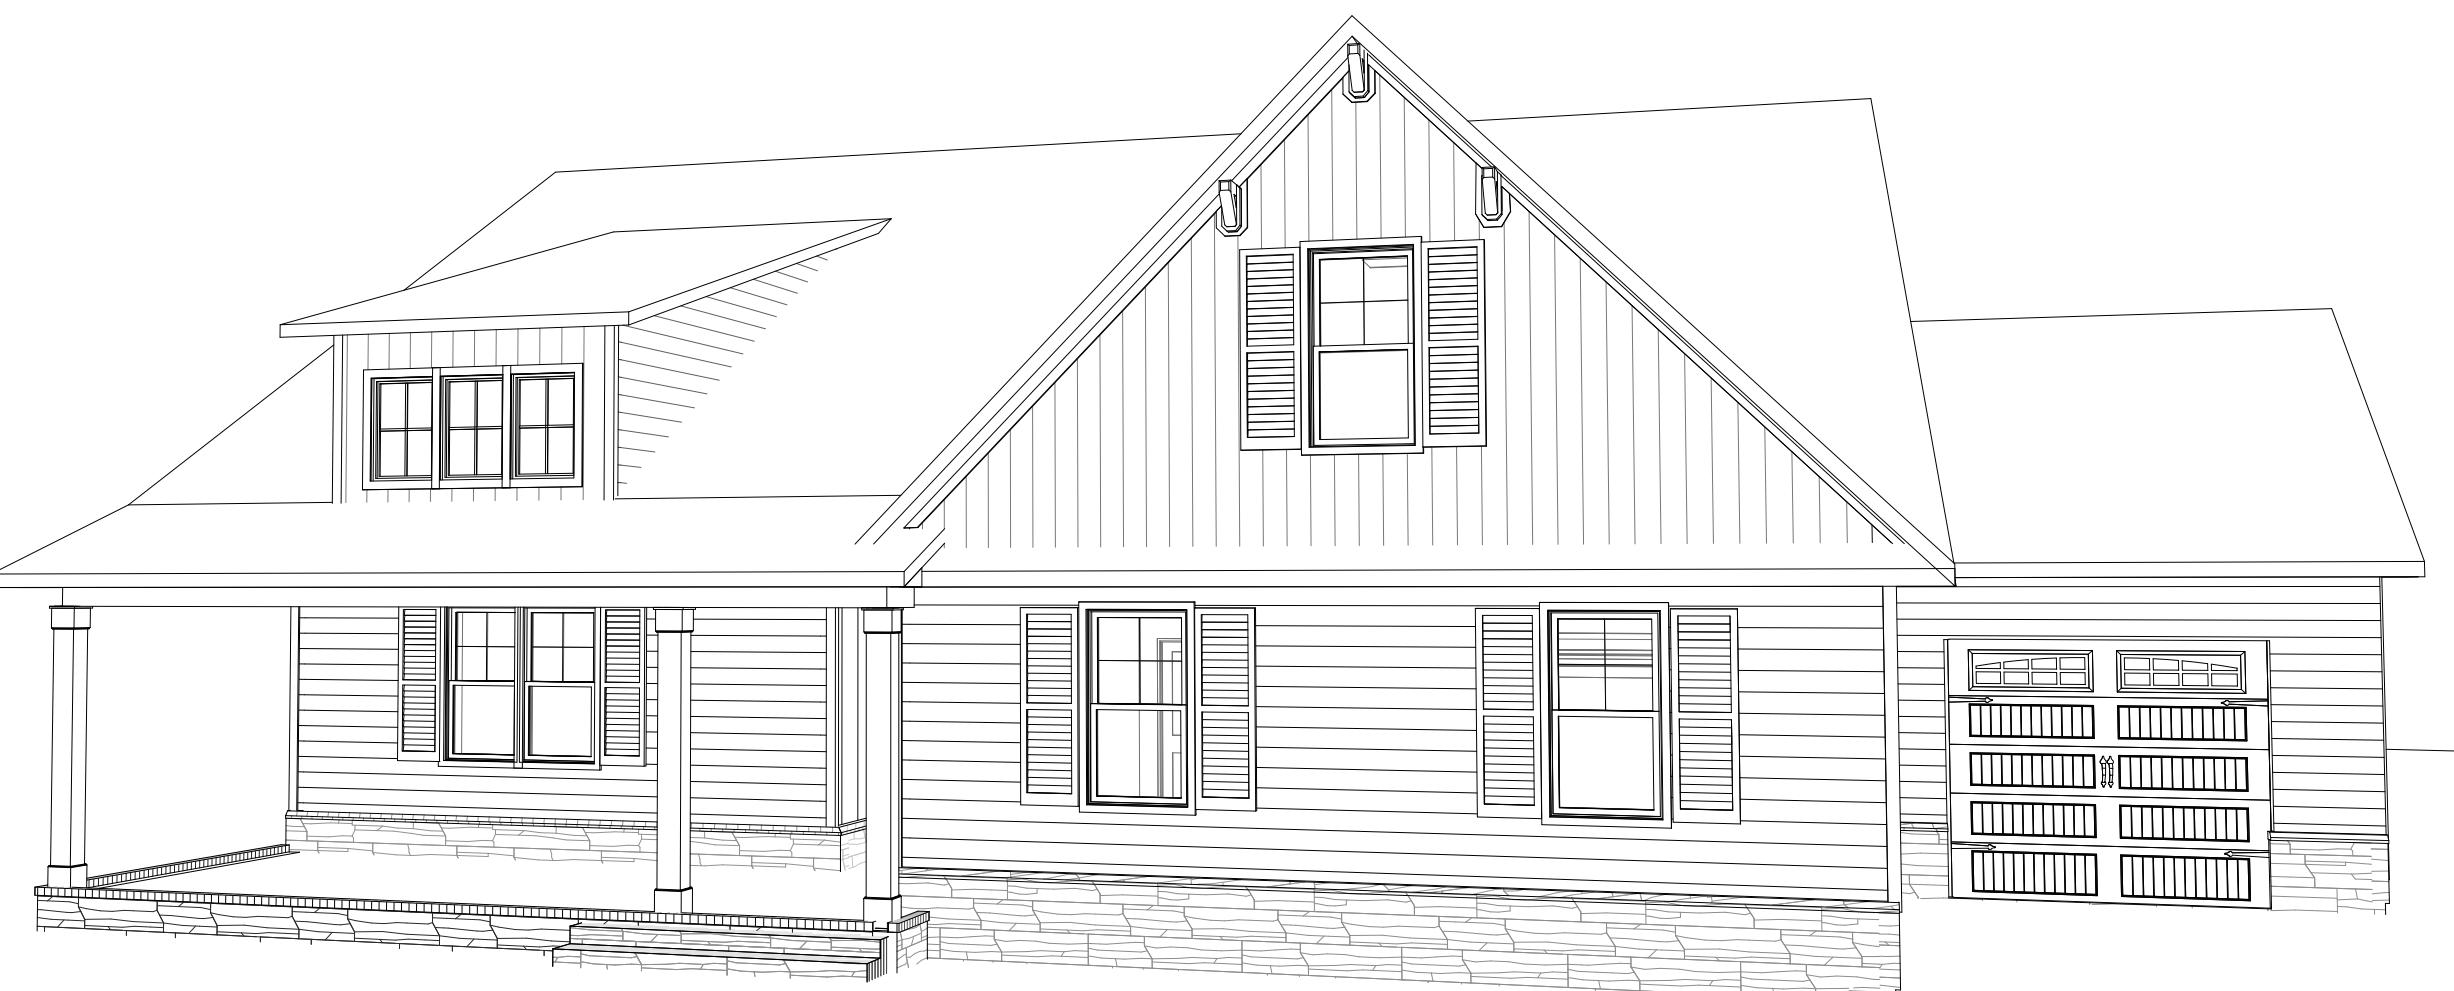

① 3D View - Front

Revisions:

SCALE:

DATE:

October 31, 2025

Project number:

0602202500021


Drawn by:

DF

Checked by:

TP

C

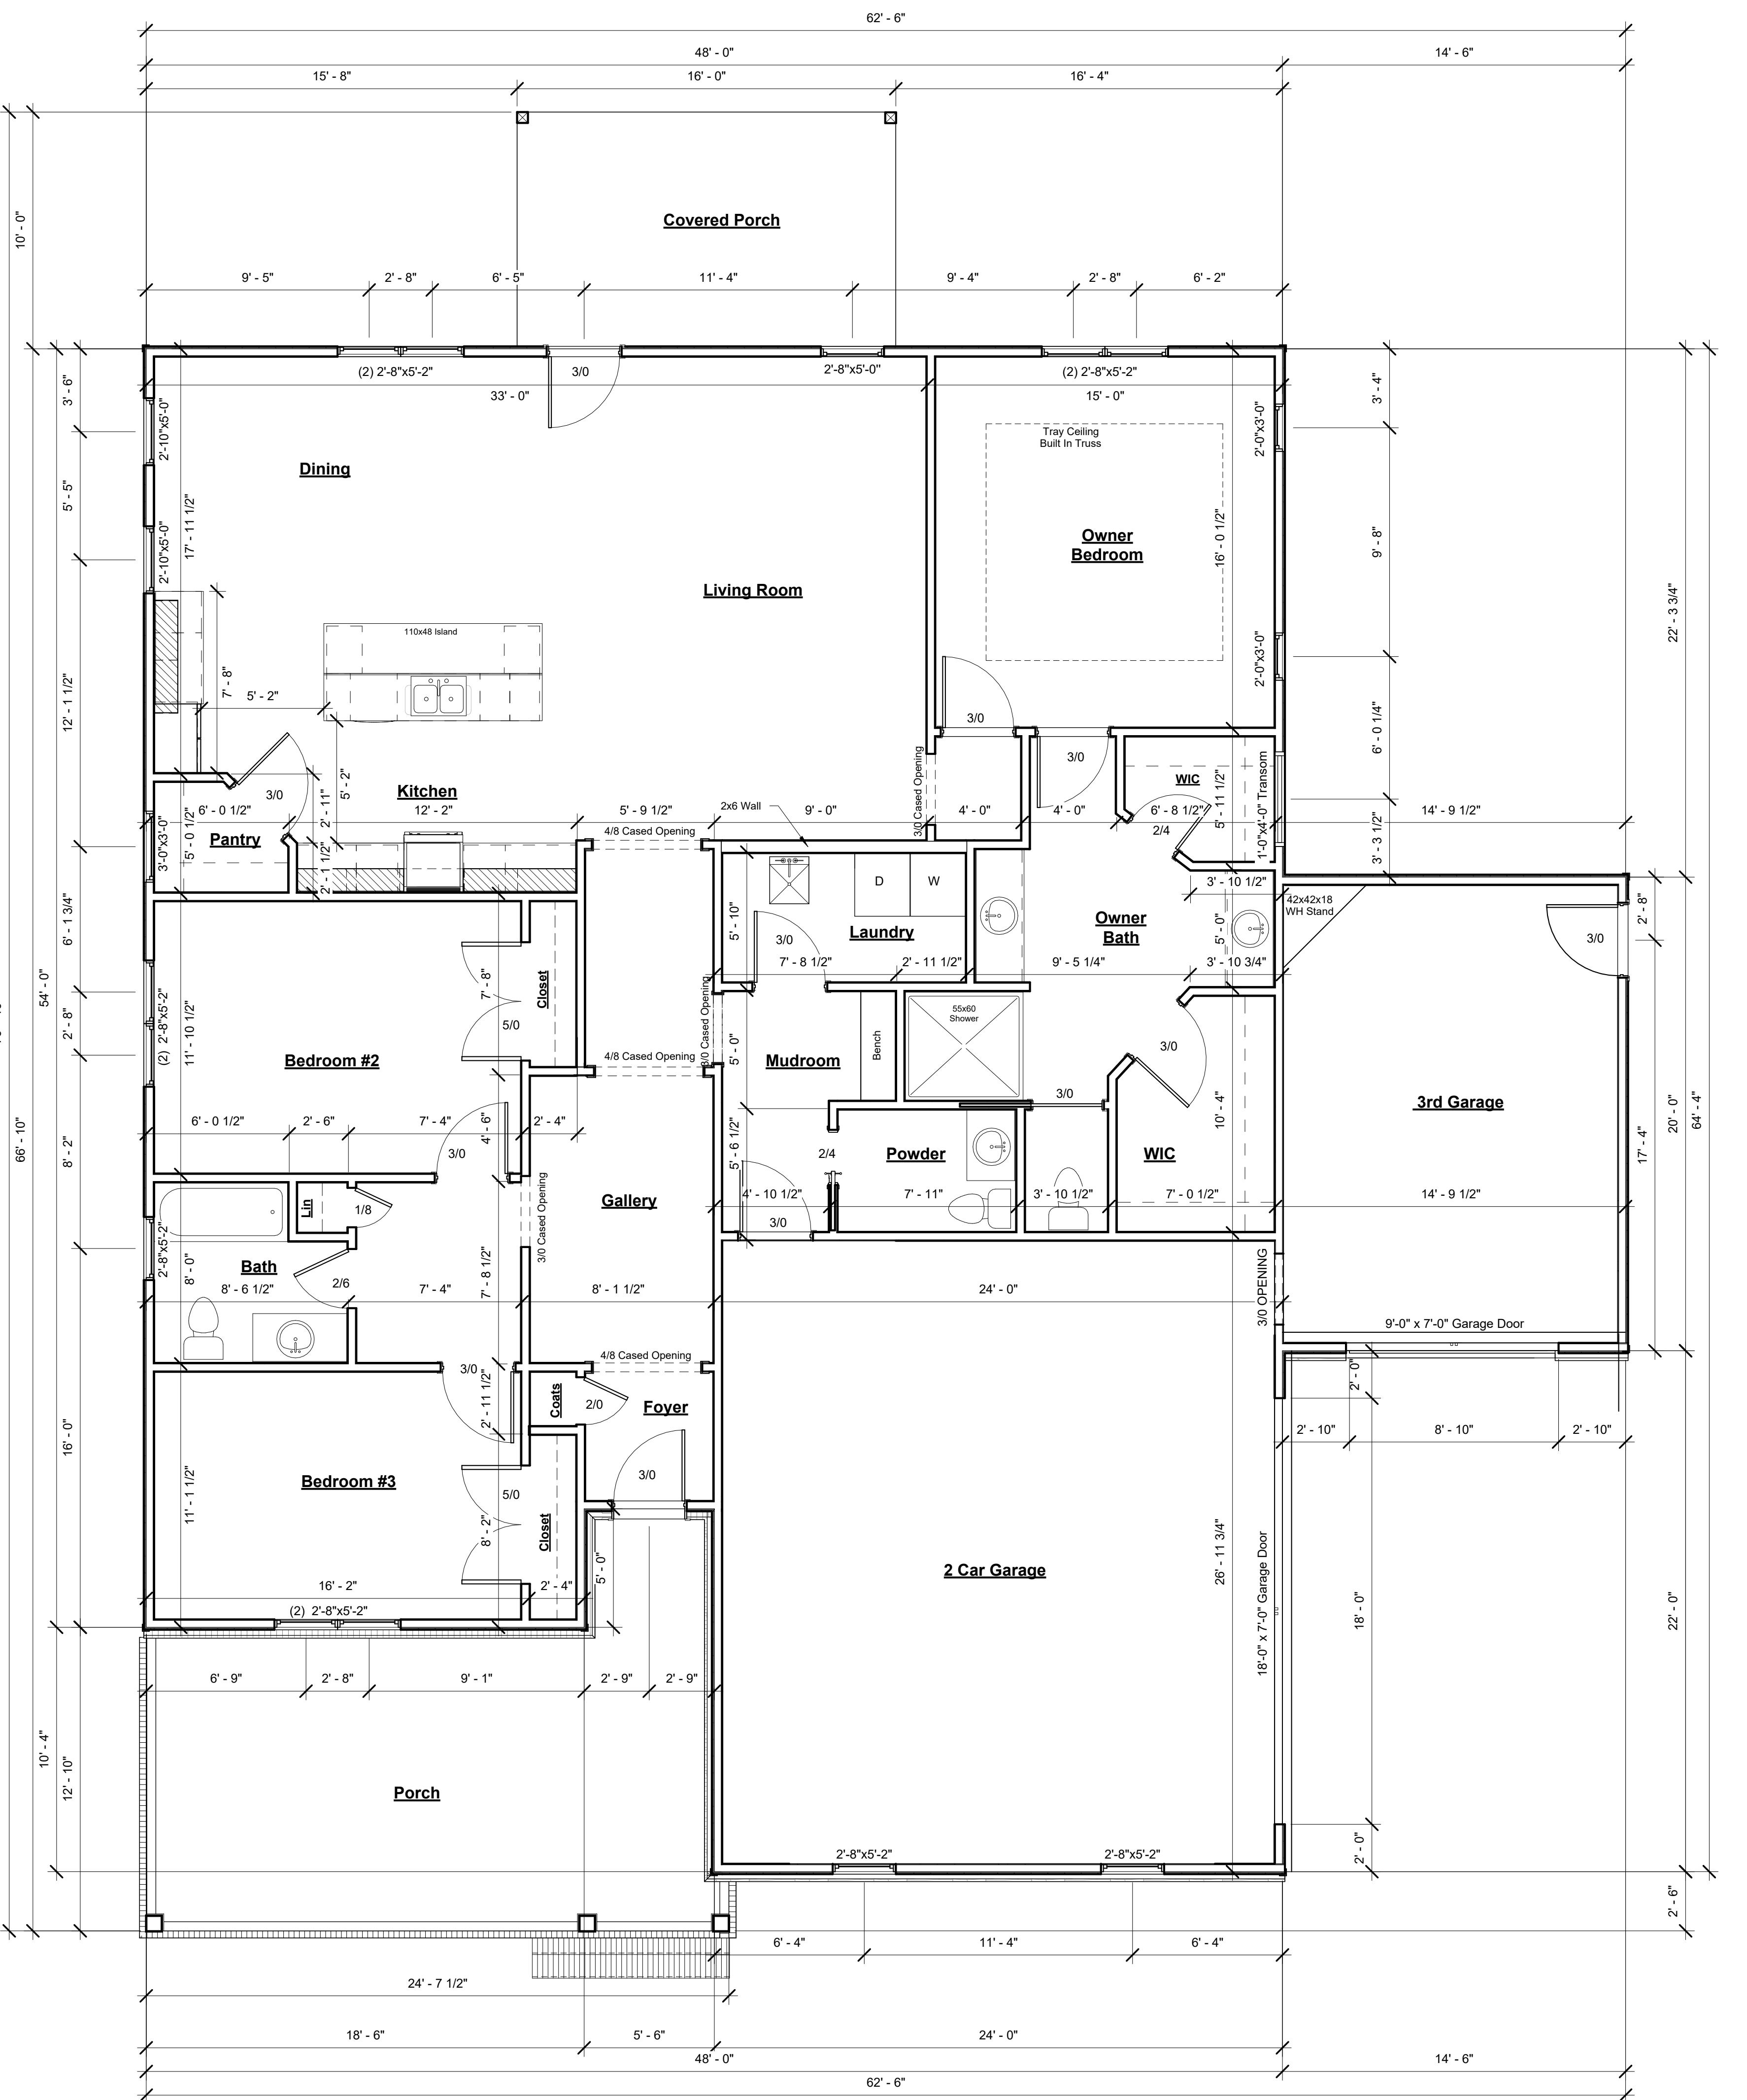

**Floor Plan Notes:**

- All structural information shown is for reference purposes only. Contractor shall have licensed structural engineer review and design all structural elements such as all framing walls, beams, connections, headers, joists and rafters.
- All dimensions are from center line of stud to face of exterior stud unless noted otherwise.
- Window sizes indicated on plans are noted by approximate rough opening size. Refer to plans and exterior elevations for window types.
- Coordinate location of utility meters with site plan and locate away from public view visual impact shall be minimized, i.e. mount as low as possible.
- Prefabricated fireplace construction shall meet or exceed all applicable codes regarding use of fire separations, clearances, etc. It is the items and contractor's responsibility to ensure that all items and construction meet or exceed the applicable code. Overall flue height shall be coordinated to match height shown on plans and shall not exceed top of chimney chase as constructed.
- Contractor shall coordinate all closet shelving requirements.
- Do not scale drawings. False dimensions only.
- Owner shall verify all cabinet dimensions before fabrication.
- Bedroom windows shall have a minimum net clear opening of 5.7 sq. ft. A minimum net clear openable height of 24" and have a maximum finish sill height of 43" from finish floor.
- All glass located within 18" of floor, 12" of a door of located within 60" of floor at bathtubs, whirlpools, showers, saunas, steam rooms or hot tubs shall be tempered.
- All exposed insulation shall have a flame spread rating of less than 25 and a smoke density rating of less than 450.
- Provide combustion air vents, with screen and back damper, for fireplaces, wood stoves and any appliance with an open flame.
- Bathrooms and utility rooms shall be vented to the outside with a minimum of a 90 cfm fan. Range hoods shall also be vented to the outside.
- Gas lines shall be located within 20'-0" of its service opening. Return air grilles shall not be located within 10'-0" of a gas fireplace.
- All walls and ceilings in garage and garage storage areas to have 5/8" Type-X gyp. brd. with 1-Hour fire rating. All exterior doors in garage to be metal or solid core doors including doors entering heated/cold portion of residence.
- All fireplace chase walls shall be insulated inside and outside. Provide horizontal "Draft Stop" at each floor level by packing 6" (R-19) insulation between joists.
- All interior walls shall be covered with 1/2" gyp. brd., with metal corner reinforcing, tape float and sand. (3 coats) use 5/8" gyp. brd. on ceilings when supporting members are 24" O.C. or greater. Use 1/2" gyp. brd. on ceiling members less than 24" O.C.
- All bath and toilet area walls and ceiling shall have water resistant gyp. brd.

**Smoke Alarms**

**R314.1**

**Smoke Detection and Notification.** All smoke alarms shall be listed in accordance with UL 217 and installed in accordance with provisions of this code and the household fire warning equipment provisions of NFPA 72.

**R314.2 Smoke Detection Systems.** Household fire alarm systems installed in accordance with NFPA 72 that include smoke alarms, or a combination of smoke detector and audible notification device installed as required by this section for smoke alarms, shall be permitted. The household fire alarm system shall provide the same level of smoke detection and alarm as required by this section for smoke alarms. Where a household fire warning system is installed using a combination of smoke detector and audible notification device(s), it shall become a permanent fixture of the occupancy and owned by the homeowner. The system shall be monitored by an approved supervising station and be maintained in accordance with NFPA72.

**R314.3 Location.** Smoke alarms shall be installed in the following locations.

- In each sleeping room.
- Outside each separate sleeping area in the immediate vicinity of the bedrooms.
- On each additional story of the dwelling, including basements and habitable attics (finished) but not including crawl spaces, uninhabited (unfinished) attics and uninhabitable (unfinished) attic-stories. In dwellings or dwelling units with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full story below the upper level.

When more than one smoke alarm is required to be installed within an individual dwelling unit the alarm devices shall be interconnected in such a manner that that the activation of one alarm will activate all of the alarms in the individual unit.

**R314.4 Power Source.** Smoke alarms shall receive their primary power from the building electrical system which will be from a framed electrical source, and when primary power is interrupted, shall receive power from a battery. Wiring shall be permanent and without a disconnection switch other than those required for overcurrent protection. Smoke alarms shall be interconnected.

**Dwelling/Garage Separation**

**REFER TO SECTIONS R302.5, R302.6, AND R302.7**

**Walls.** A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.

**Stairs.** A minimum of 1/2" gypsum must be installed on the underside and exposed sides of all stairways.

**Ceilings.** A minimum of 1/2" gypsum must be installed on the garage ceiling if there is no habitable room above. If a habitable room is above, a minimum of 5/8" Type X gypsum board must be installed on the garage ceiling.

**Opening Penetrations.** Openings between the garage and the residence shall be equipped with solid wood doors not less than 1 3/8 inches in thickness, solid or honeycomb core steel doors not less than 1 3/8 inches thick, or 20-minute fire-rated doors.

**Duct Penetrations.** Ducts in the garage and ducts penetrating the walls or ceilings separation the dwelling from the garage shall be constructed of a minimum No. 26 gauge sheet steel or other approved material and shall have no openings into the garage.

**Other Penetrations.** Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

**Attic Access**

**Section R807**

**R807.1 Attic Access.** An attic access opening shall be provided to attic areas that exceed 400 square feet and have a vertical height of 60 inches or greater. The net clear opening shall not be less than 20 inches by 30 inches and shall be located in the hallway or other unobstructed area. Headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located above attics.

**Exceptions:**

- Concealed areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc. are not required to have access.
- Pull down stair treads, stringers, handrails, and hardware may protrude into the net clear area.

**Walls & Thicknesses**

**All walls** are 3 1/2" thick 2x4 nominal studs SYP or SPF #2 @ 16" O.C. unless otherwise noted.

**Exterior walls** are drawn to actual dimensions to include both interior and exterior finishes. Measurements to exterior walls are to the exterior face of wall studs.

**Garage walls** are drawn to actual dimensions. Measurements to exterior walls are to the exterior face of wall stud. Measurements to walls between the residence and the garage are to the face of the stud on the garage side.

**Interior walls** are drawn to actual dimension. Measurements to interior walls are to the center line of the wall.

**Carbon Monoxide Alarms**

**Section R315**

**R315.1 Carbon Monoxide Alarms.** In new construction, dwelling units shall be provided with an approved carbon monoxide alarm installed outside of each separate sleeping area in the immediate vicinity of the bedroom(s) as directed by the alarm manufacturer.

**R315.2 Where Required In Existing Dwellings.** In existing dwellings, where interior alterations, repairs, fuel-fired appliance replacements, or additions requiring a permit occurs, or where one or more sleeping rooms are added or created, carbon monoxide alarms shall be provided in accordance with Section R315.1.

**R315.3 Alarm Requirements.** The required carbon monoxide alarms shall be audible in all bedrooms over background noise levels with all intervening doors closed. Single station carbon monoxide alarms shall be listed as complying with UL2034 and shall be installed in accordance with this code and the manufacturer's installation instructions.

**Walls & Thicknesses**

**All walls** are 3 1/2" thick 2x4 nominal studs SYP or SPF #2 @ 16" O.C. unless otherwise noted.

**Exterior walls** are drawn to actual dimensions to include both interior and exterior finishes. Measurements to exterior walls are to the exterior face of wall studs.

**Garage walls** are drawn to actual dimensions. Measurements to exterior walls are to the exterior face of wall stud. Measurements to walls between the residence and the garage are to the face of the stud on the garage side.

**Interior walls** are drawn to actual dimension. Measurements to interior walls are to the center line of the wall.

**Revisions:**  
SCALE:  
1/4" = 1'-0"

DATE:  
October 31, 2025

Project number  
0602202500021

Drawn by DF  
Checked by TP

## Exterior Windows And Doors

### Section R612

**R612.1 General.** This section prescribes performance and construction requirements for exterior windows and doors installed in exterior walls. Windows and doors shall be installed and flashed according with the manufacturer's installation requirements for fenestration protection. Window and door openings shall be flashed in accordance with Section R703.8. Written installation instructions shall be provided by the fenestration manufacturer for each new window and door installed.





**R612.2 Window Sills.** In dwelling units, where the opening of an operable window is located more than 72 inches above the finished grade or surface below, the lowest part of the clear opening of the window shall be a minimum of 24 inches above the finished floor of the room in which the window is located. Operable sections of windows shall not permit openings that allow the passage of a 4 inch diameter sphere where such openings are located within 24 inches of the finished floor.

**Exceptions:**  
1. Windows whose openings will not allow a 4 inch diameter sphere to pass through the opening when the opening is in its largest opened position.  
2. Openings that are provided with window fall prevention devices that comply with R612.3.  
3. Openings that are provided with window fall prevention devices that comply with ASTM F 2090.  
3. Openings that are provided with opening limiting devices that comply with section R612.4.  
**R612.3 Window Fall Prevention Devices.** Window fall prevention devices and window guards, where provided, shall comply with the requirements of ASTM F 2090.

### Exceptions:

- Windows whose openings will not allow a 4 inch diameter sphere to pass through the opening when the opening is in its largest opened position.
- Openings that are provided with window fall prevention devices that comply with R612.3.
- Openings that are provided with window fall prevention devices that comply with ASTM F 2090.
- Openings that are provided with opening limiting devices that comply with section R612.4.

**R612.3 Window Fall Prevention Devices.** Window fall prevention devices and window guards, where provided, shall comply with the requirements of ASTM F 2090.

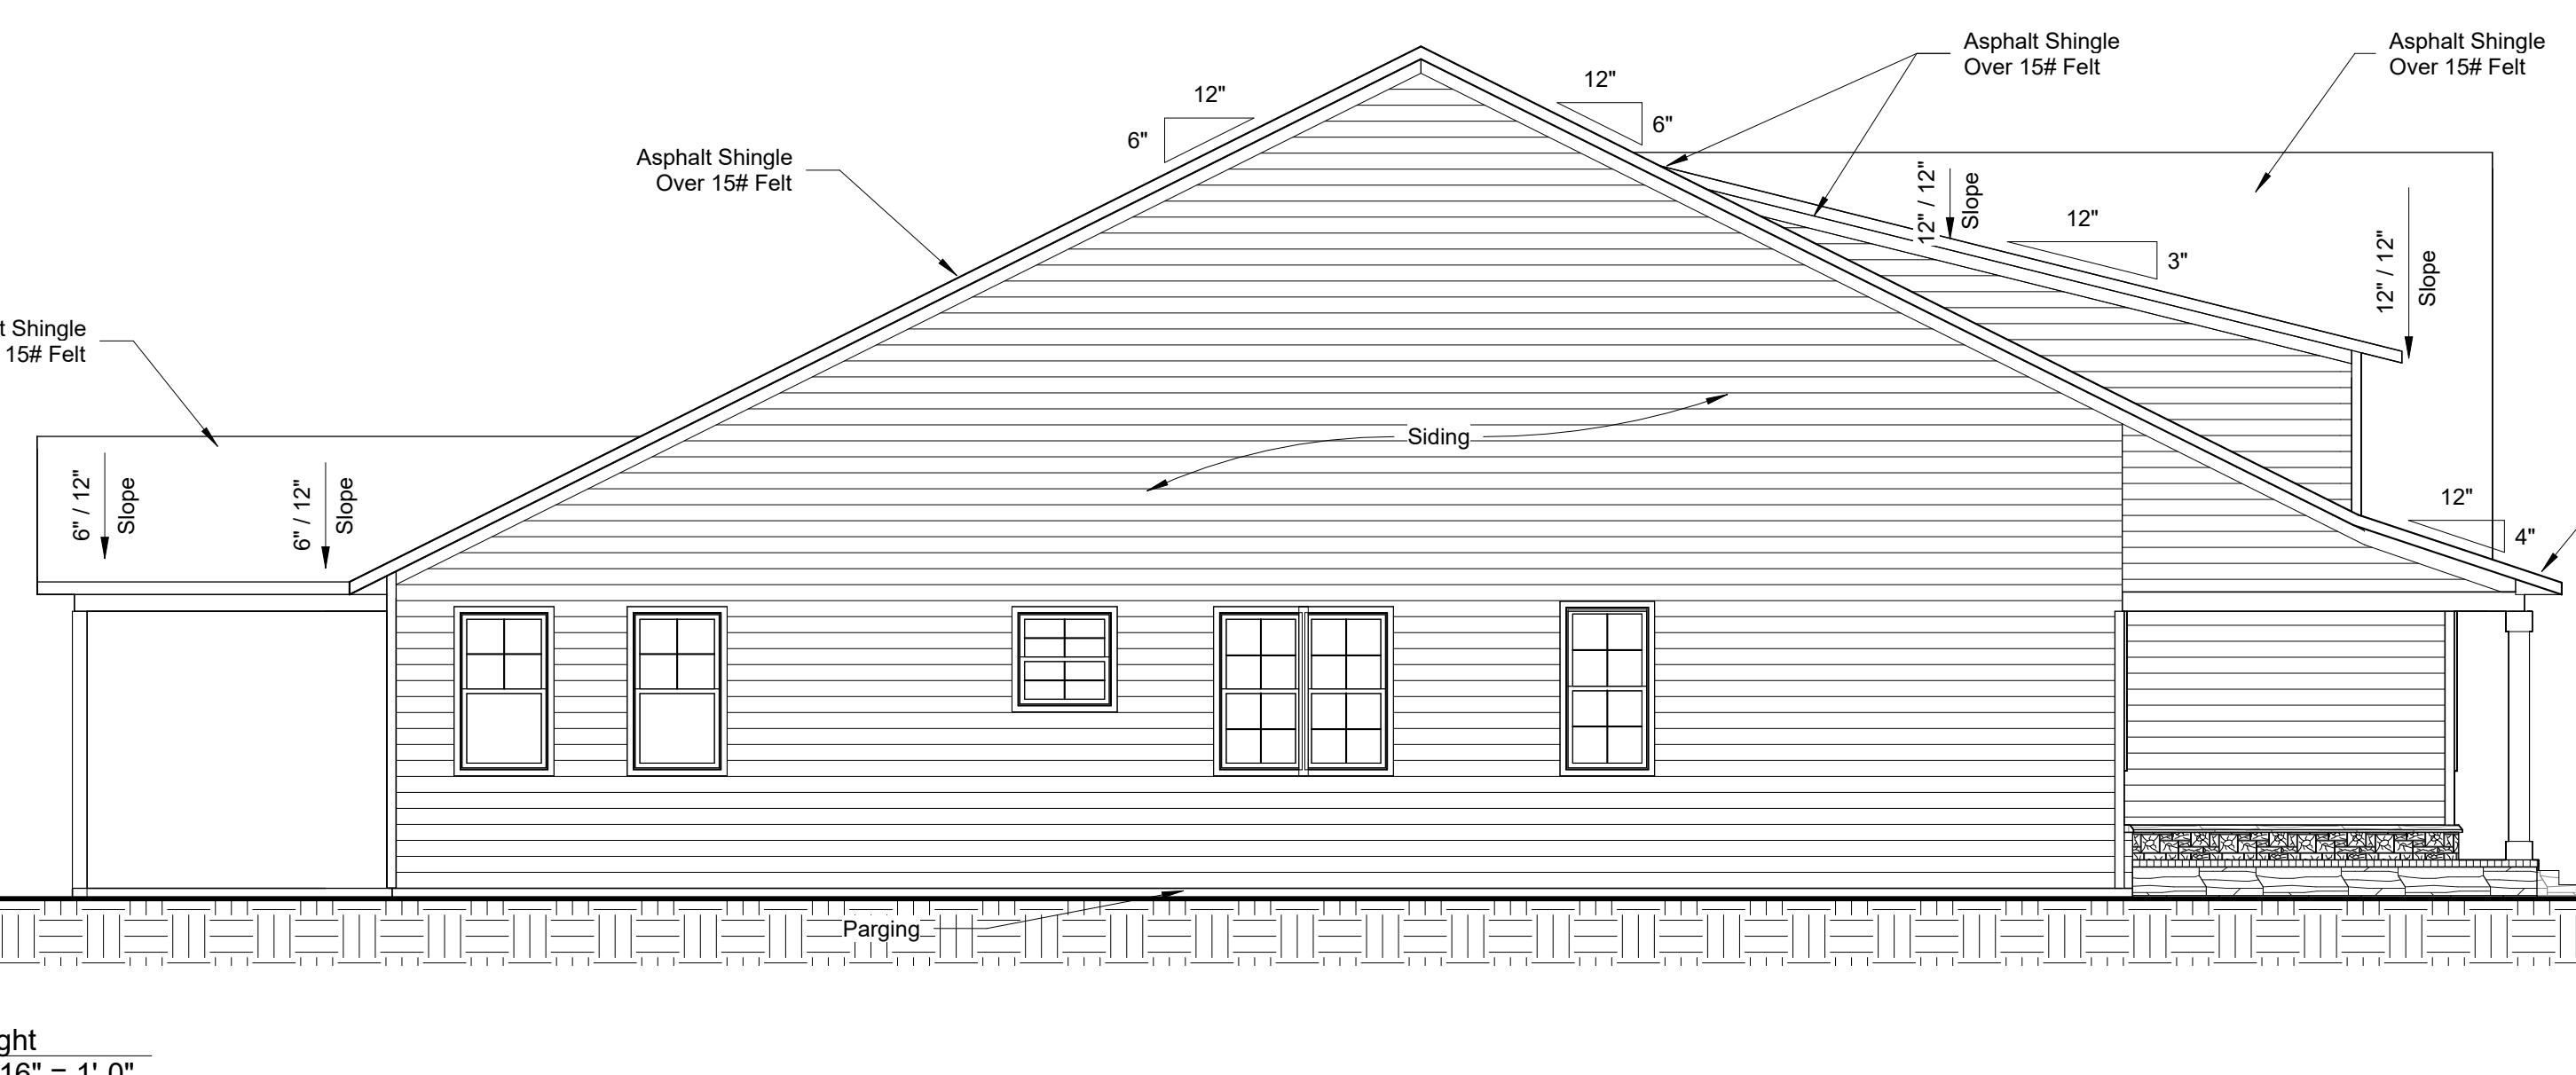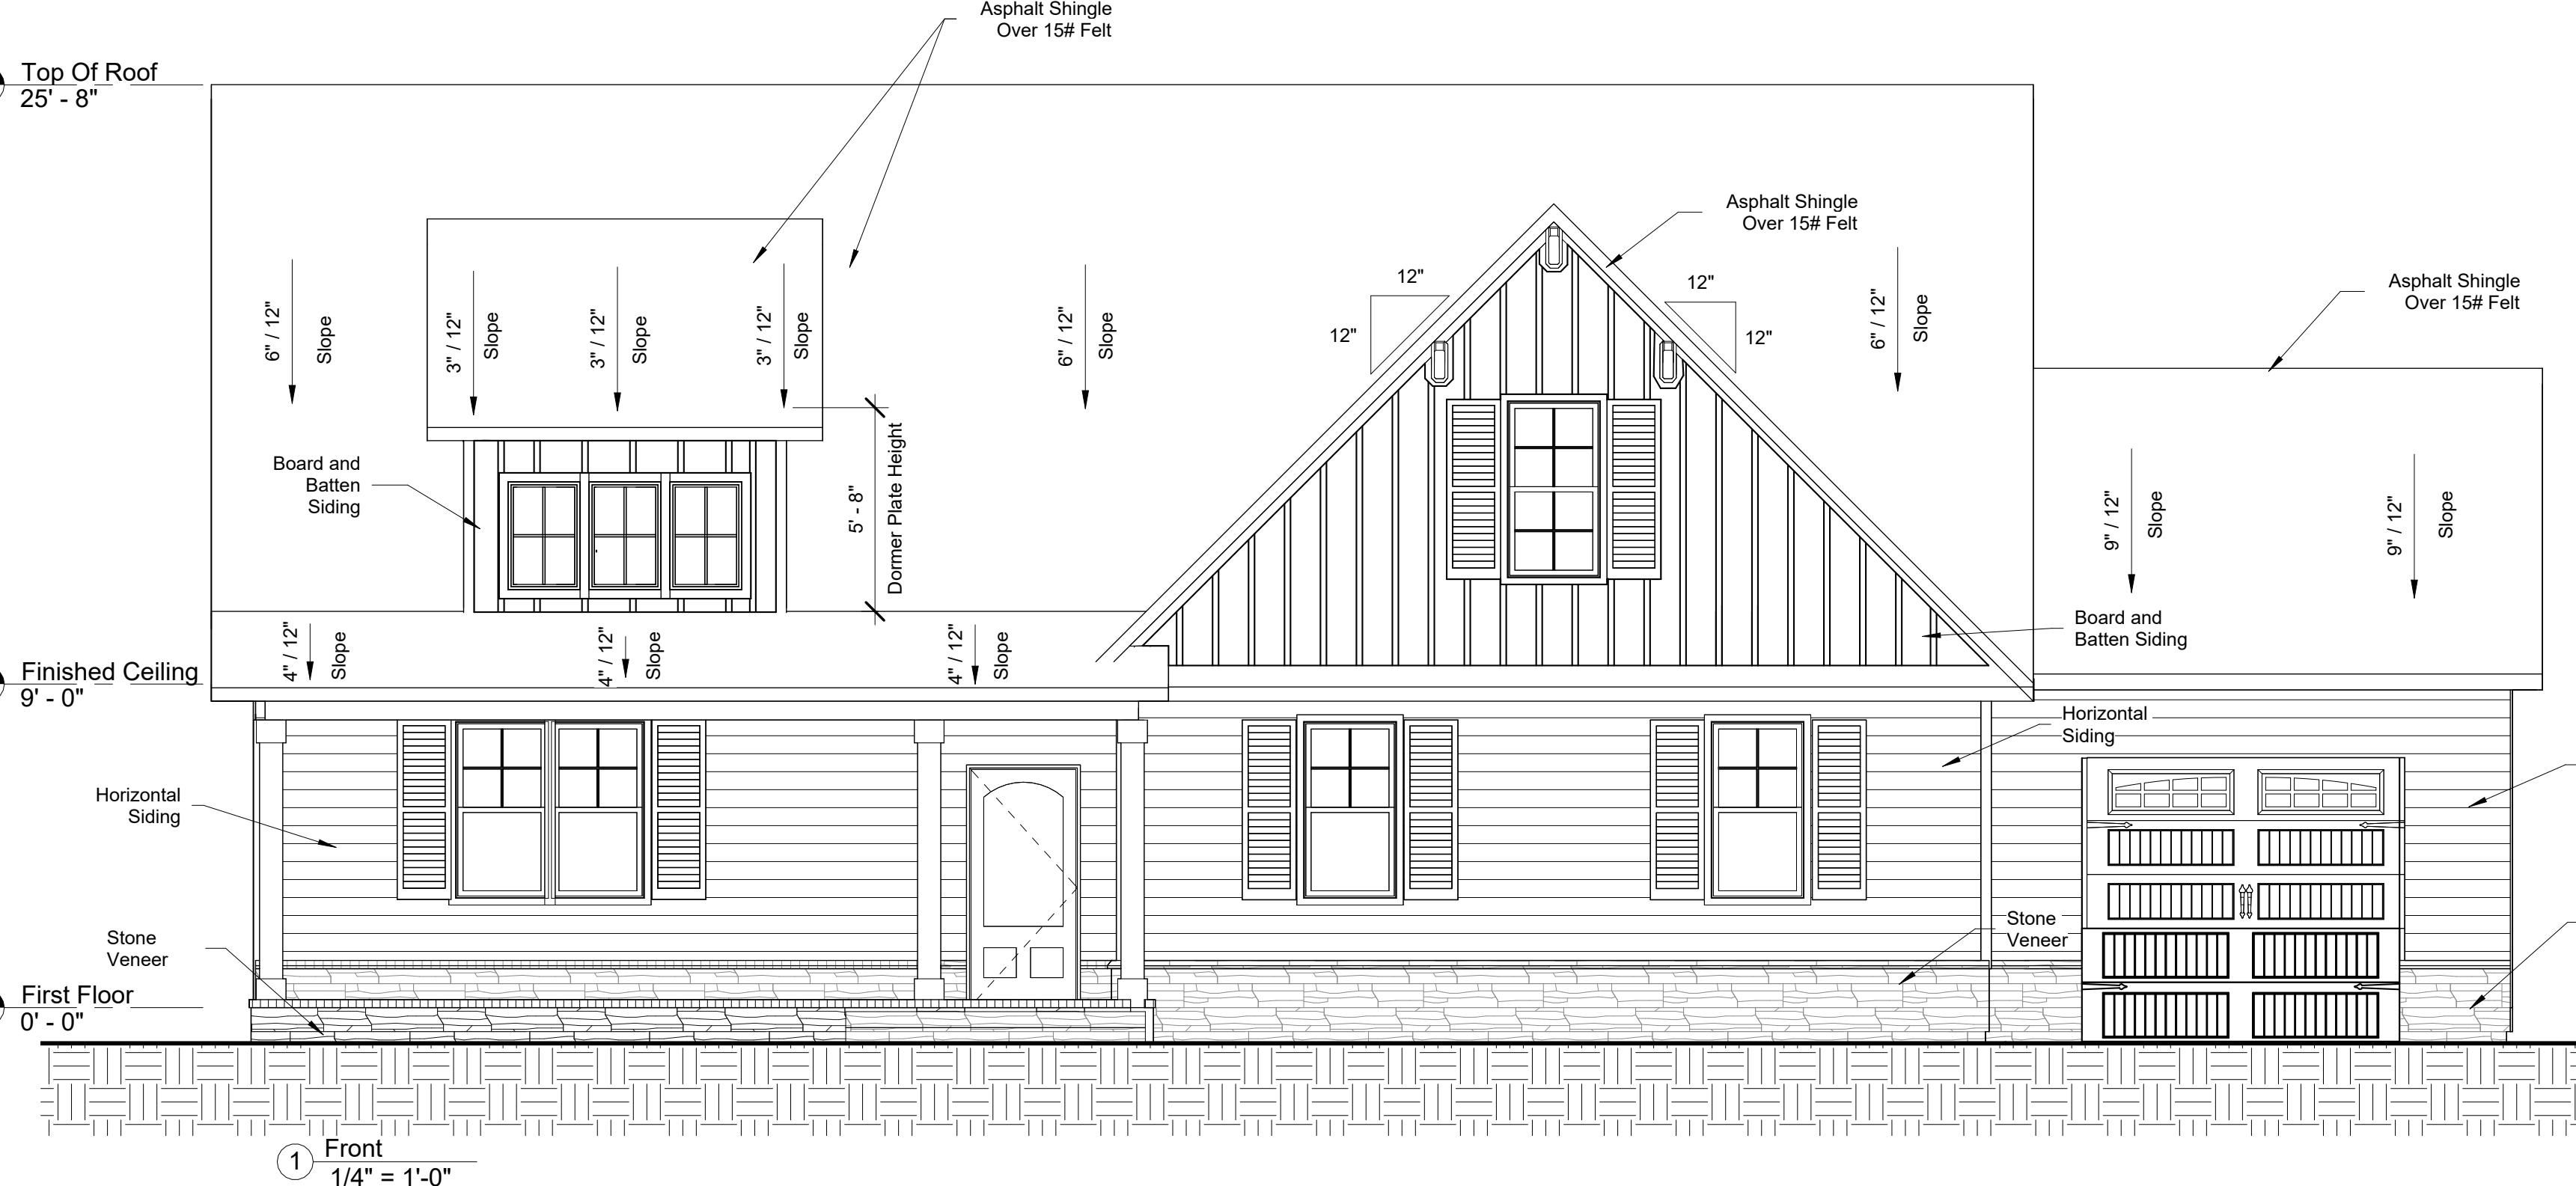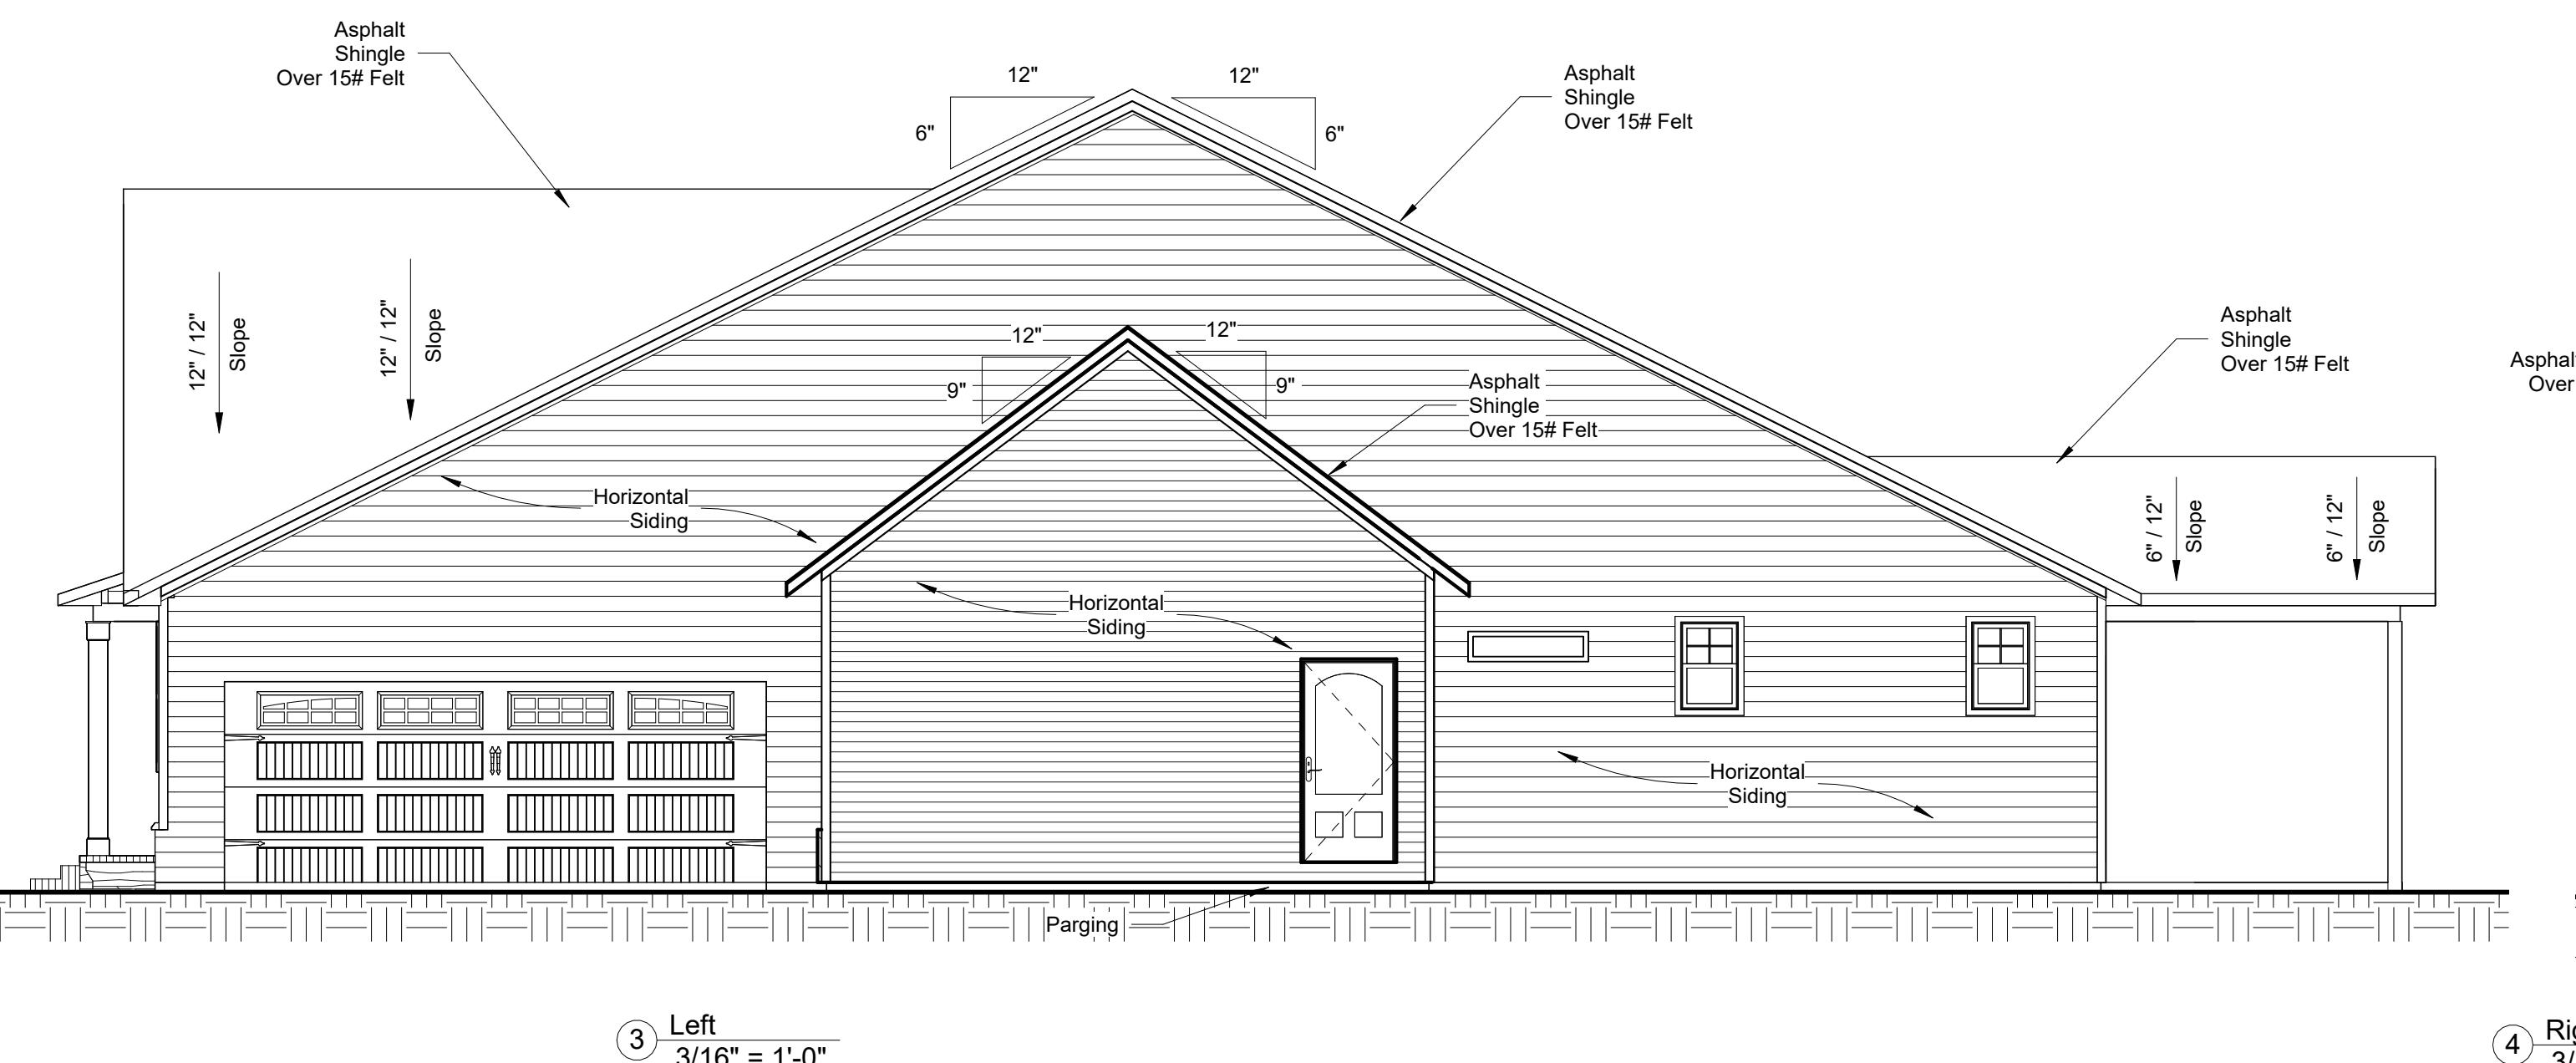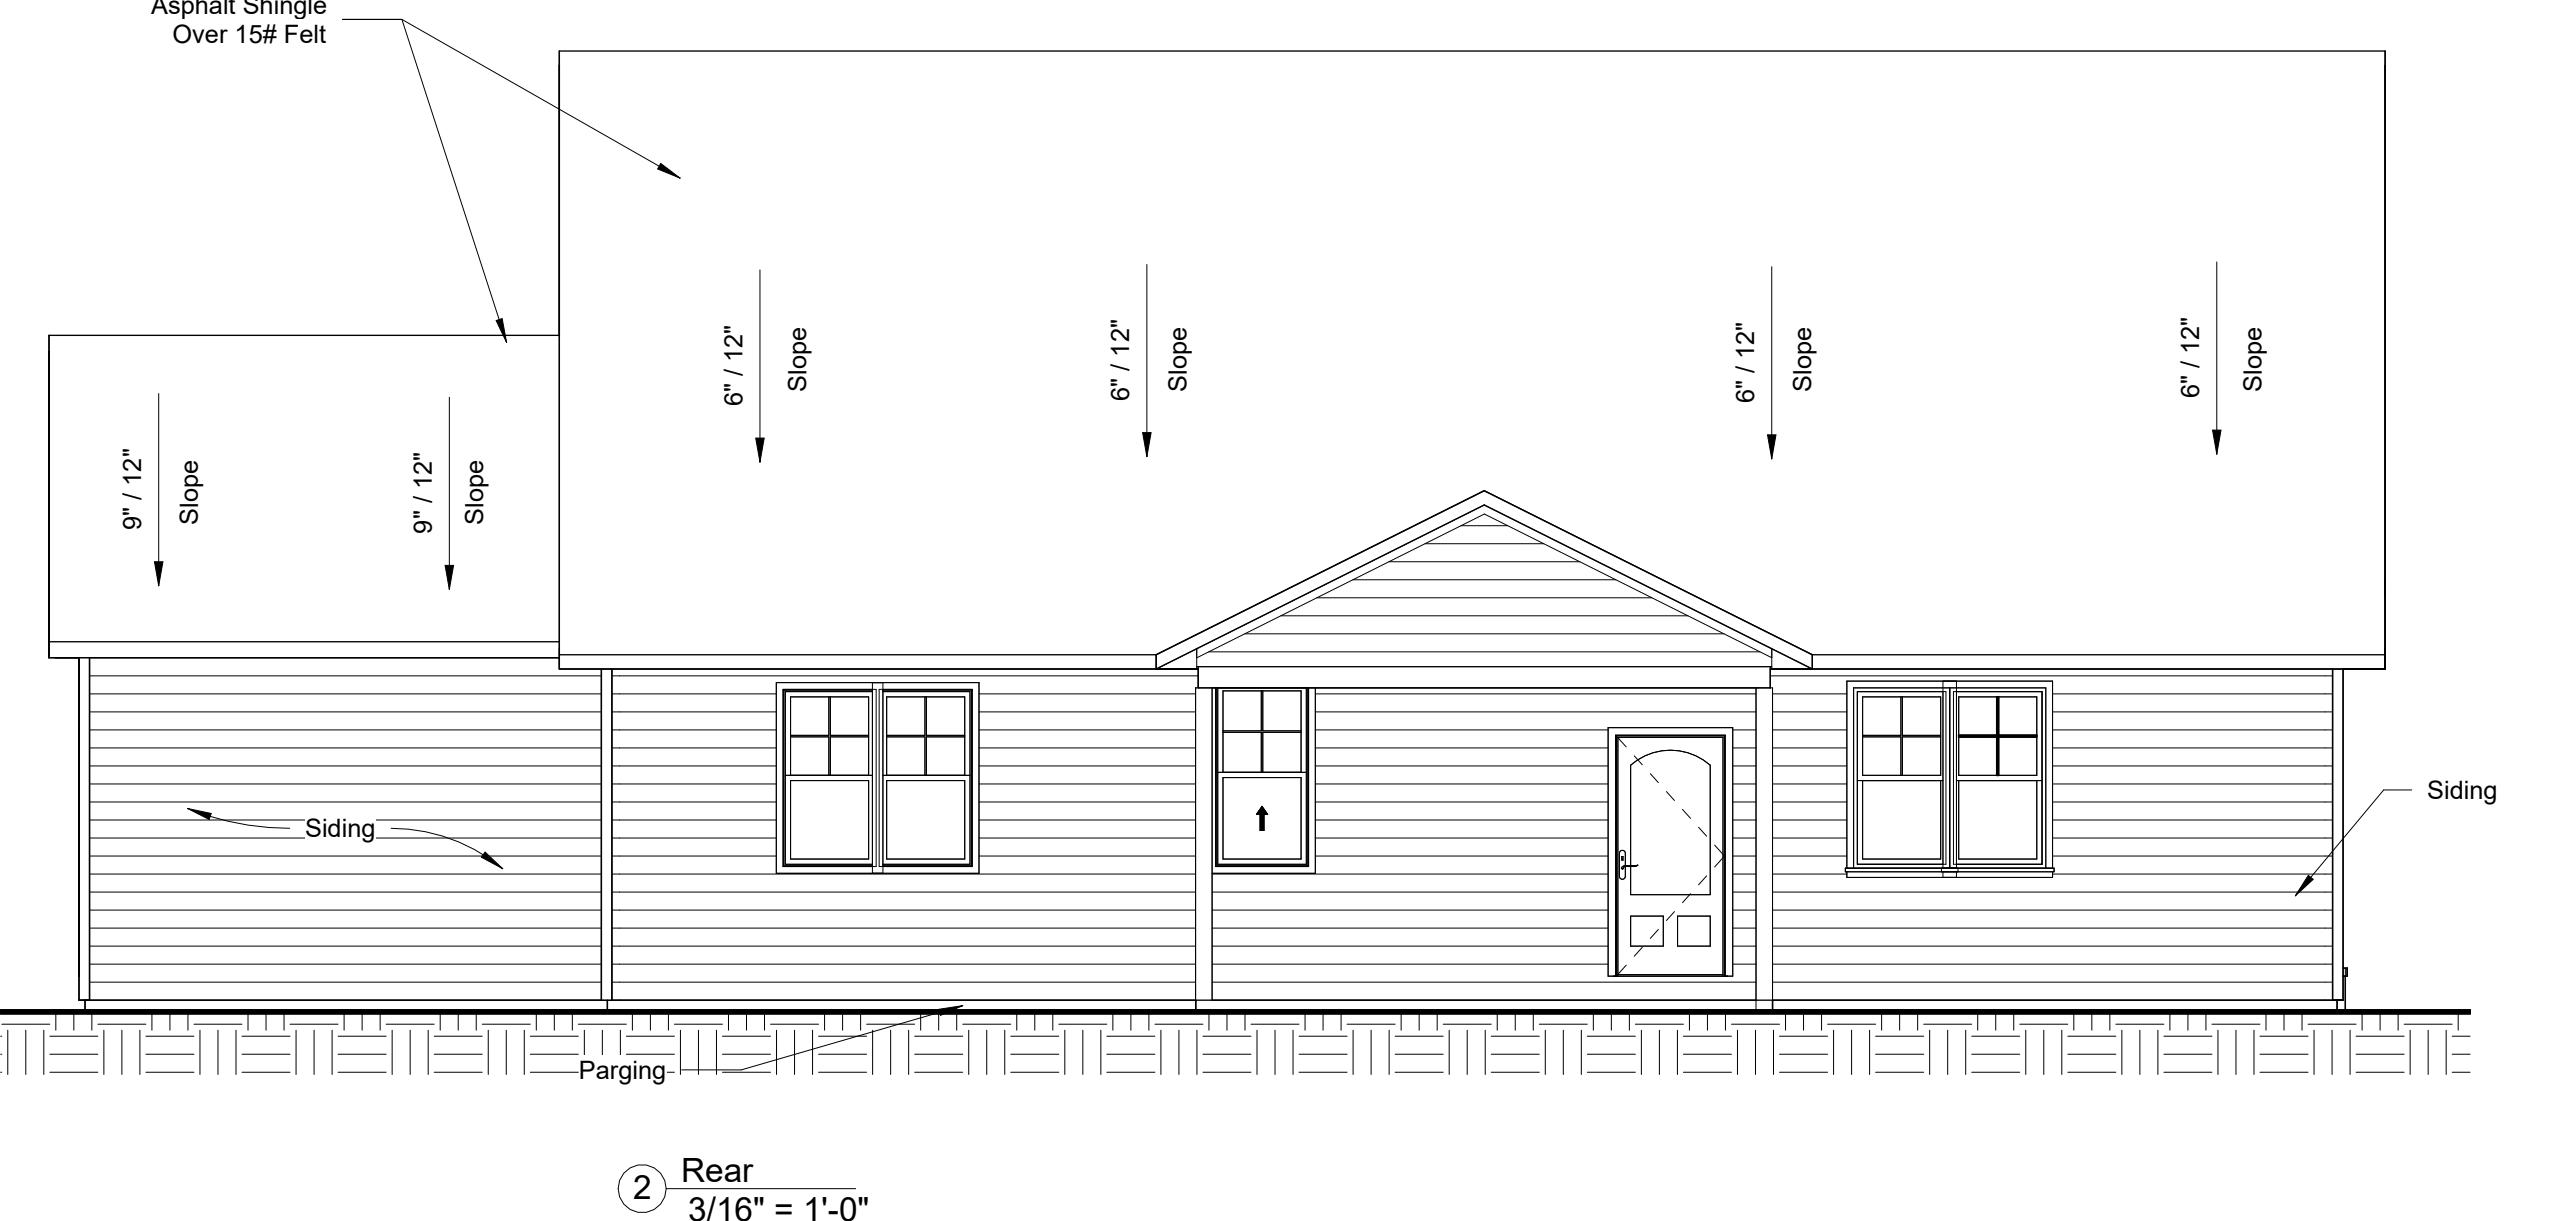

## Weaver Development Companies

### Elevations

## Charles Temm

### The Lauren III

**PROPERTY OF TPDCLLC**  
DRAWINGS AND SPECIFICATIONS AS  
INSTRUMENTS OF SERVICE ARE AND  
SHALL NOT BE USED BY THE OWNER  
OR OTHER PROJECT FOR ADDITIONS  
TO THIS PROJECT OR FOR COMPLETION  
OF THIS PROJECT BY OTHERS EXCEPT  
BY AGREEMENT IN WRITING WITH THE  
DESIGNER. IN WRITING WITH THE  
DESIGNER, APPROPRIATE COMPENSATION TO THE  
DESIGNER.

IT IS THE SOLE RESPONSIBILITY OF THE  
CONTRACTOR AND/OR BUILDER TO CONFORM  
TO ALL STANDARDS, PROVISIONS,  
REQUIREMENTS AND USES OF MATERIALS IN BUILDING CODES  
ANY OTHER LOCAL AGENCIES AND IN  
ACCORDANCE WITH GOOD ENGINEERING AND  
CONSTRUCTION PRACTICES.

I CERTIFY THAT THE CONSTRUCTION  
EXHIBITS FOR IDENTIFICATION OF  
THE PROPERTY BY HOUSE TYPE, LOT,  
LOCK, SUBDIVISION NAME, AND SO ON  
MEET ALL LOCAL CODE REQUIREMENTS  
AND ARE IN CONFORMITY WITH BOTH  
SAH AND VA MINIMUM  
PROPERTY REQUIREMENTS. ALL  
BUILDING STANDARDS AS SET FORTH  
BY THE INTERNATIONAL CODE COUNCIL  
(ICC) AND FEDERAL SAFE DRINKING  
WATER PLUMBING STANDARD.

### Revisions:

### SCALE:

As indicated

DATE:  
October 31, 2025

Project number:  
0602202500021

Drawn by DF  
Checked by TP



**PROPERTY OF TPDCLLC**  
DRAWINGS AND SPECIFICATIONS AS  
INSTRUMENTS OF SERVICE ARE AND  
SHALL BE OWNED BY THE  
DESIGNER WHETHER THEY ARE MADE FOR EXECUTED  
OR NOT. THE DRAWINGS AND SPECIFICATIONS  
SHALL NOT BE USED BY THE OWNER  
ON OTHER PROJECTS FOR ADDITIONS  
TO THIS PROJECT OR FOR COMPLETION  
OF THIS PROJECT BY OTHERS EXCEPT  
BY AGREEMENT IN WRITING WITH THE  
APPROPRIATE COMPENSATION TO THE  
DESIGNER.

IT IS THE SOLE RESPONSIBILITY OF THE  
CONTRACTOR AND/OR BUILDER TO CONFORM  
TO ALL STANDARDS, PROVISIONS,  
REQUIREMENTS AND USES OF MATERIALS IN CONSTRUCTION  
AND USES OF MATERIALS IN BUILDING CODES  
ANY OTHER LOCAL AGENCIES AND IN  
ACCORDANCE WITH GOOD ENGINEERING AND  
CONSTRUCTION PRACTICES.

I CERTIFY THAT THE CONSTRUCTION  
EXHIBITS FOR IDENTIFICATION OF  
THE PROPERTY BY HOUSE TYPE, LOT,  
LOCK, SUBDIVISION NAME, AND SO ON  
MEET ALL LOCAL CODE REQUIREMENTS  
AND ARE SUBSTANTIALLY IN CONFORMITY  
WITH BOTH SH AND VA MINIMUM  
PROPERTY REQUIREMENTS, ALL  
BUILDING STANDARDS AS SET FORTH  
BY THE INTERNATIONAL CODE COUNCIL  
(ICC) AND FEDERAL SAFE DRINKING  
WATER PLUMBING STANDARD.

## Charles Temm

### The Lauren III





## Weaver Development Companies

### Foundation Plan

4

#### MASONRY NOTES:

1. Concrete dimensions are typically to face of wall.
2. All concrete slabs shall be minimum 4" thick, with 6 x 6 1/4" W/W/M welded wire fabric placed over 6 mil poly vapor barrier over a minimum 6" bed of compacted gravel.
3. Provide Anchor Bolts sizes as indicated (min. 1/2"dia) on these drawings, at top of concrete foundation walls at a minimum of 1'-0" from corners and maximum 6'-0" O.C. for balance of perimeter walls, two per plate minimum.
4. All concrete footings shall bear on undisturbed virgin soil with presumptive bearing capacity of 4000 psf.
5. All concrete frost walls to have bottom of footing at minimum 1'-6" below finished grade.
6. Concrete foundation walls that exceed 8'-0" in height must be reinforced with steel designed by a licensed Structural Engineer.
7. All Concrete shall have the minimum 28 day strength:  
Garage Slab 3500 psi  
Basement Slab 3000 psi  
Crawl Space Slab 3000 psi  
Exterior Slab 3500 psi  
Foundation Slab 3000 psi

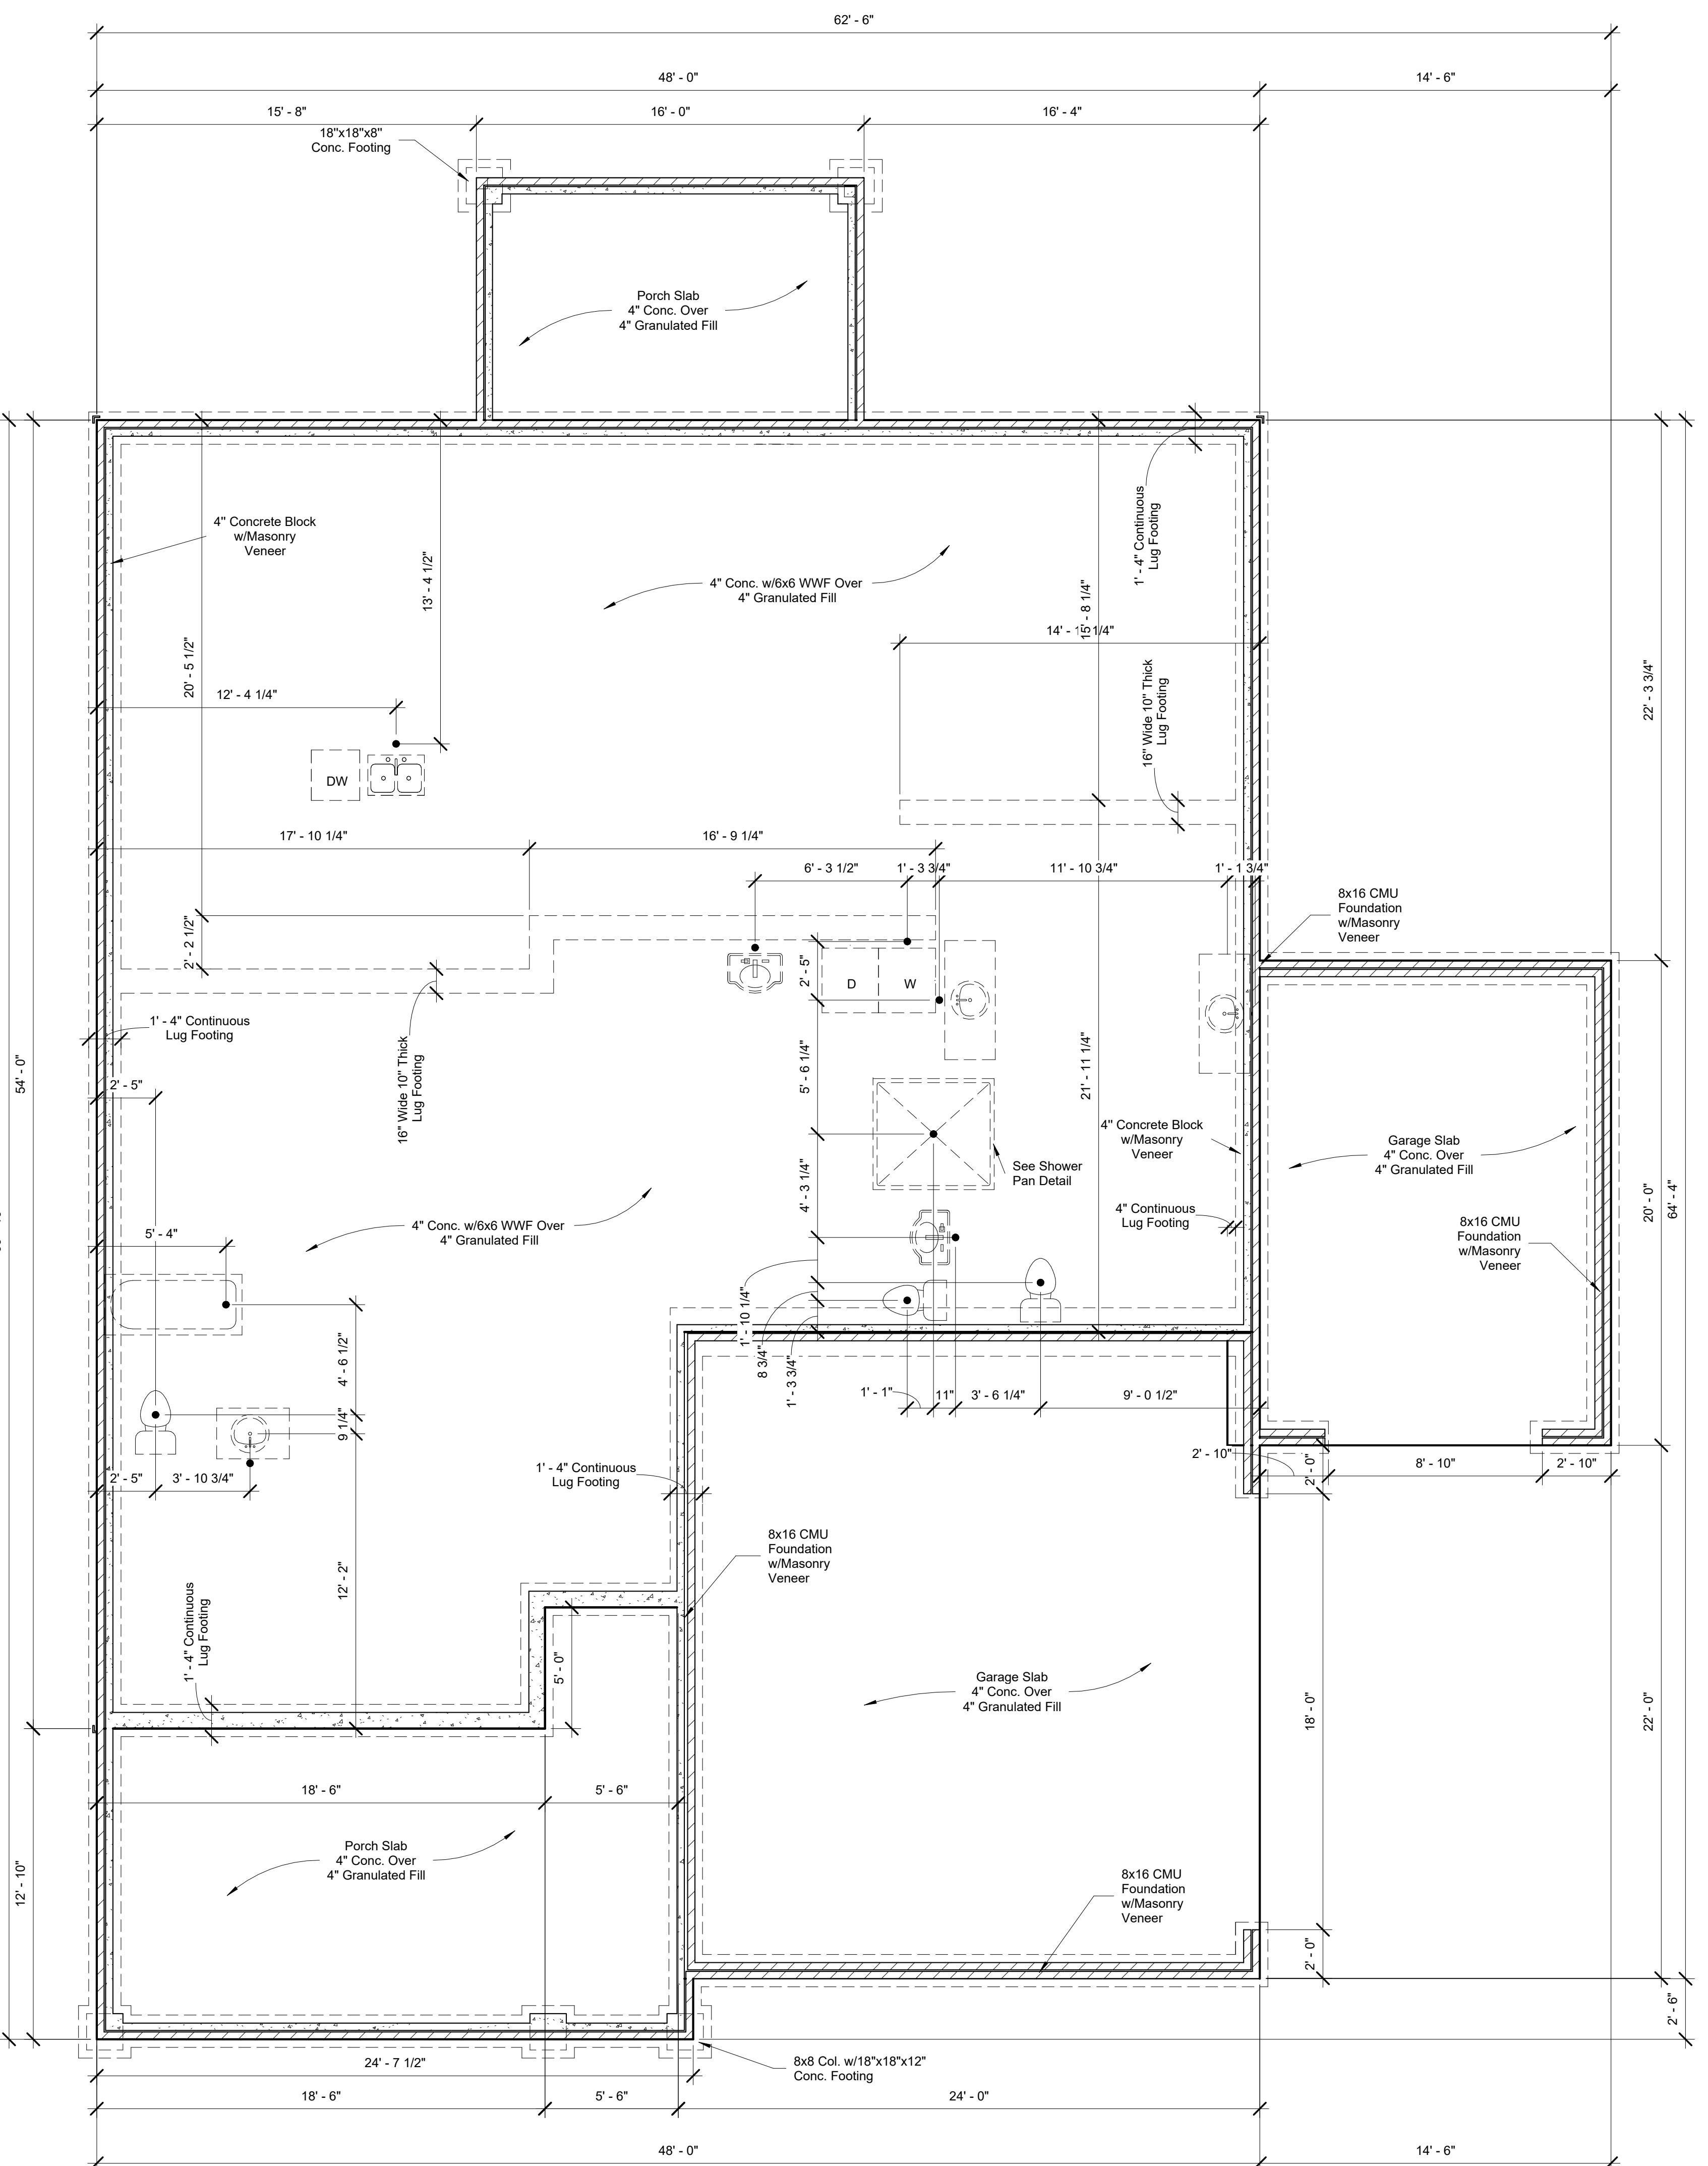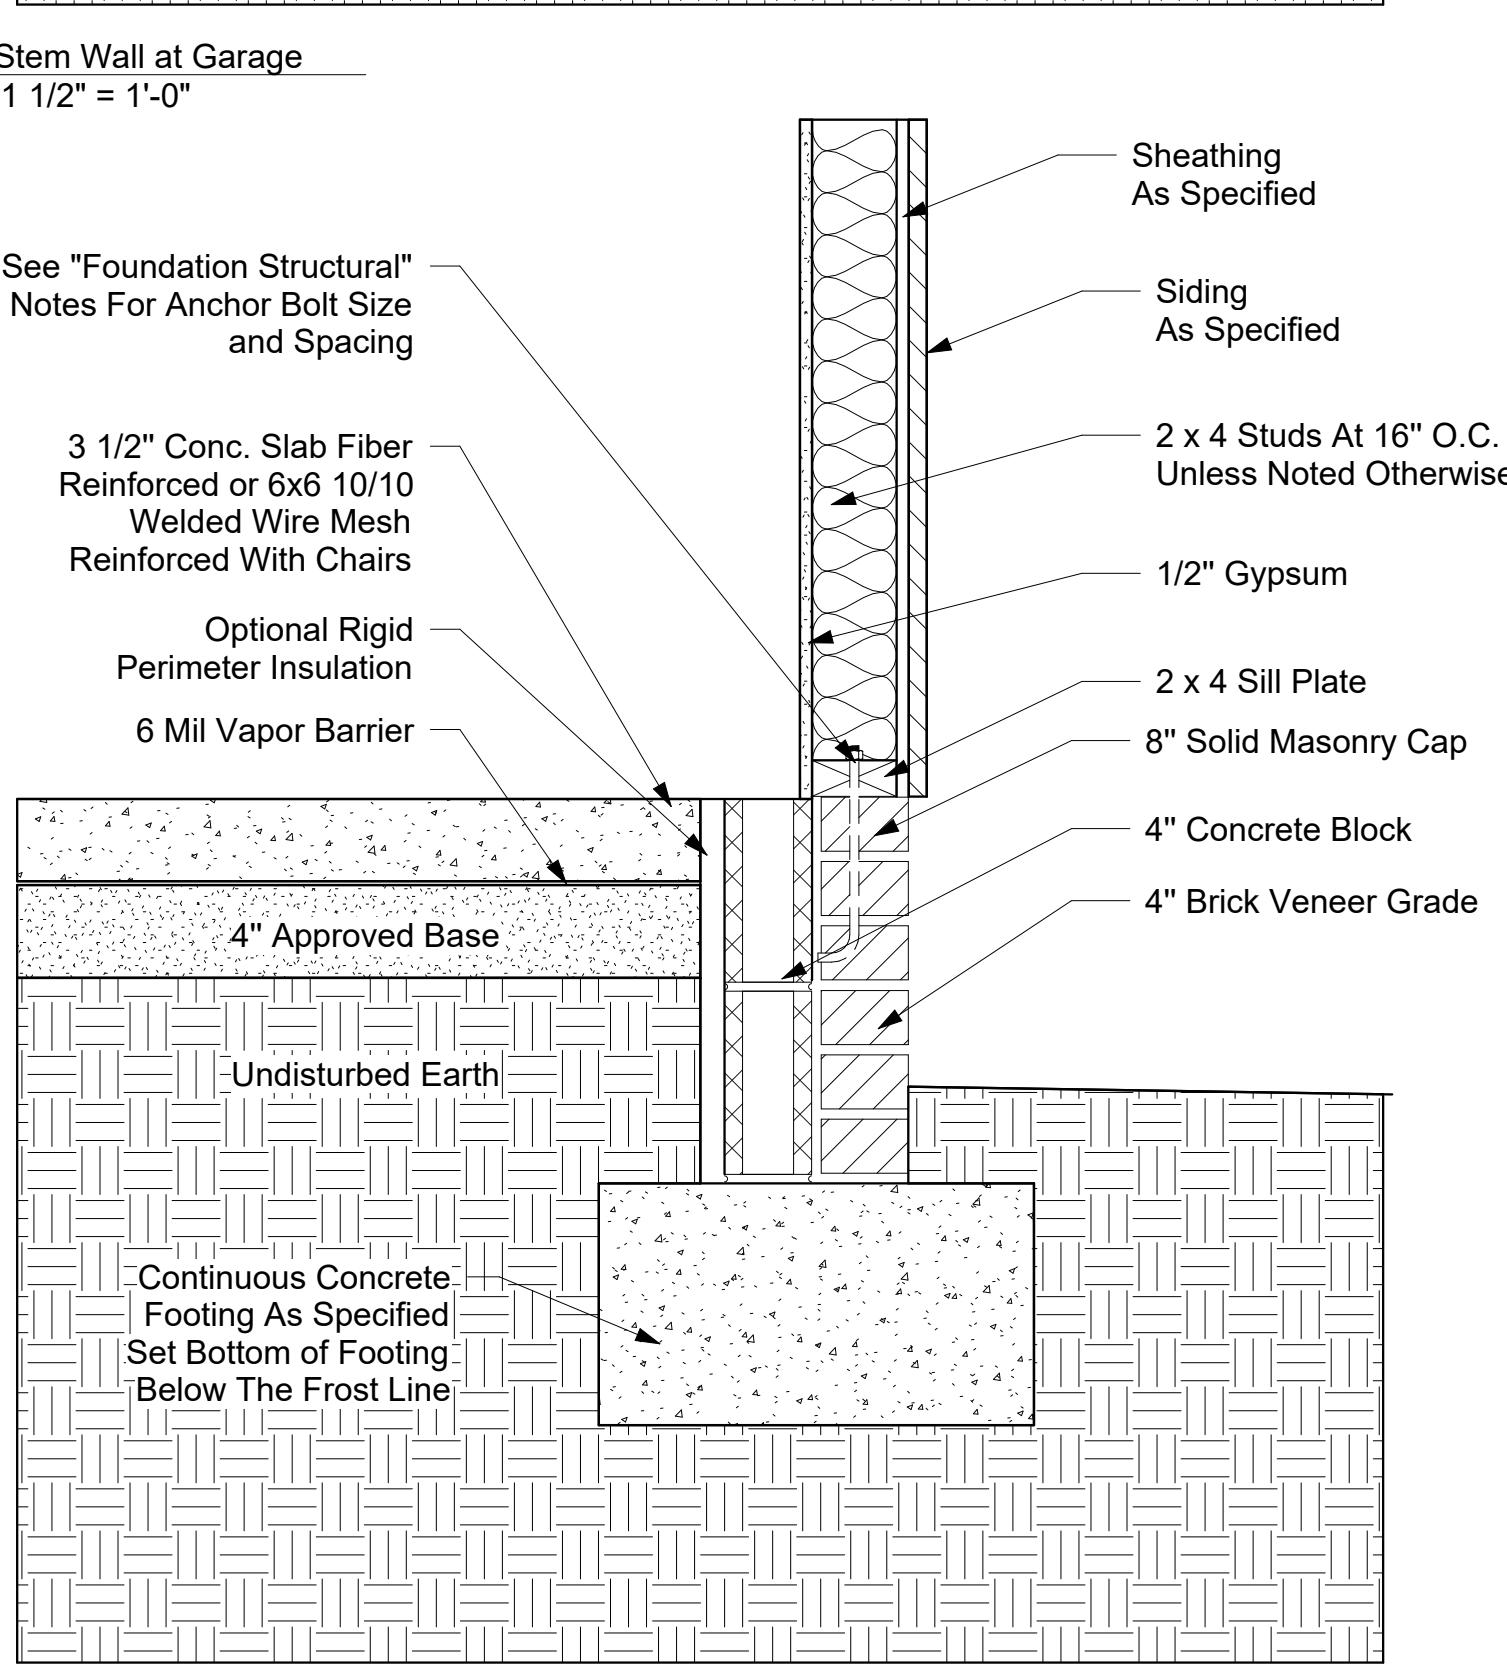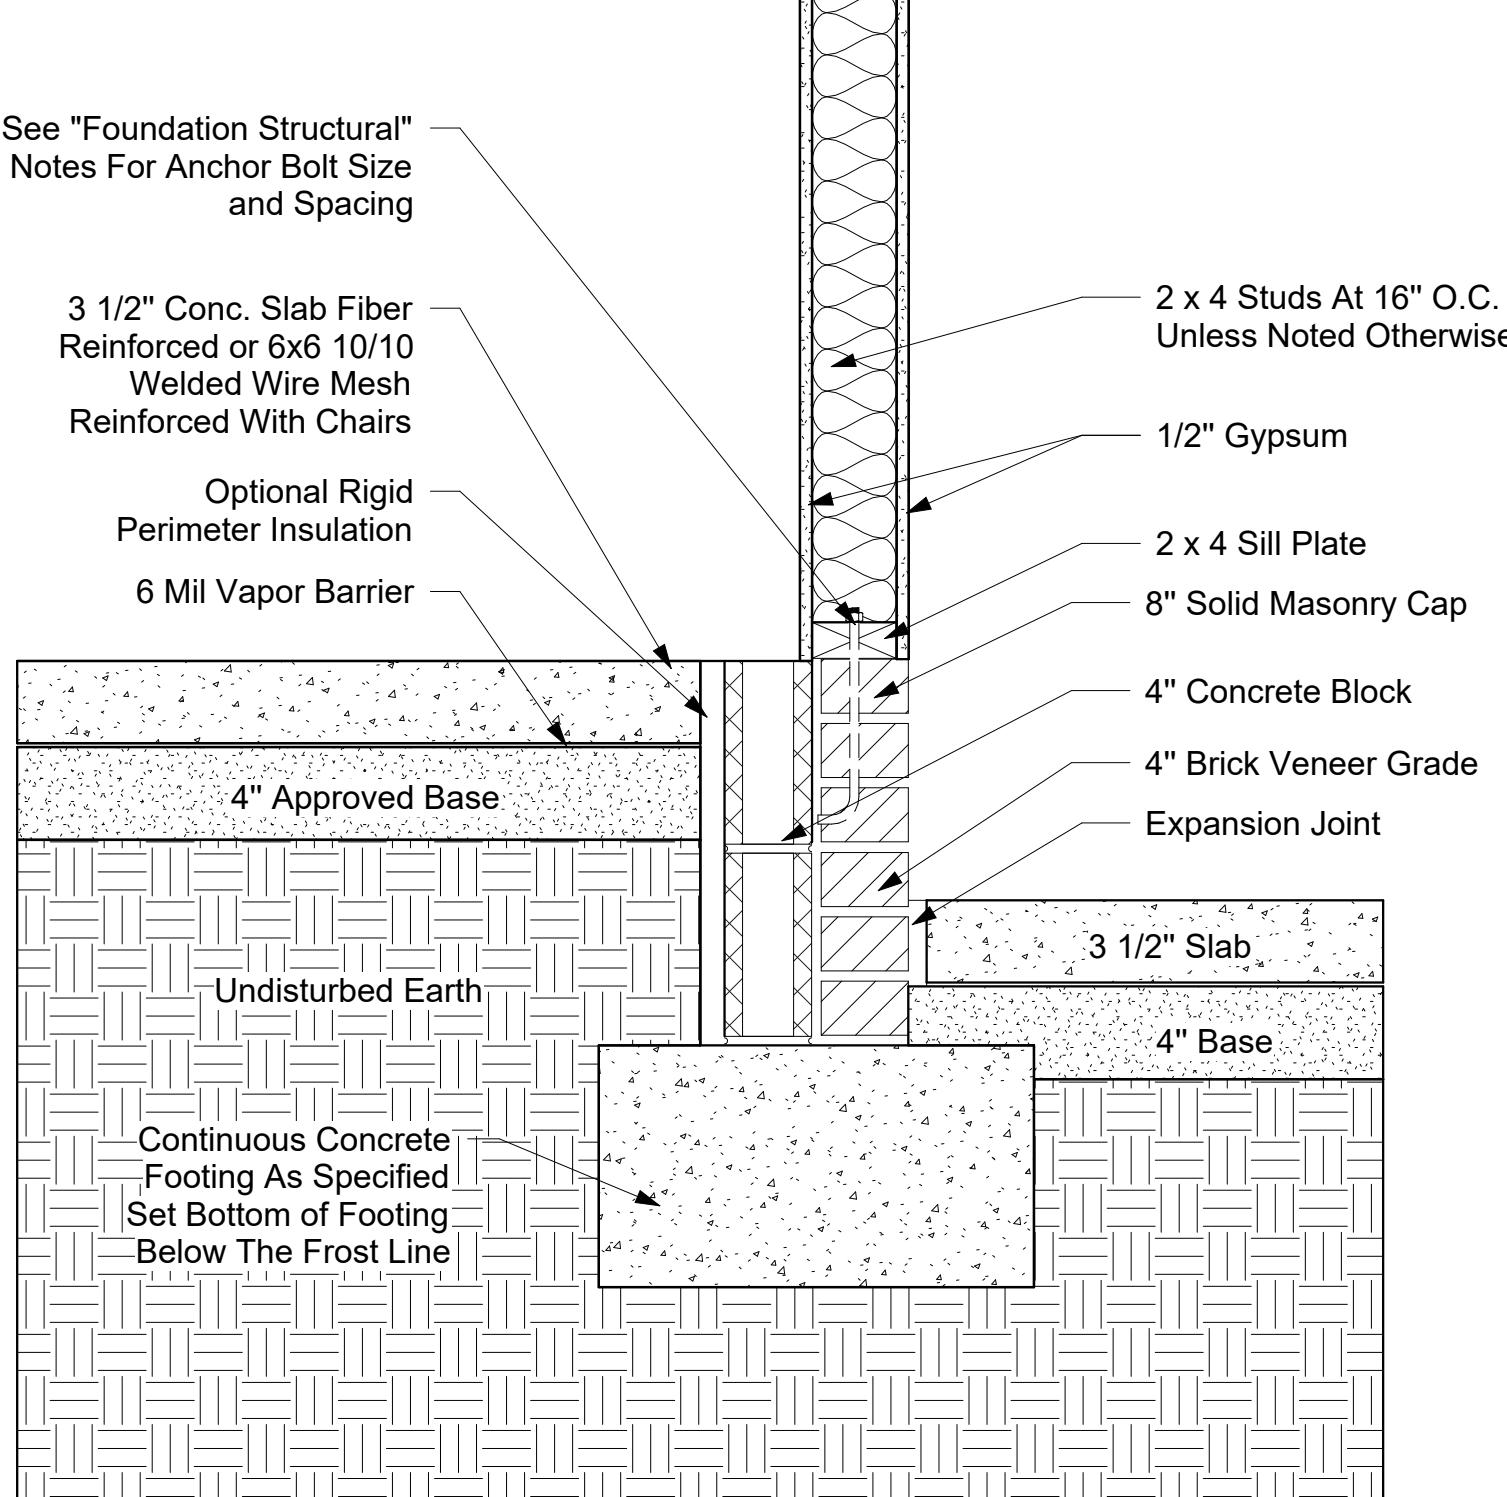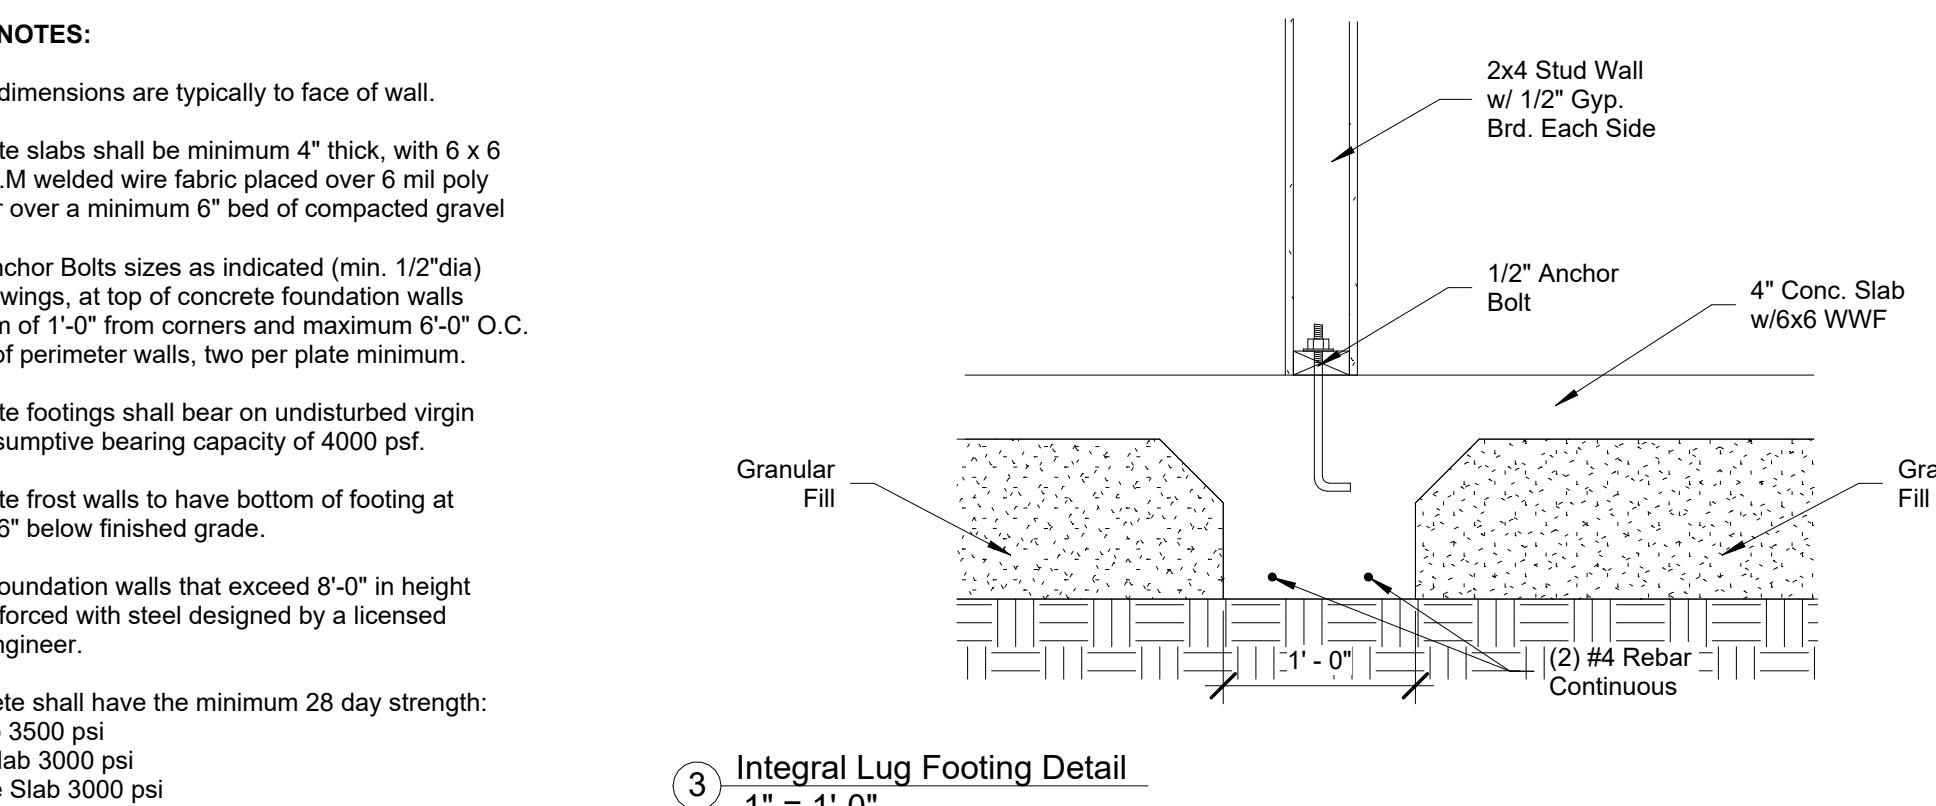

## Roofing Ventilation

## Section R806

**R806.1 Ventilation Required.** Enclosed attics and enclosed rafter spaces formed where ceilings are applied directly to the underside of the roof rafters shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow. Ventilation openings shall have a least dimension of 1/16 inch minimum and 1/4 inch maximum. Ventilation opening having a least dimension larger than 1/4 inch shall be provided with corrosion-resistant wire cloth screening, hardware cloth, or similar material with openings having a least dimension of 1/16 inch minimum and 1/4 inch maximum. Openings in roof framing members shall conform to the requirements of Section 802.7.

**R806.2 Minimum Area.** The total net free ventilating area shall not be less than 1/150 of the area of the space ventilated except that reduction of the total area to 1/300 is permitted provided that at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet above the eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents. As an alternative, the net free cross-ventilation area may be reduced to 1/300 when Class I or Class II vapor retarder is installed on the warm-in-winter side of the ceiling.

1. Enclosed attic/rafter spaces requiring less than 1 square foot of ventilation may be vented with continuous soffit ventilation only.
2. Enclosed attic/rafter spaces over unconditioned space may be vented with continuous soffit ventilation only.

<b><u>Square Footage Being Ventilated:</u></b>	3,143 Sq. Ft.
<b><u>Net Free Cross Ventilation Needed:</u></b>	
• Without 50% to 80% of venting 3'-0" Above Eave:	20.95 Sq. Ft.
• With 50% to 80% of venting 3'-0" above eave or Class I or ClassII Vapor Retarder :	10.47 Sq. Ft


<b>Net Free Cross Ventilation Needed:</b>	
Without 50% to 80% of venting 3'-0" Above Eave:	20.95 Sq. Ft.
With 50% to 80% of venting 3'-0" above eave or	

With 30% to 50% of Venting 6' x 6' above save on  
Class I or ClassII Vapor Retarder : 10.47 Sq. Ft


#### **Net Free Cross Ventilation Needs**

Sq. Ft.

t

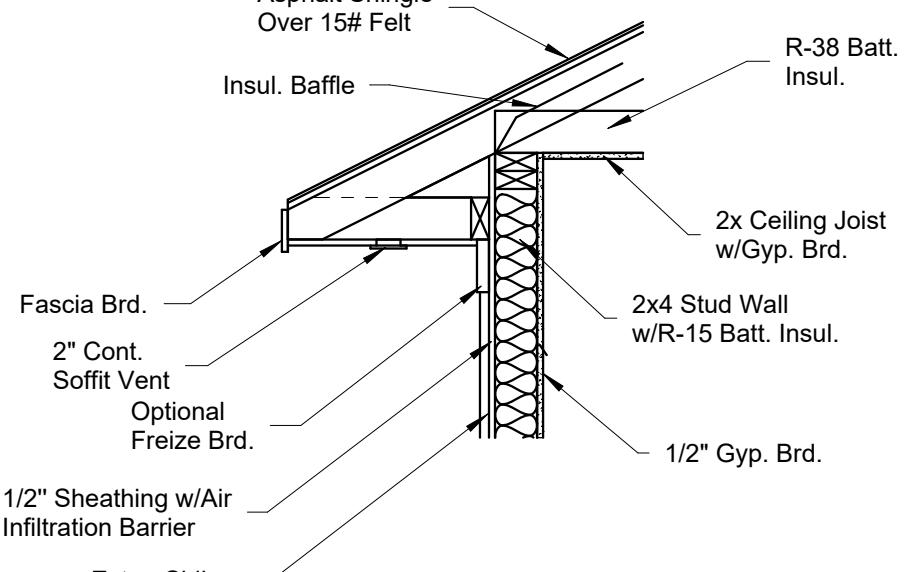

3 Detail - Cornice Typical  
3/4" = 1'-0"

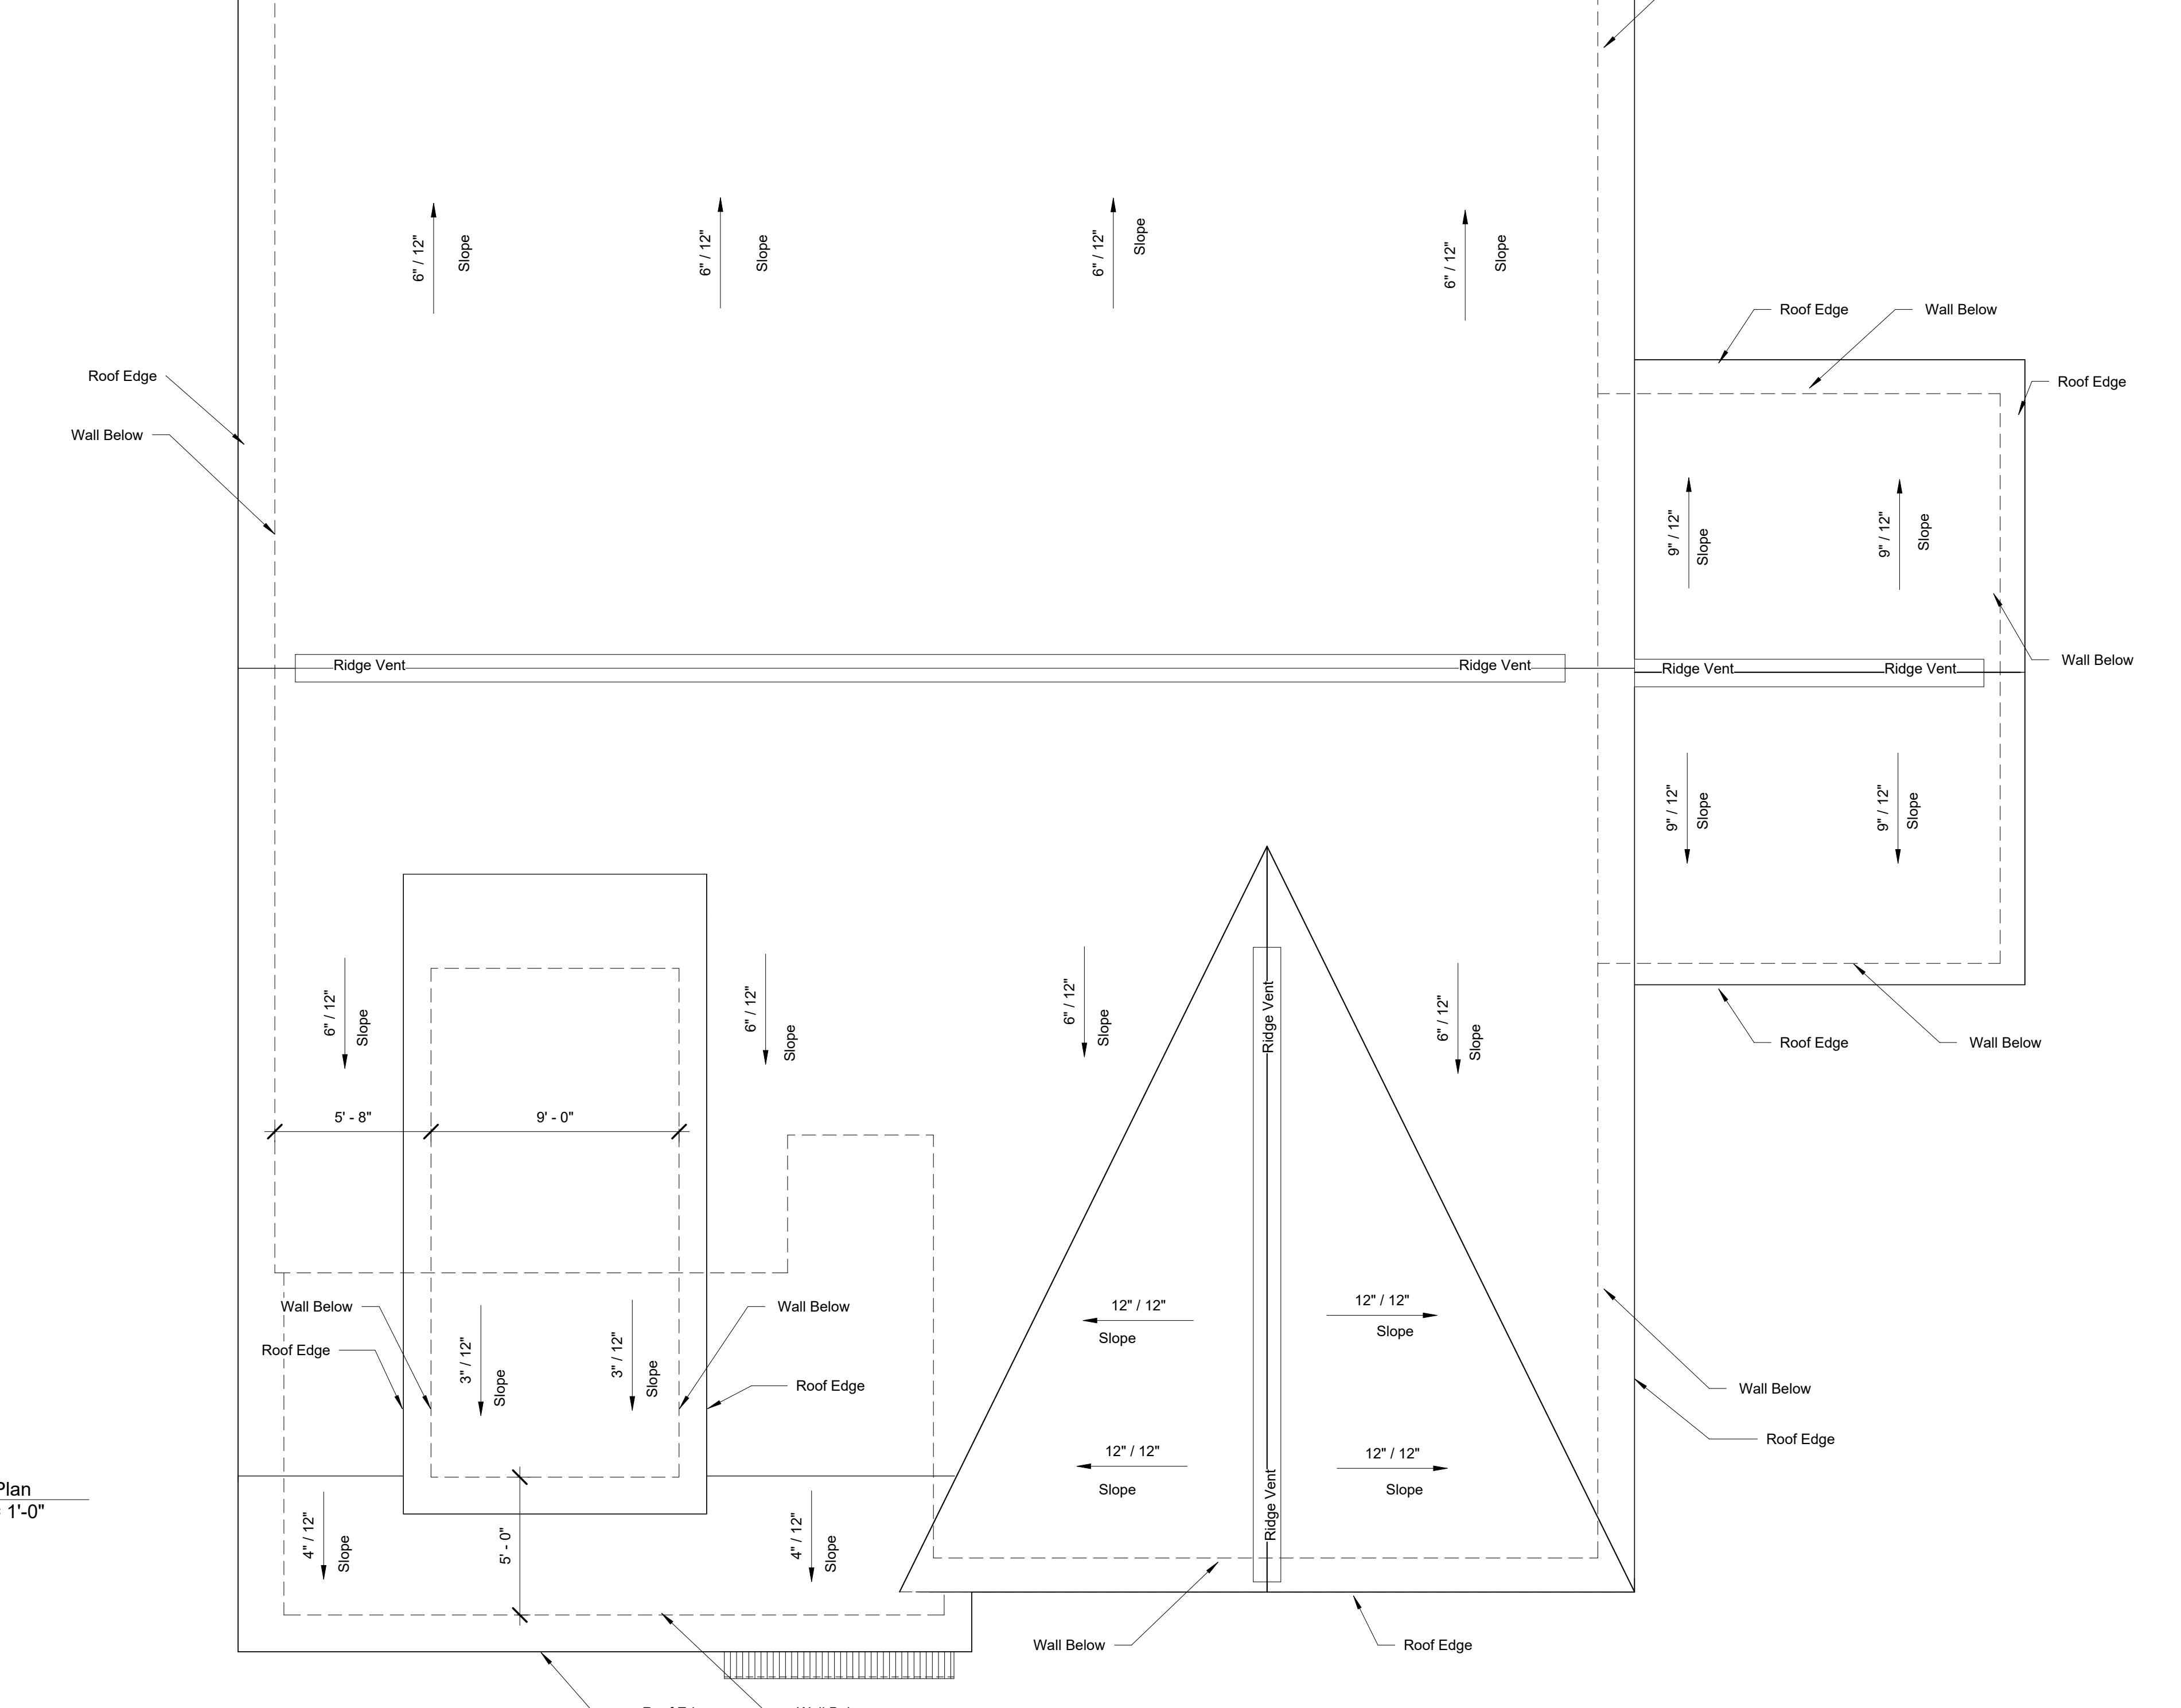

## 1 Roof Plan

## Detail - Porch Header

$$3/4'' = 1\text{--}0''$$

## 1 Roof Plan 1/4" = 1'-0"

5

Charles Temm

The Lauren III

Weaver Development  
Companies

Structural Plan

Revisions:

SCALE:

1/4" = 1'-0"

DATE:

October 31, 2025

Project number

0602202500021

Drawn by DF

Checked by TP

Structural Notes

All construction shall conform to the latest requirements of the 2018 North Carolina Residential Building Code, plus all local codes and regulations. This document in no way shall be construed to supersede the code.

Braced Wall Panel Notes

All exterior walls shall be sheathed with CS-WSP or CS-SFB

in accordance with Section R602.10.3 unless otherwise noted

**Gypsum.**

All interior sides of exterior walls and both sides of interior walls shall be sheathed with gypsum board. Gypsum board shall not use metal GB gypsum to be fastened per details R702.3.5. Method GB shall be fastened per R602.10.1.

Required Length of Bracing.

Required brace wall length for each side of the circumscribed rectangle are interpolated per table R602.10.3. Methods CS-WSP and SC-SFB contribute their actual length. Method GB contributes 0.5 its actual length. Method PF contributes 1.5 times its actual length.

Truss and I-Joist Members.

All roof truss and I-Joist layouts shall be prepared in accordance with this document. Trusses and I-Joists shall be installed according to manufacturer's specifications.

**Lintels.**

Brick lintels shall be 3 1/2" x 3 1/2" x 1/4" steel angle for up to 6'-0" and 6" x 4" x 5/16" steel angle with 6" leg vertical for spans up to 9'-0" unless otherwise noted.

**Concrete & Soils.**  
See Foundation Notes

Roof Truss Requirements

Truss Design. Trusses to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to the Designer's attention prior to commencing construction.

**Knee Wall and Ceiling Heights.** All finished knee wall heights and ceiling heights are shown furred down 10" from the decking for the insulation. If for any reason the truss manufacturer fails to meet or exceed designated heel heights, finished knee wall heights of finished ceiling heights shown on these plans, the finished square footage may vary. Any discrepancies must be brought to the attention of the designer for a suitable solution prior to commencing construction.

**Anchorages.** All required anchors for trusses due to uplift or bearing shall meet the requirements as specified by the truss manufacturer's schematics.

**Bearing.** All trusses shall be designed for bearing on SPF #2 plates or ledgers unless otherwise noted.

**Plate Heights & Floor Systems.** See Elevations and Sections for plate heights and floor thicknesses.

Use	Live Load (PSF)	Dead Load (PSF)	Deflection (LL)
Attic Without Storage	10	10	L/240
Attic With Limited Storage	20	10	L/360
Attic With Fixed Stairs	40	10	L/360
Balconies & Decks	40	10	L/360
Fire Escapes	40	10	L/360
Guardrails & Handrails	200	--	--
Guardrail Infill Components	50	--	--
Passenger Vehicle Garages	50	10	L/360
Rooms Other Than Sleeping	40	10	L/360
Sleeping Rooms	30	10	L/360
Stairs	40	--	L/360
Snow	20	--	--

Header Schedule

Header	Size	Columns
H-1	(2) 2x4	1 Jack 1 King
H-2	(2) 2x6	1 Jack 1 King
H-3	(2) 2x8	1 Jack 1 King
H-4	(2) 2x10	2 Jack 1 King
H-5	(2) 2x12	2 Jack 1 King
H-6	(1) 3 1/2"x9 1/2" LVL	2 Jack 1 King
H-7	(1) 3 1/2"x11 7/8" LVL	2 Jack 1 King

All non load bearing headers to be ladder framed or (2) 2x4 with 1 Jack and 1 King Stud unless otherwise noted

Brace Wall Factors

Max Eave to Ridge	Wind Speed	Exposure	Seismic Category
13'-0"	120	B	A or B

Rectangle A

Side	Perp. Distance	Required	Provided
1	40'-0"	18'-2"	24'-8"
2	40'-0"	18'-2"	19'-8"
3	39'-0"	17'-9"	25'-3"
4	39'-0"	17'-9"	34'-2"

Wall Height: 9'-0"

Roof +1

Eave: 13'-0"

8x8 PT Post or Equiv. Typical  
Attach Rafters To Header With Hurricane  
Connectors (Simpson H2.5 or Equiv.)  
Attach Header To Post And Post To Base  
With Post Cap, Metal Straps And/Or Post Base.

1 First Floor Structural Plan  
1/4" = 1'-0"

**Note:**  
Upper Story Bracing Not  
Shown Per R602.10.3.2 (5)&(6)

