

Harnett County Department of Public Health

PERMIT # SFD 2411-0003

Operation Permit

☒ New Installation ☒ Septic Tank ☒ Nitrification Line ☐ Repair ☐ Expansion

PROPERTY LOCATION: 194 Travelers Way (SR1116)

Name: (owner) Calemont Holding Inc SUBDIVISION Calemont Ph III B LOT # 356

System Installer: D. Gaddy

Basement with plumbing: ☐ Garage ☒ Number of Bedrooms 3 (6 people)


Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feet

System Type: TYPE III S Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

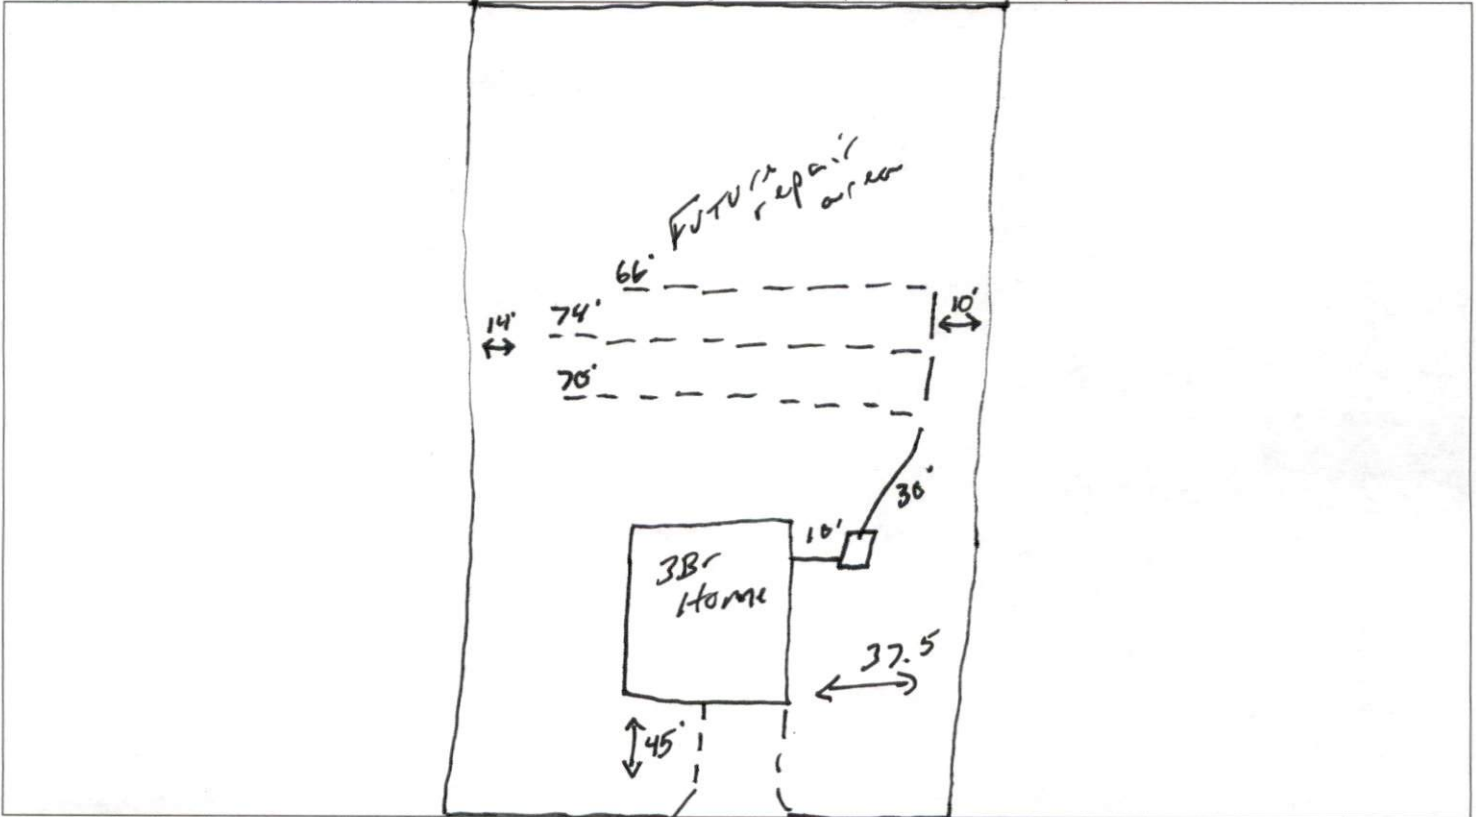

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
 II. Monitoring: As required by Rule .1961.
 III. Maintenance: As required by Rule .1961. Other: _____
 Subsurface system operator required? Yes ☐ No ☒
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

- IV. Operation: _____
 V. Other: _____

☐ _____ D-Box ☐ _____ Pump ☐ _____ Alarm ☐ _____ H2O Line ☐ _____ PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% reduction I & 4 Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface No. of exact length width of depth of
 Drainage Field ditches 1 of each ditch 210 feet ditches 3 feet ditches 22 inches
 French Drain Required: _____ Linear feet

Authorized State Agent


[Signature] PETH

Date 12-4-25

*At time of installation septic installer modified final installation as shown.
Modification is "Approved" by Alex Adams

Sketched from a plot plan supplied by owner

****1000 Gallon Septic and Pump Tank**
Tank and trenches to be located minimum of 10' from any property line and minimum of 5' from any building foundation.
*Do Not Cut, Fill, or Alter Drainfield or Repair Area
*Comply with all setbacks
*Contact local health dept. and/or Alex Adams prior to or during installation with any questions or concerns.

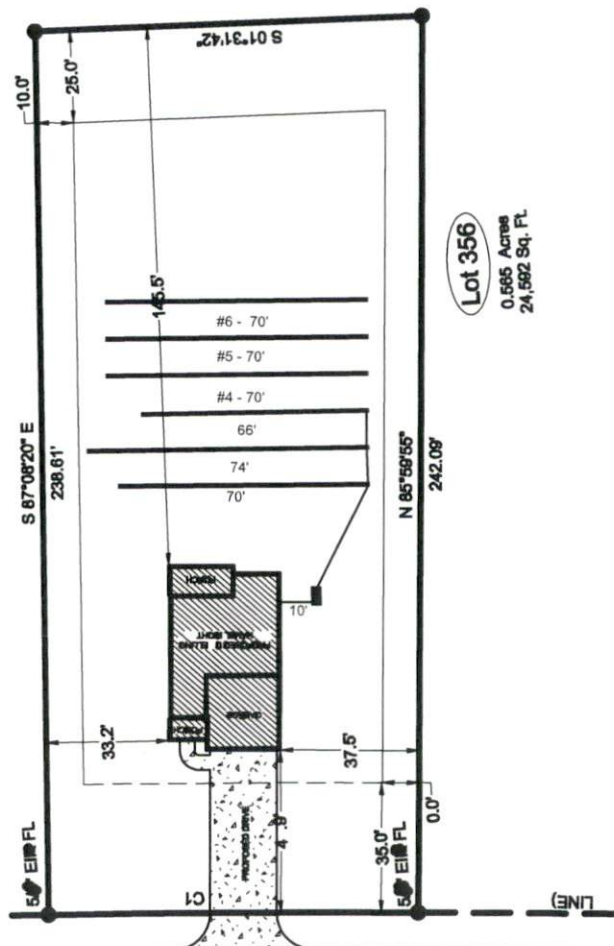

TRAVELERS WAY
(PRI ATE 507)

Adams
Soil Consulting
919-414-6761
Job #1968
11-10-25

$$1'' = 50'$$
